

NOT THE GRANTING OF A PERMIT NOR REVIEWING OF SPECS
& DRAWINGS NOR INSPECTIONS MADE DURING INSTALLATION
BY THE OFFICIAL HAVING JURISDICTION SHALL RELIEVE THE
OWNER FROM REQUIREMENTS OF THE ONTARIO BUILDING
CODE AND ANY OTHER REFERENCED REQUIREMENTS.

Garden 3 - Elevation 3

SITE NAME: BARLASSINA

BUILDER: GREENPARK HOMES

TYPE: GARDEN 3

GFA: 2415

DATE: Aug-22

LO# 98640

WINTER NATURAL AIR CHANGE RATE 0.335

SUMMER NATURAL AIR CHANGE RATE 0.091

HEAT LOSS ΔT °F. 72HEAT GAIN ΔT °F. 9

CSA-F280-12

SB-12 PACKAGE A1

ROOM USE			MBR		ENS		WIC-3		BED-2		BED-3		MEDIA		BATH				WIC							
EXP. WALL			33		27		6		34		32		17		12				8							
CLG. HT.			9		9		9		9		9		9		9				9							
FACTORS																										
GRS.WALL AREA	LOSS GAIN		297		243		54		306		288		153		108				72							
GLAZING			LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN				LOSS GAIN							
NORTH	20.3	15.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EAST	20.3	40.5	0	0	0	0	0	0	0	33	669	1338	30	608	1216	0	0	0	0	0	0	0	0	0	0	0
SOUTH	20.3	23.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	14	284	334	0	0	0	0	0
WEST	20.3	40.5	20	405	811	14	284	568	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SKYLT.	35.5	99.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
DOORS	19.1	2.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	4.3	0.5	277	1178	150	229	974	124	54	230	29	273	1161	147	258	1097	139	153	650	83	94	400	51	72	306	39
NET EXPOSED BSMT WALL ABOVE GR	3.4	0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.2	0.5	272	333	143	162	198	85	37	45	19	193	236	102	185	226	97	249	304	131	84	103	44	128	156	67
NO ATTIC EXPOSED CLG	2.6	1.1	0	0	0	0	0	0	0	0	0	15	39	17	15	39	17	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.4	0.3	0	0	0	0	0	0	37	90	11	0	0	0	240	583	74	29	70	9	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS																										
SLAB ON GRADE HEAT LOSS																										
SUBTOTAL HT LOSS					1916			1455			365			2105			2554			1025			786			463
SUB TOTAL HT GAIN						1104			777		60			1604			1544		223			430				106
LEVEL FACTOR / MULTIPLIER			0.20	0.25		0.20	0.25		0.20	0.25		0.20	0.25		0.20	0.25		0.20	0.25		0.20	0.25		0.20	0.25	
AIR CHANGE HEAT LOSS					473			359			90			520			630			253			194			114
AIR CHANGE HEAT GAIN						54		38			3			79			76			11			21			5
DUCT LOSS					0			0			45			0			318			128			0			0
DUCT GAIN					0			0			6			0			230			68			0			0
HEAT GAIN PEOPLE	240		2		480	0		0	0		1		240	1		240	0	0	0	0	0	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS					445			0			0			445			445			445			0			445
TOTAL HT LOSS BTU/H					2388			1815			500			2624			3502			1406			980			577
TOTAL HT GAIN x 1.3 BTU/H						2708		1059			90			3078			3296			970			586			723

ROOM USE			LIV/DIN		K/F/B		LAUN			W/R		FOY		MUD						LOD		BAS			
EXP. WALL			32		77		6			6		33		22						34		162			
CLG. HT.			10		10		9			10		11		11						8		8			
FACTORS																									
GRS.WALL AREA	LOSS	GAIN	320		770		54			60		363		242				272		912					
GLAZING			LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN		LOSS	GAIN	LOSS	GAIN				
NORTH	20.3	15.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
EAST	20.3	40.5	0	0	0	0	0	0	0	0	0	0	30	608	1216	0	0	0	0	0	0	0			
SOUTH	20.3	23.9	28	568	669	28	568	669	7	142	167	7	142	167	0	0	0	0	0	0	10	203	239		
WEST	20.3	40.5	0	0	0	56	1135	2270	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
SKYLT.	35.5	99.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
DOORS	19.1	2.4	0	0	0	25	478	61	0	0	0	0	0	0	18	344	44	21	401	51	0	401	51		
NET EXPOSED WALL	4.3	0.5	292	1241	158	661	2810	357	47	200	25	53	225	29	315	1339	170	221	940	119	0	0	0		
NET EXPOSED BSMT WALL ABOVE GR	3.4	0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	197	675	86		
EXPOSED CLG	1.2	0.5	0	0	0	0	0	0	48	59	25	0	0	0	0	0	0	0	0	0	0	0	0		
NO ATTIC EXPOSED CLG	2.6	1.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
EXPOSED FLOOR	2.4	0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
BASEMENT/CRAWL HEAT LOSS																									
SLAB ON GRADE HEAT LOSS																							5169		
SUBTOTAL HT LOSS				1809			4991			400			367			2291			1341			817		7089	
SUB TOTAL HT GAIN					827			3357			218			196			1430			170			370		457
LEVEL FACTOR / MULTIPLIER			0.30	0.38		0.30	0.38		0.20	0.25		0.30	0.38		0.30	0.38		0.30	0.38				0.50	0.86	
AIR CHANGE HEAT LOSS				687			1894			99			139			870			509					6831	
AIR CHANGE HEAT GAIN					41		165			11			10			70			8					41	
DUCT LOSS				0			0			0			0			0			0					0	
DUCT GAIN					0		0			0			0			0			0					0	
HEAT GAIN PEOPLE	240			0		0	0		0	0		0	0		0	0		0	0		0	0		0	
HEAT GAIN APPLIANCES/LIGHTS					445		445			445			0			0			445			0		445	
TOTAL HT LOSS BTU/H				2496			6885			499			507			3161			1850			817		13920	
TOTAL HT GAIN x 1.3 BTU/H					1706			5157			876			267			1951			811			481		1225

TOTAL HEAT GAIN BTU/H:

25142

TONS: 2.10

LOSS DUE TO VENTILATION LOAD BTU/H: 1243

STRUCTURAL HEAT LOSS: 43927

TOTAL COMBINED HEAT LOSS BTU/H: 45170



SITE NAME: BARLASSINA

BUILDER: GREENPARK HOMES

TYPE: GARDEN 3

DATE: Aug-22

GFA: 2415

LO# 98640

HEATING CFM 928 COOLING CFM 928
TOTAL HEAT LOSS 43,927 TOTAL HEAT GAIN 24,984
AIR FLOW RATE CFM 21.13 AIR FLOW RATE CFM 37.14

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure
for s/a & r/a 0.35

#GOODMAN
GMEC960603BNA 60
FAN SPEED LOW
MEDLOW
MEDIUM 928
MEDIUM HIGH 1017
HIGH 1131

AFUE = 96 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 57,600

DESIGN CFM = 928
CFM @ .6" E.S.P.

TEMPERATURE RISE 57 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	13	7	4
R/A	0	0	4	1	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	WIC-3	BED-2	BED-3	MEDIA	BATH	BED-2	BED-3	MBR	BATH	LIV/DIN	K/F/B	K/F/B	K/F/B	LAUN	W/R	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.19	1.81	0.50	1.31	1.75	1.41	0.49	1.31	1.75	1.19	0.49	2.50	2.29	2.29	2.29	0.50	0.51	3.16	1.85	3.68	3.68	3.68	3.68
CFM PER RUN HEAT	25	38	11	28	37	30	10	28	37	25	10	53	48	48	48	11	11	67	39	78	78	78	78
RM GAIN MBH.	1.35	1.06	0.09	1.54	1.65	0.97	0.29	1.54	1.65	1.35	0.29	1.71	1.72	1.72	1.72	0.88	0.27	1.95	0.81	0.43	0.43	0.43	0.43
CFM PER RUN COOLING	50	39	3	57	61	36	11	57	61	50	11	63	64	64	64	33	10	72	30	16	16	16	16
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	54	30	77	63	70	27	35	70	77	41	63	29	38	27	31	57	48	63	51	35	25	33	47
EQUIVALENT LENGTH	140	210	120	150	160	200	200	140	170	200	170	150	120	170	110	180	160	130	140	110	130	130	170
TOTAL EFFECTIVE LENGTH	194	240	197	213	230	227	235	210	247	241	233	179	158	197	141	237	208	193	191	145	155	163	217
ADJUSTED PRESSURE	0.09	0.07	0.09	0.08	0.07	0.08	0.07	0.08	0.07	0.07	0.07	0.1	0.11	0.09	0.12	0.07	0.08	0.09	0.09	0.12	0.11	0.11	0.08
ROUND DUCT SIZE	5	5	4	5	5	4	4	5	5	5	4	5	5	5	5	4	4	5	4	5	5	5	6
HEATING VELOCITY (ft/min)	184	279	126	206	272	344	115	206	272	184	115	389	352	352	352	126	126	492	447	573	573	573	398
COOLING VELOCITY (ft/min)	367	286	34	419	448	413	126	419	448	367	126	463	470	470	470	379	115	529	344	117	117	117	82
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10
TRUNK	C	D	B	A	A	D	B	A	A	D	B	B	C	D	C	B	A	A	B	C	D	B	A

RUN #	25
ROOM NAME	WIC
RM LOSS MBH.	0.58
CFM PER RUN HEAT	12
RM GAIN MBH.	0.72
CFM PER RUN COOLING	27
ADJUSTED PRESSURE	0.17
ACTUAL DUCT LGH.	11
EQUIVALENT LENGTH	135
TOTAL EFFECTIVE LENGTH	146
ADJUSTED PRESSURE	0.12
ROUND DUCT SIZE	4
HEATING VELOCITY (ft/min)	138
COOLING VELOCITY (ft/min)	310
OUTLET GRILL SIZE	3X10
TRUNK	C

SUPPLY AIR TRUNK SIZE																RETURN AIR TRUNK SIZE							
	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)			TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)		
TRUNK A	286	0.07	9.1	10	x	8	515	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.05	0	0	x	8	0
TRUNK B	498	0.07	11.2	14	x	8	640	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.05	0	0	x	8	0
TRUNK C	211	0.09	7.6	8	x	8	475	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.05	0	0	x	8	0
TRUNK D	430	0.07	10.6	14	x	8	553	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.05	0	0	x	8	0
TRUNK E	0	0.00	0	0	x	8	0	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.05	0	0	x	8	0
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.05	0	0	x	8	0
																TRUNK U	0	0.05	0	0	x	8	0
																TRUNK V	0	0.05	0	0	x	8	0
																TRUNK W	0	0.05	0	0	x	8	0
																TRUNK X	928	0.05	15.3	28	x	8	597
																TRUNK Y	550	0.05	12.6	18	x	8	550
																TRUNK Z	0	0.05	0	0	x	8	0
																DROP	928	0.05	15.3	24	x	10	557

RETURN AIR #	1	2	3	4	5										BR
AIR VOLUME	145	115	115	115	320	0	0	0	0	0	0	0	0	0	118
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	39	73	74	59	49	1	1	1	1	1	1	1	1	1	16
EQUIVALENT LENGTH	175	245	250	215	205	0	0	0	0	0	0	0	0	0	175
TOTAL EFFECTIVE LH	214	318	324	274	254	1	1	1	1	1	1	1	1	1	191
ADJUSTED PRESSURE	0.07	0.05	0.05	0.05	0.06	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.08
ROUND DUCT SIZE	7	7	7	7	9.8	0	0	0	0	0	0	0	0	0	6.3
INLET GRILL SIZE	8	8	8	8	8	0	0	0	0	0	0	0	0	0	8
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	30	0	0	0	0	0	0	0	0	0	14

TYPE: GARDEN 3
SITE NAME: BARLASSINA

LO # 98640

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐ Other:	Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm <u>42.4</u> cfm	
Other Bedrooms	<u>2</u> @ 10.6 cfm <u>21.2</u> cfm	
Kitchen & Bathrooms	<u>4</u> @ 10.6 cfm <u>42.4</u> cfm	
Other Rooms	<u>7</u> @ 10.6 cfm <u>74.2</u> cfm	
Table 9.32.3.A.	TOTAL <u>180.2</u> cfm	

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8 cfm	
2 Bedroom	47.7 cfm	
3 Bedroom	63.6 cfm	
4 Bedroom	79.5 cfm	
5 Bedroom	95.4 cfm	
TOTAL	63.6 cfm	

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>180.2</u> cfm	
Less Principal Ventil. Capacity	<u>63.6</u> cfm	
Required Supplemental Capacity	<u>116.6</u> cfm	

PRINCIPAL EXHAUST FAN CAPACITY	
Model: VANEE V150H	Location: BSMT
<u>63.6</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
63.6 CFM	X 72 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH	BY INSTALLING CONTRACTOR	50	☒	3.5
W/R	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE V150H		
<u>150</u> cfm high	<u>35</u> cfm low	
<u>75</u> % Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved	

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER: GREENPARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	August-22

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 98640	Model: GARDEN 3	Builder: GREENPARK HOMES	Date: 8/25/2022																																																									
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1088</td> <td>8</td> <td>8704</td> </tr> <tr> <td>First</td> <td>1088</td> <td>10</td> <td>10880</td> </tr> <tr> <td>Second</td> <td>1327</td> <td>9</td> <td>11943</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="2" style="text-align: right;">Total:</td> <td></td> <td>31,527.0 ft³</td> </tr> <tr> <td colspan="2" style="text-align: right;">Total:</td> <td></td> <td>892.7 m³</td> </tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1088	8	8704	First	1088	10	10880	Second	1327	9	11943	Third	0	9	0	Fourth	0	9	0	Total:			31,527.0 ft³	Total:			892.7 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 70%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 30%;">0.335</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.091</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-18</td> <td>40</td> <td>72</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>29</td> <td>5</td> <td>9</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.335	SUMMER NATURAL AIR CHANGE RATE	0.091	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-18	40	72	Summer DTDc	24	29	5	9
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	1088	8	8704																																																									
First	1088	10	10880																																																									
Second	1327	9	11943																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			31,527.0 ft³																																																									
Total:			892.7 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.335																																																											
SUMMER NATURAL AIR CHANGE RATE	0.091																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-18	40	72																																																								
Summer DTDc	24	29	5	9																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.335 x 247.98 x 40 °C x 1.2 = 4004 W = 13661 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.091 x 247.98 x 5 °C x 1.2 = 139 W = 475 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 64 CFM x 72 °F x 1.08 x 0.25 = 1243 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 64 CFM x 9 °F x 1.08 x 0.25 = 158 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$ <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairve Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0.5</td> <td rowspan="5" style="text-align: center; vertical-align: middle;">13,661</td> <td>7,906</td> <td>0.864</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>10,799</td> <td>0.380</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>11,068</td> <td>0.247</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> </tbody> </table> *HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0					Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	13,661	7,906	0.864	2	0.3	10,799	0.380	3	0.2	11,068	0.247	4	0	0	0.000	5	0	0	0.000																														
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																								
1	0.5	13,661	7,906	0.864																																																								
2	0.3		10,799	0.380																																																								
3	0.2		11,068	0.247																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
				Michael O'Rourke BCIN# 19669 																																																								

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: GARDEN 3	BUILDER: GREENPARK HOMES
SFQT: 2415	SITE: BARLASSINA
LO# 98640	

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	0	OUTDOOR DESIGN TEMP.	84
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.50

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	31527.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	4
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	5.0 ft
LENGTH: 57.0 ft	WIDTH: 24.0 ft	EXPOSED PERIMETER:	162.0 ft


2012 OBC - COMPLIANCE PACKAGE		Compliance Package A1	
Component		Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value		60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value		31	27.65
Exposed Floor Minimum RSI (R)-Value		31	29.80
Walls Above Grade Minimum RSI (R)-Value		22	17.03
Basement Walls Minimum RSI (R)-Value		20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value		-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value		10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value		10	11.13
Windows and Sliding Glass Doors Maximum U-Value		0.28	-
Skylights Maximum U-Value		0.49	-
Space Heating Equipment Minimum AFUE		96%	-
HRV/ERV Minimum Efficiency		75%	-
Domestic Hot Water Heater Minimum EF		0.8	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

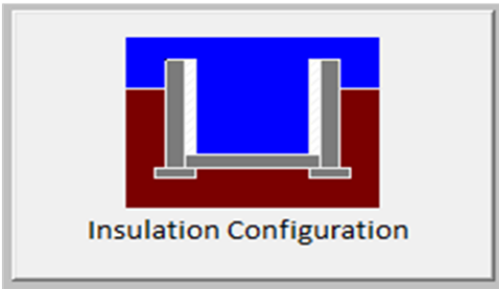Weather Station Description		
Province:	Ontario	
Region:	Cambridge	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	17.4	 Insulation Configuration
Floor Width (m):	7.3	
Exposed Perimeter (m):	0.0	
Wall Height (m):	2.4	
Depth Below Grade (m):	1.52	
Window Area (m ²):	1.6	
Door Area (m ²):	2.0	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		1515

TYPE: GARDEN 3
LO# 98640


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280


Weather Station Description				
Province:	Ontario			
Region:	Cambridge			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.62			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	892.7			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1190.1 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	30.0	30.0		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.335			
Cooling Air Leakage Rate (ACH/H):	0.091			

TYPE: GARDEN 3


LO# 98640

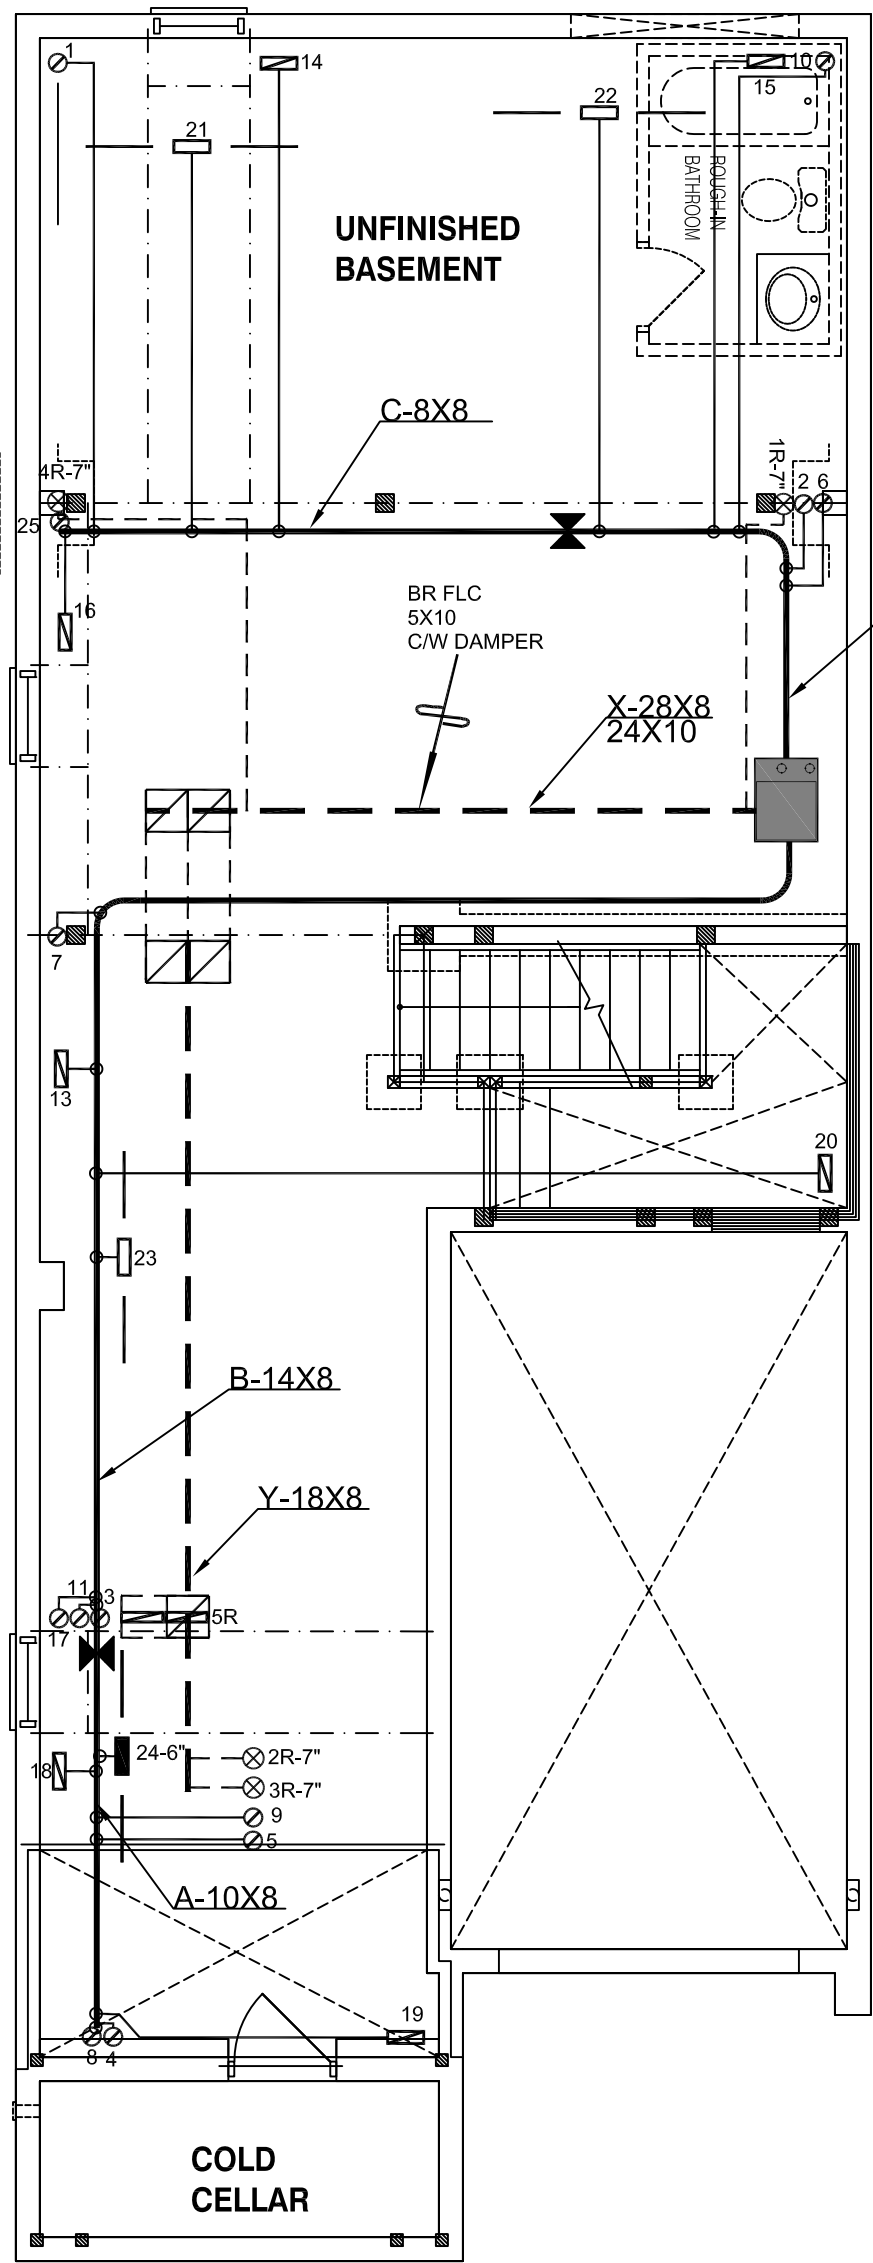


BASEMENT PLAN EL-1

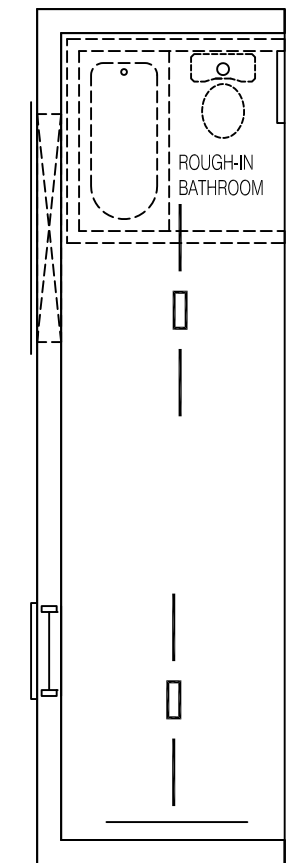

PARTIAL BASEMENT LAYOUT
FOR DECK CONDITION EL-1,2,3

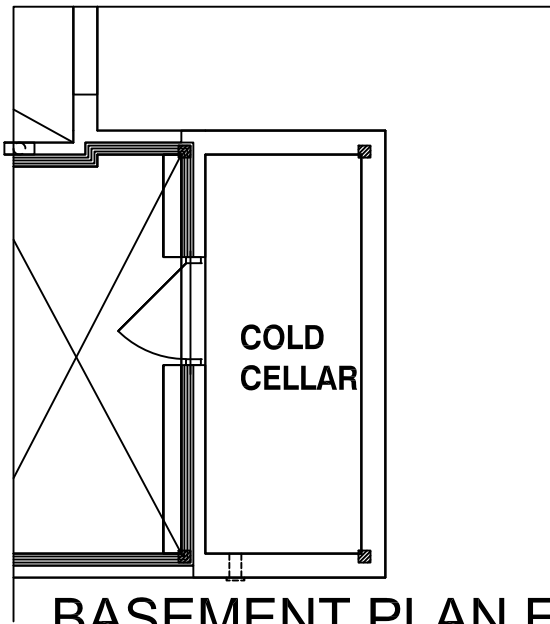

BASEMENT PLAN EL-2

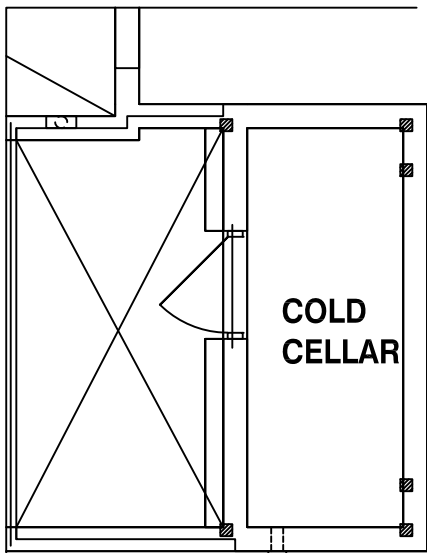

BASEMENT PLAN EL-3


CSA-F280-12
PACKAGE A1

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.



HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.


Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	HEAT LOSS 45170 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			Sheet Title		
GREENPARK HOMES			MAKE GOODMAN	3RD FLOOR				BASEMENT HEATING LAYOUT		
Project Name BARLASSINA CAMBRIDGE, ONTARIO			MODEL GMEC960603BNA	2ND FLOOR	13	4	3			
Garden 3 - Elevation 3			INPUT 60 MBTU/H	1ST FLOOR	7	1	2			
GARDEN 3			OUTPUT 57.6 MBTU/H	BASEMENT	4	1	0	Date	AUG/2022	
2415 sqft			COOLING 2.0 TONS	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A				Scale	3/16" = 1'-0"	
			FAN SPEED 928 cfm @ 0.6" w.c.					BCIN# 19669		
								LO#	98640	

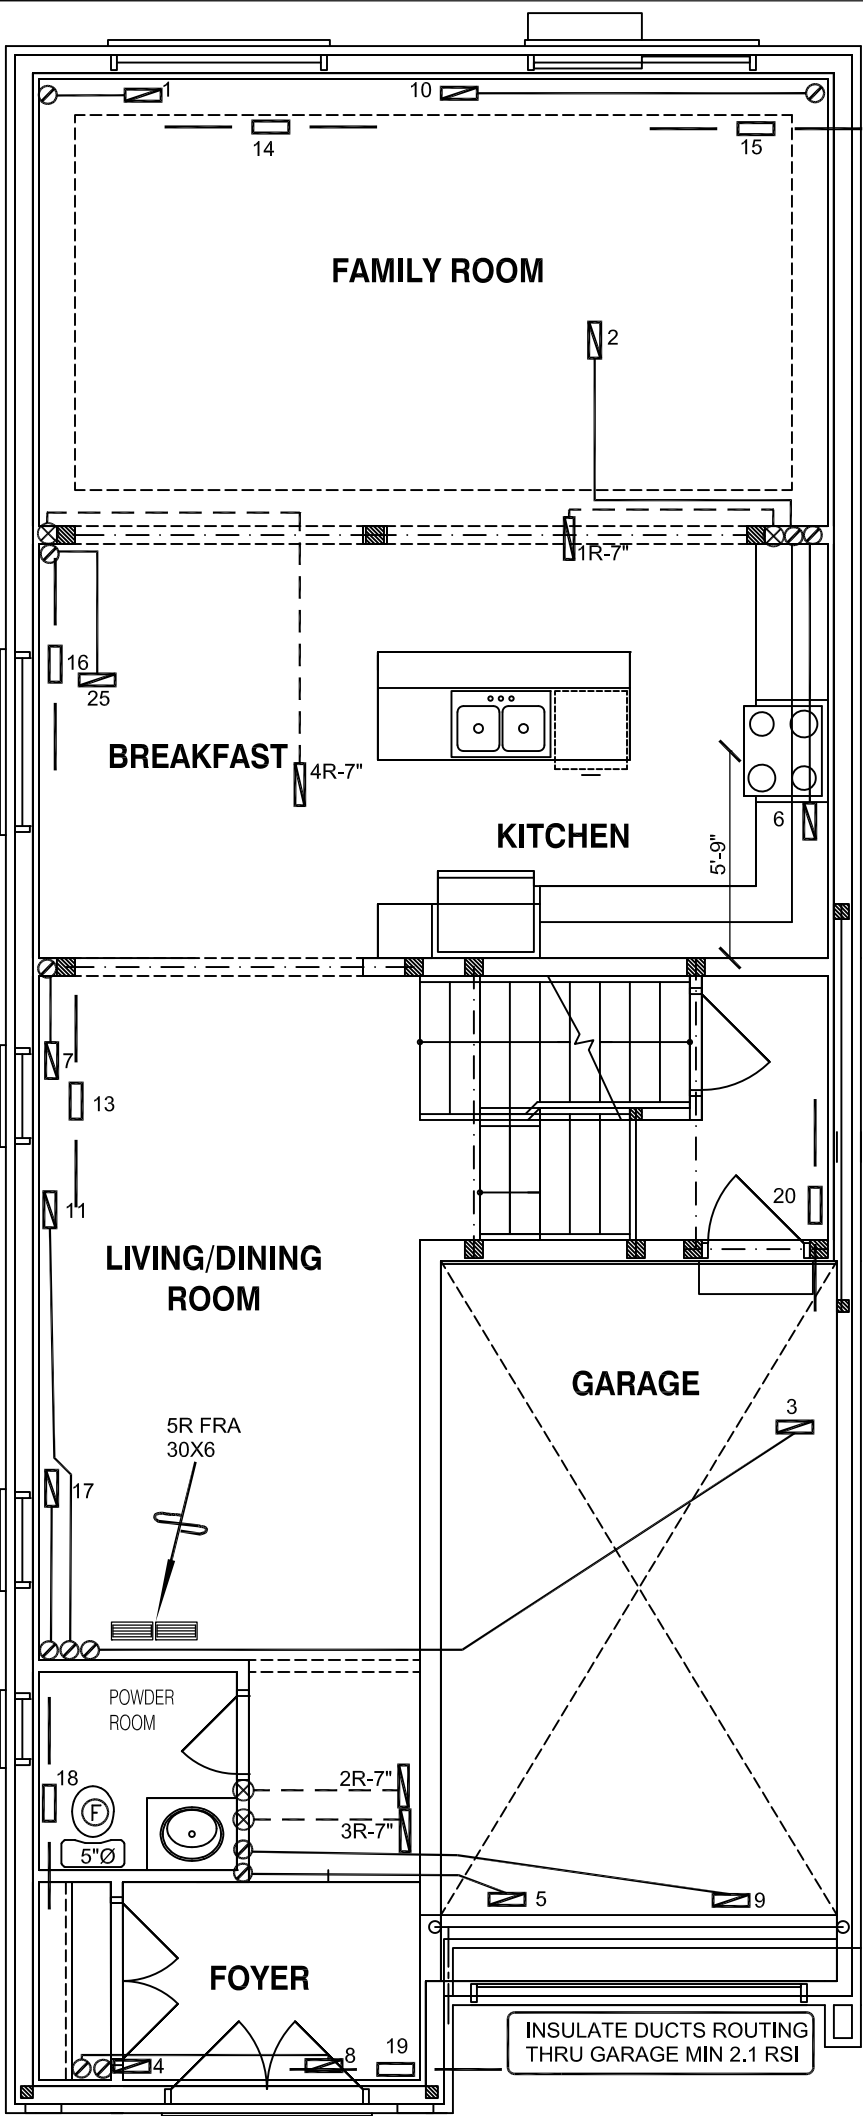

FIRST FLOOR PLAN EL-1

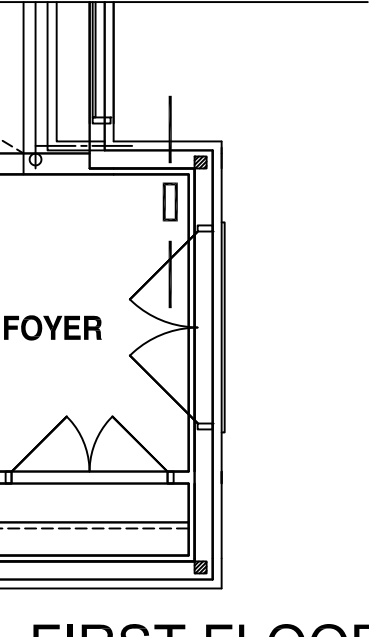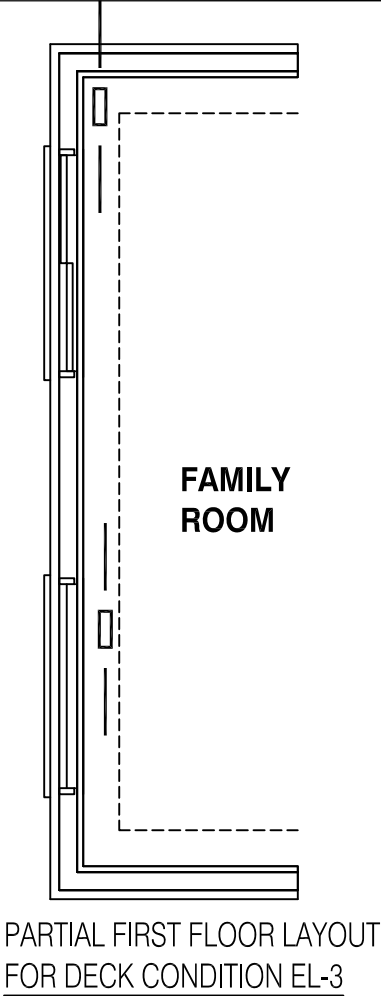

FIRST FLOOR PLAN EL-2

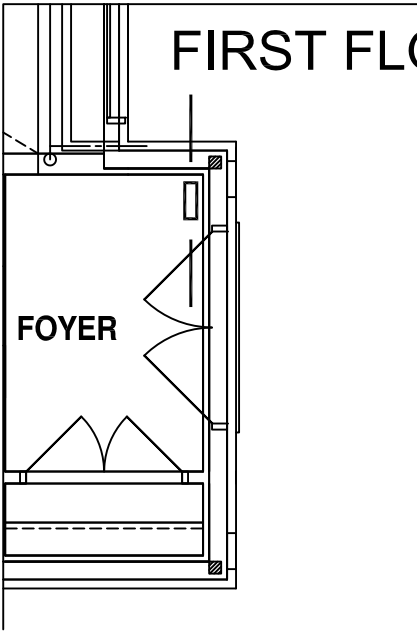

FIRST FLOOR PLAN EL-3

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.



Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1


HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GREENPARK HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	AUG/2022
BARLASSINA CAMBRIDGE, ONTARIO			Scale	3/16" = 1'-0"
Garden 3 - Elevation 3			BCIN# 19669	
GARDEN 3	2415 sqft		LO#	98640

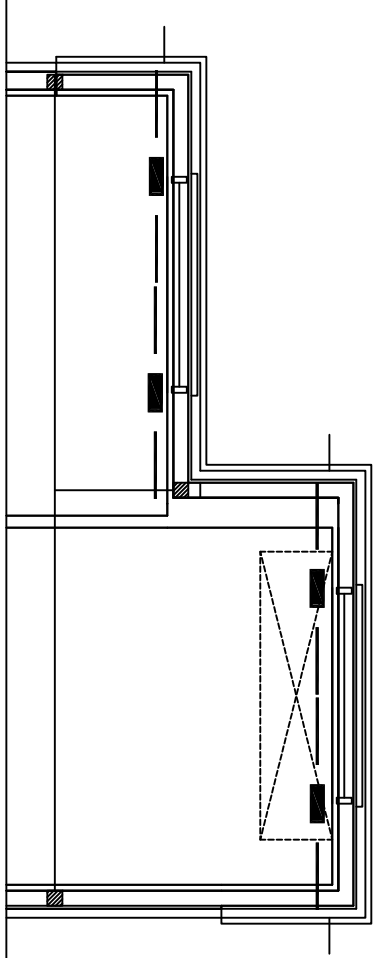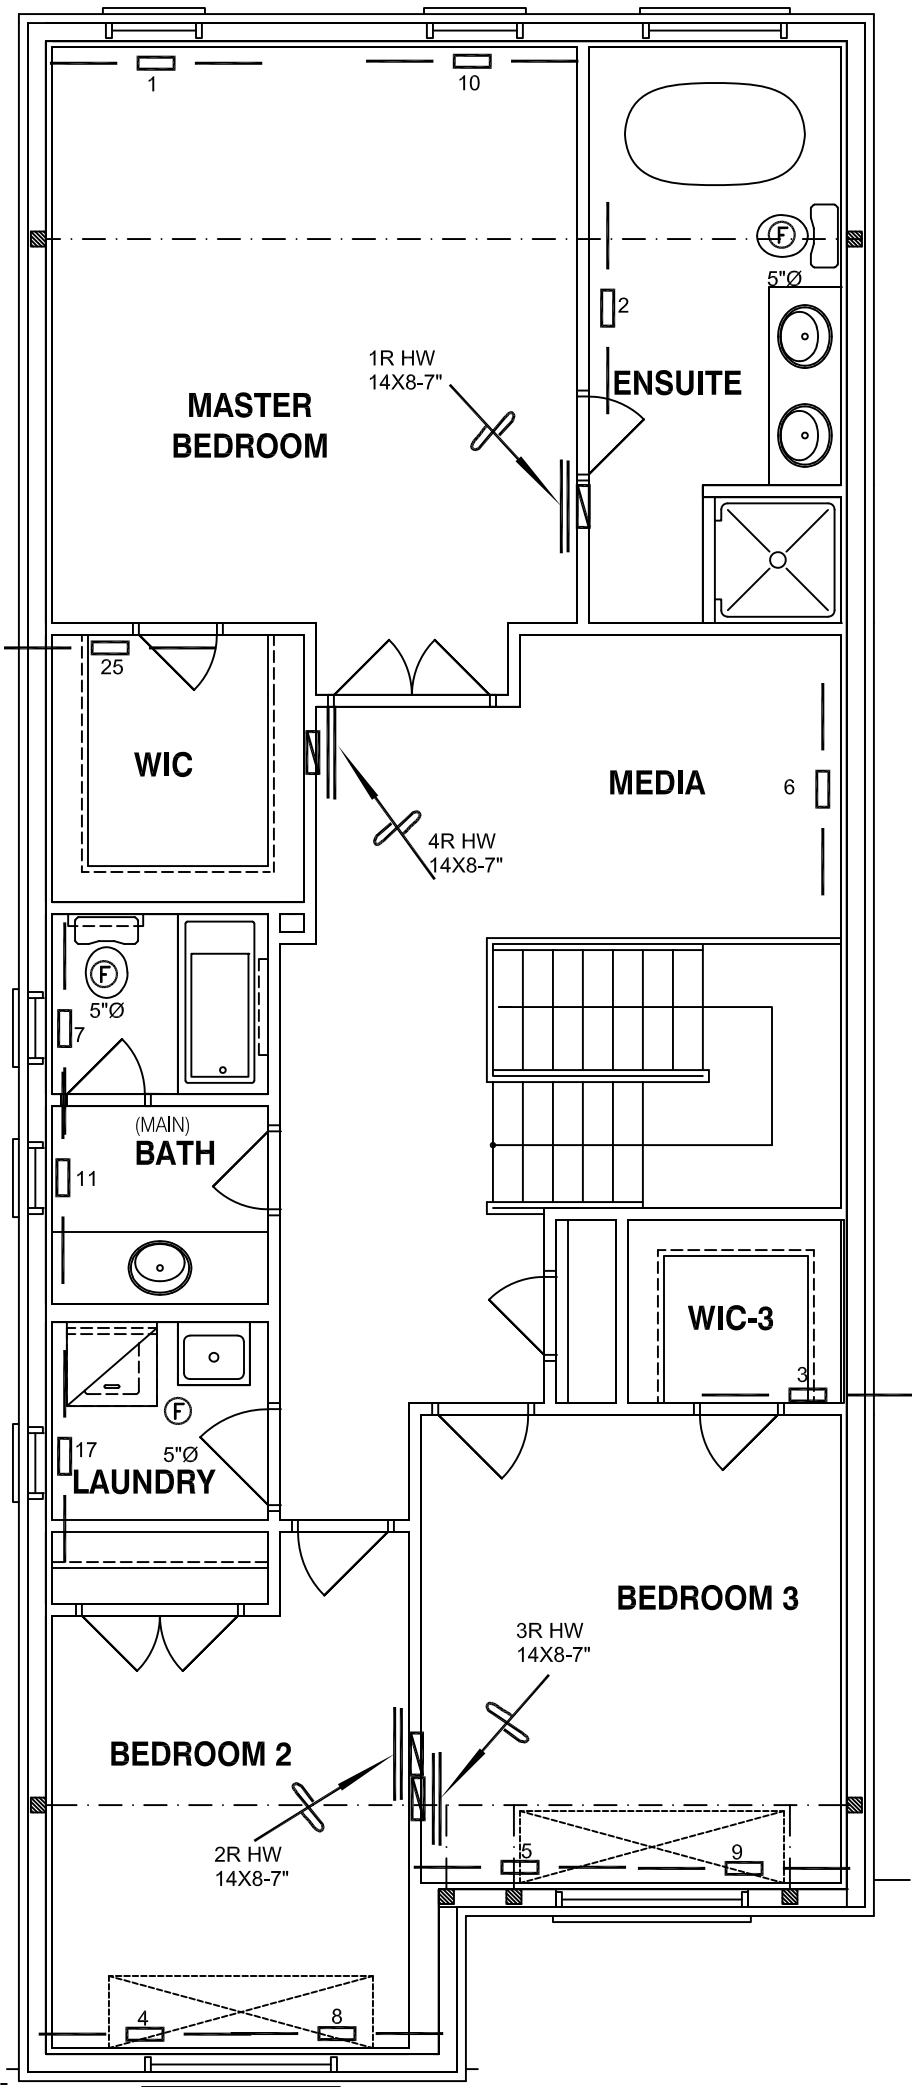

SECOND FLOOR PLAN EL-2

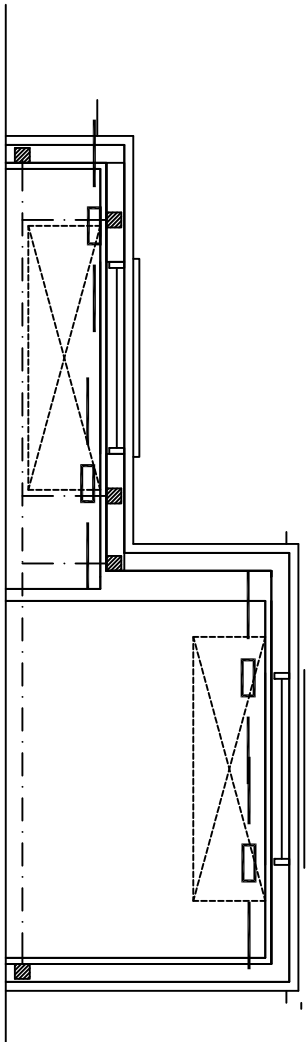

SECOND FLOOR PLAN EL-3

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GREENPARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	AUG/2022
BARLASSINA CAMBRIDGE, ONTARIO			Scale	3/16" = 1'-0"
Garden 3 - Elevation 3			BCIN# 19669	
GARDEN 3	2415 sqft		LO#	98640