

CONSTRUCTION NOTES (UNLESS OTHERWISE NOTED)

CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO
INFORM TO THE ONTARIO BUILDING CODE AND THE
APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION.
REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT.
REG. 332/12 - 2012 OBC.

MHP 23038

1 ROOF CONSTRUCTION (*SEE OBC 9.19.)

NO. 210 (10.25kg/m²) ASPHALT SHINGLES. 10mm (3/8") PLYWOOD
SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @600mm 24"
o.c. MAX. APPROVED EAVE PROTECTION TO EXTEND 900mm (3'-0")
FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF
EXTERIOR WALL. 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") o.c. AT
BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RWL &
VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF / WALL
SURFACES SUSCEPTIBLE TO DAMMING. ROOF SHEATHING TO BE
FASTENED 150 (6") c.c. ALONG EDGES & INTERMEDIATE SUPPORTS WHEN
TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF
INSULATED CEILING AREA WITH 50% AT EAVES.

2 FRAME WALL CONSTRUCTION (2"x6")

SIDING, HARDIE BOARD, STUCCATO BOARD OR EQUAL AS PER ELEVATION.
19x64 (1"x3") VERTICAL WOOD FURRING, APPROVED SHEATHING PAPER,
7/16" O.S.B. EXTERIOR SHEATHING OR OBC COMPLIANT EQUIVALENT.
38x140 (2"x6") STUDS @ 400mm (16") O.C. W/APPROVED DIAGONAL WALL
BRACING, RSI 3.87 (R22) INSULATION AND APPROVED VAPOUR BARRIER
AND APPROVED CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH.

3 BRICK VENEER CONSTRUCTION (2"x6")

90mm (4") FACE BRICK 25mm (1") AIR SPACE, 22x180x0.76mm
(7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") o.c. HORIZONTAL
600mm (24") o.c. VERTICAL. APPROVED SHEATHING PAPER, 7/16" O.S.B.
EXTERIOR SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x140 (2"x6")
STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL BRACING,
RSI 3.87 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED
CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP
HOLES @ 800mm (32") o.c. BOTTOM COURSE AND OVER OPENINGS.
PROVIDE BASE
FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

3A STUCCO WALL CONSTRUCTION (2"x6")

STUCCO CLADDING SYSTEM CONFIRMING TO OBC 9.27.1.1.(2) & 9.28
THAT EMPLOY A MINIMUM 6mm (1/4") DRAINAGE CAVITY BEHIND THE
CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED AS
PER MANUFACTURERS SPECIFICATION ON 25mm (1") MINIMUM
EXTRUDED OR EXPANDED RIGID INSULATION, APPROVED SHEATHING
PAPER, 7/16" O.S.B. EXTERIOR SHEATHING OR OBC COMPLIANT
EQUIVALENT. 38x140 (2"x6") STUDS @ 400mm (16") o.c. W/APPROVED
DIAGONAL WALL BRACING, RSI 3.87 (R22) INSUL. APPROVED VAPOUR
BARRIER AND APPROVED CONT. AIR BARRIER, 13mm (1/2") INT.
DRYWALL FINISH. STUCCO TO BE MIN.200mm (8") ABOVE FINISH GRADE.

4 INTERIOR STUD PARTITIONS

(*SEE OBC 9.23.10.&9.23.11.)

BEARING PARTITION 38x89 (2"x4") @ 400mm (16") o.c. FOR 2 STOREYS
AND 300mm (12") o.c. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x89
(2"x4") @ 600mm (24") o.c.. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND
2/38x89 (2"x4") TOP PLATE. 13mm (1/2") INTERIOR DRYWALL BOTH
SIDES OF STUD, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

5 FOUNDATION WALL/FOOTINGS:

(*SEE OBC 9.15.3 & 9.15.4.)

MIN. 200mm (8") POURED CONC. FDTN. WALL 15MPa (2200psi) WITH
BITUMENOUS DAMPROOFING AND DRAINAGE LAYER. MIN. 480x155
(19"x6") CONTIN. KEYED CONC. FTG. BRACE FOUNDATION WALL PRIOR
TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED
SOIL WITH MINIMUM BEARING CAPACITY OF 120kPa (17.4 psi) OR
GREATER.

6 WEEPING TILE (*SEE OBC 9.14.3.)

100mm (4") DIA. WEEPING TILE 150mm (6") CRUSHED STONE OVER AND
AROUND WEEPING TILES.

7 BASEMENT SLAB (*SEE OBC 9.16.-)

80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm
(4") COARSE GRANULAR FILL, OR 15MPa (2200psi) CONC. WITH
DAMPROOFING BELOW SLAB.

8 WOOD SUBFLOORS (*SEE OBC 9.23.14. & 9.30.2.)

19mm (3/4") T&G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR.
16mm (5/8") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR.
16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION.
6mm (1/4") PANEL-TYPE UNDERLAY UNDER RESILIENT & PARQUET
FLOORING.

9 ROOF INSULATION (*SEE SB12 - 2.1.1.2.A & 2.1.1.7)

RSI 10.57 (R60) ROOF INSULATION AND APPROVED VAPOUR BARRIER,
16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL.

10 ALL STAIRS/EXTERIOR STAIRS (*SEE OBC 9.8.-)

MAX. RISE	=200	(7 7/8")
MIN. RUN	=255	(10 1/4")
MIN. TREAD	=280	(11")
MAX. NOSING	=25	(1")
MIN. HEADROOM	=1950	(6'-5")
RAIL @ LANDING	=900	(2'-11")
RAIL @ STAIR	=865	(2'-10")
MIN. STAIR WIDTH	=860	(2'-10")

FOR CURVED STAIRS
MIN. AVG. RUN = 200 (8")
MIN. RUN = 150 (6")

11 RAILING (*SEE OBC 9.8.8.)

FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN
PICKETS.

INTERIOR GUARDS:	= 900mm	(2'-11") MIN.
EXTERIOR GUARDS:	= 1070mm	(3'-6") MIN.

12 SILL PLATE (*SEE OBC 9.23.6 & 9.23.7.)

38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm
(8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10")
o.c. CAULKING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND
TOP OF FDTN. WALL. USE MORTAR TO LEVEL SILL PLATE WHEN REQUIRED.

13 BASEMENT INSULATION (*SEE OBC 12.3.)

FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED
FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 152mm
(6") ABOVE THE FINISHED FLOOR OF THE BASEMENT AND NOT LESS THAN
50mm (2") TO THE SLAB.
FOUNDATION WALL INSULATION SHALL BE MINIMUM RSI. 3.52 (R20)
BLANKET INSULATION, APPROVED VAPOUR BARRIER, DAMPROOFING
W/BLDG. PAPER BETWEEN THE FDTN. AND INSUL.

14 BASEMENT BEARING STUD PARTITION

(*SEE OBC 9.23.10.)

38x89 (2"x4") STUDS @400mm (16") o.c. 38x89 (2"x4") SILL PLATE ON
DAMPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm
(8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10")
o.c. (4") HIGH CONC. CURB ON 305x155 (12"x6") CONC. FOOTING. ADD
HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15 STEEL BASEMENT COLUMN (*SEE OBC 9.17.3.)

90mm (3-1/2") DIA. x 4.78mm (.188) STL. COL. WITH 150x150x9.5mm
(6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A STEEL COLUMN (*SEE OBC 9.17.3.)

90mm (3-1/2") DIA. x 4.78mm (.188) STL. COLUMN WITH 100x100x6.4mm
(4"x4"x1/4") STEEL TOP & BOTTOM PLATE. FIELD WELD BOTTOM PLATE TO
250x100x12.5mm (10"x4"x1/2") BASE PLATE C/W 2-13mm (1/2") DIA. x
300mm (12") LONG x 50mm (2") HOOK ANCHORS.

16 NIB WALLS (*SEE OBC 9.23.8.)

BEAM POCKET OR 200x200 (8"x8") POURED CONCRETE NIB WALLS.
MINIMUM BEARING 90mm (3-1/2")

17 STEEL BEAM STRAPPING (*SEE OBC 9.23.4.3.(3)(c))

19x38 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL
BEAM.

18 GARAGE SLAB (*SEE OBC 9.16.-)

100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT
ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE
OR COMPACTED NATIVE FILL. SLOPE TO FRONT 1% MIN.

19 INTERIOR GARAGE WALLS & CEILING

(*SEE OBC 9.10.9.16.)

13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE
AND GARAGE, RSI 3.87 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TAPE
AND SEAL ALL JOINTS GAS TIGHT.

20 GARAGE DOOR GASPROOFING

(*SEE OBC 9.10.13.15.)

DOOR AND FRAME GASPROOFING. DOOR EQUIPPED WITH SELF
CLOSING DEVICE AND WEATHER STRIPPING.

21 EXTERIOR STEP

(*SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.)

PRECAST CONCRETE STEP OR WD. STEP WHERE NOT EXPOSED TO
WEATHER MAX. RISE 200mm (7-7/8"); MINIMUM TREAD 250mm (9-1/2")

22 DRYER VENT

(*SEE OBC 6.2.3.8.(7))

CAPPED DRYER EXHAUST VENTED TO EXTERIOR. USE 1000mm (4") DIA.
SMOOTH WALL VENT PIPE.

23 ATTIC ACCESS

(*SEE OBC 9.19.2.)

ATTIC ACCESS HATCH 545x700 (22"x28") WITH WEATHERSTRIPPING. RSI
5.46 (R31) RIGID INSULATION BACKING.

24 FIREPLACE CHIMNEYS

(*OBC 9.21.-)

TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST
POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm
(2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF
3050mm (10'-0") FROM THE CHIMNEY.

25 LINEN CLOSET

4 SHELVES MIN. 350mm (14") DEEP.

26 MECHANICAL EXHAUST

(*SEE OBC 9.32.3.5, 9.32.3.10.)

MECHANICAL EXHAUST FAN VENTED TO EXTERIOR.

27 STEEL BEARING PLATE FOR MASONRY WALLS

280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12
(11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC.
BLOCK PARTYWALL, ANCHORED W/ 2-19mm (3/4") x200mm (8") LONG
GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH
NON-SHRINK GROUT.

28 CLASS "B" VENT

U.L.C. RATED CLASS "B" VENT 610mm (2'-0") ABOVE THE POINT IN
CONTACT WITH THE ROOF FOR SLOPES UP TO 9/12, REFER TO THE
ONTARIO GAS UTILIZATION CODE.

29 WOOD BASEMENT POST

(*OBC 9.17.4.)

3-38x140 (3-2"x6") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO
CONC. WITH 12.7 (1/2") DIA. BOLT ON 406x406x203 (16"x16"x8") CONC.
FOOTING.

30 STEP FOOTINGS

(*OBC 9.15.3.9.)

MIN. HORIZ. STEP = 610mm (24"). MAX. VERT. STEP = 610mm (24")

31 SLAB ON GRADE

(*SEE OBC 9.16.-)

100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT
ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE
OR COMPACTED NATIVE FILL. REINFORCED W/ 6x6-W2.9xW2.9 MESH
PLACED NEAR MID-DEPTH OF SLAB.

32 DIRECT VENT FURNACE

●

DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS
REGULATOR, MIN 300mm (12") ABOVE FIN. GRADE, FROM ALL
OPENINGS, EXHAUST & INTAKE VENTS. HRV INTAKE TO BE A MIN. OF
1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS
UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY
ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0m IN COMPLIANCE WITH
O.B.C. DIV.-B TABLE 6.2.3.12..

33 DIRECT VENT GAS FIREPLACE

DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12")
FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS
UTILIZATION CODE

34 JOIST STRAPPING & BRIDGING (*SEE OBC 23.9.4.)

ALL FLOOR JOISTS TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING
OR SOLID BLOCKING @2100mm (6'-11") o.c. MAX. 19x64 (1"x3")
@2100mm (6'-11") o.c. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.

35 EXPOSED BUILDING FACE

(*SEE OBC 9.10.15.)

EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN
45min. WHERE LIMITING DISTANCE IS LESS THAN 1.2M (3'-11") WHERE THE
LIMITING DISTANCE IS LESS THAN 600mm (1'-11") THE EXPOSING FACE
SHALL BE CLAD IN NON-COMBUSTABLE MATERIAL.

36 COLD CELLAR PORCH SLAB

(*SEE OBC 9.40.)

FOR MAX. 2500mm (8'-2") PORCH DEPTH, 125mm (5") 32Mpa (4640 psi)
CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS
@200mm (8") o.c. EACH WAY IN BOTTOM THIRD OF SLAB, ANCHORED IN
PERIMETER FDTN. WALLS W/ 610x610 (24"x24") 10M @600mm (24") o.c.
DOWELS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE A MIN.
75mm (3") BEARING ON FDTN. WALLS. PROVIDE (WL1) LINTELS OVER
CELLAR DOOR.

37 FDTN. WALL REDUCTION IN THICKNESS

(*SEE OBC 9.15.4.7.)

FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK
TO A MAX. DEPTH OF 660mm (26") FOR 8" FDTN. WALL. 10" FDTN. WALL
WHEN REDUCTION IN THICKNESS IS GREATER THAN 26". FDTN. WALL SHALL
BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm
(8") o.c. VERTICALLY AND 900mm (36") o.c. HORIZONTALLY. FILL SPACE
BETWEEN WALL AND FACING SOLID WITH MORTAR.

38 CONVENTIONAL ROOF FRAMING

(*SEE OBC 9.23.4.2.(1))

FOR MAX. 2240mm (7'-4") SPAN, 38x89 (2"x4") RAFTERS @400mm (16")
o.c.. FOR MAX. 3530mm (11'-7") SPAN, 38x140 (2"x6") RAFTERS @400mm
(16") o.c.. RIDGE BOARD TO BE 51mm (2") DEEPER. 38x39 (2"x4") COLLAR
TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @400mm (16")
o.c. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 400 (16") o.c.
FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE
38x89 (2"x4") @600mm (24") o.c. WITH A 38x89 (2"x4") CENTER POST TO
THE TRUSS BELOW, Laterally BRACED @1800mm (6'-0") o.c.
VERTICALLY.

39 TWO STOREY VOLUME SPACES

FOR A MAXIMUM 5490mm (18'-0") HEIGHT, PROVIDE 2-38x140 (2-2"x6")
CONTINUOUS STUDS @300mm (12") o.c. FOR BRICK AND 400mm (16")
o.c. FOR SIDING. PROVIDE SOLID WOOD BLOCKING BETWEEN STUDS
@1220mm (4'-0") o.c. VERT. 7/16" EXT. PLYWOOD.

40 EXPOSED FLOOR TO EXTERIOR (*SB12 - 2.1.1.2.A)

PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND
CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

41 PARTYWALLS

TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND
SPECIFICATIONS.

42 EXTERIOR WALLS FOR WALK-OUT CONDITION

THE EXTERIOR BASEMENT STUD WALL TO BE 38x140mm (2"x6") STUDS
@400mm (16") o.c. MATCH FLOOR JOIST SPACING WHEN PARALEL WITH
FLOOR JOISTS.

43 SMOKE ALARM

● (*OBC 9.10.19)

PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL
AND ALSO 1 IN EACH BEDROOM NEAR HALL DOOR. ALARMS TO BE
CONNECTED TO AN ELECTRICAL CIRCUIT AND INTERCONNECTED TO
ACTIVATE ALL ALARMS IF ONE SOUNDS. BATTERY BACK-UP REQUIRED.
SMOKE ALARMS TO INCORPORATE VISUAL SIGNALLING COMPONENT.
(9.10.19.3.(3)).

44 CARBON MONOXIDE ALARM

● (*OBC 9.33.4.)

WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A DWELLING UNIT, A
BARBON MONOXIDE DETECTOR CONFORMING TO CAN./CGA-6.19,
CSA 6.19 OR UL2034 SHALL BE INSTALLED ADJACENT TO EACH SLEEPING
AREA. CARBON MONOXIDE DETECTOR(S) SHALL BE PERMANENTLY
WIRED SO THAT IT IS ACTIVATION WILL ACTIVATE ALL CARBON
MONOXIDE DETECTORS AND BE EQUIPPED WITH AN ALARM THAT IS
AUDIBLE WITHIN BEDROOMS WHEN THE INTERVENING DOORS ARE
CLOSED

45 SOIL GAS CONTROL

(*OBC 9.13.4.)

PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE
BUILDING AS REQUIRED.

STRUDET INC.



FOR STRUCTURE ONLY

The undersigned has reviewed and takes responsibility for this design,
as well as having the qualifications and requirements mandated by the
Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack

35923

Name

BCIN

Registration Information

Mackitecture

103532



www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3

Tel: 416-735-8190 Email: info@mackitecture.ca

title

Construction Notes

scale

not to scale

date

2023-07-18

by

Greenpark

type

-

area

-

project no.

22-012

sheet no.

1

project name

Greenpark

www.greenparkgroup.ca

Zadorra Estates Inc.

Compliance Package A1

MHP 23038

WINDOWS - CANADA ZONE C

(1) MINIMUM BEDROOM WINDOW (*OBC 9.9.10.1.)

AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² (3.8 SQ.FT.) UNOBSTRUCTED GLAZED OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380mm (1'-3")

GLASS AREA NOT MORE THAN 17% OF GROSS PERIPHERAL WALL AREA. MAXIMUM U-VALUE 0.28

(2) WINDOW GUARDS (*OBC 9.8.8.1(6))

A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'-6") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

GENERAL:

(1) MECHANICAL VENTILATION

MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3 AIR CHANGES PER HOUR AVERAGED OVER 24 HOURS. SEE MECHANICAL DRAWINGS.

(2) OUTDOOR AIR INTAKE ●

ALL OUTDOOR AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM SOURCES OF CONTAMINATION (EXHAUST VENTS) IN COMPLIANCE WITH O.B.C. DIV.-8 6.2.3.12. AND TABLE 6.2.3.12.

(3) REINFORCEMENT FOR GRAB BARS (*OBC 9.5.2.3.) ●

REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. REFER TO O.B.C. 9.5.2.3, 3.8.3.8.(3)(a), 3.8.3.8.(3)(c), 3.8.3.13.(2)(g) & 3.8.3.13.(4)(e). SEE DETAIL ON PAGE 11.

LUMBER:

1.) ALL LUMBER SHALL BE SPRUCE-PINE-FIR No.1&2 GRADE, UNLESS NOTED OTHERWISE.

2.) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE-PINE-FIR No.1&2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.

ALL BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS 3.) SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.

LVL BEAMS SHALL BE 2.0E (Fb=2800psi MIN.). NAIL EACH PLY OF LVL 4.) WITH 89mm (3-1/2") LONG COMMON WIRE NAILS @300mm (12") o.c. STAGGERED IN 2 ROWS FOR 184, 240, & 300mm (7-1/4", 9-1/2", 11-7/8") DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 1/2" (13mm) DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm (3'-0")o.c.

PROVIDE TOP MOUNT BEAM HANGERS FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE.

5.) PROVIDE METAL JOIST HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.

6.) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2mil. POLYETHYLENE FILM, No.50 (45lbs) ROLL ROOFING OR OTHER DAMPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER 7.) IS AT LEAST 150mm (6") ABOVE THE GROUND.

STEEL:

STRUCTURAL STEEL AND HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W.

REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

REVISION:

- ONT. REG. 332/12-2012 OBC AMENDMENT O. REG. 88/19 JAN. 01, 2020

STABILITY OF NARROW (20'-25') & TALL (±30') HOUSES

BUILDER TO PROVIDE SUFFICIENT TEMPORARY BRACING TO RESIST WIND LOADING WHEN UNDER CONSTRUCTION. FURTHER RECOMMENDATIONS:

1.) REDUCE THE FOUNDATION WALL SILL PLATE ANCHOR BOLT SPACING FROM 2400mm o.c. (7'-10") TO 1220mm o.c. (4'-0") FOR STANDARD CONDITIONS.

2.) USE 9.5mm (3/8") THICK PLYWOOD OR WAFERBOARD FOR THE EXTERIOR WALL SHEATHING.

3.) TO STIFFEN THE STRUCTURE IN TRANSVERSE DIRECTION USE 9.5mm (3/8") THICK PLYWOOD NAILED TO THE INTERIOR PARTITIONS ON EACH FLOOR FOR A MINIMUM 2 INTERIOR PARTITION WALLS ON BOTH SIDES AND PERPENDICULAR TO THE LONG WALLS.

BRICK VENEER LINTELS

WL1 = 3-1/2"x3-1/2"x1/4"L (90x90x6.0L) + 2-2"x8" SPR. No.2
WL2 = 4"x3-1/2"x5/16"L (100x90x8.0L) + 2-2"x8" SPR. No.2
WL3 = 5"x3-1/2"x5/16"L (125x90x8.0L) + 2-2"x10" SPR. No.2
WL4 = 6"x3-1/2"x3/8"L (150x90x10.0L) + 2-2"x12" SPR. No.2
WL5 = 6"x4"x3/8"L (150x100x10.0L) + 2-2"x12" SPR. No.2
WL6 = 5"x3-1/2"x5/16"L (125x90x8.0L) + 2-2"x12" SPR. No.2
WL7 = 5"x3-1/2"x5/16"L (125x90x8.0L) + 3-2"x10" SPR. No.2
WL8 = 5"x3-1/2"x5/16"L (125x90x8.0L) + 3-2"x12" SPR. No.2
WL9 = 6"x4"x3/8"L (150x100x10.0L) + 3-2"x12" SPR. No.2

WOOD LINTELS AND BEAMS

WB1 = 2-2"x8" SPR. No.2 (2-38x184 SPR. No.2)
WB2 = 3-2"x8" SPR. No.2 (3-38x184 SPR. No.2)
WB3 = 2-2"x10" SPR. No.2 (2-38x235 SPR. No.2)
WB4 = 3-2"x10" SPR. No.2 (3-38x235 SPR. No.2)
WB5 = 2-2"x12" SPR. No.2 (2-38x286 SPR. No.2)
WB6 = 3-2"x12" SPR. No.2 (3-38x286 SPR. No.2)
WB7 = 5-2"x12" SPR. No.2 (5-38x286 SPR. No.2)
WB11 = 4-2"x10" SPR. No.2 (4-38x235 SPR. No.2)
WB12 = 4-2"x12" SPR. No.2 (4-38x286 SPR. No.2)

LOOSE STEEL LINTELS

L1 = 3-1/2"x3-1/2"x1/4"L (90x90x6.0L)
L2 = 4"x3-1/2"x5/16"L (100x90x8.0L)
L3 = 5"x3-1/2"x5/16"L (125x90x8.0L)
L4 = 6"x3-1/2"x3/8"L (150x90x10.0L)
L5 = 6"x4"x3/8"L (150x100x10.0L)
L6 = 7"x4"x3/8"L (175x100x10.0L)






LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A = 1-1 3/4" x 7 1/4" (1-45x184)
LVL1 = 2-1 3/4" x 7 1/4" (2-45x184)
LVL2 = 3-1 3/4" x 7 1/4" (3-45x184)
LVL3 = 4-1 3/4" x 7 1/4" (4-45x184)
LVL4A = 1-1 3/4" x 9 1/2" (1-45x240)
LVL4 = 2-1 3/4" x 9 1/2" (2-45x240)
LVL5 = 3-1 3/4" x 9 1/2" (3-45x240)
LVL5A = 4-1 3/4" x 9 1/2" (4-45x240)
LVL6A = 1-1 3/4" x 11 7/8" (1-45x300)
LVL6 = 2-1 3/4" x 11 7/8" (2-45x300)
LVL7 = 3-1 3/4" x 11 7/8" (3-45x300)
LVL7A = 4-1 3/4" x 11 7/8" (4-45x300)
LVL8 = 2-1 3/4" x 14" (2-45x356)
LVL9 = 3-1 3/4" x 14" (3-45x356)
LVL10 = 2-1 3/4" x 18" (2-45x456)

DOOR SCHEDULE

1 = 2'-10" x 6'-8"	(865x2033)	-	INSULATED ENTRANCE DOOR
1a = 2'-8" x 6'-8"	(815x2033)	)	INSULATED FRONT DOORS
2 = 2'-8" x 6'-8"	(815x2033)	)	WOOD & GLASS DOOR
3 = 2'-8" x 6'-8" x 1-3/4"	(815x2033x45)	)	EXTERIOR SLAB DOOR
4 = 2'-8" x 6'-8" x 1-3/8"	(815x2033x35)	)	INTERIOR SLAB DOOR
5 = 2'-6" x 6'-8" x 1-3/8"	(760x2033x35)	)	INTERIOR SLAB DOOR
6 = 2'-2" x 6'-8" x 1-3/8"	(660x2033x35)	)	INTERIOR SLAB DOOR
7 = 1'-6" x 6'-8" x 1-3/8"	(460x2033x35)	)	INTERIOR SLAB DOOR

LEGEND

DJ	DOUBLE JOIST
TJ	TRIPLE JOIST
GT	GIRDER TRUSS
	POINT LOAD
	SOLID WOOD BEARING. SOLID BEARING TO BE WIDE AT LEAST AS SUPPORTED MEMBER. MIN. 3 PIECES.
	LOAD-BEARING WALL
	TWO-STOREY WALL. SEE NOTE
	FLAT ARCH
F.D. 	FLOOR DRAIN
SA 	SMOKE ALARM. SEE NOTE
SA 	SMOKE ALARM & CARBON MONOXIDE ALARM. SEE NOTE

39

43

44

STRUDET INC.




FOR STRUCTURE ONLY

Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack	35923	
Name	BCIN	Signature
Registration Information	Mackitecture	103532



www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

General Notes

scale	by	area	sheet no.
not to scale	Greenpark	-	2
date	type	project no.	
2023-04-28	-	21-018	




www.greenparkgroup.ca


project name

Zadorra Estates Inc.


MHP 23038

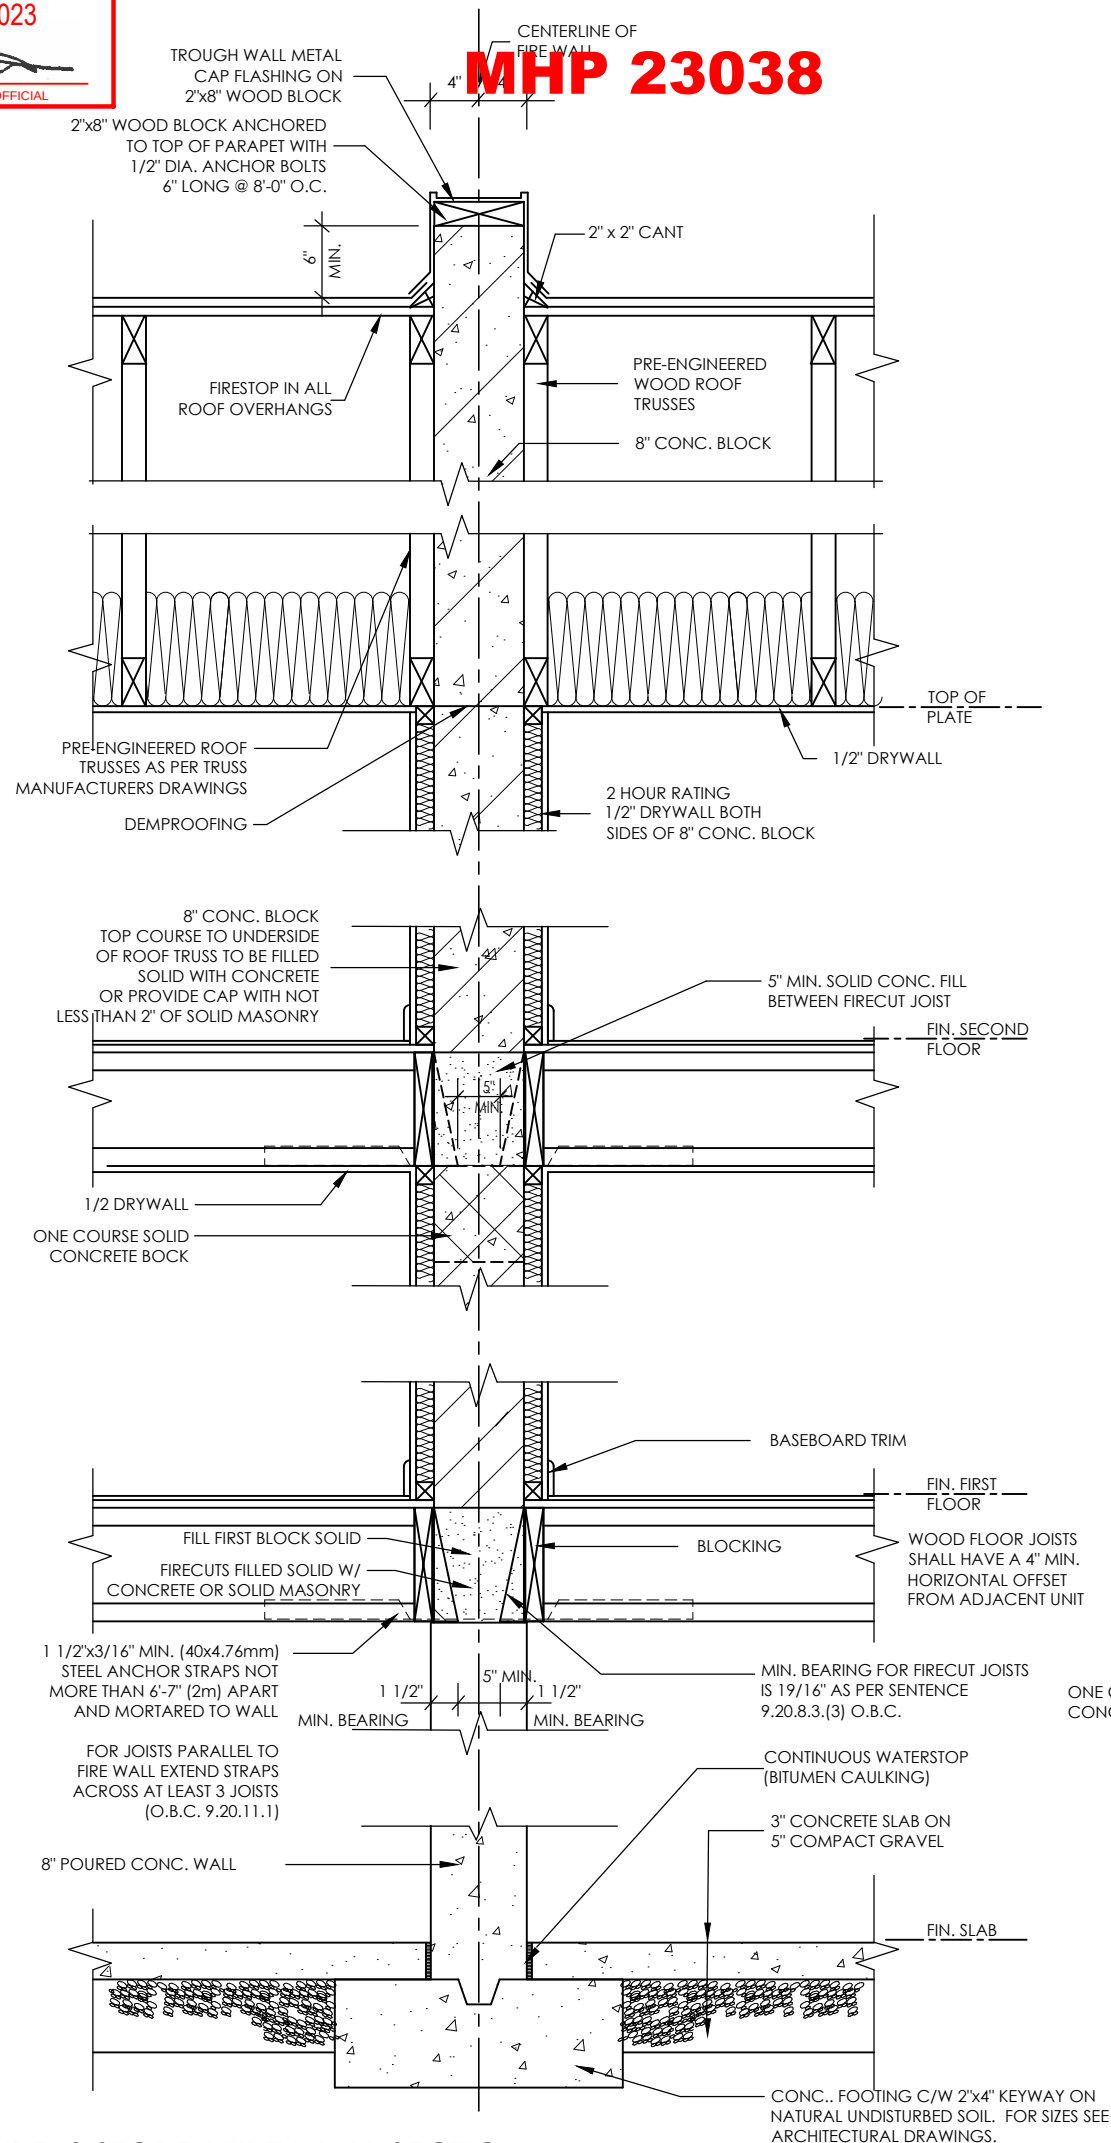

TYPE. 2 STOREY FIRE WALL SECTION
TRUSSES PARALLEL TO PARTY WALL

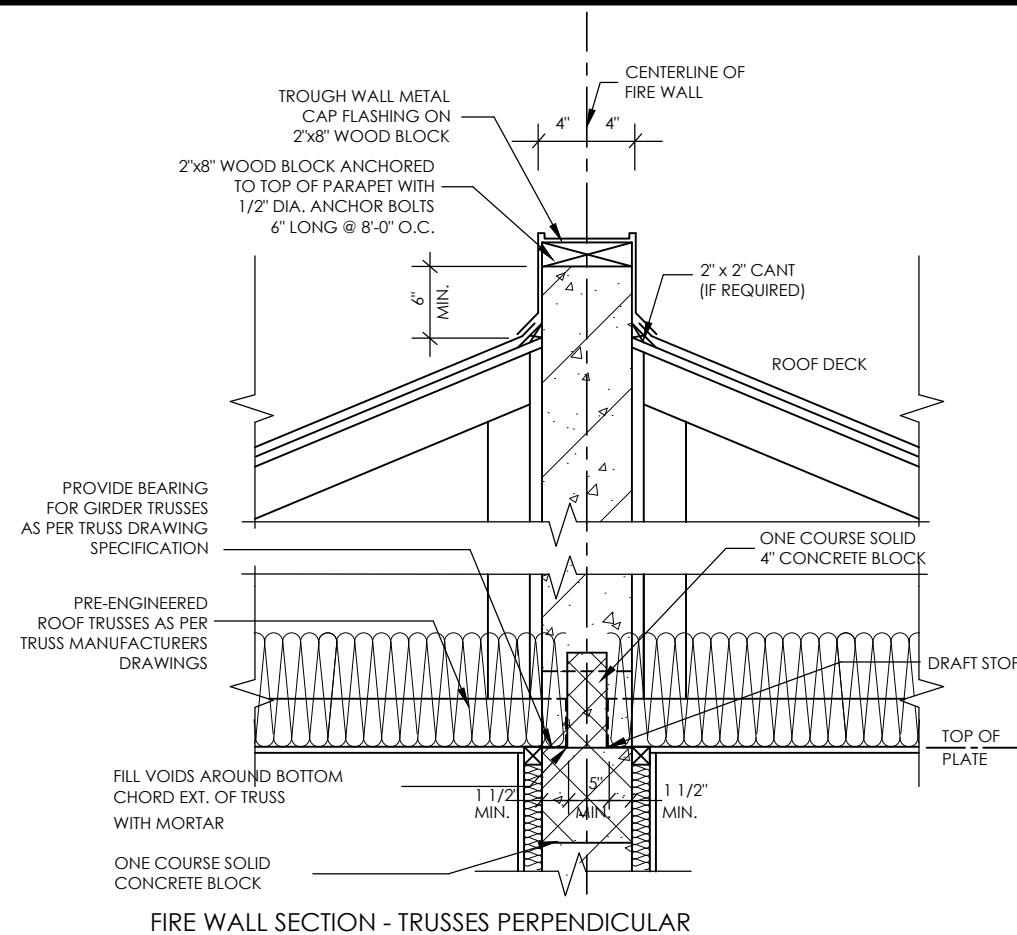


FIRE WALL SECTION - TRUSSES PERPENDICULAR

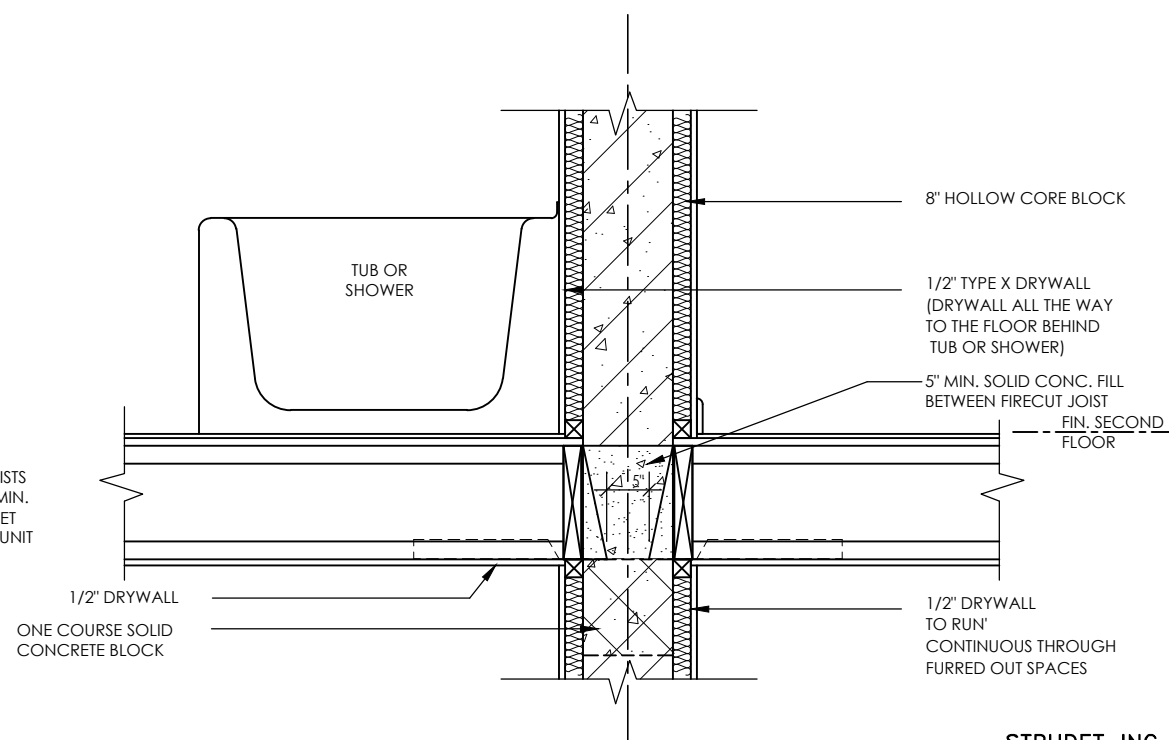

FIRE WALL SECTION @ BATH TUB

A FIREWALL SHALL EXTEND FROM THE GROUND CONTINUOUSLY THROUGH, OR ADJACENT TO, ALL STOREYS OF A BUILDING. (O.B.C. 3.1.10.3 (1))

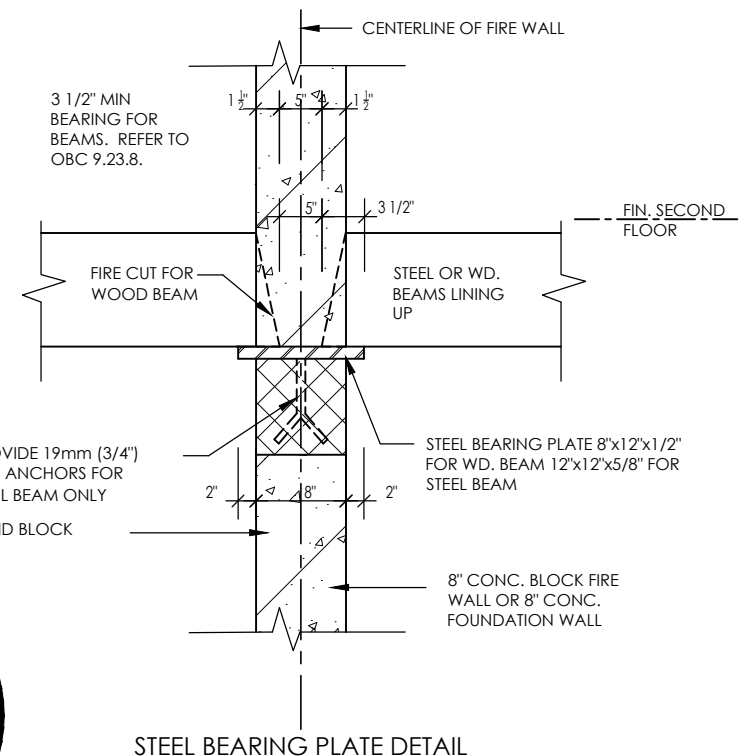

STEEL BEARING PLATE DETAIL

STRUDET INC.



FOR STRUCTURE ONLY

ENGINEERED FLOOR SYSTEM INSTALLATION TO CONFORM
TO MANUFACTURES APPROVED DETAILS AND
SPECIFIACATIONS

Compliance Package A1



www.greenparkgroup.ca

project name

Zadorra Estates Inc.

Fire Wall

scale

by
Greenpark

area	
------	--

sheet no.

3

date 2022-01-20

type	
------	--

project no.	01 010
-------------	--------

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack
Name

35923

BCIN

Registration Information

Mackitecture

103532



www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

MHP 23038

STRUDET INC.



FOR STRUCTURE ONLY

38x89 (2"x4") STUDS @ 400 O.C. WITH 15.9mm (5/8") TYPE 'X' GYPSUM BOARD ONE LAYER ON EACH SIDE. SUPPLEMENTARY STANDARDS SB3, TABLE 1, W/d WALL ASSEMBLY.

SOUND ABSORPTIVE MATERIAL REQUIREMENTS
SOUND ABSORPTIVE MATERIAL INCLUDES FIBRE PROCESSED FROM ROCK, SLAG, GLASS OR CELLULOSE FIBRE. IT MUST FILL AT LEAST 90% OF THE CAVITY THICKNESS FOR THE WALL TO PROVIDE THE LISTED STC VALUE.

SOUND TRANSMISSION RATING
MINIMUM REQUIRED S.T.C. RATING OF 50 (O.B.C. DIV. B 9.11.2.1(1))

WALL TYPE
SEE SUPPLEMENTARY STANDARDS SB3 TABLE 1, W13A BEARING WALL WITH 2 ROWS OF 2X4 SPR. @ 16" O.C. ON SEPARATE 2X4 PLATES SET 1" APART WITH 4" ABSORPTIVE MATERIAL AND 1 LAYER 5/8" TYPE 'X' GYPSUM WALL BOARD ON EACH SIDE (SEE NOTES 5 TO TABLE 1)

FIRE RESISTANCE RATING
FIRE RESISTANCE RATING REQUIRED IS 1 HR. MIN. (AS PER SENTENCE DIV. B 9.10.11.2.1(1) O.B.C.)

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

1" AIR SPACE

3/4" SUBFLOOR

ENGINEERED FLOOR JOISTS W/HEADER

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

2"x4" SILL PLATE (MAX. 2 7/25 P/F)

8" POURED CONC. FOUNDATION WALL

FIN. SLAB

CONC. FTG. C/W 2"x4" KEYWAY ON NATURAL UNDISTURBED SOIL FOR SIZES SEE ARCHITECTURAL DRAWINGS

WOOD FRAME PARTY WALL

TRUSSES PERPENDICULAR TO PARTY WALL

ALL GYPSUM BOARD TO BE TIGHT FIR AGAINST ROOF SHEATHING AND ROOF TRUSSES. MIDDLE GYPSUM BOARD BETWEEN TWO TRUSSES TO BE TIGHTLY SCREWED TO BOTH TRUSSES.

PER-ENGINEERED ROOF TRUSSES BY TRUSS MFG. @ 24" O.C.


5/8" TYPE 'X' GYPSUM WALL BOARD

TOP OF PLATE


2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

3 ROWS (TOP, MIDDLE AND BOTTOM) OF 1"x4" STRAPPING TO RESTRAIN INSULATION FROM FALLING OUT.


SECTION @ FIRE SEPARATION IN ROOF SPACE
TRUSSES PARALLEL TO PARTY WALL

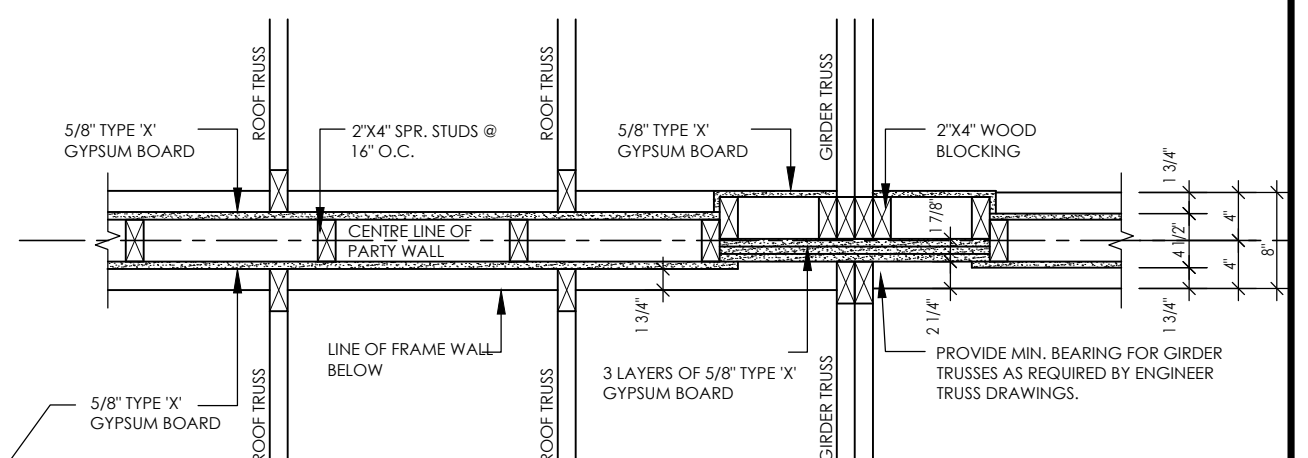


PLAN OF FIRE SEPARATION IN ROOF SPACE
TRUSSES PERPENDICULAR TO PARTY WALL

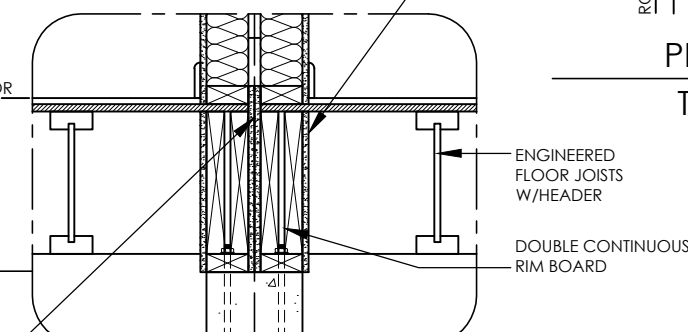

FLOOR JOISTS PARALLEL

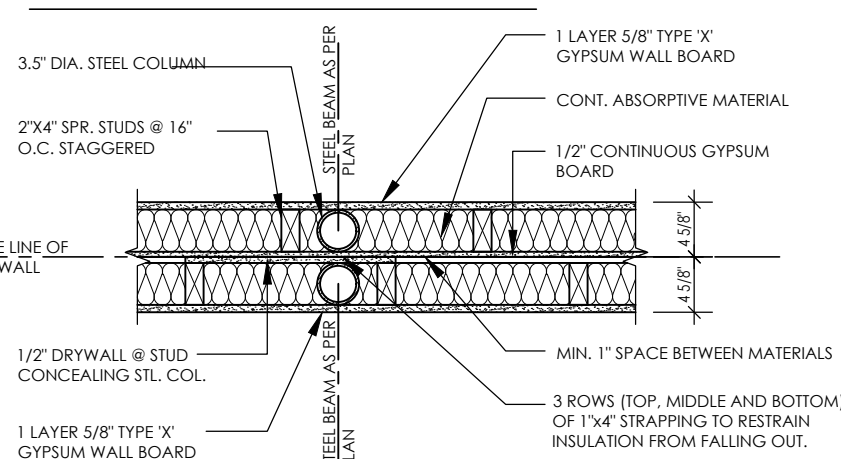

PLAN OF PARTY WALL IN GARAGE

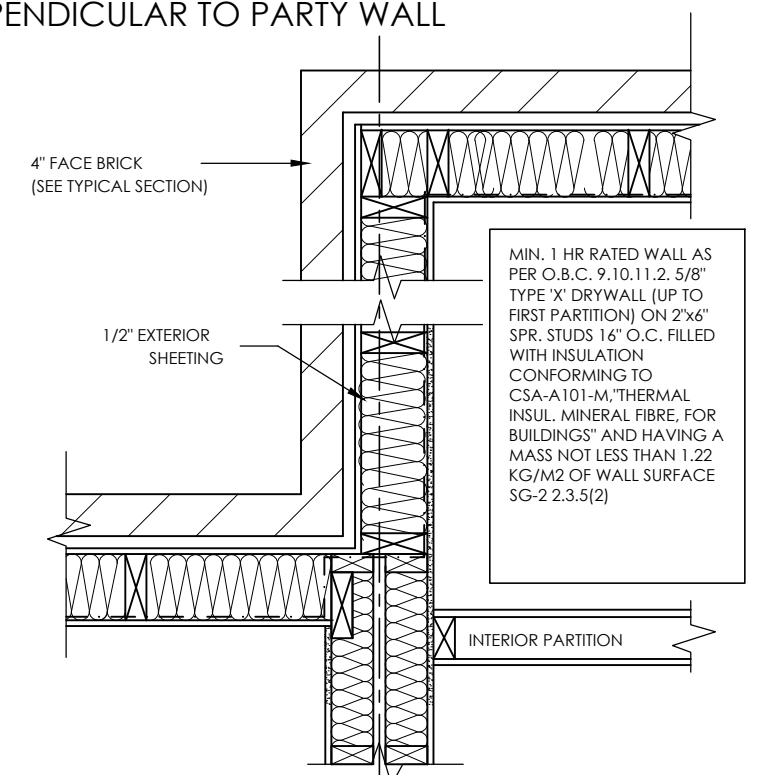

PARTY WALL PLAN SECTION

Compliance Package A1

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack
Name

35923
BCIN

Registration Information

Mackitecture

103532



www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Party Wall - Wood

scale
3/4" = 1'-0"

by
Greenpark

area
-

sheet no.

4

date
2023-04-28

type
-

project no.
21-018

Greenpark

www.greenparkgroup.ca


project name

Zadorra Estates Inc.



Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

MHP 23038


REFER TO STANDARD WALL SECTION
SHEET FOR FURTHER INFORMATION
ON WALL CONSTRUCTION.

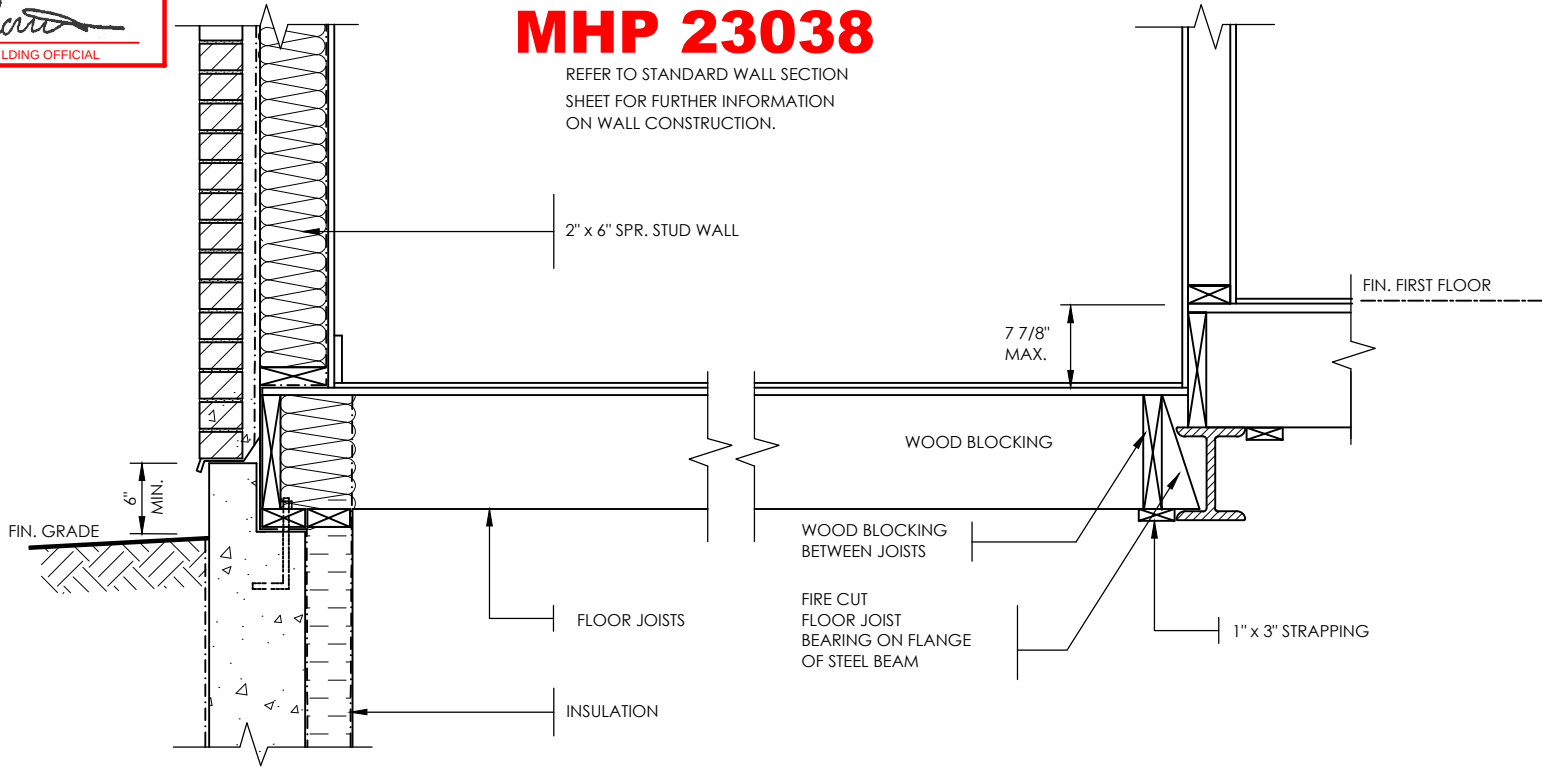

DETAIL OF SUNKEN LAUNDRY
(ONE RISER)

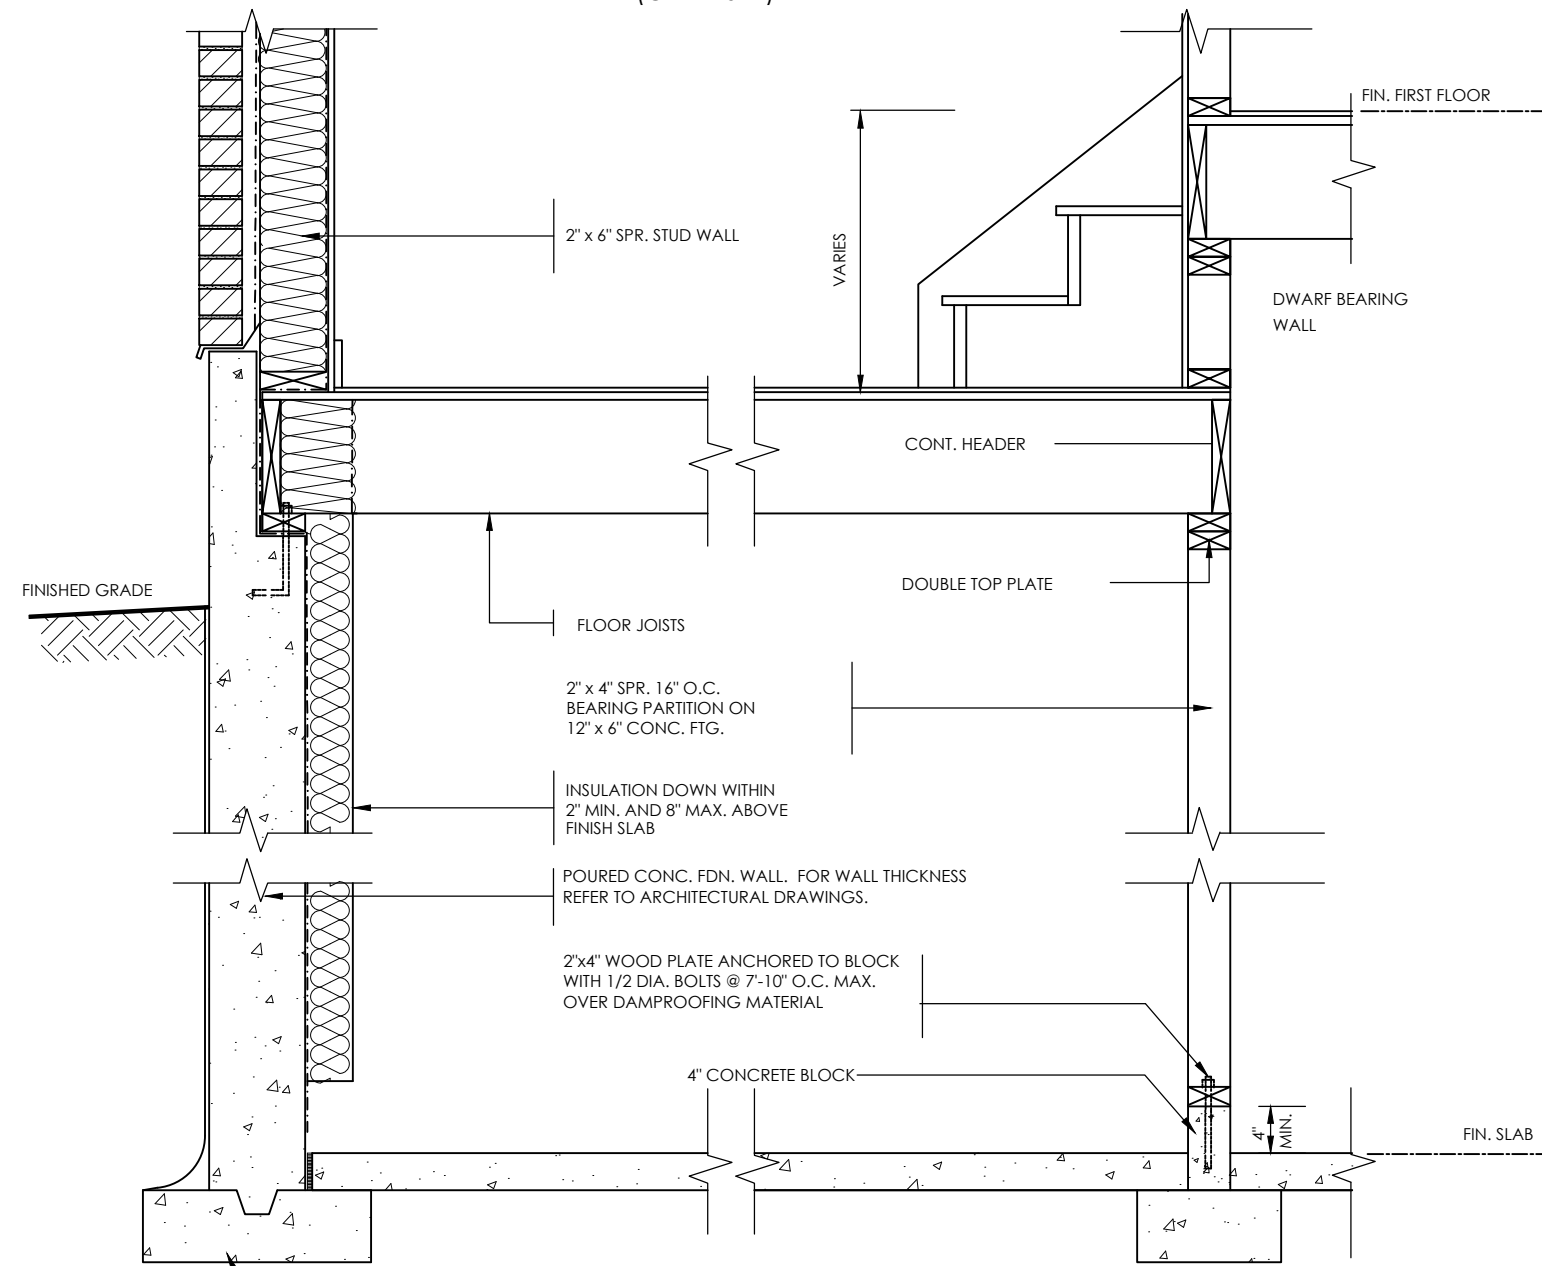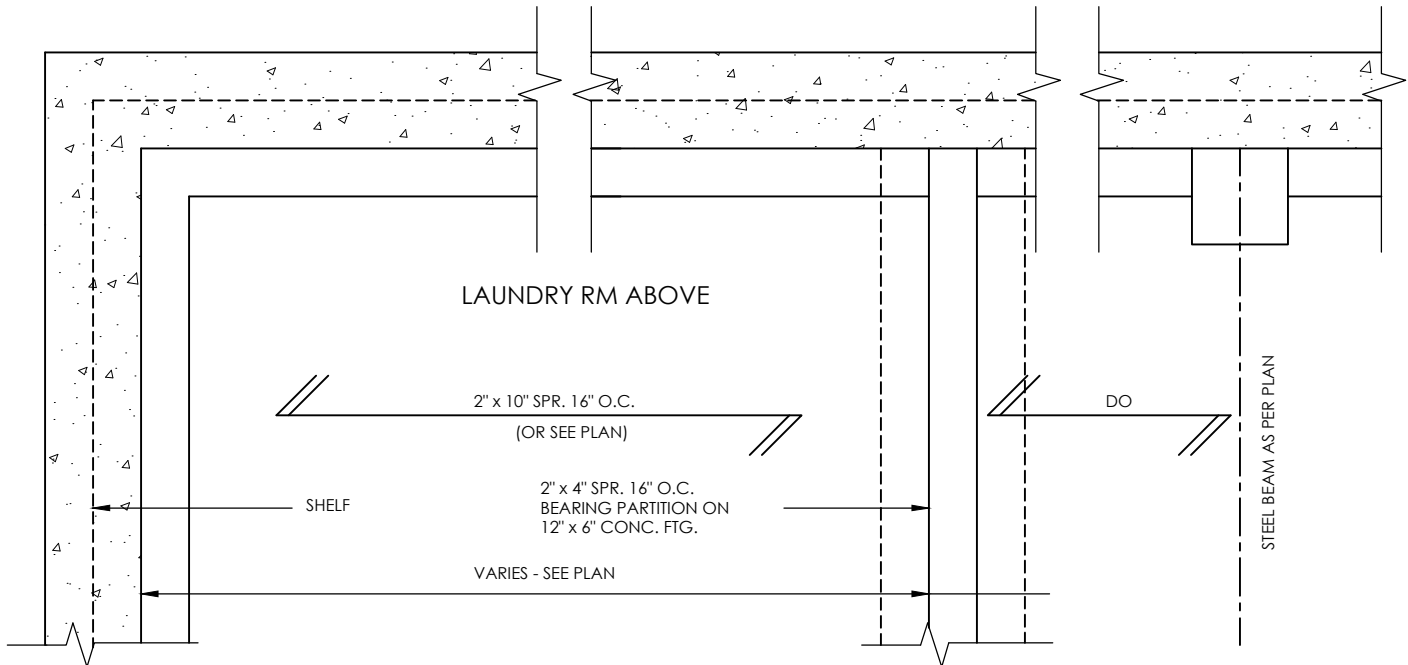

DETAIL OF SUNKEN LAUNDRY
(MORE THAN ONE RISER)

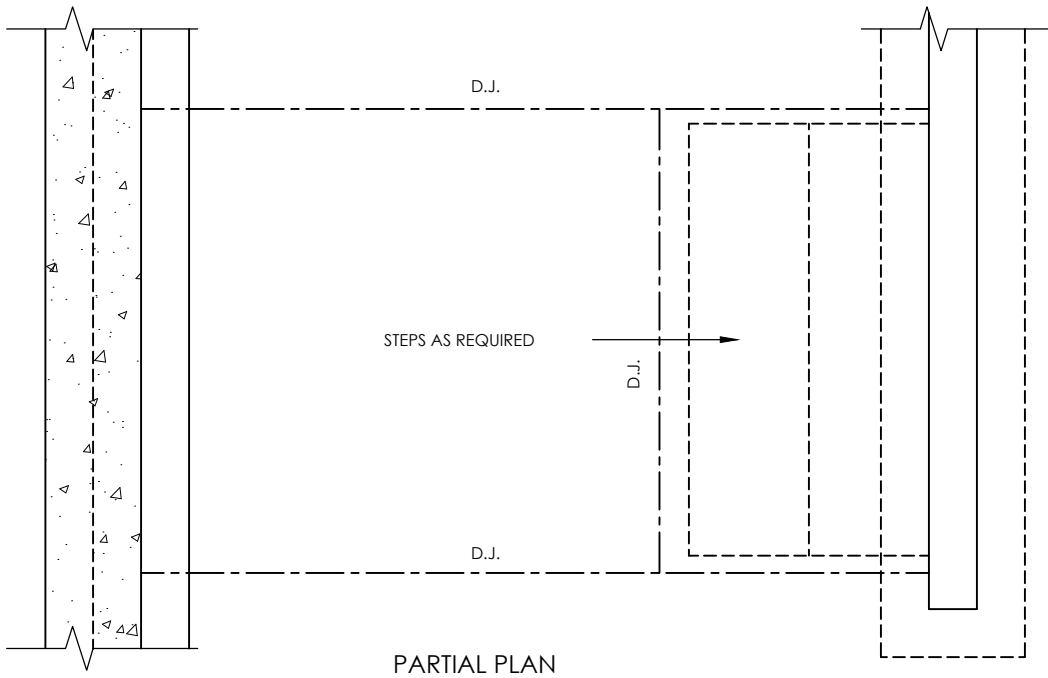

Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information


Jamie Mack 35923
Name BCIN Signature
Registration Information **Mackitecture** 103532


www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca


Sunken Laundry Details			
scale	by	area	sheet no.
3/4" = 1'-0"	Greenpark	-	5
date	type	project no.	
2023-04-28	-	22-012	


www.greenparkgroup.ca
project name
Zadorra Estates Inc.


MHP 23038

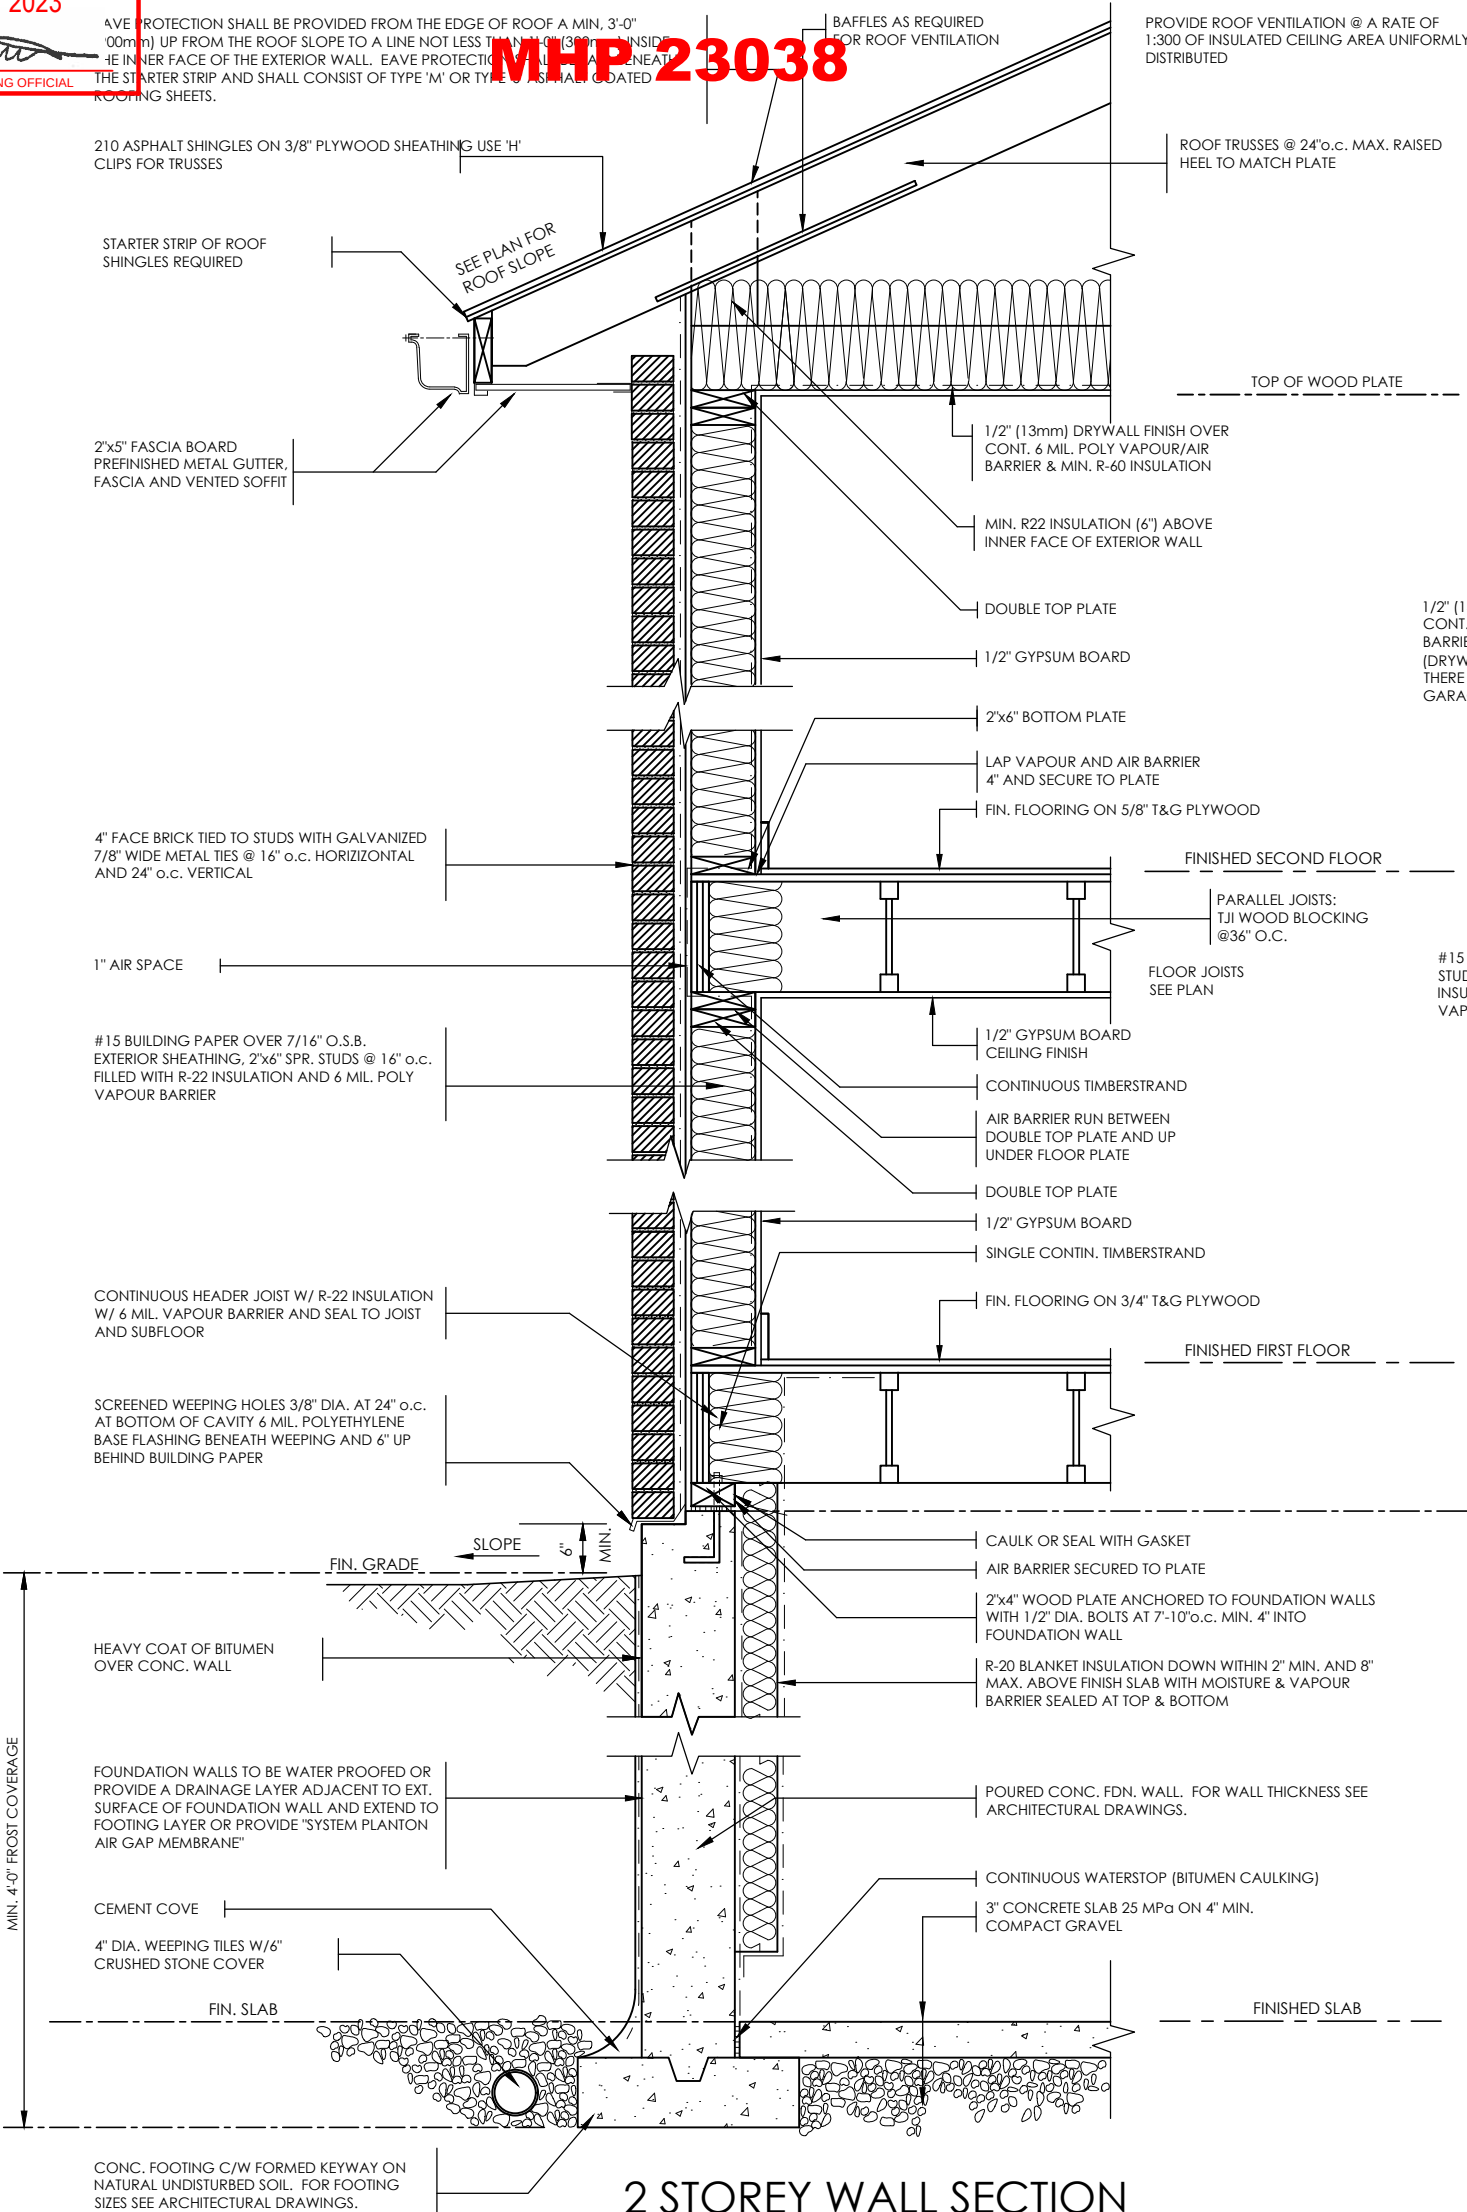

2 STOREY WALL SECTION

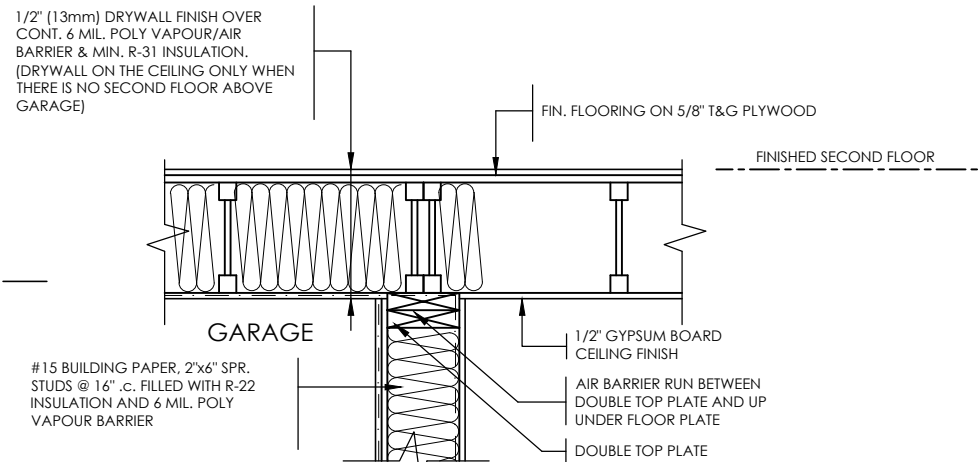

DETAIL FOR INTERIOR GARAGE WALLS & CEILINGS

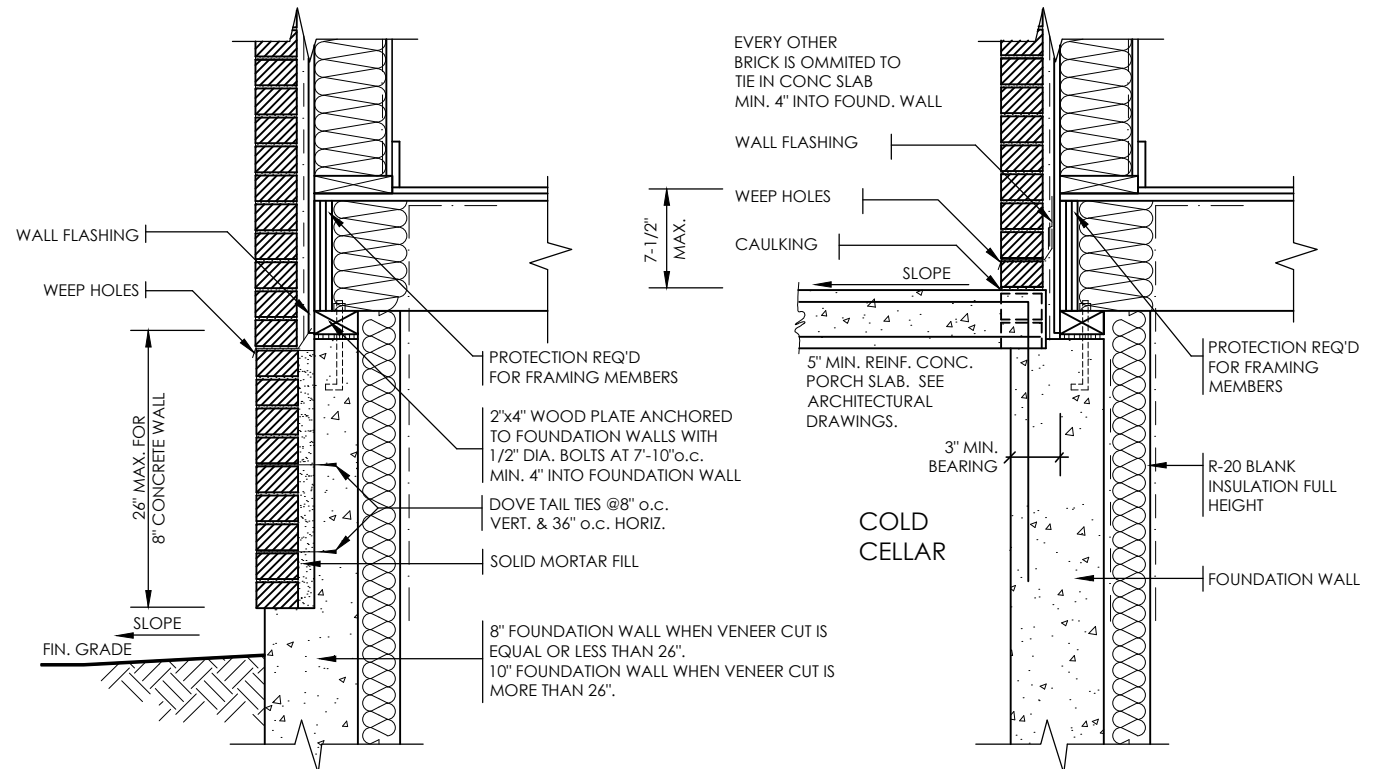

DETAIL FOR CONCRETE VENEER DROPPED GRADE

DETAIL FOR COLD CELLAR PORCH SLAB

STRUDET INC.



FOR STRUCTURE ONLY

Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN Signature
Registration Information Mackitecture 103532



www.mackitecture.ca



975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Title			
2x6 Brick Veneer 2 Storey			
scale	by	area	sheet no.
3/4" = 1'-0"	Greenpark	-	6
date	type	project no.	
2023-04-28	-	22-012	


www.greenparkgroup.ca



project name
Zadorra Estates Inc.

MHP 23038

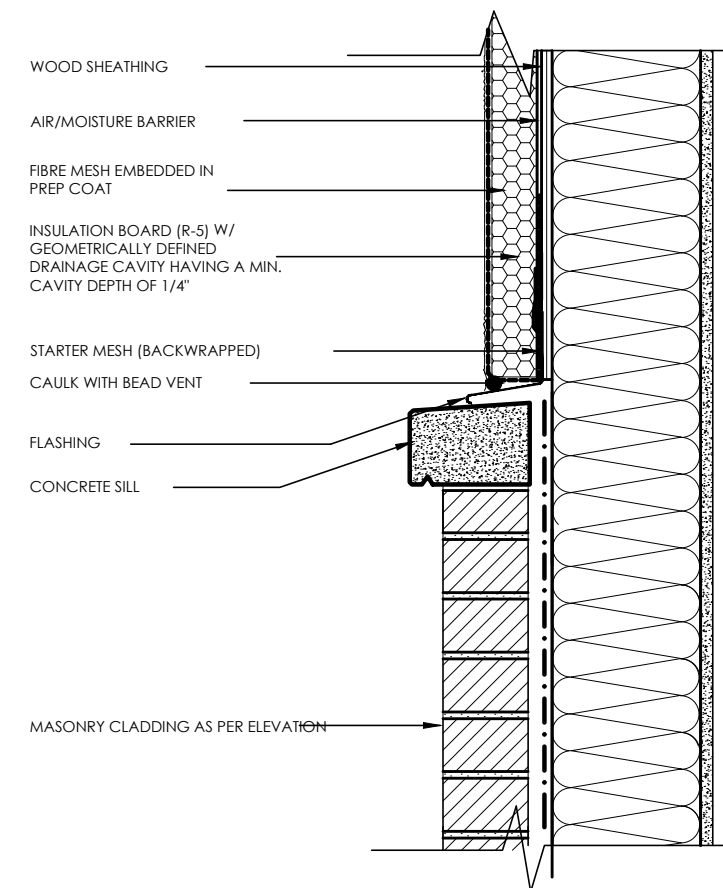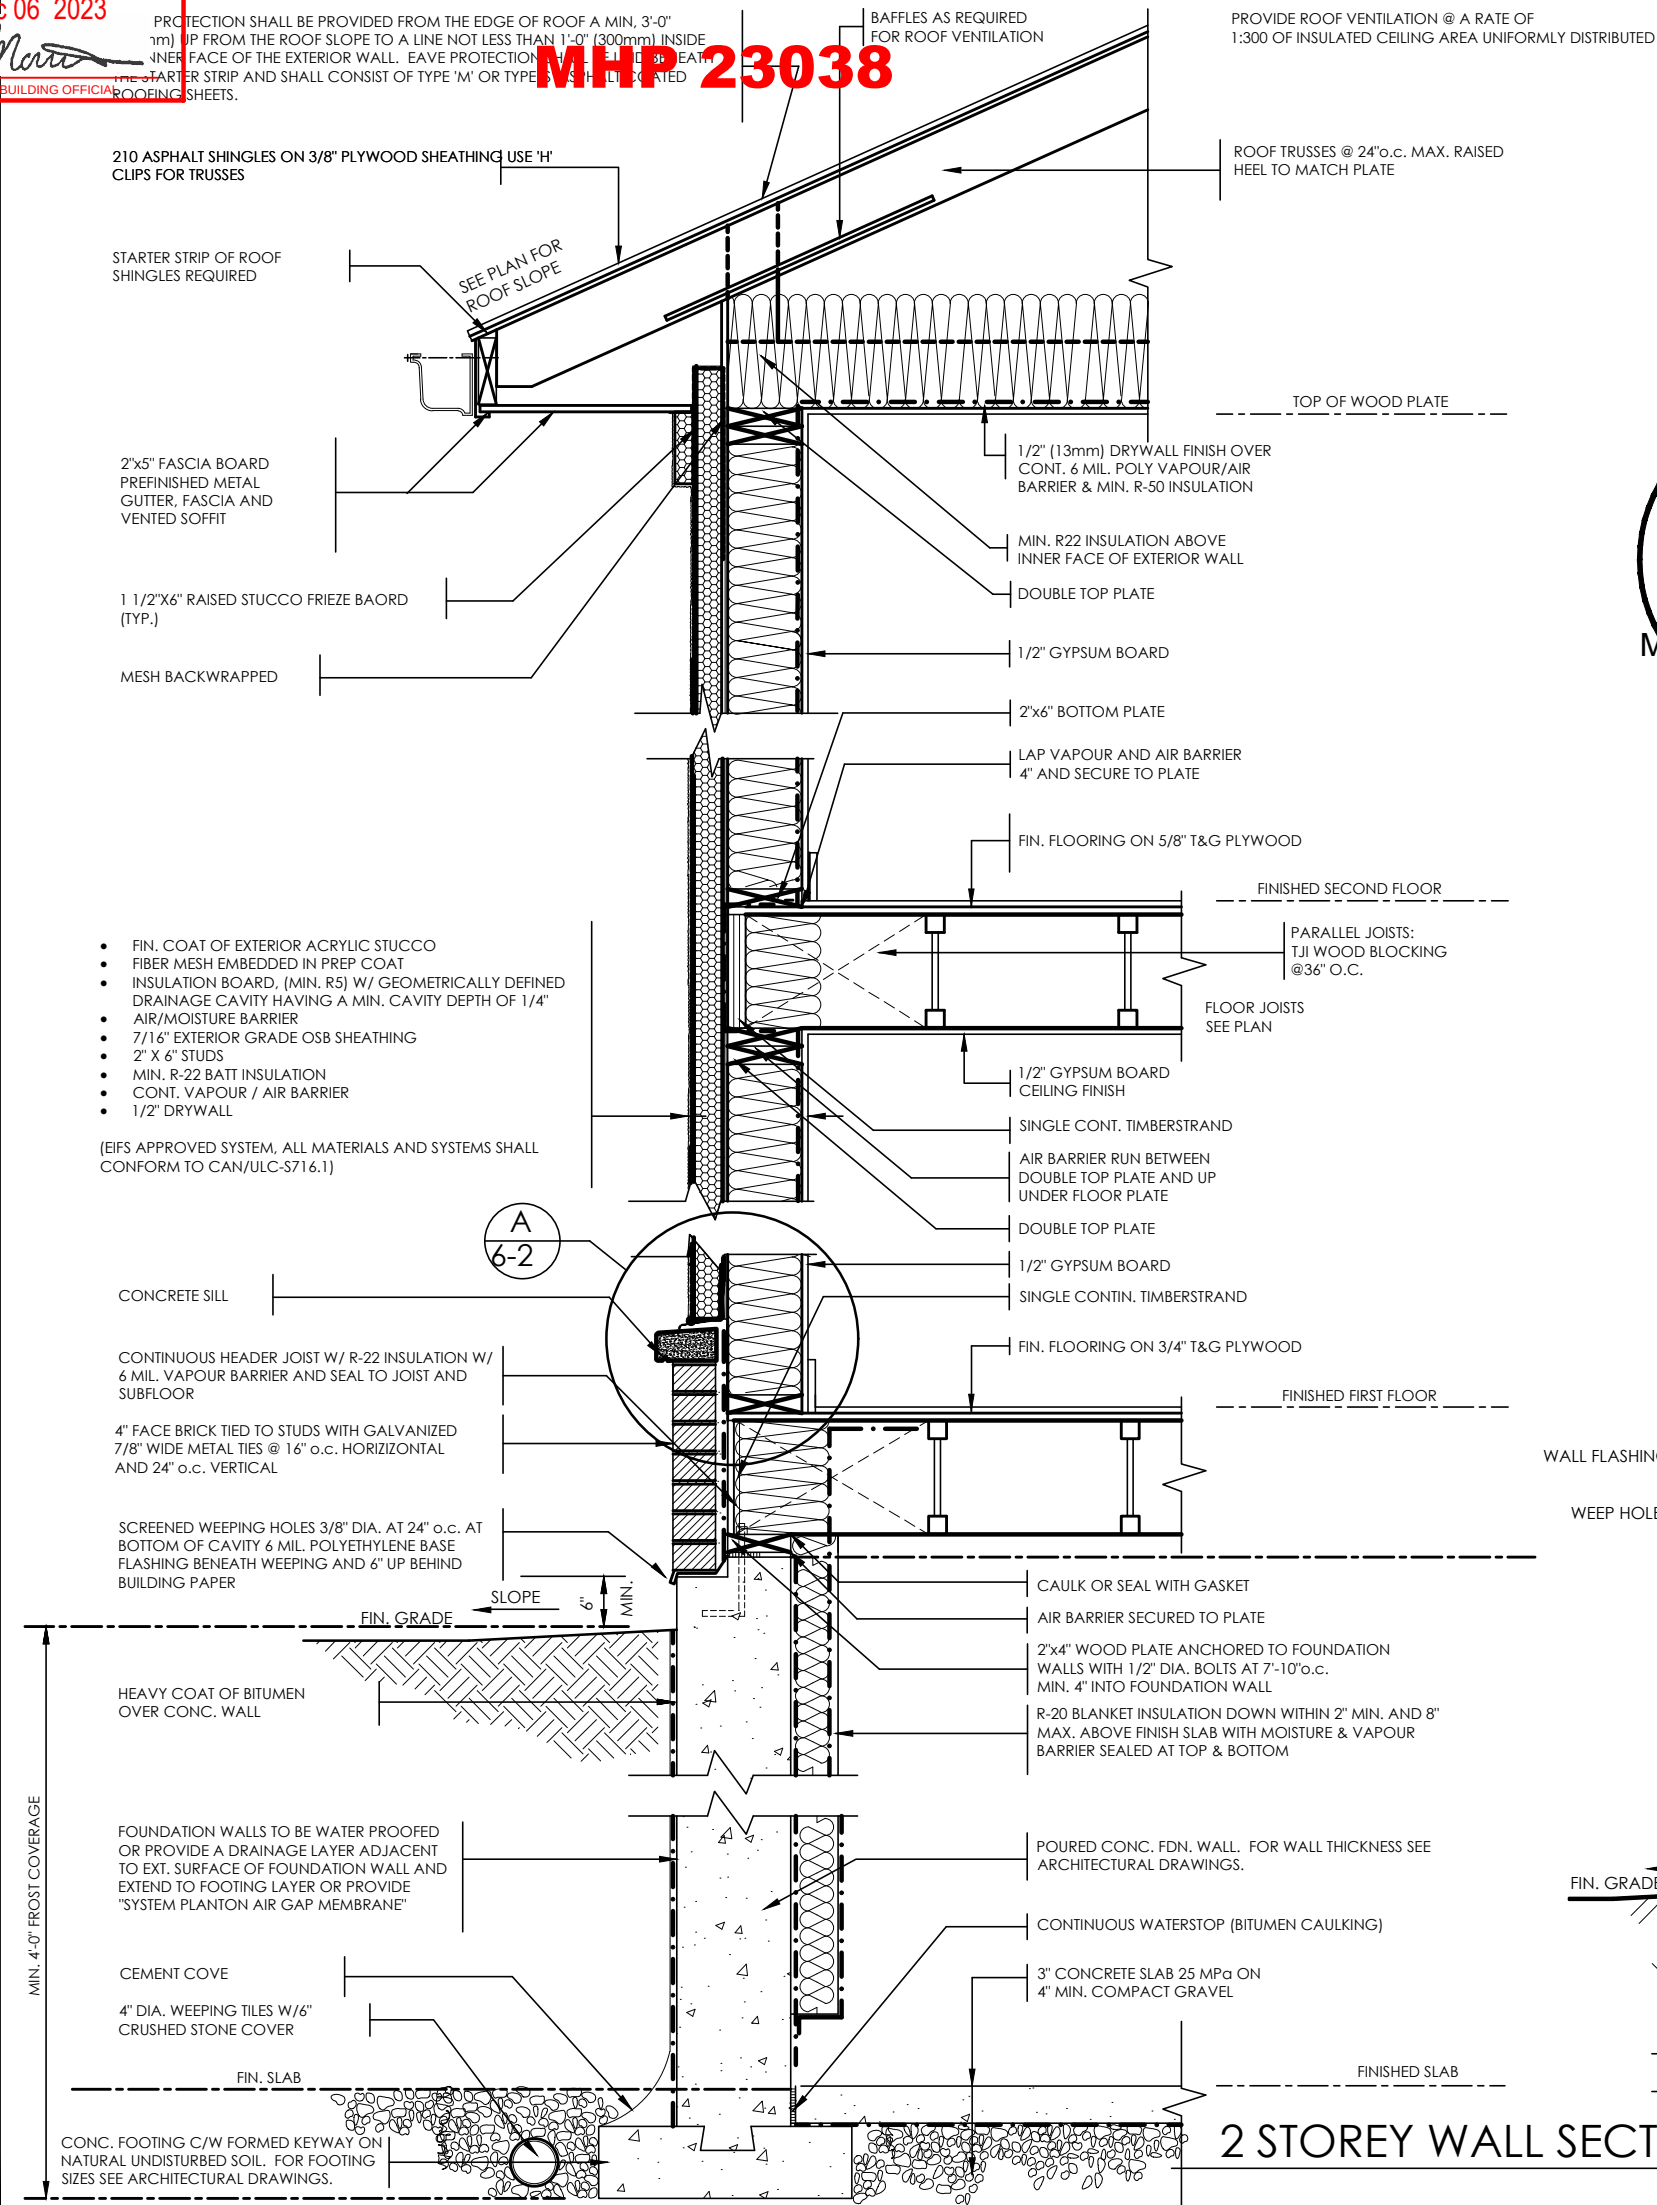

A. TERMINATION AT MASONRY CLADDING WITH SEALANT

1 1/2" = 1'0"

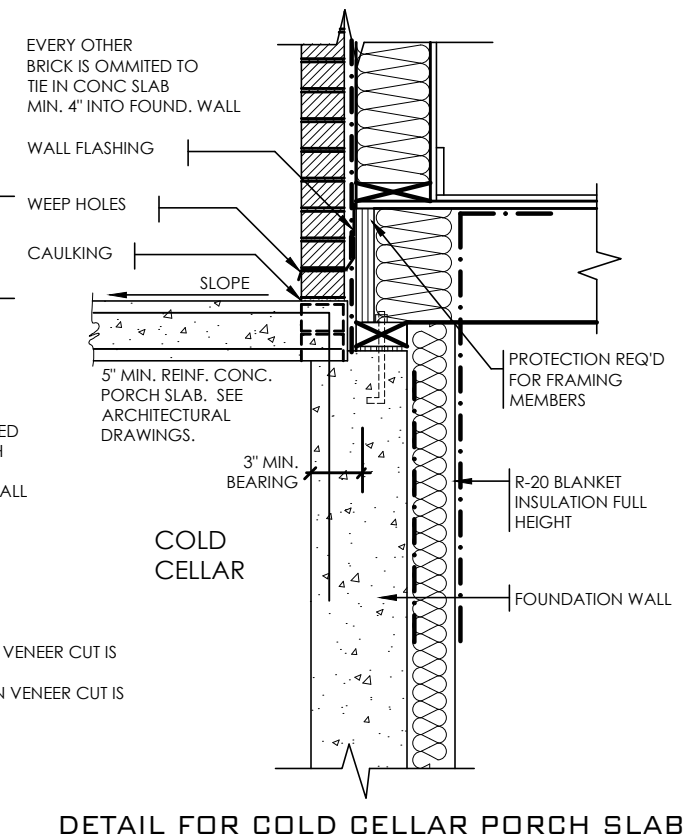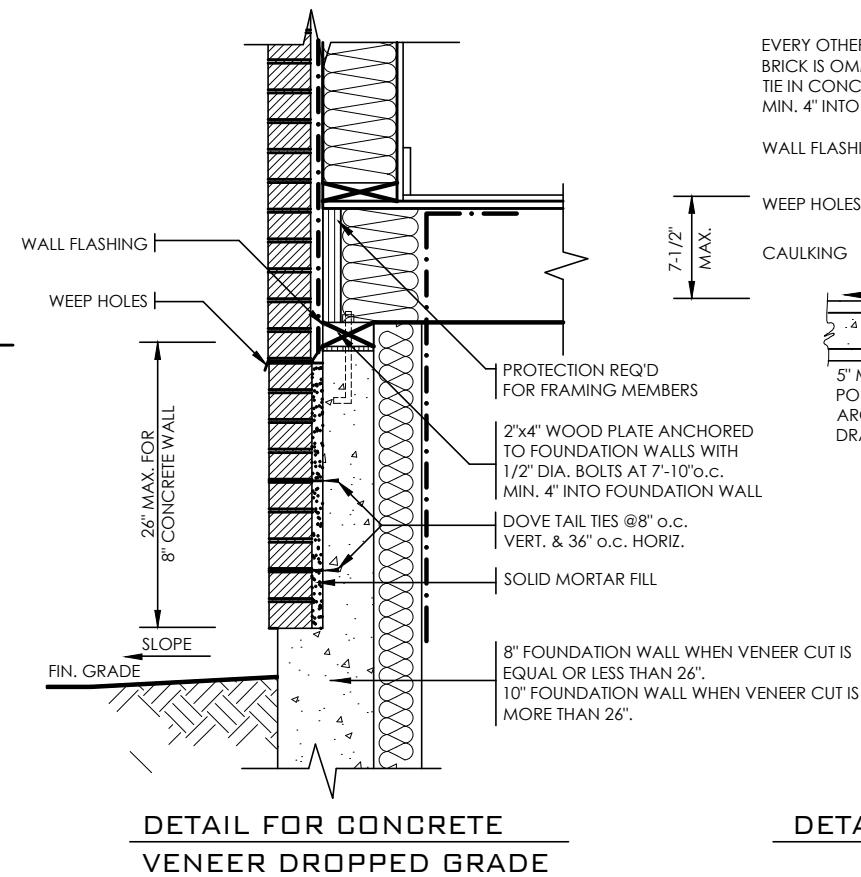

Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information




Jamie Mack 35923
Name BCIN Signature

Registration Information **Mackitecture** 103532

www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Title 2x6 Stucco Wall 2 Storey			
Scale as noted	By Greenpark	Area -	Sheet No. 6-2
Date 2023-04-28	Type -	Project No. 22-012	

Greenpark
www.greenparkgroup.ca
Project Name
Zadorra Estates Inc.

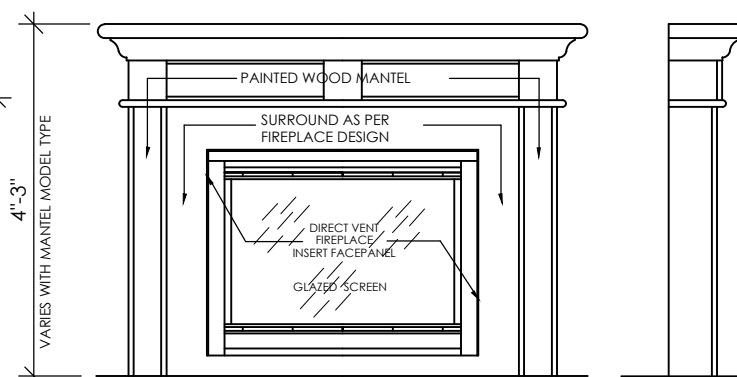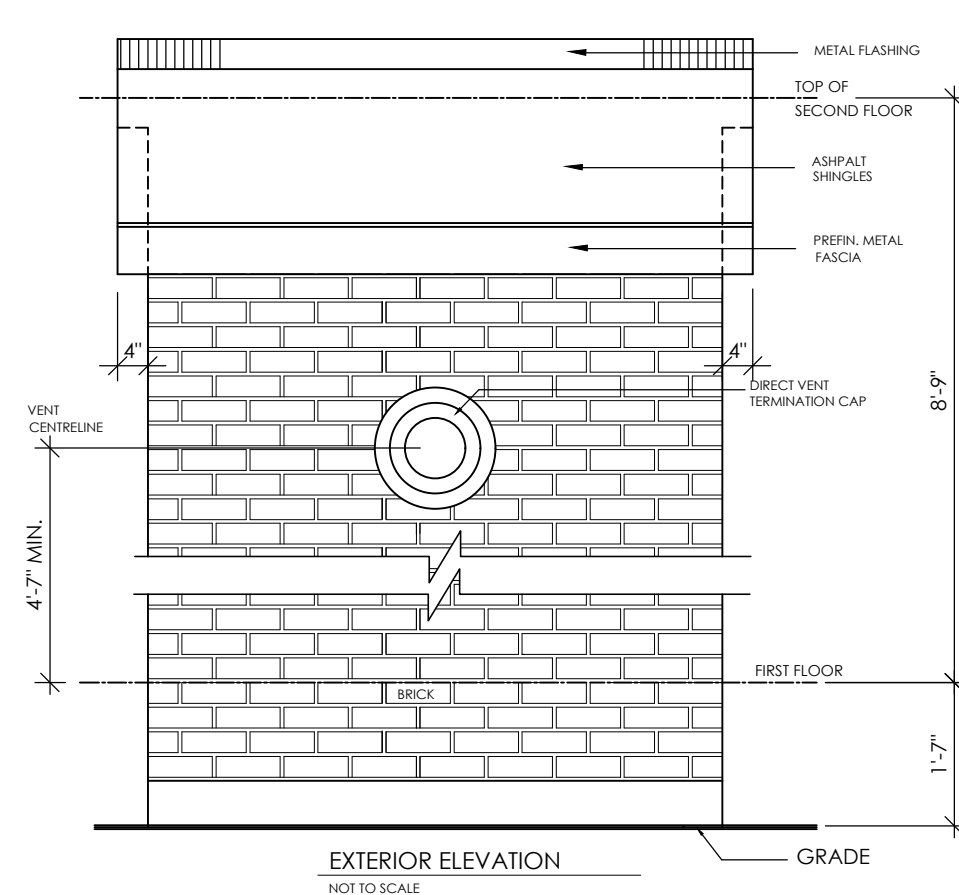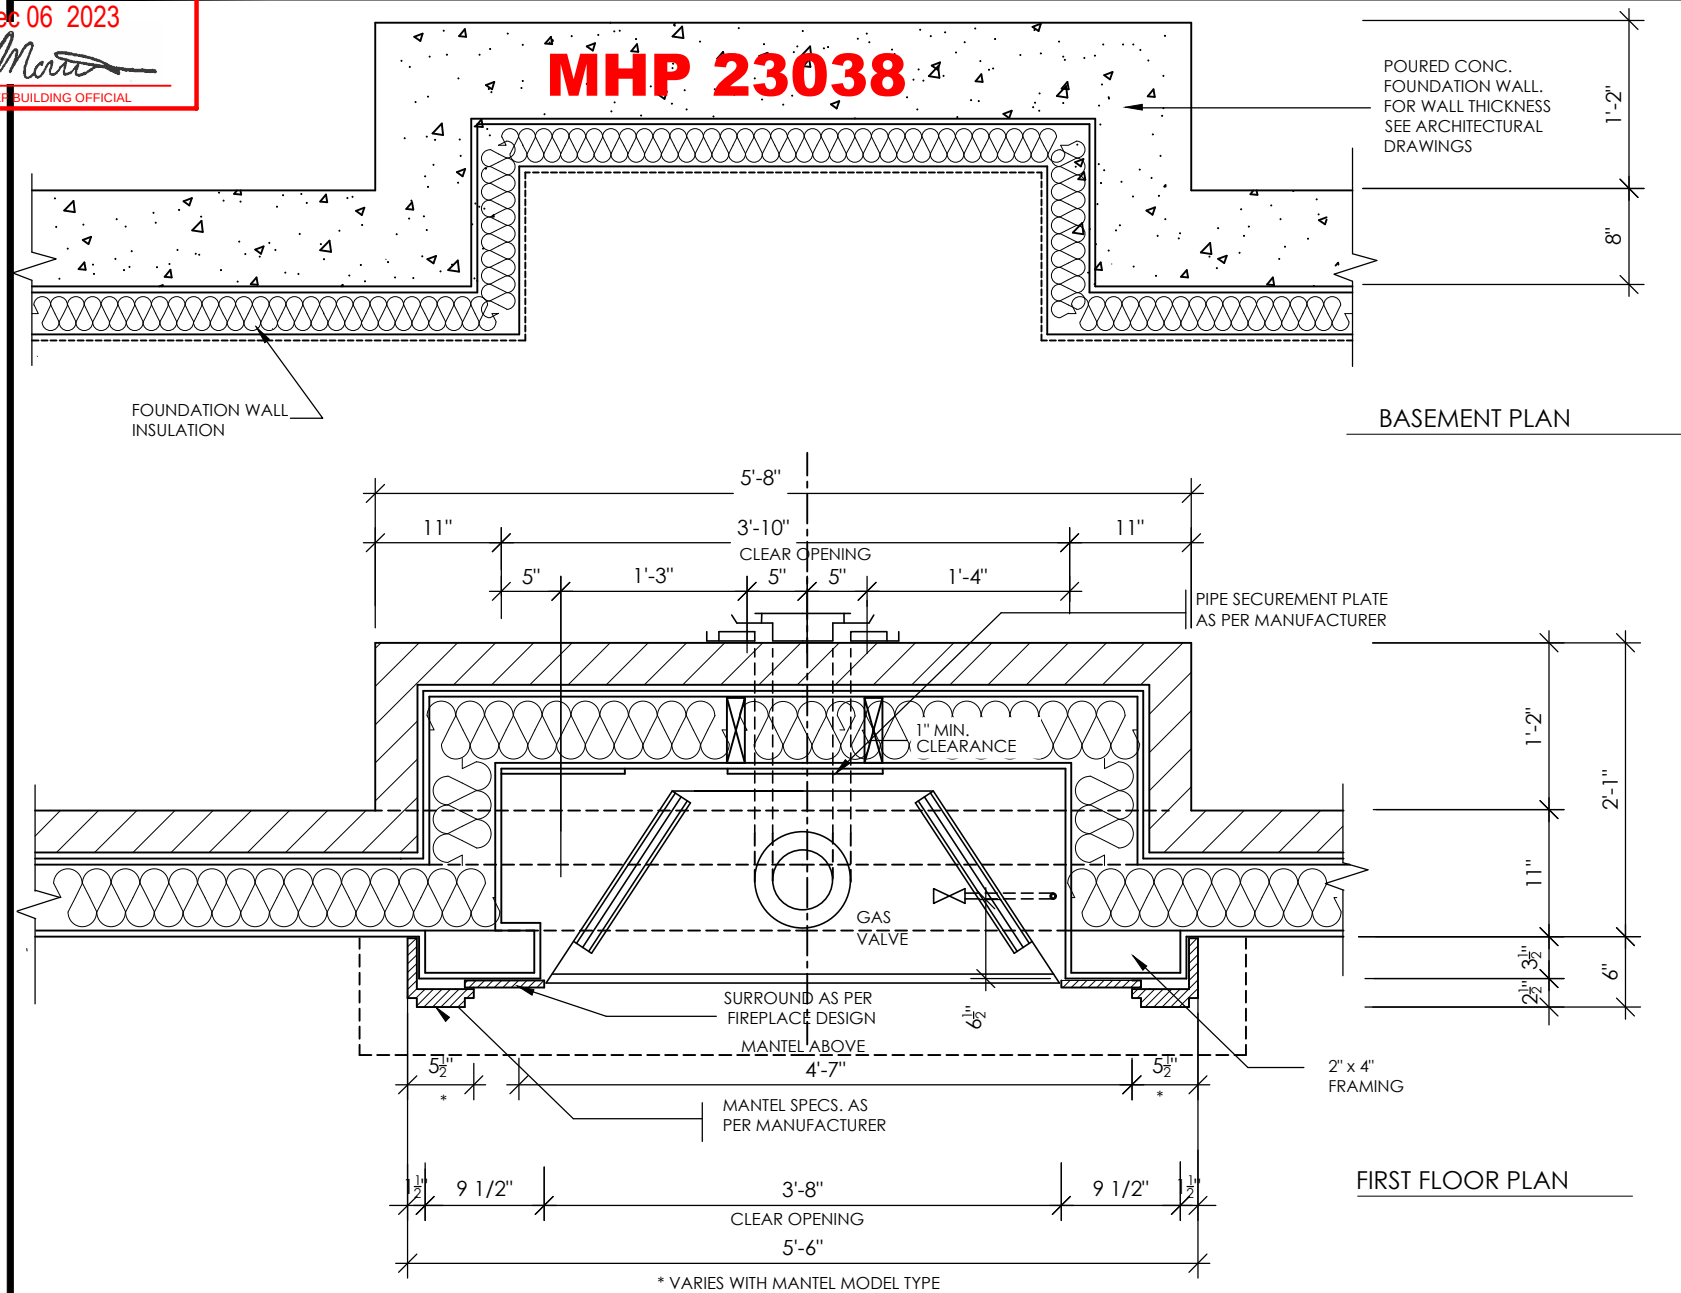


FRONT/SIDE ELEVATION

NOT TO SCALE

GENERAL INSTALLATION NOTES

- 1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURERS INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/OGA-B149.1 & 2.
- 2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:
 - FROM TOP OF UNIT 0"
 - FROM BACK OF UNIT 1/2"
 - FROM SIDES OF UNIT 1/2"
 - FROM TOP OF HORIZ. VENT 3"
 - FROM SIDES TO VENT 1"
- 3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC150 MODEL AS MANUFACTURED BY HEATILATOR.
- 4.0 THE MANTEL ILLUSTRATED IS THE S-2 GB AS SUPPLIED BY GREATER TORONTO FIREPLACE.

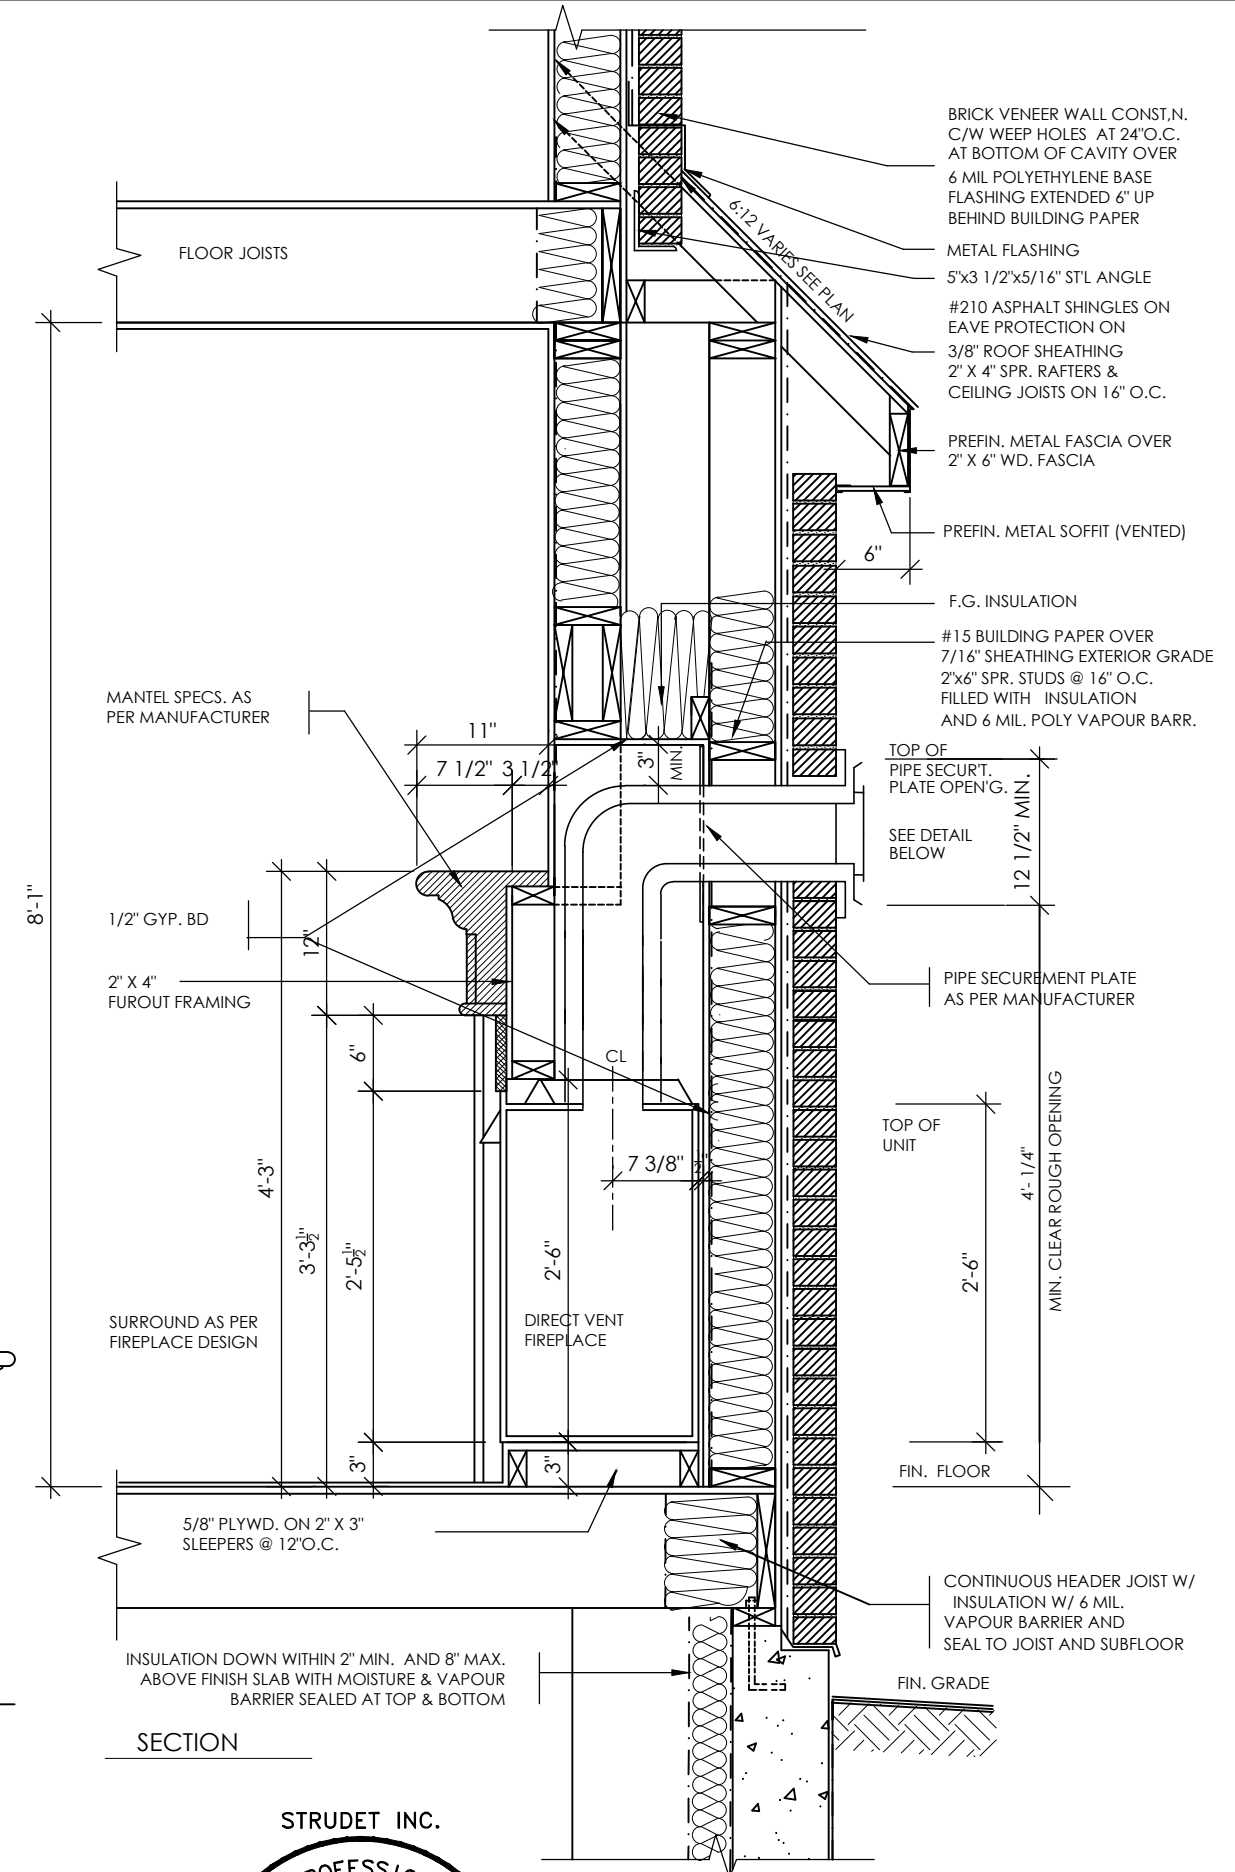

Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN

Registration Information **Mackitecture** 103532

www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

title **Direct Vent Fireplace**
Conventional Framed Roof

scale **3/4" = 1'-0"**

date **2023-04-28**

by **Greenpark**

area -





type -

project no. **22-012**

sheet no. **7**

www.greenparkgroup.ca

project name **Zadorra Estates Inc.**

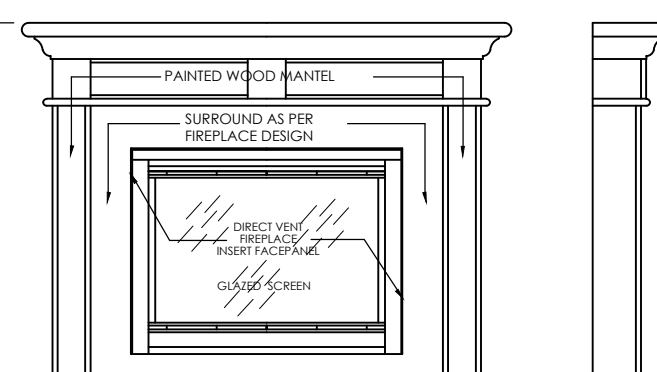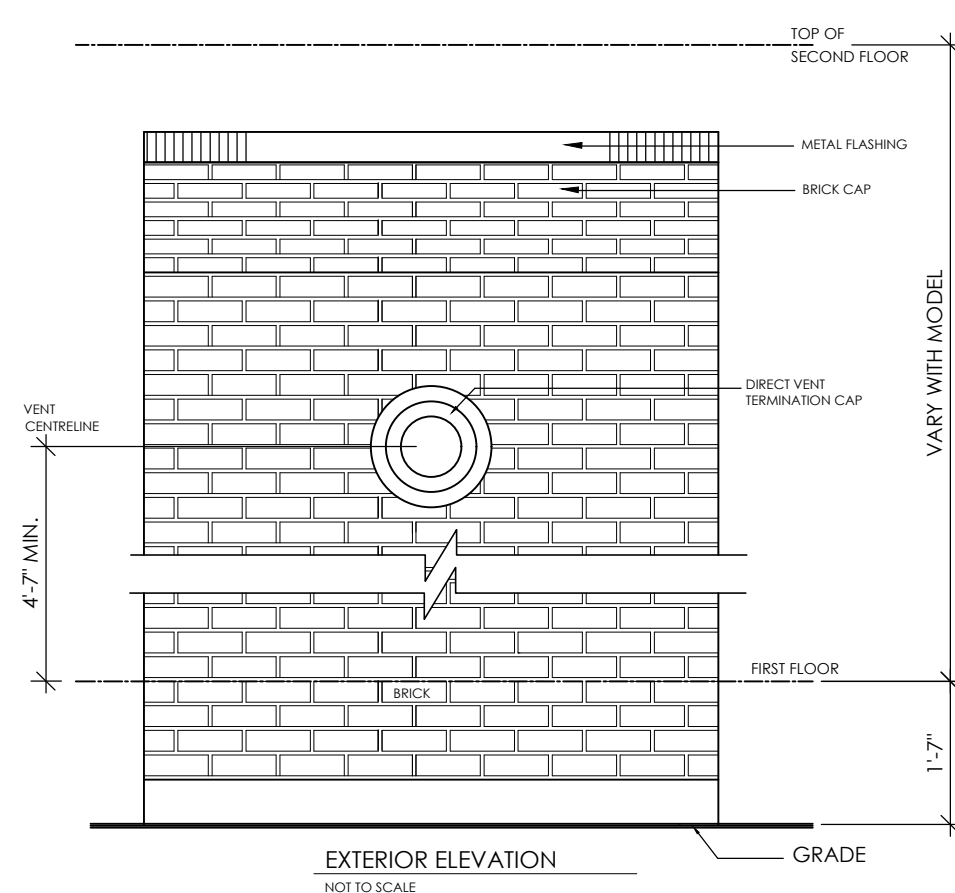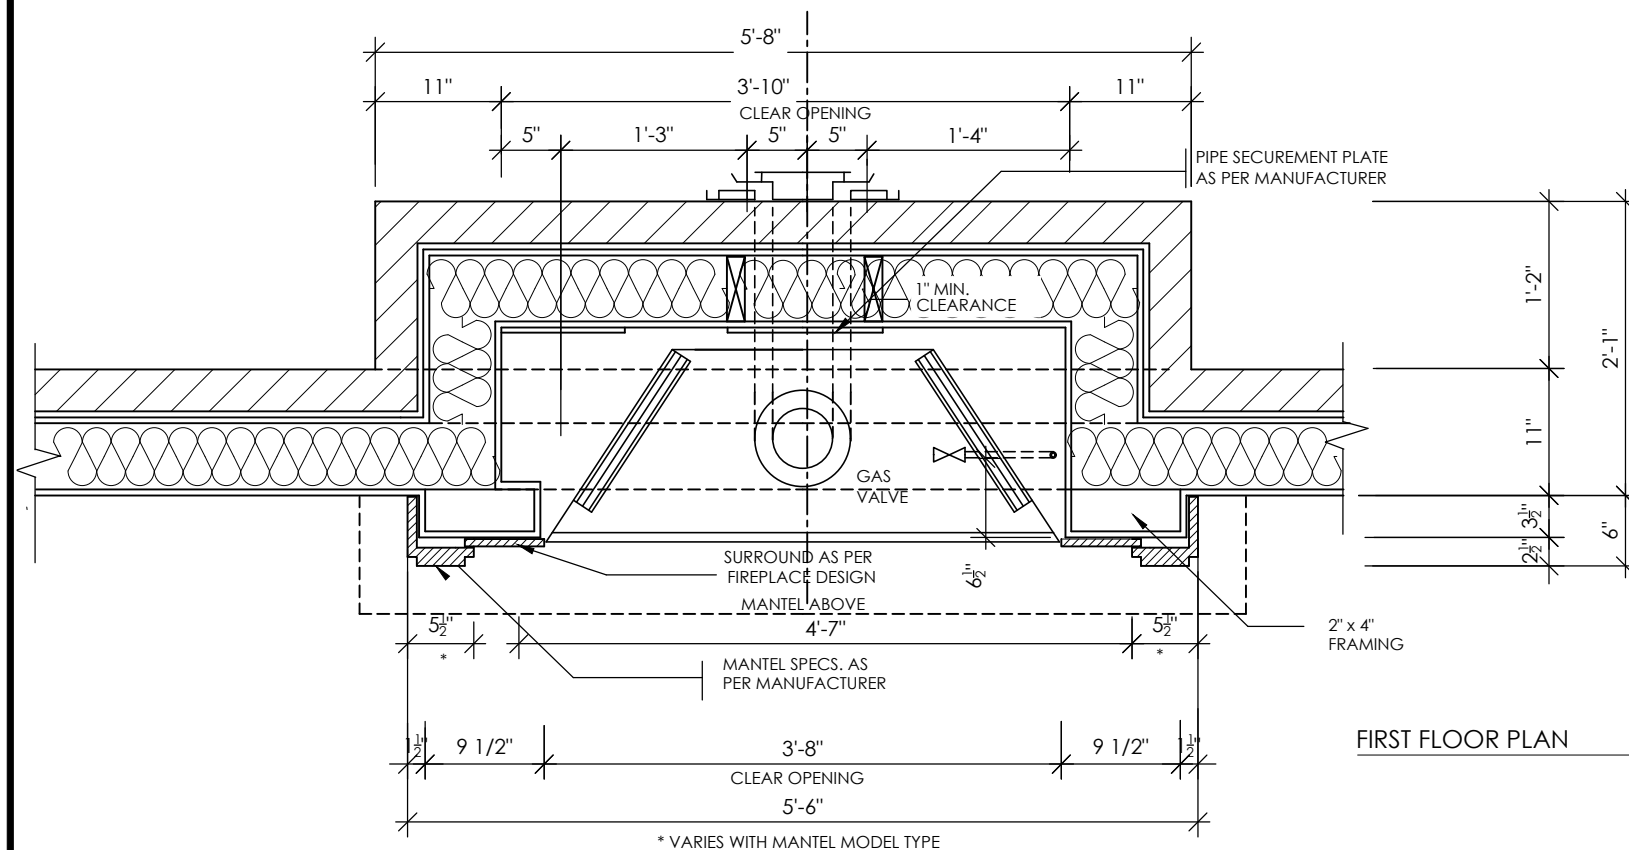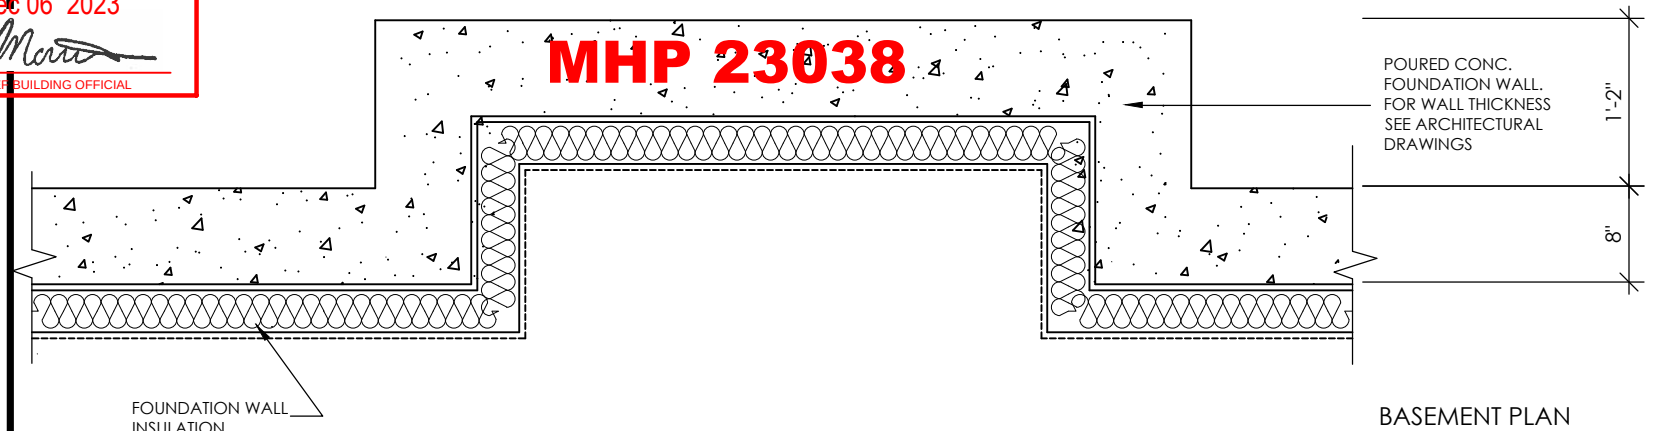


FRONT/SIDE ELEVATION

NOT TO SCALE

GENERAL INSTALLATION NOTES


- 1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURERS INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CGA-B149.1 & 2.
- 2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:
 - FROM TOP OF UNIT 0"
 - FROM BACK OF UNIT 1/2"
 - FROM SIDES OF UNIT 1/2"
 - FROM TOP OF HORIZ. VENT 3"
 - FROM SIDES TO VENT 1"
- 3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC150 MODEL AS MANUFACTURED BY HEATILATOR.
- 4.0 THE MANTEL ILLUSTRATED IS THE S-2 GB AS SUPPLIED BY GREATER TORONTO FIREPLACE.

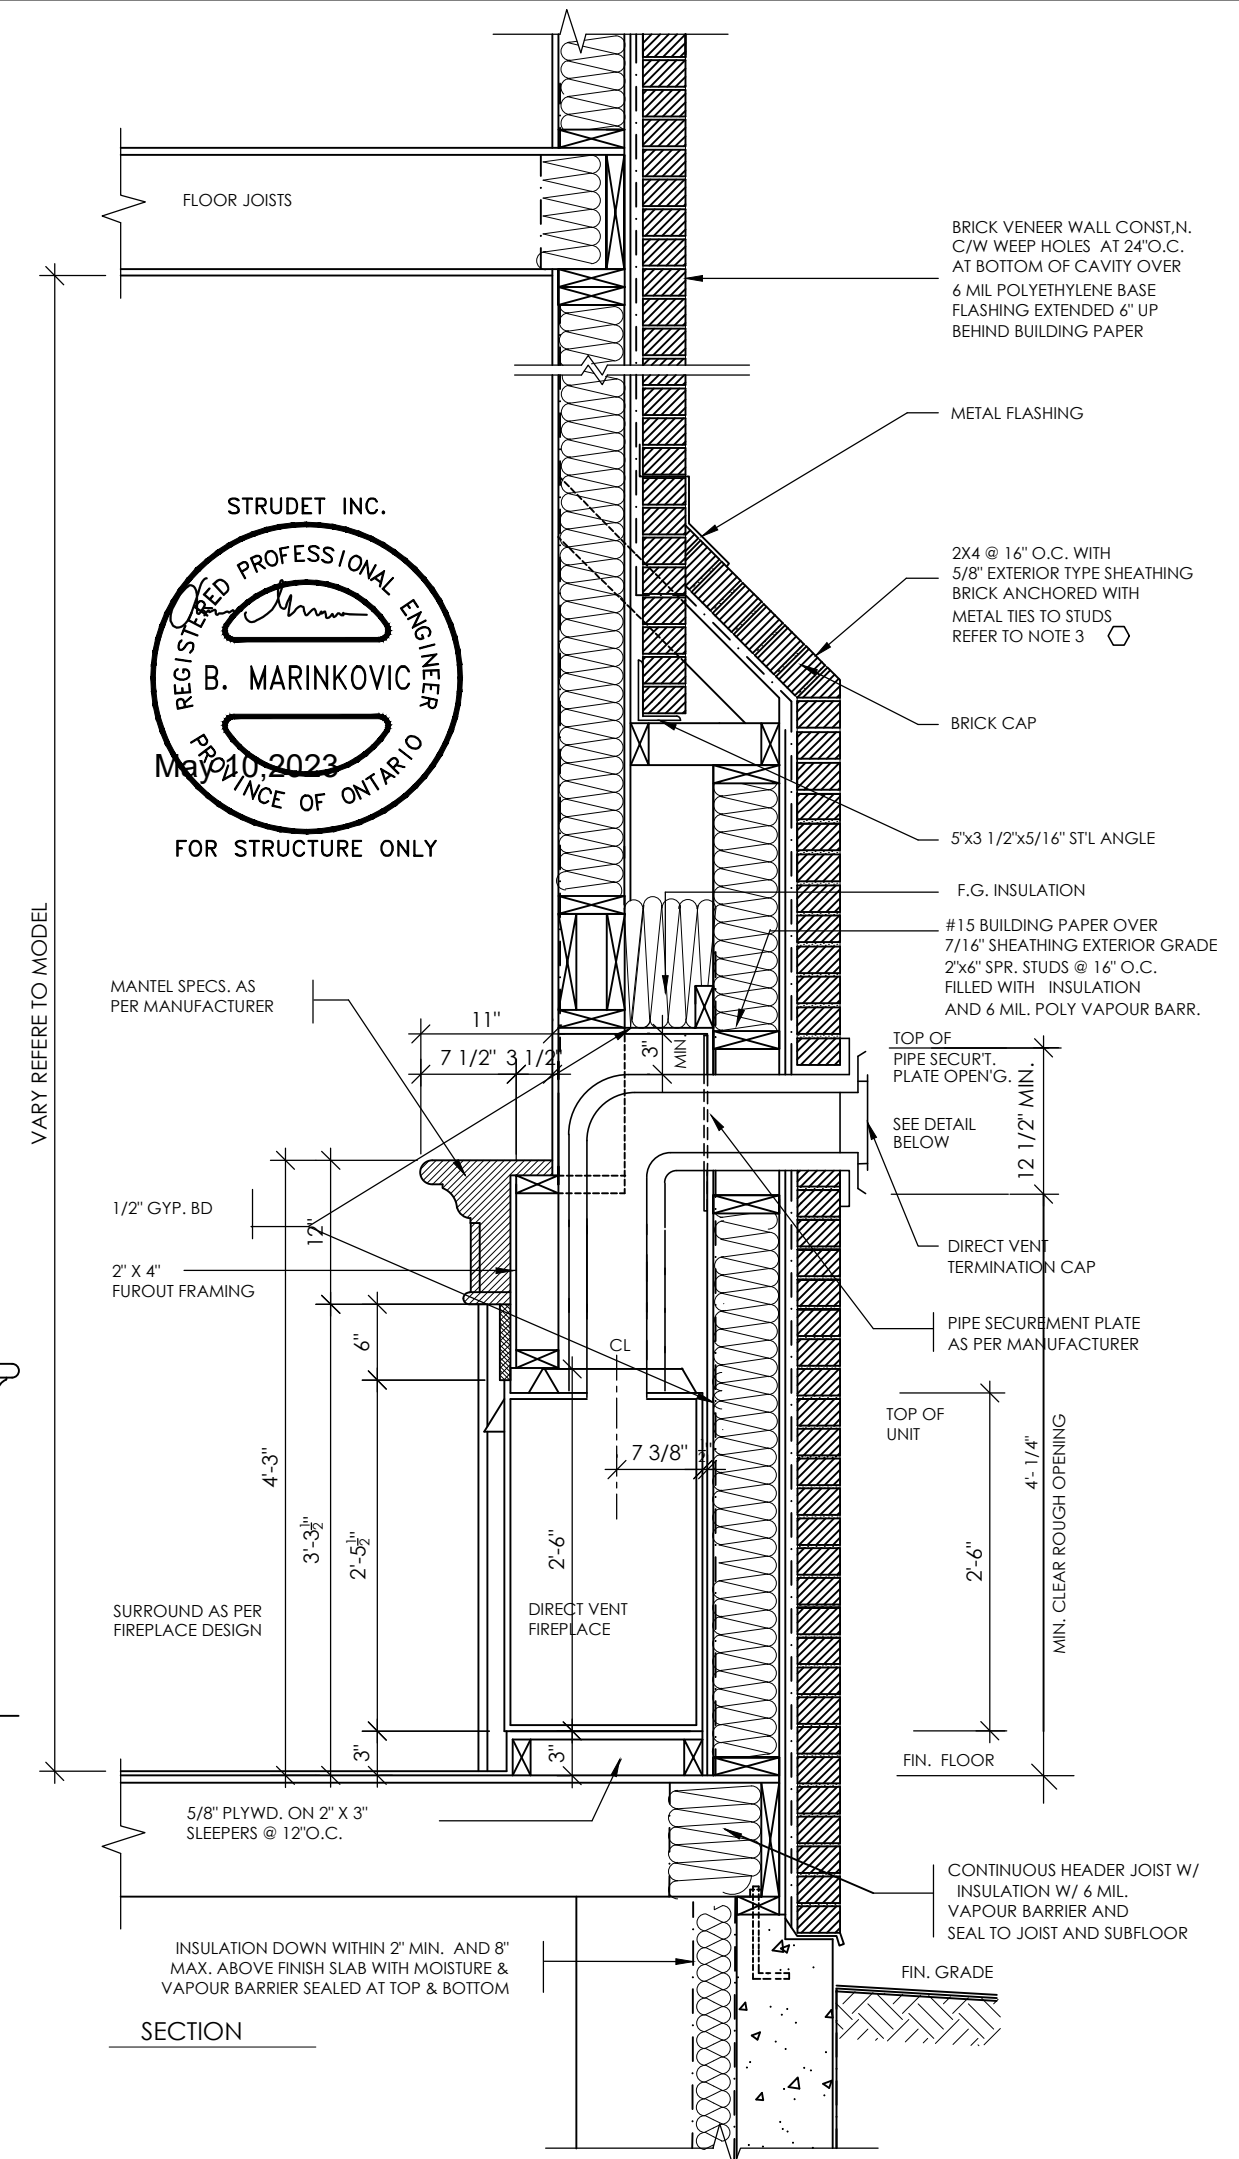

Compliance Package A1

	The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer. Qualification Information Jamie Mack 35923  Name BCIN Signature Registration Information Mackitecture 103532	 www.mackitecture.ca 975A Elgin Street West, Suite 353 Cobourg, ON K9A 5J3 Tel: 416-735-8190 Email: info@mackitecture.ca	<table><tr><td colspan="2">title</td><td colspan="2">Direct Vent Fireplace Brick Veneer Roof</td><td colspan="2"></td></tr><tr><td>scale</td><td>3/4" = 1'-0"</td><td>by</td><td>Greenpark</td><td>area</td><td>-</td></tr><tr><td>date</td><td>2023-04-28</td><td>type</td><td>-</td><td>project no.</td><td>22-012</td></tr></table>	title		Direct Vent Fireplace Brick Veneer Roof				scale	3/4" = 1'-0"	by	Greenpark	area	-	date	2023-04-28	type	-	project no.	22-012	 www.greenparkgroup.ca project name Zadorra Estates Inc.
title		Direct Vent Fireplace Brick Veneer Roof																				
scale	3/4" = 1'-0"	by	Greenpark	area	-																	
date	2023-04-28	type	-	project no.	22-012																	
Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.																						

MHP 23038

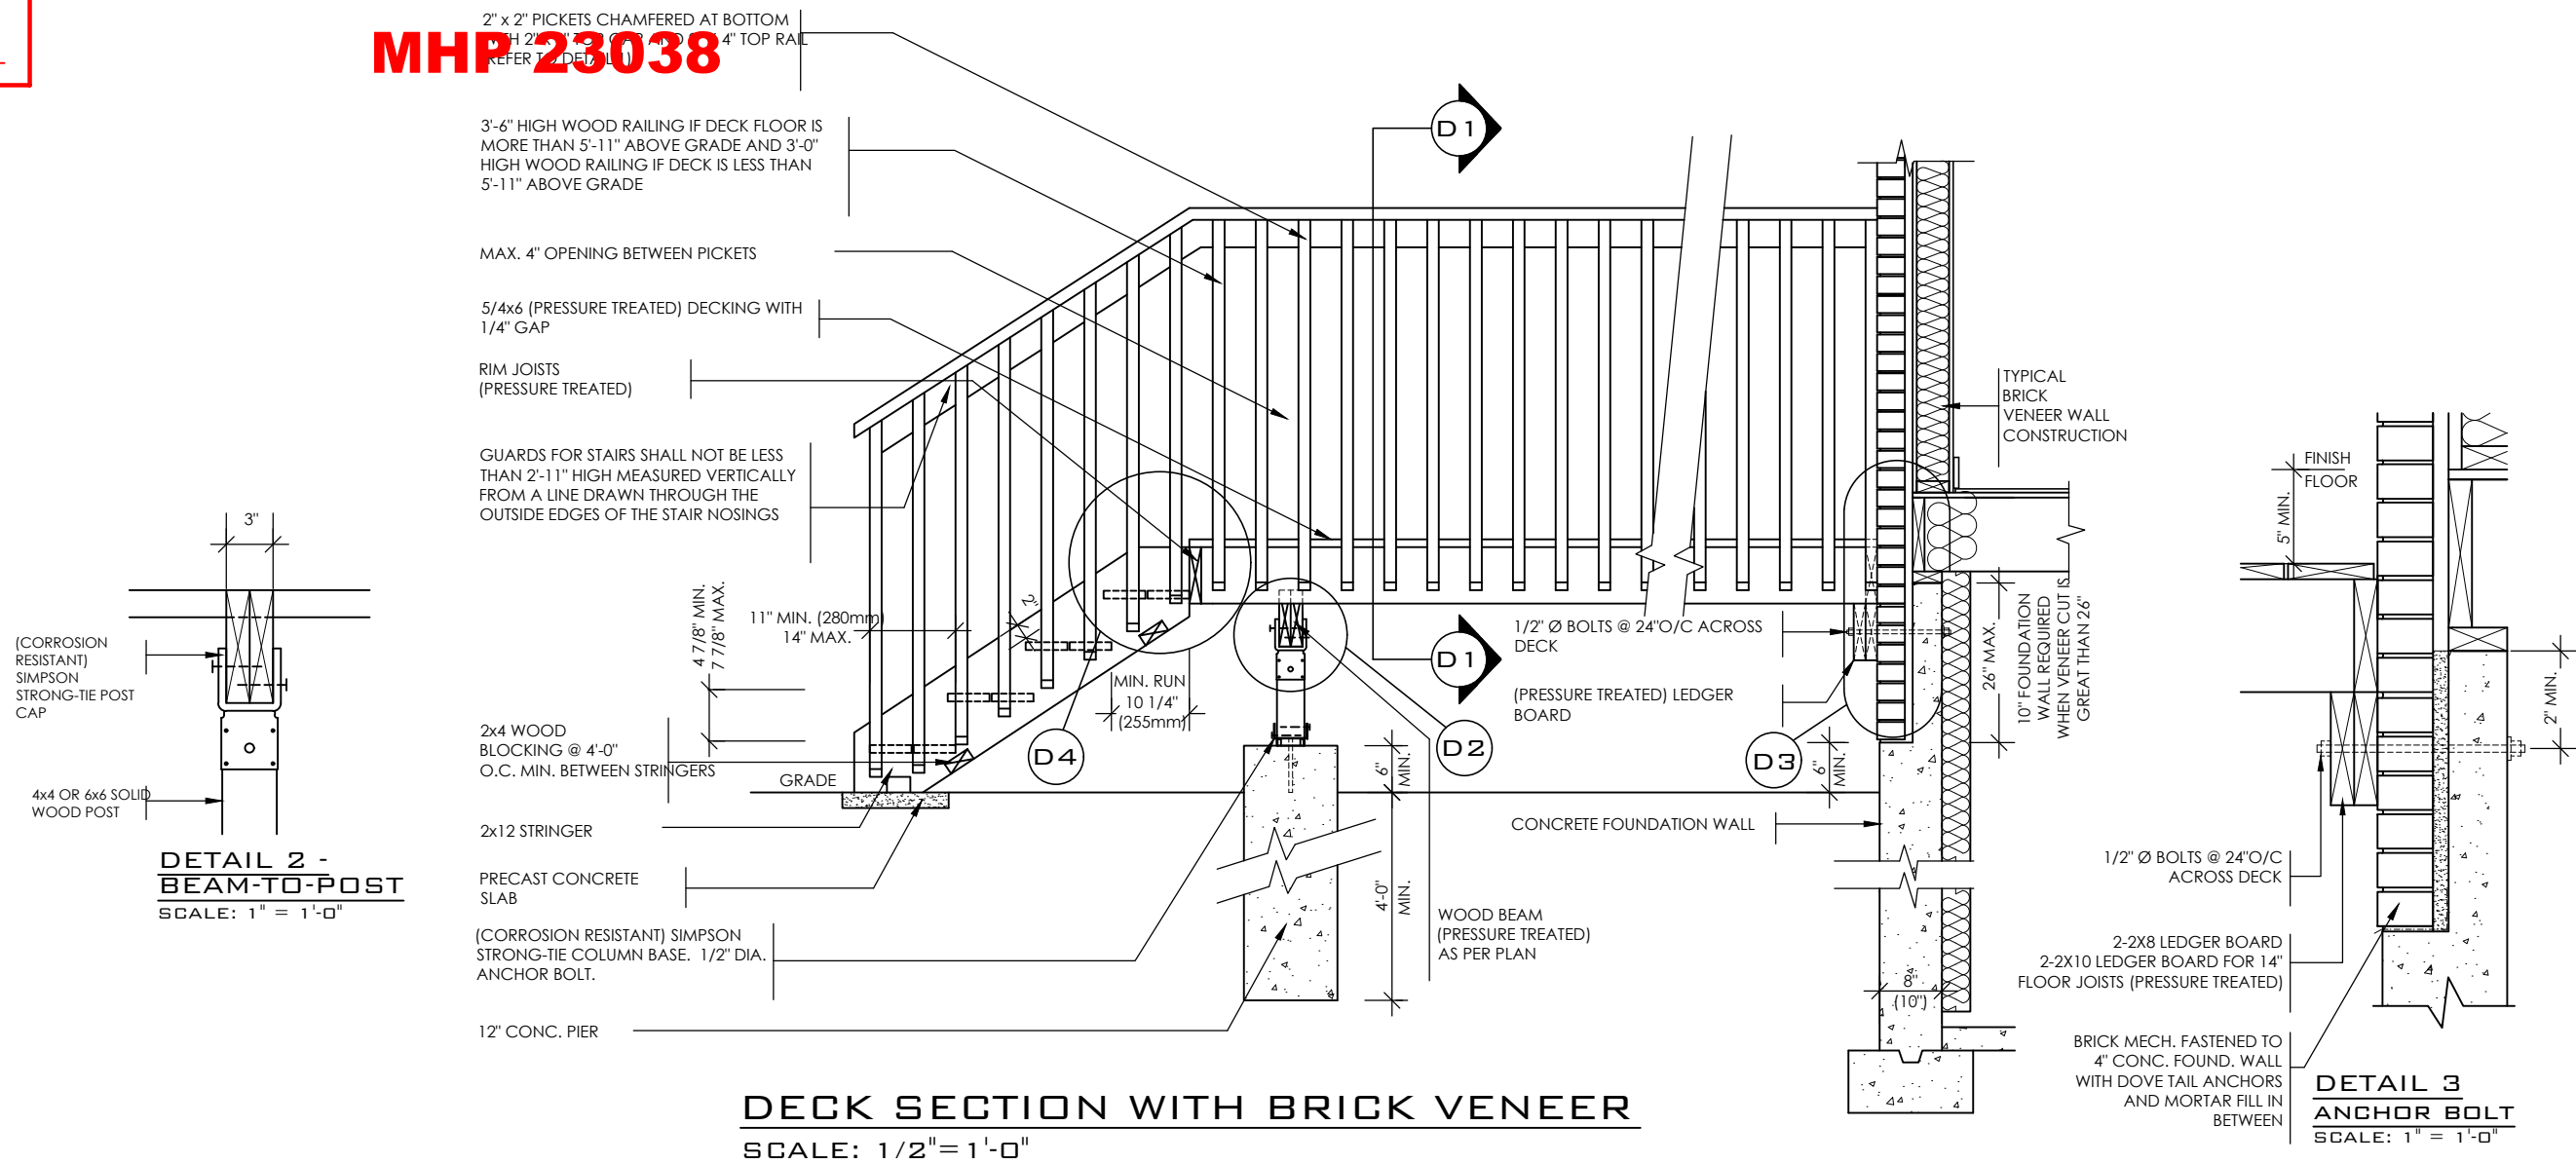


DETAIL 1

CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK



GUARD PARALLEL TO FLOOR JOISTS

SCALE: 1" = 1'-0"

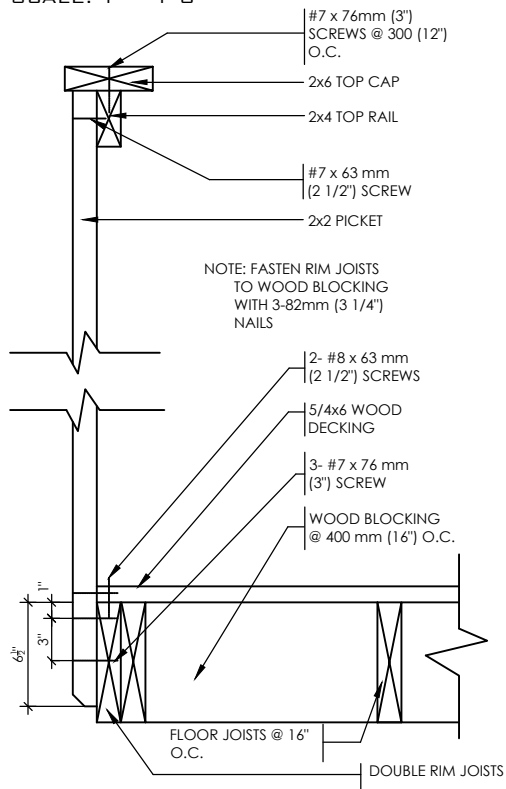

GUARD PERPENDICULAR TO FLOOR JOISTS

SCALE: 1" = 1'-0"

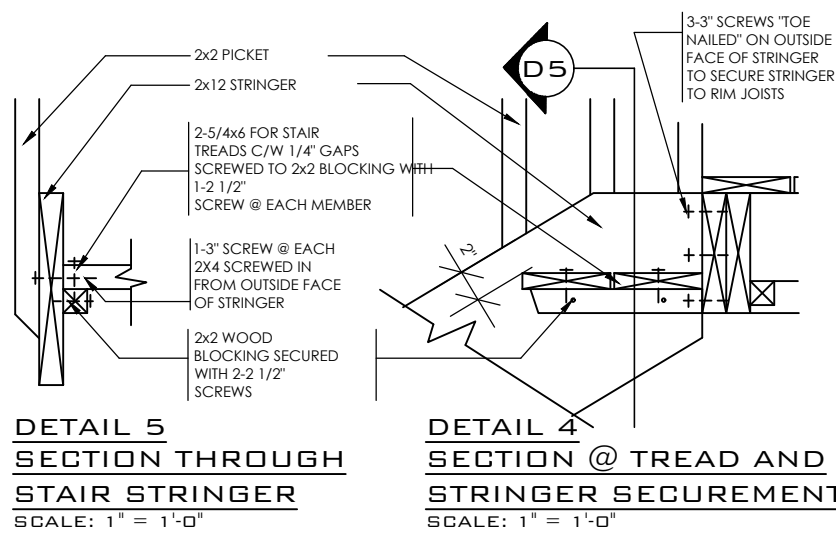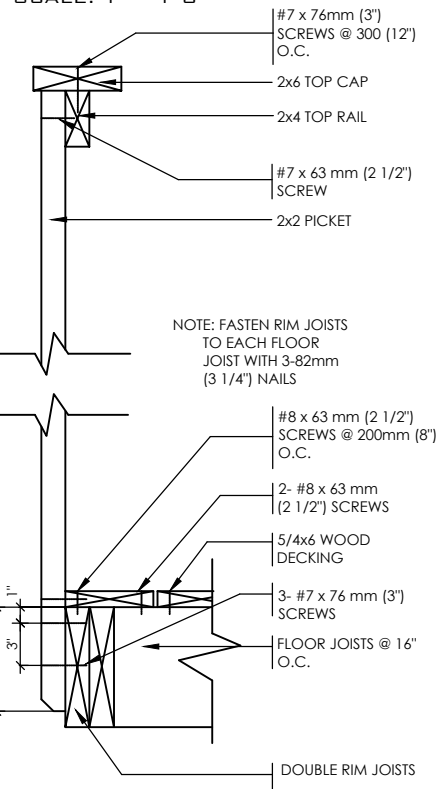

GENERAL NOTES

- BRICK TO BE COMPRESSIVE STRENGTH OF 15MPa (2200 p.s.i.) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
- MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
- ALL NAILS AND SCREWS TO BE GALVANIZED.
- WOOD FOR CANTILEVERED PICKETS PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
- THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa [40psf].
- CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINED.
- FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa [3130psf].



Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923

Name BCIN

Registration Information Mackitecture 103532



www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

title Wood Deck Details


scale As shown	by Greenpark	area -	sheet no. 8
date 2023-07-18	type -	project no. 22-012	



www.greenparkgroup.ca


project name Zadorra Estates Inc.

MHP 23038

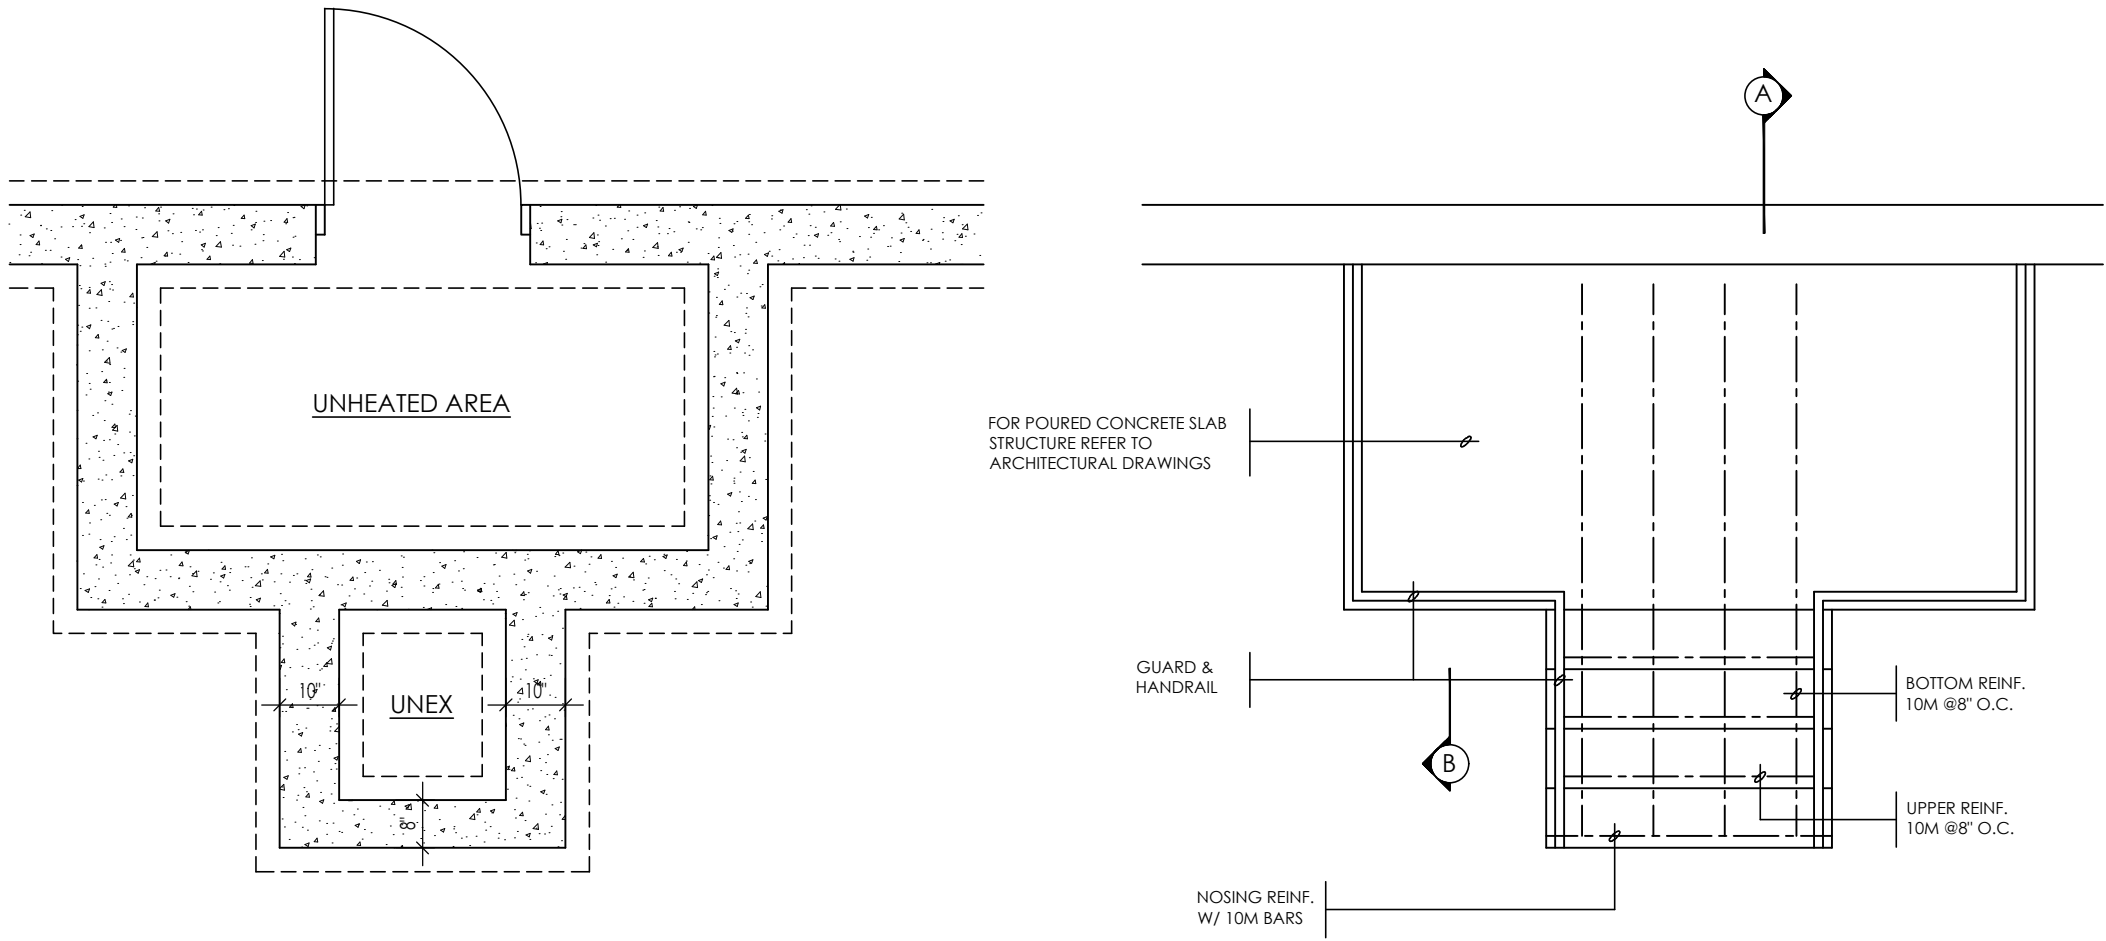

FOUNDATION PLAN

GROUND FLOOR PLAN

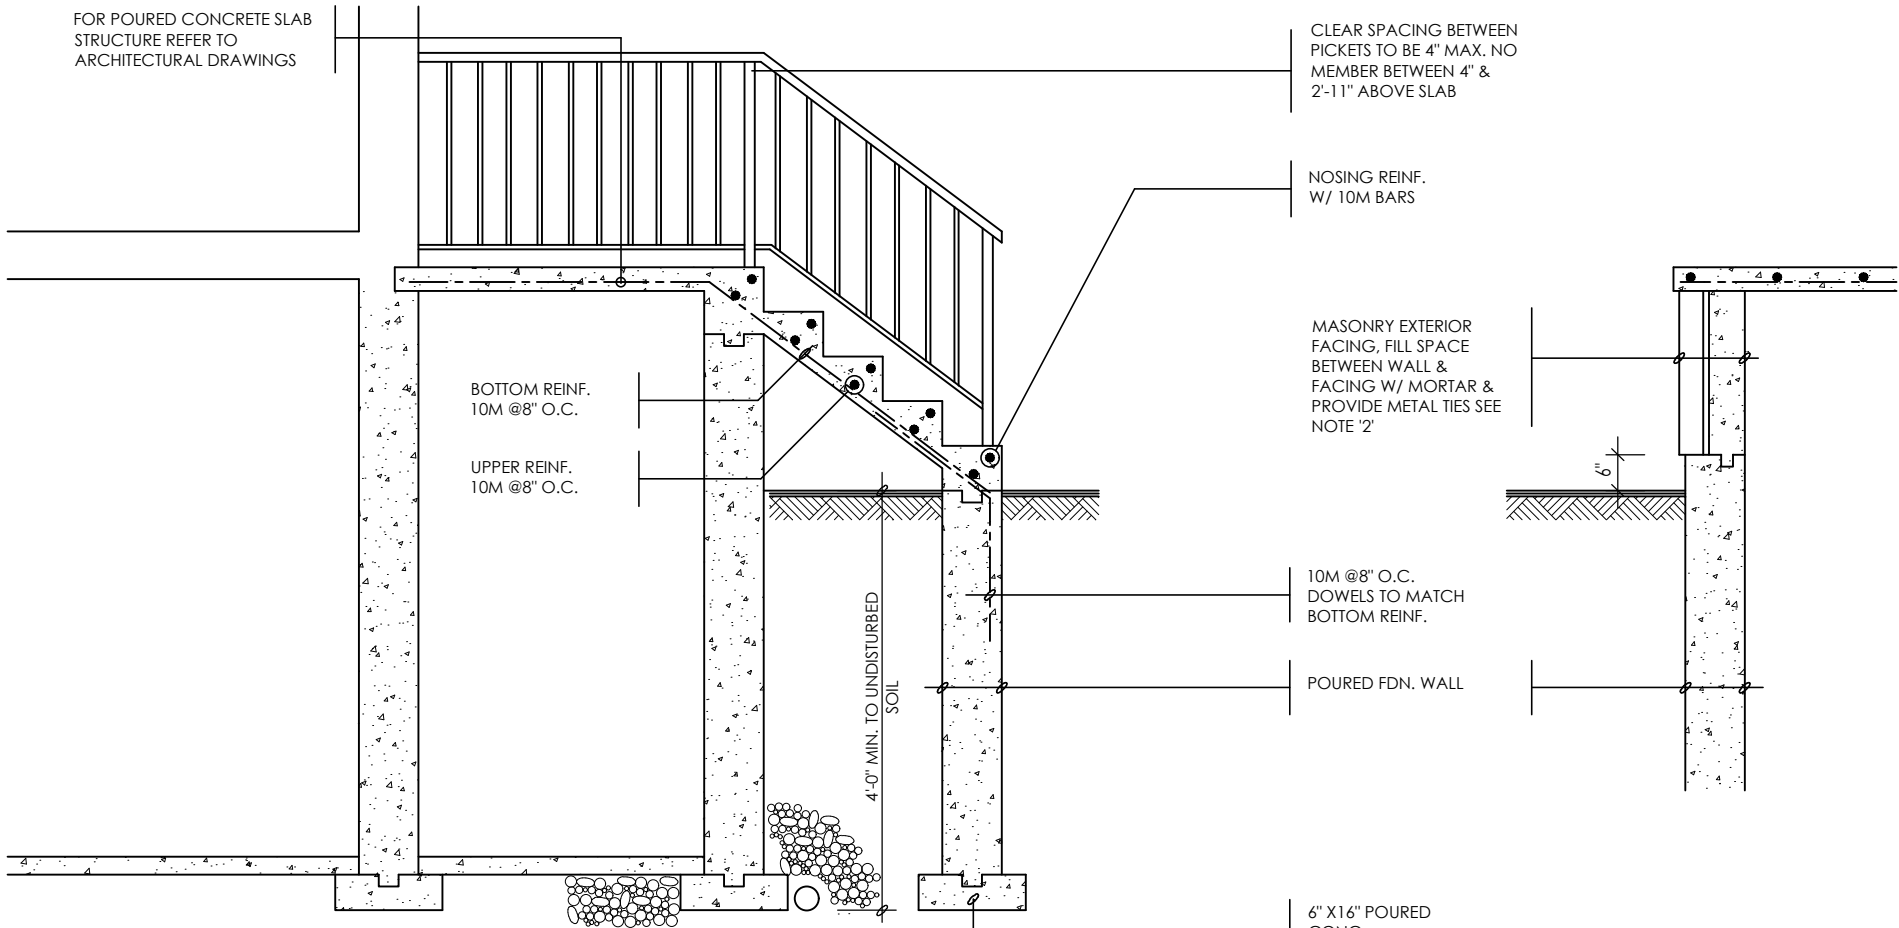

SECTION 'A'

SECTION 'B'

NOTE: FOR MORE THAN 8 RISERS

GENERAL NOTES

- EXTERIOR STAIRS**
7 7/8" RISE MAXIMUM
10 1/4" (255mm) RUN MINIMUM
11" (280mm) TREAD MINIMUM
- MASONRY TIES**
WHEN BRICK FACING IS USED ABOVE GROUND LEVEL,
PROVIDE 3/16" DIA. CORROSION RESISTANT METAL
TIES @ 36" HORIZONTAL & 8" VERTICAL
- GUARDS**
ARE REQUIRED AROUND CONCRETE SLAB IF MORE
THAN 2'-0" ABOVE GRADE & ON BOTH SIDES OF
STAIRS CONTAINING MORE THAN 6 RISERS. MINIMUM
31" HIGH FOR STAIRS MINIMUM 35" HIGH FOR
PORCHES UP TO 5'-11" ABOVE GRADE. MINIMUM 42"
HIGH FOR GREATER HTS.
- HANDRAIL**
ARE REQUIRED WHERE STEPS HAVE MORE THAN 3
RISERS. HANDRAIL HEIGHT 31" - 38".
- FOUNDATION WALLS**
THICKNESS OF FOUNDATION WALLS IS DEPENDANT
UPON VENEER CUT 8" FOR UP TO 26" VENEER CUT
HEIGHT 10" FOR VENEER CUT OVER 26" HIGH
- CONCRETE**
MINIMUM CONCRETE STRENGTH SHALL BE 4650 PSI
[32MPa] W/ 5%-8% AIR ENTRAINMENT MINIMUM
CONCRETE SLAB THICKNESS 5"
- CONCRETE COVER**
PROVIDE MINIMUM 3/4" CLEAR CONCRETE COVER
TO REINFORCING BARS



Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information




Jamie Mack 35923
Name BCIN Signature
Registration Information **Mackitecture** 103532


www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Poured Concrete Stairs				
scale	by	area	sheet no.	
3/8" = 1'-0"	Greenpark	-	14	
date	type	project no.		
2023-07-18	-	22-012		



www.greenparkgroup.ca
project name
Zadorra Estates Inc.

MHP 23038

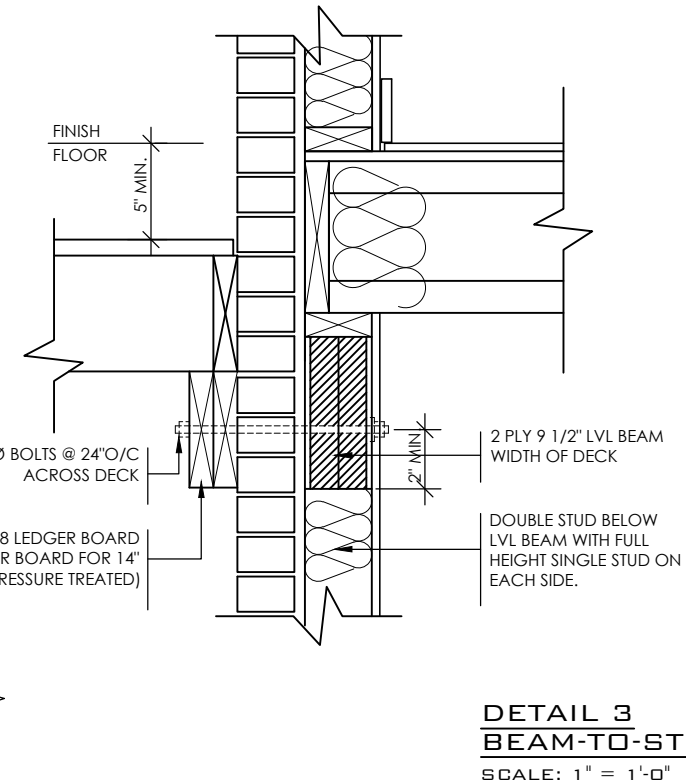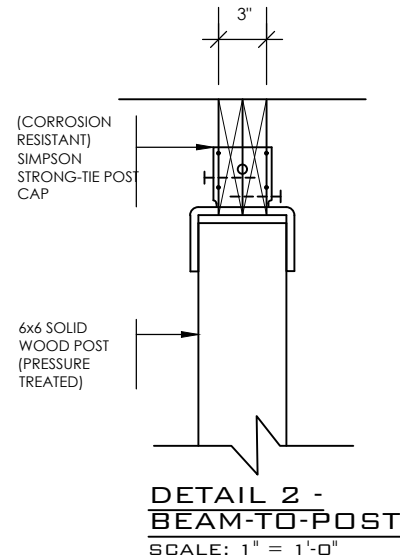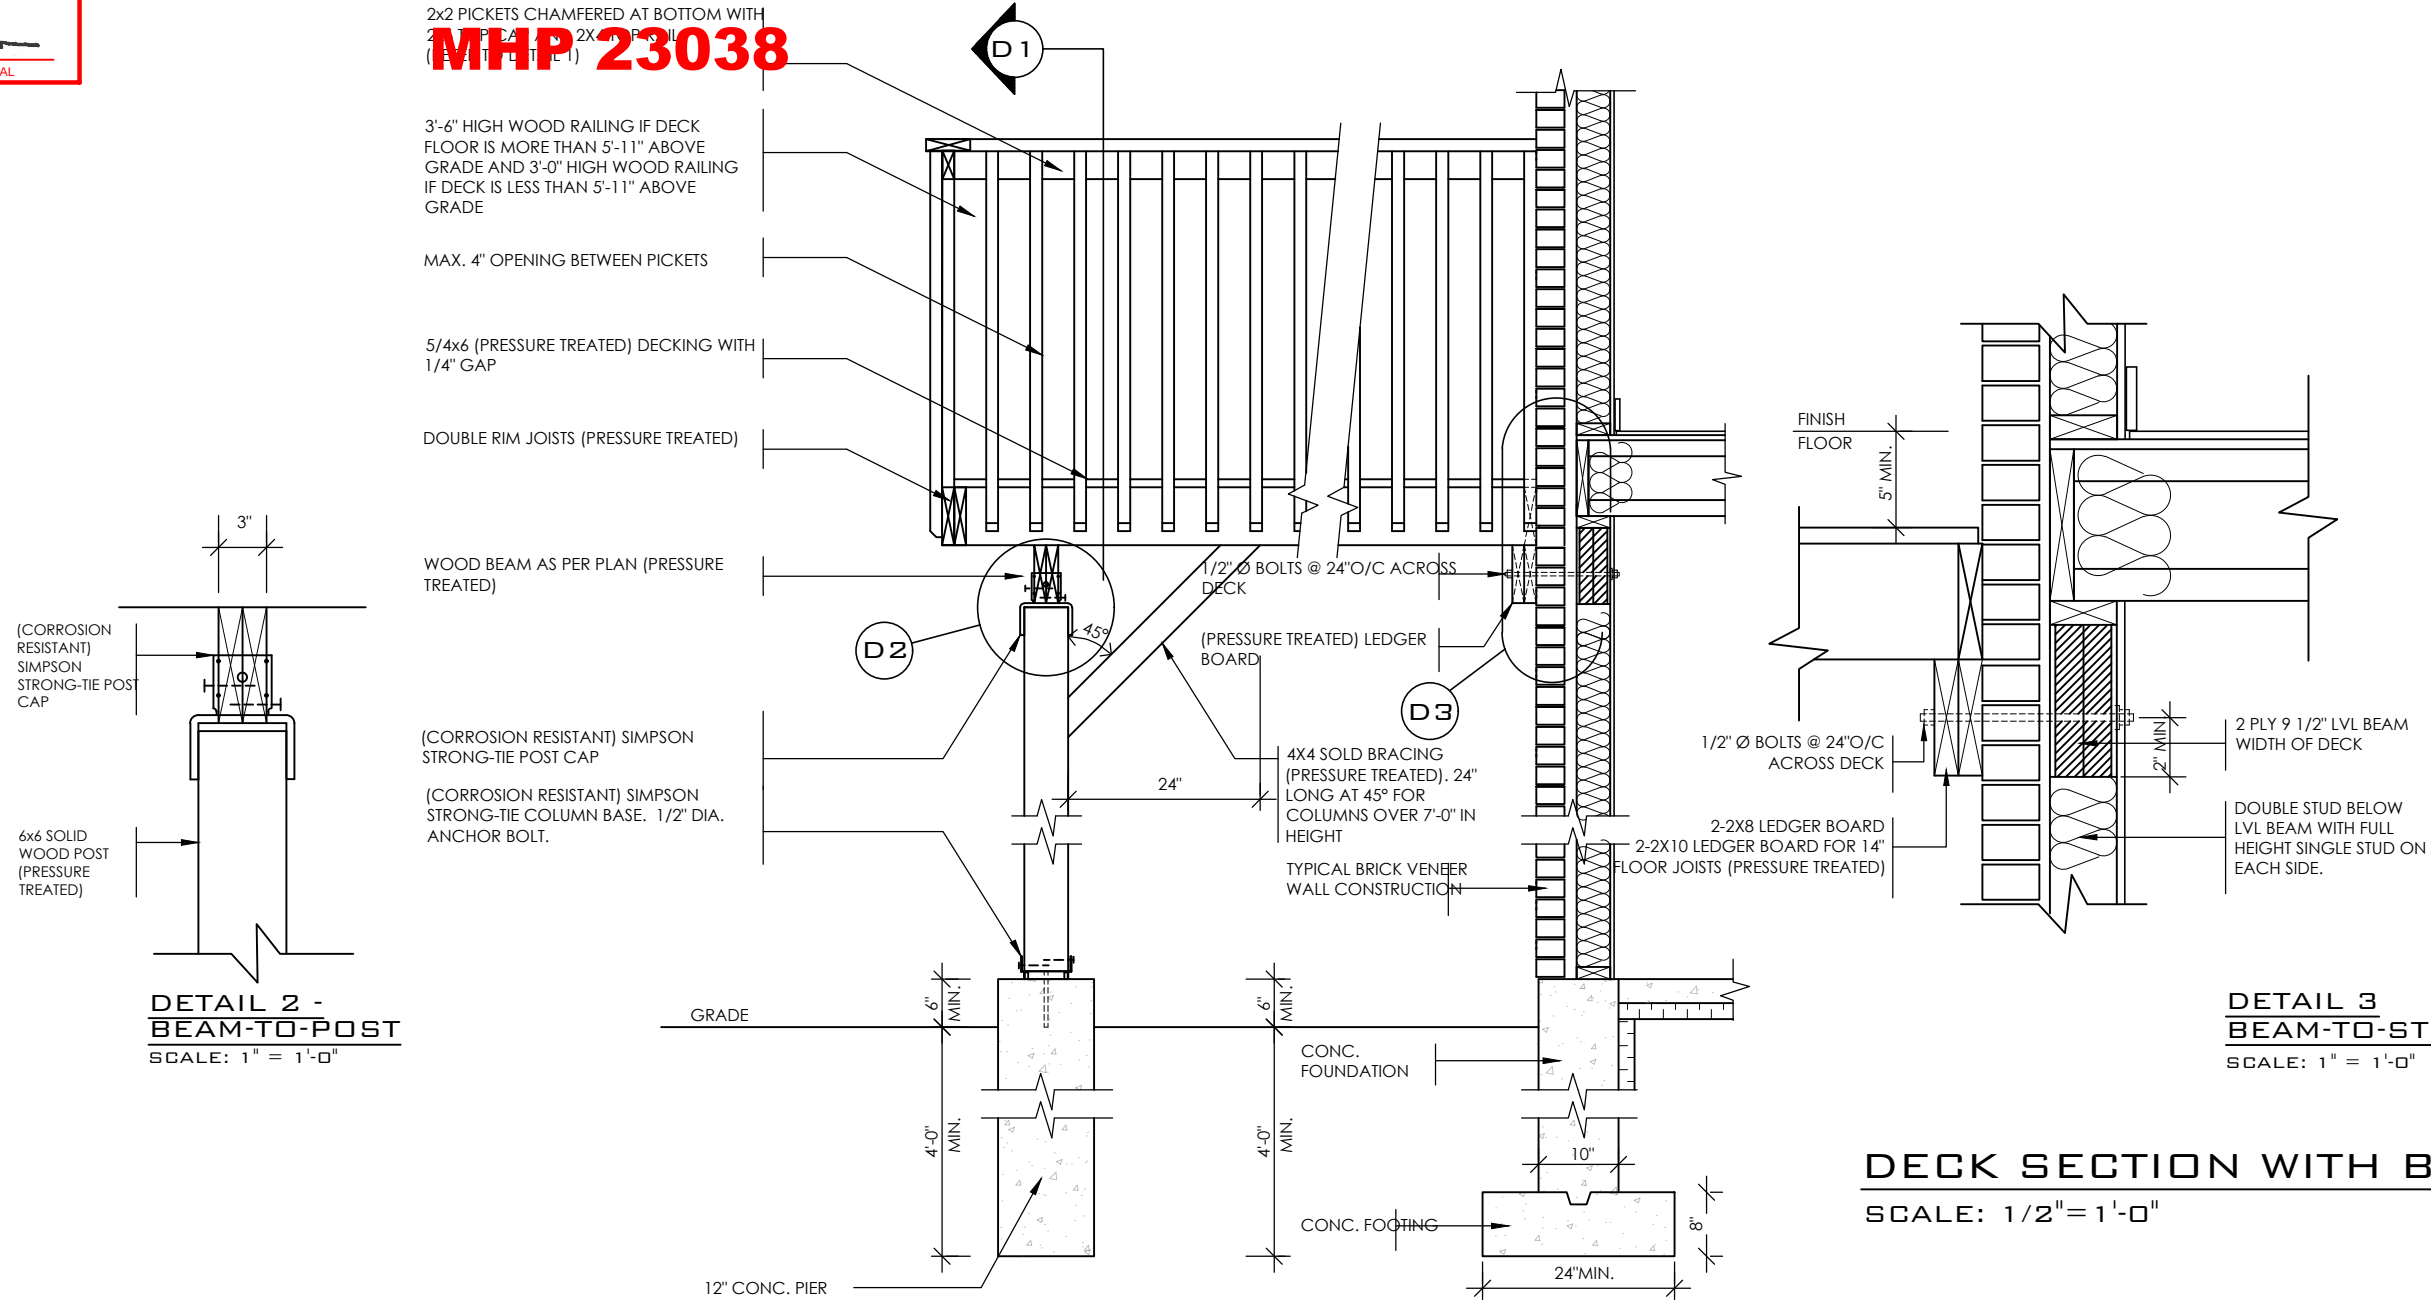


DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK
GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1" = 1'-0"

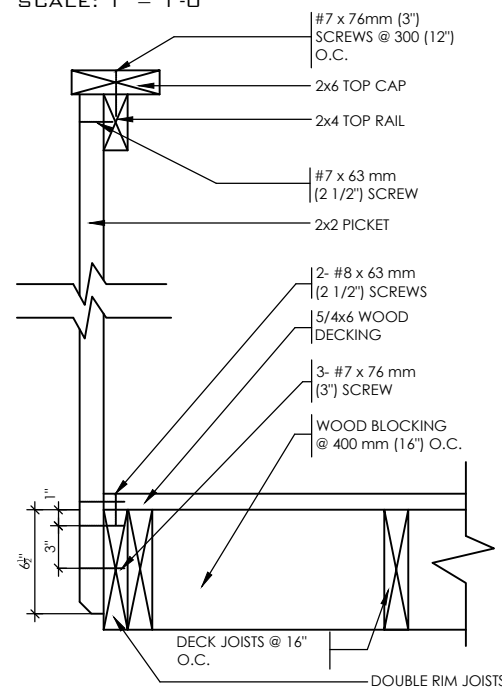

GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1" = 1'-0"

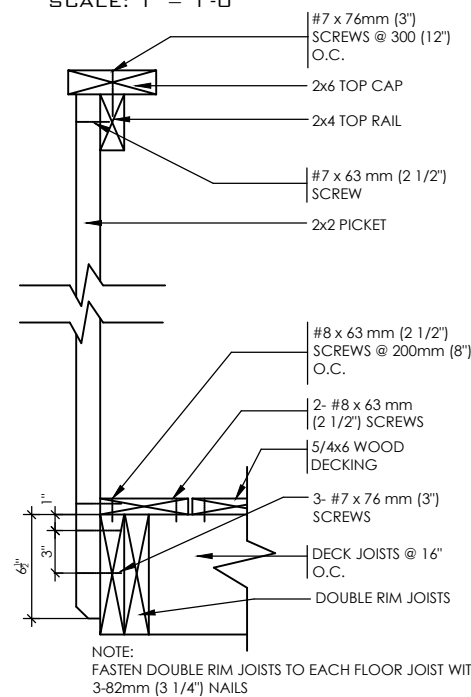

NOTE: FASTEN DOUBLE RIM JOISTS TO EACH FLOOR JOIST WITH 3-82mm (3 1/4") NAILS

GENERAL NOTES

1. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa [40psf]
2. ALL NAILS AND SCREWS TO BE GALVANIZED
3. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES
4. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINMENT
5. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa [3130psf]



Compliance Package A1

Walk-out Deck Details

scale	by	area	sheet no.
As shown	Greenpark	-	8-2
date	type	project no.	
2023-04-28	-	22-012	


www.greenparkgroup.ca

project name
Zadorra Estates Inc.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN Signature
Registration Information **Mackitecture** 103532




www.mackitecture.ca

975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

MHP 23038

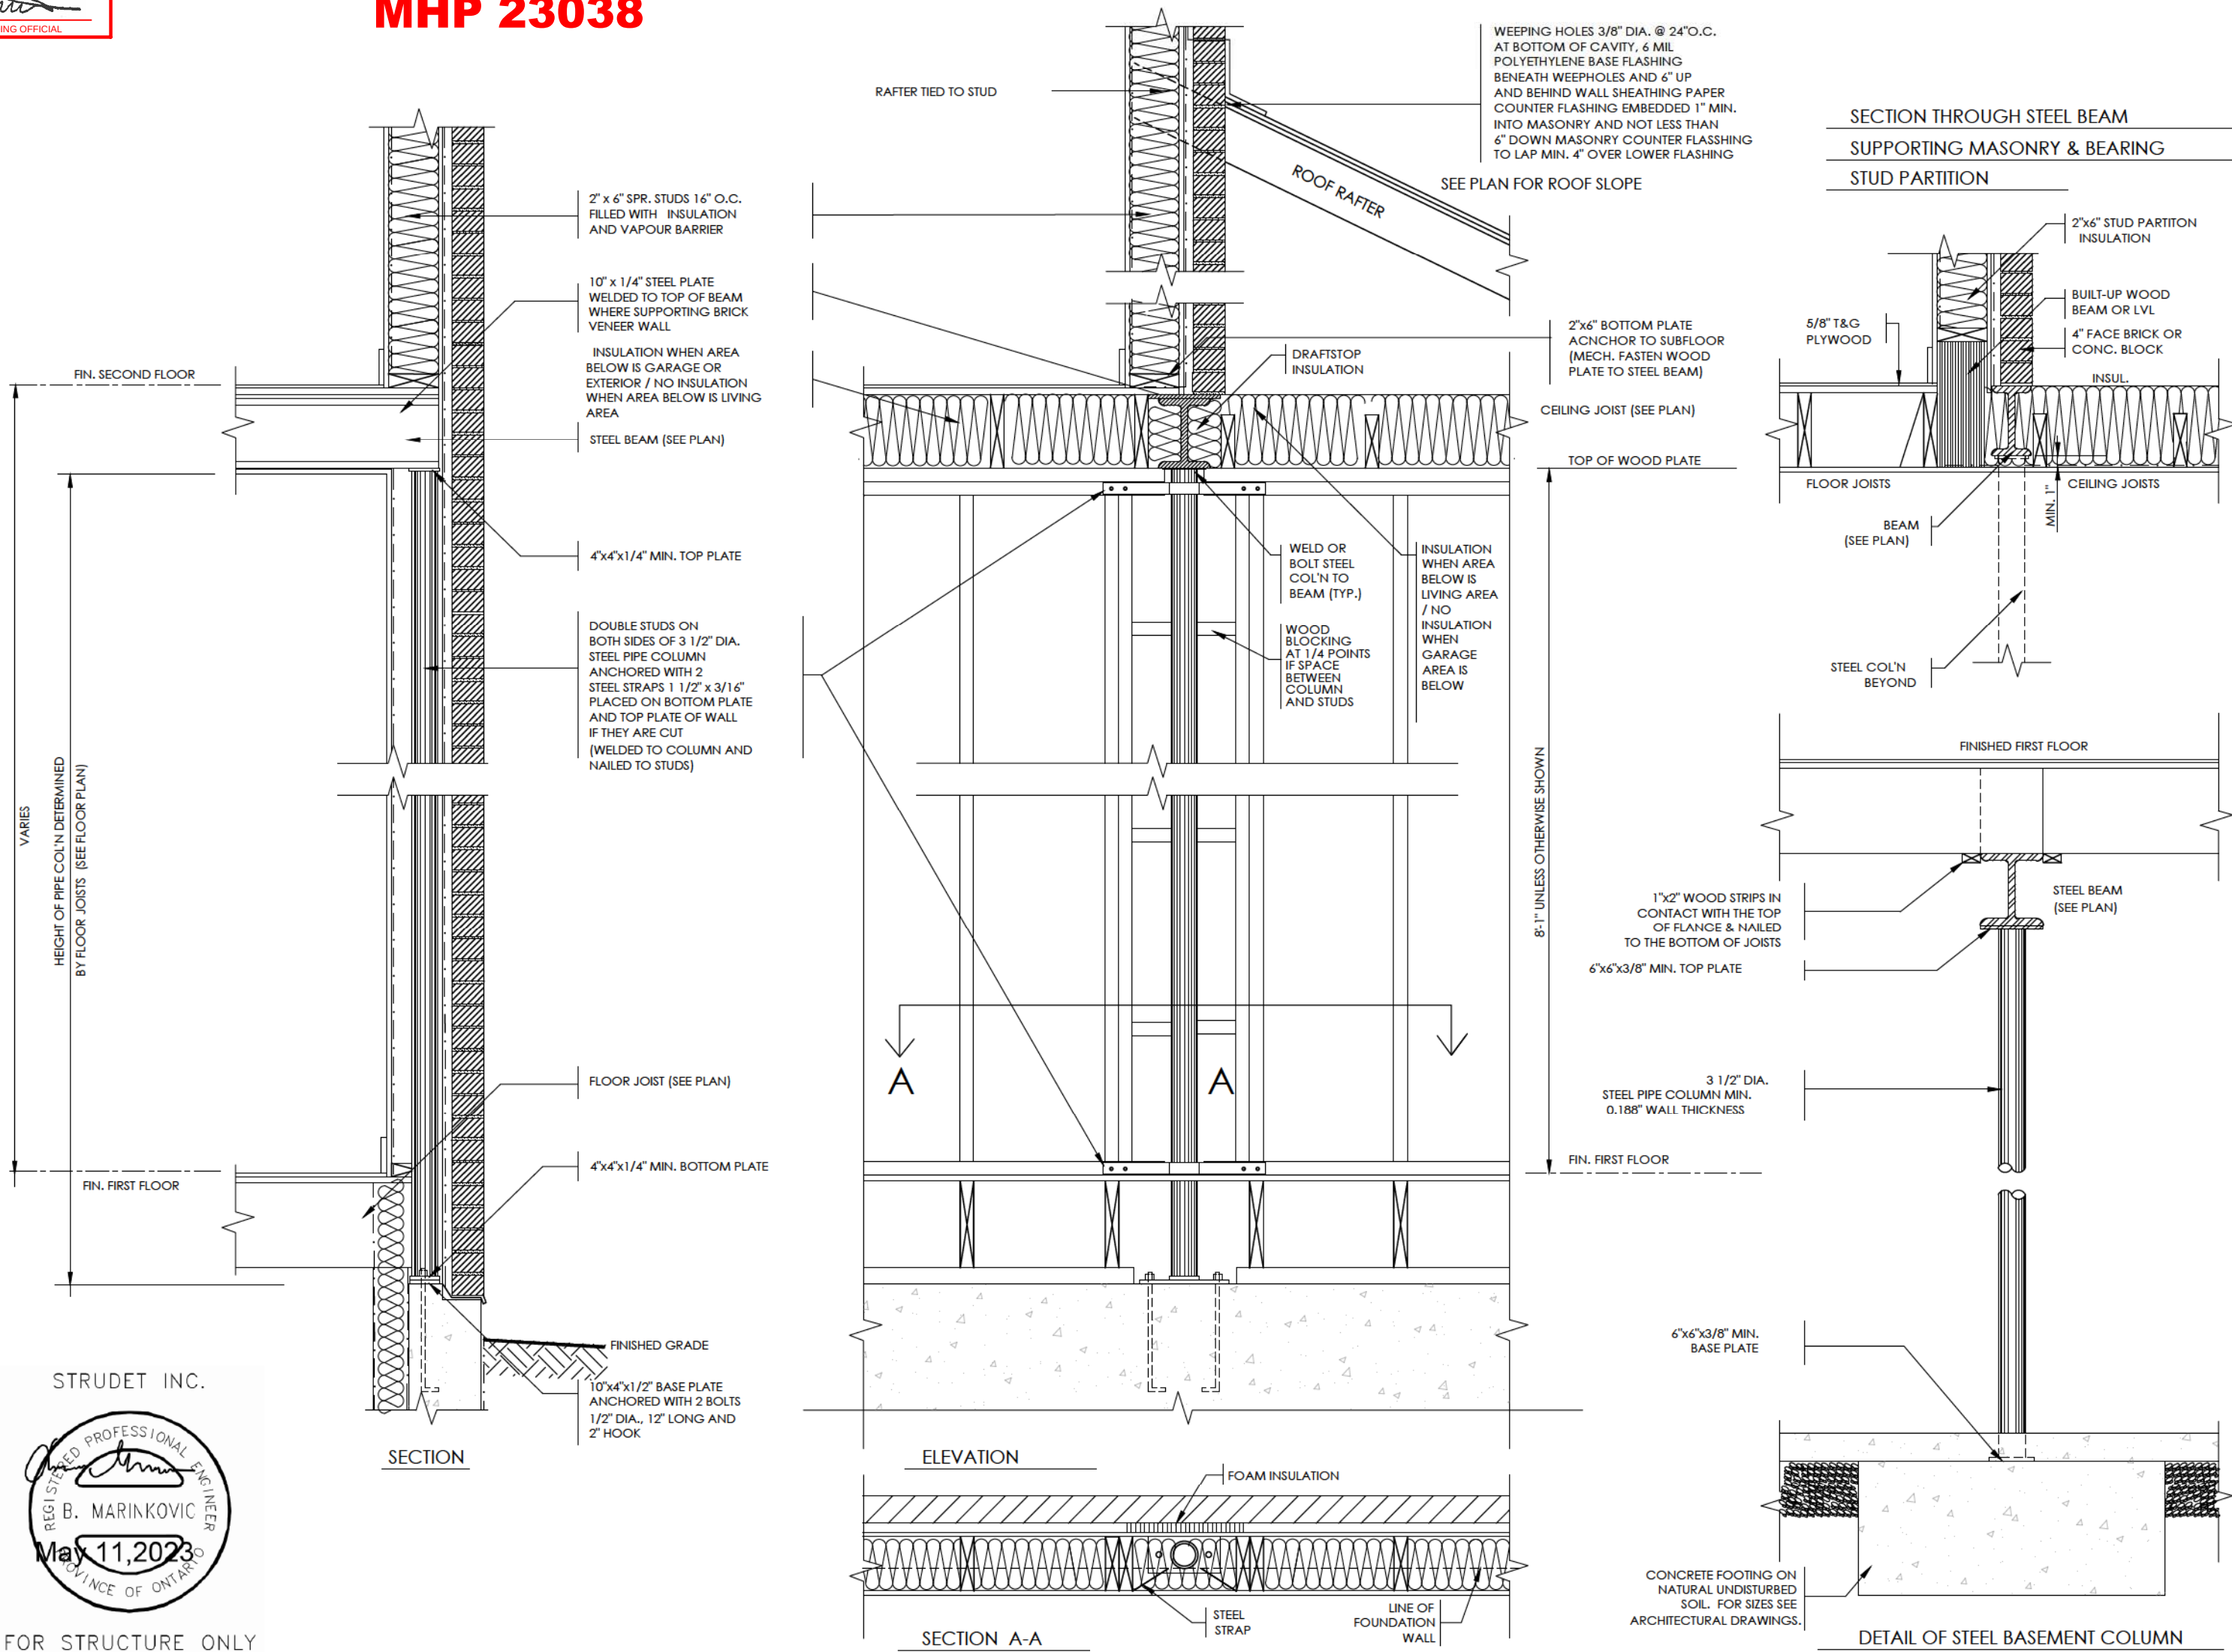

STRUDET INC.
REGISTERED PROFESSIONAL ENGINEER
B. MARINKOVIC
May 11, 2023
PROVINCE OF ONTARIO
FOR STRUCTURE ONLY

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack	35923	<i>[Signature]</i>
Name	BCIN	Signature
Registration Information	Mackitecture	103532


Mackitecture
www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Steel Column Details

scale	3/4" = 1'-0"	by	Greenpark	area	-	sheet no.	9
date	2023-05-12	type	-	project no.	22-012		



Greenpark
www.greenparkgroup.ca
project name
Zadorra Estates Inc.

MHP 23038

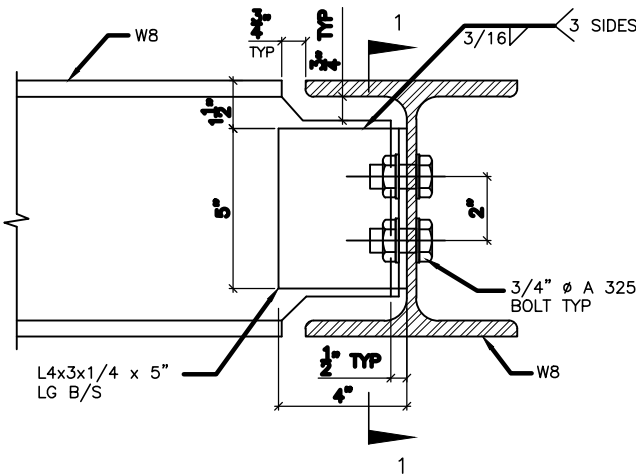



DETAIL 1.

W8
TO
W8
CONNECTION

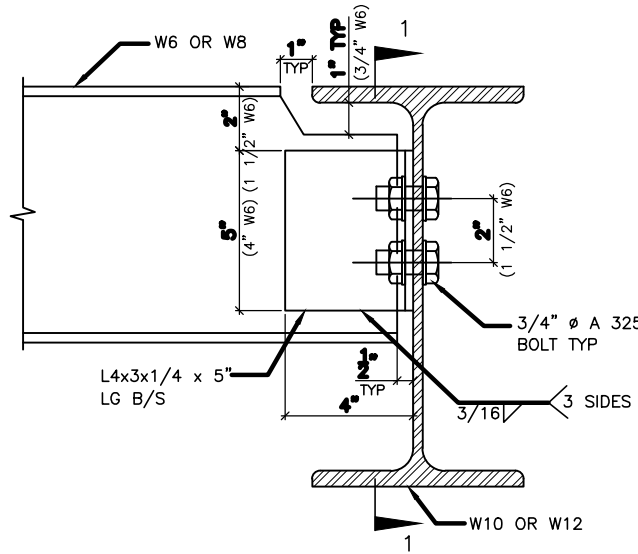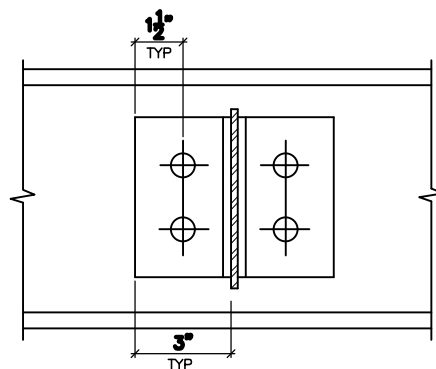



DETAIL 2.

W6(W8)
TO
W10(W12)
CONNECTION

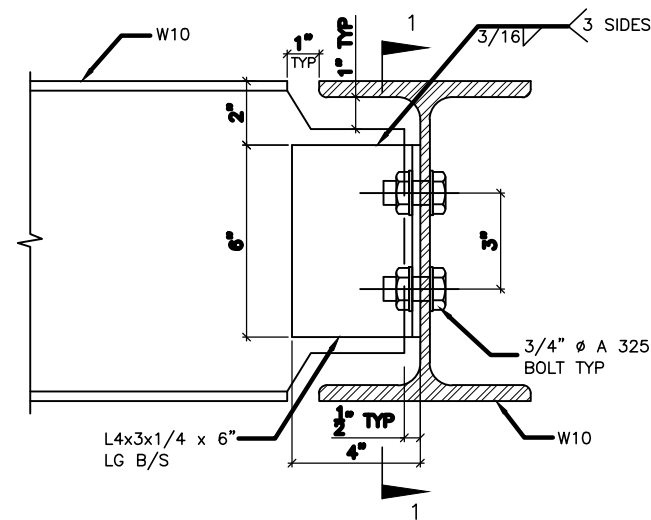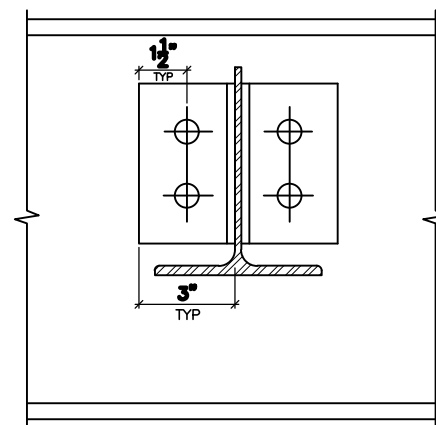



DETAIL 3.

W10
TO
W10
CONNECTION

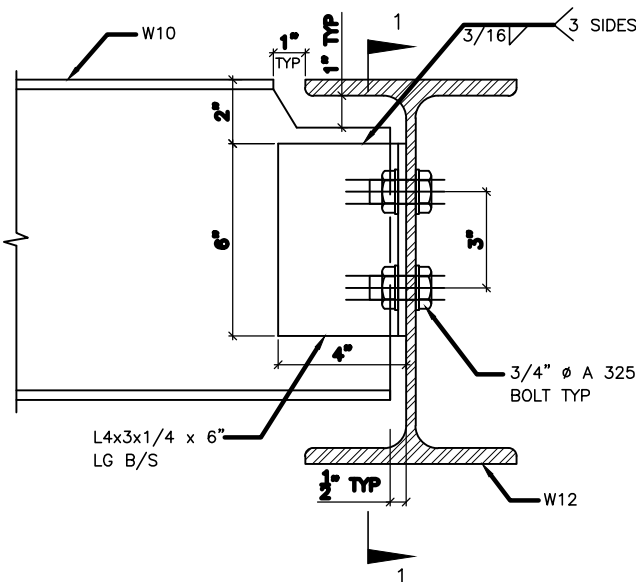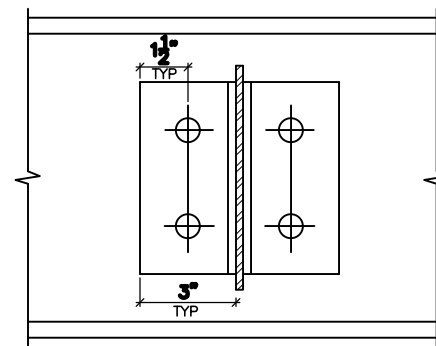



DETAIL 4.

W10
TO
W12
CONNECTION

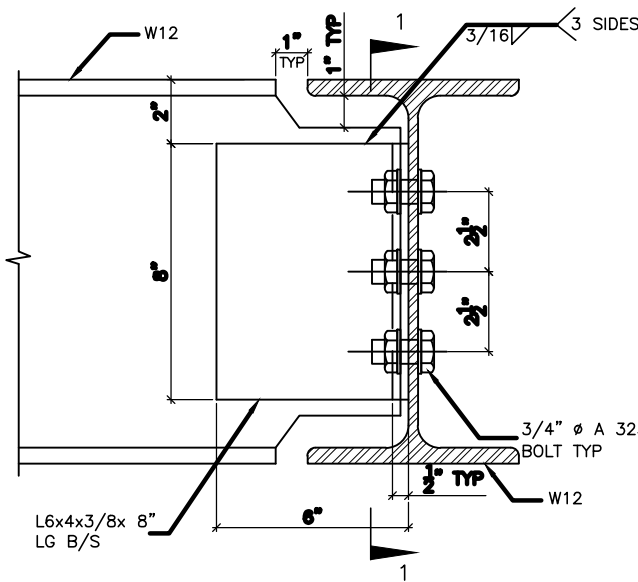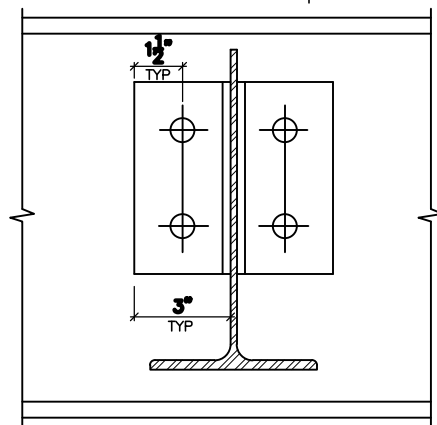

DETAIL 5.


W12
TO
W12
CONNECTION

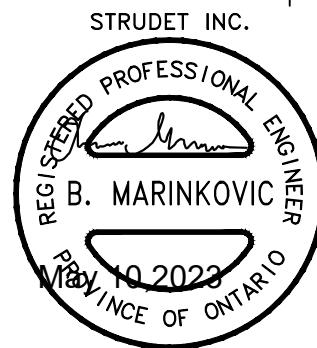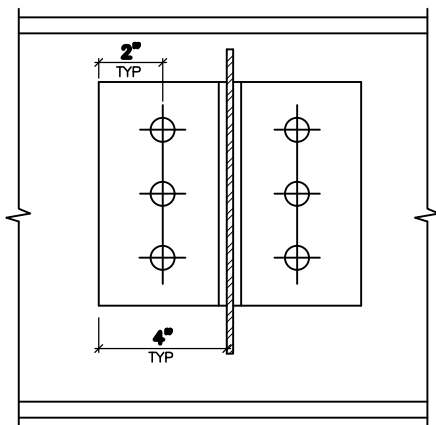


FOR STRUCTURE ONLY

DETAIL 6.

ANGLE
TO
BEAM
CONNECTION

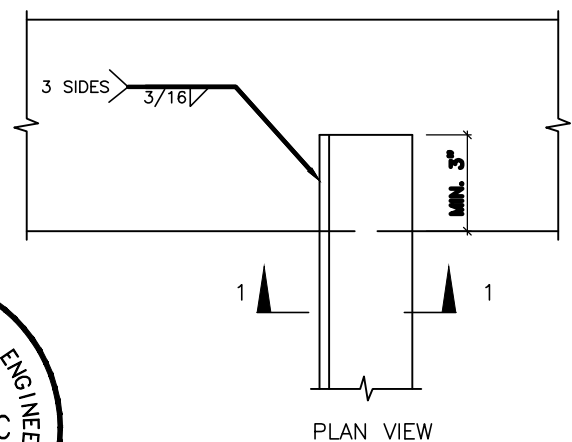

PLAN VIEW

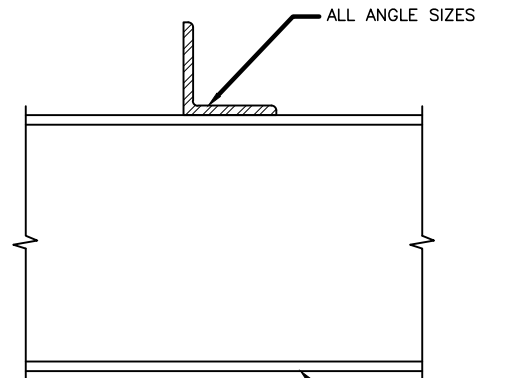

SECTION 1-1

Compliance Package A1

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN Signature
Registration Information Mackitecture 103532

www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca


Steel Beam Connection Details

scale	not to scale	by	Greenpark	area	-	sheet no.	10
date	2023-04-28	type	-	project no.	22-012		


www.greenparkgroup.ca

project name
Zadorra Estates Inc.


Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

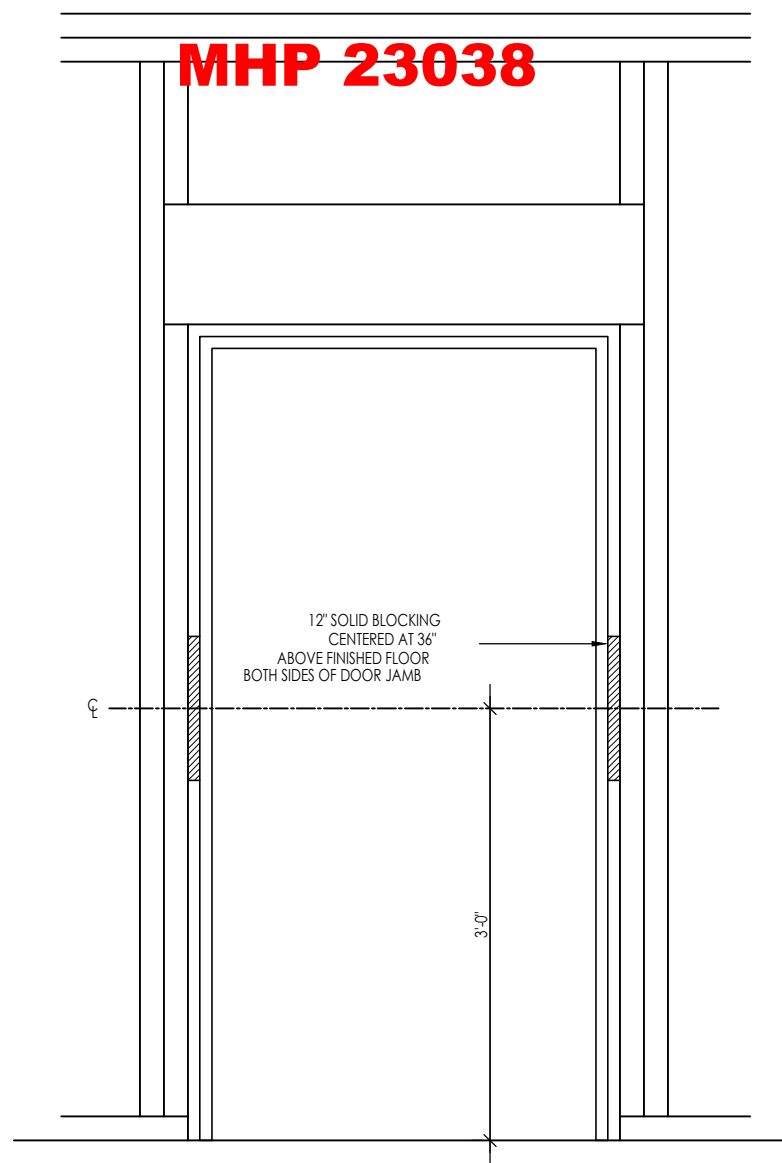


RESISTANCE TO FORCED ENTRY (OBC 9.6.8.)

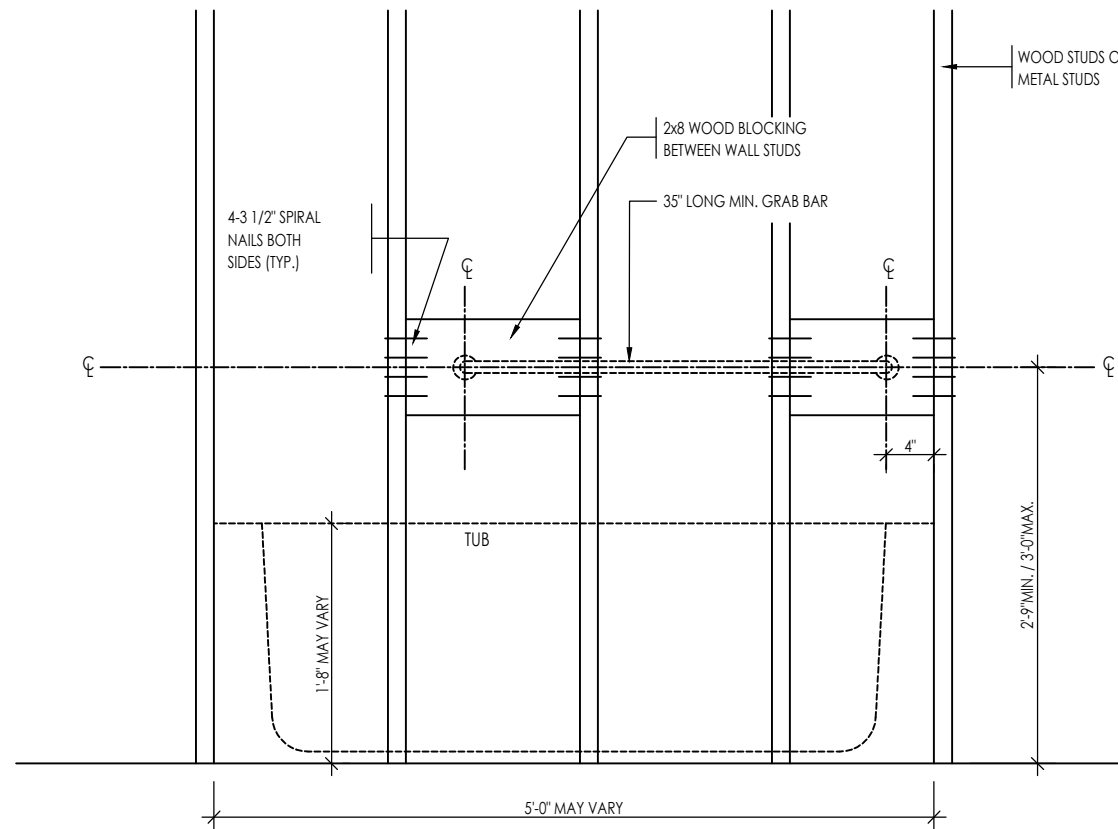

BATH TUB FRONT ELEVATION

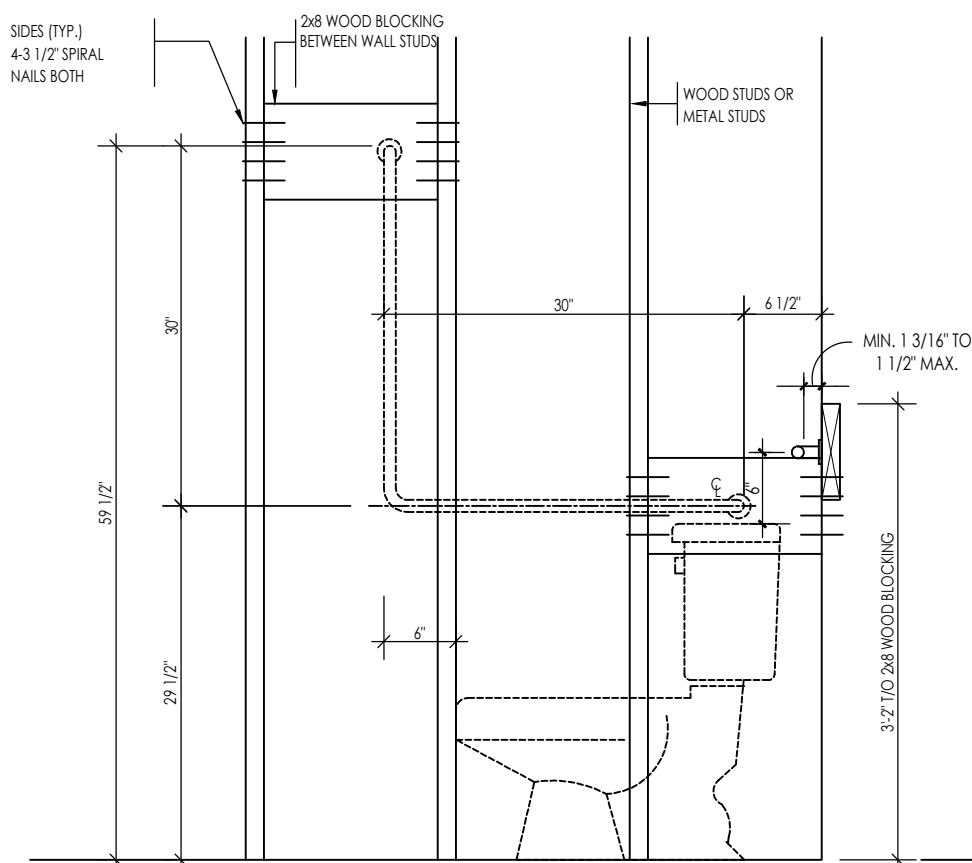

TOILET SIDE ELEVATION

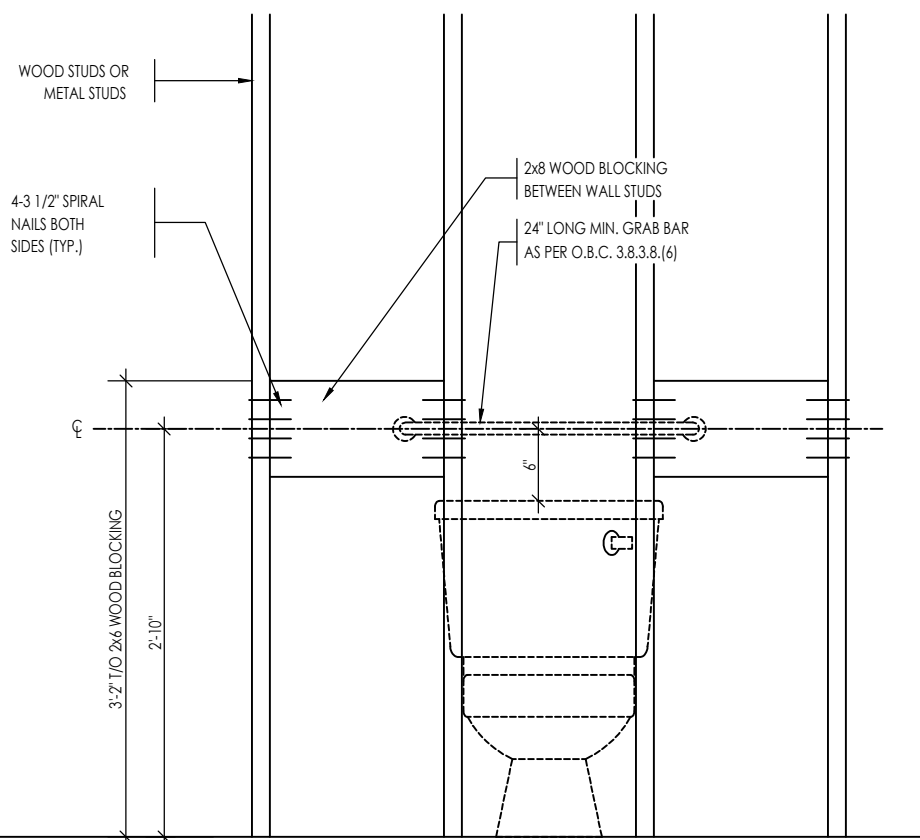

TOILET FRONT ELEVATION

STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3.)




Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN
Registration Information **Mackitecture** 103532




www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Blocking Details for Forced Entry
and Main Bath Grab Bars

scale **3/4" = 1'-0"** by **Greenpark** area - sheet no. **11**


date **2023-04-28** type - project no. **22-012**


www.greenparkgroup.ca


project name **Zadorra Estates Inc.**

Drawing created with Mackilecture v.1.0.0 (build 2643), File P:\2022\22-012-GREENPARK-ZADORRA-OSHAWA\UNITS\WORKING\DETAILS\DETAILS 12 - STUCCATO BOARD PACKAGE A1.DWG plotted on 2023-04-28 at 1:25:31 PM by JMACK

MHP 23038

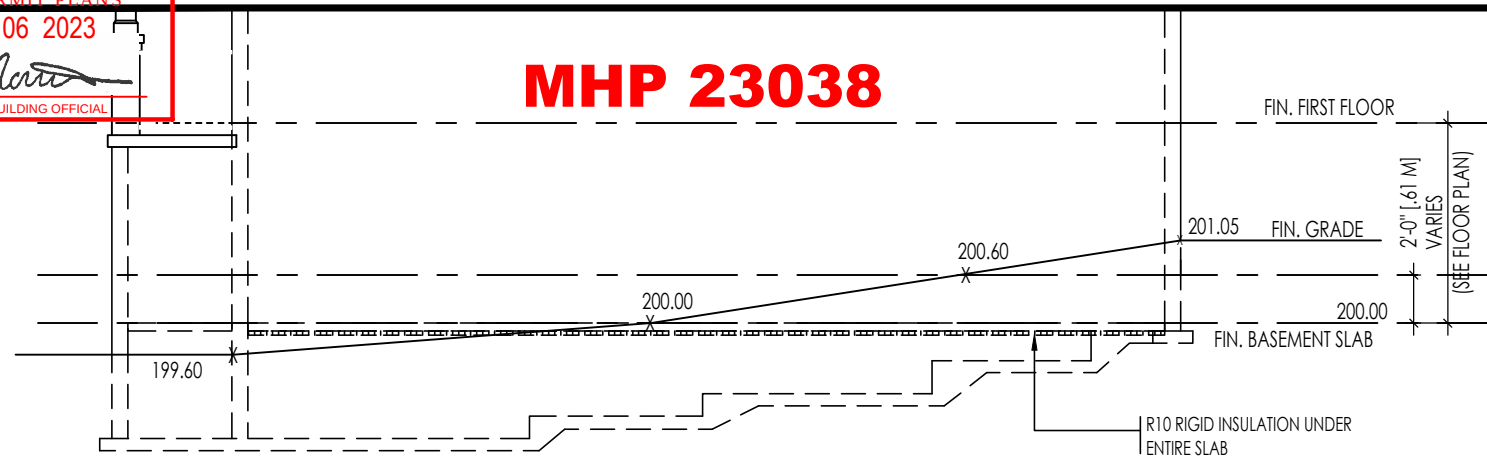


TYPICAL RIGHT SIDE ELEVATION

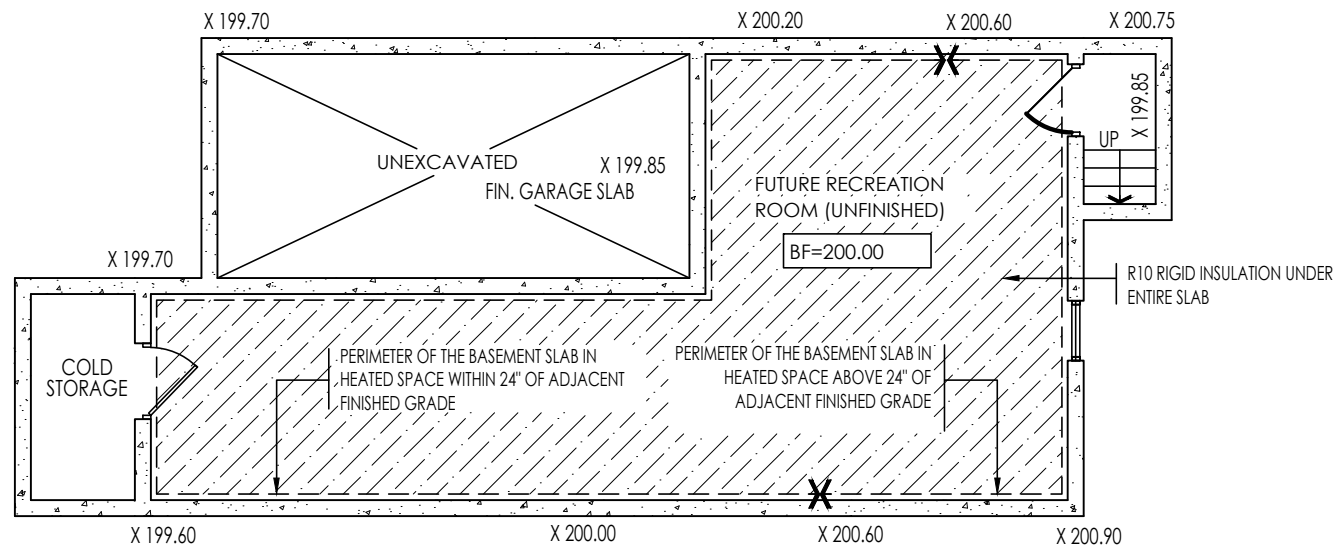

TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION


NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY. SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

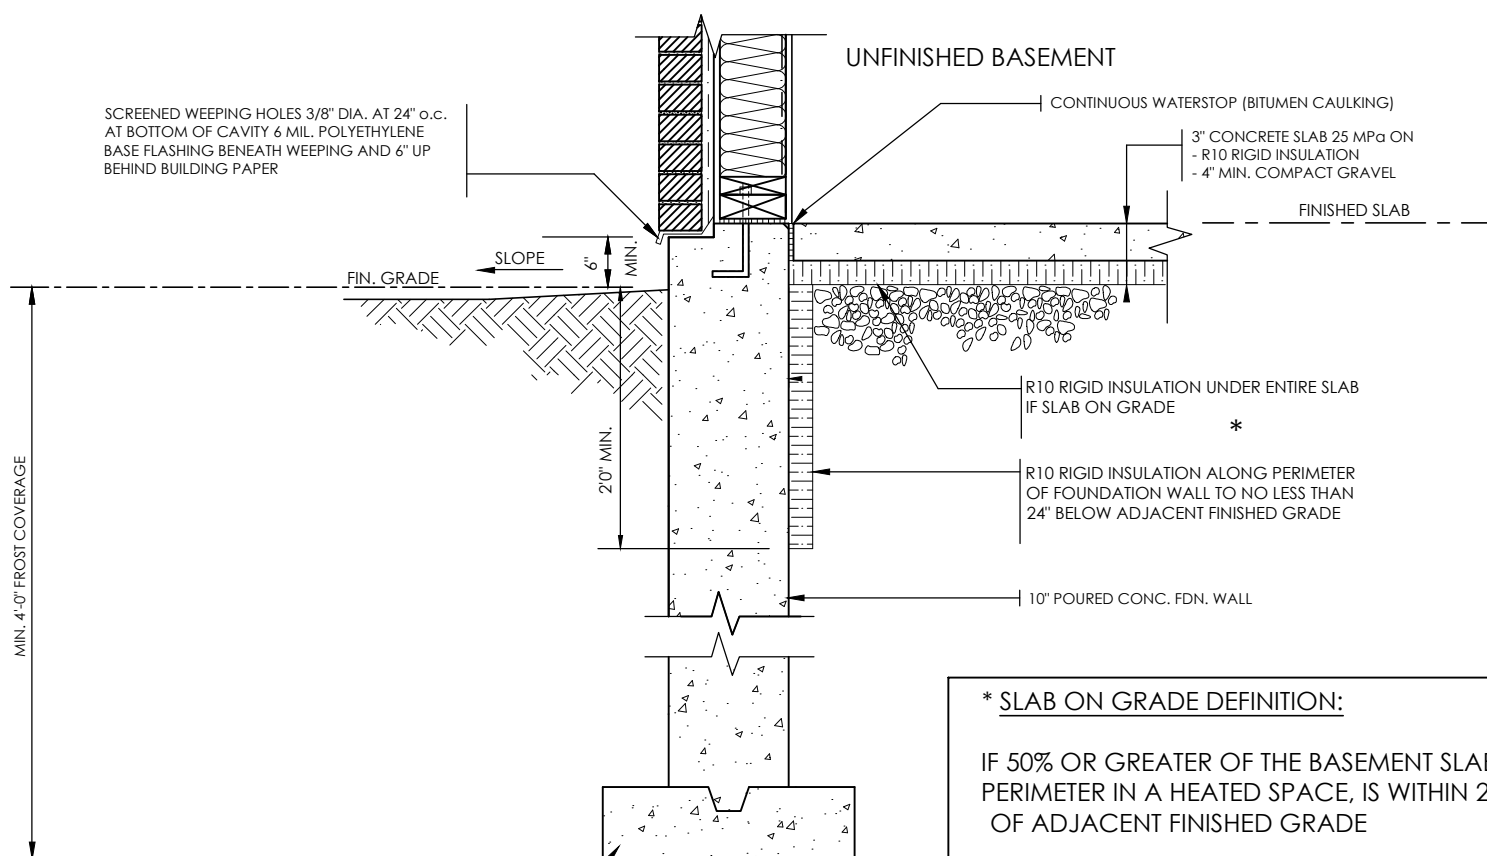


*** SLAB ON GRADE DEFINITION:**
IF 50% OR GREATER OF THE BASEMENT SLAB PERIMETER IN A HEATED SPACE, IS WITHIN 24" OF ADJACENT FINISHED GRADE

CONC. FOOTING C/W FORMED KEYWAY ON NATURAL UNDISTURBED SOIL. FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.

SLAB ON GRADE

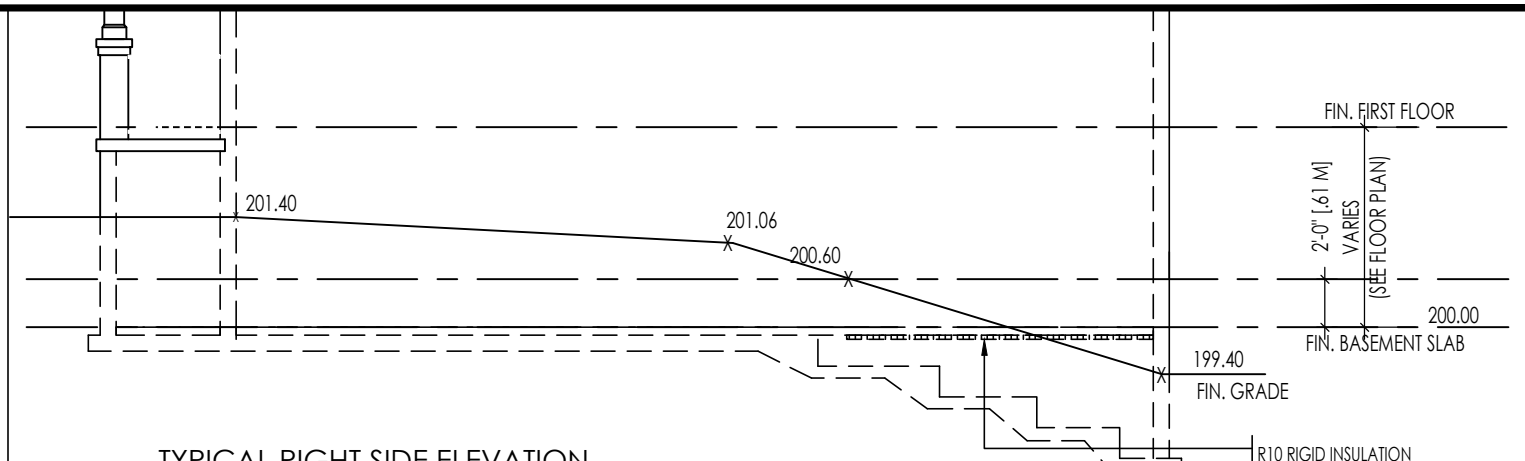


TYPICAL RIGHT SIDE ELEVATION

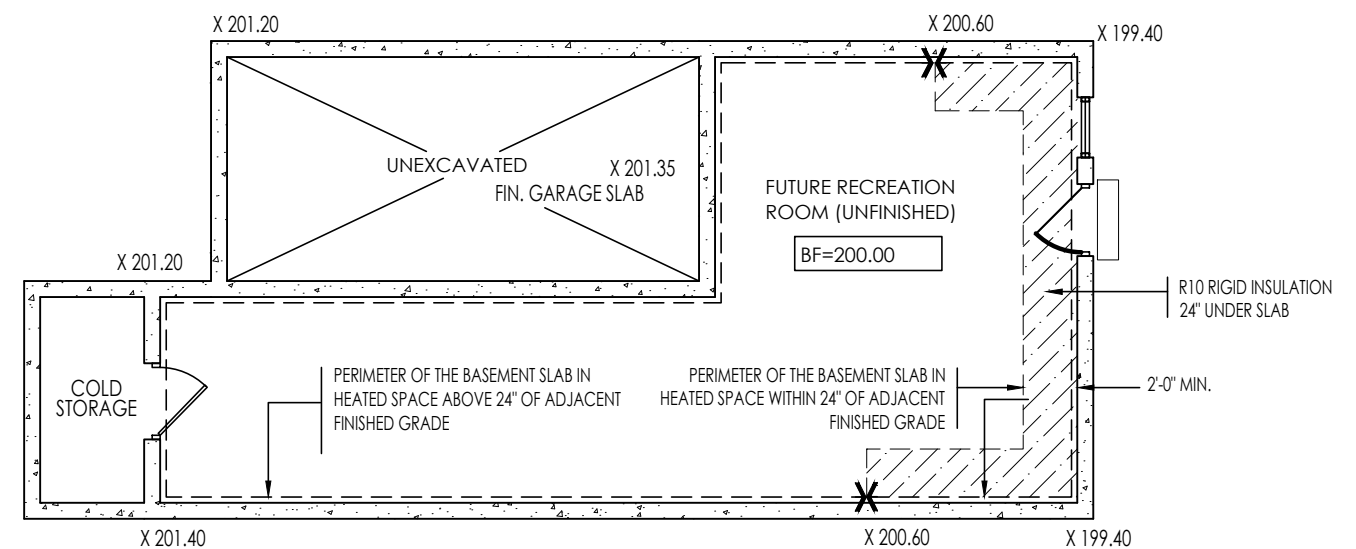

TYPICAL BASEMENT PLAN

WALK OUT BASEMENT CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY. SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

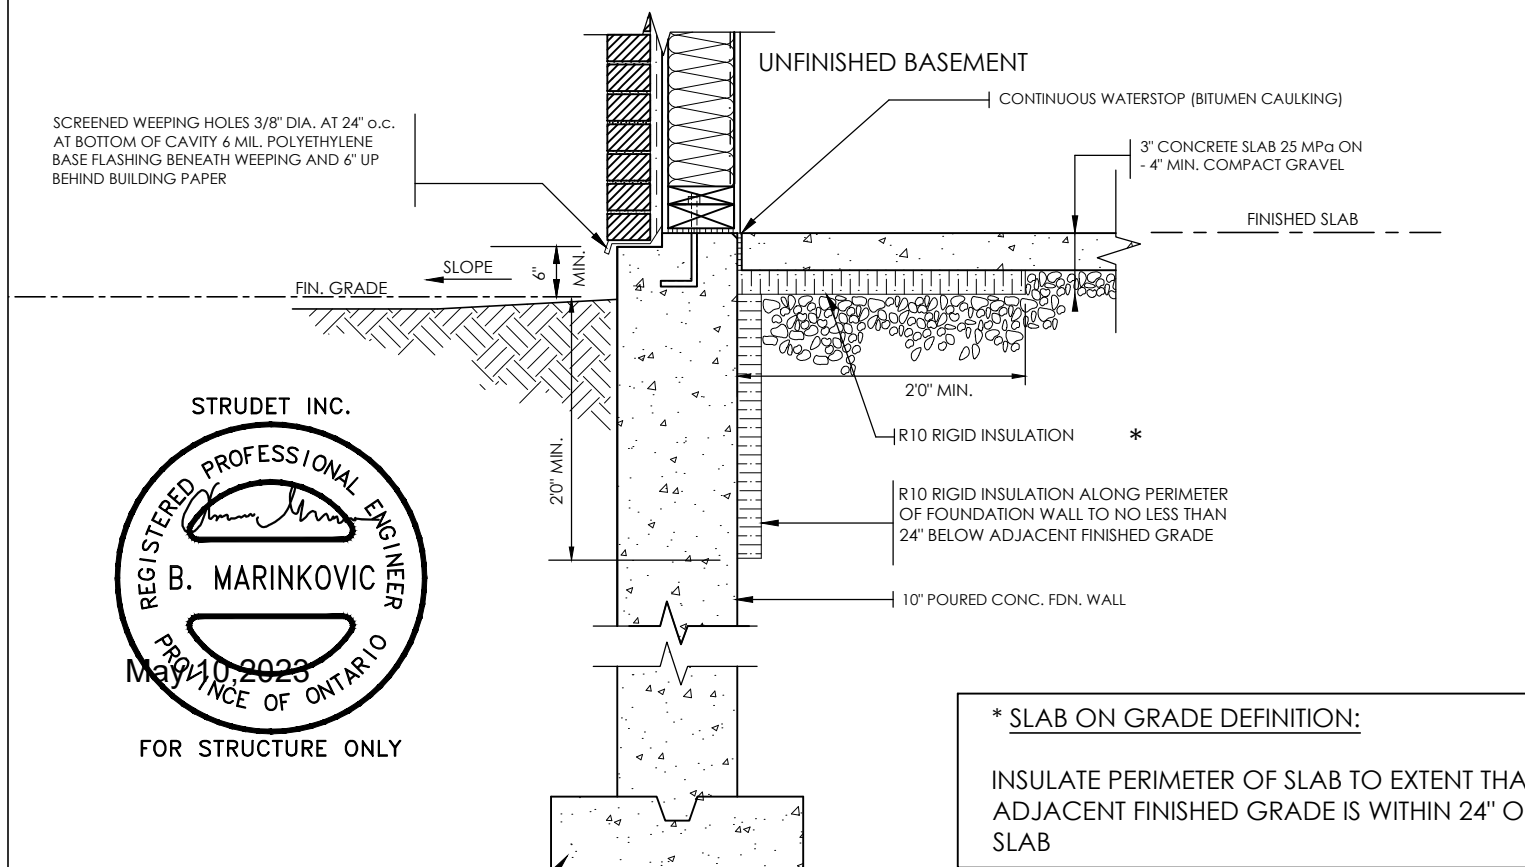

*** SLAB ON GRADE DEFINITION:**
INSULATE PERIMETER OF SLAB TO EXTENT THAT ADJACENT FINISHED GRADE IS WITHIN 24" OF SLAB

CONC. FOOTING C/W FORMED KEYWAY ON NATURAL UNDISTURBED SOIL. FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.

WALK OUT BASEMENT



Compliance Package A1

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the Designer. Prints are not to be scaled.

The undersigned has reviewed and takes responsibility for this design, as well as having the qualifications and requirements mandated by the Ontario Building Code (O.B.C.) to be a Designer.

Qualification Information

Jamie Mack 35923
Name BCIN
Registration Information **Mackitecture** 103532

www.mackitecture.ca
975A Elgin Street West, Suite 353
Cobourg, ON K9A 5J3
Tel: 416-735-8190 Email: info@mackitecture.ca

Slab On Grade for Walkout Basement				
scale	by	area	sheet no.	
not to scale	Greenpark	-	13	
date	type	project no.		
2023-04-28	-	22-012		

Greenpark
www.greenparkgroup.ca

project name
Zadorra Estates Inc.