

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

NE0518-223 GREEN YORK HOMES-AMELIA 2 EL 1
--

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS


- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.



THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.

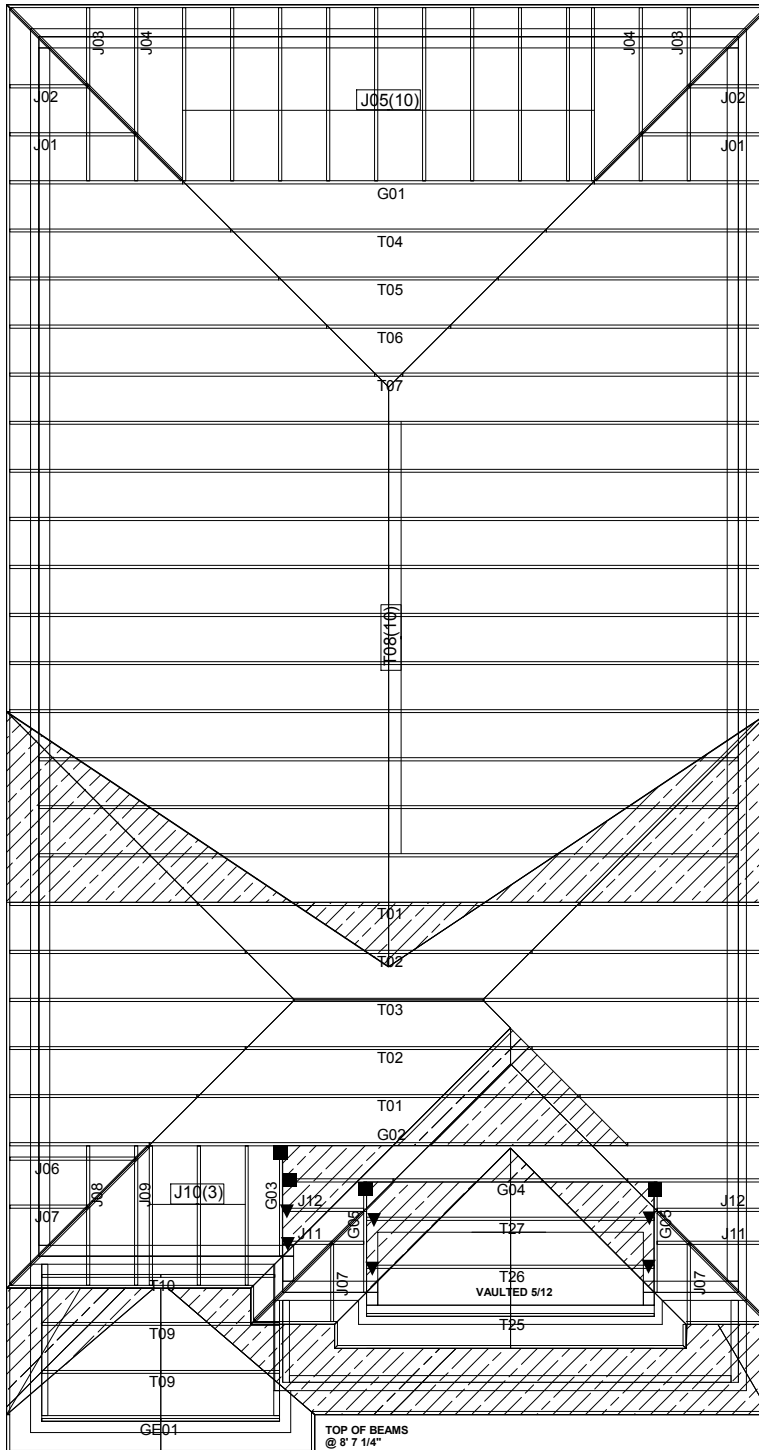

The components shown on this layout conform to our recommendations and are adequate to support the design loads required by the Ontario Building Code O.Reg 332/12 as amended and as shown on the engineering calculation page of each component.

The framing direction and girder locations shown on this layout conform to that shown on the architectural drawing.

Deflection: LL = L/360
1.33LL+DL=L/360

Architectural Drawing Info:
Date: MAY 22, 2018
Project number: 17-55
Model: AMELIA 2



CONVENTIONAL FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 S.P.F. @ 24" O/C WITH A 2x4 VERTICAL POST TO THE TRUSS UNDERNEATH EACH CROSS POINT. VERTICAL POST LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END POINT AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

HANGER LEGEND:

▼ LUS24 ■ LJS26DS
● HGUS26 ✕ HGUS26-2


SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3 PSF
BOT CH. LL = 0 PSF
DL = 7 PSF
TOTAL LOAD = 33.3 PSF
SPACING = 24" O/C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 085-09
- TPIC 2011

Model: **AMELIA 2 EL 1**
Customer: GREEN YORK HOMES
Project: GRANELLI HOMES
Location: BRAMPTON
Date: 5/30/2018 Drawn by: BB

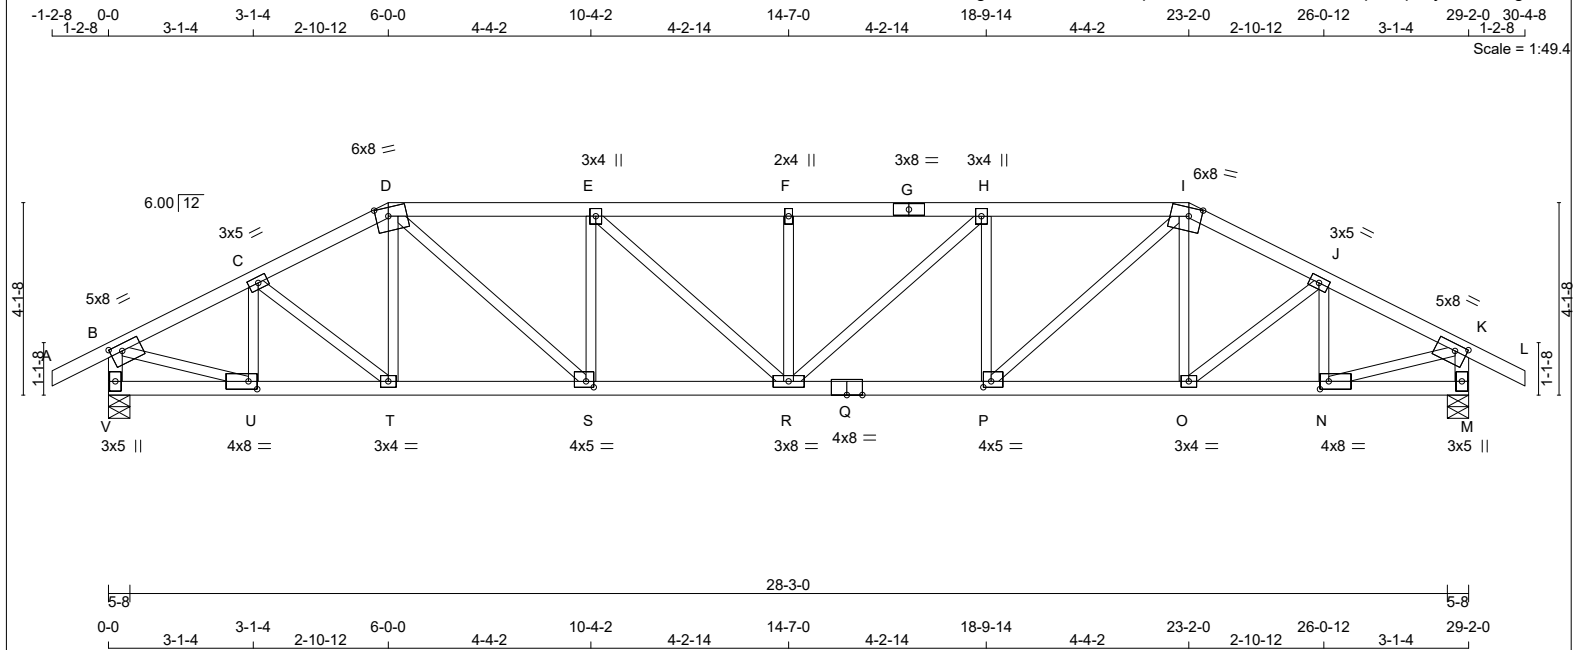

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
V - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
V - Q	2x4	DRY No.2	SPF
Q - M	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	1.75 3.00
C	TMVW-t	MT20	3.0	5.0	
D	TTVW-m	MT20	6.0	8.0	2.25 3.25
E	TMVW-t	MT20	3.0	4.0	
F	TMVW-t	MT20	2.0	4.0	
G	TS-t	MT20	3.0	8.0	
H	TMVW-t	MT20	3.0	4.0	
I	TTVW-m	MT20	6.0	8.0	2.25 3.25
J	TMVW-t	MT20	3.0	5.0	
K	TMVW-t	MT20	5.0	8.0	1.75 3.00
M	BMV1-p	MT20	3.0	5.0	
N	BMVW-t	MT20	4.0	8.0	2.00 2.25
O	BMVW-t	MT20	3.0	4.0	
P	BMVW-t	MT20	4.0	5.0	1.50 2.00
Q	BS-t	MT20	4.0	8.0	
R	BMVW-t	MT20	3.0	8.0	
S	BMVW-t	MT20	4.0	5.0	1.50 2.00
T	BMVW-t	MT20	3.0	4.0	
U	BMVW-t	MT20	4.0	8.0	2.00 2.25
V	BMV1-p	MT20	3.0	5.0	

HANGERS NOTES

1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
V	2644	0	2644	0	0
M	2644	0	2644	0	0

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
V	1855	1302 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0
M	1855	1302 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LC1	MAX	UNBRAC	MEMB.	FORCE (LBS)	MAX	CSI (LC)
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	0 / 22	-77.4	-77.4	0.10 (1)	10.00	U-C	-748 / 0	0.13 (1)	
B-C	-3483 / 0	-77.4	-77.4	0.28 (1)	3.51	C-T	0 / 473	0.12 (1)	
C-D	-3915 / 0	-77.4	-77.4	0.30 (1)	3.30	T-D	-147 / 76	0.04 (1)	
D-E	-4840 / 0	-145.9	-145.9	0.83 (1)	2.36	D-S	0 / 1802	0.45 (1)	
E-F	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	S-E	-1054 / 0	0.29 (1)	
F-G	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	E-R	0 / 527	0.13 (1)	
G-H	-5231 / 0	-145.9	-145.9	0.89 (1)	2.15	R-F	-570 / 0	0.15 (1)	
H-I	-4840 / 0	-145.9	-145.9	0.83 (1)	2.36	R-H	0 / 527	0.13 (1)	
I-J	-3915 / 0	-77.4	-77.4	0.30 (1)	3.30	P-H	-1054 / 0	0.29 (1)	
J-K	-3483 / 0	-77.4	-77.4	0.28 (1)	3.51	P-I	0 / 1802	0.45 (1)	
K-L	0 / 22	-77.4	-77.4	0.10 (1)	10.00	O-I	-147 / 76	0.04 (1)	
V-B	-2586 / 0	0.0	0.0	0.29 (1)	5.28	O-J	0 / 473	0.12 (1)	
M-K	-2586 / 0	0.0	0.0	0.29 (1)	5.28	N-J	-748 / 0	0.13 (1)	
						B-U	0 / 3226	0.80 (1)	
V-U	0 / 0	-33.0	-33.0	0.08 (4)	10.00	N-K	0 / 3226	0.80 (1)	
U-T	0 / 3120	-33.0	-33.0	0.62 (1)	10.00				
T-S	0 / 3488	-33.0	-33.0	0.68 (1)	10.00				
S-R	0 / 4840	-33.0	-33.0	0.93 (1)	10.00				
R-Q	0 / 4840	-33.0	-33.0	0.93 (1)	10.00				
Q-P	0 / 4840	-33.0	-33.0	0.93 (1)	10.00				
P-O	0 / 3488	-33.0	-33.0	0.68 (1)	10.00				
O-N	0 / 3120	-33.0	-33.0	0.62 (1)	10.00				
N-M	0 / 0	-33.0	-33.0	0.08 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
D	6-0-0	-348	-348	---	FRONT	VERT	TOTAL
I	23-2-0	-348	-348	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.27")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/739 (0.47")

CSI: TC=0.89/1.00 (F-H:1), BC=0.93/1.00 (R-S:1), WB=0.80/1.00 (B-U:1), SSI=0.32/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284
				1656	

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES-AMELIA 2 EL	PRWG NO.
NE0518-223	G01	1	1	TRUSS DESC.		PAGE 4 OF 40


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:05 2018 Page 2
ID:rxAS7EaO6bSgtLEAvLofNzBNQD-pewCnEZVoKxziV0aNhrrfQtSDqvi6yE8aow4fgzAxdK

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 348.1 lbs FACTORED DOWN AT 23-2-0,
AND 348.1 lbs FACTORED DOWN AT 6-0-0 ON
TOP CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.94 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



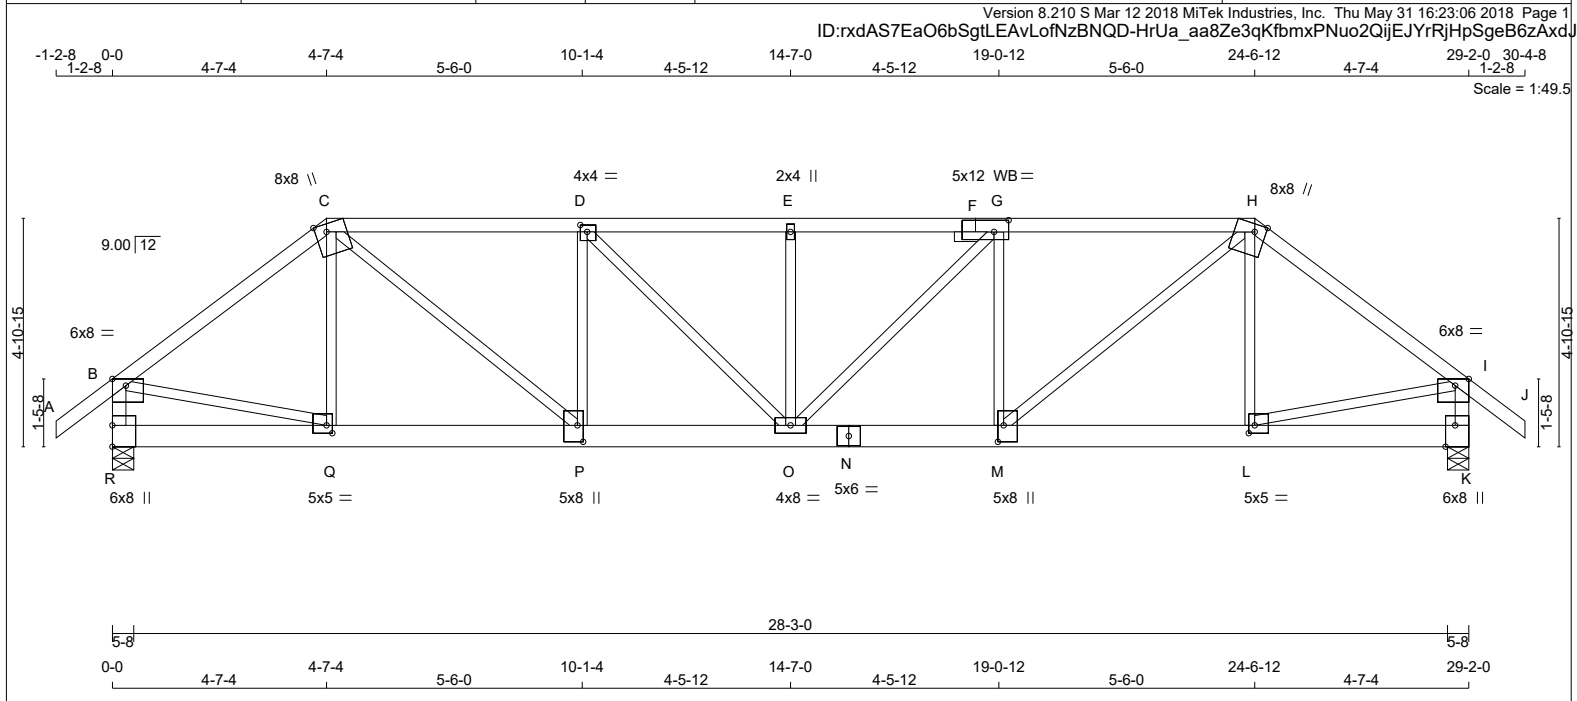

TOTAL WEIGHT = 139 lb [M]

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				*** SPECIAL LOADS ANALYSIS ***			
CHORDS	SIZE	DRY	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQRD	GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.		
A - C	2x4	DRY	2100F 1.8E	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	LOADS WERE DERIVED FROM USER INPUT		
C - F	2x4	DRY	2100F 1.8E	SPF	VERT	DOWN	UPLIFT	IN-SX	NO FURTHER MODIFICATIONS WERE MADE		
F - H	2x4	DRY	2100F 1.8E	SPF	2847	0	0	5-8			
H - J	2x4	DRY	2100F 1.8E	SPF	2095	0	0	5-8			
J - B	2x4	DRY	No.2	SPF					SPECIFIED LOADS:		
K - I	2x4	DRY	No.2	SPF					TOP CH. LL = 23.3 PSF		
R - N	2x6	DRY	No.2	SPF					DL = 3.0 PSF		
N - K	2x6	DRY	No.2	SPF					BOT CH. LL = 0.0 PSF		
									DL = 7.0 PSF		
									TOTAL LOAD = 33.3 PSF		

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 30	-77.4 -77.4 0.07 (1)	10.00	Q-C	-385 / 14	0.13 (1)	
B-C	-3240 / 0	-77.4 -77.4 0.30 (1)	4.46	C-P	0 / 2650	0.66 (1)	
C-D	-4625 / 0	-118.9 -118.9 0.52 (1)	3.61	P-D	-152 / 61	0.05 (1)	
D-E	-4195 / 0	-77.4 -77.4 0.41 (1)	3.85	D-O	-613 / 0	0.44 (1)	
E-F	-4195 / 0	-77.4 -77.4 0.33 (1)	3.95	O-E	-257 / 0	0.09 (1)	
F-G	-4195 / 0	-77.4 -77.4 0.33 (1)	3.95	O-G	0 / 1103	0.27 (1)	
G-H	-3420 / 0	-77.4 -77.4 0.32 (1)	4.34	M-G	-1235 / 0	0.43 (1)	
H-I	-2292 / 0	-77.4 -77.4 0.26 (1)	5.15	M-H	0 / 2066	0.51 (1)	
I-J	0 / 30	-77.4 -77.4 0.07 (1)	10.00	L-H	-295 / 0	0.10 (1)	
R-B	-2804 / 0	0.0 0.0 0.31 (1)	5.08	B-Q	0 / 2650	0.66 (1)	
K-I	-2065 / 0	0.0 0.0 0.23 (1)	5.84	L-I	0 / 1875	0.46 (1)	
R-Q	0 / 0	-26.9 -26.9 0.10 (4)	10.00				
Q-P	0 / 2578	-26.9 -26.9 0.42 (1)	10.00				
P-O	0 / 4626	-17.5 -17.5 0.68 (1)	10.00				
O-N	0 / 3420	-17.5 -17.5 0.49 (1)	10.00				
N-M	0 / 3420	-17.5 -17.5 0.49 (1)	10.00				
M-L	0 / 1824	-17.5 -17.5 0.28 (1)	10.00				
L-K	0 / 0	-17.5 -17.5 0.06 (4)	10.00				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

WB - INDICATES BLOCKING REQUIRED

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	4-7-4	-184	-184	---	FRONT	VERT	TOTAL
P	10-1-4	-1468	-1468	---	FRONT	VERT	TOTAL

CSI: TC=0.52/1.00 (C-D:1), BC=0.68/1.00 (O-P:1), WB=0.66/1.00 (B-Q:1), SI=0.32/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES-AMELIA 2 EL	PRWG NO.
NE0518-223	G02	1	1	TRUSS DESC.		PAGE 6 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:06 2018 Page 2
ID:rxdAS7EaO6bSgtLEAvLofNzBNQD-HrUa aa8Ze3qKfbmxPNuo2QijEJYrRjHpSgeB6zAxdJ

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 184.3 lbs FACTORED DOWN AT 4-7-4
ON TOP CHORD, AND 1467.6 lbs FACTORED
DOWN AT 10-1-4 ON BOTTOM CHORD. DESIGN
FOR UNSPECIFIED CONNECTION(S) IS
DELEGATED TO THE BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (Q) (INPUT = 0.90)
JSI METAL= 0.77 (Q) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



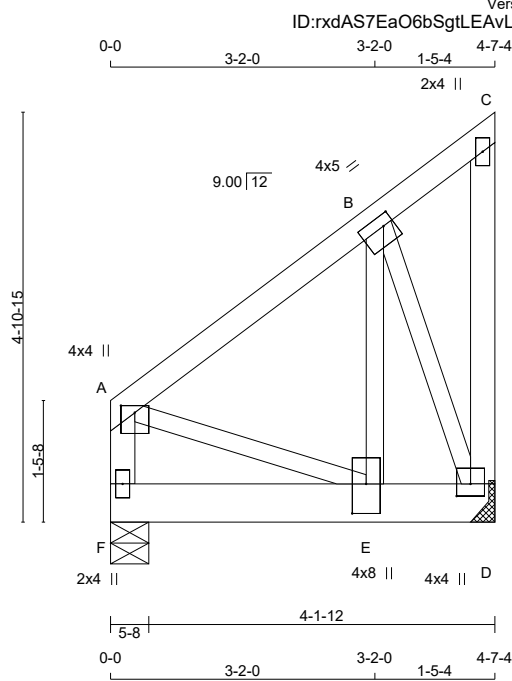

TOTAL WEIGHT = 28 lb [M]

LUMBER					DESCR.
CHORDS	SIZE	DRY	LUMBER	No.2	
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
B	TMWW-t	MT20	4.0	5.0	1.50 1.50
C	TMV+p	MT20	2.0	4.0	
D	BMVW1+p	MT20	4.0	4.0	1.75 2.00
E	BMWW+t	MT20	4.0	8.0	4.25 2.00
F	BMV1+p	MT20	2.0	4.0	

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1765.4 lbs FACTORED DOWN AT 3-2-0 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
F	837	0	837	0	5-8
D	1468	0	1468	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
F	588	411 / 0	0 / 0	0 / 0	0 / 0	177 / 0	0 / 0	
D	1030	721 / 0	0 / 0	0 / 0	0 / 0	310 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
F-A	-692 / 0	0.0	0.0 0.08 (1)	A-E	0 / 571	0.14 (1)	
A-B	-668 / 0	-77.4	-77.4 0.12 (1)	E-B	0 / 1468	0.36 (1)	
B-C	-21 / 0	-77.4	-77.4 0.07 (1)	B-D	-1399 / 0	0.35 (1)	
D-C	-21 / 0	0.0	0.0 0.01 (1)				
F-E	0 / 0	-50.1	-50.1 0.15 (1)				
E-D	0 / 542	-17.5	-17.5 0.22 (1)				

FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
E	3-2-0	-1765	-1765	---	FRONT	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 3-4-8
END DISTANCE = 3-2-0
END SPAN CARRIED = 3-4-8
END WALL WIDTH = 0-0
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WB=0.36/1.00 (B-E:1), SSI=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (D) (INPUT = 0.90)
JSI METAL= 0.30 (E) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



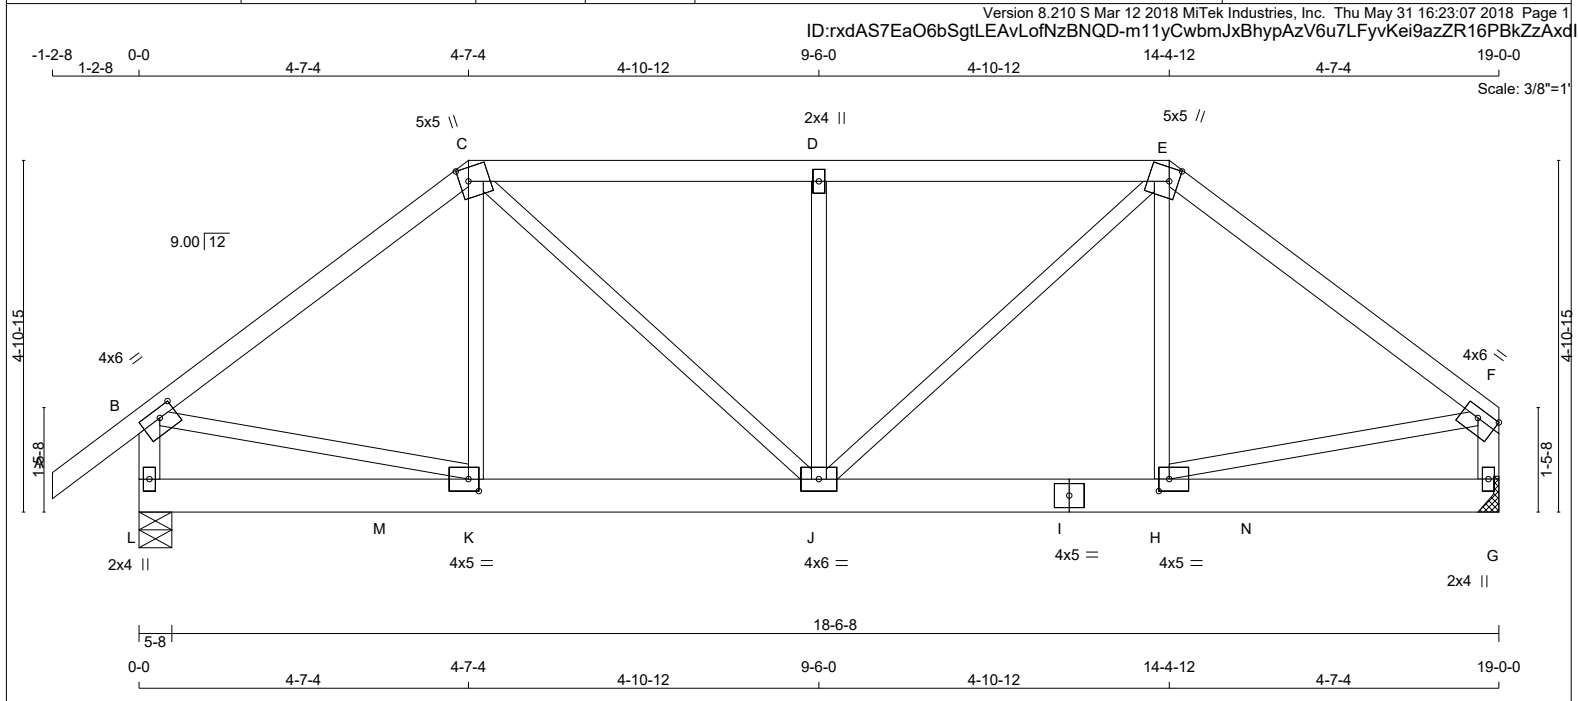

TOTAL WEIGHT = 90 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2 SPF
C - E	2x4	DRY	No.2 SPF
E - F	2x4	DRY	No.2 SPF
L - B	2x4	DRY	No.2 SPF
G - F	2x4	DRY	No.2 SPF
L - I	2x6	DRY	No.2 SPF
I - G	2x6	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	TTWW+m	MT20	5.0	5.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	5.0	2.25	1.50
F	TMVW-t	MT20	4.0	6.0	1.50	Edge
G	BMV1+p	MT20	2.0	4.0		
H	BMWW-t	MT20	4.0	5.0	2.00	1.75
I	BS-t	MT20	4.0	5.0		
J	BMWWW-t	MT20	4.0	6.0		
K	BMWW-t	MT20	4.0	5.0	2.00	1.75
L	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 864.9 lbs FACTORED DOWN AT 3-5-4, AND 864.9 lbs FACTORED DOWN AT 15-6-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	1866	0	1866	0	5-8	5-8
G	1766	0	1766	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT G TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	1308	927 / 0	0 / 0	0 / 0	0 / 0	380 / 0	0 / 0
G	1239	867 / 0	0 / 0	0 / 0	0 / 0	372 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4	-77.4 0.10 (1)	K-C	0 / 589	0.15 (1)	
B-C	-1786 / 0	-77.4	-77.4 0.41 (1)	C-J	0 / 233	0.06 (1)	
C-D	-1611 / 0	-77.4	-77.4 0.39 (1)	J-D	-456 / 0	0.16 (1)	
D-E	-1611 / 0	-77.4	-77.4 0.39 (1)	J-E	0 / 233	0.06 (1)	
E-F	-1786 / 0	-77.4	-77.4 0.41 (1)	H-E	0 / 589	0.15 (1)	
L-B	-1671 / 0	0.0	0.0 0.19 (1)	B-K	0 / 1461	0.36 (1)	
G-F	-1571 / 0	0.0	0.0 0.18 (1)	H-F	0 / 1461	0.36 (1)	
L-M	0 / 0	-17.5	-17.5 0.42 (1)				
M-K	0 / 0	-17.5	-17.5 0.42 (1)				
K-J	0 / 1440	-17.5	-17.5 0.46 (1)				
J-I	0 / 1440	-17.5	-17.5 0.46 (1)				
I-H	0 / 1440	-17.5	-17.5 0.46 (1)				
H-N	0 / 0	-17.5	-17.5 0.42 (1)				
N-G	0 / 0	-17.5	-17.5 0.42 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
M	3-5-4	-865	-865	---	FRONT	VERT	TOTAL
N	15-6-12	-865	-865	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.63")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.63")
CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.41/1.00 (B-C:1), BC=0.46/1.00 (H-J:1), WB=0.36/1.00 (B-K:1), SSI=0.50/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 822 2284 1656

CONTINUED ON PAGE 2

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES-AMELIA 2 EL	PRWG NO.
NE0518-223	G04	1	1	TRUSS DESC.		PAGE 10 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:07 2018 Page 2
ID:rxdAS7EaO6bSgtLEAvLofNzBNQD-m11yCwbmJxBhypAzV6u7LFyvKei9azZR16PBkZzAxcI

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (K) (INPUT = 0.90)
JSI METAL= 0.51 (I) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



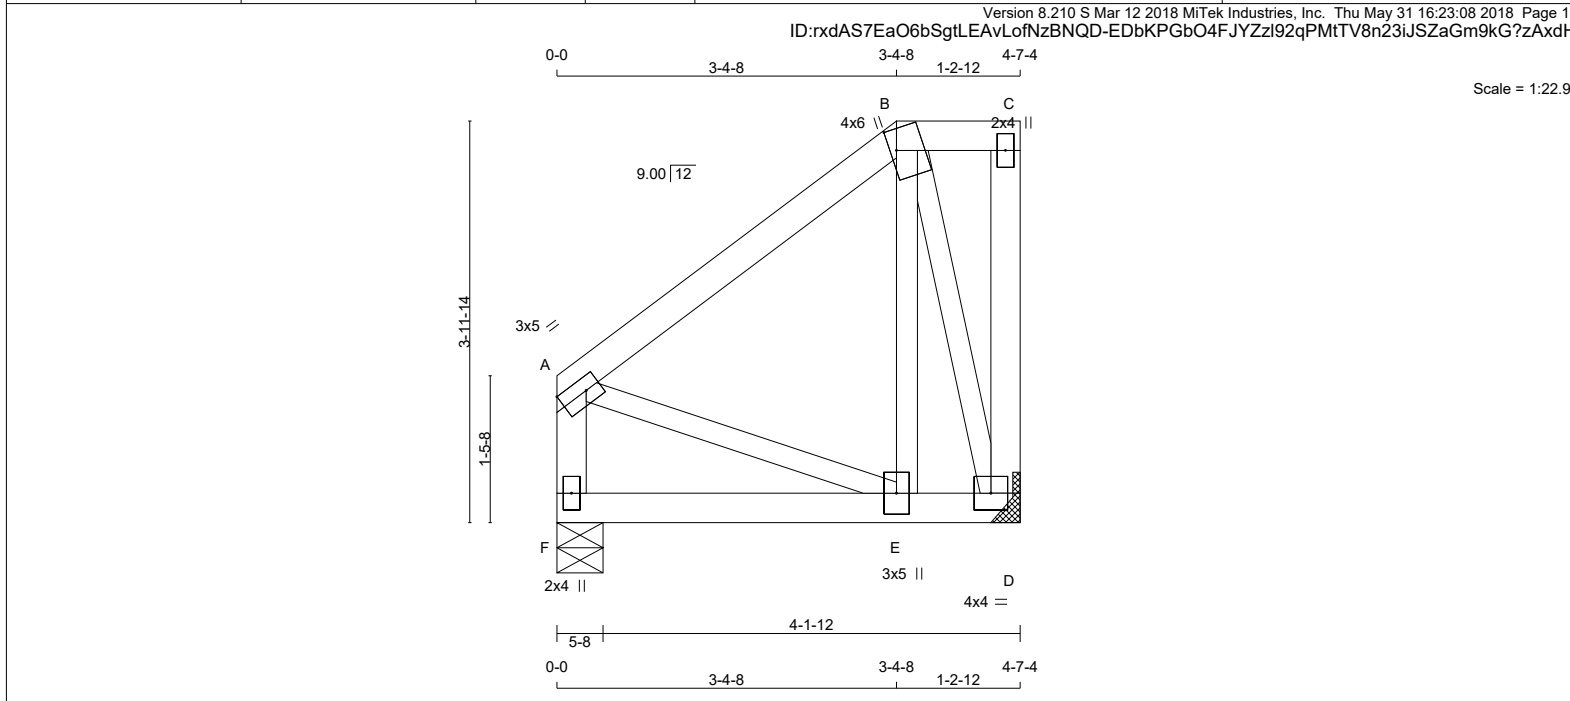

										TOTAL WEIGHT = 2 X 25 = 50 lb	
LUMBER N. L. G. A. RULES					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					DESIGN CRITERIA	
CHORDS		SIZE	LUMBER	DESCR.	BEARINGS						
A - B	2x4	DRY	No.2	SPF	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
B - C	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
D - C	2x4	DRY	No.2	SPF	D	866	0	866	0	0	MECHANICAL
F - A	2x4	DRY	No.2	SPF	F	804	0	804	0	0	5-8
F - D	2x4	DRY	No.2	SPF							
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.						
DRY: SEASONED LUMBER.											
					SPECIFIED LOADS:						
					TOP CH. LL = 23.3 PSF						
					DL = 3.0 PSF						
					BOT CH. LL = 0.0 PSF						
					DL = 7.0 PSF						
					TOTAL LOAD = 33.3 PSF						
					SPACING = 24.0 IN. C/C						
					LOADING INTENSITIES SPECIFIED AFTER CORRECTION						

PLATES (table is in inches)						UNFACTORED REACTIONS						LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
JT TYPE		PLATES	W	LEN	Y	X	1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
							JT	COMBINED	SNOW	LIVE	PERM.LIVE		WIND	DEAD	SOIL
							D	607	428 / 0	0 / 0	0 / 0		0 / 0	179 / 0	0 / 0
A	TMVW-t	MT20	3.0	5.0	1.50	Edge	F	565	391 / 0	0 / 0	0 / 0	0 / 0	174 / 0	0 / 0	
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F															
BRACING															
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.															
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.															
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.															
GIRDER TYPE: CStdGirder															
START DISTANCE = 0-0															
START SPAN CARRIED = 12-0-0															
END DISTANCE = 4-7-4															
END SPAN CARRIED = 12-0-0															
END WALL WIDTH = 0-0															
APPLIED TO FRONT SIDE OF BOTTOM CHORD.															
- ADDT'L LOADS BASED ON 55 % OF GSL.															
GIRDER TYPE: CPrimeHip															
LEFT SETBACK = 3-4-8															
RIGHT SETBACK = 0-0															

HANGERS NOTES 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 81.6 lbs FACTORED DOWN AT 3-4-8 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.				BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.			
--	--	--	--	---	--	--	--

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-342 / 0	-77.4	-77.4	0.17 (1)	E-B	0 / 817	0.20 (1)
B-C	0 / 0	-104.0	-104.0	0.03 (1)	B-D	-935 / 0	0.25 (1)
D-C	-64 / 0	0.0	0.0	0.02 (1)	A-E	0 / 287	0.07 (1)
F-A	-426 / 0	0.0	0.0	0.05 (1)			
F-E	0 / 0	-260.7	-260.7	0.41 (1)			
E-D	0 / 296	-260.7	-260.7	0.44 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
B	3-4-8	-82	-82	---	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
LL	23.3	PSF
BOT CH.	LL	PSF
LL	0.0	PSF
DL	7.0	PSF
TOTAL LOAD	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CStdGirder
 LEFT SETBACK = 3-4-8
 RIGHT SETBACK = 0-0
 END SETBACK = 3-4-8
 END WALL WIDTH = 0-0
 CORNER FRAMING TYPE: CONVENTIONAL
 END JACK TYPE: CONVENTIONAL
 APPLIED TO BACK SIDE
 - ADDTL LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CPrimeHip
 LEFT SETBACK = 3-4-8
 RIGHT SETBACK = 0-0
 END SETBACK = 3-4-8
 END WALL WIDTH = 0-0
 CORNER FRAMING TYPE: CONVENTIONAL
 END JACK TYPE: CONVENTIONAL
 APPLIED TO BACK SIDE
 - ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
 ALLOWABLE DEFL.(TL)= L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/824 (0.07")

CSI: TC=0.17/1.00 (A-B:1), BC=0.44/1.00 (D-E:1), WB=0.25/1.00 (B-D:1), SSI=0.45/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES-AMELIA 2 EL	DRWG NO.
NE0518-223	G05	2	1	TRUSS DESC.		PAGE 12 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:08 2018 Page 2
ID:rxdAS7EaO6bSgtLEAvLofNzBNQD-EDbKPGbO4FJYZzl92qPMtTV8n23iJSZaGm9kG?zAxdH

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
		822	2284
			1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)

JSI METAL= 0.22 (E) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



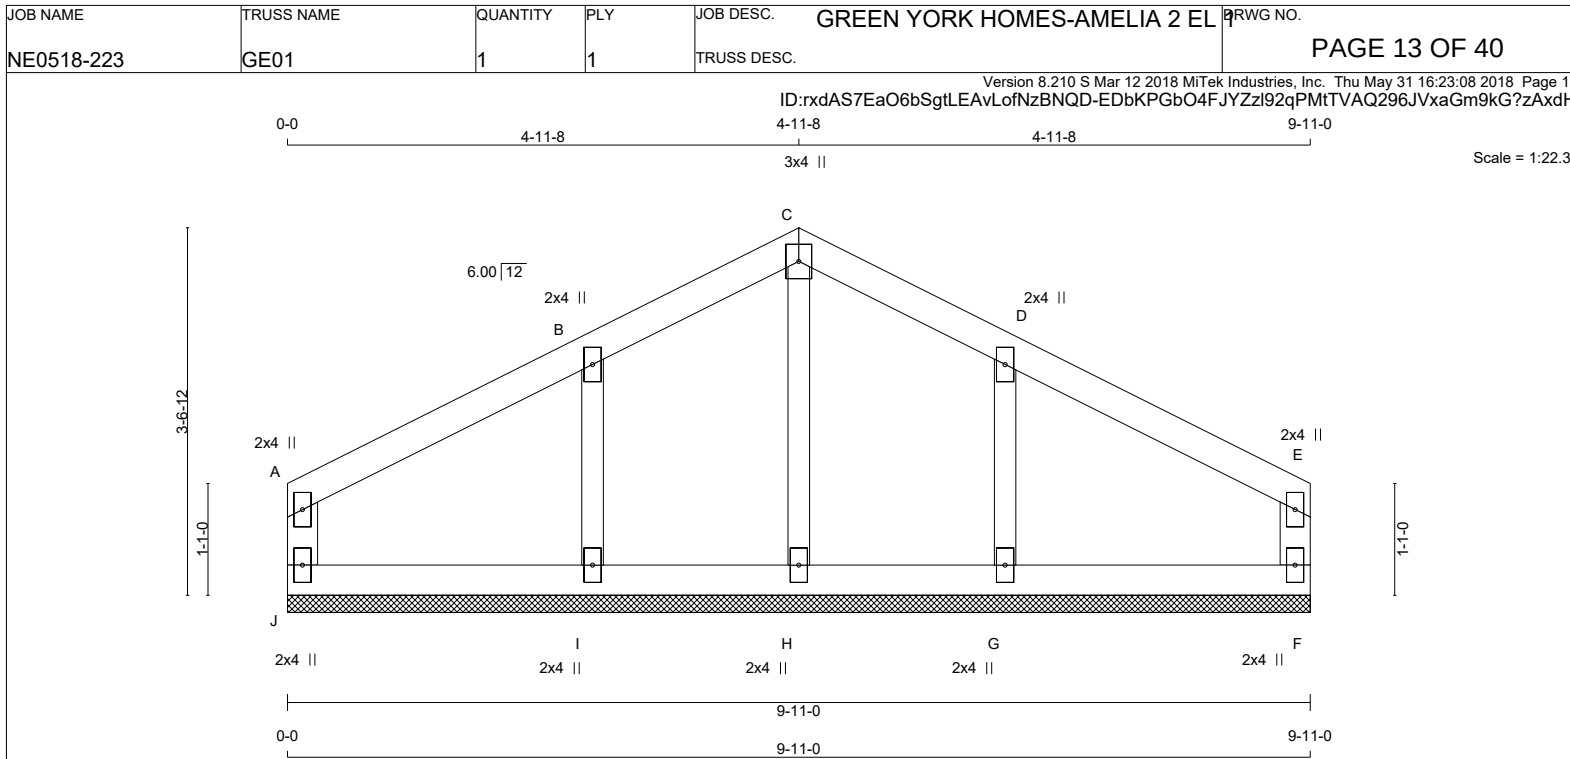

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF J - A 2x4 DRY No.2 SPF A - C 2x4 DRY No.2 SPF C - E 2x4 DRY No.2 SPF F - E 2x4 DRY No.2 SPF J - F 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF ALL GABLE WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4)				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.06/1.00 (A-B:1), BC=0.03/1.00 (I-J:4), WB=0.03/1.00 (B-I:1), SSI=0.08/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.14 (A) (INPUT = 0.90) JSI METAL= 0.06 (A) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X A TMV+p MT20 2.0 4.0 B TMW+w MT20 2.0 4.0 C TTW+p MT20 3.0 4.0 D TMW+w MT20 2.0 4.0 E TMV+p MT20 2.0 4.0 F BMV1+p MT20 2.0 4.0 G, H, I G BMW1+w MT20 2.0 4.0 J BMV1+p MT20 2.0 4.0				CHORDS MAX. FACTORED MEMB. FORCE (LBS) VERT. LOAD LC1 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO J-A -145 / 0 0.0 0.0 0.06 (1) 7.81 A-B -77 / 0 -77.4 -77.4 0.06 (1) 6.25 B-C -76 / 0 -77.4 -77.4 0.06 (1) 6.25 C-D -76 / 0 -77.4 -77.4 0.06 (1) 6.25 D-E -77 / 0 -77.4 -77.4 0.06 (1) 6.25 F-E -145 / 0 0.0 0.0 0.06 (1) 7.81 J-I 0 / 69 -17.5 -17.5 0.03 (4) 10.00 I-H 0 / 63 -17.5 -17.5 0.03 (4) 10.00 H-G 0 / 63 -17.5 -17.5 0.03 (4) 10.00 G-F 0 / 69 -17.5 -17.5 0.03 (4) 10.00				WEBS MAX. FACTORED MEMB. FORCE (LBS) MAX. CSI (LC) H-C -71 / 4 0.01 (1) I-B -203 / 0 0.03 (1) G-D -203 / 0 0.03 (1)			

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

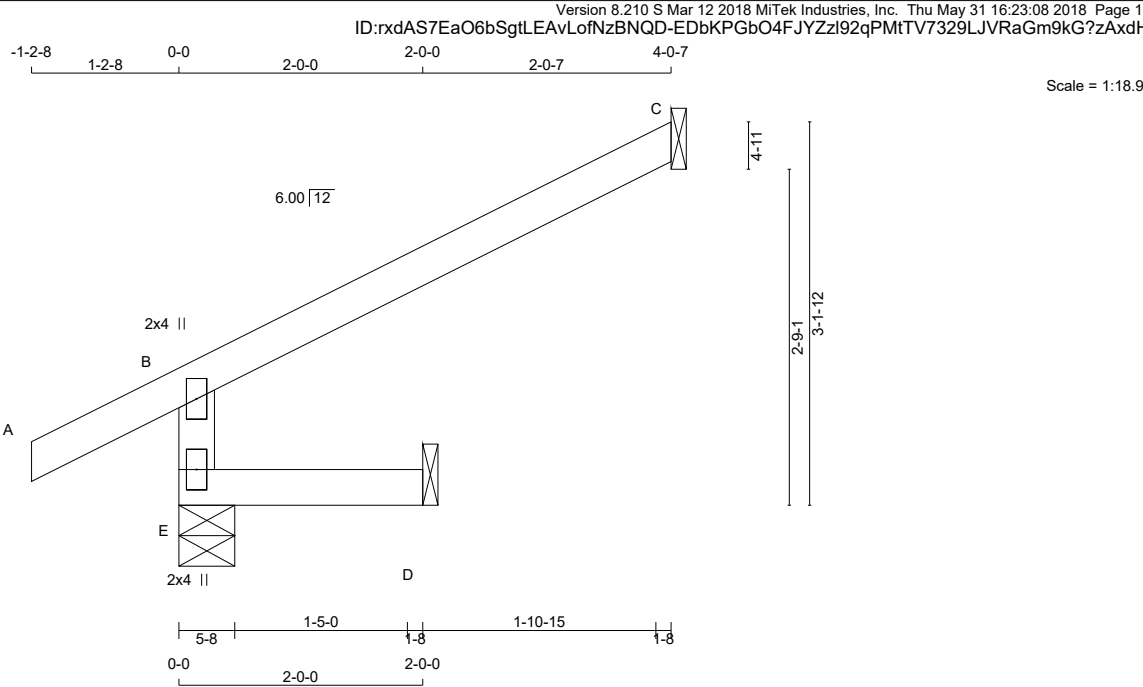

TOTAL WEIGHT = 2 X 10 = 20 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	313	0	313	0	5-8	5-8
C	117	0	117	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	215	177 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. MEMB. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1
FR-TO		FROM	TO		FR-TO		FROM	TO
E-B	-294 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00			
B-C	-17 / 0	-77.4	-77.4	0.21 (1)	6.25			
E-D	0 / 0	-17.5	-17.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



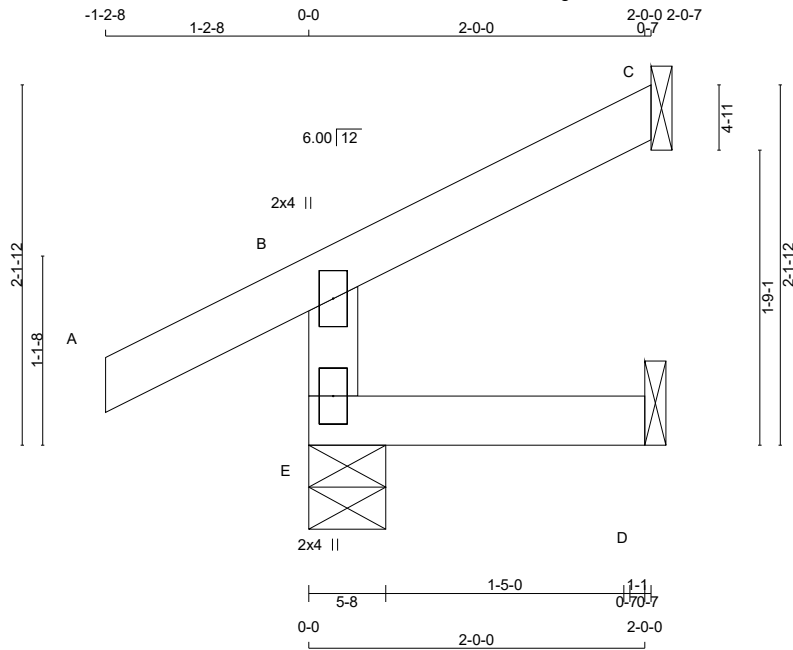

Scale = 1:13.7

TOTAL WEIGHT = 2 X 7 = 15 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	216	0	216	0	5-8	5-8	5-8	5-8
C	59	0	59	0	1-8	1-8	1-8	1-8
D	16	0	17	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	149	118 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FROM TO
E-B	-197 / 0	0.0 0.0 0.01 (4)	7.81	
A-B	0 / 22	-77.4 -77.4 0.09 (1)	10.00	
B-C	-9 / 0	-77.4 -77.4 0.05 (1)	10.00	
E-D	0 / 0	-17.5 -17.5 0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



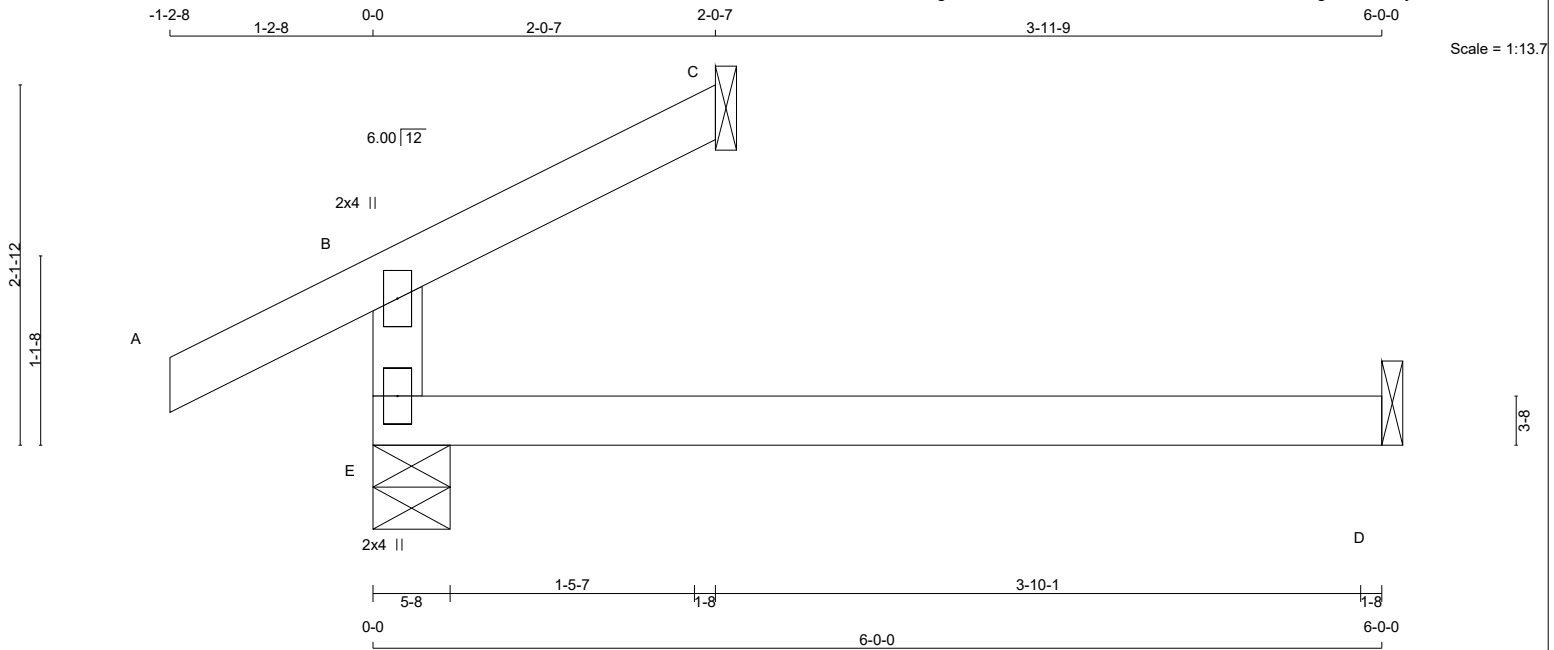

TOTAL WEIGHT = 2 X 12 = 24 lb [M][F]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

DESCR. SP
SPF
SPF
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMV+p MT20 2.0 4.0
E BMV1+p MT20 2.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	258	0	258	0	0	5-8	5-8	
C	59	0	59	0	0	1-8	1-8	
D	43	0	48	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	183	118 / 0	0 / 0	0 / 0	0 / 0	65 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FR-TO
E-B	-197 / 0	0.0 0.0 0.11 (4)	7.81	
A-B	0 / 22	-77.4 -77.4 0.09 (1)	10.00	
B-C	-9 / 0	-77.4 -77.4 0.04 (1)	10.00	
E-D	0 / 0	-17.5 -17.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.11/1.00 (B-E:4) , BC=0.13/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.08/1.00 (D-E:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



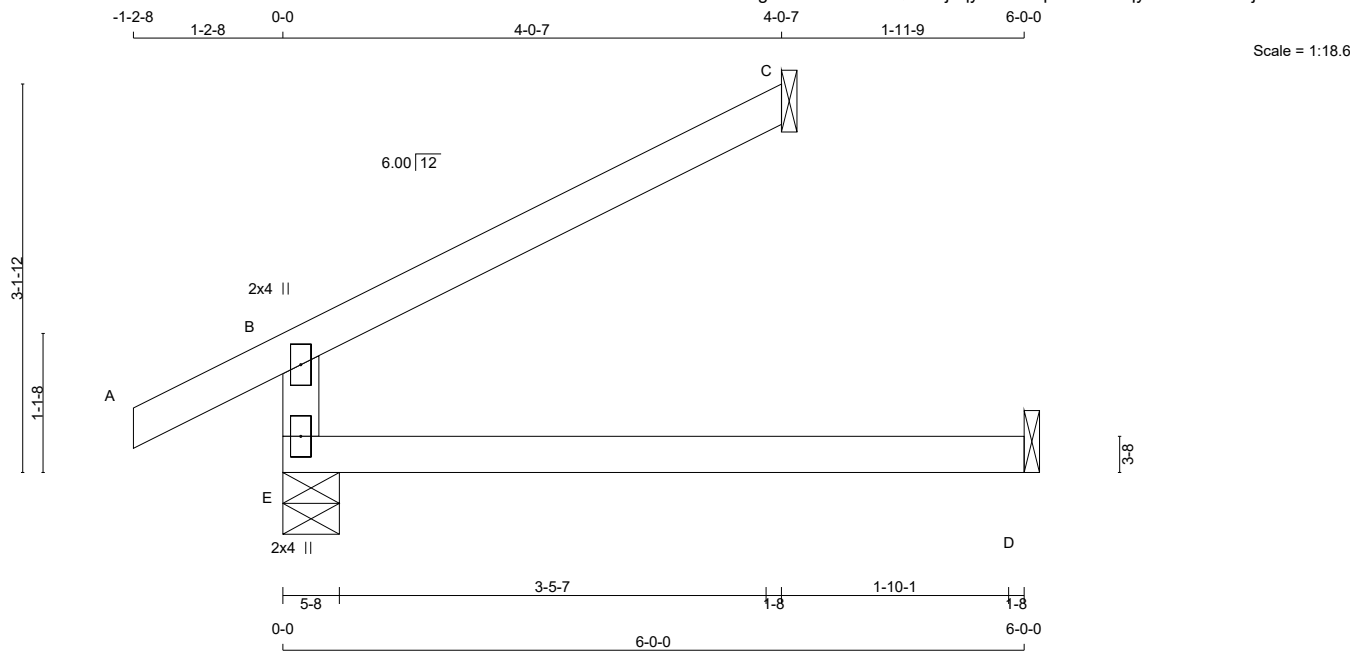

TOTAL WEIGHT = 2 X 14 = 29 lb [M][F]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	355	0	355	0	5-8	5-8
C	117	0	117	0	1-8	1-8
D	43	0	48	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	249	177 / 0	0 / 0	0 / 0	0 / 0	72 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
	MAX.	FACTORED	MAX.	FACTORED					
FR-TO									
E-B	-294 / 0	0.0	0.0	0.11 (4)	7.81				
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00				
B-C	-17 / 0	-77.4	-77.4	0.16 (1)	6.25				
E-D	0 / 0	-17.5	-17.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")

CSI: TC=0.16/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



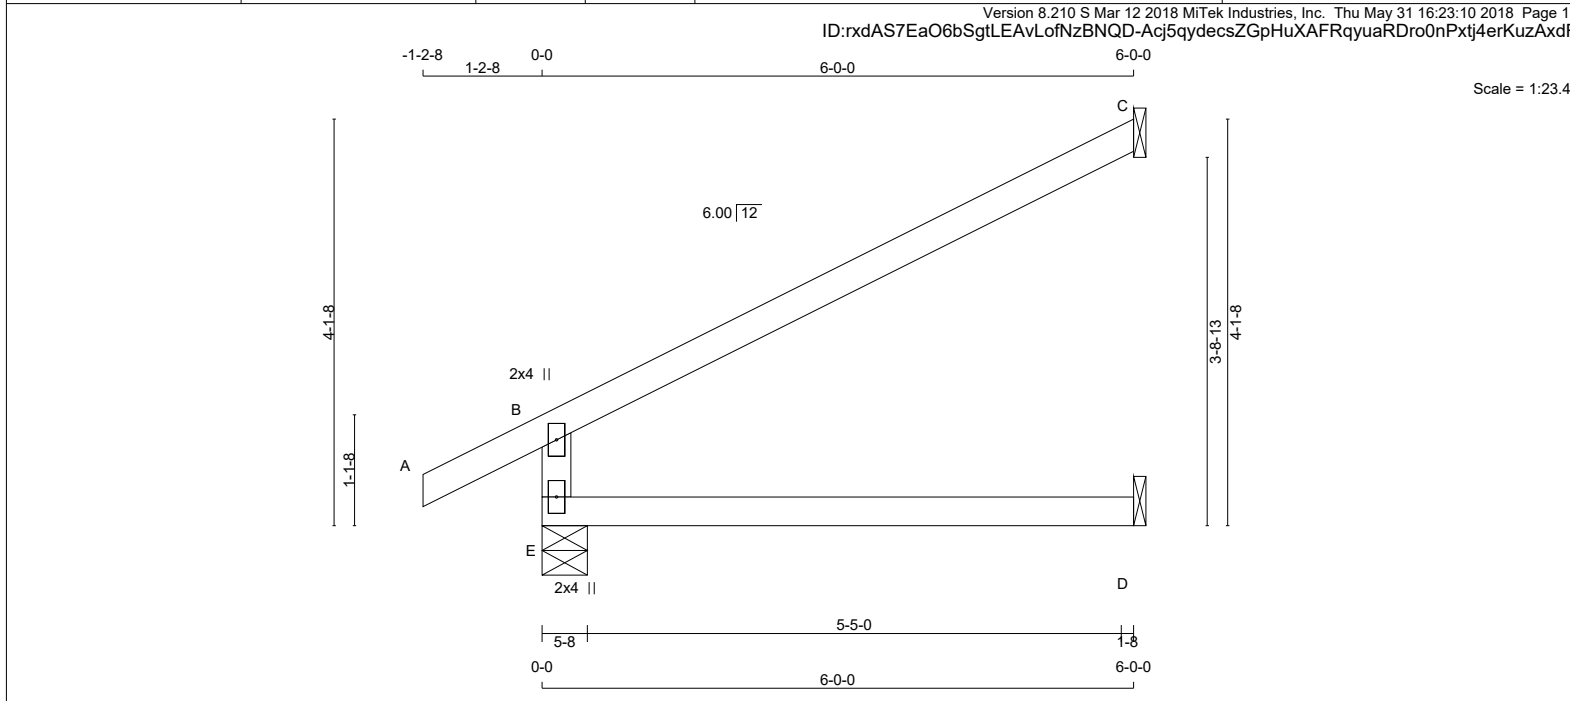

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER E - B 2x4 DRY No.2 A - C 2x4 DRY No.2 E - D 2x4 DRY No.2 DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF				TOTAL WEIGHT = 10 X 17 = 169 lb [M][F]			
---	--	--	--	--	--	--	--	--	--	--	--

PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMV+p MT20 2.0 4.0 E BMV1+p MT20 2.0 4.0				BEARINGS FACTORED GROSS REACTION JT VERT HORZ E 450 0 C 174 0 D 43 0				MAXIMUM FACTORED GROSS REACTION DOWN HORZ UPLIFT E 450 0 0 C 174 0 0 D 48 0 0				INPUT REQD BRG IN-SX IN-SX E 5-8 5-8 C 1-8 1-8 D 1-8 1-8			
---	--	--	--	--	--	--	--	--	--	--	--	---	--	--	--

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
E	314 234 / 0 0 / 0 0 / 0 80 / 0 0 / 0
C	118 105 / 0 0 / 0 0 / 0 14 / 0 0 / 0
D	35 0 / 0 0 / 0 0 / 0 35 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX. MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO			FR-TO			
E-B	-389 / 0	0.0 0.0 0.11 (4)		7.81				
A-B	0 / 22	-77.4 -77.4 0.09 (1)		10.00				
B-C	-26 / 0	-77.4 -77.4 0.36 (1)		6.25				
E-D	0 / 0	-17.5 -17.5 0.13 (4)		10.00				

ALLOWABLE DEFL.(LL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
 ALLOWABLE DEFL.(TL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1) , BC=0.13/1.00 (D-E:4) ,
 WB=0.00/1.00 (n/a:0) , SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
 JSI METAL= 0.09 (B) (INPUT = 1.00)

May 31, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



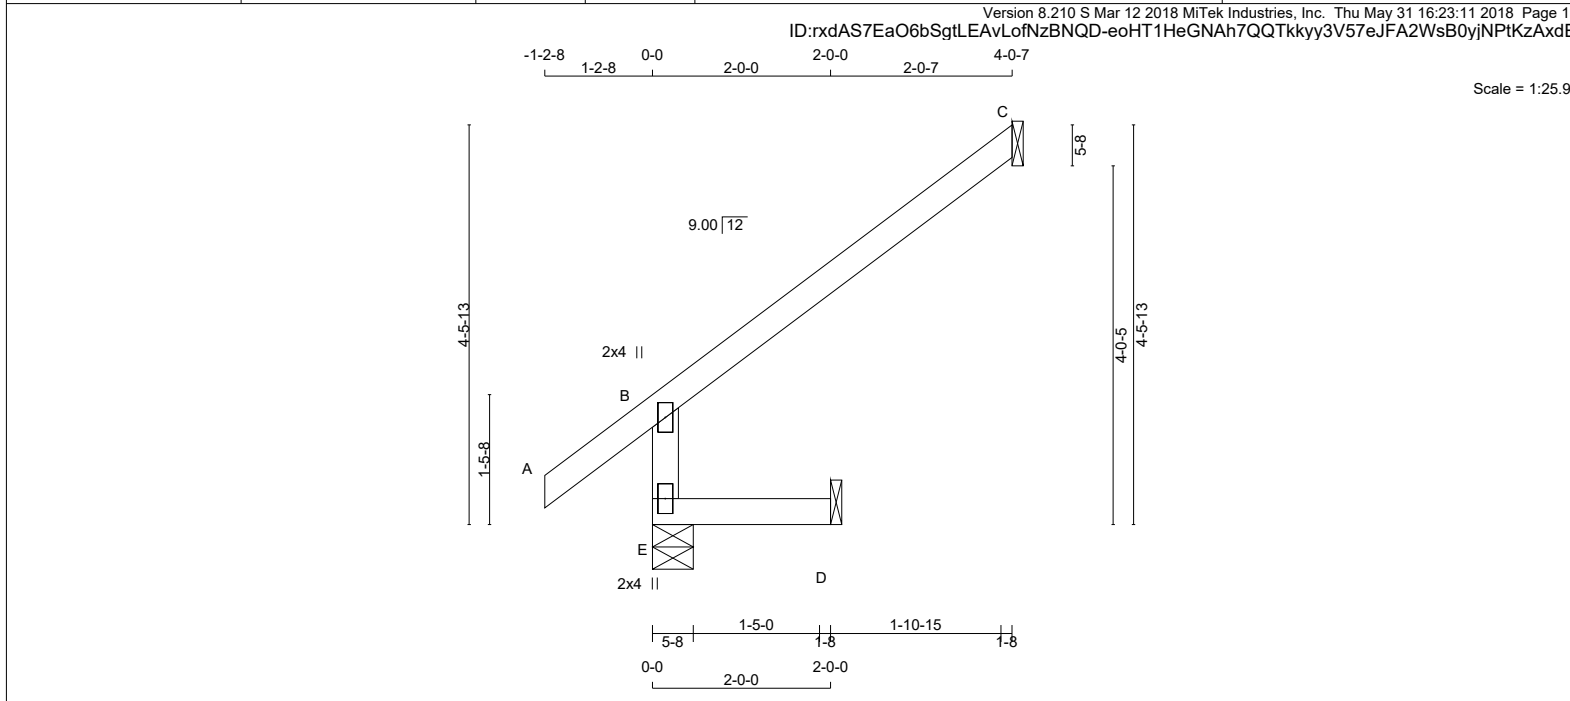

TOTAL WEIGHT = 11 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	314	0	314	0	5-8	5-8
C	117	0	117	0	1-8	1-8
D	16	0	18	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	216	178 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM	TO			FR-TO			
E-B	-295 / 0	0.0	0.0	0.01 (4)	7.81				
A-B	0 / 30	-77.4	-77.4	0.09 (1)	10.00				
B-C	-23 / 0	-77.4	-77.4	0.21 (1)	6.25				
E-D	0 / 0	-17.5	-17.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	23.3	PSF
DL	3.0	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.0	PSF
TOTAL LOAD	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



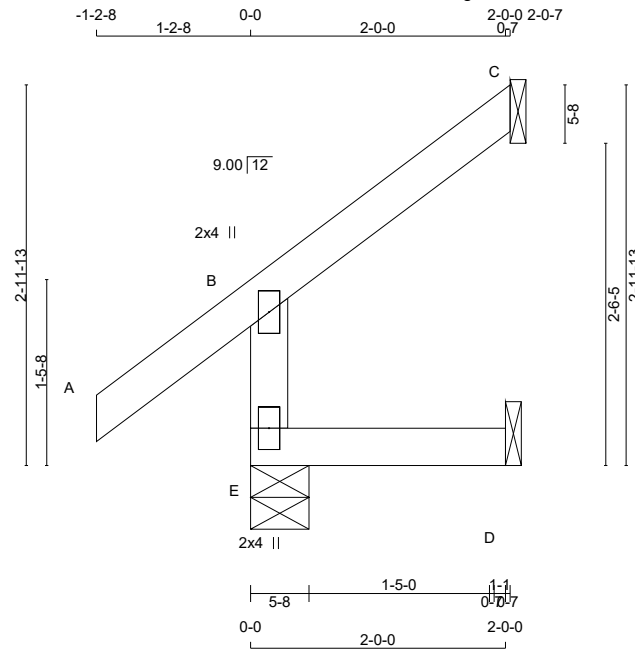

Scale = 1:18.1

TOTAL WEIGHT = 3 X 8 = 25 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	217	0	217	0	5-8	5-8
C	60	0	60	0	1-8	1-8
D	16	0	18	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	150	119 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
E-B	-198 / 0	0.0 0.0 0.01 (4)	7.81	
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B-C	-12 / 0	-77.4 -77.4 0.05 (1)	6.25	
E-D	0 / 0	-17.5 -17.5 0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.09/1.00 (A-B:1) , BC=0.02/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



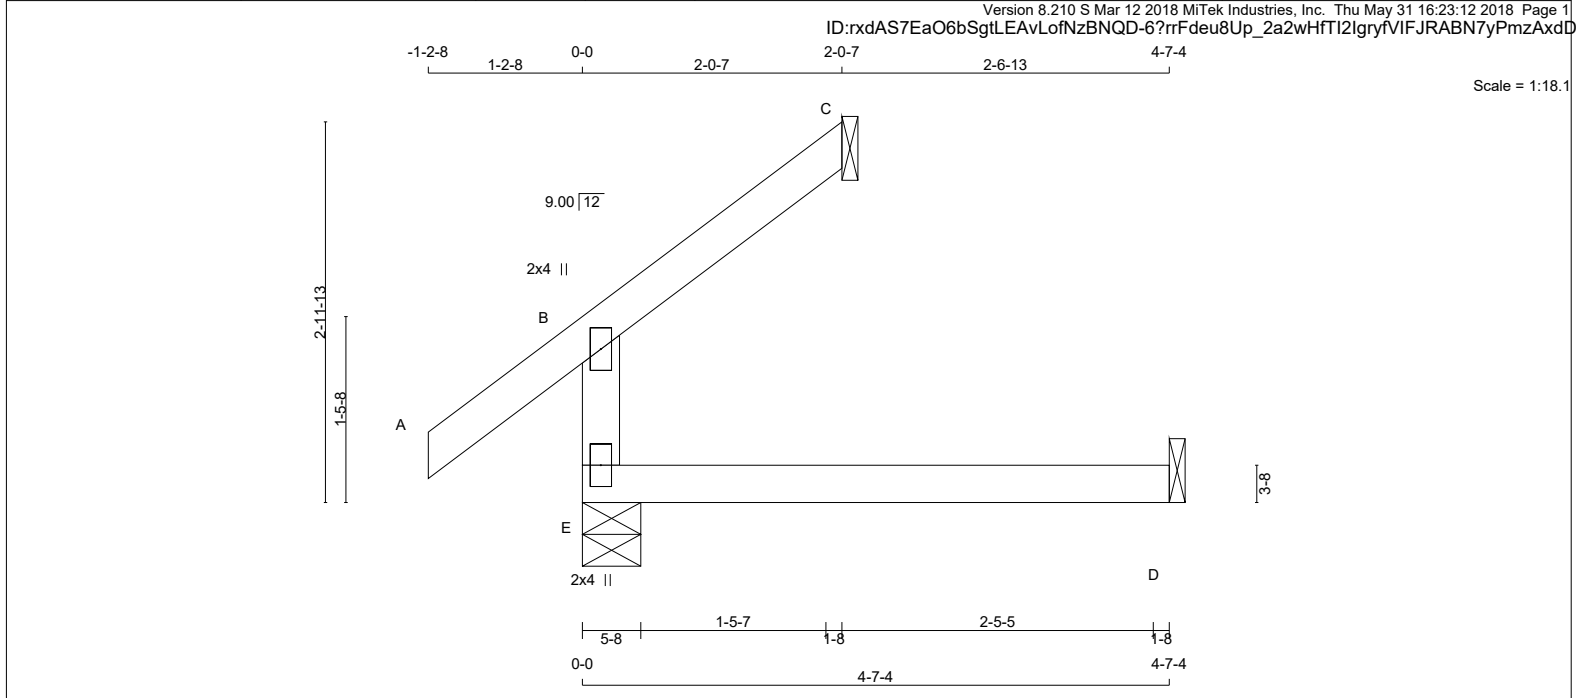

TOTAL WEIGHT = 11 lb [M]


TOTAL WEIGHT = 11 lb		[M]																																																																																																																		
LUMBER N. L. G. A. RULES <table><tr><td>CHORDS</td><td>SIZE</td><td>DRY</td><td>LUMBER</td><td>DESCR.</td></tr><tr><td>E - B</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>A - C</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr><tr><td>E - D</td><td>2x4</td><td>DRY</td><td>No.2</td><td>SPF</td></tr></table> DRY: SEASONED LUMBER.		CHORDS	SIZE	DRY	LUMBER	DESCR.	E - B	2x4	DRY	No.2	SPF	A - C	2x4	DRY	No.2	SPF	E - D	2x4	DRY	No.2	SPF																																																																																															
CHORDS	SIZE	DRY	LUMBER	DESCR.																																																																																																																
E - B	2x4	DRY	No.2	SPF																																																																																																																
A - C	2x4	DRY	No.2	SPF																																																																																																																
E - D	2x4	DRY	No.2	SPF																																																																																																																
PLATES (table is in inches) <table><tr><td>JT</td><td>TYPE</td><td>PLATES</td><td>W</td><td>LEN</td><td>Y</td><td>X</td></tr><tr><td>B</td><td>TMV+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr><tr><td>E</td><td>BMV1+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr></table>		JT	TYPE	PLATES	W	LEN	Y	X	B	TMV+p	MT20	2.0	4.0			E	BMV1+p	MT20	2.0	4.0																																																																																																
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																														
B	TMV+p	MT20	2.0	4.0																																																																																																																
E	BMV1+p	MT20	2.0	4.0																																																																																																																
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table><tr><td>JT</td><td>FACTORED GROSS REACTION VERT</td><td>FACTORED GROSS REACTION HORZ</td><td>MAXIMUM FACTORED GROSS REACTION DOWN</td><td>MAXIMUM FACTORED GROSS REACTION HORZ</td><td>INPUT BRG IN-SX</td><td>REQD BRG IN-SX</td></tr><tr><td>E</td><td>244</td><td>0</td><td>244</td><td>0</td><td>5-8</td><td>5-8</td></tr><tr><td>C</td><td>60</td><td>0</td><td>60</td><td>0</td><td>1-8</td><td>1-8</td></tr><tr><td>D</td><td>34</td><td>0</td><td>39</td><td>0</td><td>1-8</td><td>1-8</td></tr></table> SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D UNFACTORED REACTIONS <table><tr><td>JT</td><td>1ST LCASE COMBINED</td><td>SNOW</td><td>LIVE</td><td>PERM. LIVE</td><td>WIND</td><td>DEAD</td><td>SOIL</td></tr><tr><td>E</td><td>172</td><td>119 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>52 / 0</td><td>0 / 0</td></tr><tr><td>C</td><td>40</td><td>36 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>5 / 0</td><td>0 / 0</td></tr><tr><td>D</td><td>28</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>28 / 0</td><td>0 / 0</td></tr></table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) <table><tr><td colspan="2">CHORDS</td><td colspan="2">WEBS</td></tr><tr><td>MEMB.</td><td>MAX. FACTORED FORCE (LBS)</td><td>FACTORED VERT. LOAD (PLF)</td><td>MAX. FACTORED FORCE (LBS)</td></tr><tr><td>FR-TO</td><td></td><td>FROM TO</td><td>LENGTH FR-TO</td></tr><tr><td>E- B</td><td>-198 / 0</td><td>0.0 0.0</td><td>0.06 (4) 7.81</td></tr><tr><td>A- B</td><td>0 / 30</td><td>-77.4 -77.4</td><td>0.09 (1) 10.00</td></tr><tr><td>B- C</td><td>-12 / 0</td><td>-77.4 -77.4</td><td>0.05 (1) 6.25</td></tr><tr><td>E- D</td><td>0 / 0</td><td>-17.5 -17.5</td><td>0.08 (4) 10.00</td></tr></table>		JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION DOWN	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG IN-SX	REQD BRG IN-SX	E	244	0	244	0	5-8	5-8	C	60	0	60	0	1-8	1-8	D	34	0	39	0	1-8	1-8	JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	E	172	119 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0	C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0	D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	CHORDS		WEBS		MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FR-TO		FROM TO	LENGTH FR-TO	E- B	-198 / 0	0.0 0.0	0.06 (4) 7.81	A- B	0 / 30	-77.4 -77.4	0.09 (1) 10.00	B- C	-12 / 0	-77.4 -77.4	0.05 (1) 6.25	E- D	0 / 0	-17.5 -17.5	0.08 (4) 10.00	DESIGN CRITERIA SPECIFIED LOADS: <table><tr><td>TOP CH.</td><td>LL = 23.3 PSF</td></tr><tr><td></td><td>DL = 3.0 PSF</td></tr><tr><td>BOT CH.</td><td>LL = 0.0 PSF</td></tr><tr><td></td><td>DL = 7.0 PSF</td></tr><tr><td>TOTAL LOAD</td><td>= 33.3 PSF</td></tr></table> SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01") CSI: TC=0.09/1.00 (A-B:1) , BC=0.08/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.06/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES <table><tr><td>PLATE</td><td>GRIP(DRY)</td><td>SHEAR</td><td>SECTION</td></tr><tr><td></td><td>(PSI)</td><td>(PLI)</td><td>(PLI)</td></tr><tr><td></td><td>MAX MIN</td><td>MAX MIN</td><td>MAX MIN</td></tr><tr><td>MT20</td><td>618 354</td><td>1667 822</td><td>2284 1656</td></tr></table> PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.14 (B) (INPUT = 0.90) JSI METAL= 0.05 (B) (INPUT = 1.00)	TOP CH.	LL = 23.3 PSF		DL = 3.0 PSF	BOT CH.	LL = 0.0 PSF		DL = 7.0 PSF	TOTAL LOAD	= 33.3 PSF	PLATE	GRIP(DRY)	SHEAR	SECTION		(PSI)	(PLI)	(PLI)		MAX MIN	MAX MIN	MAX MIN	MT20	618 354	1667 822	2284 1656
JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION DOWN	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG IN-SX	REQD BRG IN-SX																																																																																																														
E	244	0	244	0	5-8	5-8																																																																																																														
C	60	0	60	0	1-8	1-8																																																																																																														
D	34	0	39	0	1-8	1-8																																																																																																														
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL																																																																																																													
E	172	119 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0																																																																																																													
C	40	36 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0																																																																																																													
D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0																																																																																																													
CHORDS		WEBS																																																																																																																		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)																																																																																																																	
FR-TO		FROM TO	LENGTH FR-TO																																																																																																																	
E- B	-198 / 0	0.0 0.0	0.06 (4) 7.81																																																																																																																	
A- B	0 / 30	-77.4 -77.4	0.09 (1) 10.00																																																																																																																	
B- C	-12 / 0	-77.4 -77.4	0.05 (1) 6.25																																																																																																																	
E- D	0 / 0	-17.5 -17.5	0.08 (4) 10.00																																																																																																																	
TOP CH.	LL = 23.3 PSF																																																																																																																			
	DL = 3.0 PSF																																																																																																																			
BOT CH.	LL = 0.0 PSF																																																																																																																			
	DL = 7.0 PSF																																																																																																																			
TOTAL LOAD	= 33.3 PSF																																																																																																																			
PLATE	GRIP(DRY)	SHEAR	SECTION																																																																																																																	
	(PSI)	(PLI)	(PLI)																																																																																																																	
	MAX MIN	MAX MIN	MAX MIN																																																																																																																	
MT20	618 354	1667 822	2284 1656																																																																																																																	

</



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



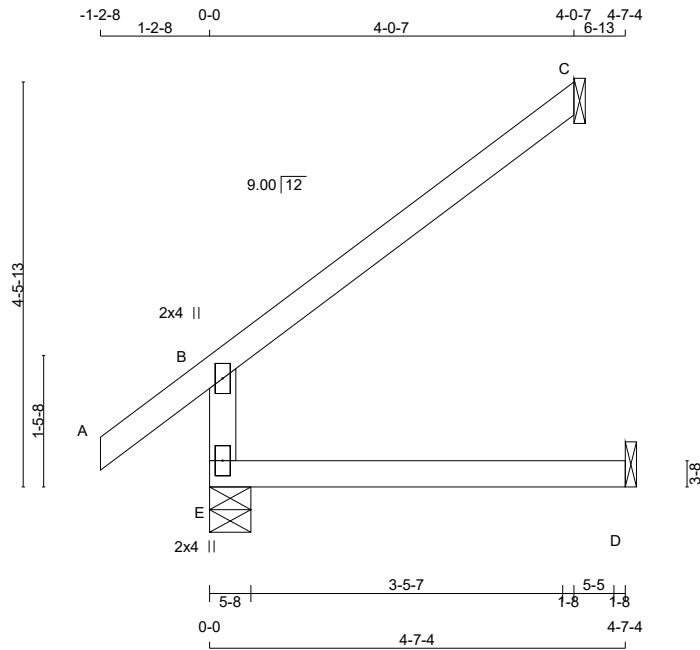

Scale = 1:25.5

TOTAL WEIGHT = 14 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	341	0	341	0	5-8	5-8		
C	117	0	117	0	1-8	1-8		
D	34	0	39	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	238	178 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	80	71 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO
E-B	-295 / 0	0.0 0.0 0.06 (4)		7.81
A-B	0 / 30	-77.4 -77.4 0.09 (1)		10.00
B-C	-23 / 0	-77.4 -77.4 0.21 (1)		6.25
E-D	0 / 0	-17.5 -17.5 0.08 (4)		10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3 PSF
DL =	3.0 PSF	
BOT CH.	LL =	0.0 PSF
DL =	7.0 PSF	
TOTAL LOAD =	33.3 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.21/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



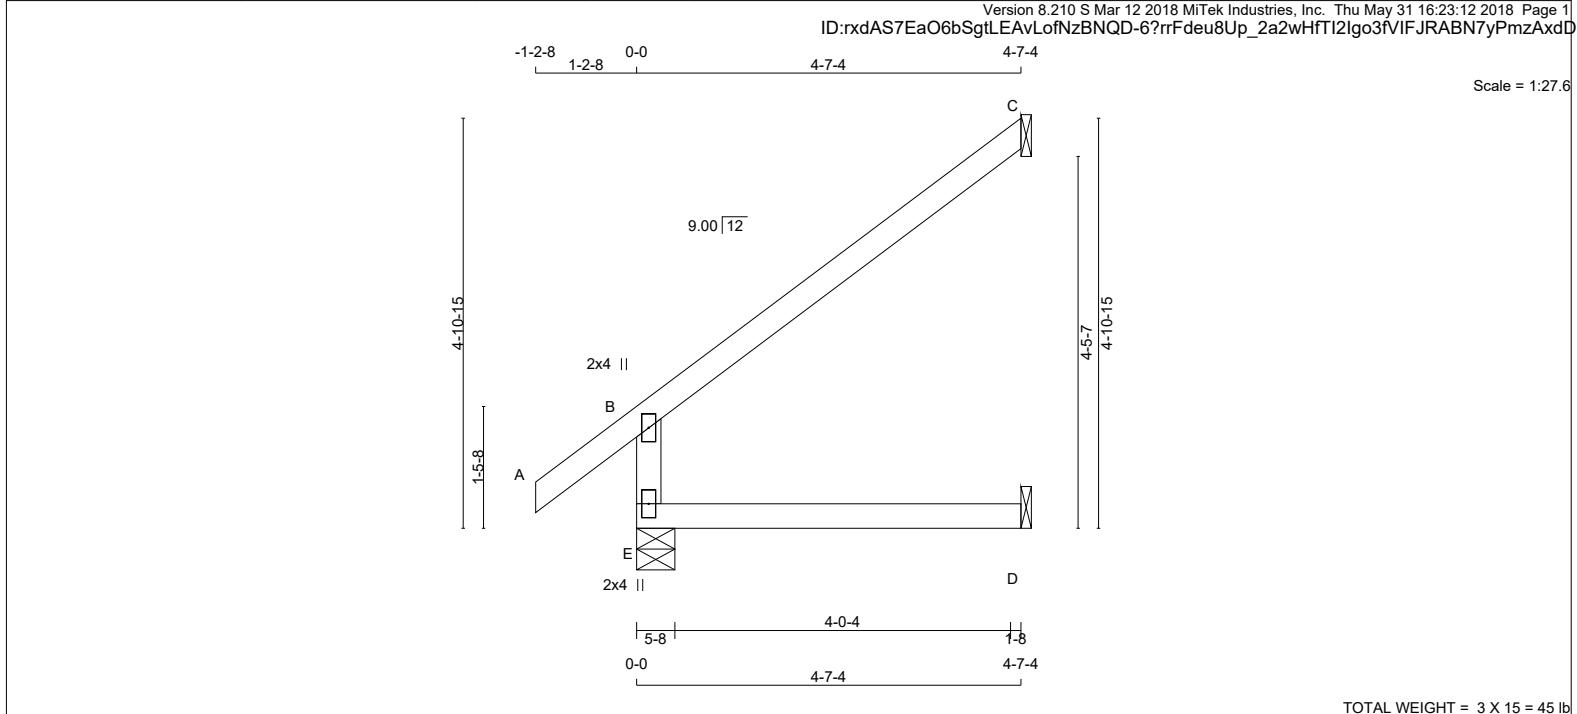

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	369	0	369	0	0	5-8	5-8
C	134	0	134	0	0	1-8	1-8
D	34	0	39	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	256	194 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	91	80 / 0	0 / 0	0 / 0	0 / 0	10 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				
TOTAL LOAD CASES: (4)				
CHORDS			WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MEMB. FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO		FROM TO	UNBRAC LENGTH FR-TO	
E- B	-323 / 0	0.0 0.0 0.06 (4)	7.81	
A- B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	
B- C	-27 / 0	-77.4 -77.4 0.28 (1)	6.25	
E- D	0 / 0	-17.5 -17.5 0.08 (4)	10.00	

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.28/1.00 (B-C:1) , BC=0.08/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES-AMELIA 2 EL	BRWG NO.
NE0518-223	J11	2	1	TRUSS DESC.		PAGE 24 OF 40

ID: rxdAS7EaO6bSgtLEAvLoFzBNQD-aBPDStXvnxrgkd6rN?XaWC1R3s?_mhJQ1sVxCzAxdC

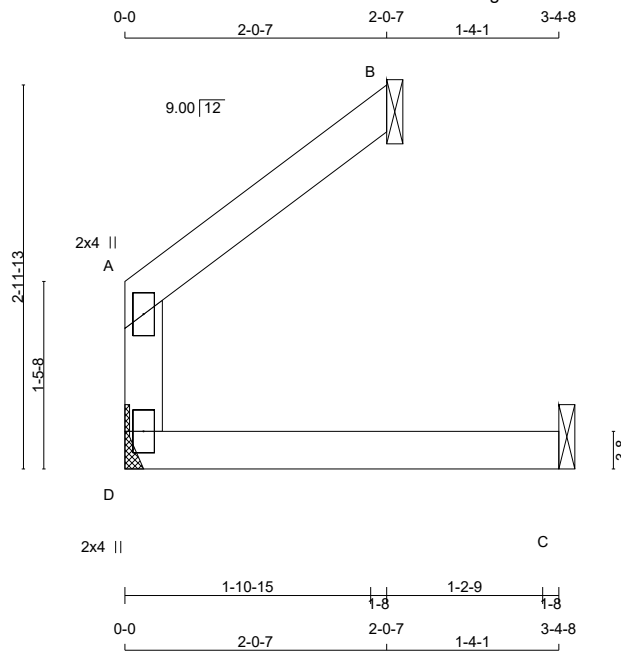

Scale = 1:17.9

TOTAL WEIGHT = 2 X 8 = 16 lb [M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
D	109	0	109	0	0	MECHANICAL		
B	78	0	78	0	0	1-8	1-8	
C	30	0	30	0	0	1-8	1-8	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
D	77	49/0	0/0	0/0	0/0	0/0	28/0
B	53	44/0	0/0	0/0	0/0	0/0	9/0
C	24	2/0	0/0	0/0	0/0	0/0	22/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
D-A	-80/0	0.0	0.0 0.02 (4)	D-A	7.81		
A-B	0/3	-77.4	-77.4 0.05 (1)	A-B	10.00		
D-C	0/0	-17.5	-17.5 0.05 (4)	D-C	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.05/1.00 (A-B:1) , BC=0.05/1.00 (C-D:4) , WB=0.00/1.00 (n/a:0) , SSI=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.05 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





TOTAL WEIGHT = $2 \times 10 = 20$ lb

N. L. G. A. RULES

DRY: SEASONED LUMBER.

PLATES (table is in inches)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX. FACTORED REACTIONS.

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

WEBS

MAX. FACTORED

DESIGN CRITERIA

SPECIFIED LOADS:

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9. NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.06/1.00 (C-D:1), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (A) (INPUT = 0.90)
JSI METAL= 0.04 (A) (INPUT = 1.00)

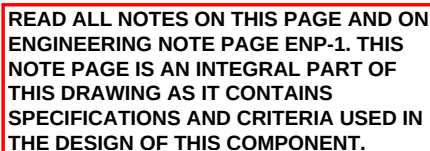

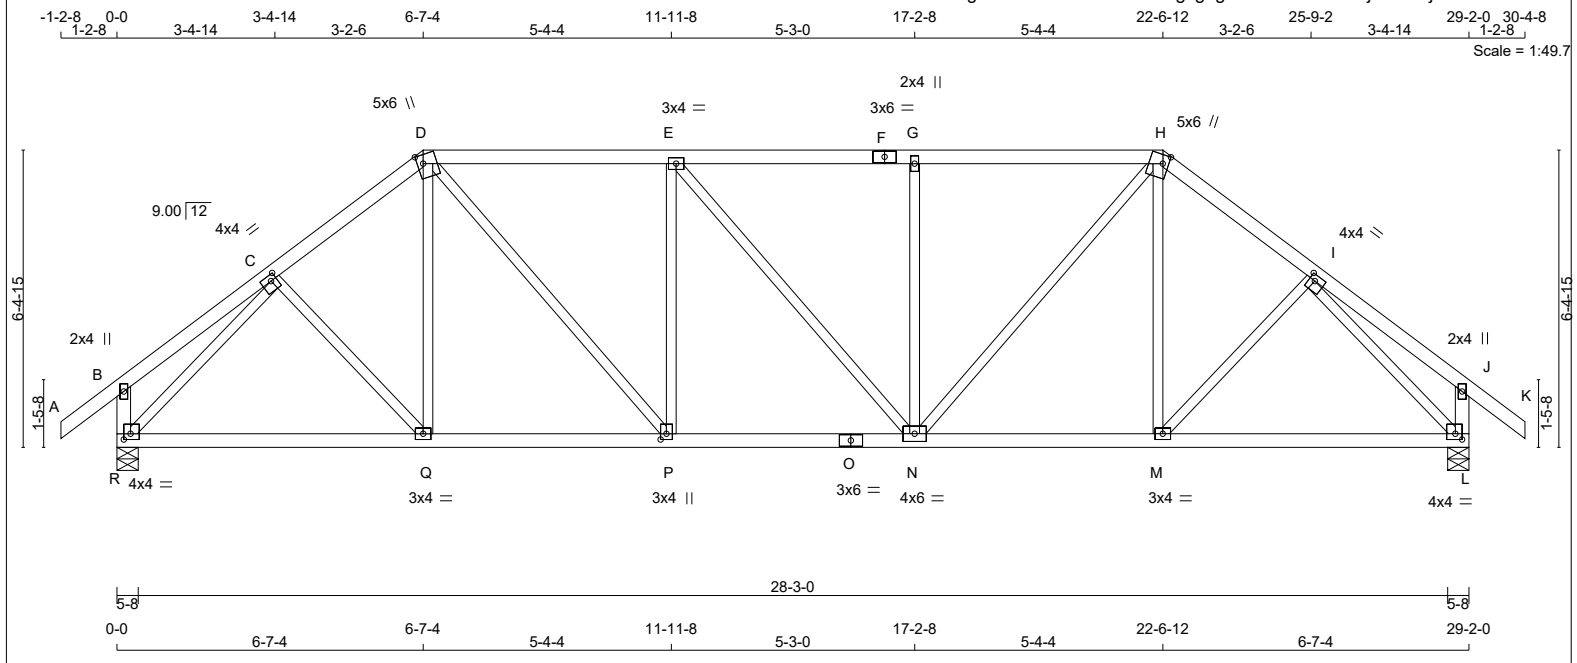

TOTAL WEIGHT = 2 X 129 = 258 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
C	TMWW-t	MT20	4.0	4.0	1.50 1.50
D	TTVW+m	MT20	5.0	6.0	2.25 1.50
E	TMWW-t	MT20	3.0	4.0	
F	TS-t	MT20	3.0	6.0	
G	TMW+w	MT20	2.0	4.0	
H	TTVW+m	MT20	5.0	6.0	2.25 1.50
I	TMWW-t	MT20	4.0	4.0	1.50 1.50
J	TMV+p	MT20	2.0	4.0	
L	BMVW1-t	MT20	4.0	4.0	1.50 1.75
M	BMVW1-t	MT20	3.0	4.0	
N	BMVW1-t	MT20	4.0	6.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW1-t	MT20	3.0	4.0	1.50 1.50
Q	BMVW1-t	MT20	3.0	4.0	
R	BMVW1-t	MT20	4.0	4.0	1.50 1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
R	1484	0	1484	0	0	5-8	5-8	5-8	5-8
L	1484	0	1484	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
L	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.79 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	C-Q	0 / 60	0.02 (4)	
B-C	0 / 16	-77.4 -77.4 0.12 (1)	10.00	Q-D	0 / 94	0.03 (4)	
C-D	-1481 / 0	-77.4 -77.4 0.15 (1)	5.24	D-P	0 / 703	0.16 (1)	
D-E	-1634 / 0	-77.4 -77.4 0.36 (1)	4.79	P-E	-443 / 0	0.29 (1)	
E-F	-1633 / 0	-77.4 -77.4 0.35 (1)	4.79	E-N	-2 / 0	0.00 (1)	
F-G	-1633 / 0	-77.4 -77.4 0.35 (1)	4.79	N-G	-443 / 0	0.29 (1)	
G-H	-1633 / 0	-77.4 -77.4 0.35 (1)	4.80	N-H	0 / 701	0.16 (1)	
H-I	-1481 / 0	-77.4 -77.4 0.15 (1)	5.24	M-H	0 / 94	0.03 (4)	
I-J	0 / 16	-77.4 -77.4 0.12 (1)	10.00	M-I	0 / 60	0.02 (4)	
J-K	0 / 30	-77.4 -77.4 0.09 (1)	10.00	R-C	-1672 / 0	0.63 (1)	
R-B	-201 / 0	0.0 0.0 0.02 (1)	7.81	I-L	-1672 / 0	0.63 (1)	
L-J	-201 / 0	0.0 0.0 0.02 (1)	7.81				
R-Q	0 / 1128	-17.5 -17.5 0.27 (1)	10.00				
Q-P	0 / 1170	-17.5 -17.5 0.28 (1)	10.00				
P-O	0 / 1634	-17.5 -17.5 0.31 (1)	10.00				
O-N	0 / 1634	-17.5 -17.5 0.31 (1)	10.00				
N-M	0 / 1171	-17.5 -17.5 0.28 (1)	10.00				
M-L	0 / 1128	-17.5 -17.5 0.28 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.13")

CSI: TC=0.36/1.00 (D-E:1), BC=0.31/1.00 (N-P:1), WB=0.63/1.00 (L-L:1), SSI=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.62 (I) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



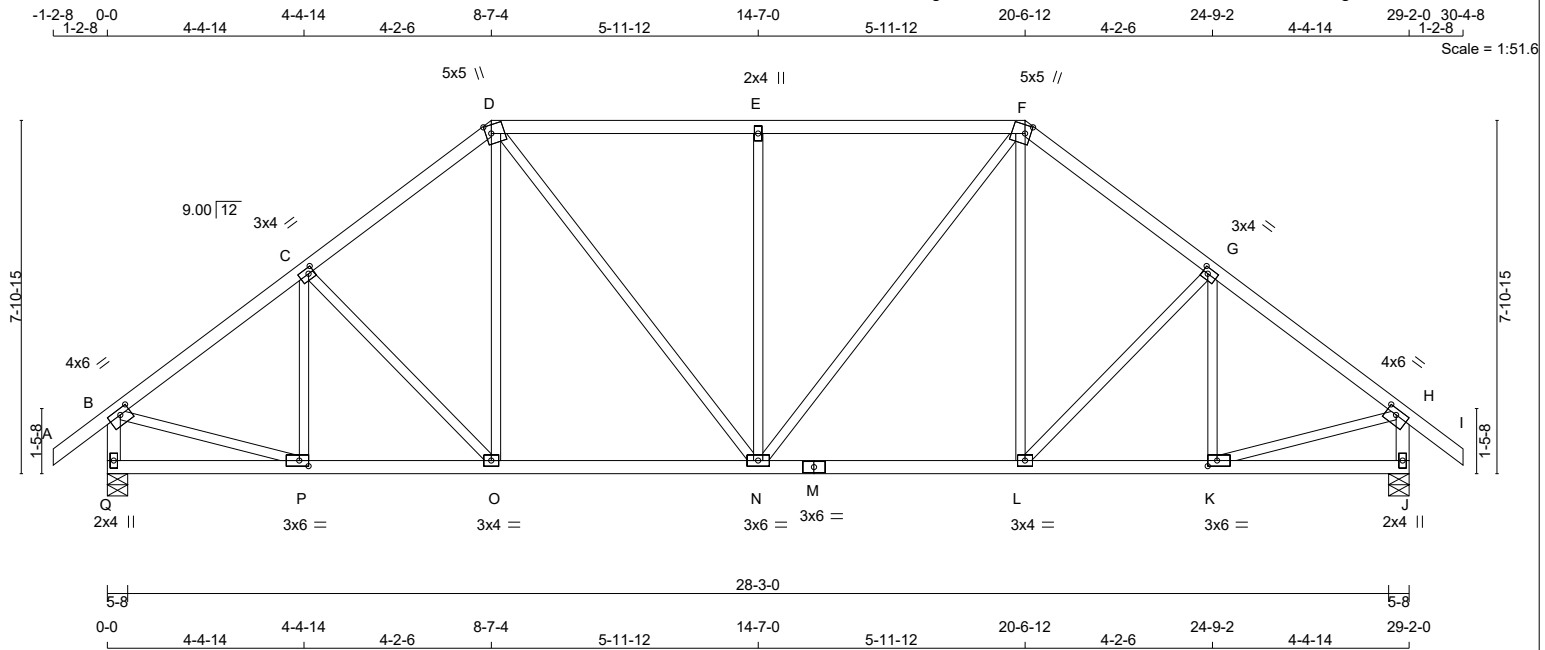

TOTAL WEIGHT = 2 X 134 = 268 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.50	2.75
C	CTMWW-t	MT20	3.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	5.0	2.25	1.50
G	TMWW-t	MT20	3.0	4.0	1.50	1.50
H	TMVW-t	MT20	4.0	6.0	1.50	2.75
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	3.0	6.0	1.50	2.50
L	BMWW-t	MT20	3.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWWWW-t	MT20	3.0	6.0		
O	BMWW-t	MT20	3.0	4.0		
P	BMWW-t	MT20	3.0	6.0	1.50	2.50
Q	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG
Q	1484	0	1484	0	0	5-8	5-8		
J	1484	0	1484	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 30	-77.4 -77.4 0.09 (1)	10.00	P-C	-235 / 0	0.08 (1)	
B-C	-1488 / 0	-77.4 -77.4 0.21 (1)	5.18	C-O	-146 / 0	0.10 (1)	
C-D	-1411 / 0	-77.4 -77.4 0.20 (1)	5.29	O-D	0 / 197	0.04 (1)	
D-E	-1374 / 0	-77.4 -77.4 0.38 (1)	5.10	D-N	0 / 427	0.10 (1)	
E-F	-1374 / 0	-77.4 -77.4 0.38 (1)	5.10	N-E	-566 / 0	0.67 (1)	
F-G	-1411 / 0	-77.4 -77.4 0.20 (1)	5.29	N-F	0 / 427	0.10 (1)	
G-H	-1488 / 0	-77.4 -77.4 0.21 (1)	5.18	L-F	0 / 197	0.04 (1)	
H-I	0 / 30	-77.4 -77.4 0.09 (1)	10.00	L-G	-146 / 0	0.10 (1)	
Q-B	-1449 / 0	0.0 0.0 0.15 (1)	6.79	K-G	-235 / 0	0.08 (1)	
J-H	-1449 / 0	0.0 0.0 0.15 (1)	6.79	B-P	0 / 1248	0.28 (1)	
				K-H	0 / 1248	0.28 (1)	
Q-P	0 / 0	-17.5 -17.5 0.07 (4)	10.00				
P-O	0 / 1209	-17.5 -17.5 0.25 (1)	10.00				
O-N	0 / 1110	-17.5 -17.5 0.24 (1)	10.00				
N-M	0 / 1110	-17.5 -17.5 0.24 (1)	10.00				
M-L	0 / 1110	-17.5 -17.5 0.24 (1)	10.00				
L-K	0 / 1209	-17.5 -17.5 0.25 (1)	10.00				
K-J	0 / 0	-17.5 -17.5 0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.38/1.00 (D-E:1), BC=0.25/1.00 (O-P:1), WB=0.67/1.00 (E-N:1), SSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (N) (INPUT = 0.90)
JSI METAL= 0.41 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



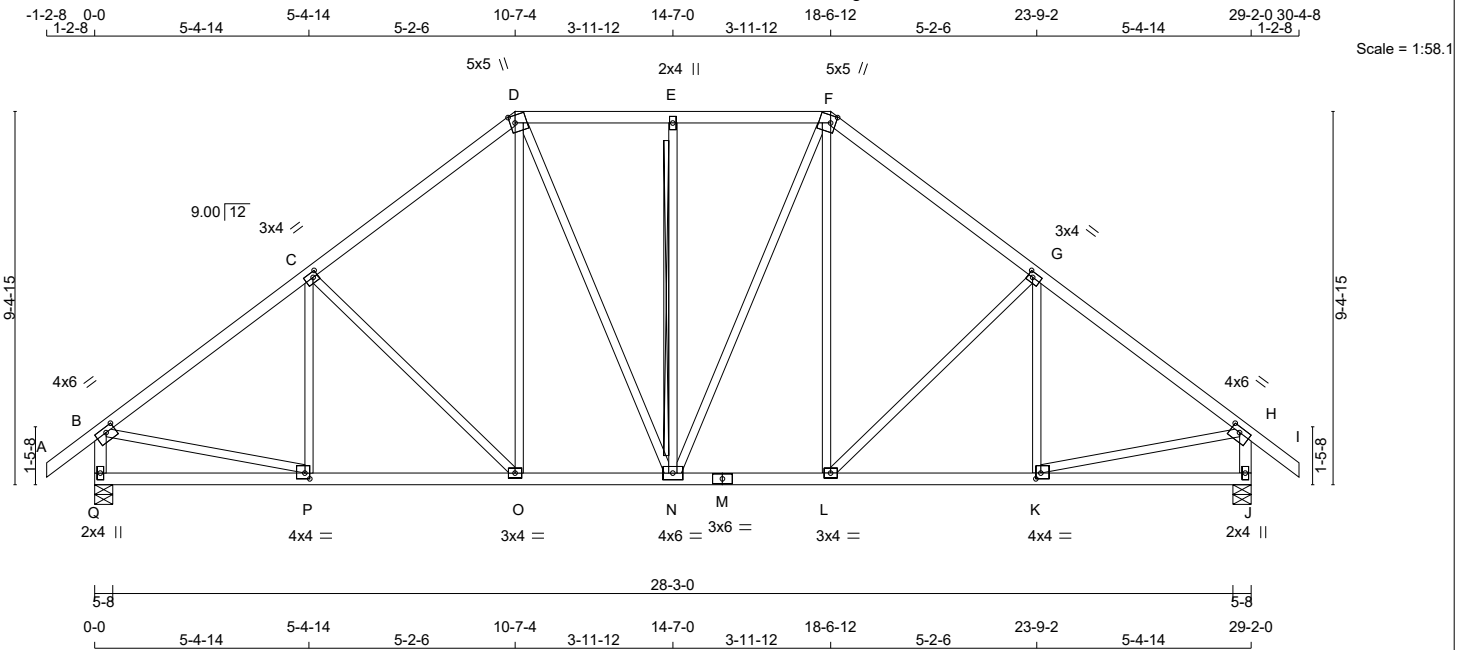

TOTAL WEIGHT = 144 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	6.0	1.50 2.75
C	TMWW-t	MT20	3.0	4.0	1.50 1.50
D	TTWW+m	MT20	5.0	5.0	2.25 1.50
E	TMW+w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	5.0	2.25 1.50
G	TMWW-t	MT20	3.0	4.0	1.50 1.50
H	TMVW-t	MT20	4.0	6.0	1.50 2.75
J	BMV1+p	MT20	2.0	4.0	
K	BMWW-t	MT20	4.0	4.0	1.75 1.50
L	BMWW-t	MT20	3.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMWWW-t	MT20	4.0	6.0	
O	BMWW-t	MT20	3.0	4.0	
P	BMWW-t	MT20	4.0	4.0	1.75 1.50
Q	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1484	0	1484	0	5-8
J	1484	0	1484	0	5-8

UNFACTORED REACTIONS						
JT	COMBINED	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND
Q	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0
J	1039	740 / 0	0 / 0	0 / 0	0 / 0	299 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.01 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT E-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.
FR-TO		FROM TO	CSI (LC)	FR-TO		FROM TO	CSI (LC)
A-B	0 / 30	-77.4 -77.4	0.09 (1)	10.00	P-C	-154 / 45	0.07 (1)
B-C	-1513 / 0	-77.4 -77.4	0.32 (1)	5.01	C-O	-290 / 0	0.31 (1)
C-D	-1315 / 0	-77.4 -77.4	0.31 (1)	5.30	O-D	0 / 284	0.06 (1)
D-E	-1123 / 0	-77.4 -77.4	0.16 (1)	5.82	D-N	0 / 234	0.05 (1)
E-F	-1123 / 0	-77.4 -77.4	0.16 (1)	5.82	N-E	-368 / 0	0.24 (1)
F-G	-1315 / 0	-77.4 -77.4	0.31 (1)	5.30	N-F	0 / 234	0.05 (1)
G-H	-1513 / 0	-77.4 -77.4	0.32 (1)	5.01	L-F	0 / 284	0.06 (1)
H-I	0 / 30	-77.4 -77.4	0.09 (1)	10.00	L-G	-290 / 0	0.31 (1)
Q-B	-1444 / 0	0.0 0.0	0.15 (1)	6.80	K-G	-154 / 45	0.07 (1)
J-H	-1444 / 0	0.0 0.0	0.15 (1)	6.80	B-P	0 / 1260	0.28 (1)
					K-H	0 / 1260	0.28 (1)
Q-P	0 / 0	-17.5 -17.5	0.12 (4)	10.00			
P-O	0 / 1234	-17.5 -17.5	0.26 (1)	10.00			
O-N	0 / 1030	-17.5 -17.5	0.21 (1)	10.00			
N-M	0 / 1030	-17.5 -17.5	0.21 (1)	10.00			
M-L	0 / 1030	-17.5 -17.5	0.21 (1)	10.00			
L-K	0 / 1234	-17.5 -17.5	0.26 (1)	10.00			
K-J	0 / 0	-17.5 -17.5	0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.32/1.00 (G-H:1), BC=0.26/1.00 (K-L:1), WB=0.31/1.00 (G-L:1), SSI=0.16/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (P) (INPUT = 0.90)
JSI METAL= 0.46 (P) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



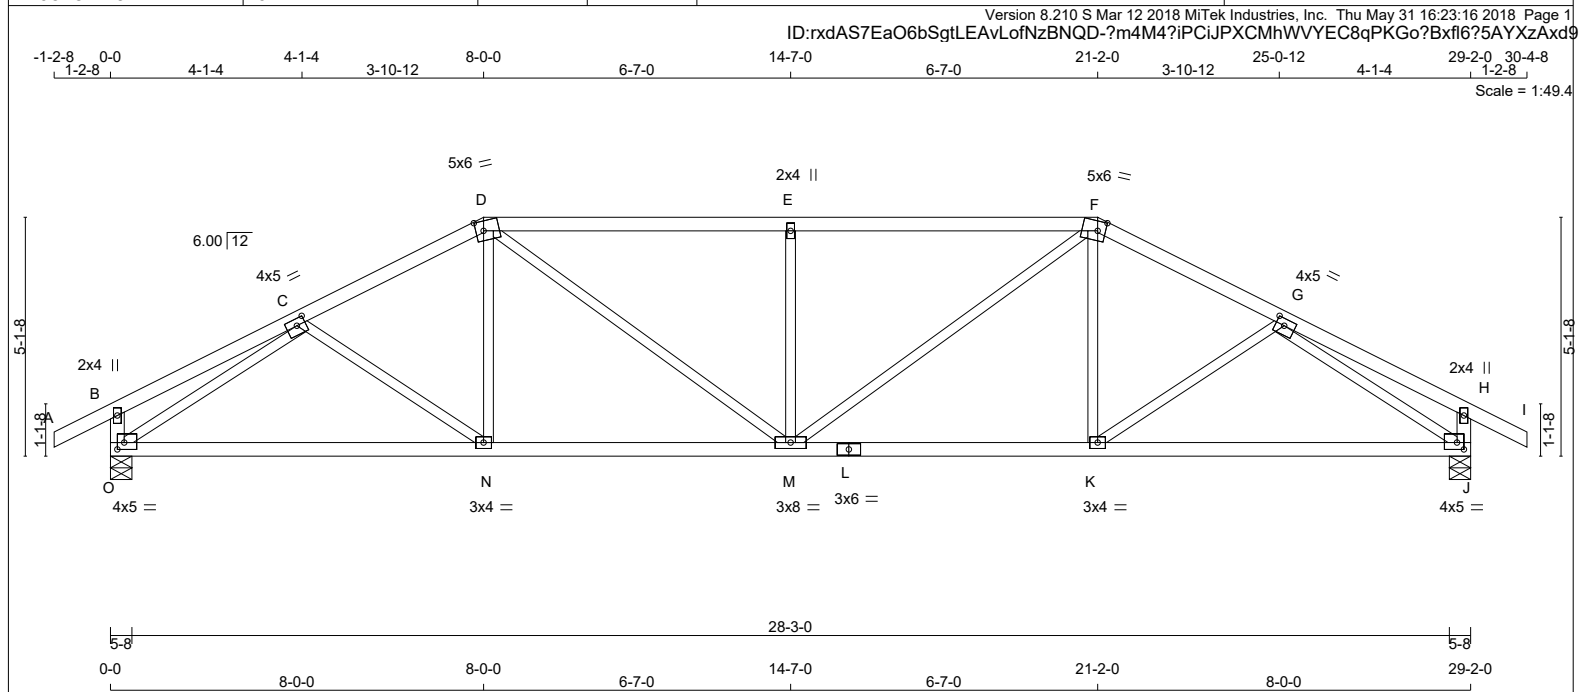

LUMBER N. L. G. A. RULES					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA			
CHORDS SIZE LUMBER DESCR.					BEARINGS										SPECIFIED LOADS:			
					FACTORED		MAXIMUM FACTORED		INPUT		REQRD		TOP CH. LL = 23.3 PSF					
A - D 2x4 DRY No.2 SPF					GROSS REACTION		GROSS REACTION		BRG		BRG		DL = 3.0 PSF					
D - F 2x4 DRY No.2 SPF					JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BOT CH. LL = 0.0 PSF					
F - I 2x4 DRY No.2 SPF					O	1482	0	1482	0	0	5-8	5-8	DL = 7.0 PSF					
O - B 2x4 DRY No.2 SPF					J	1482	0	1482	0	0	5-8	5-8	TOTAL LOAD = 33.3 PSF					
J - H 2x4 DRY No.2 SPF																		
O - L 2x4 DRY No.2 SPF																		
L - J 2x4 DRY No.2 SPF																		
ALL WEBS 2x3 DRY No.2 SPF					UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C			
EXCEPT					1ST LCASE MAX./MIN. COMPONENT REACTIONS										LOADING IN FLAT SECTION BASED ON A			
					JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	SLOPE OF 2.00/12 MINIMUM					
					O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0						
DRY: SEASONED LUMBER.					J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0						

PLATES (table is in inches)		W	LEN	Y	X
JT	TYPE	PLATES			
B	TMV+p	MT20	2.0	4.0	
C	TMWW-t	MT20	4.0	5.0	1.75
D	TTWW-m	MT20	5.0	6.0	2.50
E	TMW+w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.50
G	TMWW-t	MT20	4.0	5.0	1.75
H	TMV+p	MT20	2.0	4.0	
J	BMVW-t	MT20	4.0	5.0	1.75
K	BMWW-t	MT20	3.0	4.0	
L	BS-t	MT20	3.0	6.0	
M	BMWWW-t	MT20	3.0	8.0	
N	BMWW-t	MT20	3.0	4.0	
O	BMVW-t	MT20	4.0	5.0	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
O	1482	0	1482	0	0	5-8	5-8
J	1482	0	1482	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally Restrained.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD L1	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00	C-N	-29 / 57	0.02 (4)	
B-C	0 / 14	-77.4	-77.4	0.17 (1)	10.00	N-D	0 / 169	0.05 (4)	
C-D	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	D-M	0 / 605	0.14 (1)	
D-E	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-E	-626 / 0	0.24 (1)	
E-F	-2175 / 0	-77.4	-77.4	0.52 (1)	4.09	M-F	0 / 605	0.14 (1)	
F-G	-1898 / 0	-77.4	-77.4	0.18 (1)	4.74	K-F	0 / 169	0.05 (4)	
G-H	0 / 14	-77.4	-77.4	0.17 (1)	10.00	K-G	-29 / 57	0.02 (4)	
H-I	0 / 22	-77.4	-77.4	0.09 (1)	10.00	O-C	-2088 / 0	0.82 (1)	
O-B	-223 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-2088 / 0	0.82 (1)	
J-H	-223 / 0	0.0	0.0	0.02 (1)	7.81				
O-N	0 / 1708	-17.5	-17.5	0.41 (1)	10.00				
N-M	0 / 1688	-17.5	-17.5	0.41 (1)	10.00				
M-L	0 / 1688	-17.5	-17.5	0.41 (1)	10.00				
L-K	0 / 1688	-17.5	-17.5	0.41 (1)	10.00				
K-J	0 / 1708	-17.5	-17.5	0.41 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F.
RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED
ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.52/1.00 (D-E:1), BC=0.41/1.00 (D-E:1),
WB=0.82/1.00 (C-O:1), SFI=0.25/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (F) (INPUT = 0.90)

JSI METAL= 0.61 (C) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



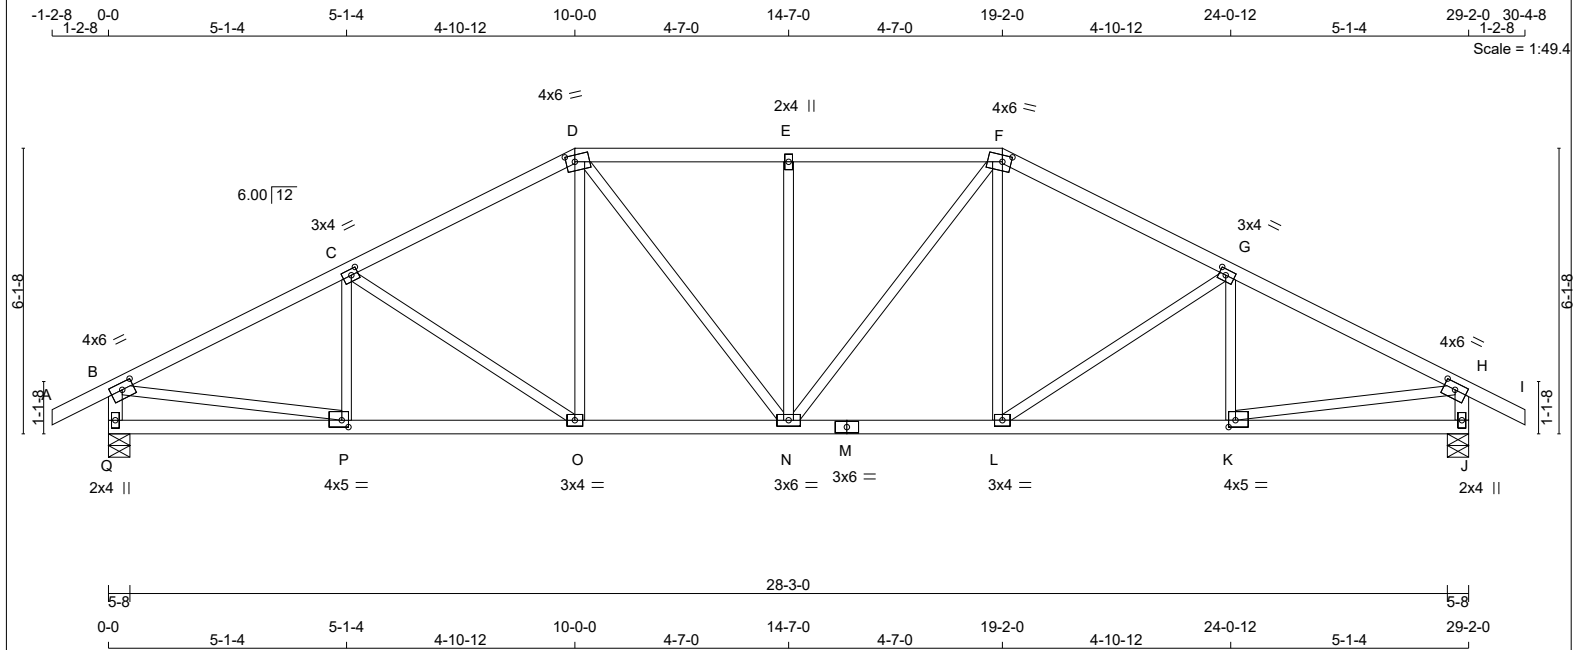

TOTAL WEIGHT = 121 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TMWW-t	MT20	3.0	4.0	1.50	1.75
D	TTWW-m	MT20	4.0	6.0	1.75	2.25
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	4.0	6.0	1.75	2.25
G	TMWW-t	MT20	3.0	4.0	1.50	1.75
H	TMVW-t	MT20	4.0	6.0	1.75	3.00
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	5.0	1.75	1.75
L	BMWW-t	MT20	3.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWWW-t	MT20	3.0	6.0		
O	BMWW-t	MT20	3.0	4.0		
P	BMWW-t	MT20	4.0	5.0	1.75	1.75
Q	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1482	0	1482	0	0	5-8	5-8
J	1482	0	1482	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
J	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 22	-77.4 -77.4	0.09 (1)	10.00	P-C	-197 / 26	0.04 (1)
B-C	-1995 / 0	-77.4 -77.4	0.30 (1)	4.52	C-O	-288 / 0	0.18 (1)
C-D	-1769 / 0	-77.4 -77.4	0.28 (1)	4.76	O-D	0 / 249	0.06 (1)
D-E	-1765 / 0	-77.4 -77.4	0.24 (1)	4.80	D-N	0 / 319	0.07 (1)
E-F	-1765 / 0	-77.4 -77.4	0.24 (1)	4.80	N-E	-430 / 0	0.25 (1)
F-G	-1769 / 0	-77.4 -77.4	0.28 (1)	4.76	N-F	0 / 319	0.07 (1)
G-H	-1995 / 0	-77.4 -77.4	0.30 (1)	4.52	L-F	0 / 249	0.06 (1)
H-I	0 / 22	-77.4 -77.4	0.09 (1)	10.00	L-G	-288 / 0	0.18 (1)
Q-B	-1442 / 0	0.0 0.0	0.15 (1)	6.81	K-G	-197 / 26	0.04 (1)
J-H	-1442 / 0	0.0 0.0	0.15 (1)	6.81	B-P	0 / 1825	0.41 (1)
					K-H	0 / 1825	0.41 (1)
Q-P	0 / 0	-17.5 -17.5	0.10 (4)	10.00			
P-O	0 / 1802	-17.5 -17.5	0.34 (1)	10.00			
O-N	0 / 1567	-17.5 -17.5	0.30 (1)	10.00			
N-M	0 / 1567	-17.5 -17.5	0.30 (1)	10.00			
M-L	0 / 1567	-17.5 -17.5	0.30 (1)	10.00			
L-K	0 / 1802	-17.5 -17.5	0.34 (1)	10.00			
K-J	0 / 0	-17.5 -17.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.99")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")

CSI: TC=0.30/1.00 (B-C:1), BC=0.34/1.00 (O-P:1), WB=0.41/1.00 (B-P:1), SSI=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.54 (K) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



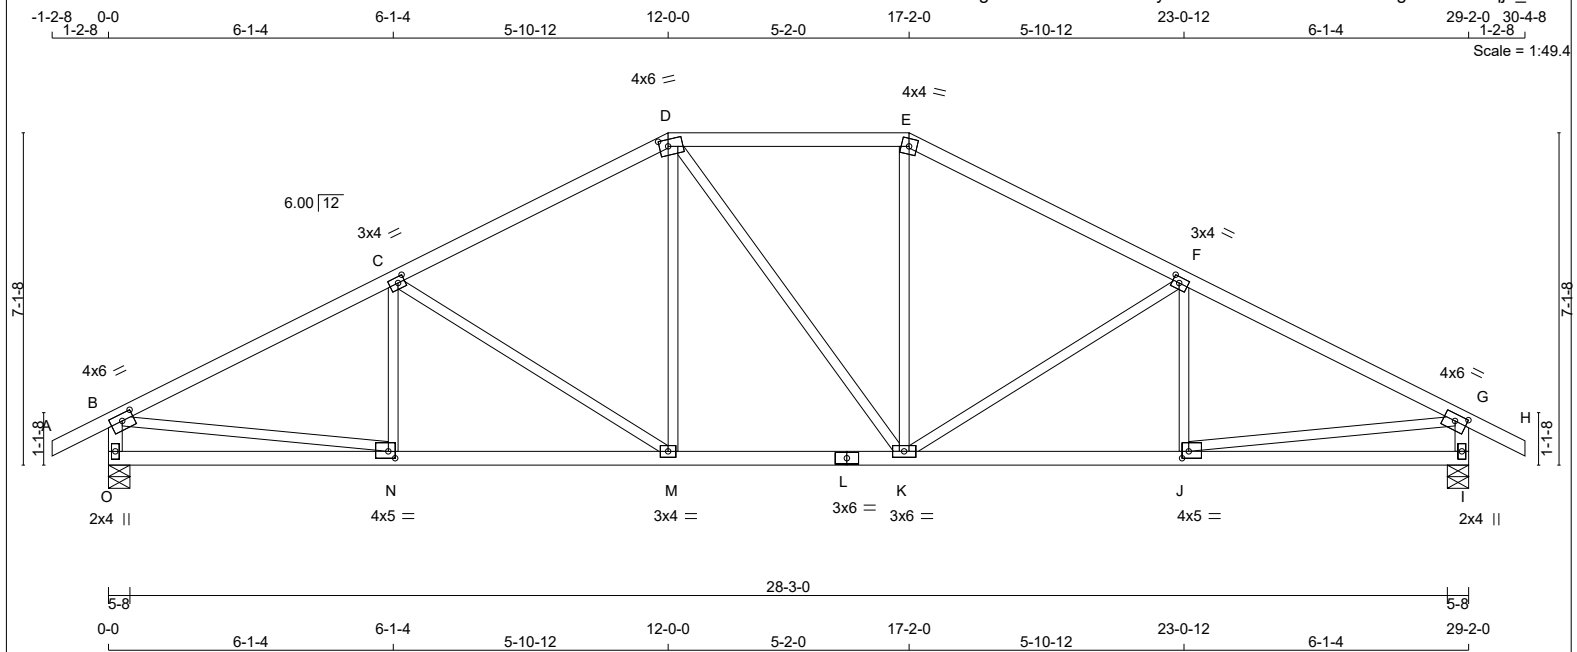

TOTAL WEIGHT = 118 lb
[M][F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TMWW-t	MT20	3.0	4.0	1.50	1.75
D	TTWW-m	MT20	4.0	6.0	1.75	2.25
E	TTW-m	MT20	4.0	4.0		
F	TMWW-t	MT20	3.0	4.0	1.50	1.75
G	TMVW-t	MT20	4.0	6.0	1.75	3.00
I	BMV1+p	MT20	2.0	4.0		
J	BMWW-t	MT20	4.0	5.0	1.75	1.75
K	BMWWW-t	MT20	3.0	6.0		
L	BS-t	MT20	3.0	6.0		
M	BMWW-t	MT20	3.0	4.0		
N	BMWW-t	MT20	4.0	5.0	1.75	1.75
O	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UP
O	1482	0	1482	0
I	1482	0	1482	0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MAX./MIN. LIVE	MAX./MIN. PERM. LIVE	MAX./MIN. WIND	MAX./MIN. DEAD	MAX./MIN. SOIL
O	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
I	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 22	-77.4	-77.4 0.09 (1)	10.00	N-C	-128 / 64	0.03 (1)
B-C	-2015 / 0	-77.4	-77.4 0.44 (1)	4.34	C-M	-465 / 0	0.46 (1)
C-D	-1628 / 0	-77.4	-77.4 0.40 (1)	4.77	M-D	0 / 346	0.08 (1)
D-E	-1439 / 0	-77.4	-77.4 0.29 (1)	5.13	D-K	0 / 0	0.00 (1)
E-F	-1628 / 0	-77.4	-77.4 0.40 (1)	4.77	K-E	0 / 347	0.08 (1)
F-G	-2015 / 0	-77.4	-77.4 0.44 (1)	4.34	K-F	-464 / 0	0.46 (1)
G-H	0 / 22	-77.4	-77.4 0.09 (1)	10.00	J-F	-129 / 63	0.03 (1)
O-B	-1437 / 0	0.0	0.0 0.14 (1)	6.81	B-N	0 / 1840	0.41 (1)
I-G	-1436 / 0	0.0	0.0 0.14 (1)	6.81	J-G	0 / 1840	0.41 (1)
O-N	0 / 0	-17.5	-17.5 0.15 (4)	10.00			
N-M	0 / 1824	-17.5	-17.5 0.36 (1)	10.00			
M-L	0 / 1438	-17.5	-17.5 0.29 (1)	10.00			
L-K	0 / 1438	-17.5	-17.5 0.29 (1)	10.00			
K-J	0 / 1823	-17.5	-17.5 0.36 (1)	10.00			
J-I	0 / 0	-17.5	-17.5 0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.16")

CSI: TC=0.44/1.00 (B-C:1), BC=0.36/1.00 (M-N:1), WB=0.46/1.00 (C-M:1), SSI=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.55 (N) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



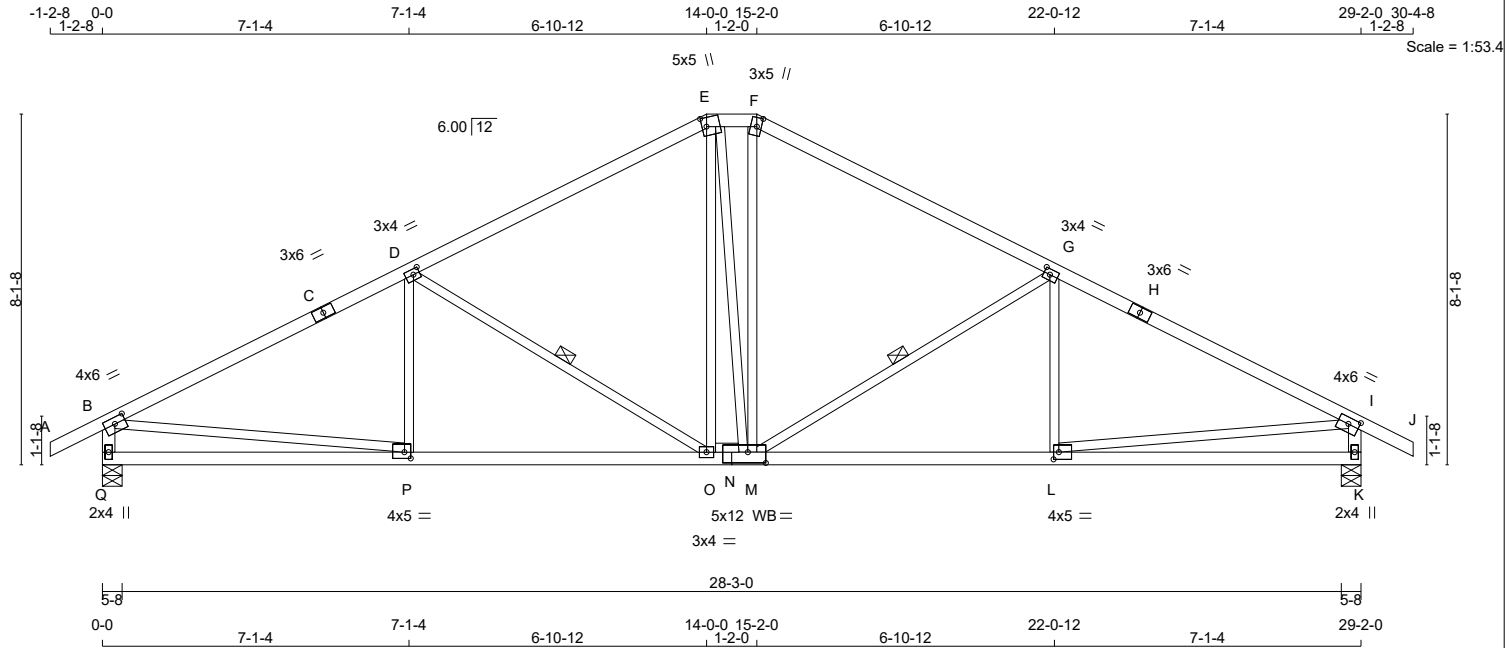

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
K - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TS-t	MT20	3.0	6.0		
D	TMWW-t	MT20	3.0	4.0	1.50	1.75
E	TTWW+m	MT20	5.0	5.0	2.50	1.25
F	TTW+m	MT20	3.0	5.0	2.50	1.25
G	TMWW-t	MT20	3.0	4.0	1.50	1.75
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	6.0	1.75	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMWW-t	MT20	4.0	5.0	2.00	1.50
M						
N	BSWWW-I	MT20	5.0	12.0	3.00	5.00
O	BMWW-t	MT20	3.0	4.0		
P	BMWW-t	MT20	4.0	5.0	1.75	1.75
Q	BMV1+p	MT20	2.0	4.0		

WB - INDICATES BLOCKING REQUIRED



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1482	0	1482	0	5-8	5-8
K	1482	0	1482	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT							
Q	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
K	1038	739 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-O, G-M. DBS = 20-0-0. CBF = 79 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 22	-77.4 -77.4	0.09 (1)	10.00	P-D	-70 / 98	0.03 (4)
B-C	-2011 / 0	-77.4 -77.4	0.62 (1)	4.11	D-O	-633 / 0	0.29 (1)
C-D	-2011 / 0	-77.4 -77.4	0.62 (1)	4.11	O-E	0 / 373	0.08 (1)
D-E	-1470 / 0	-77.4 -77.4	0.54 (1)	4.74	E-M	0 / 27	0.01 (1)
E-F	-1296 / 0	-77.4 -77.4	0.03 (1)	5.66	M-F	0 / 401	0.09 (1)
F-G	-1473 / 0	-77.4 -77.4	0.55 (1)	4.74	M-G	-627 / 0	0.29 (1)
G-H	-2009 / 0	-77.4 -77.4	0.62 (1)	4.11	L-G	-75 / 96	0.03 (4)
H-I	-2009 / 0	-77.4 -77.4	0.62 (1)	4.11	B-P	0 / 1836	0.41 (1)
I-J	0 / 22	-77.4 -77.4	0.09 (1)	10.00	L-I	0 / 1835	0.41 (1)
Q-B	-1431 / 0	0.0 0.0	0.14 (1)	6.82			
K-I	-1430 / 0	0.0 0.0	0.14 (1)	6.82			
Q-P	0 / 0	-17.5 -17.5	0.22 (4)	10.00			
P-O	0 / 1824	-17.5 -17.5	0.40 (1)	10.00			
O-N	0 / 1292	-17.5 -17.5	0.30 (1)	10.00			
N-M	0 / 1292	-17.5 -17.5	0.30 (1)	10.00			
M-L	0 / 1823	-17.5 -17.5	0.39 (1)	10.00			
L-K	0 / 0	-17.5 -17.5	0.21 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	DL	PSF
	23.3	3.0	PSF
BOT CH.	0.0	7.0	PSF
TOTAL LOAD	33.3		PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.62/1.00 (B-D:1), BC=0.40/1.00 (O-P:1), WB=0.41/1.00 (B-P:1), SSI=0.24/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.55 (P) (INPUT = 1.00)



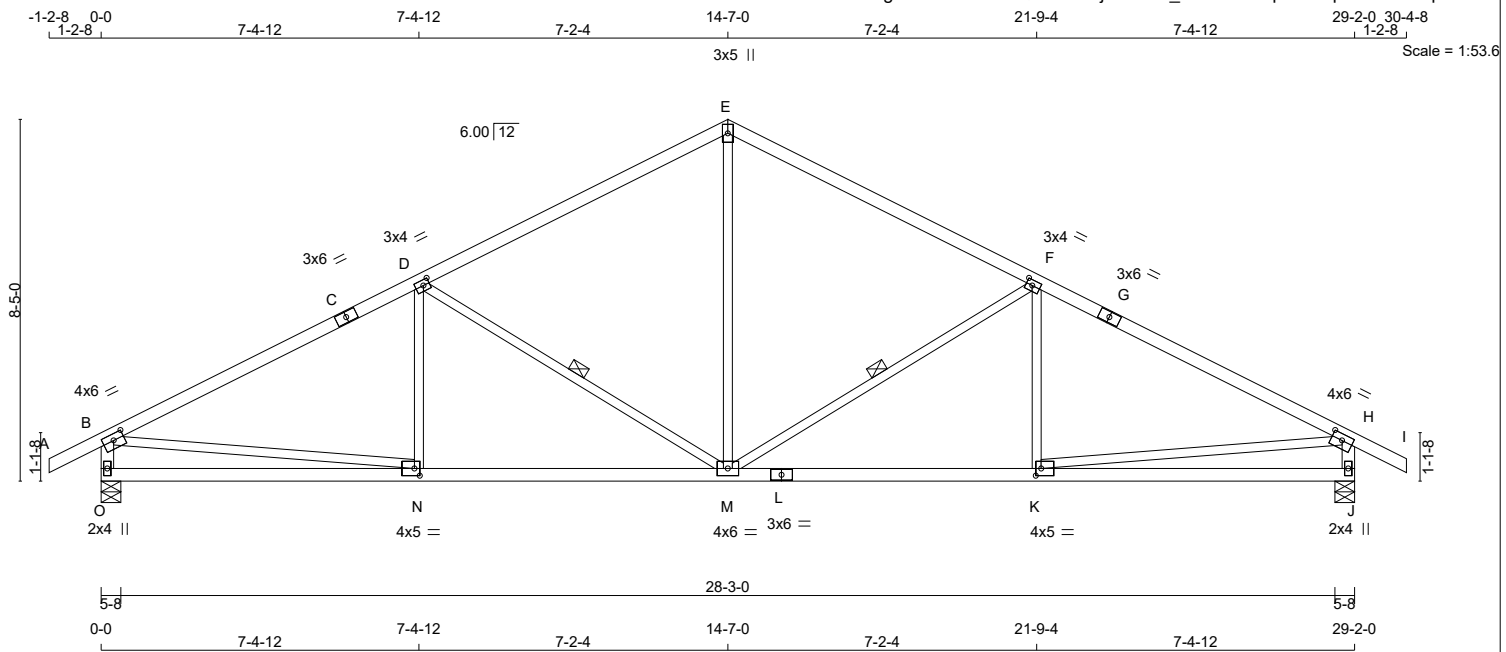

TOTAL WEIGHT = 10 X 113 = 1134 lb

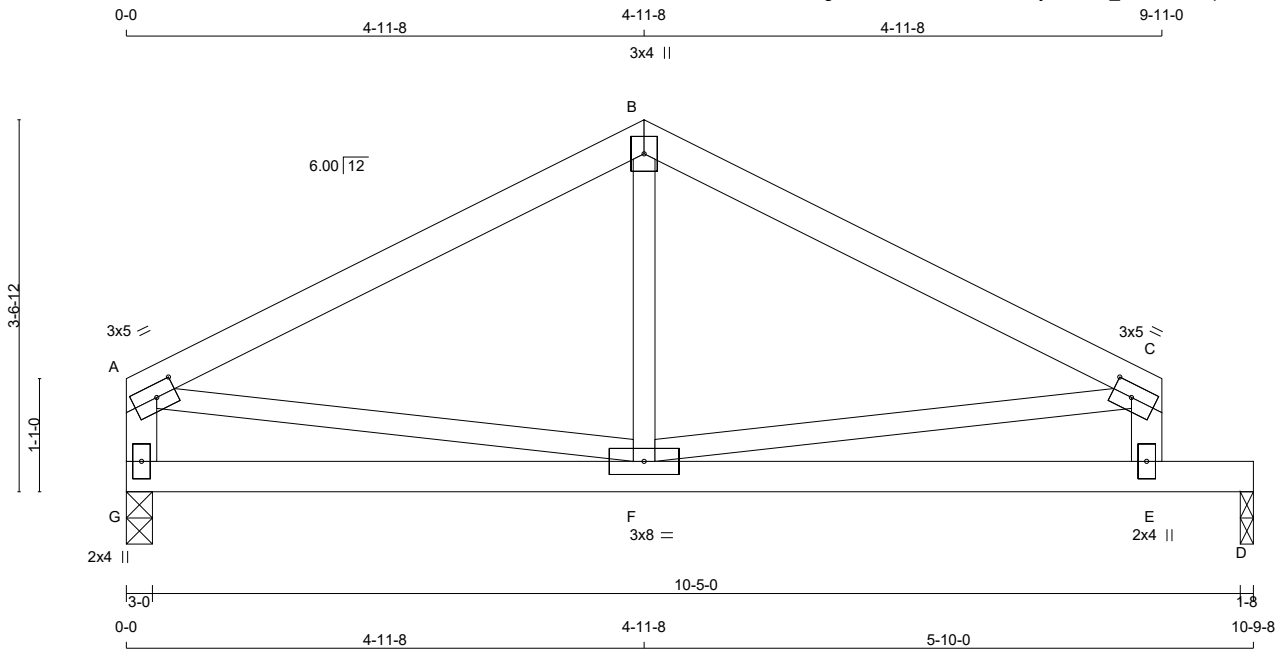

TOTAL WEIGHT = 2 X 37 = 73 lb [M]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
G - A	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
G - D	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	2.25
B	TTW+p	MT20	3.0	4.0		
C	TMVW-t	MT20	3.0	5.0	1.50	2.25
E	BMV+p	MT20	2.0	4.0		
F	BMVW-t	MT20	3.0	8.0		
G	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	UPLIFT	IN-SX
JT				
G	512	0	0	3-0
D	512	0	0	1-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT							
G	359	251 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0
D	359	251 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	-522 / 0	-77.4	-77.4 0.34 (1)	6.25	F-B	0 / 110	0.04 (4)
B-C	-522 / 0	-77.4	-77.4 0.34 (1)	6.25	A-F	0 / 473	0.11 (1)
G-A	-498 / 0	0.0	0.0 0.05 (1)	7.81	F-C	0 / 473	0.11 (1)
E-C	-498 / 0	0.0	0.0 0.05 (1)	7.81			
G-F	0 / 0	-17.5	-17.5 0.20 (1)	10.00			
F-E	0 / 0	-17.5	-17.5 0.56 (1)	10.00			
E-D	0 / 0	-94.9	-94.9 0.56 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.12")
ALLOWABLE DEFL.(TL)= L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/ 575 (0.23")

CSI: TC=0.34/1.00 (B-C:1), BC=0.56/1.00 (E-F:1), WB=0.11/1.00 (A-F:1), SSI=0.40/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.52 (F) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu May 31 16:23:20 2018 Page 1
ID: rxdAS7EaO6bSqtLEAvLofNzBNQD-tXKswMlwGxqr?pfSILdAM_?AYtEb7v8L1d3NhIzAxd5

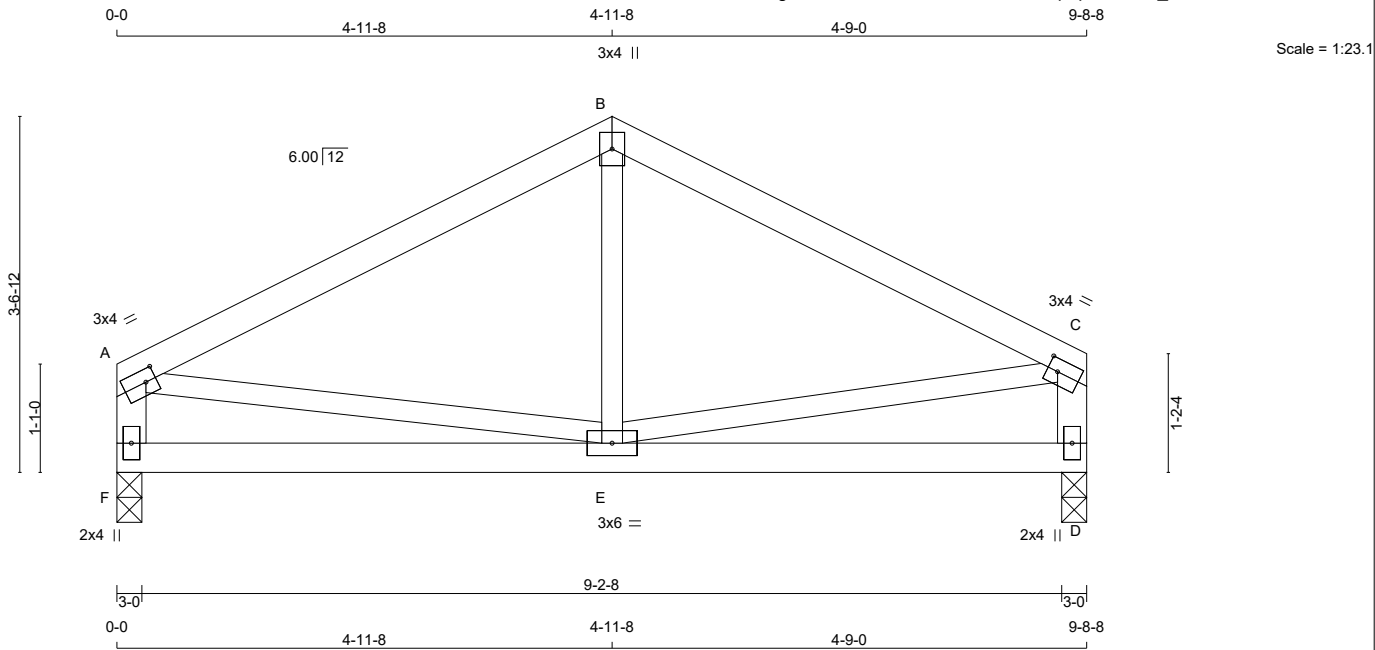

TOTAL WEIGHT = 35 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE		LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	4.0	1.50	1.25
B	TTW+p	MT20	3.0	4.0		
C	TMVW-t	MT20	3.0	4.0	1.50	1.25
D	BMV1+p	MT20	2.0	4.0		
E	BMWWW-t	MT20	3.0	6.0		
F	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	460	0	460	0	0	3-0	3-0
D	460	0	460	0	0	3-0	3-0

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	323	226 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
D	323	226 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	-399 / 0	-77.4	-77.4	0.25 (1)	6.25	E-B	-18 / 78	0.03 (4)	
B-C	-399 / 0	-77.4	-77.4	0.23 (1)	6.25	A-E	0 / 361	0.08 (1)	
F-A	-426 / 0	0.0	0.0	0.04 (1)	7.81	E-C	0 / 363	0.08 (1)	
D-C	-428 / 0	0.0	0.0	0.04 (1)	7.81				
F-E	0 / 0	-17.5	-17.5	0.12 (4)	10.00				
E-D	0 / 0	-17.5	-17.5	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.25/1.00 (A-B:1), BC=0.12/1.00 (D-E:4), WB=0.08/1.00 (C-E:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



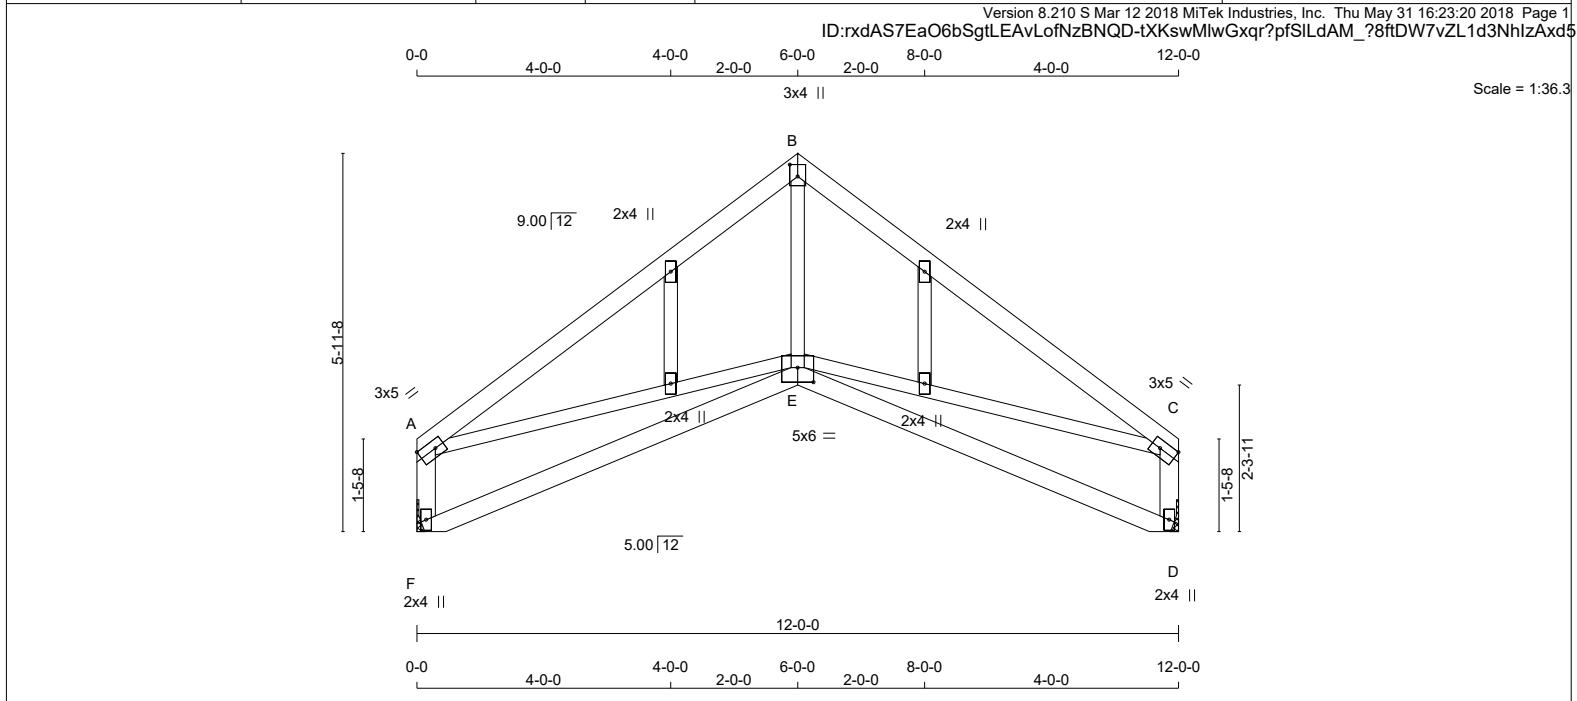

TOTAL WEIGHT = 50 lb [M][F]


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.						
A - B	2x4	DRY	No.2	SPF		
B - C	2x4	DRY	No.2	SPF		
F - A	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		
ALL GABLE WEBS DRY: SEASONED LUMBER.	2x3	DRY	No.2	SPF		
GABLE STUDS SPACED AT 2'-0-0 OC.						
PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTW+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	Edge
D	BMV1+p	MT20	2.0	4.0		
E	BBWW-p	MT20	5.0	6.0	2.75	3.00
F	BMV1+p	MT20	2.0	4.0		
G, H, I, J						
G	NP+w	MT20	2.0	4.0		
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.						

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG					
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX				
F	569	0	569	0	0	MECHANICAL			
D	569	0	569	0	0	MECHANICAL			
A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D TO RESIST THE MAX FACTORED REACTIONS.									
UNFACTORED REACTIONS									
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
F	399	279 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0		
D	399	279 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0		
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



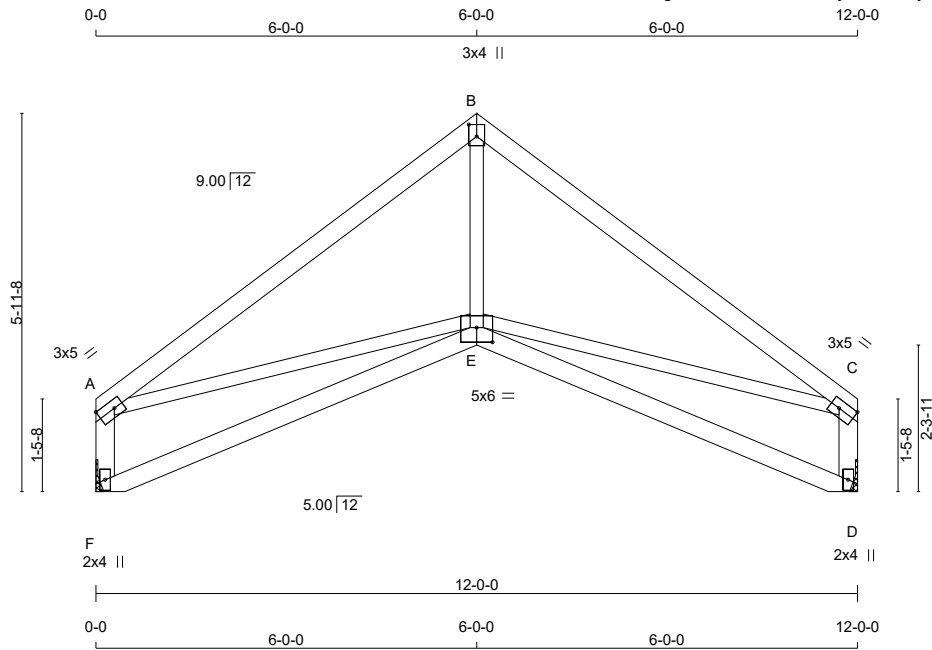

Scale = 1:36.3

TOTAL WEIGHT = 47 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
E - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	Edge
B	TTW+p	MT20	3.0	4.0	2.25	1.50
C	TMVW-t	MT20	3.0	5.0	1.50	Edge
D	BMV1+p	MT20	2.0	4.0		
E	BBWWV-p	MT20	5.0	6.0	2.75	3.00
F	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
F	569 0	569 0	0 0	MECHANICAL	
D	569 0	569 0	0 0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	399	279 / 0	0 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0
D	399	279 / 0	0 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-645 / 0	E-B	0 / 310
B-C	-645 / 0	A-E	0 / 526
F-A	-517 / 0	E-C	0 / 526
D-C	-517 / 0		
F-E	0 / 0		
E-D	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.08")

CSI: TC=0.37/1.00 (A-B:1) , BC=0.18/1.00 (D-E:4) , WB=0.12/1.00 (A-E:1) , SSI=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.73 (C) (INPUT = 0.90)
JSI METAL= 0.24 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



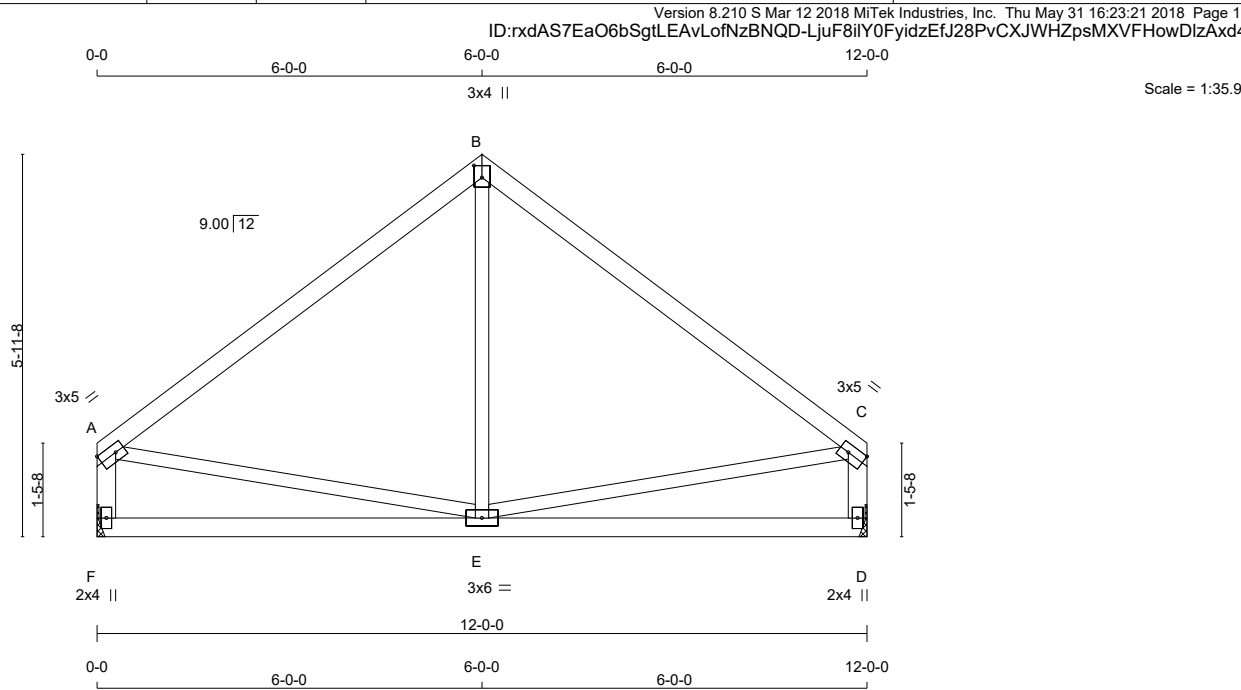

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-t	MT20	3.0	5.0	1.50 Edge
B	TTW+p	MT20	3.0	4.0	2.25 1.50
C	TMVW-t	MT20	3.0	5.0	1.50 Edge
D	BMV1+p	MT20	2.0	4.0	
E	BMVW-t	MT20	3.0	6.0	
F	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP	IN-SX
F	569	0	569	0	MECHANICAL
D	569	0	569	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	399	279 / 0	0 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0
D	399	279 / 0	0 / 0	0 / 0	0 / 0	0 / 0	120 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-396 / 0	-77.4	-77.4 0.36 (1)	E-B	0 / 107	0.04 (4)	
B-C	-396 / 0	-77.4	-77.4 0.36 (1)	A-E	0 / 322	0.07 (1)	
F-A	-529 / 0	0.0	0.0 0.05 (1)	E-C	0 / 322	0.07 (1)	
D-C	-529 / 0	0.0	0.0 0.05 (1)				
F-E	0 / 0	-17.5	-17.5 0.18 (4)				
E-D	0 / 0	-17.5	-17.5 0.18 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.36/1.00 (A-B:1), BC=0.18/1.00 (D-E:4), WB=0.07/1.00 (A-E:1), SSI=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.70 (E) (INPUT = 0.90)
JSI METAL= 0.16 (C) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

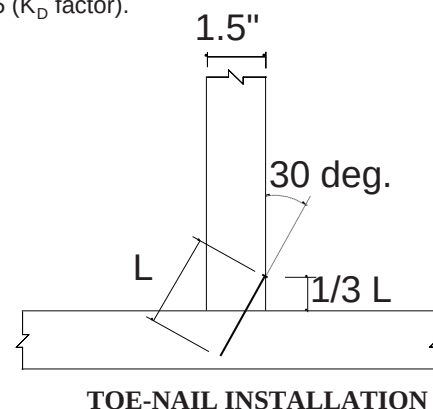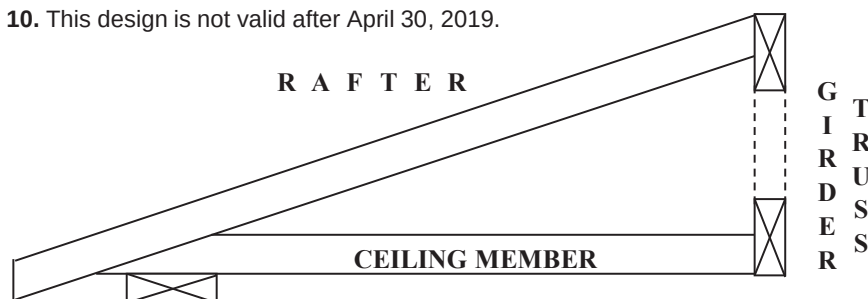

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

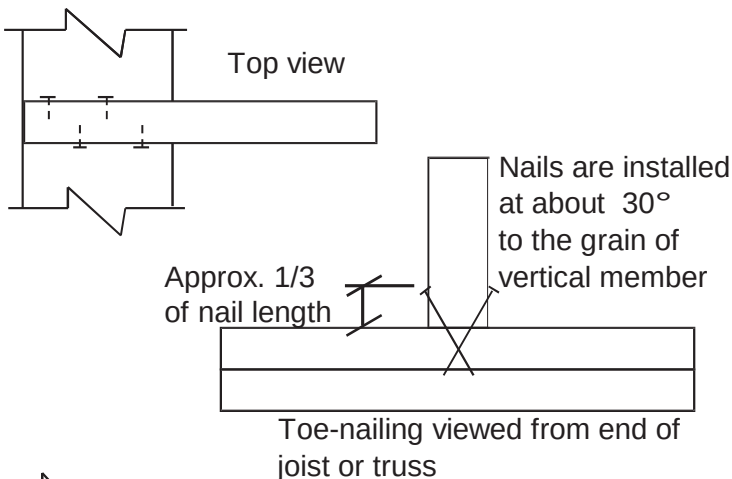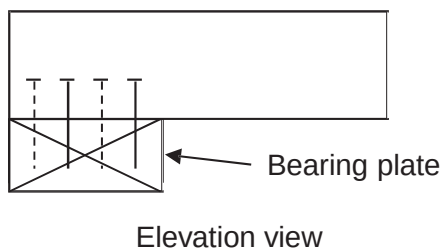

Toe-nailing on 2x4 Bearing Plate

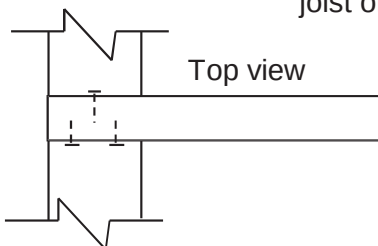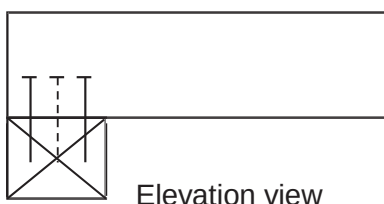

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017