

NE0618-006**GREEN YORK HOMES - GRANELLI
HOME CORP - LIANA 3 ELEV 2****RESPONSIBILITIES**

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

*For conventional framing roof / ceilings
framing shall conform to OBC.9.23*

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS


- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

Layout based on plans provided by
Jardin Design Group Inc.
Revision #2 dated May 22, 2018

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.



ENG.JOB:NE0618-006

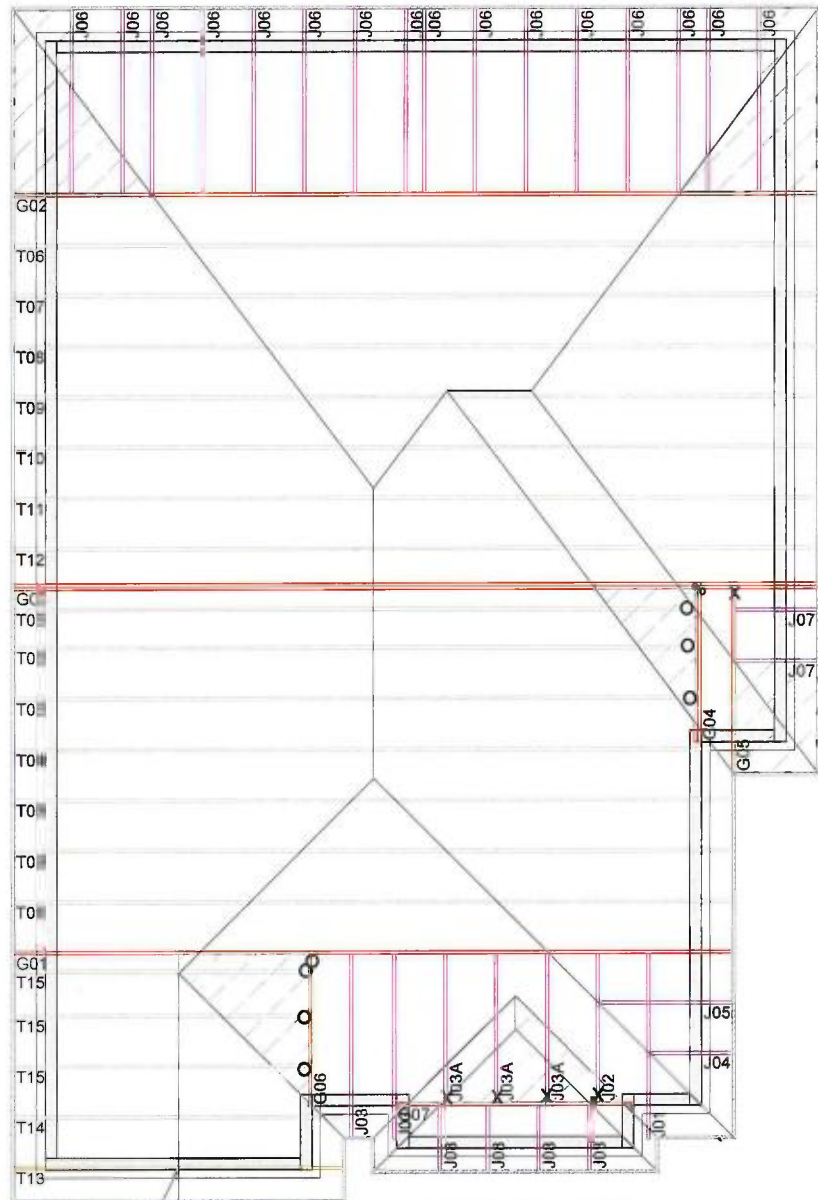


Only front gable truss designed at
10/12 pitch

LOWER ROOF TO BE
CRF AS PER PLAN

All work shall conform to the Ontario
Building Code O. Reg. 332/12 as amended

For conventional framing roof / ceilings
framing shall conform to OBC.9.23

19-447191.000.00 R.R.

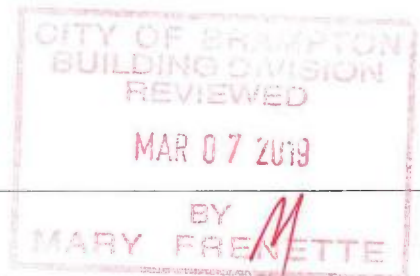

ROOF TRUSS LAYOUT



CONVENTIONAL
FRAMING BY OTHERS

HANGER LEGEND

X - LUS24
- HGUS26

O - LJS26DS
% - HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 psf
DL = 3.0 psf
BOT CH. LL = 0.0 psf
DL = 7.0 psf
TOTAL LOAD = 33.3 psf

SPACING @ 24" CENTERS,
THIS TRUSS SYSTEM IS DESIGN FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBC 2010

THIS DESIGN COMPLIES WITH PART 9 OF OBC 2012,
BCBC 2012, ABC 2012, CSA 086-09, TPIC 2011


ALLOWABLE DEFLECTION OF EACH COMPONENT = L/360

Model:	LIANA 3 ELE 2
Customer:	GREEN YORK HOMES
Project:	GRANELLI HOME
Location:	BRAMPTON, ON
Drawn By:	DM
Date:	5/31/2018

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS
MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C RAFTER THAT
CROSS MEET OVER TRUSSES TO BE 2X4 SPF @ 24" O/C WITH 2X4 VERT POST TO THE
TRUSS BELOW EA CROSS PT. VERT POS. THAN 6' TO HAVE A LATERAL BRACING SO THAT
THE DISTANCE BETEN PT & VERT ROWS OF BRACING DOES NOT EXCEED 6'

Version 8.210 S Mar 12 2018 MITek Industries, Inc. Sat Jun 2 15:02:02 2018 Page 1
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-BzqJ4jxUO_DgnqwjzFV7LpjMGfuXf0?dz94SizAld

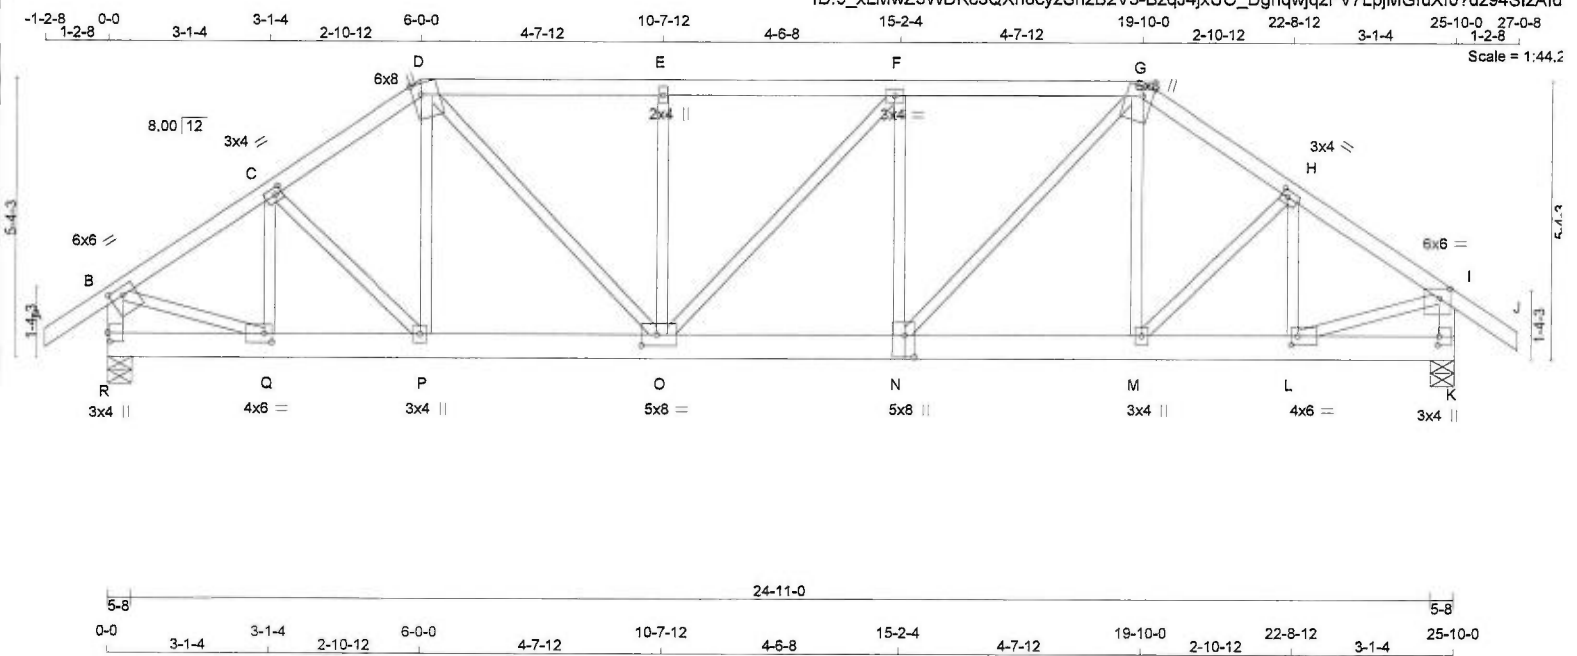

TOTAL WEIGHT = 130 lb [M]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER

A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
R - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
R - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	2248	0	5-8	5-8
K	2499	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LOASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
R	1576	1110 / 0 0 / 0 0 / 0 466 / 0 0 / 0
K	1755	1218 / 0 0 / 0 0 / 0 538 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-77.4 -77.4	0.10 (1)	Q-C	-653 / 0	0.13 (1)	
B-C	-2456 / 0	-77.4 -77.4	0.19 (1)	C-P	0 / 311	0.08 (1)	
C-D	-2749 / 0	-77.4 -77.4	0.21 (1)	P-D	-59 / 30	0.02 (1)	
D-E	-3530 / 0	-77.4 -77.4	0.51 (1)	D-O	0 / 1841	0.46 (1)	
E-F	-3530 / 0	-145.9 -145.9	0.74 (1)	O-E	-509 / 0	0.21 (1)	
F-G	-3457 / 0	-145.9 -145.9	0.74 (1)	C-F	0 / 108	0.03 (1)	
G-H	-3038 / 0	-77.4 -77.4	0.22 (1)	N-F	-838 / 0	0.34 (1)	
H-I	-2737 / 0	-77.4 -77.4	0.21 (1)	N-G	0 / 1383	0.34 (1)	
I-J	0 / 28	-77.4 -77.4	0.10 (1)	M-G	-42 / 113	0.04 (1)	
R-B	-2191 / 0	0.0 0.0	0.24 (1)	M-H	0 / 319	0.08 (1)	
K-I	-2420 / 0	0.0 0.0	0.27 (1)	L-H	-662 / 0	0.14 (1)	
				B-Q	0 / 2145	0.53 (1)	
R-Q	0 / 0	-18.2 -18.2	0.06 (1)	L-I	0 / 2390	0.59 (1)	
Q-P	0 / 2053	-18.2 -18.2	0.33 (1)				
P-O	0 / 2271	-18.2 -18.2	0.36 (1)				
O-N	0 / 3457	-34.4 -34.4	0.54 (1)				
N-M	0 / 2511	-34.4 -34.4	0.37 (1)				
M-L	0 / 2287	-34.4 -34.4	0.35 (1)				
L-K	0 / 0	-34.4 -34.4	0.07 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
G	19-10-0	-348	-348	—	FRONT	VERT	TOTAL
O	10-5-4	-854	-854	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 15-0-0 OF SPAN MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.12")
ALLOWABLE DEFL.(TL)= L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.21")

CSI: TC=0.74/1.00 (E-F:1), BC=0.54/1.00 (N-O:1), WB=0.59/1.00 (I-L:1), SSI=0.35/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 348.1 lbs FACTORED DOWN AT 19-10-0
ON TOP CHORD, AND 854.0 lbs FACTORED
DOWN AT 10-5-4 ON BOTTOM CHORD. DESIGN
FOR UNSPECIFIED CONNECTION(S) IS
DELEGATED TO THE BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (O) (INPUT = 0.90)
JSI METAL= 0.64 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



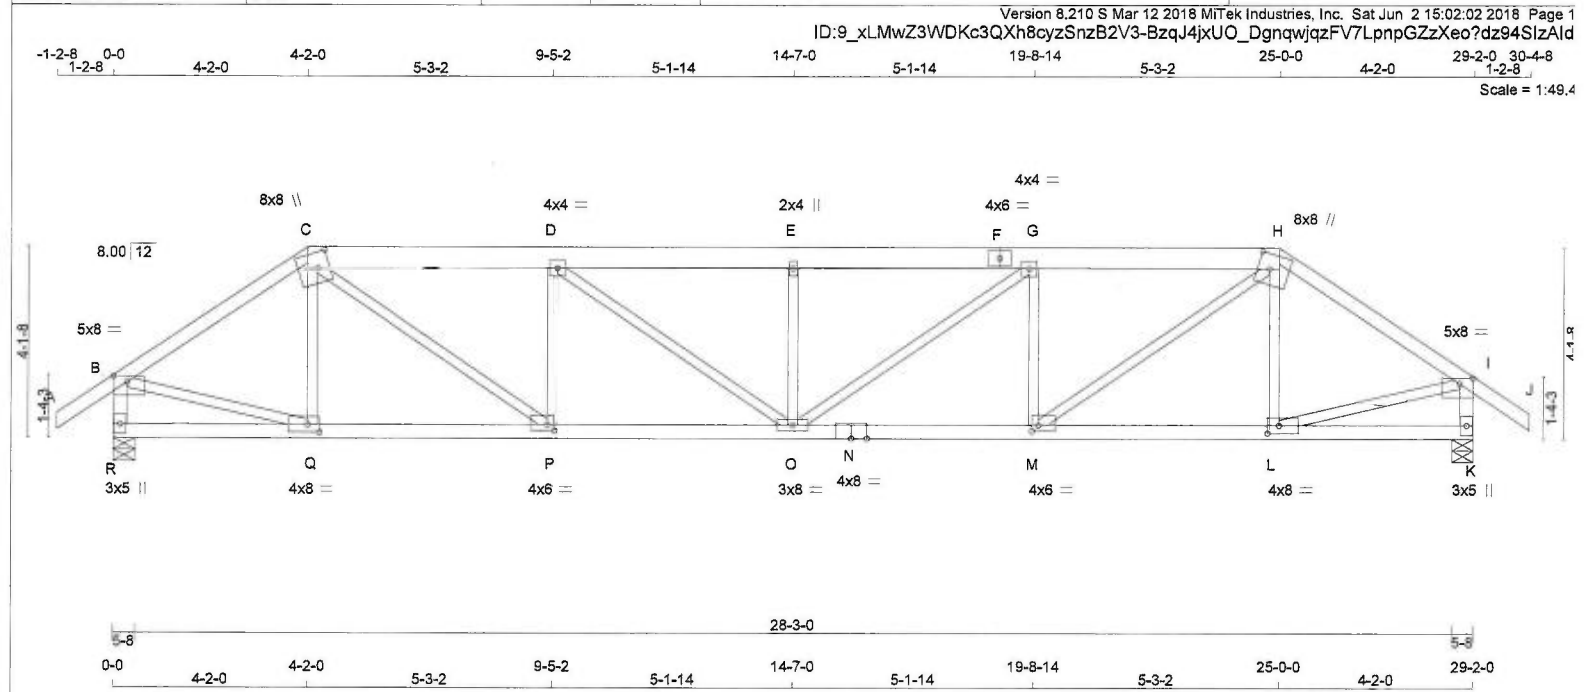

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 SPF C - F 2x6 DRY No.2 SPF F - H 2x6 DRY No.2 SPF H - J 2x4 DRY No.2 SPF R - B 2x4 DRY No.2 SPF K - I 2x4 DRY No.2 SPF R - N 2x4 DRY No.2 SPF N - K 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX R 2685 0 2685 0 0 5-8 5-8 K 2685 0 2685 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL R 1885 1314 / 0 0 / 0 0 / 0 0 / 0 571 / 0 0 / 0 K 1885 1314 / 0 0 / 0 0 / 0 0 / 0 571 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.44 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO A-B 0 / 28 -77.4 -77.4 0.10 (1) 10.00 Q-C -449 / 14 0.11 (1) B-C -3151 / 0 -77.4 -77.4 0.46 (1) 3.52 C-P 0 / 2539 0.63 (1) C-D -4680 / 0 -145.9 -145.9 0.43 (1) 3.63 P-D -1309 / 0 0.33 (1) D-E -5292 / 0 -145.9 -145.9 0.43 (1) 3.44 D-O 0 / 757 0.19 (1) E-F -5292 / 0 -145.9 -145.9 0.43 (1) 3.44 O-E -711 / 0 0.18 (1) F-G -5292 / 0 -145.9 -145.9 0.43 (1) 3.44 O-G 0 / 757 0.19 (1) G-H -4680 / 0 -145.9 -145.9 0.43 (1) 3.63 M-G -1309 / 0 0.33 (1) H-I -3151 / 0 -77.4 -77.4 0.46 (1) 3.52 M-H 0 / 2539 0.63 (1) I-J 0 / 28 -77.4 -77.4 0.10 (1) 10.00 L-H -449 / 14 0.11 (1) R-B -2628 / 0 0.0 0.0 0.30 (1) 5.23 B-Q 0 / 2704 0.67 (1) K-I -2628 / 0 0.0 0.0 0.30 (1) 5.23 L-I 0 / 2704 0.67 (1) R-Q 0 / 0 -34.4 -34.4 0.19 (4) 10.00 Q-P 0 / 2617 -34.4 -34.4 0.57 (1) 10.00 P-O 0 / 4680 -34.4 -34.4 0.92 (1) 10.00 O-N 0 / 4680 -34.4 -34.4 0.92 (1) 10.00 N-M 0 / 4680 -34.4 -34.4 0.92 (1) 10.00 M-L 0 / 2617 -34.4 -34.4 0.57 (1) 10.00 L-K 0 / 0 -34.4 -34.4 0.19 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE C 4-2-0 -242 -242 — FRONT VERT TOTAL H 25-0-0 -242 -242 — FRONT VERT TOTAL				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.3 PSF TOTAL LOAD = 33.6 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM GIRDER TYPE: CPrimeHip SIDE SETBACK = 4-2-0 END SETBACK = 6-0-0 END WALL WIDTH = 5-8 CORNER FRAMING TYPE: CONVENTIONAL END JACK TYPE: CONVENTIONAL APPLIED TO FRONT SIDE - ADD'L LOADS BASED ON 55 % OF GSL. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.97") CALCULATED VERT. DEFL.(LL) = L/999 (0.23") ALLOWABLE DEFL.(TL)= L/360 (0.97") CALCULATED VERT. DEFL.(TL) = L/851 (0.41") CSI: TC=0.46/1.00 (H-I:1), BC=0.92/1.00 (M-O:1), WB=0.67/1.00 (L-I:1), SSI=0.29/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2264 1656			
---	--	--	--	---	--	--	--	--	--	--	--




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (Q) (INPUT = 0.90)
JSI METAL= 0.90 (N) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



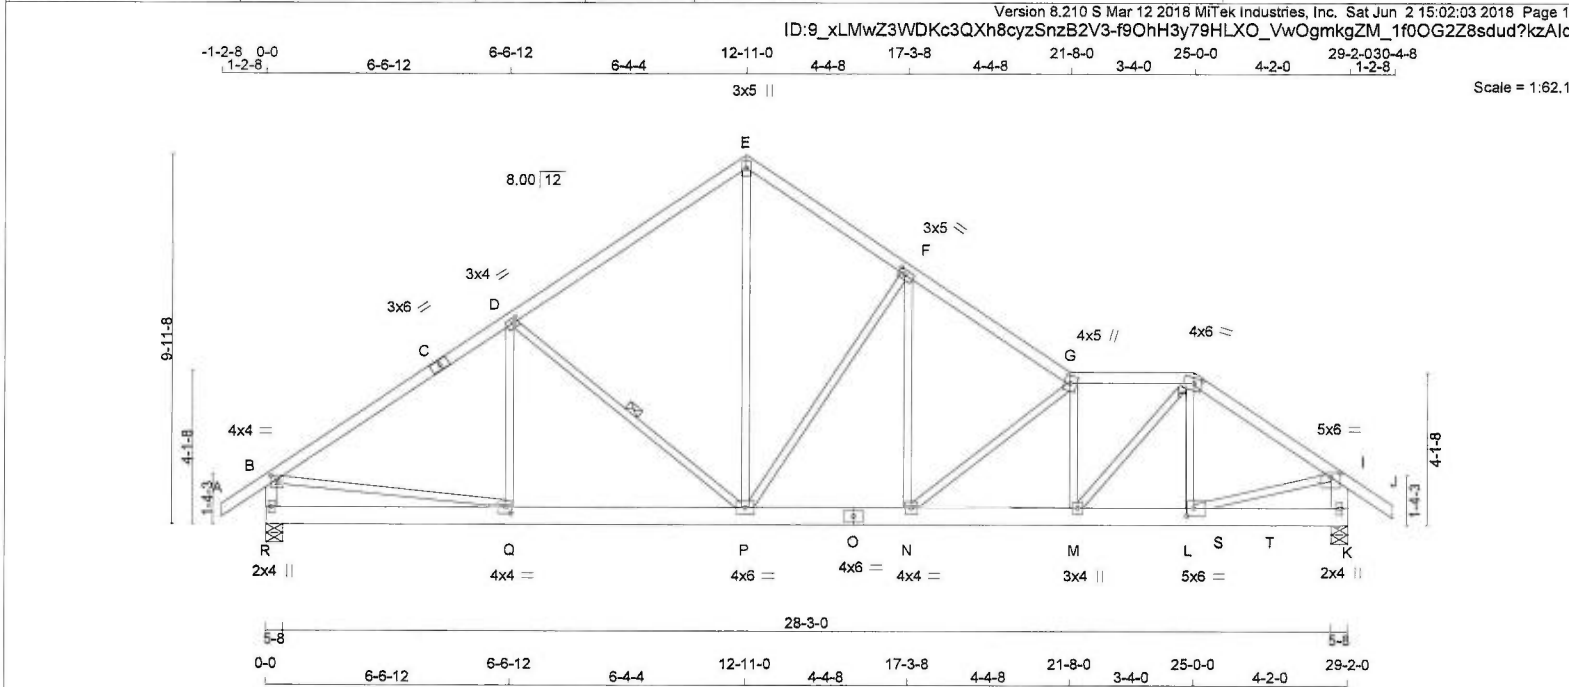

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
R - B	2x4	DRY	No.2
K - I	2x6	DRY	No.2
R - O	2x6	DRY	No.2
O - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-C	1	12	TOP
C-E	1	12	TOP
E-G	1	12	TOP
G-H	1	12	TOP
H-J	1	12	TOP
R-B	1	12	TOP
K-I	2	12	TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

R-O	2	12	TOP
O-K	2	12	SIDE(0.0)

WEBS : (0.122"x3") SPIRAL NAILS

2x3	1	6	
-----	---	---	--

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	JT HORZ	DOWN	UP
JT 1744	0	1744	0
R 3460	0	3460	0

UNFACTORED REACTIONS			
1ST CASE	MAX./MIN.	COMPONENT REACTIONS	
JT COMBINED	SNOW	LIVE	PERM.LIVE
JT 1223	861 / 0	0 / 0	0 / 0
K 2429	1697 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.68 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-P. DBS = 20-0-0. CBF = 53 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) TO EACH PLY USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-77.4	10.00
B-C	-2032 / 0	-77.4	5.76
C-D	-2032 / 0	-77.4	5.76
D-E	-1711 / 0	-77.4	6.15
E-F	-1699 / 0	-77.4	6.25
F-G	-2563 / 0	-77.4	5.50
G-H	-3462 / 0	-77.4	4.93
H-I	-3798 / 0	-77.4	4.68
I-J	0 / 28	-77.4	10.00
R-B	-1687 / 0	0.0	7.81
K-I	-3072 / 0	0.0	7.81
R-Q	0 / 0	-18.2	10.00
Q-P	0 / 1718	-18.2	10.00
P-O	0 / 2154	-18.2	10.00
O-N	0 / 2154	-18.2	10.00
N-M	0 / 3477	-18.2	10.00
M-L	0 / 3197	-18.2	10.00
L-S	0 / 0	-18.2	10.00
S-T	0 / 0	-18.2	10.00
T-K	0 / 0	-18.2	10.00

FACTORED CONCENTRATED LOADS (LBS)			
JT LOC.	LC1	MAX-	MAX+
S 25-8-8	-1946	-1946	—
T 27-1-4	-270	-270	—

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.36/1.00 (B-D:1), BC=0.46/1.00 (L-M:1), WB=0.89/1.00 (F-P:1), SS=0.63/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



CONTINUED ON PAGE 2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.25	2.00
C	TS-t	MT20	3.0	6.0		
D	TMWWW-t	MT20	3.0	4.0	1.50	1.50
E	TTW+p	MT20	3.0	5.0		
F	TMWWW-t	MT20	3.0	5.0	1.50	2.00
G	TTWW+m	MT20	4.0	5.0		
H	TTWW-m	MT20	4.0	6.0	1.75	2.50
I	TMVW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMWWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWWW-t	MT20	3.0	4.0		
N	BMWWW-t	MT20	4.0	4.0		
O	BS-t	MT20	4.0	6.0		
P	BMWWW-t	MT20	4.0	6.0		
Q	BMWWW-t	MT20	4.0	4.0	2.00	1.75
R	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1945.7 lbs. FACTORED DOWN AT 25-8-8, AND 270.4 lbs. FACTORED DOWN AT 27-1-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (G) (INPUT = 0.90)

JSI METAL= 0.40 (L) (INPUT = 1.00)

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



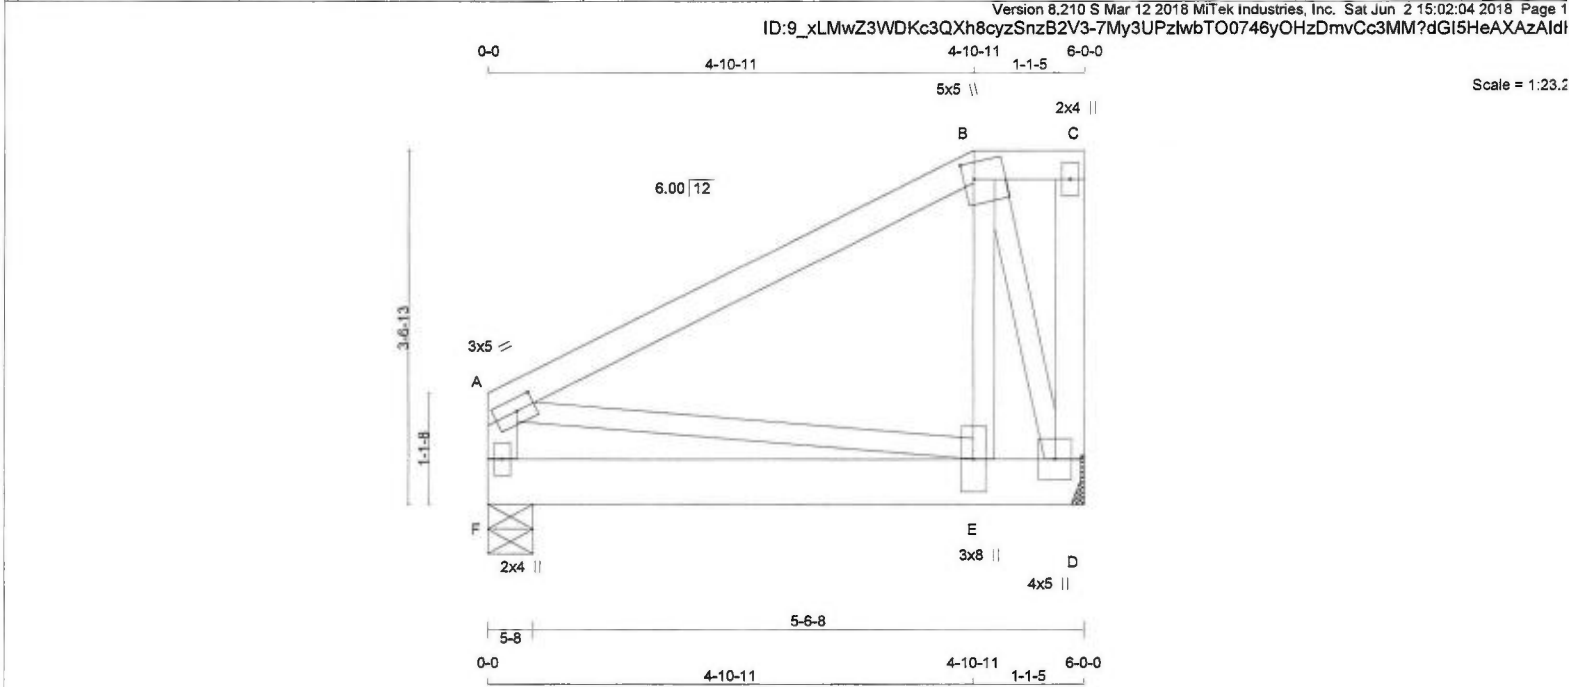

LUMBER N. L. G. A. RULES					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					DESIGN CRITERIA				
CHORDS					BEARINGS					SPECIFIED LOADS:				
A - B 2x4 DRY No.2 SPF					FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQRD BRG					TOP CH. LL = 23.3 PSF				
B - C 2x4 DRY No.2 SPF					JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX					DL = 3.0 PSF				
D - C 2x4 DRY No.2 SPF					D 1945 0 1945 0 0 MECHANICAL					BOT CH. LL = 0.0 PSF				
F - A 2x4 DRY No.2 SPF					F 1945 0 1945 0 0 5-8					DL = 7.3 PSF				
F - D 2x6 DRY No.2 SPF										TOTAL LOAD = 33.6 PSF				
ALL WEBS 2x3 DRY No.2 SPF EXCEPT					A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.					SPACING = 24.0 IN. C/C				
DRY: SEASONED LUMBER.					UNFACTORED REACTIONS					LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM				
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:					1ST LCASE MAX./MIN. COMPONENT REACTIONS					GIRDER TYPE: CStdGirder				
CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)					JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL					START DISTANCE = 0-0				
TOP CHORDS : (0.122"x3") SPIRAL NAILS					D 1367 947 / 0 0 / 0 0 / 0 0 / 0 419 / 0 0 / 0					START SPAN CARRIED = 25-7-0				
A-B 1 12 TOP					F 1367 947 / 0 0 / 0 0 / 0 0 / 0 419 / 0 0 / 0					END DISTANCE = 6-0-0				
B-C 1 12 TOP					BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F					END SPAN CARRIED = 25-7-0				
C-D 1 12 TOP					BRACING					END WALL WIDTH = 5-8				
F-A 1 12 TOP					TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.					APPLIED TO BACK SIDE OF BOTTOM CHORD.				
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS					MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.					- ADDTL LOADS BASED ON 55 % OF GSL.				
F-D 2 9 SIDE(276.4)					ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.					THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010				
WEBS : (0.122"x3") SPIRAL NAILS					LOADING					THIS DESIGN COMPLIES WITH:				
2x3 1 6					TOTAL LOAD CASES: (4)					- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014				
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.					CHORDS					- CSA 086-09				
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.					MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) LC1 MAX CSI (LC) MAX. UNBRAC LENGTH					- TPIC 2011				
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.					FR-TO					WEBS				
					A-B -932 / 0 -77.4 -77.4 0.18 (1) 6.25					MEMB. MAX. FACTORED FORCE (LBS) MAX CSI (LC)				
					B-C 0 / 0 -77.4 -77.4 0.01 (1) 10.00					E-B 0 / 2841 0.35 (1)				
					D-C -43 / 0 0.0 0.0 0.00 (1) 7.81					B-D -2811 / 0 0.31 (1)				
					F-A -729 / 0 0.0 0.0 0.04 (1) 7.81					A-E 0 / 842 0.10 (1)				
					F-E 0 / 0 -571.0 -571.0 0.48 (1) 10.00									
					E-D 0 / 926 -571.0 -571.0 0.45 (1) 10.00									
PLATES (table is in inches)										(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				
JT TYPE PLATES W LEN Y X										ALLOWABLE DEFL.(LL)= L/360 (0.20")				
A TMVW-t MT20 3.0 5.0 1.50 2.25										CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")				
B TTWW+v-m MT20 5.0 5.0 2.00 1.25										ALLOWABLE DEFL.(TL)= L/360 (0.20")				
C TMV+p MT20 2.0 4.0										CALCULATED VERT. DEFL.(TL) = L/ 822 (0.09")				
										CSI: TC=0.18/1.00 (A-B:1), BC=0.48/1.00 (E-F:1), WB=0.35/1.00 (B-E:1), SSI=0.54/1.00 (E-F:1)				
										DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00				

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
D	BMVW1+p	MT20	4.0	5.0		
E	BMVW+t	MT20	3.0	8.0		
F	BMV1+p	MT20	2.0	4.0		

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (E) (INPUT = 0.90)

JSI METAL= 0.39 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



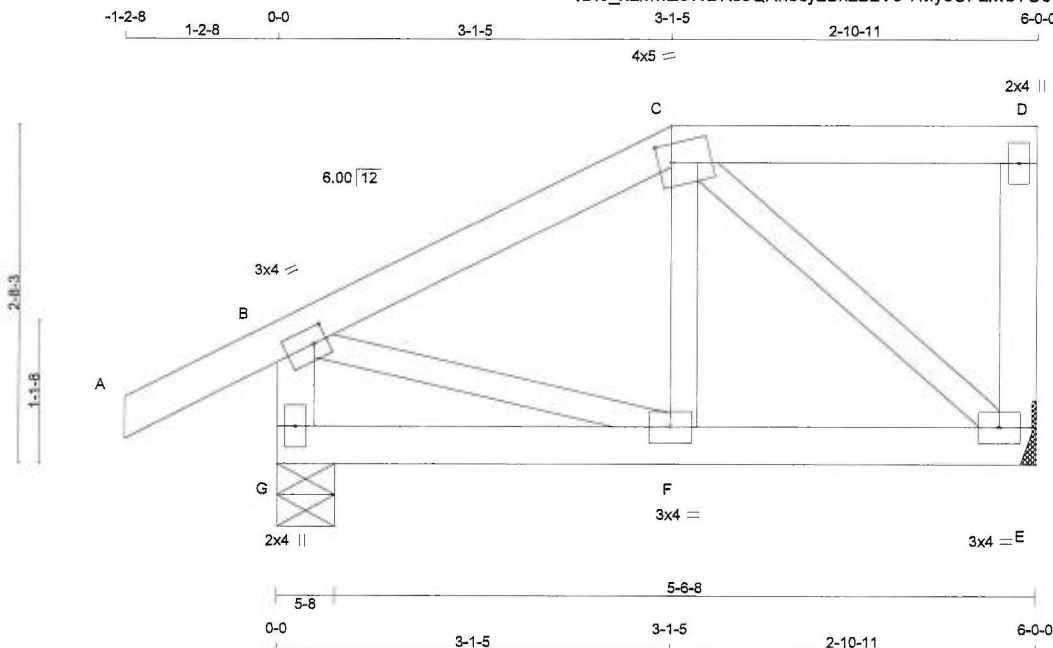

TOTAL WEIGHT = 26 lb [M]

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
G - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	4.0	1.50	1.25
C	TTWW-m	MT20	4.0	5.0	1.75	1.25
D	TMV+p	MT20	2.0	4.0		
E	BMVW1-t	MT20	3.0	4.0		
F	BMVW-t	MT20	3.0	4.0		
G	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 20.0 lbs FACTORED DOWN AT 3-1-5 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
E	272	272	0	0
G	383	383	0	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MAX./MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	190	134 / 0	0 / 0	0 / 0	0 / 0	56 / 0	0 / 0
G	266	201 / 0	0 / 0	0 / 0	0 / 0	65 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 22	-77.4	-77.4	0.10 (1)	F-C	0 / 52	0.02 (4)
B-C	-209 / 0	-77.4	-77.4	0.14 (1)	C-E	-243 / 0	0.06 (1)
C-D	0 / 0	-68.5	-68.5	0.11 (1)	B-F	0 / 193	0.05 (1)
E-D	-99 / 0	0.0	0.0	0.01 (1)			
G-B	-360 / 0	0.0	0.0	0.04 (1)			
G-F	0 / 0	-16.2	-16.2	0.04 (4)			
F-E	0 / 187	-16.2	-16.2	0.06 (4)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	3-1-5	-20	-20	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 3-1-5
RIGHT SETBACK = 0-0
END SETBACK = 2-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.06/1.00 (E-F:4), WB=0.06/1.00 (C-E:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - LIANA 3 ELEV 2	DRWG NO.
NE0618-006 .	G05	1	1	TRUSS DESC.		PAGE 12 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Sat Jun 2 15:02:04 2018 Page 2
ID:9_xLMwZ3WVKc3QXh8cyzSnzB2V3-7My3UPzIwbTO0746yOHZDmvCE3Tu?isi5HeAXAzAIdf

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.49 (B) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



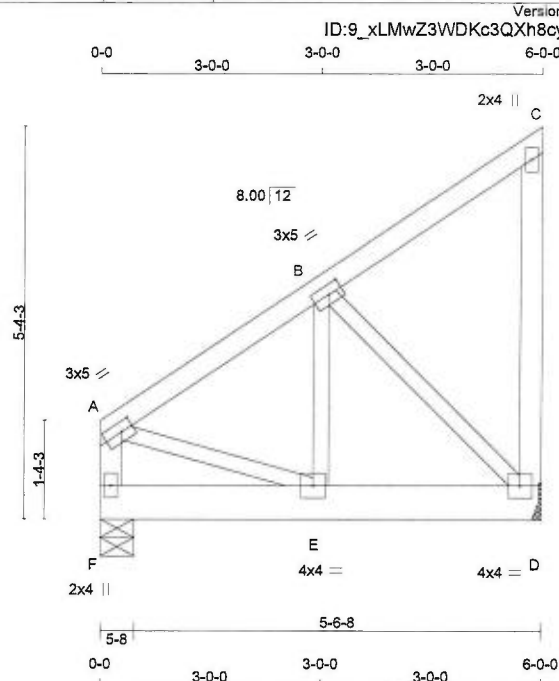

Scale = 1:31.4

TOTAL WEIGHT = 33 lb
[M]

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2					SPF
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	3.0	5.0	1.50	2.00
B	TMVW-t	MT20	3.0	5.0	1.50	2.25
C	TMVW-p	MT20	2.0	4.0		
D	BMVW-t	MT20	4.0	4.0		
E	BMVW-t	MT20	4.0	4.0		
F	BMVW-t	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
D	855	0	855	0	MECHANICAL	
F	855	0	855	0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
D	600	416 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	
F	600	416 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRAC LENGTH FR-TO	WEBS		MAX. FACTORED
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX (LC)		MAX. FORCE (LBS)	MAX (LC)	
FR-TO		FROM TO						
A-B	-605 / 0	-77.4	-77.4	0.12 (1)	6.25	E-B	0 / 565	0.14 (1)
B-C	-14 / 0	-77.4	-77.4	0.12 (1)	6.25	B-D	-721 / 0	0.21 (1)
D-C	-90 / 0	0.0	0.0	0.04 (1)	7.81	A-E	0 / 540	0.13 (1)
F-A	-596 / 0	0.0	0.0	0.07 (1)	7.81			
F-E	0 / 0	-207.5	-207.5	0.12 (1)	10.00			
E-D	0 / 515	-207.5	-207.5	0.19 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 10-4-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 10-4-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.19/1.00 (D-E:1), WB=0.21/1.00 (B-D:1), SS=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 622 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - LIANA 3 ELEV 2	DRWG NO.
NE0618-006 ,	G06	1	1	TRUSS DESC.		PAGE 14 OF 42

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Sat Jun 2 15:02:05 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-bYVRilzNhvbFeHflV5pCj_ROHTn8k5nRJxNk3czAldC

JSI GRIP= 0.85 (B) (INPUT = 0.90)
JSI METAL= 0.20 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



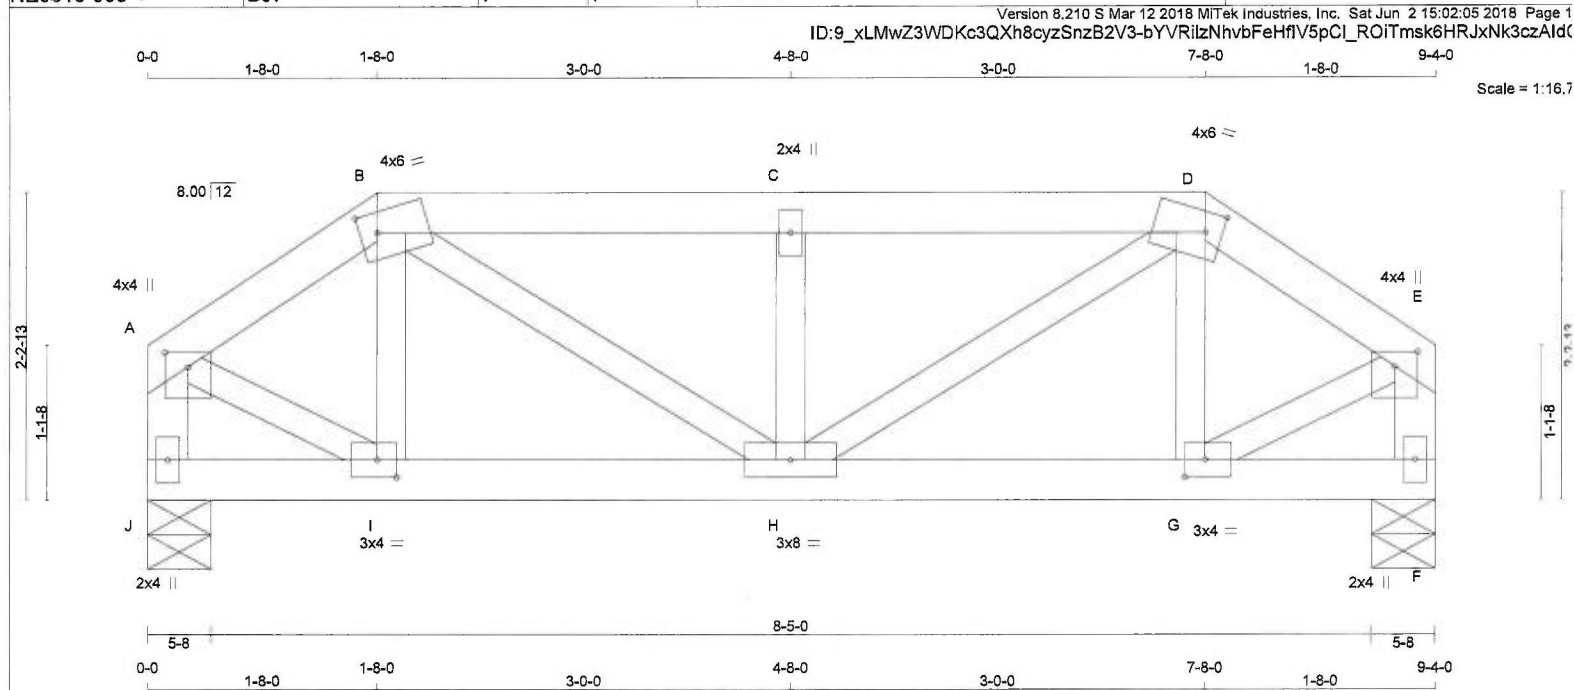

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR. ALL WEBS EXCEPT 2x3 DRY No.2 SPF DRY: SEASONED LUMBER.

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY No.2	SPF
B - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
J - A	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
J - F	2x4	DRY No.2	SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER								
BEARINGS								
	FACTORED			MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX
	853	0		853	0	0	5-8	5-8
F	853	0		853	0	0	5-8	5-8

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW-m	MT20	4.0	6.0	1.75	1.50
C	TMW+w	MT20	2.0	4.0		
D	TTWW-m	MT20	4.0	6.0	1.75	1.50
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	2.0	4.0		
G	BMVW-t	MT20	3.0	4.0	1.50	1.75
H	BMVW-t	MT20	3.0	8.0		
I	BMVW-t	MT20	3.0	4.0	1.50	1.75
J	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 10.7 lbs FACTORED DOWN AT 7-8-0, AND 10.7 lbs FACTORED DOWN AT 1-8-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	598	418 / 0	0 / 0	0 / 0	0 / 0	0 / 0	180 / 0	0 / 0
F	598	418 / 0	0 / 0	0 / 0	0 / 0	0 / 0	180 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	-775 / 0	-77.4	-77.4 0.05 (1)	I-B	-5 / 32		0.01 (4)
B-C	-1066 / 0	-68.5	-68.5 0.10 (1)	B-H	0 / 505		0.12 (1)
C-D	-1066 / 0	-68.5	-68.5 0.10 (1)	H-C	-230 / 0		0.04 (1)
D-E	-776 / 0	-77.4	-77.4 0.05 (1)	H-D	0 / 504		0.12 (1)
J-A	-790 / 0	0.0	0.0 0.09 (1)	G-D	-4 / 32		0.01 (4)
F-E	-790 / 0	0.0	0.0 0.09 (1)	A-I	0 / 705		0.17 (1)
				G-E	0 / 706		0.17 (1)
J-I	0 / 0	-108.8	-108.8 0.09 (1)				
I-H	0 / 642	-108.8	-108.8 0.20 (1)				
H-G	0 / 642	-108.8	-108.8 0.20 (1)				
G-F	0 / 0	-108.8	-108.8 0.09 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
B	1-8-0	-11	-11	—	FRONT	VERT	TOTAL
D	7-8-0	-11	-11	—	FRONT	VERT	TOTAL

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 1-8-0
END SETBACK = 2-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 5-10-8
END DISTANCE = 9-4-0
END SPAN CARRIED = 5-10-8
END WALL WIDTH = 0-0
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")
CALCULATED VERT. DEFL.(LL)= L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.31")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.10/1.00 (B-C:1), BC=0.20/1.00 (G-H:1), WB=0.17/1.00 (E-G:1), SSI=0.14/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN YORK HOMES - GRANELLI HOME CORP - LIANA 3 ELEV 2	DRWG NO.
NE0618-006	G07	1	1	TRUSS DESC.		PAGE 16 OF 42

Version 8.210 S Mar 12 2018 MITek Industries, Inc. Sat Jun 2 15:02:05 2018 Page 2
ID:9_xLMwZ3WDKc3QXh8cyzSnzB2V3-bYVRilzNhvbFeHfIV5pCI_ROITmsk6HRJxNk3czAIdC

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)

JSI METAL= 0.24 (I) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



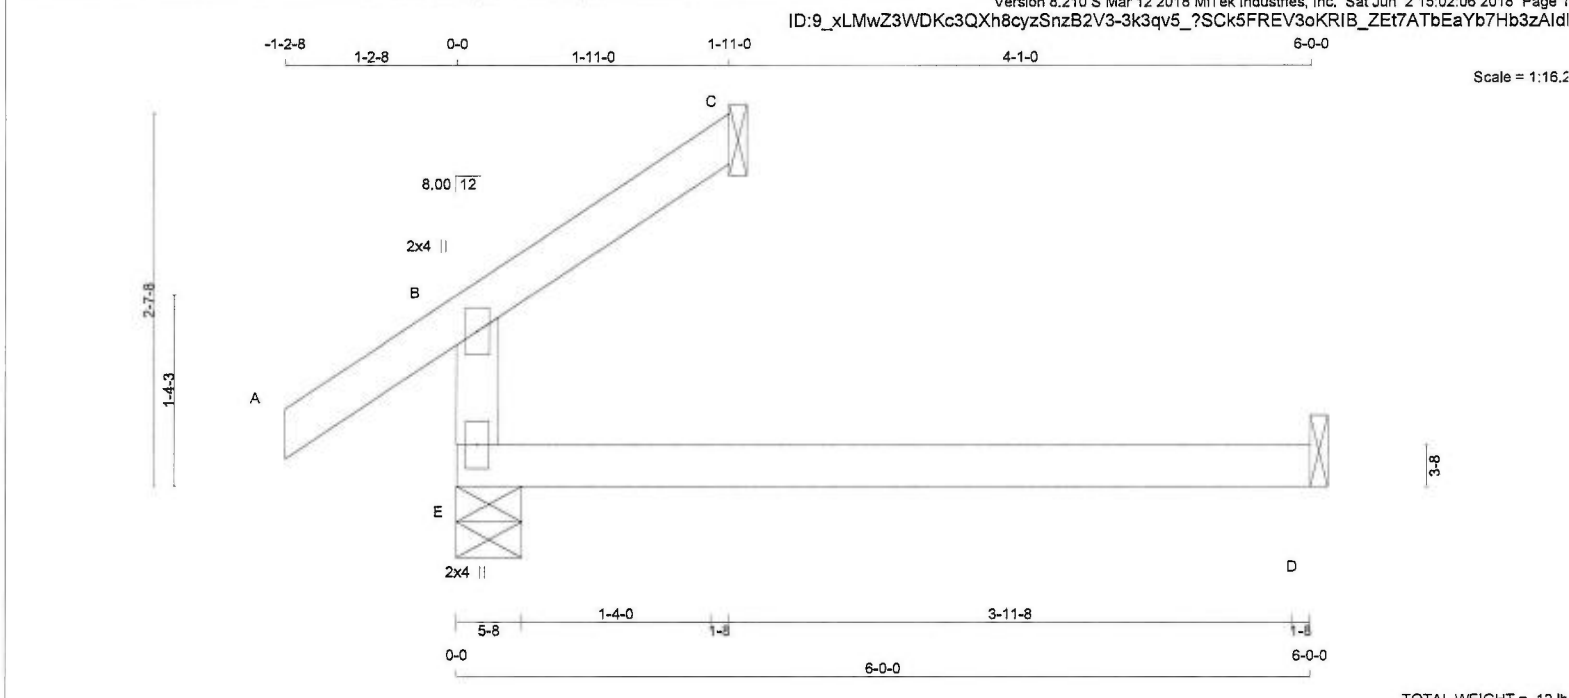

LUMBER
N. L. G. A. RULES
CHORDS SIZE
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

 DRY: SEASONED LUMBER.

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.3 PSF
 TOTAL LOAD = 33.6 PSF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	181	115 / 0	0 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARINGS
 FACTORED GROSS REACTION

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	REQRD
E	256	0	256	0	0	5-8	5-8	
C	56	0	56	0	0	1-8	1-8	
D	46	0	51	0	0	1-8	1-8	

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS


MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. UNBRAC LENGTH FR-TO
FR-TO		FROM TO		
E-B	-192 / 0	0.0	0.0 0.11 (4)	7.61
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00
B-C	-10 / 0	-77.4	-77.4 0.04 (1)	10.00
E-D	0 / 0	-18.2	-18.2 0.13 (4)	10.00

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MEMB. UNBRAC LENGTH FR-TO
FR-TO		
E-B	-192 / 0	7.61
A-B	0 / 28	10.00
B-C	-10 / 0	10.00
E-D	0 / 0	10.00

DESIGN CRITERIA
 ALLOWABLE DEFL.(LL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")
 CSI: TC=0.11/1.00 (B-E:4) , BC=0.13/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.09/1.00 (D-E:4)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10
 COMPANION LIVE LOAD FACTOR = 0.50
 AUTOSOLVE RIGHT HEEL ONLY
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP= 0.12 (B) (INPUT = 0.90)
 JSI METAL= 0.05 (B) (INPUT = 1.00)

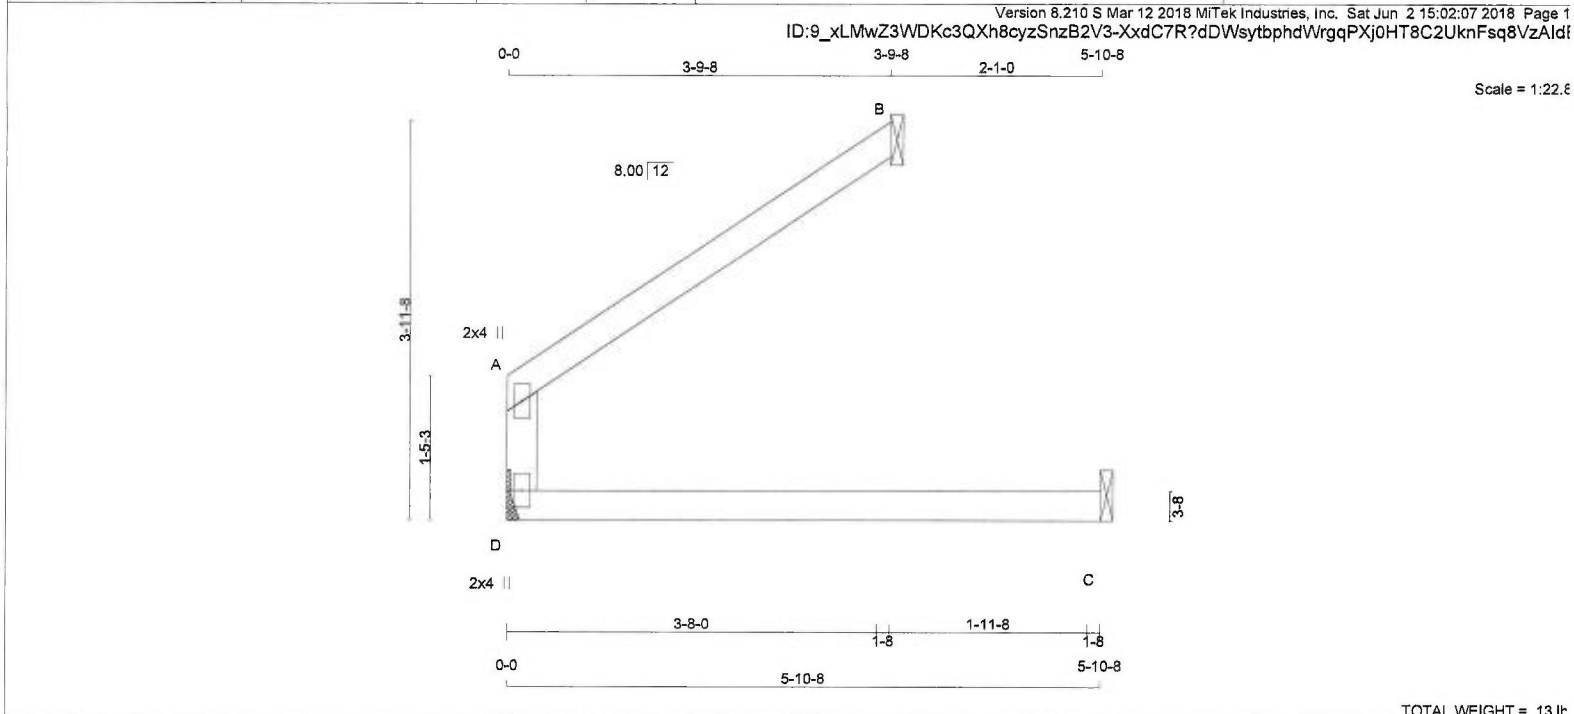

LUMBER					DESCR.	
N. L. G. A. RULES						
CHORDS	SIZE	LUMBER				
D - A	2x4	DRY	No.2			
A - B	2x4	DRY	No.2			
D - C	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
D	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
D	201	0	201	0	0	MECHANICAL
B	143	0	143	0	0	1-8
C	56	0	56	0	0	1-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B , C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
D	143	91 / 0	0 / 0	0 / 0	0 / 0	0 / 0	52 / 0
B	98	81 / 0	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0
C	44	5 / 0	0 / 0	0 / 0	0 / 0	0 / 0	39 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX UNBRACED LENGTH	FR-TO
D-A	-150 / 0	0.0	0.0 0.06 (4)	A-B	-2 / 5	-77.4	0.17 (1)
A-B	-2 / 5	-77.4	-77.4 0.17 (1)	B-C	0 / 0	-18.2	-18.2 0.15 (4)
D-C	0 / 0	-18.2	-18.2 0.15 (4)	C-D			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.3 PSF
TOTAL LOAD	=	33.6 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
 ALLOWABLE DEFL.(TL)= L/360 (0.20")
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.06")

CSI: TC=0.17/1.00 (A-B:1) , BC=0.15/1.00 (C-D:4) , WB=0.00/1.00 (n/a:0) , SSI=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (A) (INPUT = 0.90)
 JSI METAL= 0.04 (A) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

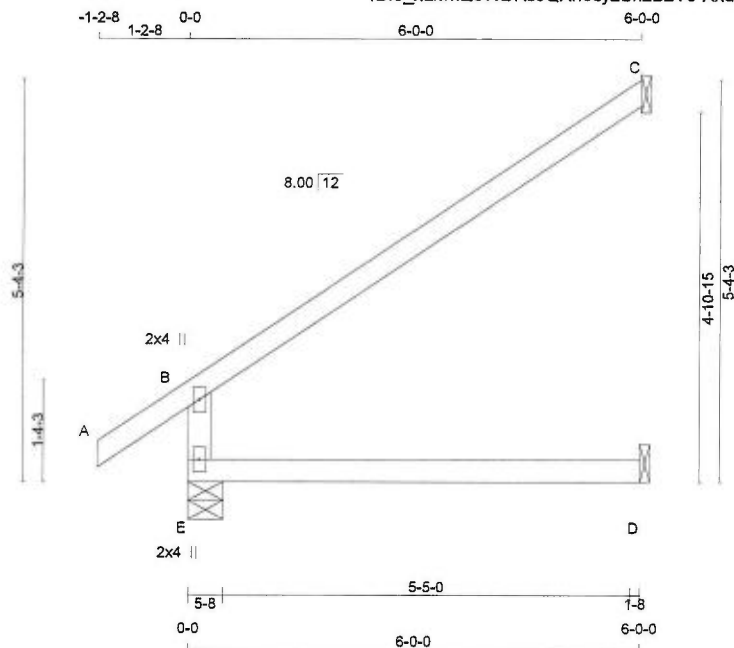

Scale = 1:30.0

LUMBER					DESCR.	SPF
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER		
E - B	2x4	DRY	No.2		SPF	
A - C	2x4	DRY	No.2		SPF	
E - D	2x4	DRY	No.2		SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	454	0	454	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	46	0	51	0	1-8	1-8

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	316	235 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	37	0 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
E-B	-390 / 0	0.0	0.0	0.11 (4)
A-B	0 / 28	-77.4	-77.4	0.09 (1)
B-C	-32 / 0	-77.4	-77.4	0.36 (1)
E-D	0 / 0	-18.2	-18.2	0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.36/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



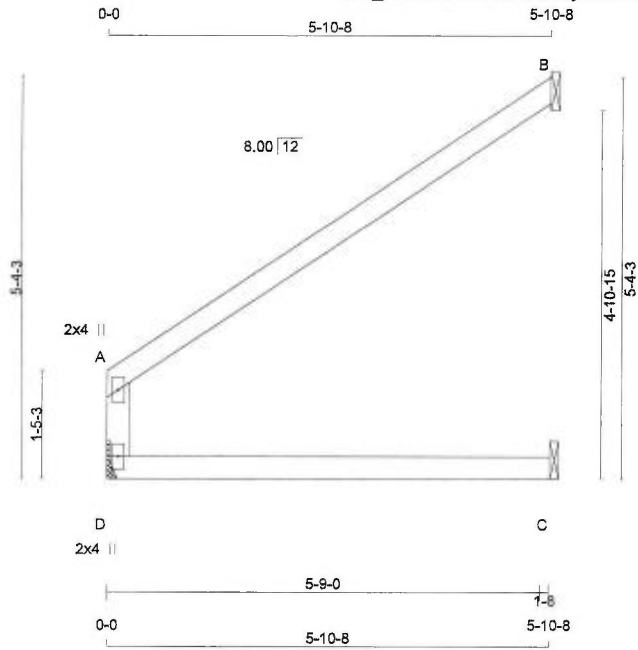

Scale = 1:30.0

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS	REACT	GROSS	REACT	BRG	IN-SX	BRG	IN-SX
D	281	0	281	0	0	MECHANICAL			
B	207	0	207	0	0	1-8	1-8		
C	73	0	73	0	0	1-8	1-8		

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT D TO RESIST THE MAX FACTORED REACTIONS.

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) B , C

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	197	137 / 0	0 / 0	0 / 0	0 / 0	61 / 0	0 / 0
B	142	122 / 0	0 / 0	0 / 0	0 / 0	20 / 0	0 / 0
C	56	15 / 0	0 / 0	0 / 0	0 / 0	41 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB. UNBRAC LENGTH	FR-TO	FORCE (LBS)	LC1 MAX
D-A	-247 / 0	0.0	0.0 0.14 (1)	7.81			
A-B	-11 / 2	-77.4	-77.4 0.39 (1)	6.25			
D-C	0 / 0	-18.2	-18.2 0.20 (1)	10.00			

TOTAL WEIGHT = 3 X 16 = 48 lb
[M][F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/662 (0.11")

CSI: TC=0.39/1.00 (A-B:1), BC=0.20/1.00 (C-D:1), WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656		

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.16 (A) (INPUT = 0.90)
JSI METAL= 0.06 (A) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



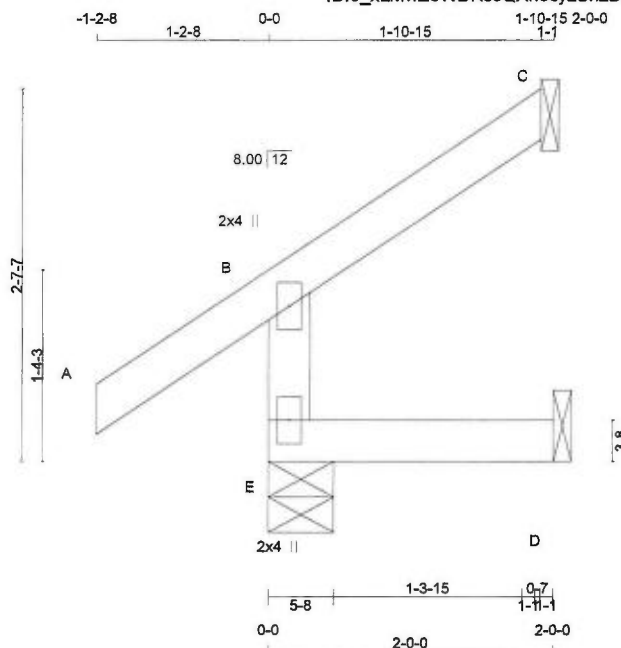

Scale = 1:16.2

TOTAL WEIGHT = 8 lb
[M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQRD
GROSS REACTION		GROSS REACTION				BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	212	0	212	0	0	5-8	5-8
C	56	0	56	0	0	1-8	1-8
D	16	0	18	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	146	115 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	38	34 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX UNBRAC	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	CSI (LC)	LENGTH	FR-TO		CSI (LC)
E-B	-192 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00			
B-C	-10 / 0	-77.4	-77.4 0.05 (1)	10.00			
E-D	0 / 0	-18.2	-18.2 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.06/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.12 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Sat Jun 2 15:02:09 2018 Page 1
ID:9_xLMwZ3WDKc3QXh8cyzSszB2V3-TJlyY60t76g6vz4kxt8wqc234Ahgy_1EZLxCOzAId

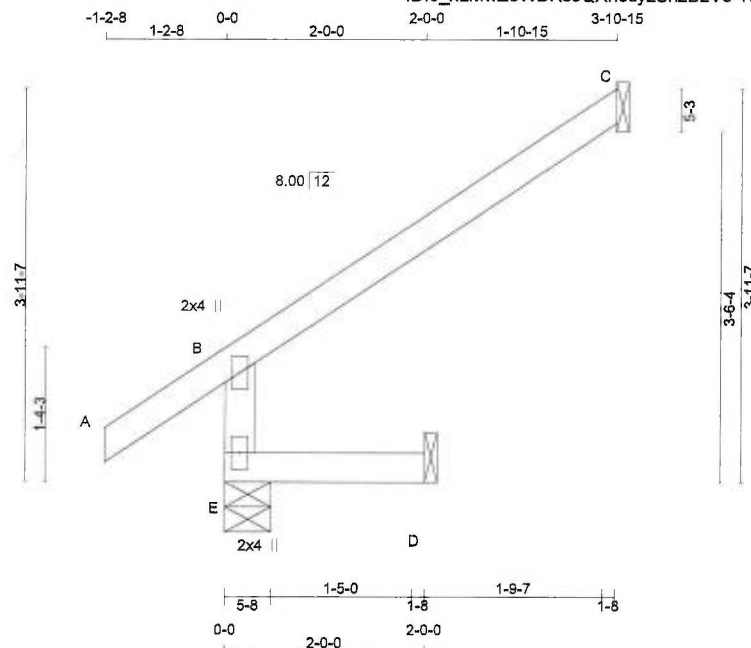

TOTAL WEIGHT = 11 lb
[M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	BRG
E	309	0	0	309	0	0	5-8	5-8	5-8
C	114	0	0	114	0	0	1-8	1-8	1-8
D	16	0	0	18	0	0	1-8	1-8	1-8

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN.	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	212	174 / 0	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0
C	77	68 / 0	0 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	MAX. UNBRAC LENGTH	FR-TO
E-B	-289 / 0	0.0	0.0 0.01 (4)	E-B	0 / 28	7.81	10.00
A-B	0 / 28	-77.4	-77.4 0.09 (1)	A-B	-21 / 0	6.25	10.00
B-C	-21 / 0	-77.4	-77.4 0.20 (1)	B-C	0 / 0	-18.2	-18.2 0.02 (4)
E-D	0 / 0	-18.2	-18.2 0.02 (4)	E-D	0 / 0	-18.2	-18.2 0.02 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.20/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 622 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



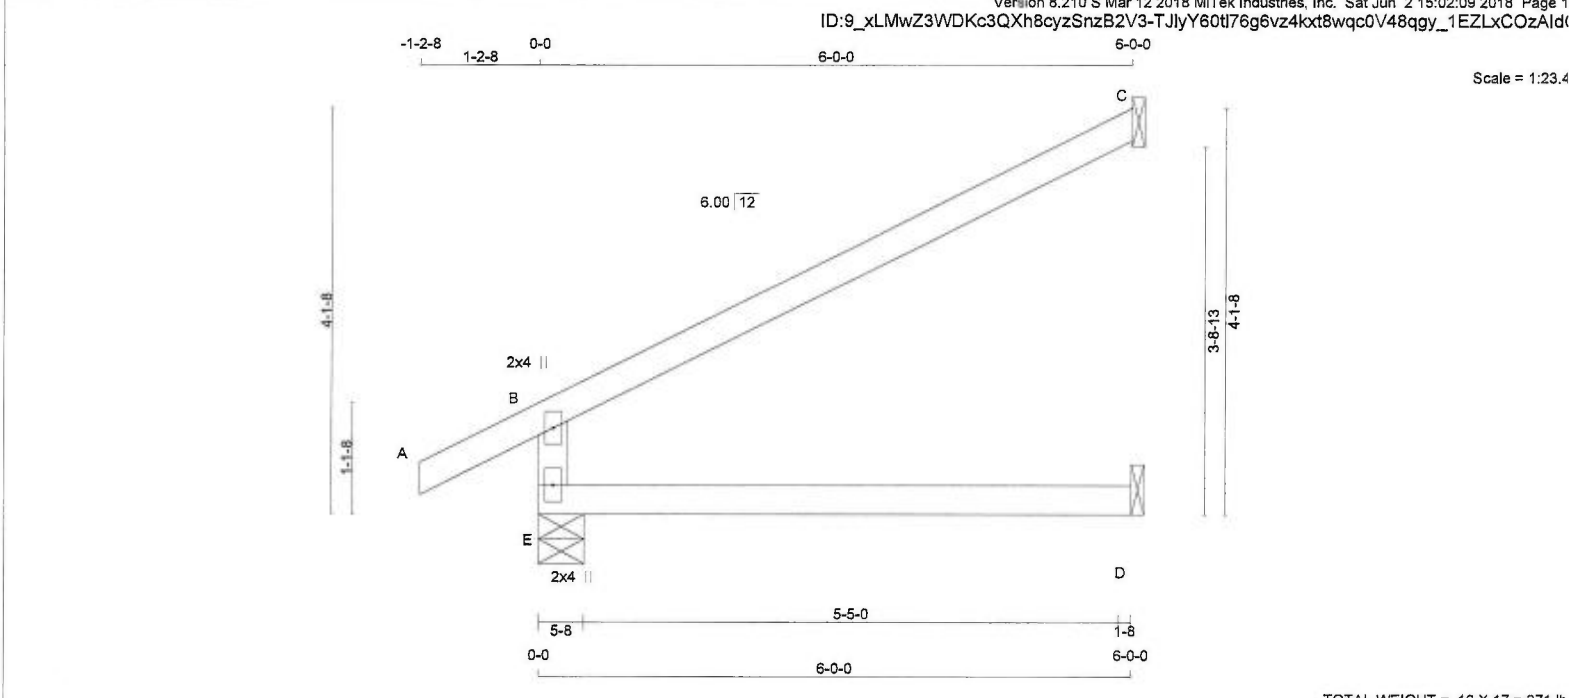

8/11/2018 10:17:17 AM [M]F

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER			
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	2.0	4.0	
E	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	453	0	453	0	0	5-8	5-8
C	174	0	174	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS							
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	316	234 / 0	0 / 0	0 / 0	0 / 0	82 / 0	0 / 0
C	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)		VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO		MEMB.	MAX. FACTORED FORCE (LBS)	
	FROM	TO		LC1	MAX		FROM	TO
FR-TO								
E-B	-389 / 0	0.0	0.0	0.11 (4)	7.81			
A-B	0 / 22	-77.4	-77.4	0.09 (1)	10.00			
B-C	-26 / 0	-77.4	-77.4	0.36 (1)	6.25			
E-D	0 / 0	-18.2	-18.2	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD	=	33.6	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.36/1.00 (B-C:1) , BC=0.14/1.00 (D-E:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX	MIN
MT20	618	354	1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

Jun 02, 2018


PROVINCIAL ENGINEER

PROVINCE OF ONTARIO

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Scale = 1:16.5

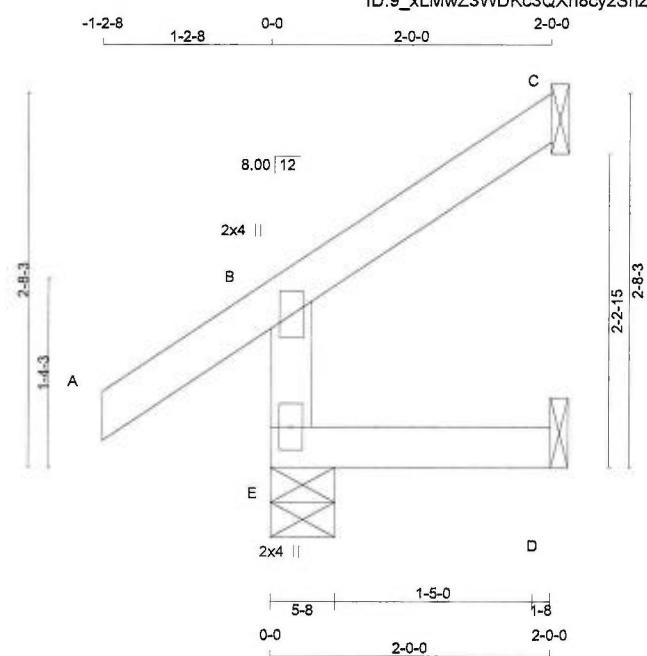

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
E	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ
E	216	0	216	0
C	58	0	58	0
D	16	0	18	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN.	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED							
E	149	118 / 0	0 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
C	40	35 / 0	0 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. MEMB. UNBRAC LENGTH FR-TO	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)
FR-TO		FROM	TO			
E-B	-196 / 0	0.0	0.0	0.01 (4)	7.61	
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	
B-C	-10 / 0	-77.4	-77.4	0.05 (1)	6.25	
E-D	0 / 0	-18.2	-18.2	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 8 = 16 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1) , BC=0.02/1.00 (D-E:4) ,
VB=0.00/1.00 (n/a:0) , SSI=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822
			2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



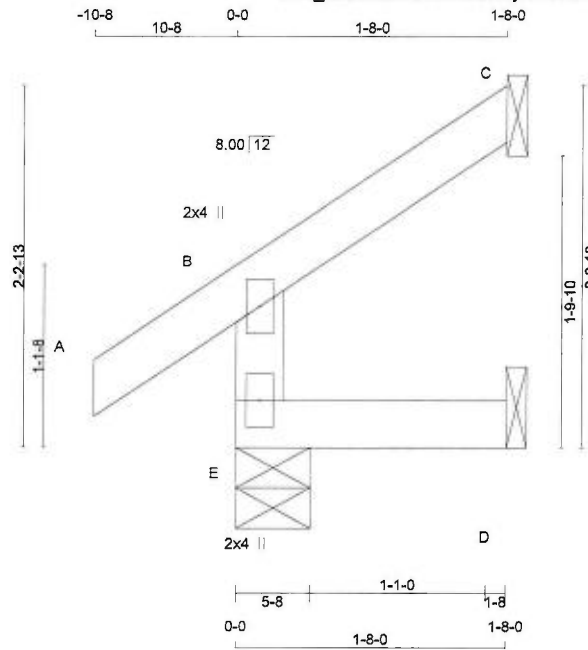

Scale = 1:14.2

TOTAL WEIGHT = 4 X 6 = 26 lb [M]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
E	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	171	0	171	0	0	5-8	5-8
C	49	0	49	0	0	1-8	1-8
D	14	0	15	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	118	93 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
C	33	29 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	11	0 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-154 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 21	-77.4	-77.4 0.05 (1)	10.00			
B-C	-9 / 0	-77.4	-77.4 0.04 (1)	10.00			
E-D	0 / 0	-18.2	-18.2 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.05/1.00 (A-B:1), BC=0.01/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.05/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



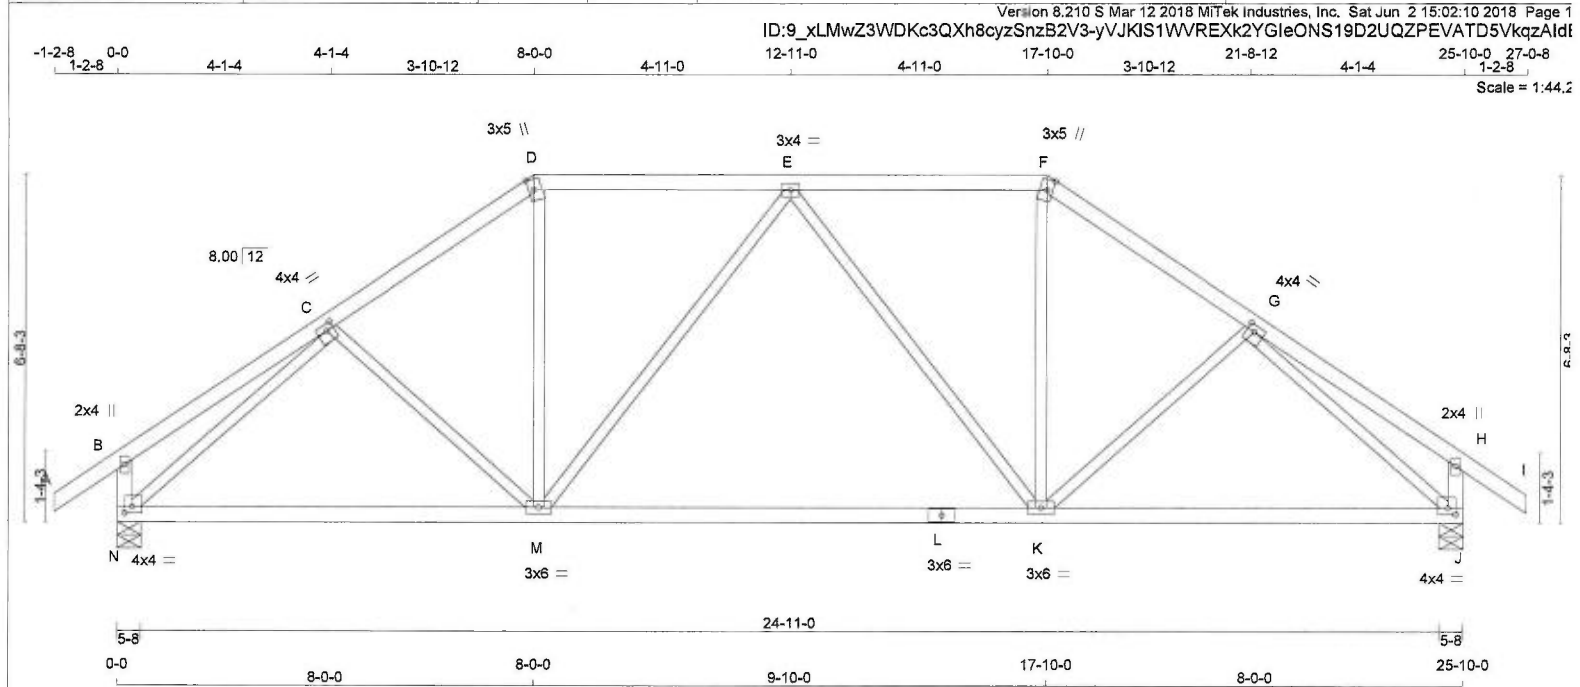

TOTAL WEIGHT = 108 lb

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY; SEASONED LUMBER.

PLATES (table is in inches)					
J	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	2.0	4.0	
C	TMWw-t	MT20	4.0	4.0	1.50
D	TMV+m	MT20	3.0	5.0	2.50
E	TMWw-t	MT20	3.0	4.0	
F	TMV+m	MT20	3.0	5.0	2.50
G	TMWw-t	MT20	4.0	4.0	1.50
H	TMV+p	MT20	2.0	4.0	
I	BMVWV-t	MT20	4.0	4.0	1.50
K	BMWwWw-t	MT20	3.0	6.0	
L	BS-t	MT20	3.0	6.0	
M	BMWwWw-t	MT20	3.0	6.0	
N	BMVWV-t	MT20	4.0	4.0	1.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	1335	0	1335	0	0	5-8	5-8
J	1335	0	1335	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	935	662 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0
N	935	662 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.46 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOCL CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	C-M	-74 / 36 0.04 (1)		
B-C	0 / 19	-77.4	-77.4	0.19 (1)	10.00	M-D	0 / 461 0.10 (1)		
C-D	-1330 / 0	-77.4	-77.4	0.17 (1)	5.46	M-E	-291 / 0 0.39 (1)		
D-E	-1097 / 0	-77.4	-77.4	0.25 (1)	5.75	E-K	-291 / 0 0.39 (1)		
E-F	-1097 / 0	-77.4	-77.4	0.25 (1)	5.75	K-F	0 / 461 0.10 (1)		
F-G	-1330 / 0	-77.4	-77.4	0.17 (1)	5.46	K-G	-74 / 36 0.04 (1)		
G-H	0 / 19	-77.4	-77.4	0.19 (1)	10.00	N-C	-1558 / 0 0.75 (1)		
H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00	G-J	-1558 / 0 0.75 (1)		
N-B	-220 / 0	0.0	0.0	0.02 (1)	7.81				
J-H	-220 / 0	0.0	0.0	0.02 (1)	7.81				
N-M	0 / 1145	-18.2	-18.2	0.41 (4)	10.00				
M-L	0 / 1272	-18.2	-18.2	0.42 (4)	10.00				
L-K	0 / 1272	-18.2	-18.2	0.42 (4)	10.00				
K-J	0 / 1144	-18.2	-18.2	0.41 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD =		33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.25/1.00 (D-E:1), BC=0.42/1.00 (K-M:4),
WB=0.75/1.00 (C-N:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (N) (INPUT = 0.90)
JSI METAL= 0.57 (G) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



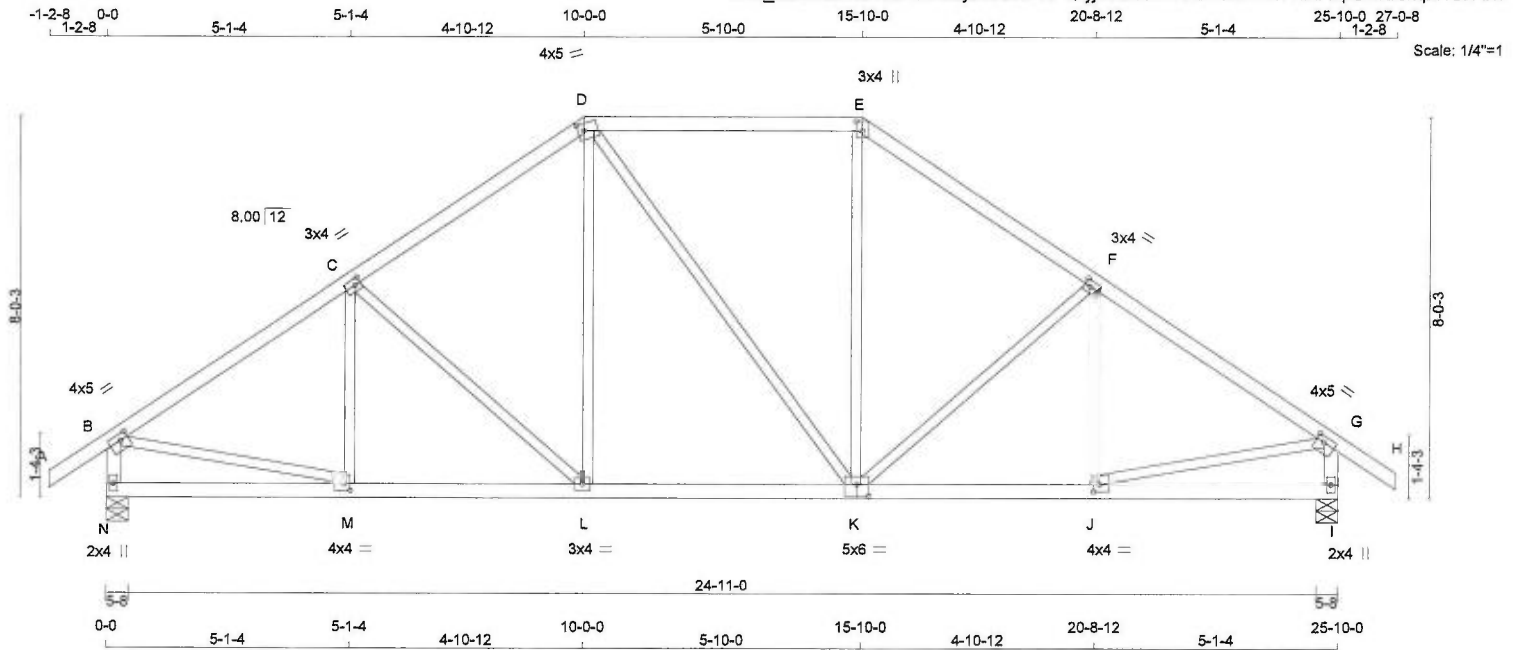

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N - L, G, A, RULES	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B - TMVW-t	MT20	4.0	5.0	1.50	2.00		
C - TMVW-t	MT20	3.0	4.0	1.50	1.50		
D - TTWW-m	MT20	4.0	5.0	1.75	1.50		
E - TTW+p	MT20	3.0	4.0	2.50	1.50		
F - TMVW-t	MT20	3.0	4.0	1.50	1.50		
G - TMVW-t	MT20	4.0	5.0	1.50	2.00		
I - BMV1+p	MT20	2.0	4.0				
J - BMVW-t	MT20	4.0	4.0	1.75	1.50		
K - BSWWW-I	MT20	5.0	6.0	3.00	3.00		
L - BMVW-t	MT20	3.0	4.0				
M - BMVW-t	MT20	4.0	4.0	1.75	1.50		
N - BMV1+p	MT20	2.0	4.0				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
N	1335	0	0	1335	0	0	0	5-8	5-8
I	1335	0	0	1335	0	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	935	662 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0
I	935	662 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	M-C	-144 / 41	0.05 (1)	10.00
B-C	-1419 / 0	-77.4	-77.4 0.28 (1)	C-L	-291 / 0	0.24 (1)	5.19
C-D	-1211 / 0	-77.4	-77.4 0.27 (1)	L-D	0 / 291	0.07 (1)	5.52
D-E	-988 / 0	-77.4	-77.4 0.35 (1)	D-K	0 / 0	0.00 (1)	5.82
E-F	-1211 / 0	-77.4	-77.4 0.26 (1)	K-E	0 / 291	0.07 (1)	5.52
F-G	-1418 / 0	-77.4	-77.4 0.28 (1)	K-F	-289 / 0	0.24 (1)	5.19
G-H	0 / 28	-77.4	-77.4 0.09 (1)	J-F	-145 / 40	0.05 (1)	10.00
N-B	-1295 / 0	0.0	0.0 0.13 (1)	B-M	0 / 1226	0.28 (1)	7.10
I-G	-1295 / 0	0.0	0.0 0.13 (1)	J-G	0 / 1225	0.28 (1)	7.10
N-M	0 / 0	-18.2	-18.2 0.10 (4)				10.00
M-L	0 / 1202	-18.2	-18.2 0.25 (1)				10.00
L-K	0 / 988	-18.2	-18.2 0.22 (1)				10.00
K-J	0 / 1201	-18.2	-18.2 0.25 (1)				10.00
J-I	0 / 0	-18.2	-18.2 0.10 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.35/1.00 (D-E:1), BC=0.25/1.00 (J-K:1), WB=0.28/1.00 (B-M:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 622 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (B) (INPUT = 0.90)
JSI METAL= 0.47 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



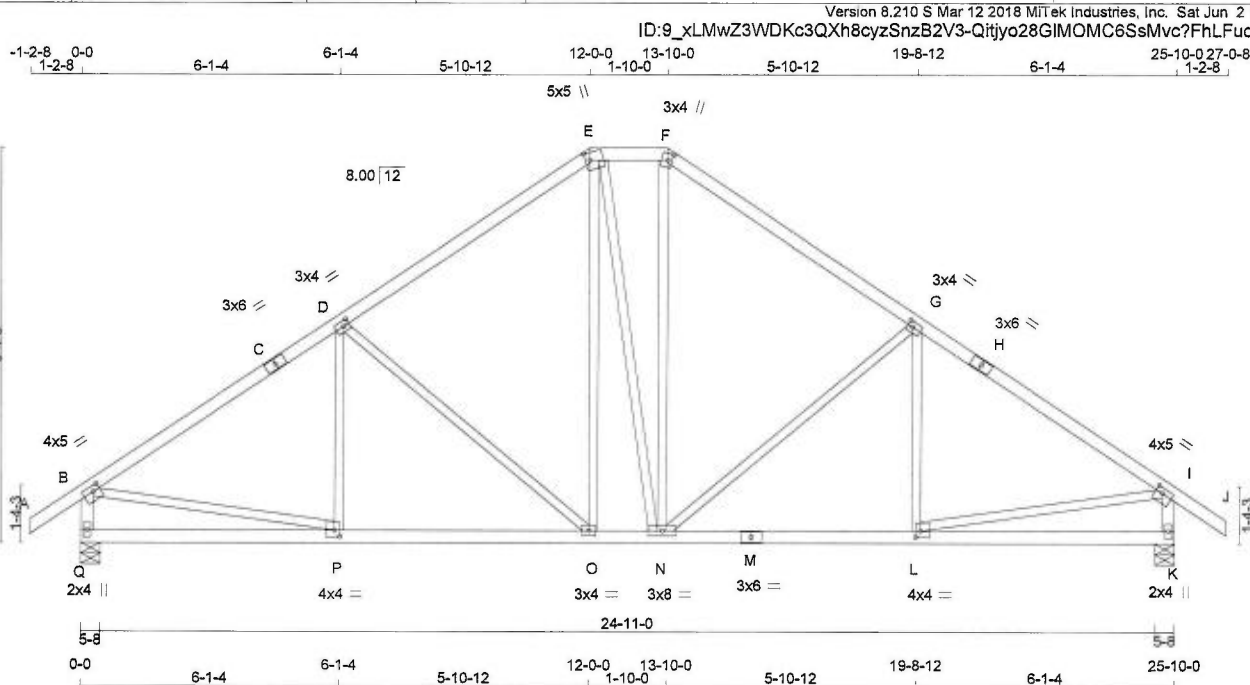

Scale = 1:54.4

TOTAL WEIGHT = 121 lb [M]F

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
Q - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
Q - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	5.0	1.50	2.00
C	TS-t	MT20	3.0	6.0		
D	TMVW-t	MT20	3.0	4.0	1.50	1.50
E	TTWW+m	MT20	5.0	5.0	2.25	1.25
F	TTW+m	MT20	3.0	4.0	2.00	1.25
G	TMVW-t	MT20	3.0	4.0	1.50	1.50
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	5.0	1.50	2.00
K	BMV1+p	MT20	2.0	4.0		
L	BMVW-t	MT20	4.0	4.0	1.75	1.50
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	3.0	8.0		
O	BMVW-t	MT20	3.0	4.0		
P	BMVW-t	MT20	4.0	4.0	1.75	1.50
Q	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1335	0	1335	0
K	1335	0	1335	0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MAX./MIN. LIVE	MAX./MIN. PERM. LIVE	WIND	DEAD	SOIL
Q	935	662 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0
K	935	662 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 MAX CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-77.4	-77.4 0.09 (1)	P-D	-76 / 84	0.03	(1)
B-C	-1422 / 0	-77.4	-77.4 0.41 (1)	D-O	-435 / 0	0.56	(1)
C-D	-1422 / 0	-77.4	-77.4 0.41 (1)	O-E	0 / 334	0.08	(1)
D-E	-1087 / 0	-77.4	-77.4 0.38 (1)	E-N	0 / 11	0.00	(1)
E-F	-883 / 0	-77.4	-77.4 0.04 (1)	N-F	0 / 346	0.08	(1)
F-G	-1089 / 0	-77.4	-77.4 0.38 (1)	G-N	-431 / 0	0.55	(1)
G-H	-1420 / 0	-77.4	-77.4 0.41 (1)	L-G	-80 / 82	0.04	(1)
H-I	-1420 / 0	-77.4	-77.4 0.41 (1)	B-P	0 / 1226	0.28	(1)
I-J	0 / 28	-77.4	-77.4 0.09 (1)	L-I	0 / 1224	0.28	(1)
Q-B	-1290 / 0	0.0	0.0 0.13 (1)				
K-I	-1289 / 0	0.0	0.0 0.13 (1)				
Q-P	0 / 0	-18.2	-18.2 0.17 (4)				
P-O	0 / 1209	-18.2	-18.2 0.28 (1)				
O-N	0 / 881	-18.2	-18.2 0.20 (1)				
N-M	0 / 1207	-18.2	-18.2 0.28 (1)				
M-L	0 / 1207	-18.2	-18.2 0.28 (1)				
L-K	0 / 0	-18.2	-18.2 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.41/1.00 (B-D:1), BC=0.28/1.00 (O-P:1),
WB=0.56/1.00 (D-O:1), SSI=0.19/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (F) (INPUT = 0.90)
JSI METAL= 0.48 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



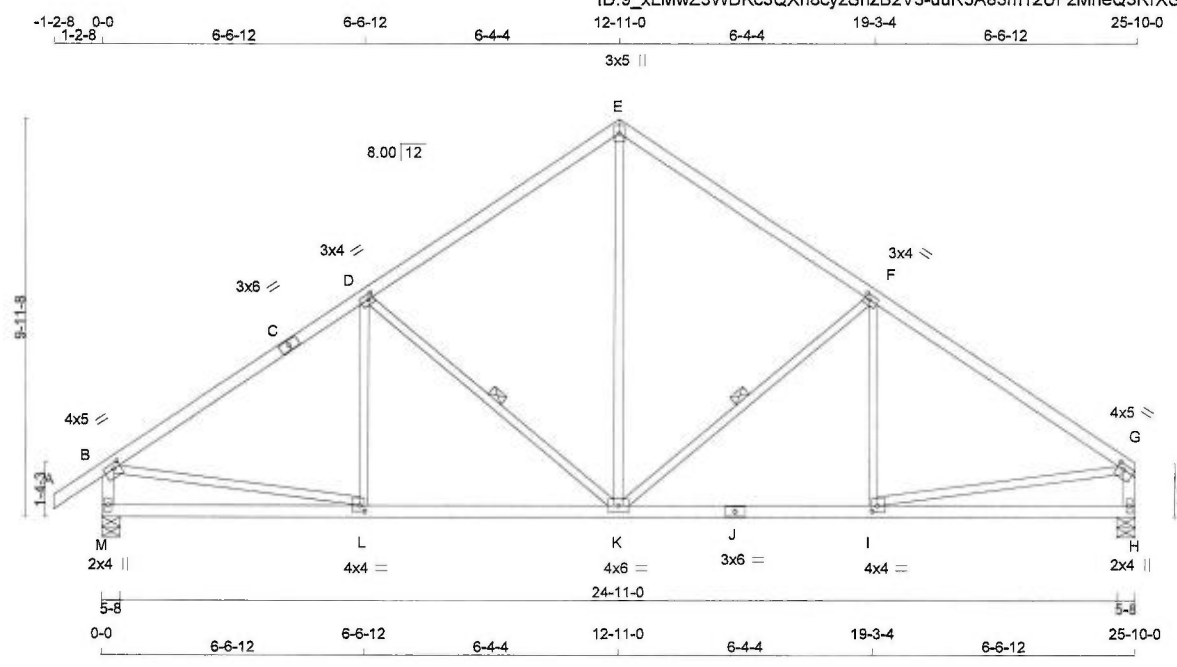

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	5.0	1.50 2.00
C	TS-t	MT20	3.0	6.0	
D	TMVW-t	MT20	3.0	4.0	1.50 1.50
E	TTW+p	MT20	3.0	5.0	
F	TMVW-t	MT20	3.0	4.0	1.50 1.50
G	TMVW-t	MT20	4.0	5.0	1.50 2.00
H	BMV1+p	MT20	2.0	4.0	
I	BMVW-t	MT20	4.0	4.0	1.75 1.50
J	BS-t	MT20	3.0	6.0	
K	BMVW-t	MT20	4.0	4.0	1.75 1.50
L	BMVW-t	MT20	4.0	4.0	1.75 1.50
M	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
M	1335	0	0	1335	0	0	0	5-8	5-8
H	1235	0	0	1235	0	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS						
JT	1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	935	662 / 0	0 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0
H	868	602 / 0	0 / 0	0 / 0	0 / 0	0 / 0	266 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.92 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-K, F-K. DBS = 20-0-0. CBF = 61 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-77.4 -77.4	0.09 (1)	L-D	-57 / 94	0.03 (4)	
B-C	-1415 / 0	-77.4 -77.4	0.48 (1)	D-K	-488 / 0	0.23 (1)	
C-D	-1415 / 0	-77.4 -77.4	0.48 (1)	K-E	0 / 743	0.17 (1)	
D-E	-1036 / 0	-77.4 -77.4	0.44 (1)	E-F	-487 / 0	0.23 (1)	
E-F	-1036 / 0	-77.4 -77.4	0.44 (1)	F-G	-58 / 94	0.03 (4)	
F-G	-1414 / 0	-77.4 -77.4	0.48 (1)	G-H	0 / 1219	0.27 (1)	
M-B	-1285 / 0	0.0 0.0	0.13 (1)	I-G	0 / 1219	0.27 (1)	
H-G	-1186 / 0	0.0 0.0	0.12 (1)				
M-L	0 / 0	-18.2 -18.2	0.18 (4)				
L-K	0 / 1205	-18.2 -18.2	0.29 (1)				
K-J	0 / 1204	-18.2 -18.2	0.29 (1)				
J-I	0 / 1204	-18.2 -18.2	0.29 (1)				
I-H	0 / 0	-18.2 -18.2	0.18 (4)				

TOTAL WEIGHT = 108 lb [M]F

DESIGN CRITERIA		
SPECIFIED LOADS:		
TOP CH.	LL	= 23.3 PSF
	DL	= 3.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.3 PSF
TOTAL LOAD = 33.6 PSF		

SPACING = 24.0 IN. C/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")

CSI: TC=0.48/1.00 (B-D:1), BC=0.29/1.00 (K-L:1), WB=0.27/1.00 (B-L:1), SS=0.20/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (G) (INPUT = 0.90)
JSI METAL= 0.48 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



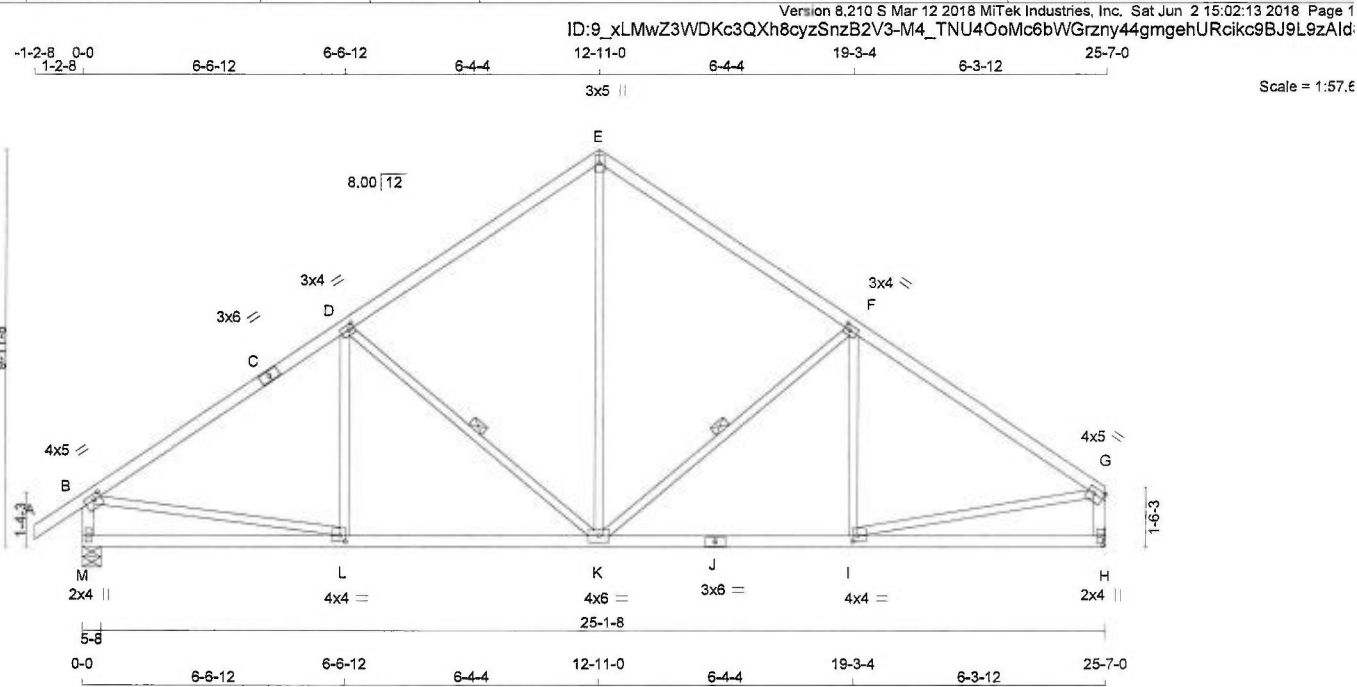

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - E 2x4 DRY No.2 SPF
E - G 2x4 DRY No.2 SPF
M - B 2x4 DRY No.2 SPF
H - G 2x4 DRY No.2 SPF
M - J 2x4 DRY No.2 SPF
J - H 2x4 DRY No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMVW-t MT20 4.0 5.0 1.50 2.00
C TS-t MT20 3.0 6.0
D TMVW-t MT20 3.0 4.0 1.50 1.50
E TTW+p MT20 3.0 5.0
F TMVW-t MT20 3.0 4.0 1.50 1.50
G TMVW-t MT20 4.0 5.0 1.75 Edge
H BMV1+p MT20 2.0 4.0
I BMVW-t MT20 4.0 4.0 1.75 1.50
J BS-t MT20 3.0 6.0
K BMVW-t MT20 4.0 6.0
L BMVW-t MT20 4.0 4.0 1.75 1.50
M BMV1+p MT20 2.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED GROSS REACTION
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
M 1323 0 1323 0 0 5-8 5-8
H 1223 0 1223 0 0 MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT H TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS
1ST LCASE MAX./MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
M 927 656 / 0 0 / 0 0 / 0 0 / 0 271 / 0 0 / 0
H 859 596 / 0 0 / 0 0 / 0 0 / 0 264 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF D-K, F-K, DBS = 20-0-0. CBF = 61 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS: 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)
CHORDS WEBS
MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (LC) MAX. FACTORED FORCE (LBS) MAX. UNBRACED LENGTH (LC)
FR-TO FROM TO FR-TO
A-B 0 / 28 -77.4 -77.4 0.09 (1) 10.00 L-D -55 / 94 0.03 (4)
B-C -1397 / 0 -77.4 -77.4 0.48 (1) 4.94 D-K -490 / 0 0.23 (1)
C-D -1397 / 0 -77.4 -77.4 0.48 (1) 4.94 K-E 0 / 719 0.16 (1)
D-E -1016 / 0 -77.4 -77.4 0.44 (1) 5.63 K-F -448 / 0 0.21 (1)
E-F -1015 / 0 -77.4 -77.4 0.43 (1) 5.65 I-F -91 / 81 0.05 (1)
F-G -1359 / 0 -77.4 -77.4 0.45 (1) 5.04 B-L 0 / 1205 0.27 (1)
M-B -1273 / 0 0.0 0.0 0.13 (1) 7.14 I-G 0 / 1179 0.27 (1)
H-G -1176 / 0 0.0 0.0 0.12 (1) 7.35
M-L 0 / 0 -18.2 -18.2 0.18 (4) 10.00
L-K 0 / 1190 -18.2 -18.2 0.29 (1) 10.00
K-J 0 / 1158 -18.2 -18.2 0.28 (1) 10.00
J-I 0 / 1158 -18.2 -18.2 0.28 (1) 10.00
I-H 0 / 0 -18.2 -18.2 0.18 (4) 10.00

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.48/1.00 (B-D:1), BC=0.29/1.00 (K-L:1), WB=0.27/1.00 (B-L:1), SSI=0.20/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.48 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



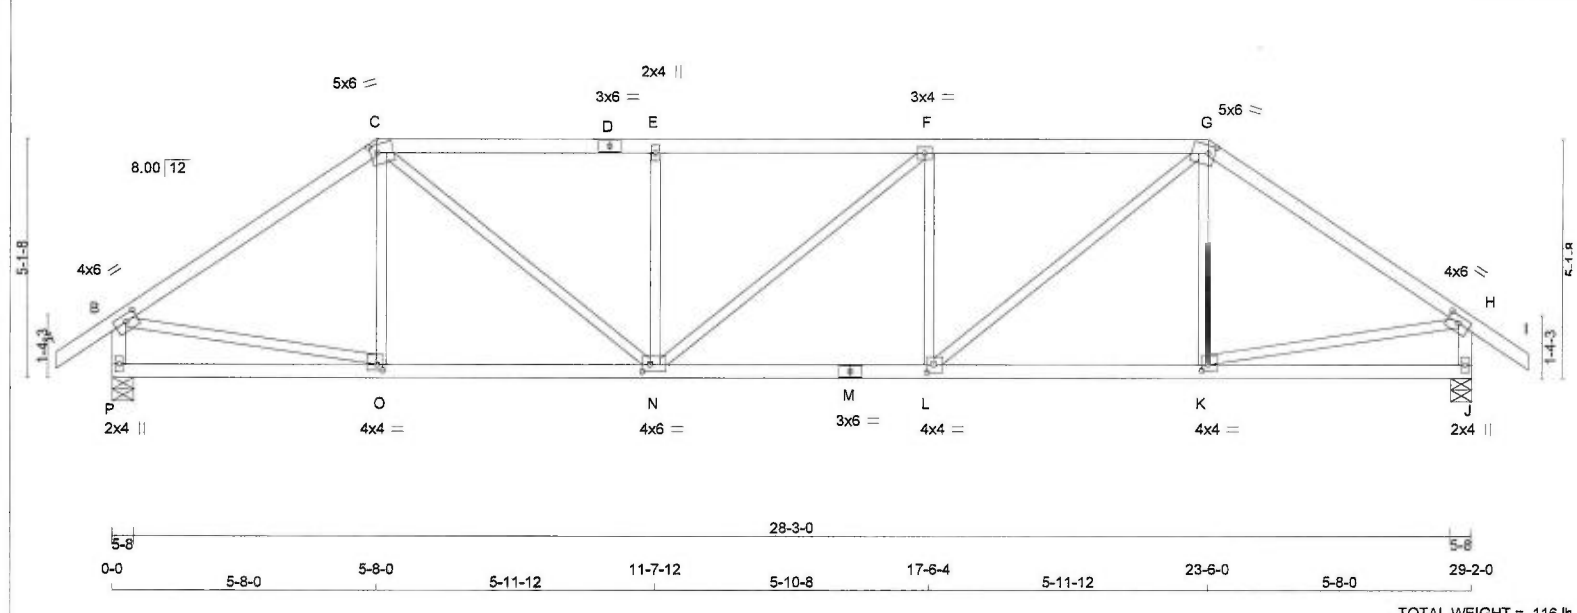

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TTWW-m	MT20	5.0	6.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.00	1.75
H	TMVW-t	MT20	4.0	6.0	1.75	3.00
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	4.0	1.50	1.50
L	BMWW-t	MT20	4.0	4.0	2.00	1.75
M	BS-t	MT20	3.0	6.0		
N	BMWWW-t	MT20	4.0	6.0	1.75	2.00
O	BMWW-t	MT20	4.0	4.0	1.50	1.50
P	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT	REQRD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
P	1494	0	1494	0	0	5-8	5-8
J	1494	0	1494	0	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED MOMENT (K-FT)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	O-C	-117 / 61	0.05 (1)	
B-C	-1609 / 0	-77.4	-77.4	0.55 (1)	4.58	C-N	0 / 956	0.22 (1)	
C-D	-2079 / 0	-77.4	-77.4	0.48 (1)	4.22	N-E	-495 / 0	0.19 (1)	
D-E	-2079 / 0	-77.4	-77.4	0.48 (1)	4.22	N-F	-2 / 0	0.00 (1)	
E-F	-2079 / 0	-77.4	-77.4	0.49 (1)	4.21	L-F	-497 / 0	0.19 (1)	
F-G	-2081 / 0	-77.4	-77.4	0.49 (1)	4.21	L-G	0 / 958	0.22 (1)	
G-H	-1609 / 0	-77.4	-77.4	0.55 (1)	4.58	K-G	-118 / 61	0.05 (1)	
H-I	0 / 28	-77.4	-77.4	0.09 (1)	10.00	B-O	0 / 1359	0.31 (1)	
P-B	-1452 / 0	0.0	0.0	0.15 (1)	6.79	K-H	0 / 1358	0.31 (1)	
J-H	-1452 / 0	0.0	0.0	0.15 (1)	6.79				
P-O	0 / 0	-18.2	-18.2	0.15 (4)	10.00				
O-N	0 / 1335	-18.2	-18.2	0.30 (1)	10.00				
N-M	0 / 2081	-18.2	-18.2	0.39 (1)	10.00				
M-L	0 / 2081	-18.2	-18.2	0.39 (1)	10.00				
L-K	0 / 1335	-18.2	-18.2	0.30 (1)	10.00				
K-J	0 / 0	-18.2	-18.2	0.15 (4)	10.00				

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.55/1.00 (B-C:1), BC=0.39/1.00 (L-N:1), WB=0.31/1.00 (B-O:1), SSI=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (G) (INPUT = 0.90)
JSI METAL= 0.57 (M) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TTWW-m	MT20	5.0	6.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.00	1.75
H	TMVW-t	MT20	4.0	6.0	1.75	3.00
J	BMV1+p	MT20	2.0	4.0		
K	BMVW-t	MT20	4.0	4.0	1.50	1.50
L	BMVW-t	MT20	4.0	4.0	2.00	1.75
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	6.0	1.75	2.00
O	BMVW-t	MT20	4.0	4.0	1.50	1.50
P	BMV1+p	MT20	2.0	4.0		



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



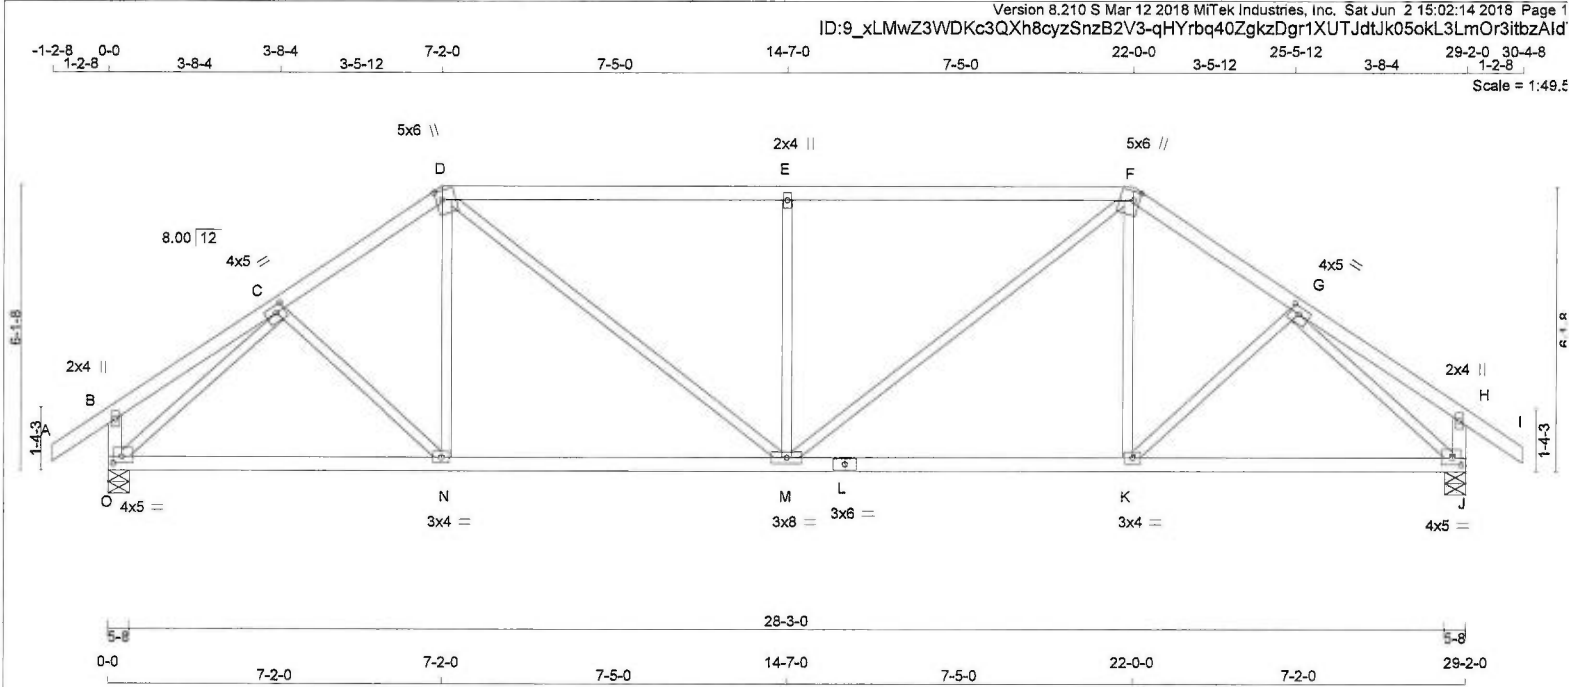

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW-t	MT20	4.0	5.0	1.75	2.25
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMWW-t	MT20	4.0	5.0	1.75	2.25
H	TMV+p	MT20	2.0	4.0		
J	BMVW1-t	MT20	4.0	5.0	1.75	2.25
K	BMWW-t	MT20	3.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWWW-t	MT20	3.0	8.0		
N	BMWW-t	MT20	3.0	4.0		
O	BMVW1-t	MT20	4.0	5.0	1.75	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
O	1494	0	1494	0
J	1494	0	1494	0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-77.4	-77.4 0.09 (1)	C-N	0 / 59	0.02	(4)
B-C	0 / 16	-77.4	-77.4 0.14 (1)	N-D	0 / 134	0.04	(4)
C-D	-1595 / 0	-77.4	-77.4 0.18 (1)	D-M	0 / 672	0.15	(1)
D-E	-1842 / 0	-77.4	-77.4 0.95 (1)	M-E	-706 / 0	0.42	(1)
E-F	-1842 / 0	-77.4	-77.4 0.95 (1)	M-F	0 / 672	0.15	(1)
F-G	-1595 / 0	-77.4	-77.4 0.18 (1)	K-F	0 / 134	0.04	(4)
G-H	0 / 16	-77.4	-77.4 0.14 (1)	K-G	0 / 59	0.02	(4)
H-I	0 / 28	-77.4	-77.4 0.09 (1)	O-C	-1785 / 0	0.70	(1)
O-B	-209 / 0	0.0	0.0 0.02 (1)	G-J	-1785 / 0	0.70	(1)
J-H	-209 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1292	-18.2	-18.2 0.34 (1)				
N-M	0 / 1314	-18.2	-18.2 0.35 (1)				
M-L	0 / 1314	-18.2	-18.2 0.35 (1)				
L-K	0 / 1314	-18.2	-18.2 0.35 (1)				
K-J	0 / 1292	-18.2	-18.2 0.34 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.95/1.00 (D-E:1), BC=0.35/1.00 (K-M:1), WB=0.70/1.00 (G-J:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(Psi) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.53 (C) (INPUT = 1.00)

TOTAL WEIGHT = 119 lb



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



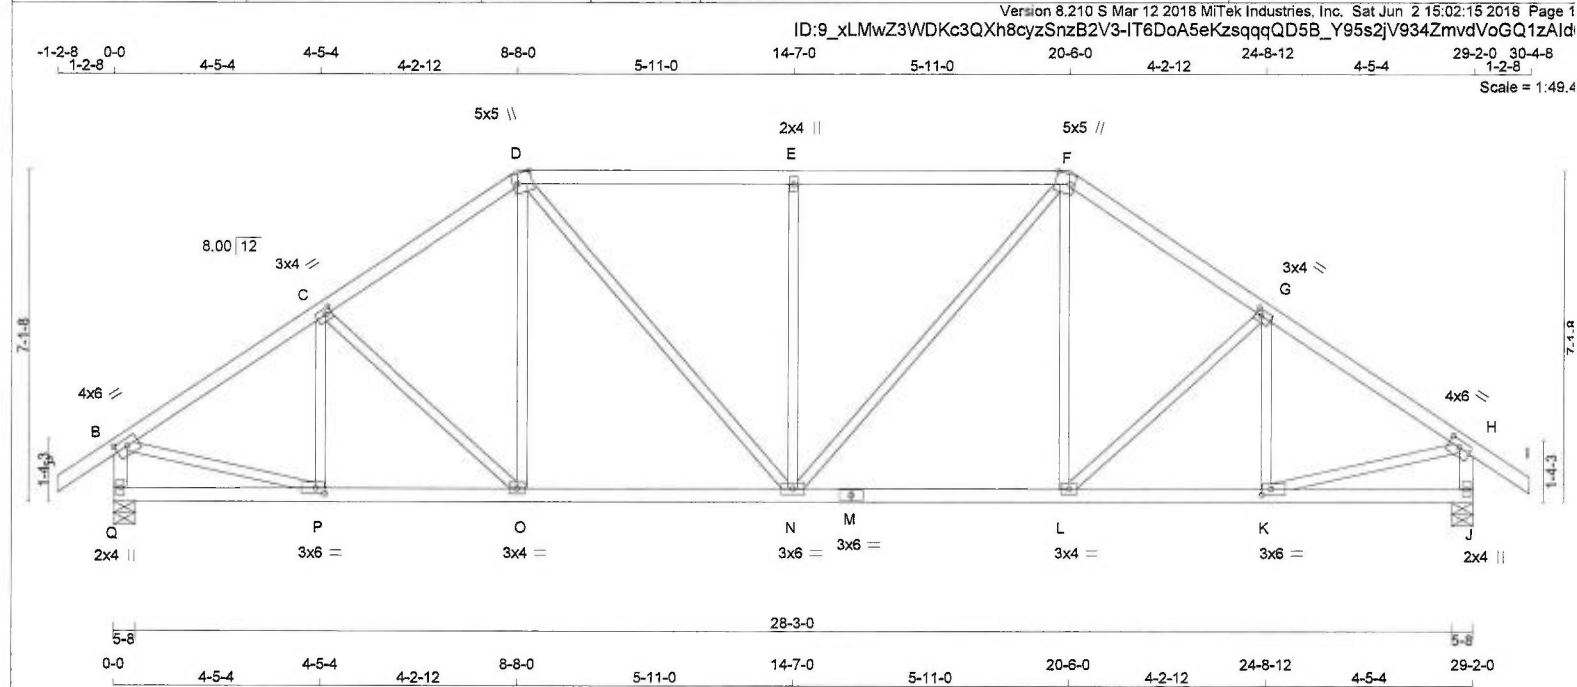

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - D 2x4 DRY No.2 SPF
D - F 2x4 DRY No.2 SPF
F - I 2x4 DRY No.2 SPF
Q - B 2x4 DRY No.2 SPF
J - H 2x4 DRY No.2 SPF
Q - M 2x4 DRY No.2 SPF
M - J 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
Q	1494	0	0	5-8
J	1494	0	0	5-8

UNFACTORED REACTIONS


	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE
Q	1047	739 / 0	0 / 0	0 / 0
J	1047	739 / 0	0 / 0	0 / 0

TOTAL WEIGHT = 128 lb
[M/J/F]

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	1.75	3.00
C	TMVW-t	MT20	3.0	4.0	1.50	1.50
D	TTWW+m	MT20	5.0	5.0	Edge	3.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	5.0	Edge	3.75
G	TMVW-t	MT20	3.0	4.0	1.50	1.50
H	TMVW-t	MT20	4.0	6.0	1.75	3.00
J	BMV1+p	MT20	2.0	4.0		
K	BMVW-t	MT20	3.0	6.0	1.50	2.25
L	BMVW-t	MT20	3.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	3.0	6.0		
O	BMVW-t	MT20	3.0	4.0		
P	BMVW-t	MT20	3.0	6.0	1.50	2.25
Q	BMV1+p	MT20	2.0	4.0		

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010
THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.12")
CSI: TC=0.38/1.00 (E-F:1), BC=0.28/1.00 (O-P:1), WB=0.49/1.00 (E-N:1), SSI=0.22/1.00 (E-F:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 0.50
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.87 (N) (INPUT = 0.90)
JSI METAL= 0.44 (H) (INPUT = 1.00)

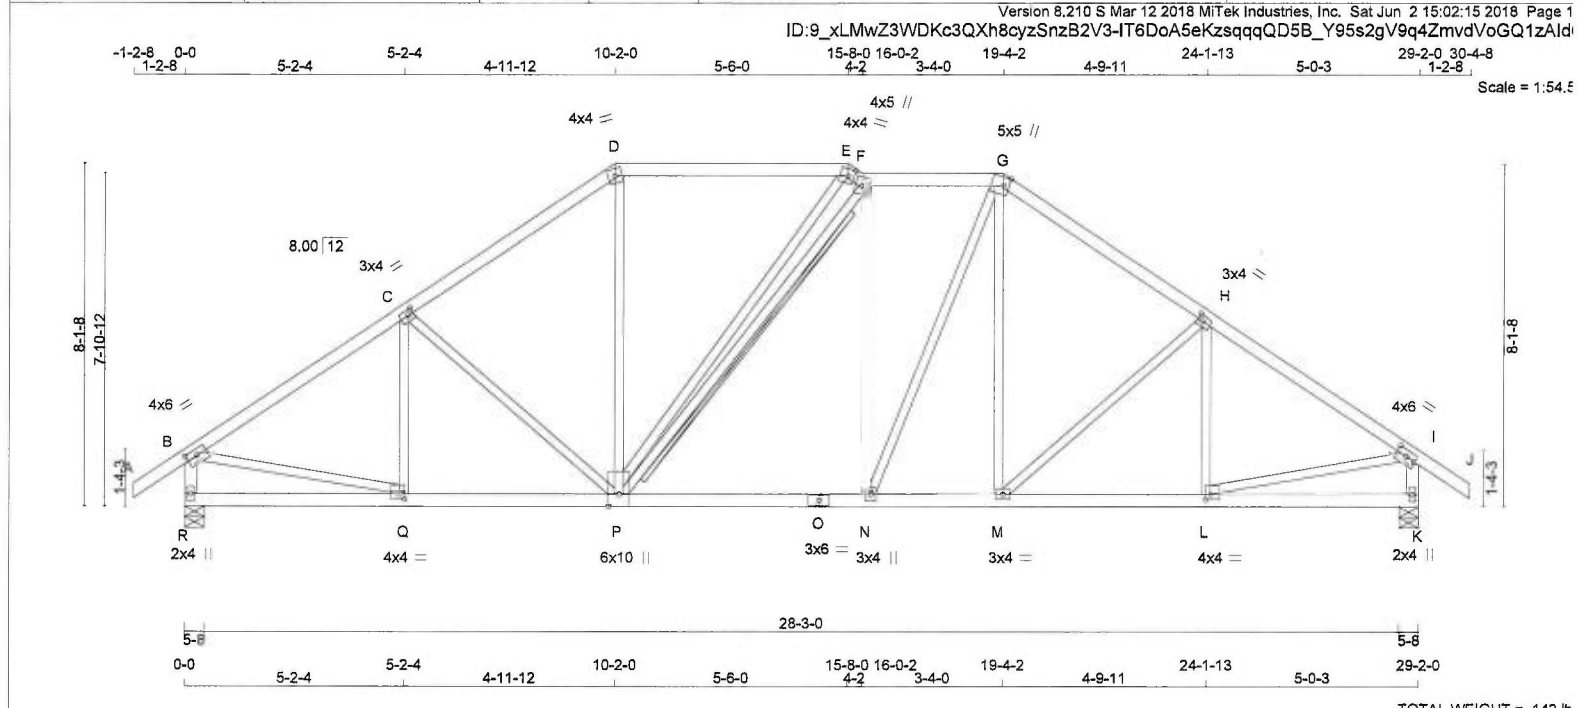


LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQRD	TOP CH.	LL = 23.3	PSF	
A - D	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	BOT CH.	LL = 0.0	PSF	
D - E	2x4	DRY	No.2	JT VERT	DOWN	UPLIFT	IN-SX	TOTAL LOAD	= 33.6	PSF	
E - F	2x4	DRY	No.2	R 1494	0	1494	0				
F - G	2x4	DRY	No.2	K 1494	0	1494	0				
G - J	2x4	DRY	No.2								
R - B	2x4	DRY	No.2								
K - I	2x4	DRY	No.2								
R - O	2x4	DRY	No.2								
O - K	2x4	DRY	No.2								
ALL WEBS	2x3	DRY	No.2	UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C			
EXCEPT				1ST LCASE	MAX./MIN. COMPONENT REACTIONS			LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM			
				JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
				R 1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0	
				K 1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					BRACING				
JT	TYPE	PLATES	W	LEN	Y	X	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.		
B	TMVW-t	MT20	4.0	6.0	1.75	3.00	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.		
C	TMVW-t	MT20	3.0	4.0	1.50	1.50	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.		
D	TTW-m	MT20	4.0	4.0			2x4 DRY SPF No.2 T-BRACE AT F-P		
E	TTW-m	MT20	4.0	4.0	2.00	1.75	FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.		
F	TTW-m	MT20	4.0	5.0			END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW		
G	TTW-m	MT20	5.0	5.0	2.50	1.50	LOADING		
H	TMVW-t	MT20	3.0	4.0	1.50	1.50	TOTAL LOAD CASES: (4)		
I	TMVW-t	MT20	4.0	6.0	1.75	3.00	CHORDS		
K	BMV1+p	MT20	2.0	4.0			MEMB. FORCE VERT. LOAD LC1 MAX		
L	BMVW-t	MT20	4.0	4.0	1.50	1.50	FACTORED (PLF) CSI (LC)		
M	BMVW-t	MT20	3.0	4.0			MAX. UNBRAC LENGTH		
N	BMVW-t	MT20	3.0	4.0			MEMB. FORCE VERT. LOAD LC1 MAX		
O	BS-t	MT20	3.0	6.0			FACTORED (PLF) CSI (LC)		
P	BMVW-t	MT20	6.0	10.0	Edge		MAX. UNBRAC LENGTH		
Q	BMVW-t	MT20	4.0	4.0	1.50	1.50	MEMB. FORCE VERT. LOAD LC1 MAX		
R	BMV1+p	MT20	2.0	4.0			FACTORED (PLF) CSI (LC)		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

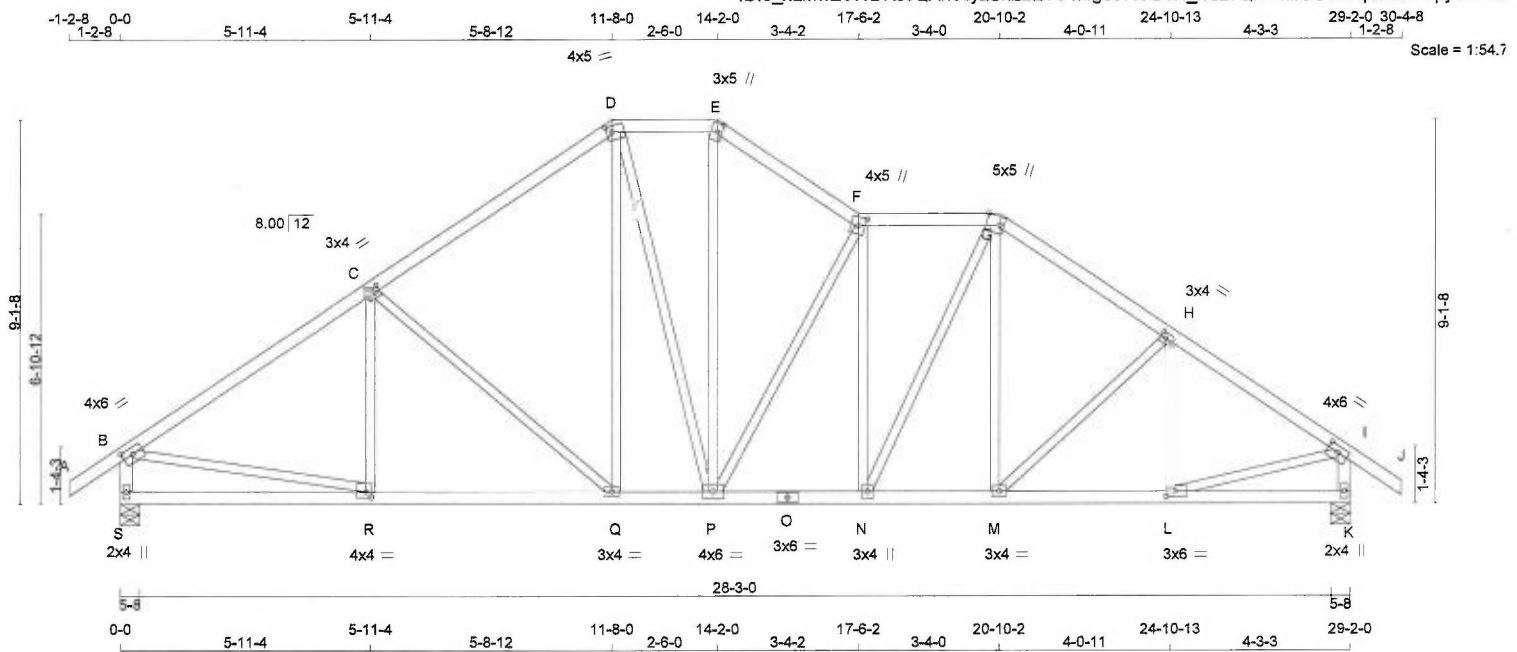

TOTAL WEIGHT = 146 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
S - O	2x4	DRY	No.2	SPF
O - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+t	MT20	4.0	6.0	1.75	3.00
C	CTMWW-t	MT20	3.0	4.0	1.50	1.50
D	TTWW-t-m	MT20	4.0	5.0	1.75	1.50
E	TTW+m	MT20	3.0	5.0	2.50	1.25
F	TTWW+m	MT20	4.0	5.0	2.50	1.75
G	TTWW+m	MT20	5.0	5.0	Edge	3.75
H	MTMWW-t	MT20	3.0	4.0	1.50	1.50
I	TMVW-t	MT20	4.0	6.0	1.75	3.00
K	BMV1+p	MT20	2.0	4.0		
L	BMVW-t	MT20	3.0	6.0	1.50	2.25
M	BMVW-t	MT20	3.0	4.0		
N	BMVW+t	MT20	3.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVWWW-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	3.0	4.0		
R	BMVW-t	MT20	4.0	4.0	1.50	1.50
S	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	1494	0	1494	0	0	5-8	5-8
K	1494	0	1494	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
K	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATEROALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	R-C	-120 / 67 0.05 (1)		
B-C	-1650 / 0	-77.4	-77.4	0.40 (1)	4.75	C-Q	-383 / 0 0.46 (1)		
C-D	-1362 / 0	-77.4	-77.4	0.37 (1)	5.15	Q-D	0 / 325 0.07 (1)		
D-E	-1152 / 0	-77.4	-77.4	0.08 (1)	5.86	D-P	0 / 158 0.04 (1)		
E-F	-1377 / 0	-77.4	-77.4	0.13 (1)	5.42	P-E	0 / 538 0.12 (1)		
F-G	-1475 / 0	-77.4	-77.4	0.13 (1)	5.27	P-F	-722 / 0 0.79 (1)		
G-H	-1538 / 0	-77.4	-77.4	0.19 (1)	5.13	N-F	-382 / 0 0.31 (1)		
H-I	-1610 / 0	-77.4	-77.4	0.20 (1)	5.04	N-G	0 / 482 0.11 (1)		
I-J	0 / 28	-77.4	-77.4	0.09 (1)	10.00	M-G	0 / 164 0.04 (1)		
S-B	-1449 / 0	0.0	0.0	0.15 (1)	6.79	M-H	-131 / 0 0.07 (1)		
K-I	-1459 / 0	0.0	0.0	0.15 (1)	6.77	L-H	-246 / 0 0.07 (1)		
						B-R	0 / 1418 0.32 (1)		
						L-I	0 / 1395 0.31 (1)		
S-R	0 / 0	-18.2	-18.2	0.16 (4)	10.00				
R-Q	0 / 1398	-18.2	-18.2	0.30 (1)	10.00				
Q-P	0 / 1111	-18.2	-18.2	0.22 (1)	10.00				
P-O	0 / 1481	-18.2	-18.2	0.27 (1)	10.00				
O-N	0 / 1481	-18.2	-18.2	0.27 (1)	10.00				
N-M	0 / 1263	-18.2	-18.2	0.23 (1)	10.00				
M-L	0 / 1356	-18.2	-18.2	0.25 (1)	10.00				
L-K	0 / 0	-18.2	-18.2	0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.3	PSF
TOTAL LOAD		=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.12")

CSI: TC=0.40/1.00 (B-C:1), BC=0.30/1.00 (Q-R:1),
WB=0.79/1.00 (F-P:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (G) (INPUT = 0.90)
JSI METAL= 0.52 (R) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



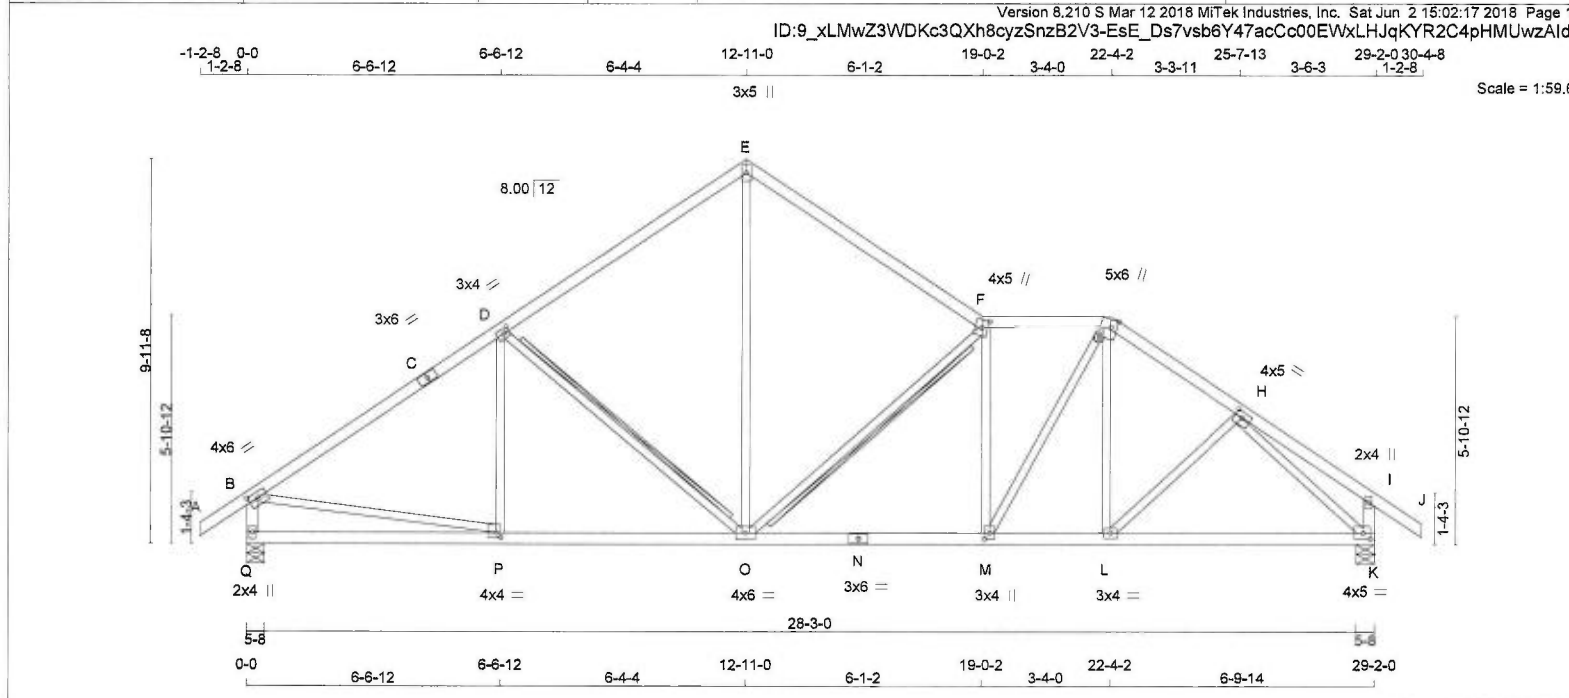


LUMBER				N. L. G. A. RULES				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 129 LBS			
CHORDS				SIZE				LUMBER				DESCR.			
A - C				2x4				DRY				No.2			
C - E				2x4				DRY				No.2			
E - F				2x4				DRY				No.2			
F - G				2x4				DRY				No.2			
G - J				2x4				DRY				No.2			
Q - B				2x4				DRY				No.2			
K - I				2x4				DRY				No.2			
Q - N				2x4				DRY				No.2			
N - K				2x4				DRY				No.2			
ALL WEBS				2x3				DRY				No.2			
EXCEPT												SPF			
DRY: SEASONED LUMBER.															
PLATES (table is in inches)															
JT TYPE PLATES W LEN Y X															
B TMVW-t MT20 4.0 6.0 1.75 3.00															
C TS-t MT20 3.0 6.0															
D TMWW-t MT20 3.0 4.0 1.50 1.50															
E TTW+p MT20 3.0 5.0															
F TTWW+m MT20 4.0 5.0 2.50 1.75															
G TTWW+m MT20 5.0 6.0 Edge 1.75															
H TMWW-t MT20 4.0 5.0 1.75 2.25															
I TMV+p MT20 2.0 4.0															
K BMVW-t MT20 4.0 5.0 1.75 2.25															
L BMWW-t MT20 3.0 4.0															
M BMWW-t MT20 3.0 4.0 1.75 1.50															
N BS-t MT20 3.0 6.0															
O BMWW-t MT20 4.0 6.0															
P BMWW-t MT20 4.0 4.0 1.50 1.50															
Q BMV1+p MT20 2.0 4.0															
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.															
															
READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.															
BEARINGS															
FACTORED MAXIMUM FACTORED INPUT REQD															
GROSS REACTION GROSS REACTION BRG BRG															
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX															
Q 1494 0 1494 0 0 5-8 5-8															
K 1494 0 1494 0 0 5-8 5-8															
UNFACTORED REACTIONS															
1ST LCASE MAX./MIN. COMPONENT REACTIONS															
JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL															
Q 1047 739 / 0 0 / 0 0 / 0 0 / 0 308 / 0 0 / 0															
K 1047 739 / 0 0 / 0 0 / 0 0 / 0 308 / 0 0 / 0															
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K															
BRACING															
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.62 FT.															
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.															
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.															
2x4 DRY SPF No.2 T-BRACE AT D-O, F-O															
FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.															
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW															
LOADING															
TOTAL LOAD CASES: (4)															
CHORDS WEBS															
MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRAC LENGTH FR-TO															
MEMB. FORCE (LBS) VERT. LOAD (PLF) MAX. UNBRAC LENGTH FR-TO															
FR-TO FROM TO															
A-B 0 / 28 -77.4 -77.4 0.09 (1) 10.00 P-D -90 / 82 0.05 (1)															
B-C -1646 / 0 -77.4 -77.4 0.50 (1) 4.62 D-O -459 / 0 0.24 (1)															
C-D -1646 / 0 -77.4 -77.4 0.50 (1) 4.62 Q-E 0 / 974 0.22 (1)															
D-E -1293 / 0 -77.4 -77.4 0.46 (1) 5.12 Q-F -822 / 0 0.43 (1)															
E-F -1258 / 0 -77.4 -77.4 0.41 (1) 5.26 M-F -505 / 0 0.27 (1)															
F-G -1644 / 0 -77.4 -77.4 0.14 (1) 5.05 M-G 0 / 653 0.15 (1)															
G-H -1599 / 0 -77.4 -77.4 0.13 (1) 5.12 L-G 0 / 88 0.03 (4)															
H-I 0 / 15 -77.4 -77.4 0.12 (1) 10.00 L-H 0 / 64 0.02 (4)															
I-J 0 / 28 -77.4 -77.4 0.09 (1) 10.00 B-P 0 / 1414 0.32 (1)															
Q-B -1444 / 0 0.0 0.0 0.15 (1) 6.80 H-K -1777 / 0 0.64 (1)															
K-I -205 / 0 0.0 0.0 0.02 (1) 7.81															
Q-P 0 / 0 -18.2 -18.2 0.18 (4) 10.00															
P-O 0 / 1397 -18.2 -18.2 0.31 (1) 10.00															
O-N 0 / 1653 -18.2 -18.2 0.35 (1) 10.00															
N-M 0 / 1653 -18.2 -18.2 0.35 (1) 10.00															
M-L 0 / 1317 -18.2 -18.2 0.31 (1) 10.00															
L-K 0 / 1277 -18.2 -18.2 0.31 (1) 10.00															
DESIGN CRITERIA															
SPECIFIED LOADS:															
TOP CH. LL = 23.3 PSF															
DL = 3.0 PSF															
BOT CH. LL = 0.0 PSF															
DL = 7.3 PSF															
TOTAL LOAD = 33.6 PSF															
SPACING = 24.0 IN. C/C															
LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM															
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010															
THIS DESIGN COMPLIES WITH:															
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014															
- CSA 086-09															
- TPIC 2011															
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD															
ALLOWABLE DEFL.(LL)= L/360 (0.97")															
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.08")															
ALLOWABLE DEFL.(TL)= L/360 (0.97")															
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")															
CSI: TC=0.50/1.00 (B-D:1), BC=0.35/1.00 (M-O:1), WB=0.64/1.00 (H-K:1), SSI=0.20/1.00 (B-D:1)															
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10															
COMP=1.10 SHEAR=1.10 TENS=1.10															
COMPANION LIVE LOAD FACTOR = 0.50															
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.															
NAIL VALUES															
PLATE GRIP(DRY) SHEAR SECTION															
(PSI) (PLI) (PLI)															
MAX MIN MAX MIN MAX MIN															
MT20 618 354 1667 822 2284 1656															
PLATE PLACEMENT TOL. = 0.250 inches															
PLATE ROTATION TOL. = 5.0 Deg.															
JSI GRIP= 0.90 (H) (INPUT = 0.90)															
JSI METAL= 0.53 (H) (INPUT = 1.00)															
															



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



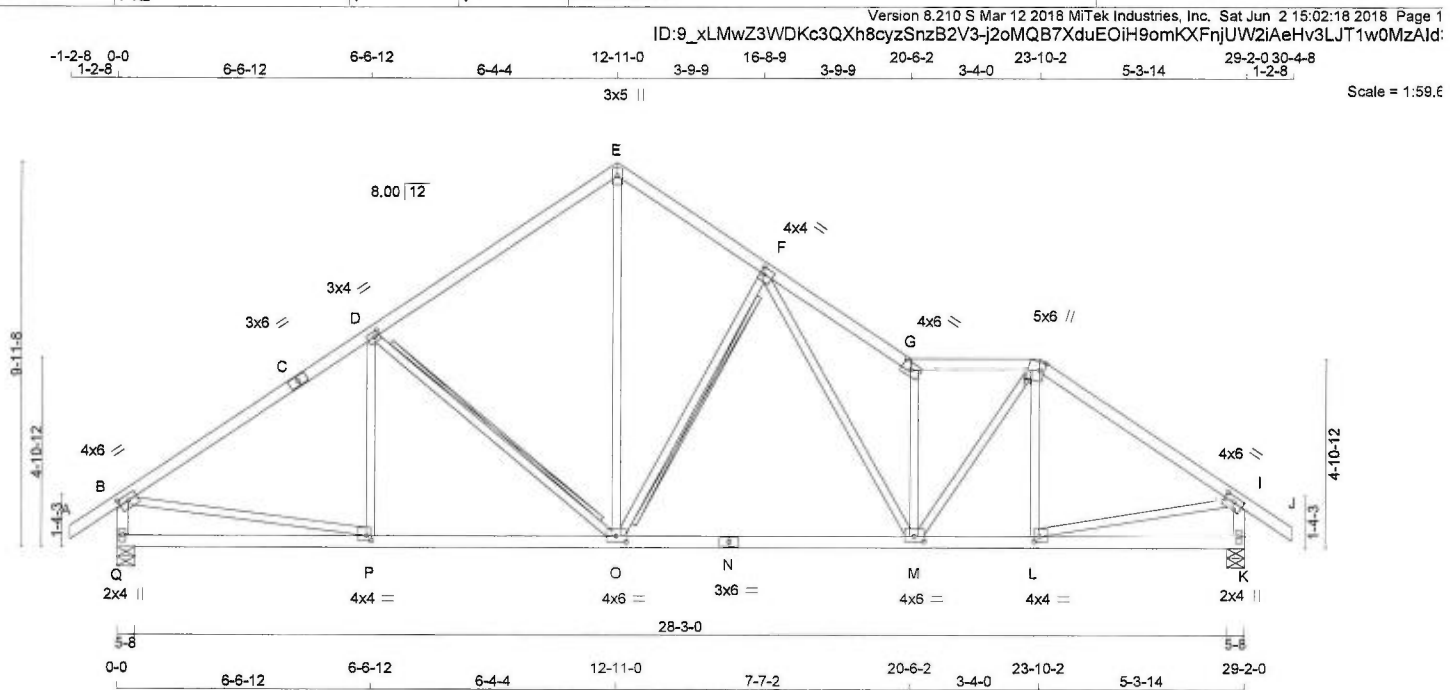

TOTAL WEIGHT = 130 lb
[M][F]

LUMBER		N. L. G. A. RULES		LUMBER		DESCR.	
CHORDS	SIZE						
A - C	2x4	DRY	No.2		SPF		
C - E	2x4	DRY	No.2		SPF		
E - G	2x4	DRY	No.2		SPF		
G - H	2x4	DRY	No.2		SPF		
H - J	2x4	DRY	No.2		SPF		
Q - B	2x4	DRY	No.2		SPF		
K - I	2x4	DRY	No.2		SPF		
Q - N	2x4	DRY	No.2		SPF		
N - K	2x4	DRY	No.2		SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2		SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVVW-t	MT20	4.0	6.0	1.75	3.00
C	TS-t		3.0	6.0		
D	TMVVW-t	MT20	3.0	4.0	1.50	1.50
E	TTW+p	MT20	3.0	5.0		
F	TMVVW-t	MT20	4.0	4.0	2.00	1.25
G	TTW-h		4.0	6.0	2.25	3.00
H	TTVVW+m	MT20	5.0	6.0	2.50	1.50
I	TMVVW-t	MT20	4.0	6.0	1.75	3.00
K	BMVW+p	MT20	2.0	4.0		
L	BMVVW-t	MT20	4.0	4.0	1.50	1.50
M	BMVVWV-t		4.0	6.0	1.50	3.00
N	BS-t	MT20	3.0	6.0		
O	BMVVWV-t	MT20	4.0	6.0	1.75	3.00
P	BMVVW-t	MT20	4.0	4.0	1.50	1.50
Q	BMVW+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1494	0	1494	0	0	5-8	5-8
K	1494	0	1494	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0
K	1047	739 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-O, F-O

FASTEN T AND I-BRACES TO NARROW-EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX	CS1 (LC)	
FR-TO		FROM TO	CS1 (LC)	LENGTH	FR-TO				
A-B	0 / 28	-77.4	-77.4	0.09 (1)	10.00	P-D	-96 / 77		0.05 (1)
B-C	-1845 / 0	-77.4	-77.4	0.50 (1)	4.63	D-O	-454 / 0		0.24 (1)
C-D	-1845 / 0	-77.4	-77.4	0.50 (1)	4.63	O-E	0 / 1105		0.25 (1)
D-E	-1265 / 0	-77.4	-77.4	0.46 (1)	5.12	O-F	-761 / 0		0.37 (1)
E-F	-1282 / 0	-77.4	-77.4	0.16 (1)	5.53	F-M	0 / 968		0.22 (1)
F-G	-2230 / 0	-77.4	-77.4	0.21 (1)	4.41	M-G	-1483 / 0		0.52 (1)
G-H	-1842 / 0	-77.4	-77.4	0.15 (1)	4.82	M-H	0 / 888		0.20 (1)
H-I	-1606 / 0	-77.4	-77.4	0.33 (1)	4.89	L-H	-168 / 10		0.06 (1)
I-J	0 / 28	-77.4	-77.4	0.09 (1)	10.00	B-P	0 / 1413		0.32 (1)
Q-B	-1443 / 0	0.0	0.0	0.15 (1)	6.81	L-I	0 / 1358		0.31 (1)
K-I	-1451 / 0	0.0	0.0	0.15 (1)	6.79				
Q-P	0 / 0	-18.2	-18.2	0.17 (4)	10.00				
P-O	0 / 1396	-18.2	-18.2	0.35 (1)	10.00				
O-N	0 / 1409	-18.2	-18.2	0.35 (1)	10.00				
N-M	0 / 1409	-18.2	-18.2	0.35 (1)	10.00				
M-L	0 / 1331	-18.2	-18.2	0.27 (1)	10.00				
L-K	0 / 0	-18.2	-18.2	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.3	PSF
TOTAL LOAD	=	33.6	PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= 1/360 (0.97")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.10")
ALLOWABLE DEFL.(TL)= 1/360 (0.97")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.23")

CSI: TC=0.50/1.00 (B-D:1) , BC=0.35/1.00 (M-O:1) ,
WB=0.52/1.00 (G-M:1) , SSI=0.20/1.00 (B-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.55 (G) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



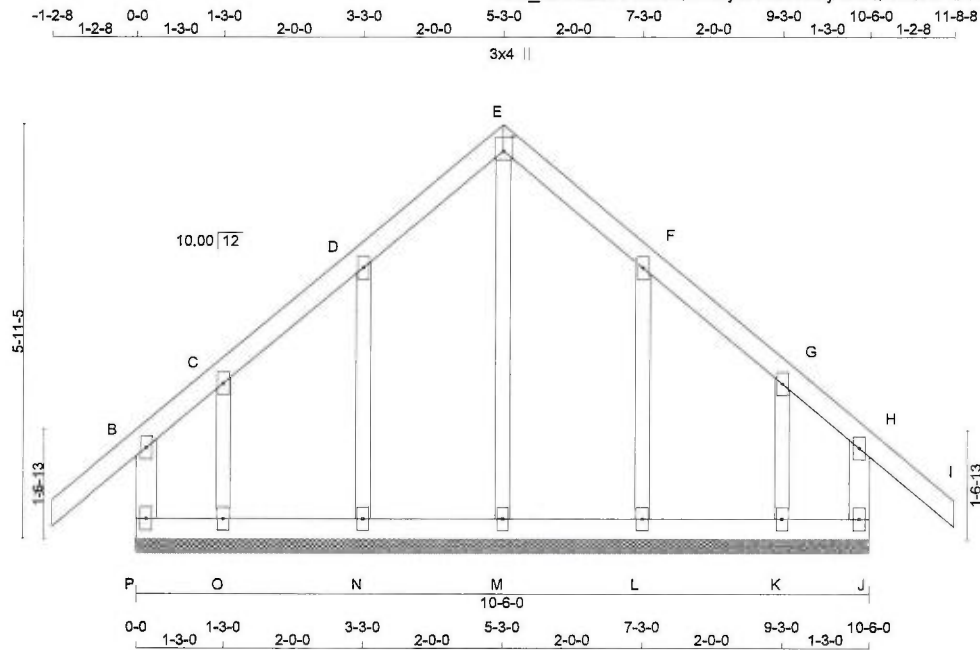

Scale = 1:33.0

TOTAL WEIGHT = 48 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C, D, F, G						
C	TMW+w	MT20	2.0	4.0		
E	TTW+p	MT20	3.0	4.0	2.50	1.50
H	TMV+p	MT20	2.0	4.0		
J	BMV1+p	MT20	2.0	4.0		
K, L, M, N, O						
K	BMV1+w	MT20	2.0	4.0		
P	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 / 32	-77.4	-77.4	0.09 (1)	10.00	M-E	-191 / 0	0.10 (1)	
B-C	0 / 0	-77.4	-77.4	0.06 (1)	10.00	N-D	-167 / 0	0.05 (1)	
C-D	0 / 28	-77.4	-77.4	0.05 (1)	10.00	O-C	-83 / 0	0.01 (1)	
D-E	0 / 26	-77.4	-77.4	0.05 (1)	10.00	L-F	-167 / 0	0.05 (1)	
E-F	0 / 26	-77.4	-77.4	0.05 (1)	10.00	K-G	-83 / 0	0.01 (1)	
F-G	0 / 28	-77.4	-77.4	0.05 (1)	10.00				
G-H	0 / 0	-77.4	-77.4	0.06 (1)	10.00				
H-I	0 / 32	-77.4	-77.4	0.09 (1)	10.00				
P-B	-161 / 0	0.0	0.0	0.03 (1)	7.81				
J-H	-161 / 0	0.0	0.0	0.03 (1)	7.81				
P-O	-14 / 0	-18.2	-18.2	0.01 (4)	6.25				
O-N	-17 / 0	-18.2	-18.2	0.02 (4)	6.25				
N-M	-21 / 0	-18.2	-18.2	0.02 (4)	6.25				
M-L	-21 / 0	-18.2	-18.2	0.02 (4)	6.25				
L-K	-17 / 0	-18.2	-18.2	0.02 (4)	6.25				
K-J	-14 / 0	-18.2	-18.2	0.01 (4)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	23.3	PSF
		DL	=	3.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.3	PSF
TOTAL LOAD				=	33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (H-I:1), BC=0.02/1.00 (L-M:4),
WB=0.10/1.00 (E-M:1), SSI=0.06/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (E) (INPUT = 0.90)
JSI METAL= 0.06 (E) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



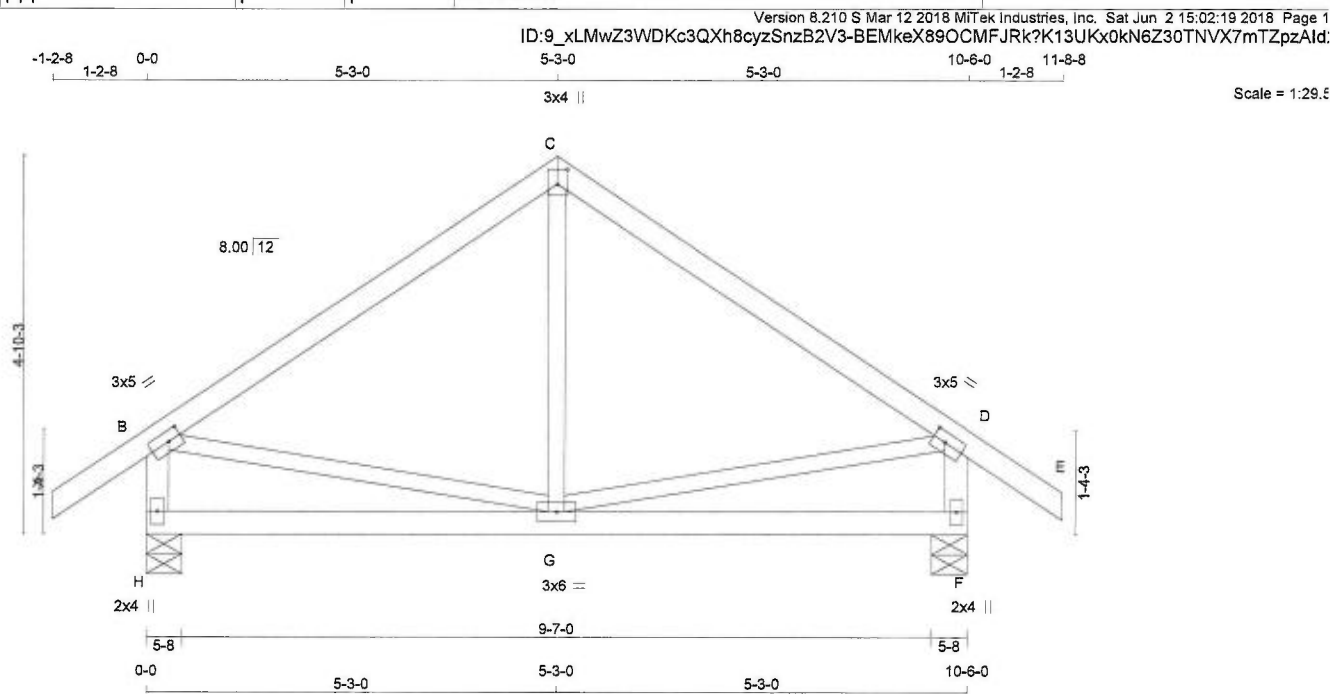

TOTAL WEIGHT = 44 lb [M]F

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	3.0	5.0	1.50	2.00
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMVW-t	MT20	3.0	5.0	1.50	2.00
F	BMV1+p	MT20	2.0	4.0		
G	BMVW-t	MT20	3.0	6.0		
H	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	IN-SX
H	602	0	602	0	5-8
F	602	0	602	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	420	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0
F	420	305 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	UNBRAC LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	G-C	0 / 93	0.03 (4)
B-C	-365 / 0	-77.4	-77.4 0.27 (1)	6.25	B-G	0 / 310	0.07 (1)
C-D	-365 / 0	-77.4	-77.4 0.27 (1)	6.25	G-D	0 / 310	0.07 (1)
D-E	0 / 28	-77.4	-77.4 0.09 (1)	10.00			
H-B	-565 / 0	0.0	0.0 0.06 (1)	7.81			
F-D	-565 / 0	0.0	0.0 0.06 (1)	7.81			
H-G	0 / 0	-18.2	-18.2 0.14 (4)	10.00			
G-F	0 / 0	-18.2	-18.2 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.27/1.00 (C-D:1), BC=0.14/1.00 (F-G:4), WB=0.07/1.00 (B-G:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (G) (INPUT = 0.90)
JSI METAL = 0.16 (D) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



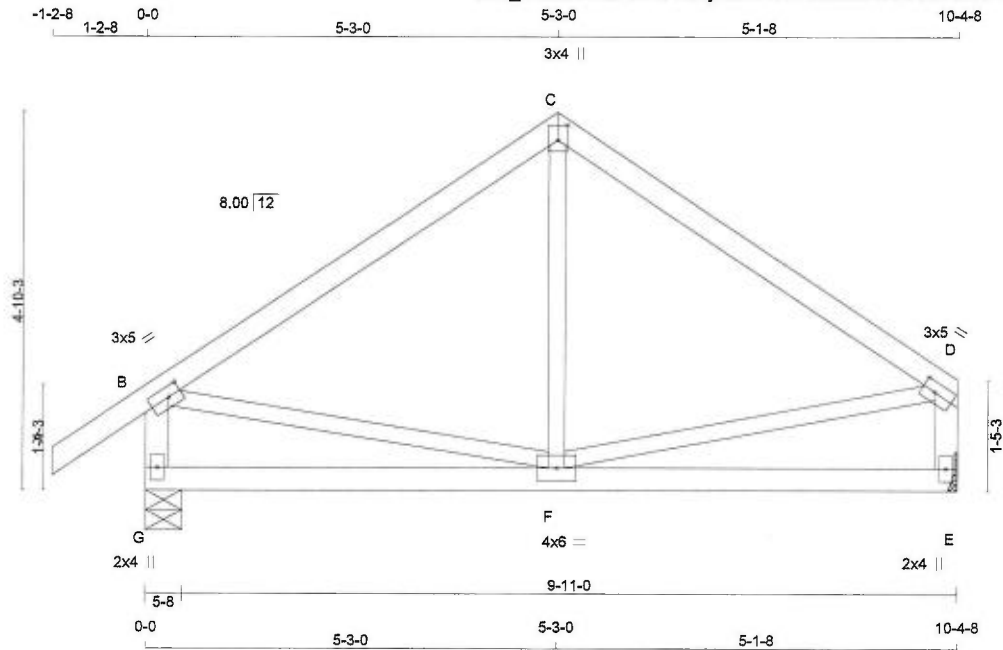

Scale = 1:29.5

TOTAL WEIGHT = 3 X 42 = 125 lb
[M]F

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVWt	MT20	3.0	5.0	1.50	2.00
C	TTW+p	MT20	3.0	4.0	2.25	1.50
D	TMVWt	MT20	3.0	5.0	1.50	2.00
E	BMV1+p	MT20	2.0	4.0		
F	BMVWVt	MT20	4.0	6.0		
G	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX
G	596	0	596	0	0	5-8	5-8		
E	496	0	496	0	0	MECHANICAL			

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT E TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	416	302 / 0	0 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
E	348	242 / 0	0 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-77.4	-77.4 0.09 (1)	10.00	F-C	-6 / 90	0.03 (4)
B-C	-357 / 0	-77.4	-77.4 0.27 (1)	6.25	B-F	0 / 302	0.07 (1)
C-D	-357 / 0	-77.4	-77.4 0.26 (1)	6.25	F-D	0 / 304	0.07 (1)
G-B	-559 / 0	0.0	0.0 0.06 (1)	7.81			
E-D	-460 / 0	0.0	0.0 0.05 (1)	7.81			
G-F	0 / 0	-18.2	-18.2 0.14 (4)	10.00			
F-E	0 / 0	-18.2	-18.2 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.3 PSF
TOTAL LOAD = 33.6 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.27/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.07/1.00 (D-F:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately $1/3$ the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

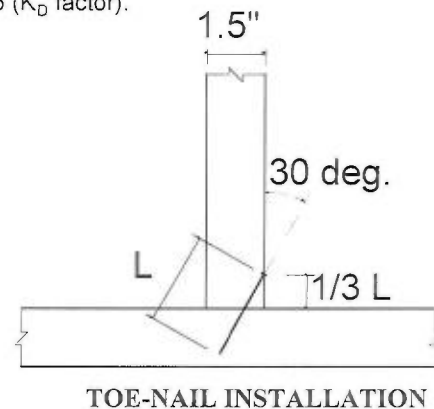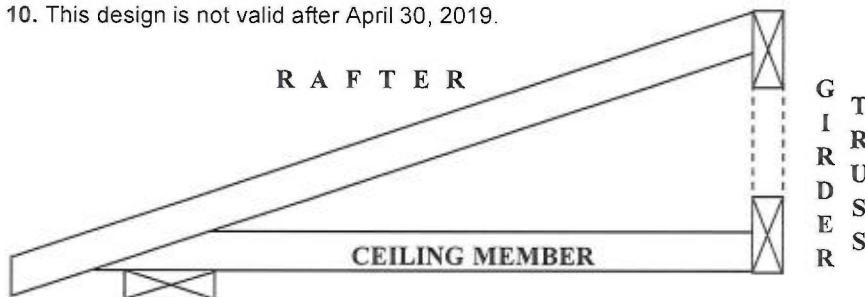

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

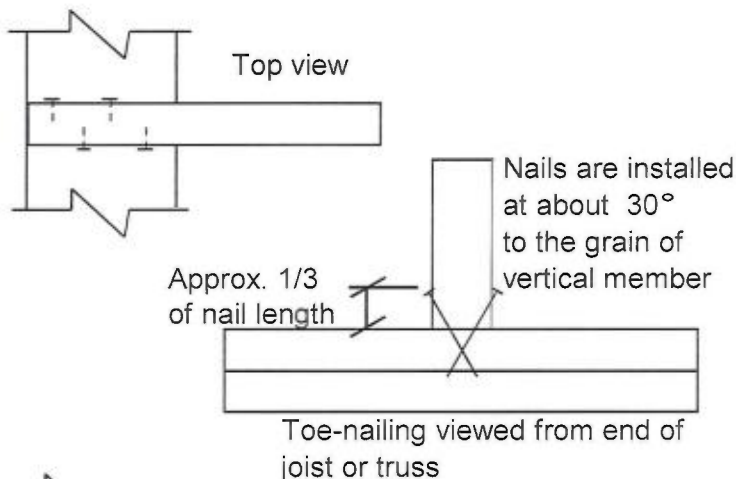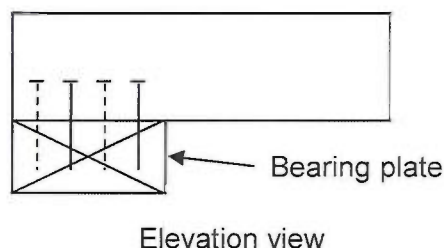

Toe-nailing on 2x4 Bearing Plate

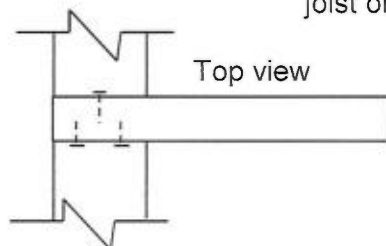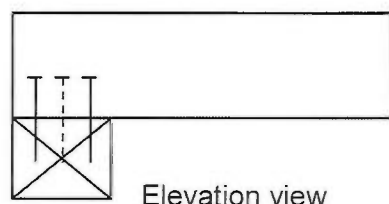

MiTek Canada Inc
100 Industrial Rd
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017