

Energy Efficiency Design Summary: Prescriptive Method

(Building Code Part 9, Residential)

This form is used by a designer to demonstrate that the energy efficiency design of a house complies with the building code using the prescriptive method described in Subsection 3.1.1. of SB-12. This form is applicable where the ratio of gross area of windows/sidelights/skylights/glazing in doors and sliding glass doors to the gross area of peripheral walls is not more than 22%.

For use by Principal Authority	
Application No:	Model/Certification Number INDIGO 1, EL-1

A. Project Information

Building number, street name 1 Penle a Gate	Unit number	Lot/Con 27
Municipality City of Brampton	Postal code	Reg. Plan number / other description 43M-2057

B. Prescriptive Compliance [indicate the building code compliance package being employed in this house design]

SB-12 Prescriptive (input design package): Package: **A1** Table: _____

C. Project Design Conditions


Climatic Zone (SB-1):	Heating Equipment Efficiency	Space Heating Fuel Source
☐ Zone 1 (< 5000 degree days)	☐ ≥ 92% AFUE	☐ Gas ☐ Propane ☐ Solid Fuel
☐ Zone 2 (≥ 5000 degree days)	☐ ≥ 84% < 92% AFUE	☐ Oil ☐ Electric ☐ Earth Energy
Ratio of Windows, Skylights & Glass (W, S & G) to Wall Area	Other Building Characteristics	
Area of walls = 356.32 m ² or _____ ft ²	☐ Log/Post&Beam ☐ ICF Above Grade ☐ ICF Basement	
	☐ Slab-on-ground ☐ Walkout Basement	
	☐ Air Conditioning ☐ Combo Unit	
	☐ Air Sourced Heat Pump (ASHP)	
	☐ Ground Sourced Heat Pump (GSHP)	
Area of W, S & G = 48.01 m ² or _____ ft ²	W, S & G % = 13.47%	
	Utilize window averaging: ☐ Yes ☐ No	

D. Building Specifications [provide values and ratings of the energy efficiency components proposed]

Energy Efficiency Substitutions				
☐ ICF (3.1.1.2.(5) & (6) / 3.1.1.3.(5) & (6))				
☐ Combined space heating and domestic water heating systems (3.1.1.2.(7) / 3.1.1.3.(7))				
☐ Airtightness substitution(s)				
Airtightness test required (Refer to Design Guide Attached)		☐ Table 3.1.1.4.B Required: _____ Permitted Substitution: _____ ☐ Table 3.1.1.4.C Required: _____ Permitted Substitution: _____ Required: _____ Permitted Substitution: _____		
Building Component	Minimum RSI / R values or Maximum U-Value ⁽¹⁾		Building Component	Efficiency Ratings
Thermal Insulation	Nominal	Effective	Windows & Doors Provide U-Value ⁽¹⁾ or ER rating	
Ceiling with Attic Space	10.57	10.43	Windows/Sliding Glass Doors	1.6
Ceiling without Attic Space	5.46	4.87	Skylights/Glazed Roofs	2.8
Exposed Floor	5.46	5.25	Mechanicals	
Walls Above Grade	4.22	3.00	Heating Equip.(AFUE)	96%
Basement Walls	3.52	3.72	HRV Efficiency (SRE% at 0° C)	75%
Slab (all >600mm below grade)	-	-	DHW Heater (EF)	0.83
Slab (edge only ≤600mm below grade)	1.76	1.76	DWHR (CSA B55.1 (min. 42% efficiency))	42 # Showers 2
Slab (all ≤600mm below grade, or heated)	1.76	1.96	Combined Heating System	N/A

(1) U value to be provided in either W/(m²·K) or Btu/(h·ft²·F) but not both.

E. Designer(s) [name(s) & BCIN(s), if applicable, of person(s) providing information herein to substantiate that design meets the building code]

Qualified Designer Declaration of designer to have reviewed and take responsibility for the design work.		
Name Walter Botter Jardin Design Group Inc.	BCIN 21031 27763	Signature 

19-447 257 000-00 RL

OPTIONAL
STAIR

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI

APR 17 2019

ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

A-12X8

COLDCELLAR

Y-22X8

OPT LW
FOR OPT
STAIR

X-32X8
24X12

BR FLC
5X10
C/W DAMPER

HRV
LIFEBREATH
RNC5-HEX

UNFINISHED
BASEMENT

D-26X8

E-8X8

C-16X8

A HEAT RECOVERY VENTILATOR SHALL BE INSTALLED IN
COMPLIANCE WITH OBC DIV. B, 6.2.1.6, 9.32.3.6(3), 9.32.3.11
AND HRAI DIGEST REQUIREMENTS.

UNEXCAVATED

B-12X8

ELEVATION 1

MECHANICAL VENTILATION SHALL BE PROVIDED IN
CONFORMANCE WITH OBC DIV. B, 9.32.3 REQUIREMENTS.

THE INSTALLATION OF CARBON MONOXIDE DETECTOR(S)
SHALL COMPLY WITH OBC DIV. B, 9.33.4 REQUIREMENTS.

UNEXCAVATED

ELEVATION 2

CSA-F280-12
PACKAGE A1

INSTALLATION OF KITCHEN EXHAUST DUCT LARGER THAN 6" dia SHALL BE PRECEDED
BY APPLICATION FOR REVISION OF DESIGN PER OBC PART 6 REQUIREMENTS.
EXHAUST FAN SHALL DISCHARGE DIRECTLY TO OUTSIDE. CLOTHES DRYER EXHAUST
SYSTEM SHALL COMPLY WITH OBC DIV B 9.32.1.2, 9.32.1.3 & 9.32.3 REQ'S. BALANCE
THE RETURN AIRFLOW ON THE UPPER FLOOR TO MATCH THE SUPPLY.
WHEN HRV IS USED AS PRINCIPAL EXHAUST FAN, THE CONTROLLER SHALL BE WIRED
TO THE HRV UNIT AND INTERCONNECTED TO THE FURNACE FAN. THE FURNACE
BLOWER MUST BE IN OPERATION WHEN THE HRV IS IN OPERATION.
- OBC DIV B 9.33.3.1(1).
UNDERCUT BY MIN 1". THE DOOR TO ANY ROOM WITHOUT RETURN AIR GRILLE.
ENSURE RETURN AIR INTAKE SHALL BE CONNECTED TO THE MAIN R/A DUCT AT A
HORIZONTAL DISTANCE OF MIN 6FT FROM THE CASING OF THE UNIT (HRAI DIGEST).

INSTALLATION OF HVAC EQUIP.
SHALL CONFORM TO MANUFACTURER'S SPECIFICATIONS
AND MANUALS

I MICHAEL O'Rourke HAVE REVIEW
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND
USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE
USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE
ONTARIO BUILDING CODE.

Client
GREENYORK HOMES
Project Name
GRANELLI HOMES CORP
BRAMPTON, ONTARIO
M-2057 LOT 27
INDIGO 1 3187 sqft

HVACDESIGNS LTD.


375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply
branch outlets shall be equipped with a manual balancing damper.
Ductwork which passes through the garage or unheated spaces shall be
adequately insulated and be gas-proofed.

HEAT LOSS 58217 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS		
MAKE	CARRIER	3RD FLOOR		
MODEL	59SP5A-80-16-80	2ND FLOOR	12	4 3
INPUT	80 MBTU/H	1ST FLOOR	8	2 2
OUTPUT	78 MBTU/H	BASEMENT	5	1 0
COOLING	3.5 TONS	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A		
FAN SPEED	1200 cfm @ 0.6" w.c.			

Sheet Title	
BASEMENT HEATING LAYOUT	
Date	JUNE/2018
Scale	3/16" = 1'-0"
BCIN#	19669
LO#	78997

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI
APR 17 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

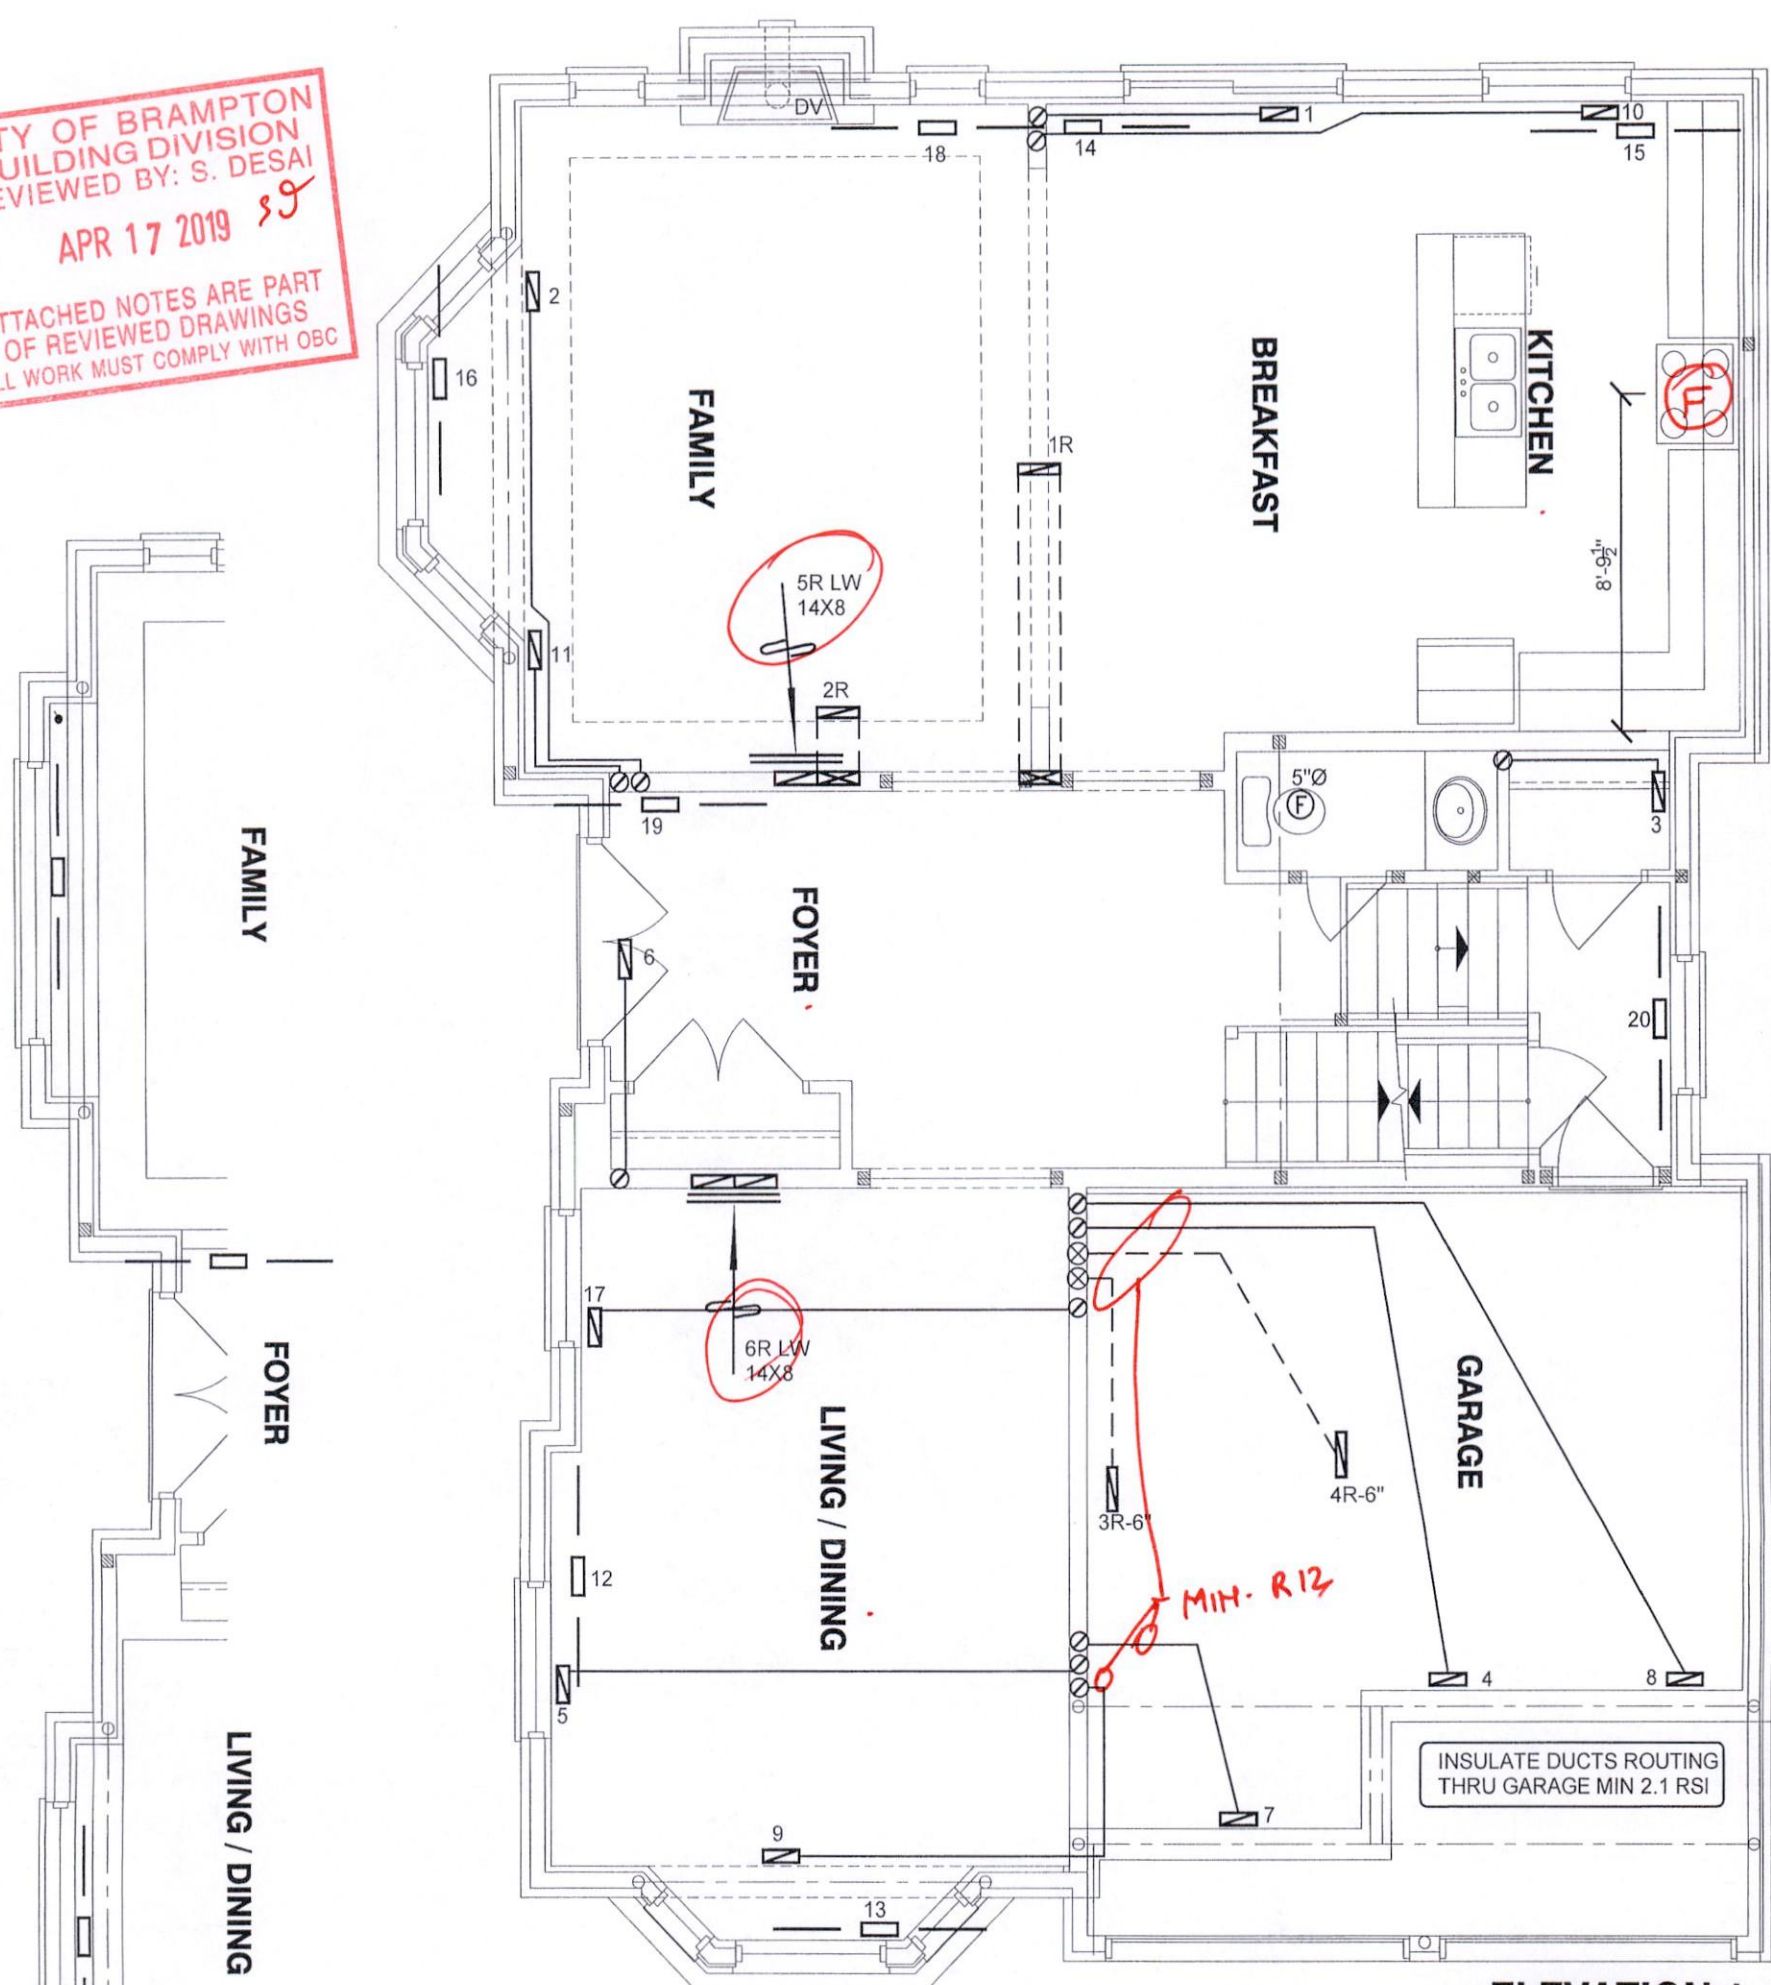

ELEVATION 1

MECHANICAL VENTILATION SHALL BE PROVIDED IN
CONFORMANCE WITH OBC DIV. B, 9.32.3 REQUIREMENTS.

THE INSTALLATION OF CARBON MONOXIDE DETECTOR(S)
SHALL COMPLY WITH OBC DIV. B, 9.33.4 REQUIREMENTS.

THIS INSTALLATION OF A GAS FIREPLACE IS REGULATED UNDER
THE T.S.S.A. BY C.S.A. B149.1 NATURAL GAS AND PROPANE
INSTALLATION CODE CALL ENBRIDGE FOR INSPECTION AT
1-800-785-1314

ELEVATION 2

CSA-F280-12
PACKAGE A1

I MICHAEL O'ROURKE HAVE REVIEWED
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND								REVISIONS	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	No.	Date
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	3.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	2.	
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	1.	
								No.	Description



ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. © AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT WRITTEN CONSENT. THE DRAWINGS ARE DATED AND
USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE
USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE
ONTARIO BUILDING CODE.

Client GREENYORK HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdsgns.ca Specializing in Residential Mechanical Design Services	Sheet Title FIRST FLOOR HEATING LAYOUT		
Project Name GRANELLI HOMES CORP BRAMPTON, ONTARIO			Date JUNE/2018		
M-2057 LOT 27		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Scale 3/16" = 1'-0"		
INDIGO 1 3187 sqft			BCIN# 19669		
			LO#	78997	

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI

APR 17 2019 *SD*

ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

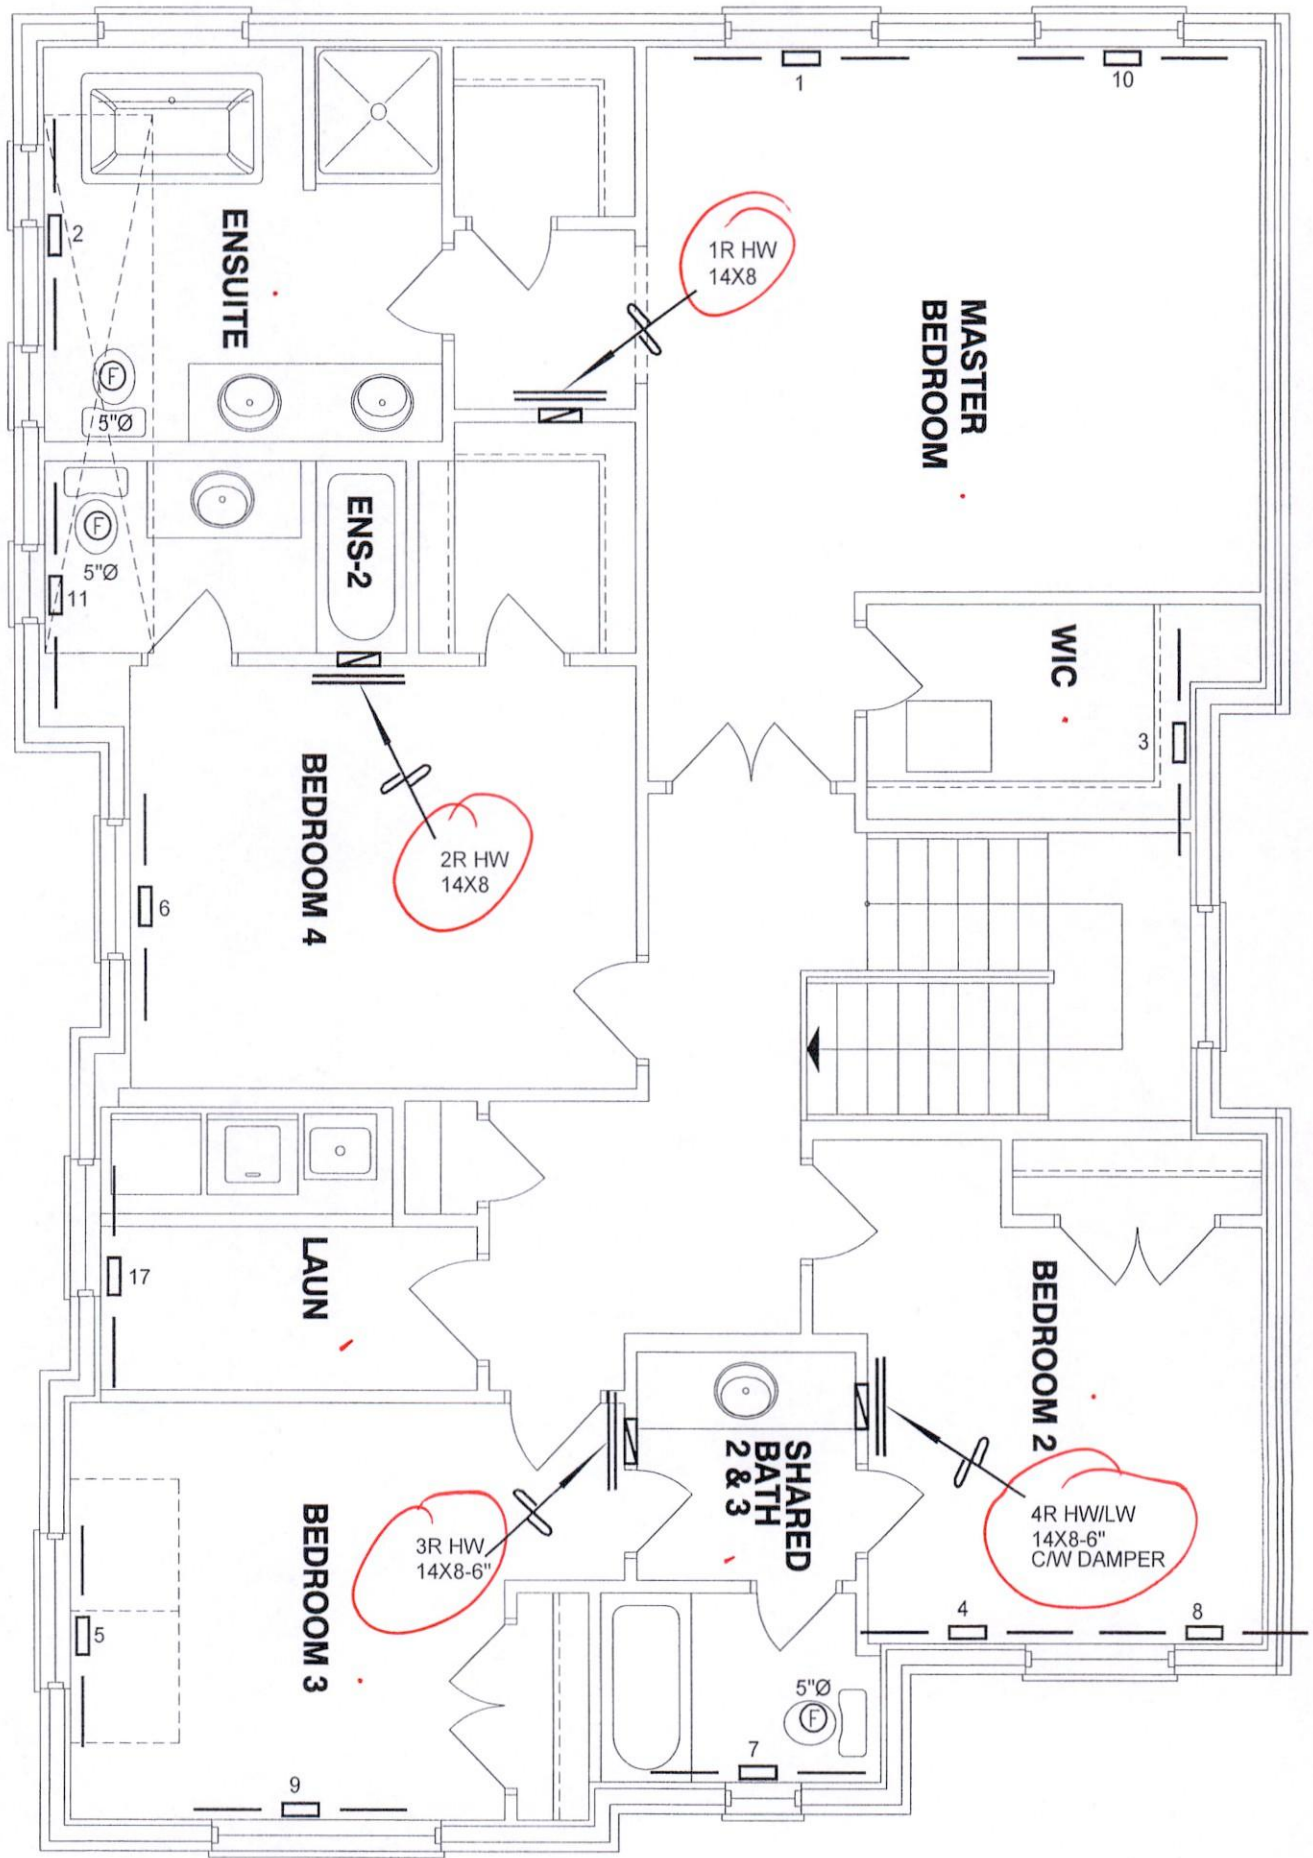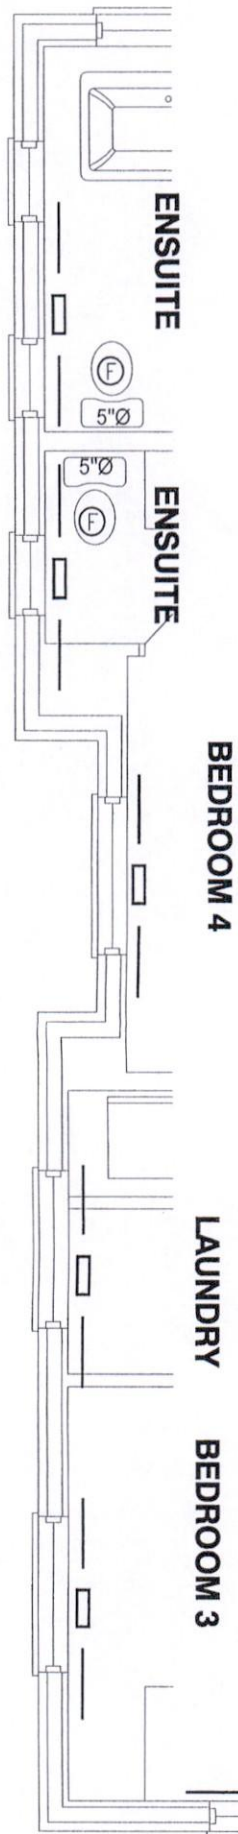

MECHANICAL VENTILATION SHALL BE PROVIDED IN
CONFORMANCE WITH OBC DIV. B, 9.32.3 REQUIREMENTS.

ELEVATION 1

BEDROOM 2

THE INSTALLATION OF CARBON MONOXIDE DETECTOR(S)
SHALL COMPLY WITH OBC DIV. B, 9.33.4 REQUIREMENTS.

~~ELEVATION 2~~

CSA-F280-12
PACKAGE A1

I MICHAEL O'Rourke HAVE REVIEWED
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND								REVISIONS	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	No.	Date
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	3.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	2.	
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	1.	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. © AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESS CONSENT. THE DRAWINGS ARE DATED AND
USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE
USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE
ONTARIO BUILDING CODE.

Client GREENYORK HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	Sheet Title SECOND FLOOR HEATING LAYOUT	
Project Name GRANELLI HOMES CORP BRAMPTON, ONTARIO M-2057 LOT 27 INDIGO 1 3187 sqft			Date JUNE/2018 Scale 3/16" = 1'-0" BCIN# 19669 LO# 78997	
		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.		

SITE NAME: GRANELLI HOME CORP

BUILDER: GREENYORK HOMES

TYPE: INDIGO 1

GFA: 2917

DATE: Jun-18

LO# 78997

WINTER NATURAL AIR CHANGE RATE 0.335

SUMMER NATURAL AIR CHANGE RATE 0.119

HEAT LOSS AT *F. 74

HEAT GAIN AT *F. 14

CSA-F280-12

SB-12 PACKAGE A1

ROOM USE			MBR		ENS		WIC		BED-2		BED-3		BED-4		BATH		ENS-2		
EXP. WALL			38		23		10		37		29		12		13		6		
CLG. HT.			9		9		9		9		9		9		9		9		
FACTORS																			
GRS.WALL AREA			342		207		90		333		261		108		117		54		
GLAZING			LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		
NORTH			20.8	16.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EAST			20.8	41.9	0	0	0	0	0	0	0	0	0	0	0	14	291	586	0
SOUTH			20.8	25.2	0	0	0	20	416	505	0	0	0	20	416	505	18	374	454
WEST			20.8	41.9	40	831	1676	16	332	670	0	0	0	0	0	0	0	0	0
SKYLT.			36.4	102.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
DOORS			24.7	4.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL			4.4	0.8	302	1316	248	171	745	141	90	392	74	298	1298	245	90	392	74
NET EXPOSED BSMT WALL ABOVE GR			3.5	0.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG			1.3	0.6	345	432	210	107	134	65	118	148	72	300	376	182	158	198	96
NO ATTIC EXPOSED CLG			2.7	1.3	0	0	0	25	67	33	0	0	0	0	0	0	40	107	52
EXPOSED FLOOR			2.5	0.5	0	0	0	0	0	0	0	0	0	186	463	87	0	0	0
BASEMENT/CRAWL HEAT LOSS			0		0		0		0		0		0		0		0		
SLAB ON GRADE HEAT LOSS			0		0		0		0		0		0		0		0		
SUBTOTAL HT LOSS			2579		1694		540		2865		2362		1003		1088		504		
SUB TOTAL HT GAIN			2134		1413		146		1572		2329		643		771		339		
LEVEL FACTOR / MULTIPLIER			0.20	0.27	0.20	0.27	0.20	0.27	0.20	0.27	0.20	0.27	0.20	0.27	0.20	0.27	0.20	0.27	
AIR CHANGE HEAT LOSS			689		452		144		765		631		268		291		135		
AIR CHANGE HEAT GAIN			150		99		10		111		164		45		54		24		
DUCT LOSS			0		0		0		363		0		0		138		0		
DUCT GAIN			0		0		0		258		0		0		83		0		
HEAT GAIN PEOPLE			240	2	480	0	0	0	1	240	1	240	1	240	0	0	0	0	
HEAT GAIN APPLIANCES/LIGHTS			659		0		0		659		659		659		0		0		
TOTAL HT LOSS BTU/H			3268		2147		684		3993		2993		1271		1516		638		
TOTAL HT GAIN x 1.3 BTU/H			4449		1966		203		3691		4409		2063		1181		472		

ROOM USE			LV/DN			KIT			FAM			LAUN			FOY			MUD			WUP			BAS	
EXP. WALL			54			40			45			9			14			30			18			174	
CLG. HT.			11			11			11			9			11			13			9			9	
FACTORS																									
GRS.WALL AREA	LOSS	GAIN	594		440		495		81		154		390		162		1044								
GLAZING			LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN							
NORTH	20.8	16.3	0	0	0	0	0	0	0	0	0	0	0	16	332	261	0	0	0	0	0	0	0		
EAST	20.8	41.9	38	789	1592	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4	83	16	
SOUTH	20.8	25.2	45	935	1136	0	0	0	45	935	1136	20	416	505	0	0	0	0	0	0	0	8	166	20	
WEST	20.8	41.9	0	0	0	71	1475	2974	26	540	1089	0	0	0	0	0	0	0	0	0	0	4	83	16	
SKYLT.	36.4	102.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
DOORS	24.7	4.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
NET EXPOSED WALL	4.4	0.8	511	2226	420	369	1608	303	424	1847	349	61	266	50	108	471	89	354	1542	291	142	619	117	0	0
NET EXPOSED BSMT WALL ABOVE GR	3.5	0.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED CLG	1.3	0.6	0	0	0	0	0	0	0	0	0	189	237	115	0	0	0	0	0	0	0	0	0	0	
NO ATTIC EXPOSED CLG	2.7	1.3	48	129	62	0	0	0	34	91	44	0	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED FLOOR	2.5	0.5	0	0	0	0	0	0	0	0	0	25	62	12	0	0	0	0	0	0	0	0	0	0	
BASEMENT/CRAWL HEAT LOSS			0			0			0			0			0			0			0			5971	
SLAB ON GRADE HEAT LOSS			0			0			0			0			0			0			0				
SUBTOTAL HT LOSS			4080			3083			3414			980			1581			2368			1112			8631	
SUB TOTAL HT GAIN			3210			3277			2617			681			426			645			210			97	
LEVEL FACTOR / MULTIPLIER	0.30	0.38			0.30	0.38			0.30	0.38			0.20	0.27	0.30	0.38			0.30	0.38			0.50	0.93	
AIR CHANGE HEAT LOSS			1532			1158			1282			262			594			889						9091	
AIR CHANGE HEAT GAIN			226			230			184			48			30			45						83	
DUCT LOSS			0			0			0			124			0			0						0	
DUCT GAIN			0			0			0			139			0			0						0	
HEAT GAIN PEOPLE	240	0	0			0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
HEAT GAIN APPLIANCES/LIGHTS			659			659			659			659			0			659						65	
TOTAL HT LOSS BTU/H			5612			4240			4696			1366			2175			3257			1112			17721	
TOTAL HT GAIN x 1.3 BTU/H			5323			5417			4498			1985			593			1754			273				

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI
APR 17 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI
APR 17 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

TOTAL HEAT GAIN BTU/H:

40798

TONS: 3.40

LOSS DUE TO VENTILATION LOAD BTU/H: 1529

STRUCTURAL HEAT LOSS: 56688

TOTAL COMBINED HEAT LOSS BTU/H: 58217

SITE NAME: GRANELLI HOME CORP
 BUILDER: GREENYORK HOMES

TYPE: INDIGO 1

DATE: Jun-18

GFA: 2917

LO# 78997

 HEATING CFM 1200 COOLING CFM 1200
 TOTAL HEAT LOSS 56,688 TOTAL HEAT GAIN 40,510
 AIR FLOW RATE CFM 21.17 AIR FLOW RATE CFM 29.62

 furnace pressure 0.6
 furnace filter 0.05
 a/c coil pressure 0.2
 available pressure for s/a & r/a 0.35

 #CARRIER 59SP5A-80-16 80
 FAN SPEED LOW 0
 MEDLOW 975
 MEDIUM 1200
 MEDIUM HIGH 1370
 HIGH 1540

 AFUE = 97 %
 INPUT (BTU/H) = 80,000
 OUTPUT (BTU/H) = 78,000

 DESIGN CFM = 1200
 CFM @ .6" E.S.P.

TEMPERATURE RISE 60 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	12	8	5
R/A	0	0	4	2	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

 plenum pressure s/a 0.18
 max s/a dif press. loss 0.01
 min adjusted pressure s/a 0.17
 r/a pressure 0.17
 r/a grille press. Loss 0.02
 adjusted pressure r/a 0.15

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	WIC	BED-2	BED-3	BED-4	BATH	BED-2	BED-3	MBR	ENS-2	LV/DN	LV/DN	KIT	KIT	FAM	LAUN	FAM	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.63	2.15	0.68	2.00	1.50	1.27	1.52	2.00	1.50	1.63	0.64	2.81	2.81	2.12	2.12	2.35	1.37	2.35	2.18	3.26	3.77	3.77	3.77	3.77
CFM PER RUN HEAT	35	45	14	42	32	27	32	42	32	35	14	59	59	45	45	50	29	50	46	69	80	80	80	80
RM GAIN MBH.	2.22	1.97	0.20	1.85	2.20	2.06	1.18	1.85	2.20	2.22	0.47	2.66	2.66	2.71	2.71	2.25	1.99	2.25	0.59	1.75	0.50	0.50	0.50	0.50
CFM PER RUN COOLING	66	58	6	55	65	61	35	55	65	66	14	79	79	80	80	67	59	67	18	52	15	15	15	15
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	45	56	18	61	65	57	58	63	66	55	46	51	54	27	21	36	46	32	27	17	32	26	14	26
EQUIVALENT LENGTH	140	140	150	160	180	190	190	180	170	130	170	190	140	130	140	130	150	160	150	100	90	200	140	190
TOTAL EFFECTIVE LENGTH	185	196	168	221	245	247	248	243	236	185	216	241	194	157	161	166	196	192	177	117	122	226	154	216
ADJUSTED PRESSURE	0.09	0.09	0.1	0.08	0.07	0.07	0.07	0.07	0.07	0.09	0.08	0.07	0.09	0.11	0.11	0.1	0.09	0.09	0.1	0.15	0.14	0.08	0.11	0.08
ROUND DUCT SIZE	5	5	4	5	5	5	4	5	5	5	4	5	5	5	5	5	5	5	4	5	5	5	5	5
HEATING VELOCITY (ft/min)	257	330	161	308	235	198	367	308	235	257	161	433	433	330	330	367	213	367	528	507	587	587	587	587
COOLING VELOCITY (ft/min)	485	426	69	404	477	448	402	404	477	485	161	580	580	587	587	492	433	492	207	382	110	110	110	110
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	D	A	E	C	B	C	B	C	B	D	A	B	B	D	E	A	C	A	A	E	A	A	E	A

RUN #	25
ROOM NAME	BAS
RM LOSS MBH.	3.77
CFM PER RUN HEAT	80
RM GAIN MBH.	0.50
CFM PER RUN COOLING	15
ADJUSTED PRESSURE	0.17
ACTUAL DUCT LGH.	49
EQUIVALENT LENGTH	160
TOTAL EFFECTIVE LENGTH	209
ADJUSTED PRESSURE	0.08
ROUND DUCT SIZE	5
HEATING VELOCITY (ft/min)	587
COOLING VELOCITY (ft/min)	110
OUTLET GRILL SIZE	3X10
TRUNK	B

**CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI**

APR 17 2019

ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

SUPPLY AIR TRUNK SIZE

TRUNK	STATIC	ROUND	RECT	VELOCITY	TRUNK	STATIC	ROUND	RECT	VELOCITY
CFM	PRESS.	DUCT	DUCT	(ft/min)	CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK A	445	0.08	10.4	12	x	8	668		
TRUNK B	294	0.07	9.2	12	x	8	441		
TRUNK C	434	0.07	10.6	16	x	8	488		
TRUNK D	994	0.07	14.5	26	x	8	688		
TRUNK E	208	0.10	7.4	6	x	8	624		
TRUNK F	0	0.00	0	0	x	8	0		
TRUNK G	0	0.00	0	0	x	8	0		
TRUNK H	0	0.00	0	0	x	8	0		
TRUNK I	0	0.00	0	0	x	8	0		
TRUNK J	0	0.00	0	0	x	8	0		
TRUNK K	0	0.00	0	0	x	8	0		
TRUNK L	0	0.00	0	0	x	8	0		

RETURN AIR TRUNK SIZE

TRUNK	STATIC	ROUND	RECT	VELOCITY
CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK O	0	0.05	0	0
TRUNK P	0	0.05	0	0
TRUNK Q	0	0.05	0	0
TRUNK R	0	0.05	0	0
TRUNK S	0	0.05	0	0
TRUNK T	0	0.05	0	0
TRUNK U	0	0.05	0	0
TRUNK V	0	0.05	0	0
TRUNK W	0	0.05	0	0
TRUNK X	1200	0.05	16.9	32
TRUNK Y	690	0.05	13.7	22
TRUNK Z	0	0.05	0	0
DROP	1200	0.05	16.9	24

RETURN AIR #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
AIR VOLUME	155	155	75	85	155	380	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	54	52	51	53	36	49	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
EQUIVALENT LENGTH	135	145	255	215	185	190	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL EFFECTIVE LH	189	197	306	268	221	239	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
ADJUSTED PRESSURE	0.08	0.08	0.05	0.06	0.07	0.06	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80
ROUND DUCT SIZE	7	7	6	6	7.2	10.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	14	30	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

TYPE: INDIGO 1
SITE NAME: GRANELLI HOME CORP

LO # 78997

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm
Kitchen & Bathrooms	5 @ 10.6 cfm	53 cfm
Other Rooms	6 @ 10.6 cfm	63.6 cfm
Table 9.32.3.A.	TOTAL	190.8 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		79.5 cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	190.8	cfm
Less Principal Ventil. Capacity	79.5	cfm
Required Supplemental Capacity	111.3	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	LIFEBREATH RNC5-HEX
Location:	BSMT
79.5 cfm	3.0 sones
☒ HVI Approved	

PRINCIPAL EXHAUST HEAT LOSS CALCULATION			
CFM	$\Delta T \cdot F$	FACTOR	% LOSS
79.5 CFM	X 74 F	X 1.08	X 0.24

SUPPLEMENTAL FANS		NUTONE		
Location	Model	cfm	HVI	Sones
ENS	QTXEN050C	50	☒	0.3
BATH	QTXEN050C	50	☒	0.3
ENS-2	QTXEN050C	50	☒	0.3

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	LIFEBREATH RNC5-HEX	
108 cfm high	59 cfm low	
76 % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GREENYORK HOMES	
Name:	
Address:	
City:	
Telephone #:	

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	June-18

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** INDIGO 1**BUILDER:** GREENYORK HOMES**SFQT:** 2917**LO#** 78997**SITE:** GRANELLI HOME CORP**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-2	OUTDOOR DESIGN TEMP.	86
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	72

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	40916.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.55	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	6.0 ft
LENGTH: 50.0 ft	WIDTH: 37.0 ft	EXPOSED PERIMETER:	174.0 ft




2012 OBC - COMPLIANCE PACKAGE		Compliance Package A1	
Component		Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value		60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value		31	27.65
Exposed Floor Minimum RSI (R)-Value		31	29.80
Walls Above Grade Minimum RSI (R)-Value		22	17.03
Basement Walls Minimum RSI (R)-Value		20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value		-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value		10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value		10	11.13
Windows and Sliding Glass Doors Maximum U-Value		0.28	-
Skylights Maximum U-Value		0.49	-
Space Heating Equipment Minimum AFUE		0.96	-
HRV Minimum Efficiency		75%	-
Domestic Hot Water Heater Minimum EF		0.8	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description		
Province:	Ontario	
Region:	Brampton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	15.2	 Insulation Configuration
Floor Width (m):	11.3	
Exposed Perimeter (m):	0.0	
Wall Height (m):	2.7	
Depth Below Grade (m):	1.83	
Window Area (m ²):	1.5	
Door Area (m ²):	3.7	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		1750

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. DESAI
APR 17 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH OBC

TYPE: INDIGO 1
LO# 78997

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Brampton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.01			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1158.6			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1544.5 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	37.5	37.5		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.335			
Cooling Air Leakage Rate (ACH/H):	0.119			

TYPE: INDIGO 1
LO# 78997

CSA F280-12 Residential Heat Loss and Heat Gain Calculations
Formula Sheet (For Air Leakage / Ventilation Calculation)

LO#: 78997

Model: INDIGO 1

Builder: GREENYORK HOMES

Date: 6/18/2018

Volume Calculation
Air Change & Delta T Data
House Volume

Level	Floor Area (ft ²)	Floor Height (ft)	Volume (ft ³)
Bsmt	1333	9	11997
First	1333	11	14663
Second	1584	9	14256
Third	0	9	0
Fourth	0	9	0
Total:			40,916.0 ft ³
Total:			1158.6 m ³

WINTER NATURAL AIR CHANGE RATE	0.335
SUMMER NATURAL AIR CHANGE RATE	0.119

Design Temperature Difference

	Tin °C	Tout °C	ΔT °C	ΔT °F
Winter DTDh	22	-19	41	74
Summer DTDc	22	30	8	14

5.2.3.1 Heat Loss due to Air Leakage
6.2.6 Sensible Gain due to Air Leakage

$$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$$

$$0.335 \times 321.84 \times 41^\circ\text{C} \times 1.2 = 5329 \text{ W}$$

$$= 18181 \text{ Btu/h}$$

$$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$$

$$0.119 \times 321.84 \times 8^\circ\text{C} \times 1.2 = 356 \text{ W}$$

$$= 1216 \text{ Btu/h}$$

5.2.3.2 Heat Loss due to Mechanical Ventilation
6.2.7 Sensible heat Gain due to Ventilation

$$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$$

$$80 \text{ CFM} \times 74^\circ\text{F} \times 1.08 \times 0.24 = 1529 \text{ Btu/h}$$

$$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$$

$$80 \text{ CFM} \times 14^\circ\text{F} \times 1.08 \times 0.24 = 288 \text{ Btu/h}$$

5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)

$$HL_{airr} = \text{Level Factor} \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$$

Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HL _{clevel})
1	0.5	18,181	9,742	0.933
2	0.3		14,525	0.376
3	0.2		13,614	0.267
4	0		0	0.000
5	0		0	0.000

*HLairbv = Air leakage heat loss + ventilation heat loss

*For a balanced or supply only ventilation system HLairve = 0



Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information

Building number, street name <u>1 Penlea Gate</u>	Unit no.	Lot/con. <u>27</u>
Municipality BRAMPTON	Postal code	Plan number/ other description <u>43M-2057</u>

B. Individual who reviews and takes responsibility for design activities

Name <u>SANDY WHITE, P.Eng.</u>	Firm <u>ANDA ENGINEERING LTD.</u>
Street address <u>5125 ARDOCH ROAD</u>	Unit no. / Lot/con.
Municipality <u>ARDOCH</u>	Postal code <u>K0H-1C0</u> Province <u>ONTARIO</u>
Telephone number <u>(613) 479-0161</u>	Fax number <u>() N/A</u>
	E-mail <u>design@andaengineering.com</u>
	Cell number <u>(416) 476-1105</u>

C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1. of Division C]

☐ House	☐ HVAC – House	☐ Building Structural
☐ Small Buildings	☐ Building Services	☒ Plumbing – House
☐ Large Buildings	☐ Detection, Lighting and Power	☐ Plumbing – All Buildings
☐ Complex Buildings	☐ Fire Protection	☐ On-site Sewage Systems

Description of designer's work

INDIGO 1 EL. 1

GRANELLI HOMES CORP.

D. Declaration of Designer

I SANDY WHITE, declare that (choose one as appropriate):
(print name)

☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.
Individual BCIN: _____
Firm BCIN: _____

☐ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code.
Individual BCIN: _____
Basis for exemption from registration: _____

☒ The design work is exempt from the registration and qualification requirements of the Building Code.
Basis for exemption from registration and qualification: P.Eng. exempt, note 2

I certify that:

- The information contained in this schedule is true to the best of my knowledge.
- I have submitted this application with the knowledge and consent of the firm.

2019/24/01

Date

**SANDY
WHITE**

Signature of Designer

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) (c) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of practice, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.



BRAMPTON
Flower City


Planning and Development Services
Building Division
8850 McLaughlin Road, Unit 1
Brampton, ON L6Y 5T1

WATER PIPE SIZING AND PLUMBING DATA SHEET

CERTIFIED MODEL WITH ONE DWELLING UNIT

THIS TABLE IS APPLICABLE FOR A HOUSE AFTER DECEMBER 31, 2017

Builder Name: Greenyork Homes
Certified Model Name: INDIGO 1 (LO78997-P)
Optional Floor Layout:
Application No.:

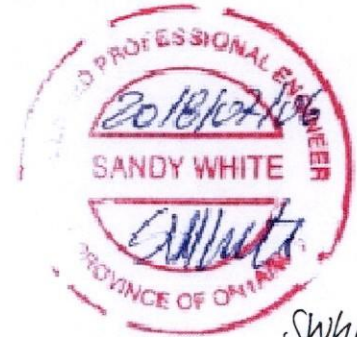

The Ontario Building Code Div. B, 7.6.3 regulates size and capacity of pipes for a new house. Please enter the number of individual fixtures as listed and bathroom groups⁽⁶⁾ or powder room groups⁽⁷⁾ per floor. The fixture units and required minimum size of water service will automatically be calculated.

Description	Basement Floor	First Floor	Second Floor	Third Floor
	Qty.	Qty.	Qty.	Qty.
Bathroom group ⁽⁶⁾	1		3	
Bidet				
Extra Shower			1	
Lav			1	
Bar Sink				
Powder room ⁽⁷⁾		1		
Kitchen Sink		1		
Dishwasher		1		
Laundry Tub			1	
Washing Machine			1	
Hose Bib		2		

Total Fixture Units 30
Minimum Diametre of Water Service Pipe
Required from the Property Line to the 1
House (Inch)

Notes:

- (1) A potable water system shall be designed, constructed and installed to conform to good engineering practice appropriate to the circumstances, such as that described in the ASHRAE Handbooks and ASPE Data Books.
- (2) No water system between the point of connection with the water service pipe or the water meter and the first branch that supplies a water heater that serves more than one fixture shall be less than ¾ in. in size.
- (3) The minimum water pressure at the entry to the building is 200 kPa, and the total maximum length of the water system is 90 m.
- (4) In a hot water distribution system of a developed length of more than 30 m from the HWT to the farthest fixture or supplying more than 4 storeys, the water temperature shall be maintained by, (a) recirculation, or (b) a self-regulating heat tracing system.
- (5) Where piping may be exposed to freezing conditions, it shall be protected from the effects of freezing.
- (6) A bathroom group consists of 1 water closet, 1 lavatory, and 1 bathtub (with or without showerhead)
- (7) A powder room group consists of 1 water closet and 1 lavatory.


**PLEASE SEE THE
NOTES AS THEY
OF THE REVIEW**

NOTES

1. DRAWINGS ARE TO BE PRINTED IN COLOUR
2. WHERE A 3/4"Ø TUB SPOUT/ SPIGOT CONNECTION IS USED ON THE BATHTUB FAUCET THE WATER SUPPLY PIPE SHALL BE 3/4"Ø TO THE BRANCH FOR THE BATHTUB
3. BASEMENT BATHROOM ROUGH-IN SHALL BE USED IN SIZING OF WATER PIPE
4. EXACT LOCATION OF ALL PLUMBING PIPING TO BE DETERMINED ON SITE

LEGEND

SYMBOL	DESCRIPTION (SEE PLAN FOR PIPE SIZING)
	WATER METER, PROVIDE SUPPLY PIPE SIZE/ Ø
	HOSE BIB
	PROPOSED COLD WATER LINE & RISER
	PROPOSED HOT WATER LINE & RISER
	FLOOR DRAIN

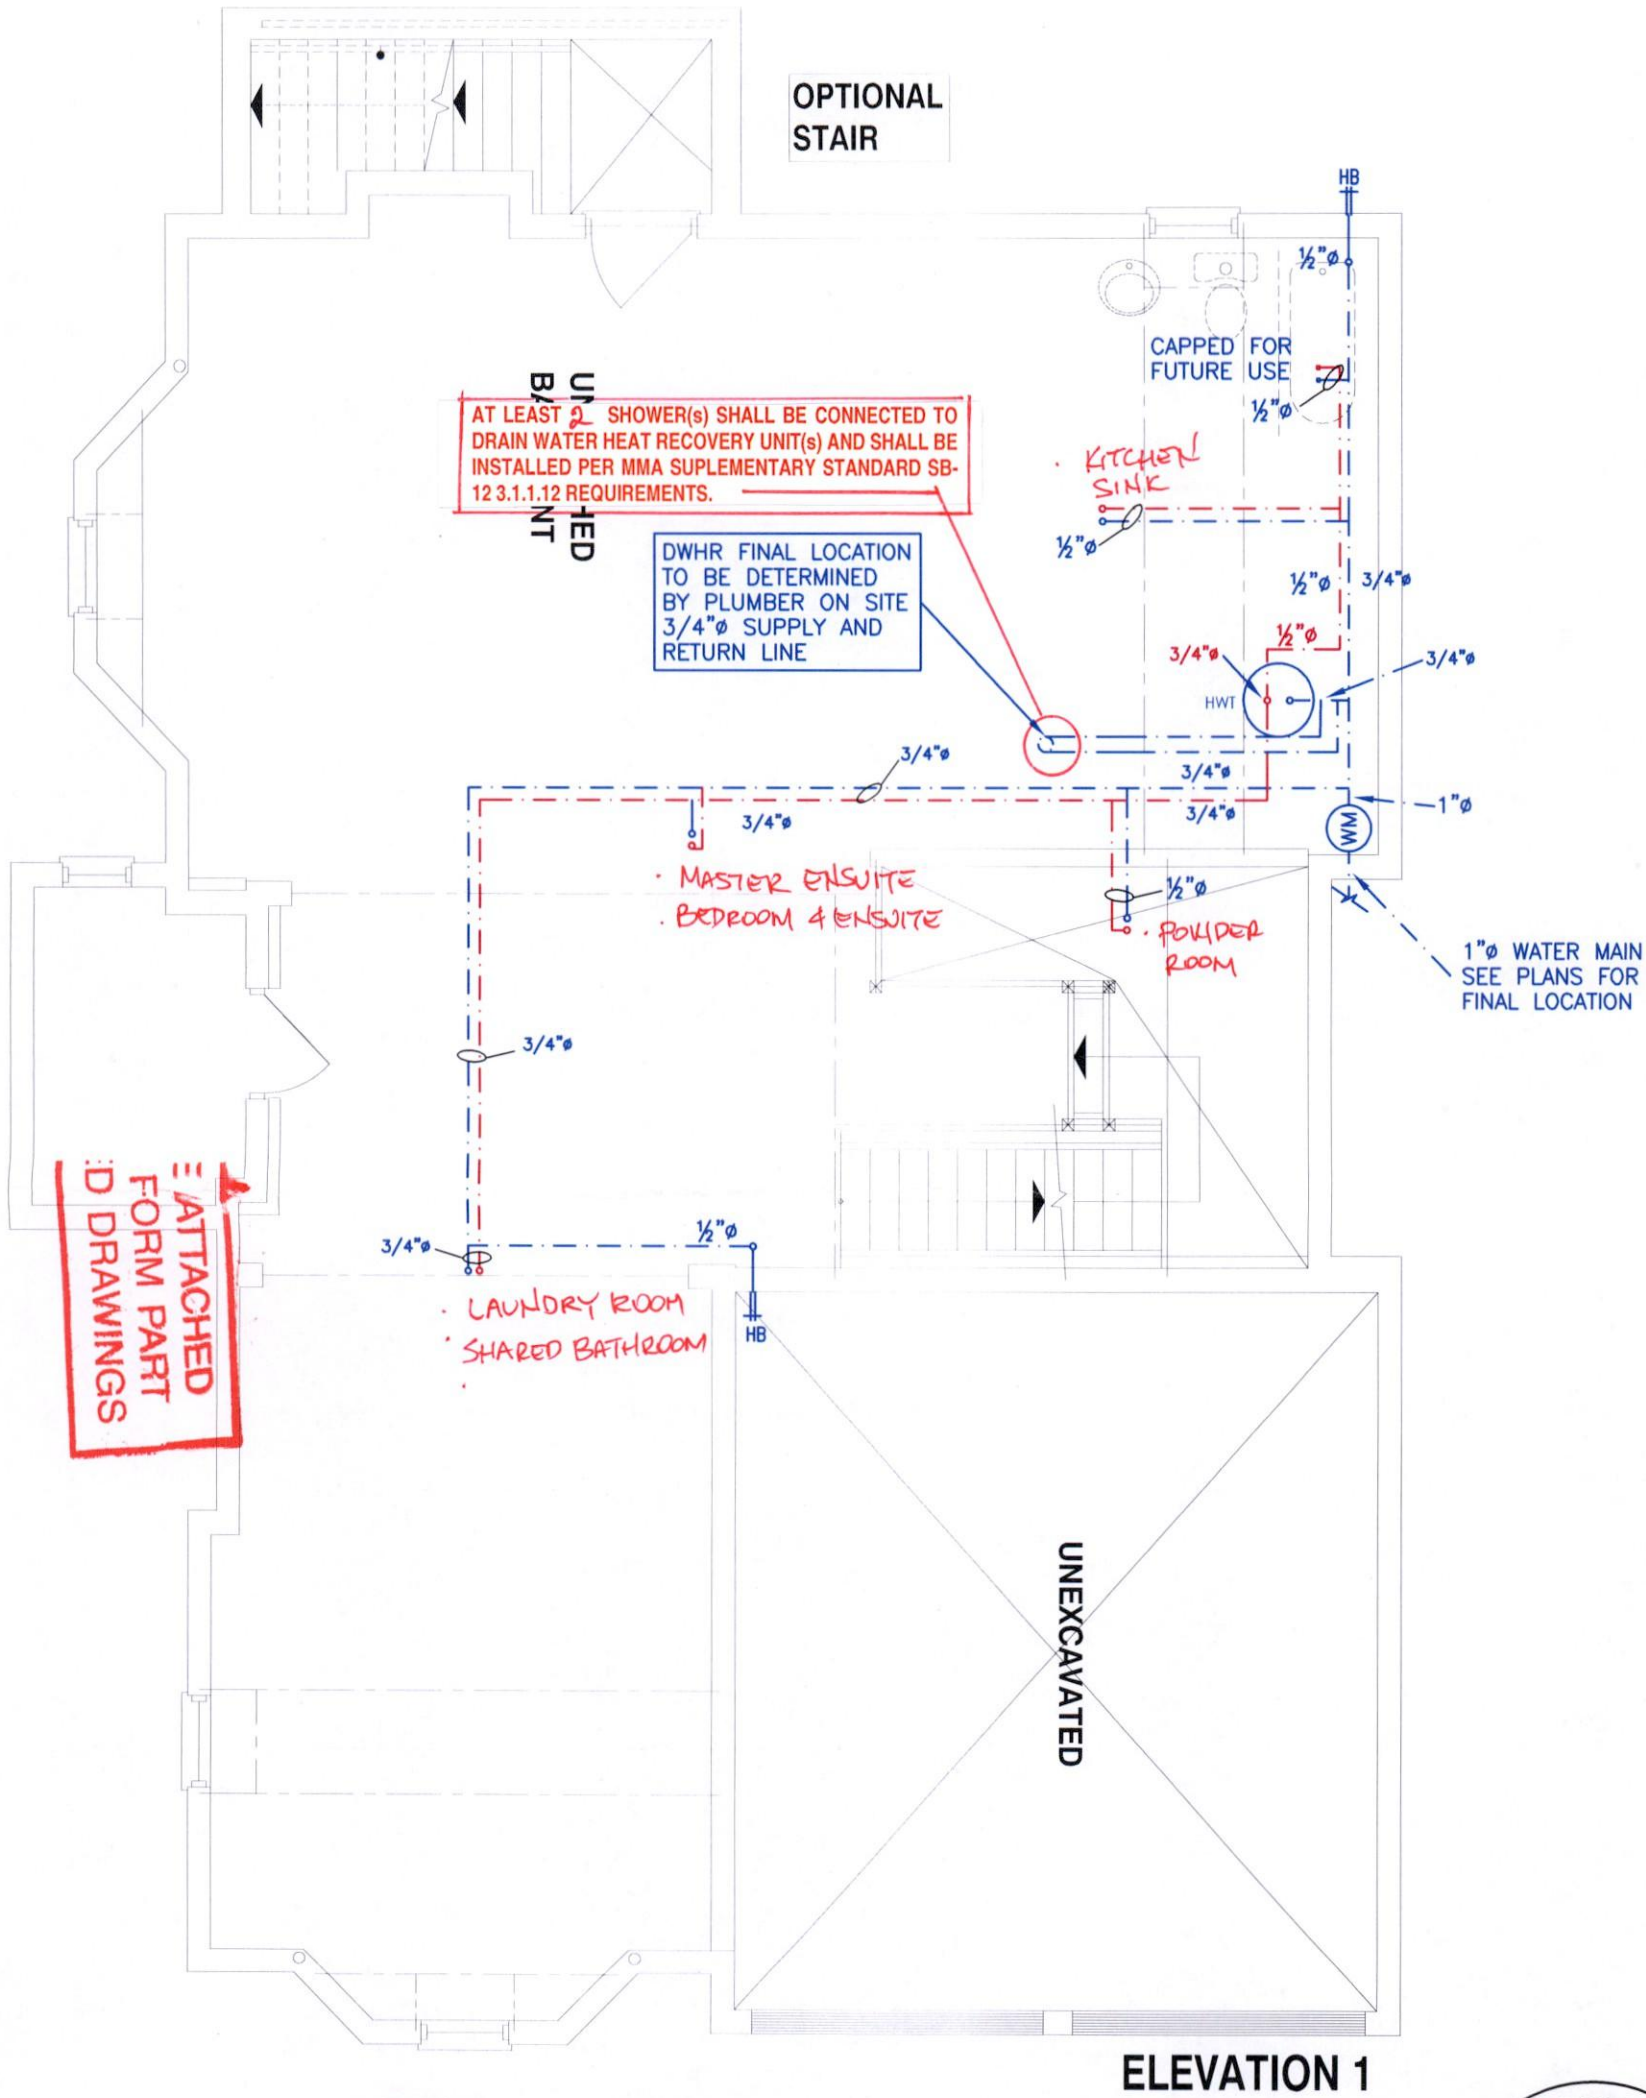

Lot 27

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED

APR 03 2019

PLUMBING BY
KOFI MORIEL

ALL PLUMBING SHALL CONFORM TO
THE ONTARIO BUILDING CODE, O.B.C.
332/12, AS AMENDED, DIVISION B, PART 7.



Client
GREENYORK HOMES

Project Name
GRANELLI HOMES CORP
BRAMPTON, ONTARIO

INDIGO 1 3187 sqft

HVACDESIGNS LTD.
375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Sheet Title
BASEMENT
PLUMBING
LAYOUT

Date
JULY 2018

Scale
3/16" = 1'-0"


LO# 78997-P

NOTES

1. DRAWINGS ARE TO BE PRINTED IN COLOUR
2. WHERE A 3/4"Ø TUB SPOUT/ SPIGOT CONNECTION IS USED ON THE BATHTUB FAUCET THE WATER SUPPLY PIPE SHALL BE 3/4"Ø TO THE BRANCH FOR THE BATHTUB
3. BASEMENT BATHROOM ROUGH-IN SHALL BE USED IN SIZING OF WATER PIPE
4. EXACT LOCATION OF ALL PLUMBING PIPING TO BE DETERMINED ON SITE

LEGEND

SYMBOL	DESCRIPTION (SEE PLAN FOR PIPE SIZING)
	WATER METER, PROVIDE SUPPLY PIPE SIZE/ Ø
	HOSE BIB
	PROPOSED COLD WATER LINE & RISER
	PROPOSED HOT WATER LINE & RISER
	FLOOR DRAIN

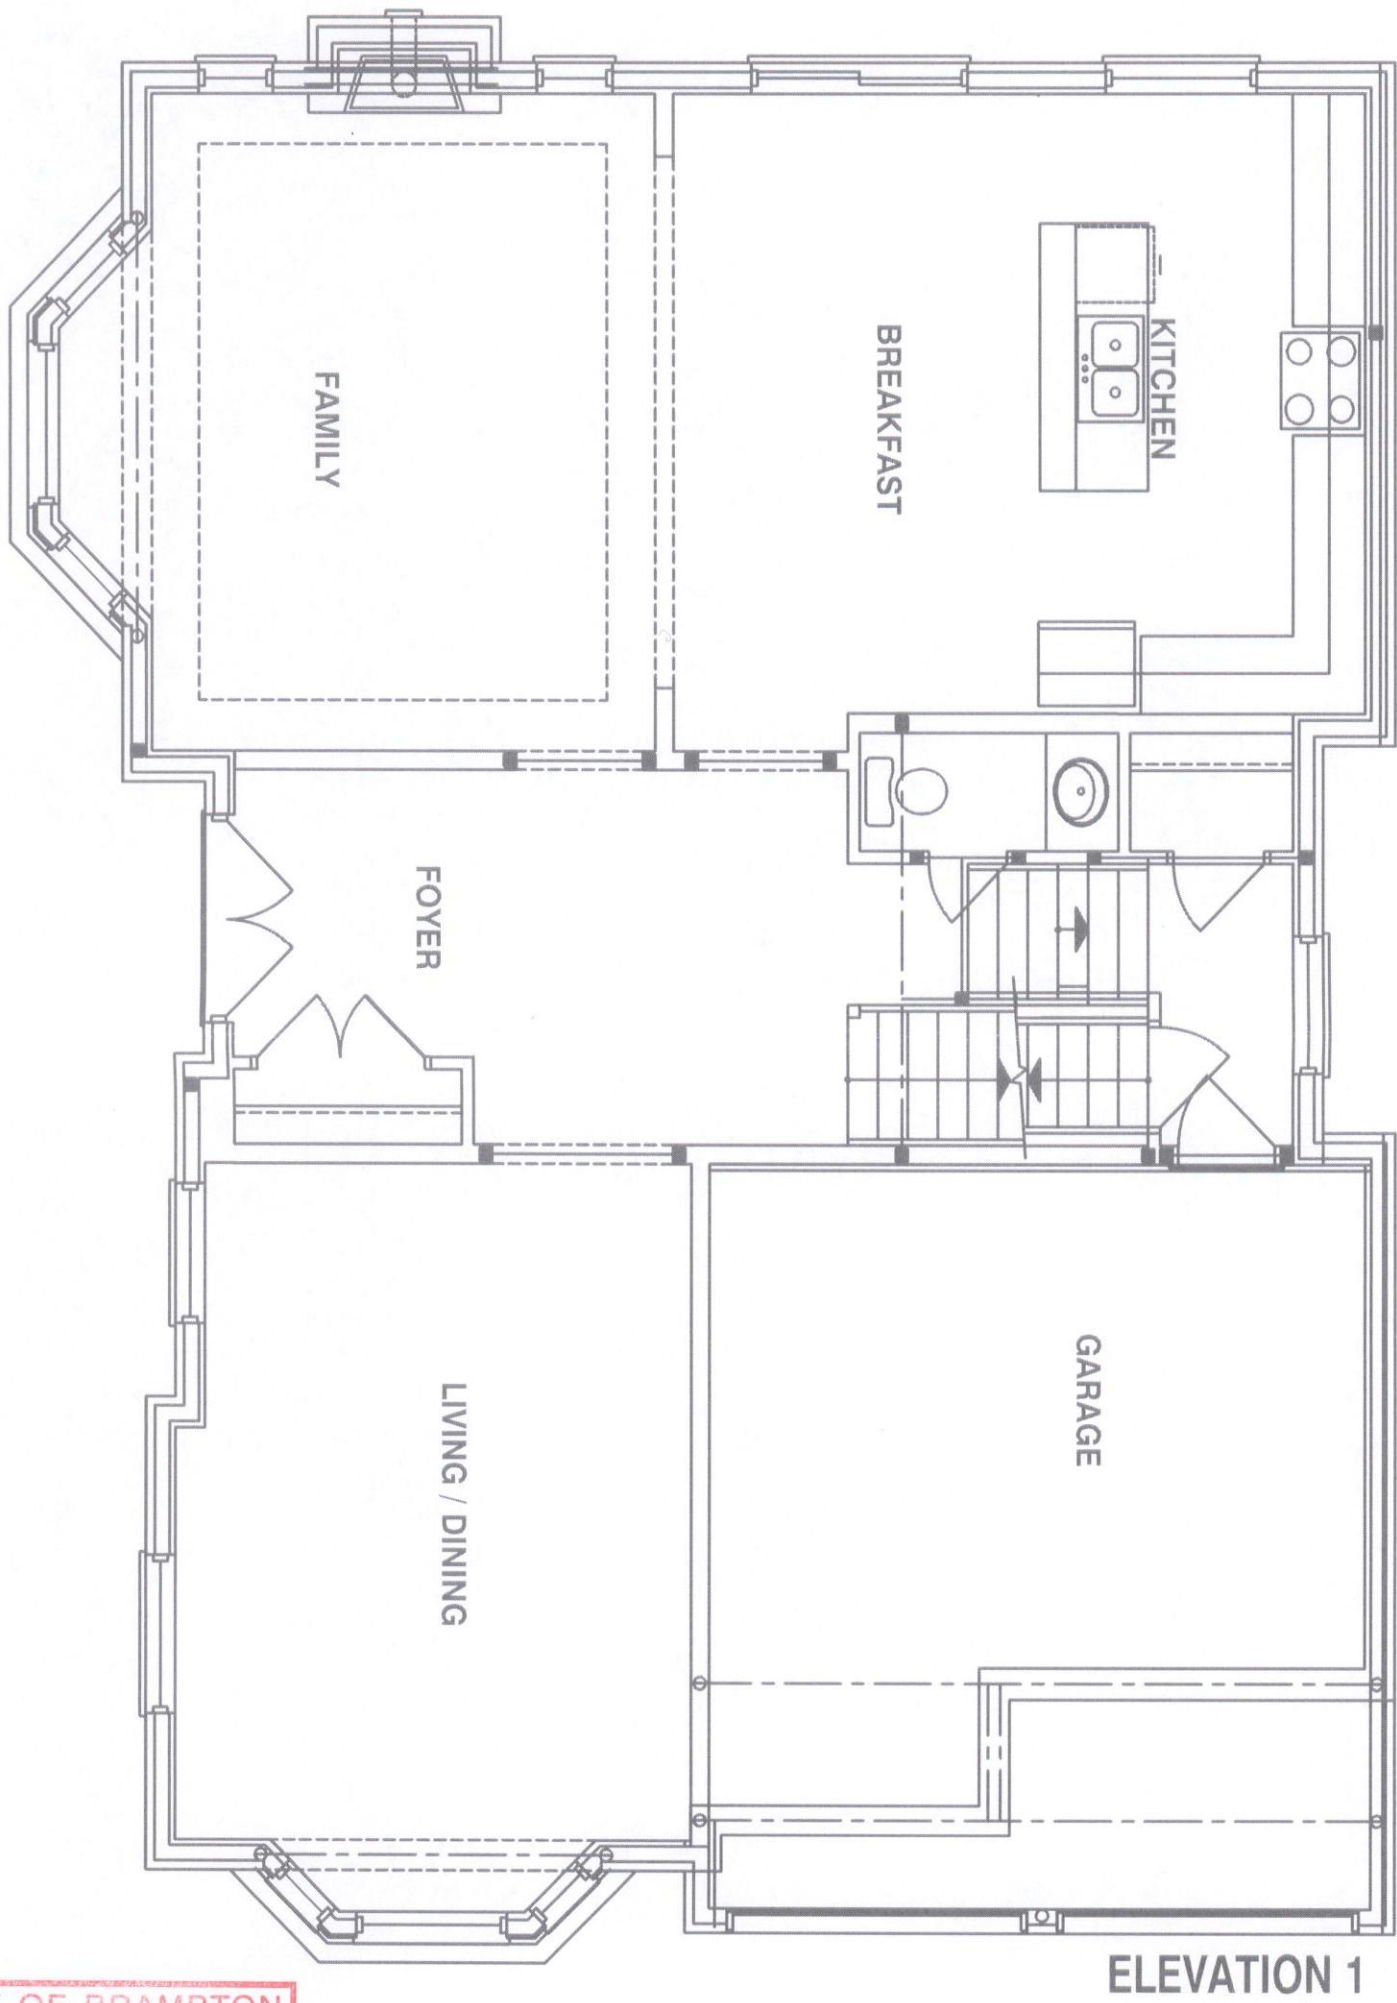

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED

APR 03 2019

PLUMBING BY
KOFI MORIEL



Client

GREENYORK HOMES

Project Name

GRANELLI HOMES CORP
BRAMPTON, ONTARIO

M-2057 LOT 27

INDIGO 1

3187 sqft

HVACDESIGNS LTD.

375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Sheet Title

FIRST FLOOR
PLUMBING
LAYOUT

Date

JULY 2018

Scale

3/16" = 1'-0"

LO#


78997-P

NOTES

1. DRAWINGS ARE TO BE PRINTED IN COLOUR
2. WHERE A 3/4"Ø TUB SPOUT/ SPIGOT CONNECTION IS USED ON THE BATHTUB FAUCET THE WATER SUPPLY PIPE SHALL BE 3/4"Ø TO THE BRANCH FOR THE BATHTUB
3. BASEMENT BATHROOM ROUGH-IN SHALL BE USED IN SIZING OF WATER PIPE
4. EXACT LOCATION OF ALL PLUMBING PIPING TO BE DETERMINED ON SITE

LEGEND

SYMBOL	DESCRIPTION (SEE PLAN FOR PIPE SIZING)
	WATER METER, PROVIDE SUPPLY PIPE SIZE/ Ø
	HOSE BIB
	PROPOSED COLD WATER LINE & RISER
	PROPOSED HOT WATER LINE & RISER
	FLOOR DRAIN

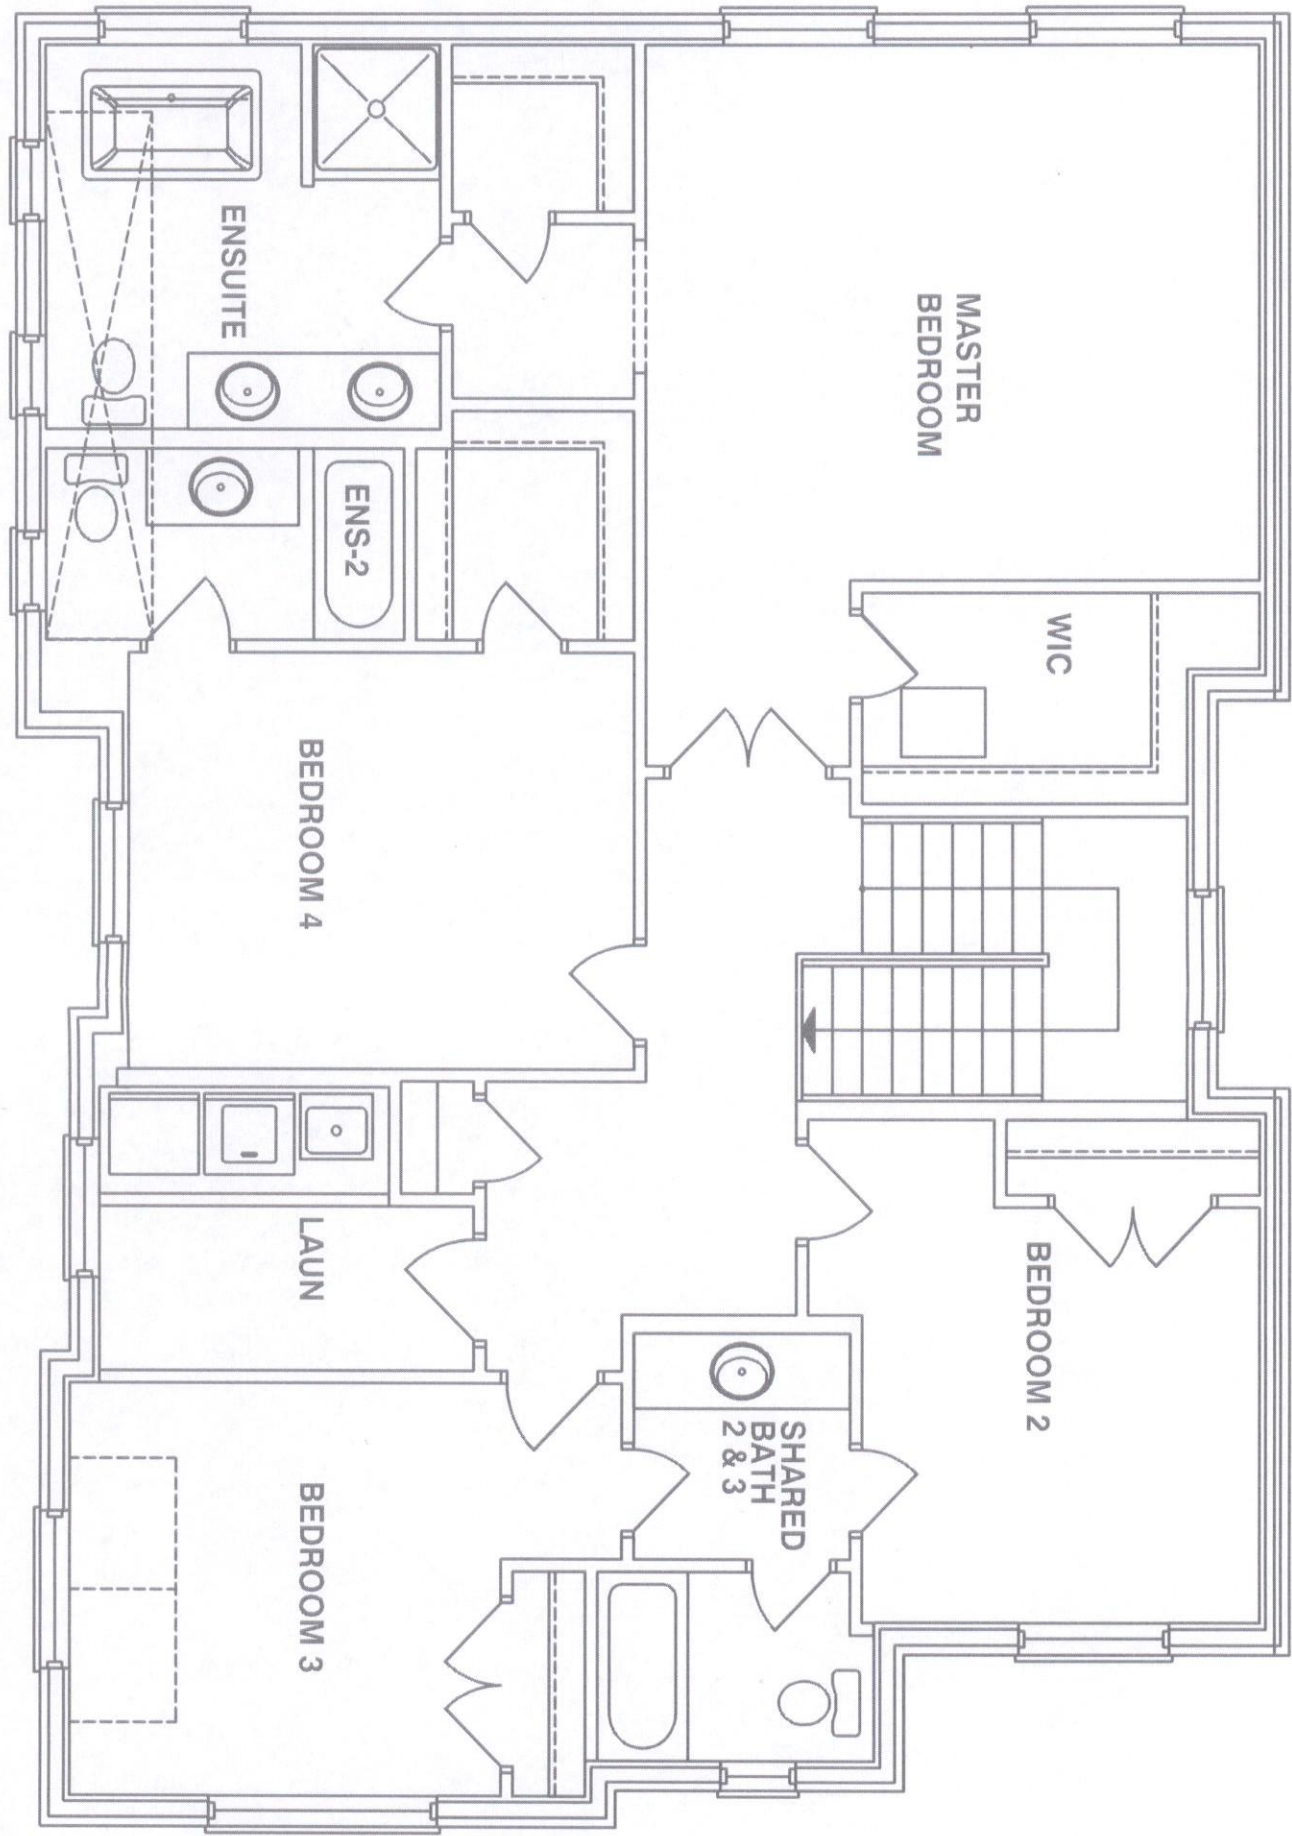


ELEVATION 1

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED

APR 03 2019

PLUMBING BY
KOFI MORIEL

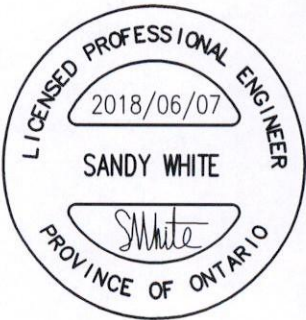

Client

GREENYORK HOMES

Project Name

GRANELLI HOMES CORP
BRAMPTON, ONTARIO

M-2057 LOT 27

INDIGO 1

3187 sqft

HVACDESIGNS LTD.

375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Sheet Title

SECOND FLOOR
PLUMBING
LAYOUT

Date

JULY 2018

Scale

3/16" = 1'-0"

LO#

78997-P