


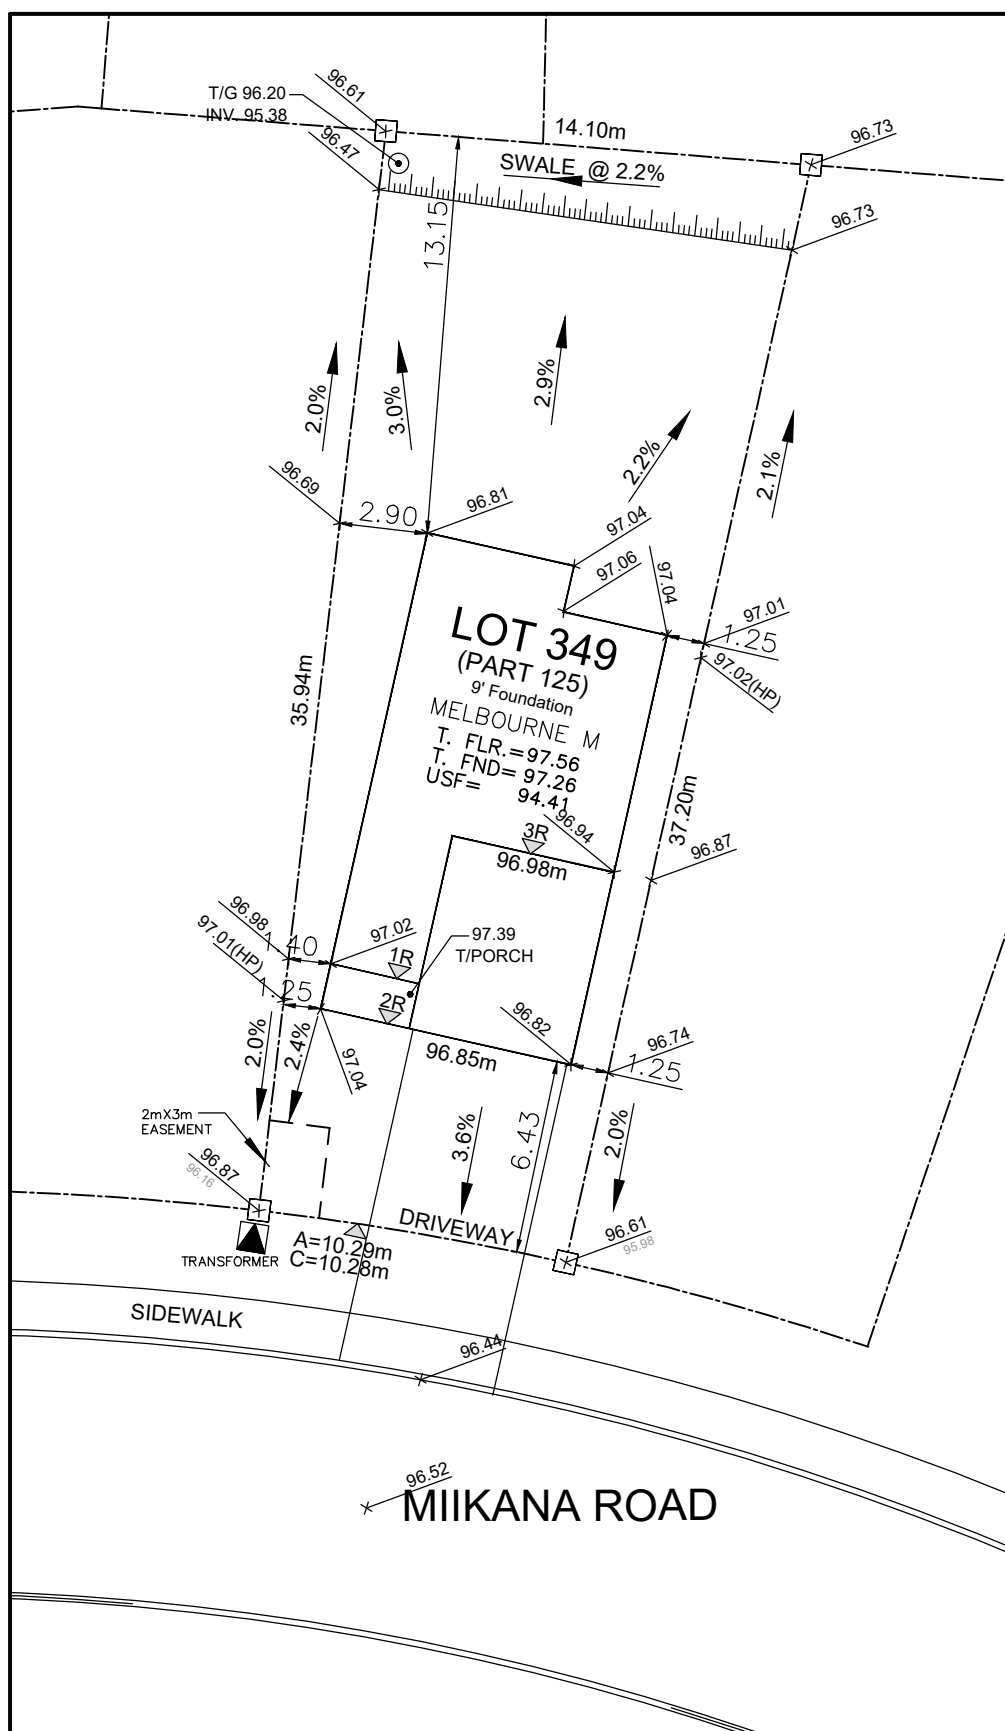

- Sleeved services required under retaining walls/ footings/ garage, and are recommended under porches, decks and similar structures.
- USF to have min. 1.5m cover around foundation or foundation shall be insulated.
- Top of foundation to be min. 0.15m above final grade.
- Grading to be 2-7%.
- Grading over 7% to be terraced (max. 3H:1V)