



ELEVATION 'A'



ELEVATION 'B'



ELEVATION 'C'

UNIT 4504 - "THE DUNCAN"

SB-12 ENERGY EFFICIENCY DESIGN MATRIX

PERFORMANCE COMPLIANCE		SB-12 (SECTION 3.1.1) TABLE 3.1.1.2.A	
PERFORMANCE COMPLIANCE	SPACE HEATING FUEL		
	☒ GAS	☐ OIL	
	☐ ELECTRIC	☐ PROPANE	
	☐ EARTH	☐ SOLID FUEL	
BUILDING COMPONENT	REQUIRED	PROPOSED	
INSULATION RSI (R) VALUE			
CEILING W/ ATTIC SPACE	10.56 (R60)	10.56 (R60)	
CEILING W/O ATTIC SPACE	5.46 (R31)	5.46 (R31)	
EXPOSED FLOOR	5.46 (R31)	5.46 (R31)	
WALLS ABOVE GRADE	3.87 (R22)	3.87 (R22)+1.5ci	
BASEMENT WALLS	3.52 ci	3.52 ci	
* PROPOSED VALUES MAY BE SUBSTITUTED W/ 2.11+1.76ci (R12+R10ci)	(R20 ci) *	(R20 ci) *	
BELOW GRADE SLAB ENTIRE SURFACE > 600mm BELOW GRADE	-	-	
EDGE OF BELOW GRADE SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)	
HEATED SLAB OR SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)	
WINDOWS & DOORS			
WINDOWS/SLIDING GLASS DOORS (MAX U-VALUE)	1.6	1.6	
SKYLIGHTS (MAX. U-VALUE)	2.8	2.8	
APPLIANCE EFFICIENCY			
SPACE HEATING EQUIP. (AFUE%)	96%	96%	
HRV EFFICIENCY (%)	75%	75%	
DOMESTIC HOT WATER HEATER (EF)	0.8	EF of 0.9.	
DWHR UNIT (%)	(SEE O.B.C. 3.1.1.12 FOR RULES & EXCEPTIONS)	42% ON 2 SHOWERS MIN.	

AREA CALCULATIONS	EL. 'A'	EL. 'B'	EL. 'C'
	STD/OPT PLAN	STD/OPT PLAN	STD/OPT PLAN
GROUND FLOOR AREA	1453 sq. ft.	1453 sq. ft.	1453 sq. ft.
SECOND FLOOR AREA	1769 sq. ft.	1770 sq. ft.	1770 sq. ft.
SUBTOTAL	3222 sq. ft.	3223 sq. ft.	3223 sq. ft.
DEDUCT ALL OPEN AREAS	0 sq. ft.	0 sq. ft.	0 sq. ft.
TOTAL NET AREA	3222 sq. ft.	3223 sq. ft.	3223 sq. ft.
	(299.33 sq. m.)	(299.43 sq. m.)	(299.43 sq. m.)
FINISHED BASEMENT AREA	0 sq. ft.	0 sq. ft.	0 sq. ft.
COVERAGE W/OUT PORCH	1849 sq. ft.	1849 sq. ft.	1849 sq. ft.
	(171.78 sq. m.)	(171.78 sq. m.)	(171.78 sq. m.)
COVERAGE W/ PORCH	1899 sq. ft.	1899 sq. ft.	1904 sq. ft.
	(176.42 sq. m.)	(176.42 sq. m.)	(176.89 sq. m.)

WINDOW / WALL AREA CALCULATIONS	EL. 'A'	EL. 'A'	EL. 'A'	EL. 'A'	EL. 'B'	EL. 'B'
	STD. PLAN	OPT. GRD.	OPT. GRD & 2ND	OPT. 2ND	STD. PLAN	OPT. GRD.
GROSS WALL AREA	4113.29 sq. ft.	3948.68 sq. ft.	4105.35 sq. ft.	3956.07 sq. ft.	4129.17 sq. ft.	3964.56 sq. ft.
	(382.14 sq. m.)	(366.84 sq. m.)	(381.40 sq. m.)	(367.53 sq. m.)	(383.61 sq. m.)	(368.32 sq. m.)
GROSS WINDOW AREA (INCL. GLASS DOORS & SKYLIGHTS)	459.02 sq. ft.	440.35 sq. ft.	458.13 sq. ft.	451.02 sq. ft.	473.21 sq. ft.	454.54 sq. ft.
	(42.64 sq. m.)	(40.91 sq. m.)	(42.56 sq. m.)	(41.90 sq. m.)	(43.96 sq. m.)	(42.23 sq. m.)
TOTAL WINDOW %	11.16 %	11.15 %	11.16 %	11.40 %	11.46 %	11.47 %



- 1 - TITLE SHEET
- 2 - BASEMENT PLAN EL. 'A' & 'B'
- 3 - BASEMENT PLAN EL. 'A' & 'B' FOR OPT. GROUND FLOOR PLAN COND.
- 4 - GROUND FLOOR PLAN EL. 'A'
- 5 - OPT. GROUND FLOOR PLAN 'A'
- 6 - PART.OPT. IN-LAW SUITE FLOOR PLANS EL. 'A', 'B' & 'C'
- 7 - SECOND FLOOR PLAN EL. 'A'
- 8 - OPT. 5 BEDROOM SECOND FLOOR PLAN EL. 'A'
- 9 - OPT. SECOND FLOOR PLAN EL. 'A' (W/ 5 BEDROOM, 4 BATHROOM)
- 10 - GROUND FLOOR PLAN EL. 'B'
- 11 - OPT. GROUND FLOOR PLAN 'B'
- 12 - SECOND FLOOR PLAN EL. 'B'
- 13 - OPT. 5 BEDROOM SECOND FLOOR PLAN EL. 'B'
- 14 - OPT. SECOND FLOOR PLAN EL. 'B' (W/ 5 BEDROOM, 4 BATHROOM)
- 15 - BASEMENT PLAN EL. 'C'
- 16 - BASEMENT PLAN EL. 'C' FOR OPT. GROUND FLOOR PLAN COND.
- 17 - GROUND FLOOR PLAN EL. 'C'
- 18 - OPT. GROUND FLOOR PLAN 'C'
- 19 - SECOND FLOOR PLAN EL. 'C'
- 20 - OPT. 5 BEDROOM SECOND FLOOR PLAN EL. 'C'
- 21 - OPT. SECOND FLOOR PLAN EL. 'C' (W/ 5 BEDROOM, 4 BATHROOM)
- 22 - FRONT ELEVATION 'A'
- 23 - LEFT SIDE ELEVATION 'A'
- 24 - LEFT SIDE ELEVATION 'A' - OPT. GROUND & SECOND FLOOR PLAN
- 25 - RIGHT SIDE ELEVATION 'A'
- 26 - REAR ELEVATION 'A', 'B' & 'C'
- 27 - REAR ELEVATION 'A', 'B' & 'C' - OPT. GROUND & SECOND FLOOR PLAN
- 28 - FRONT ELEVATION 'B'
- 29 - LEFT SIDE ELEVATION 'B'
- 30 - LEFT SIDE ELEVATION 'B' - OPT. GROUND & SECOND FLOOR PLAN
- 31 - RIGHT SIDE ELEVATION 'B'
- 32 - FRONT ELEVATION 'C'
- 33 - LEFT SIDE ELEVATION 'C'
- 34 - LEFT SIDE ELEVATION 'C' - OPT. GROUND & SECOND FLOOR PLAN
- 35 - RIGHT SIDE ELEVATION 'C'
- 36 - CROSS SECTION 'A-A'
- 37 - WALK-UP BASEMENT CONDITION
- 38 - CONSTRUCTION NOTES 1
- 39 - CONSTRUCTION NOTES 2

EL. 'B'	EL. 'B'	EL. 'C'	EL. 'C'	EL. 'C'	EL. 'C'
OPT. GRD & 2ND	OPT. 2ND	STD. PLAN	OPT. GRD.	OPT. GRD & 2ND	OPT. 2ND
4121.23 sq. ft.	3971.95 sq. ft.	4137.29 sq. ft.	3972.68 sq. ft.	4129.35 sq. ft.	3980.07 sq. ft.
(382.87 sq. m.)	(369.01 sq. m.)	(384.37 sq. m.)	(369.07 sq. m.)	(383.63 sq. m.)	(369.76 sq. m.)
472.32 sq. ft.	449.46 sq. ft.	505.91 sq. ft.	487.25 sq. ft.	505.02 sq. ft.	498.36 sq. ft.
(43.88 sq. m.)	(41.76 sq. m.)	(47.00 sq. m.)	(45.27 sq. m.)	(46.92 sq. m.)	(46.30 sq. m.)
11.46 %	11.32 %	12.23 %	12.27 %	12.23 %	12.52 %



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

7. ISSUED FOR PERMIT	-	-
6. ISSUED FOR FINAL APPROVAL	-	-
5. REVISED AS PER ARCHITECTURAL CONTROL COMMENTS	-	-
4. REVISED AS PER ENGINEER COMMENTS	2021/04/30	JLT
3. REVISED AS PER ROOF TRUSS MANUFACTURE PLANS	2021/04/30	JLT
2. REVISED AS PER FLOOR MANUFACTURE PLANS	2020/08/19	JT
1. REVISED AS PER CLIENT'S COMMENTS (2)	2020/07/29	VM
REVISIONS	DATE (YYYY/MM/DD)	BY

TITLE SHEET

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION
Derek R. Santos
37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

UNIT 4504 "THE DUNCAN"
REV.2021.05.07

Drawn By SK/MM Checked By VL Scale 3/16"=1'-0" File Number 216102WS4504.dwg Page Number 1 of 39

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

SIGNATURE

37308
BCIN

19695


HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
Drawn By SK/MM
Checked By VL
Scale 3/16"=1'-0"
File Number 216102WS4504.dwg
Page Number 5 of 39

OPT. GROUND FLOOR PLAN 'A'



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

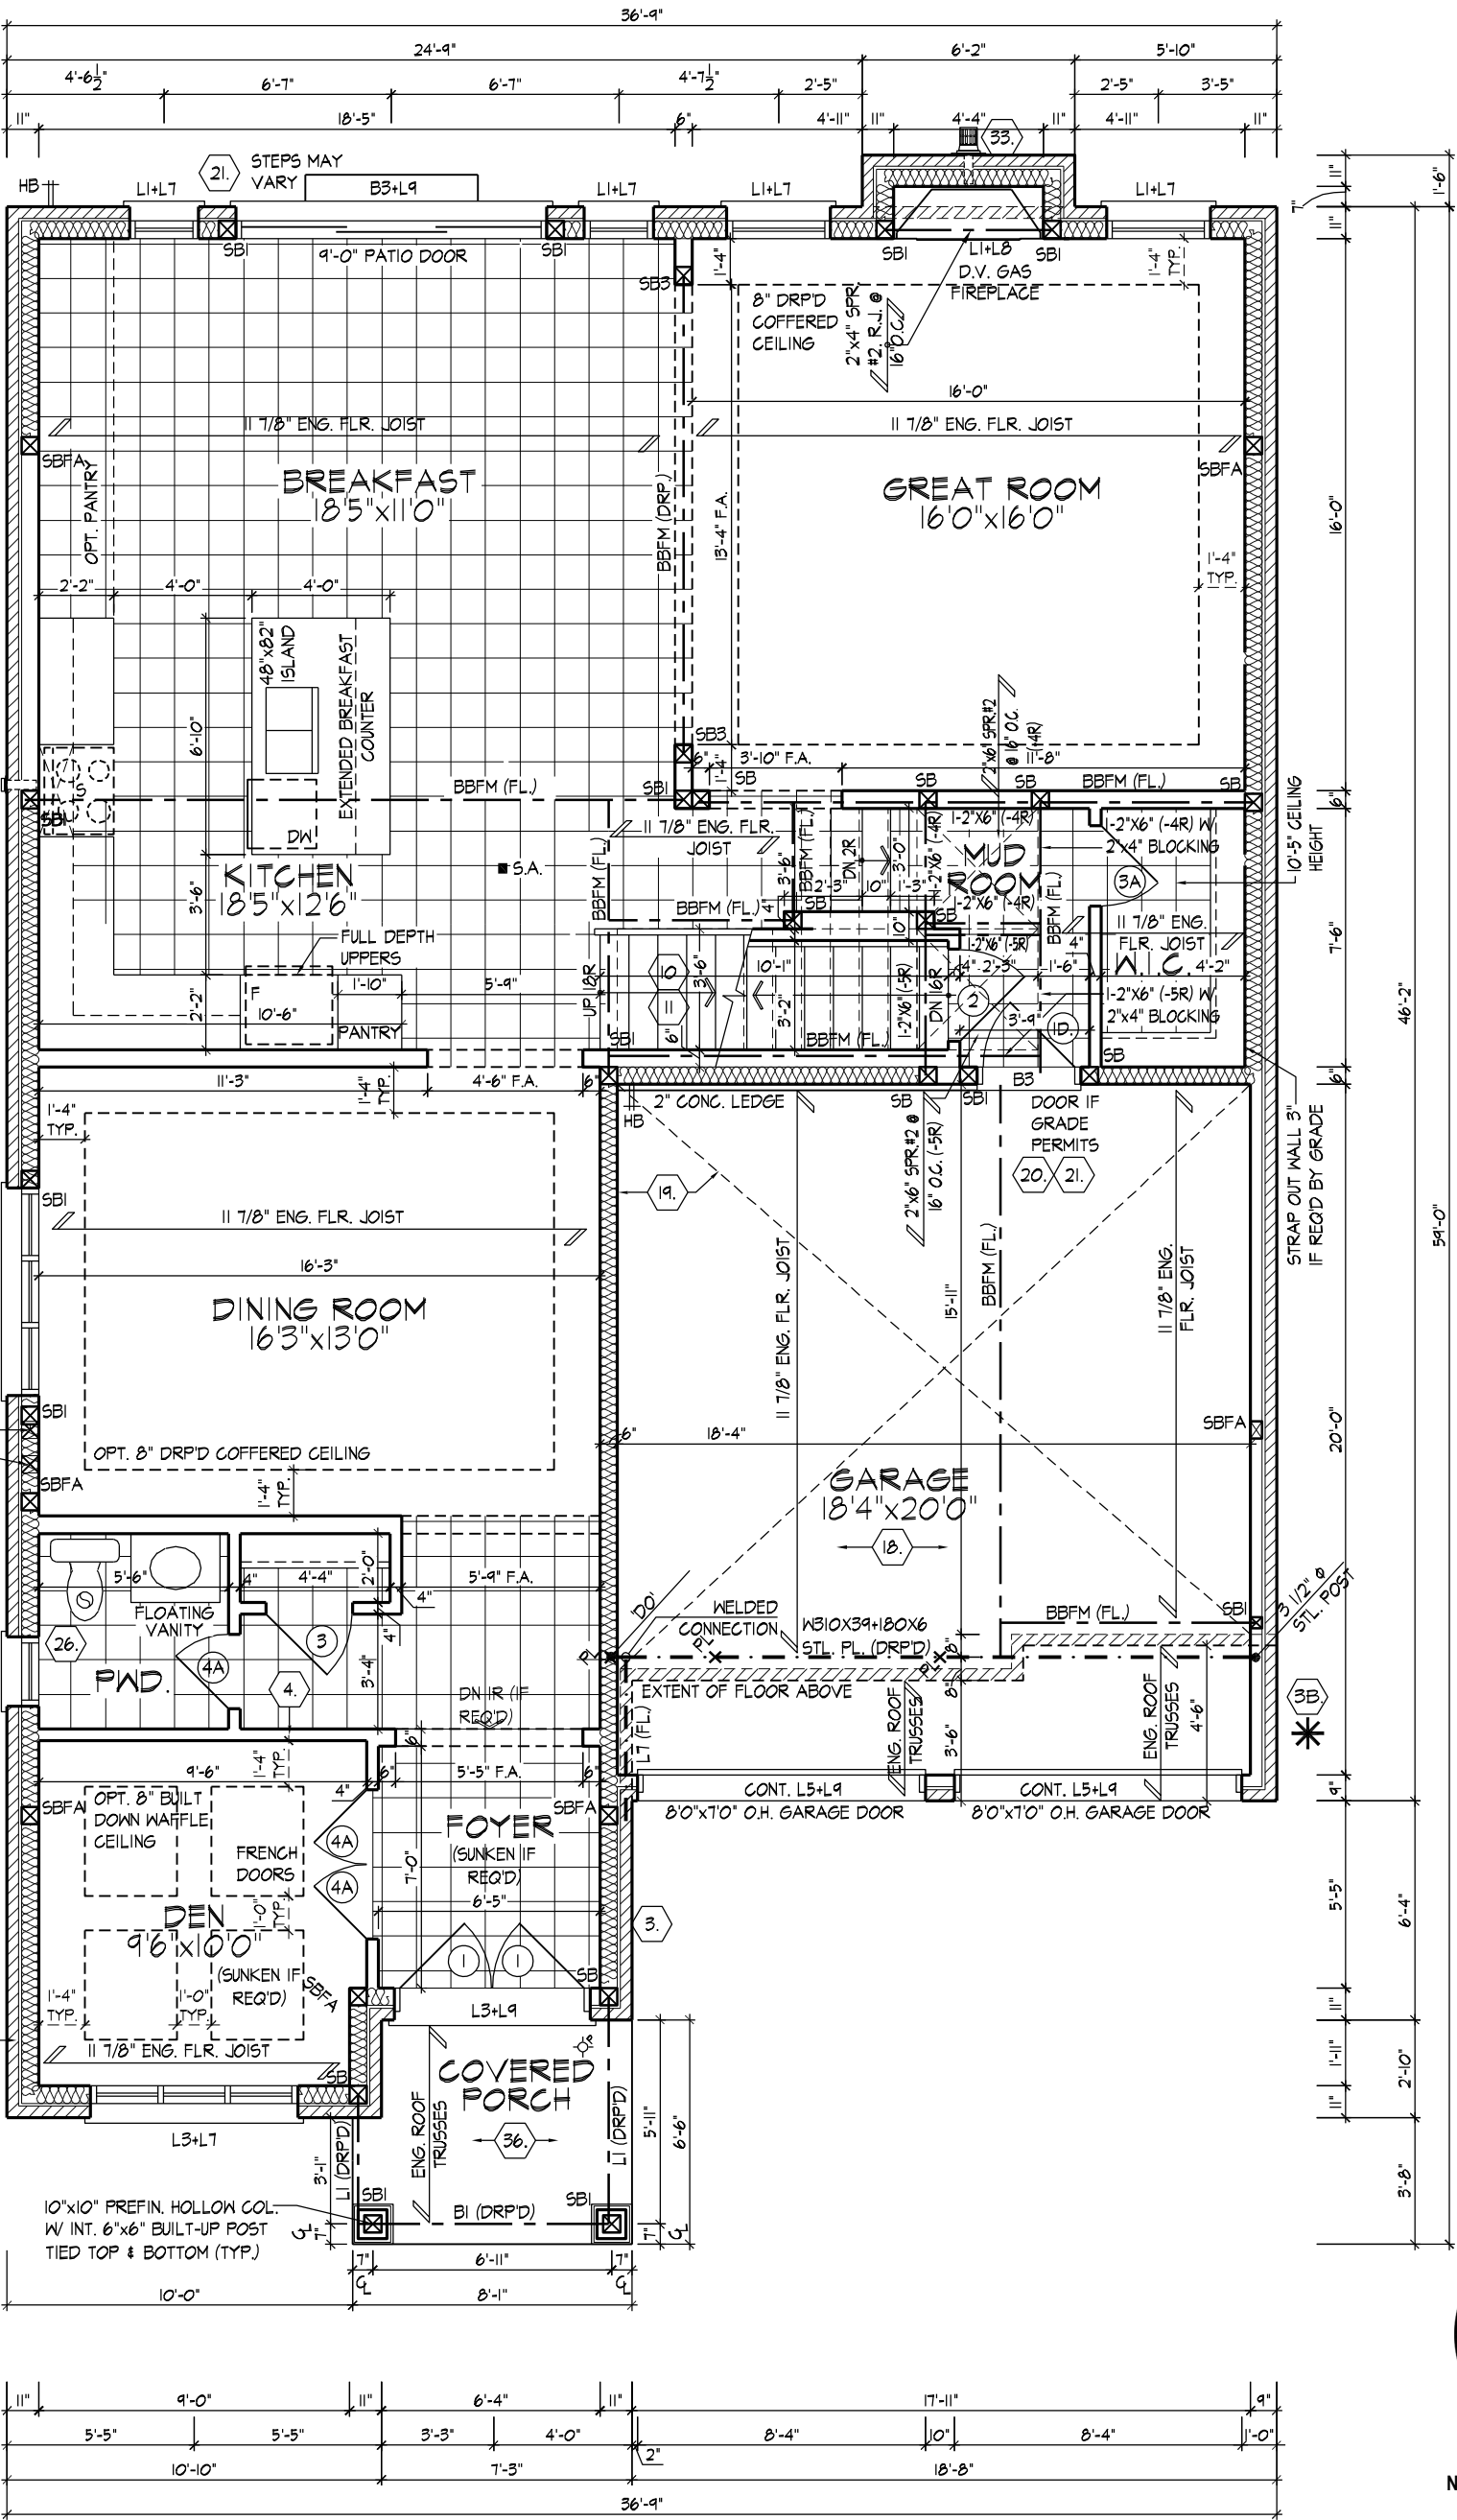


OPT. GROUND FLOOR PLAN 'A'

REFER TO FLOOR JOIST
MANUFACTURER'S DRAWINGS FOR
LAYOUT, SPACING, BLOCKING &
STRAPPING REQUIREMENTS,
INSTALLATION DETAILS AND HANGER
SIZES, & SUBFLOOR THICKNESS


WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS
GREATER THAN THE STUD SPACING SHALL HAVE
A SINGLE JACK AND KING POST ON EACH SIDE.
OPENINGS LARGER THAN 5'-6", SHALL HAVE A
MINIMUM OF TWO JACK POSTS AND ONE KING
POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL
BE MIN. 2/2"x4" OR 2/2"x6", UNLESS
OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

* 2"x4" STUD WALL ASSEMBLY EXCEEDING
MAX. UNSUPPORTED HEIGHT
FOR WALLS GREATER THAN 9'-10" TO MAX. 12'-0" HIGH,
- W/O FLOOR LOAD, DOUBLE UP EVERY STUD @ 16" O.C.
- W/ FLOOR LOAD DOUBLE UP EVERY STUD @ 12" O.C.
PROVIDE BLOCKING EVERY 4'-0" O.C. VERTICAL.

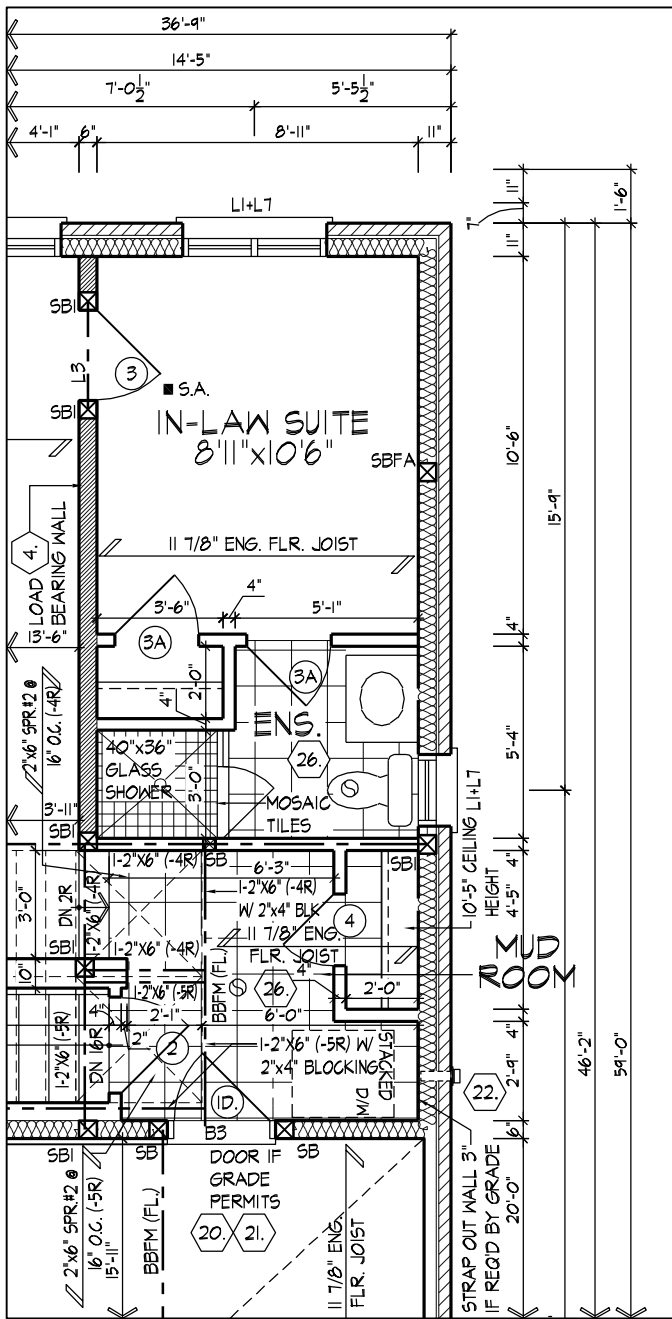

OPT. GROUND FLOOR PLAN W/
IN-LAW SUITE W/ OPT. LAUNDRY

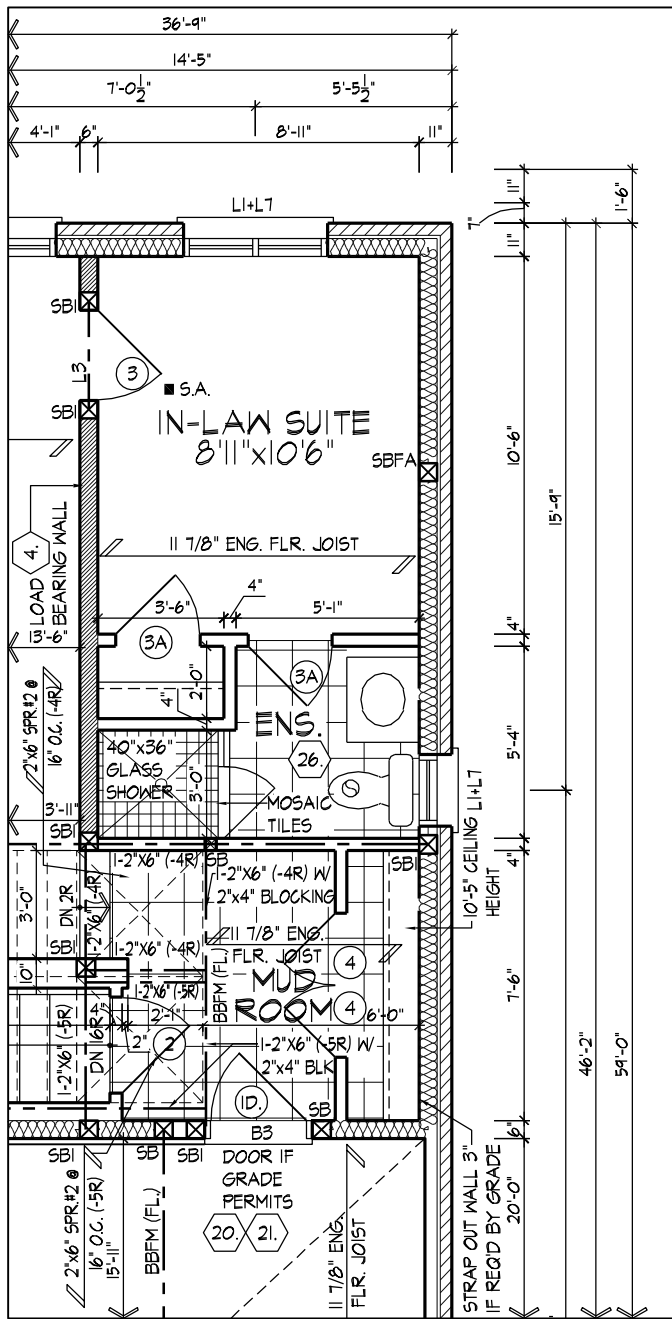

OPT. GROUND FLOOR PLAN W/
IN-LAW SUITE


REFER TO STANDARD PLAN FOR
COMPLETE CONSTRUCTION NOTES
& DIMENSIONS

REFER TO FLOOR JOIST
MANUFACTURER'S DRAWINGS FOR
LAYOUT, SPACING, BLOCKING &
STRAPPING REQUIREMENTS,
INSTALLATION DETAILS AND HANGER
SIZES, & SUBFLOOR THICKNESS

WOOD LINTEL NOTES:

ALL OPENINGS IN LOAD BEARING WALLS
GREATER THAN THE STUD SPACING SHALL HAVE
A SINGLE JACK AND KING POST ON EACH SIDE.
OPENINGS LARGER THAN 5'-6", SHALL HAVE A
MINIMUM OF TWO JACK POSTS AND ONE KING
POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL
BE MIN. 2/2"x4" OR 2/2"x6", UNLESS
OTHERWISE NOTED AS FOLLOWS:
SB1 - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

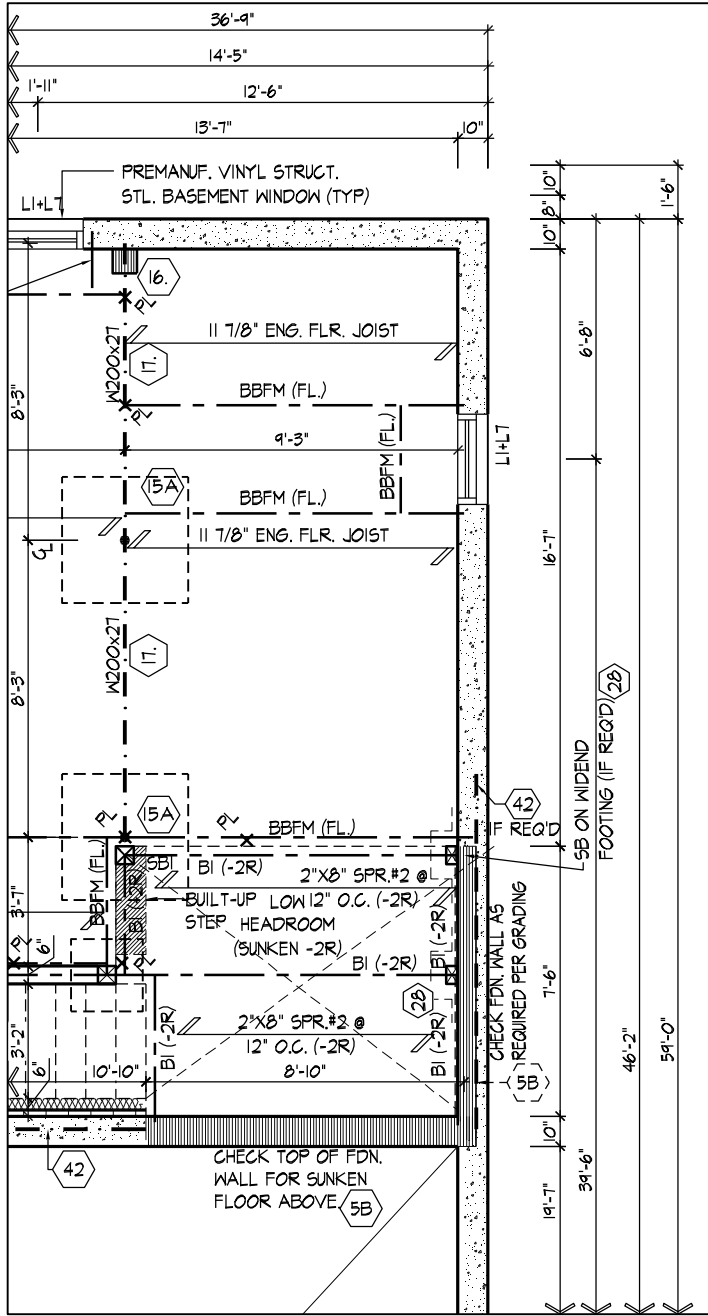

BASEMENT PLAN FOR OPT. IN-LAW
SUITES



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

PART.OPT. IN-LAW SUITE FLOOR PLANS EL. 'A', 'B' & 'C'

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS
THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING
CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Derek R. Santos

NAME
REGISTRATION INFORMATION

HUNT DESIGN ASSOCIATES INC.

37308

BCIN

HUNT
DESIGN ASSOCIATES INC.

www.huntdesign.ca

ROYAL PINE HOMES - 216102

"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON

SK/MM

Checked By

VL

Scale

3/16"=1'-0"

UNIT 4504 "THE DUNCAN"

REV.2021.05.07

File Number


216102WS4504.dwg

Page Number

6 of 39

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

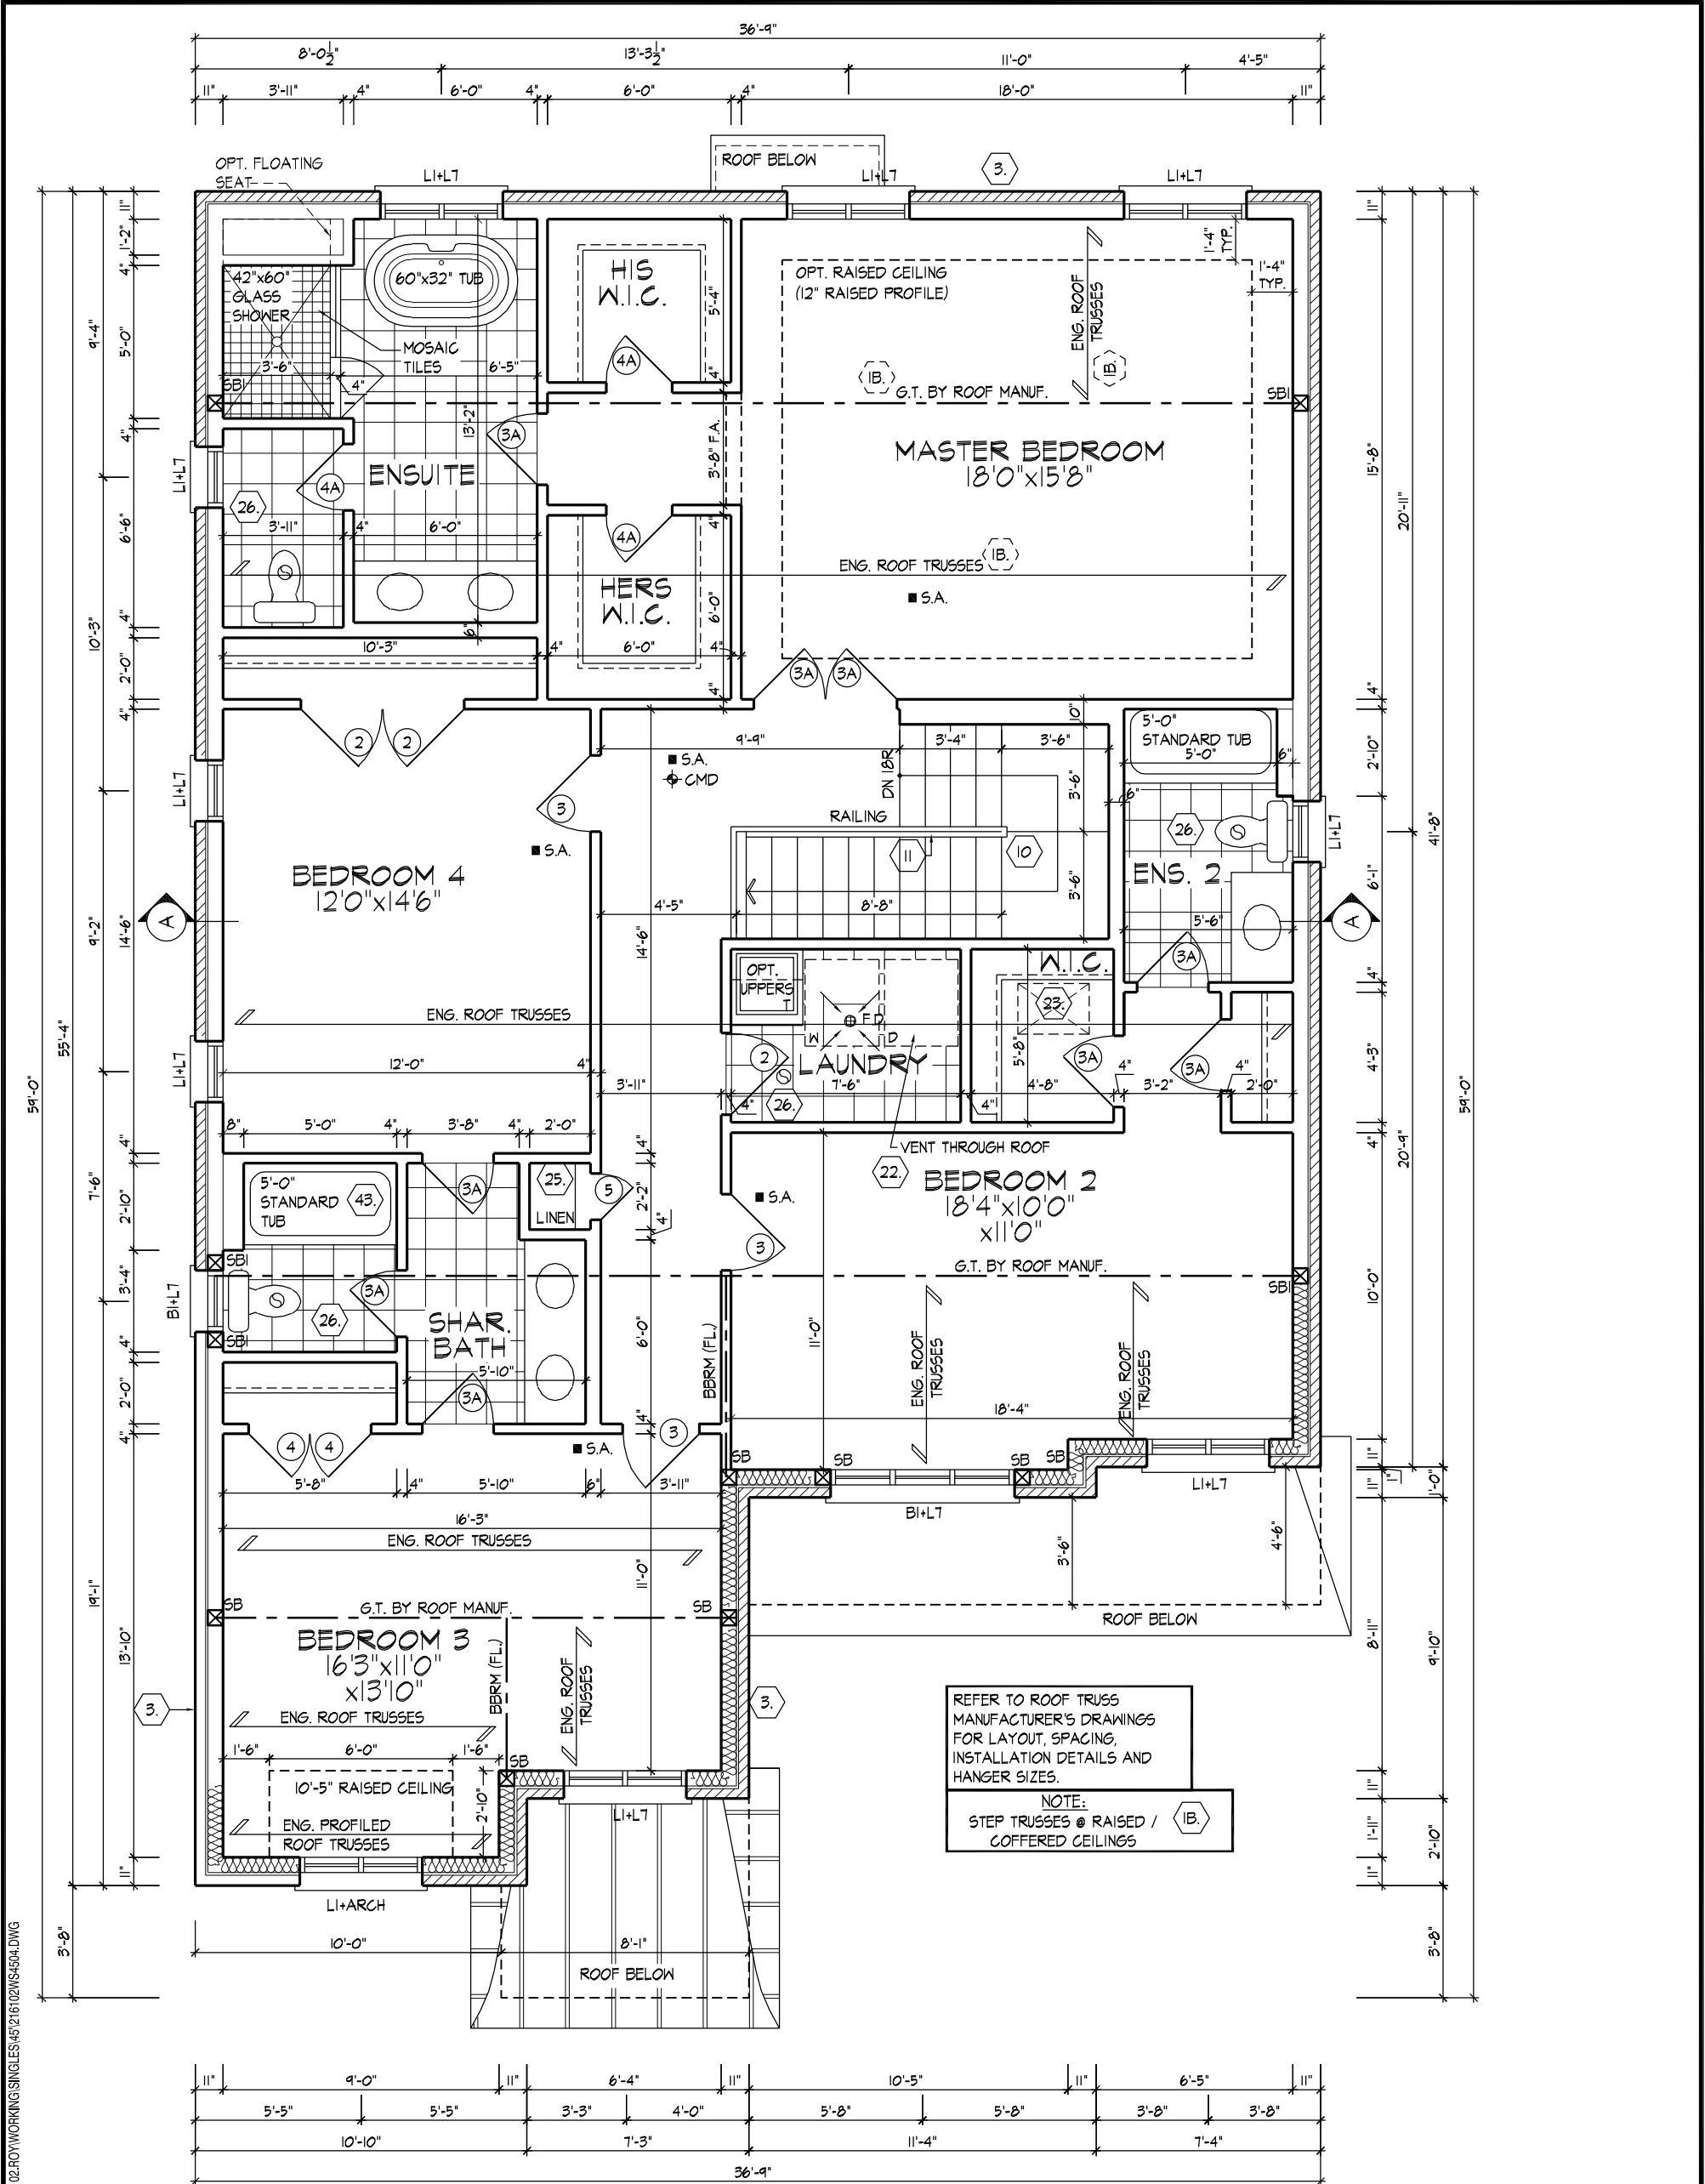

SECOND FLOOR PLAN EL. 'A'

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

SECOND FLOOR PLAN EL. 'A'



37308
BCIN


ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
UNIT 4504 "THE DUNCAN"
REV.2021.05.07
8 of 39
216102WS4504.dwg
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

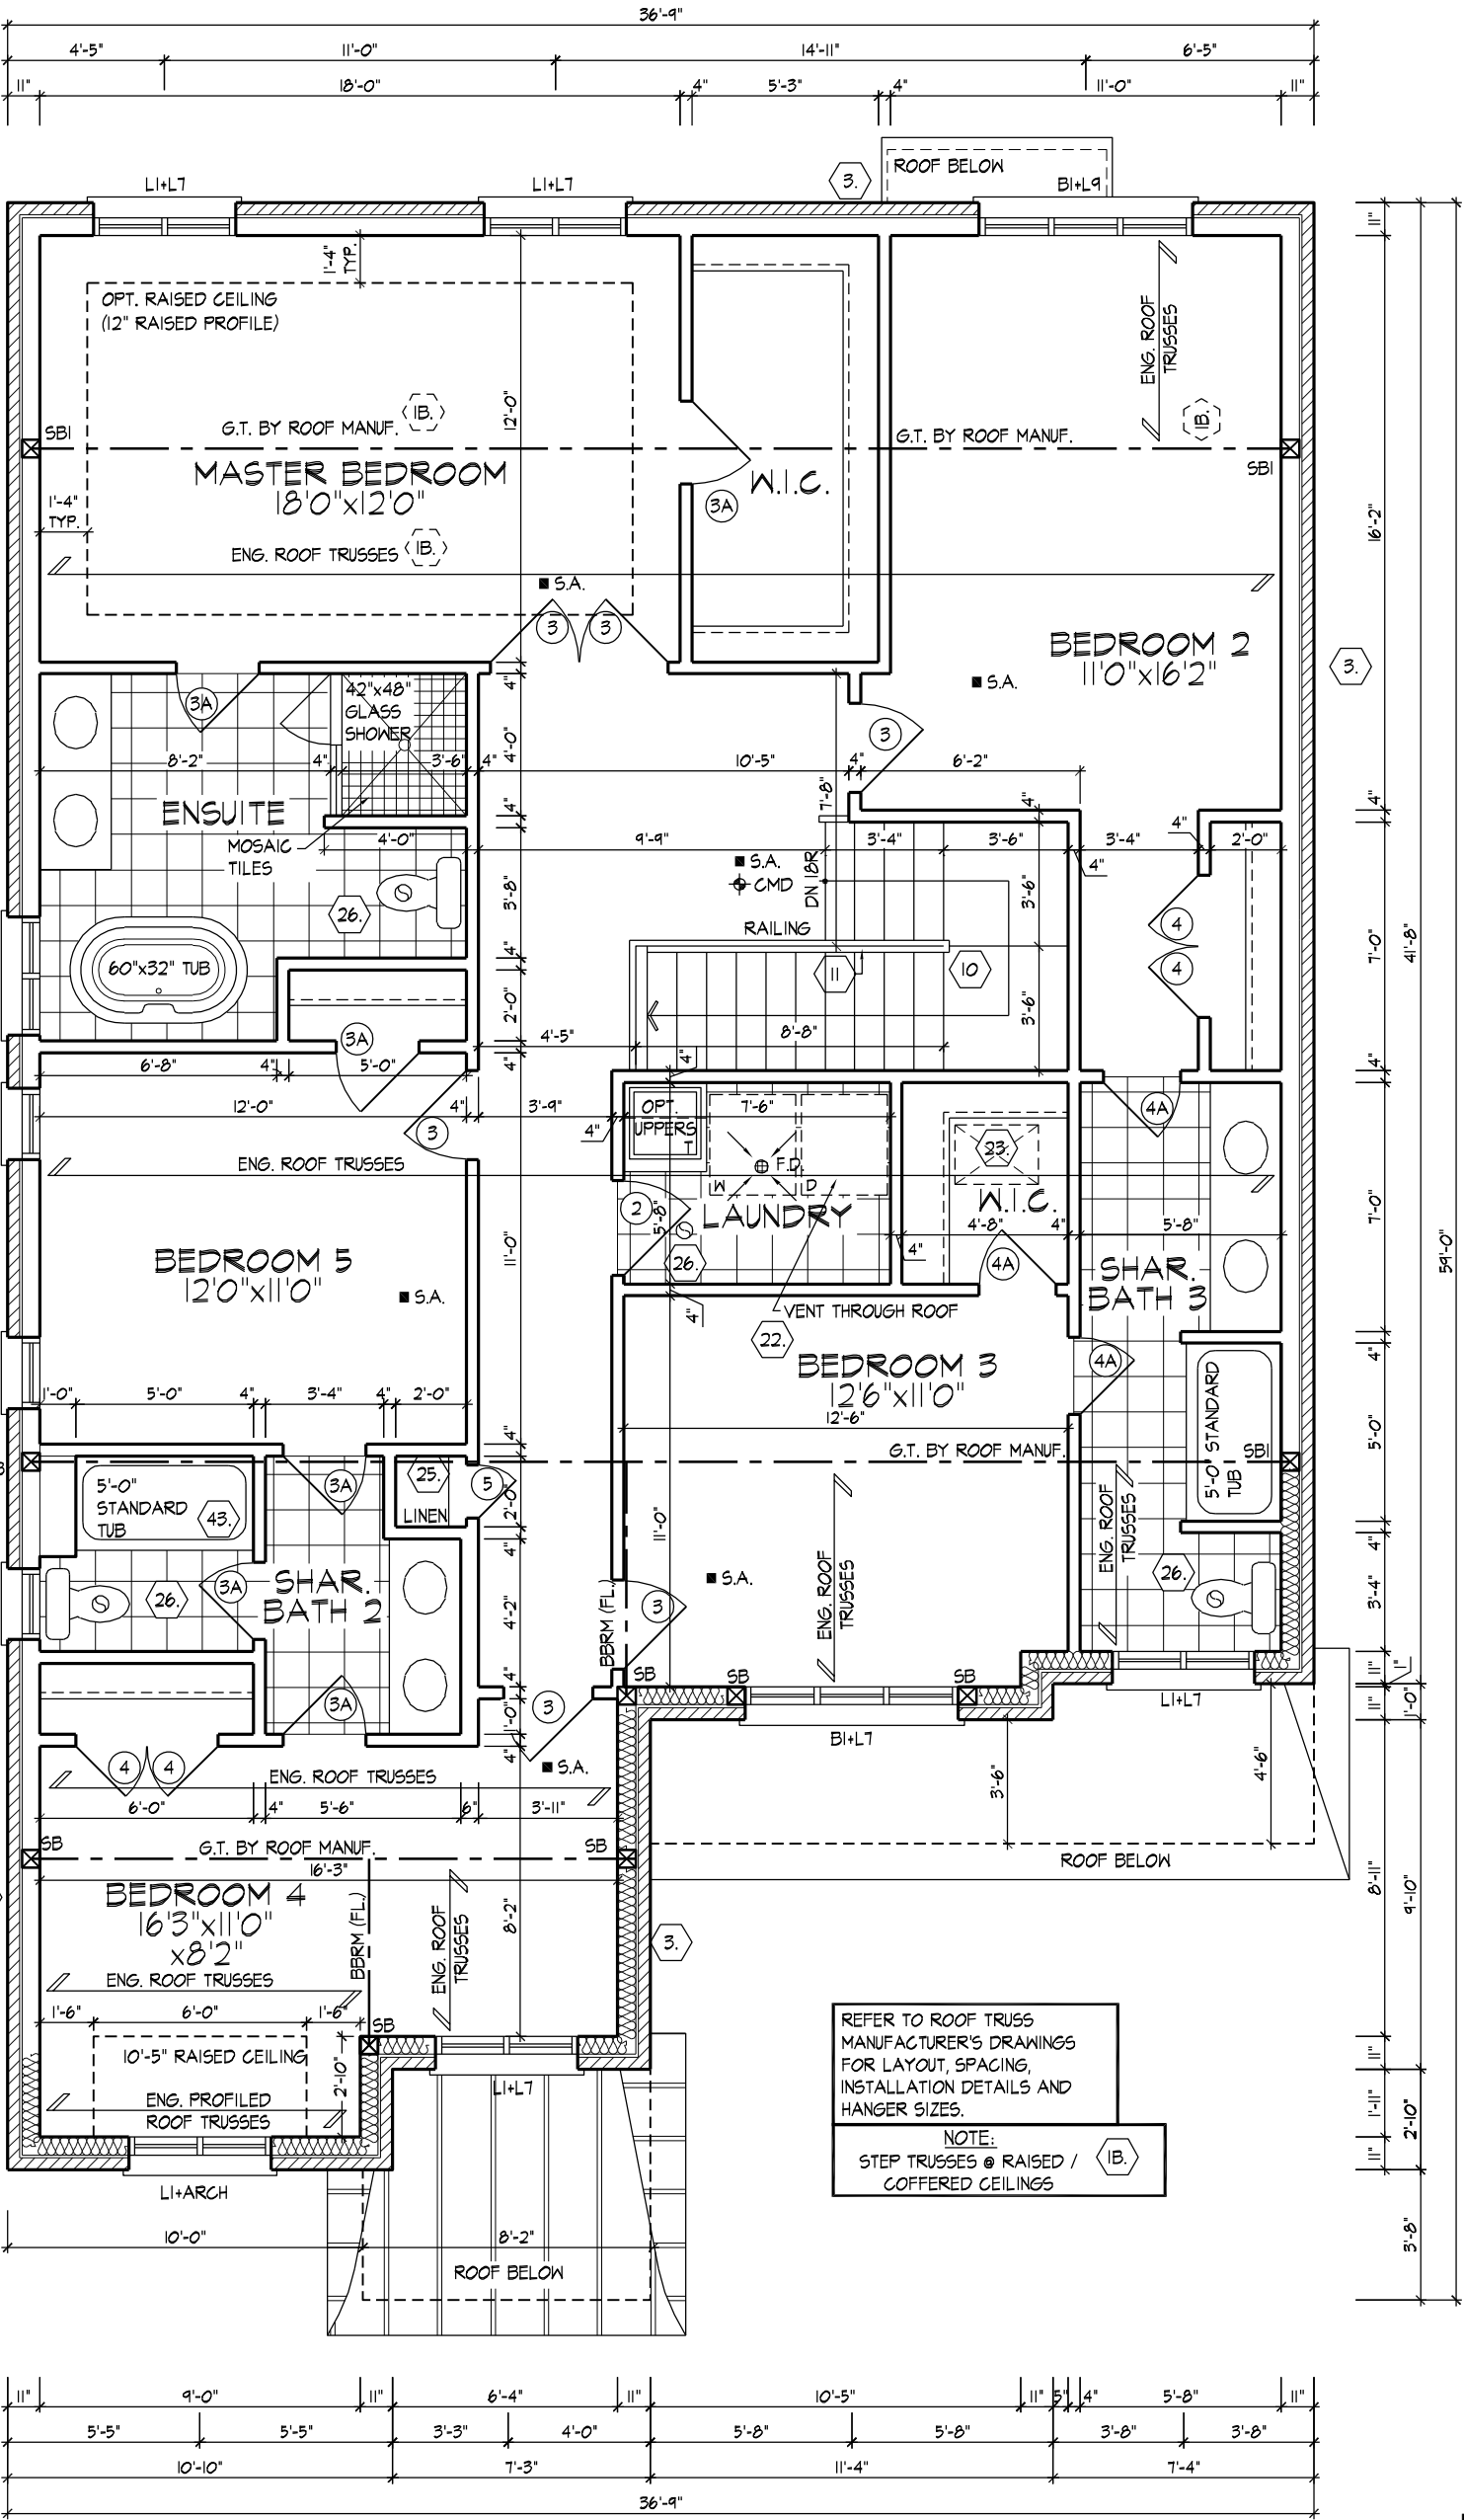

REFER TO ROOF TRUSS MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, INSTALLATION DETAILS AND HANGER SIZES.

NOTE:
STEP TRUSSES @ RAISED / COFFERED CEILINGS



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

OPT. SECOND FLOOR PLAN 'A'
5 BEDROOM CONDITION

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.


37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
Drawn By SK/MM
Checked By VL
Scale 3/16"=1'-0"

UNIT 4504 "THE DUNCAN"
REV.2021.05.07
File Number 216102WS4504.dwg
Page Number 9 of 39

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

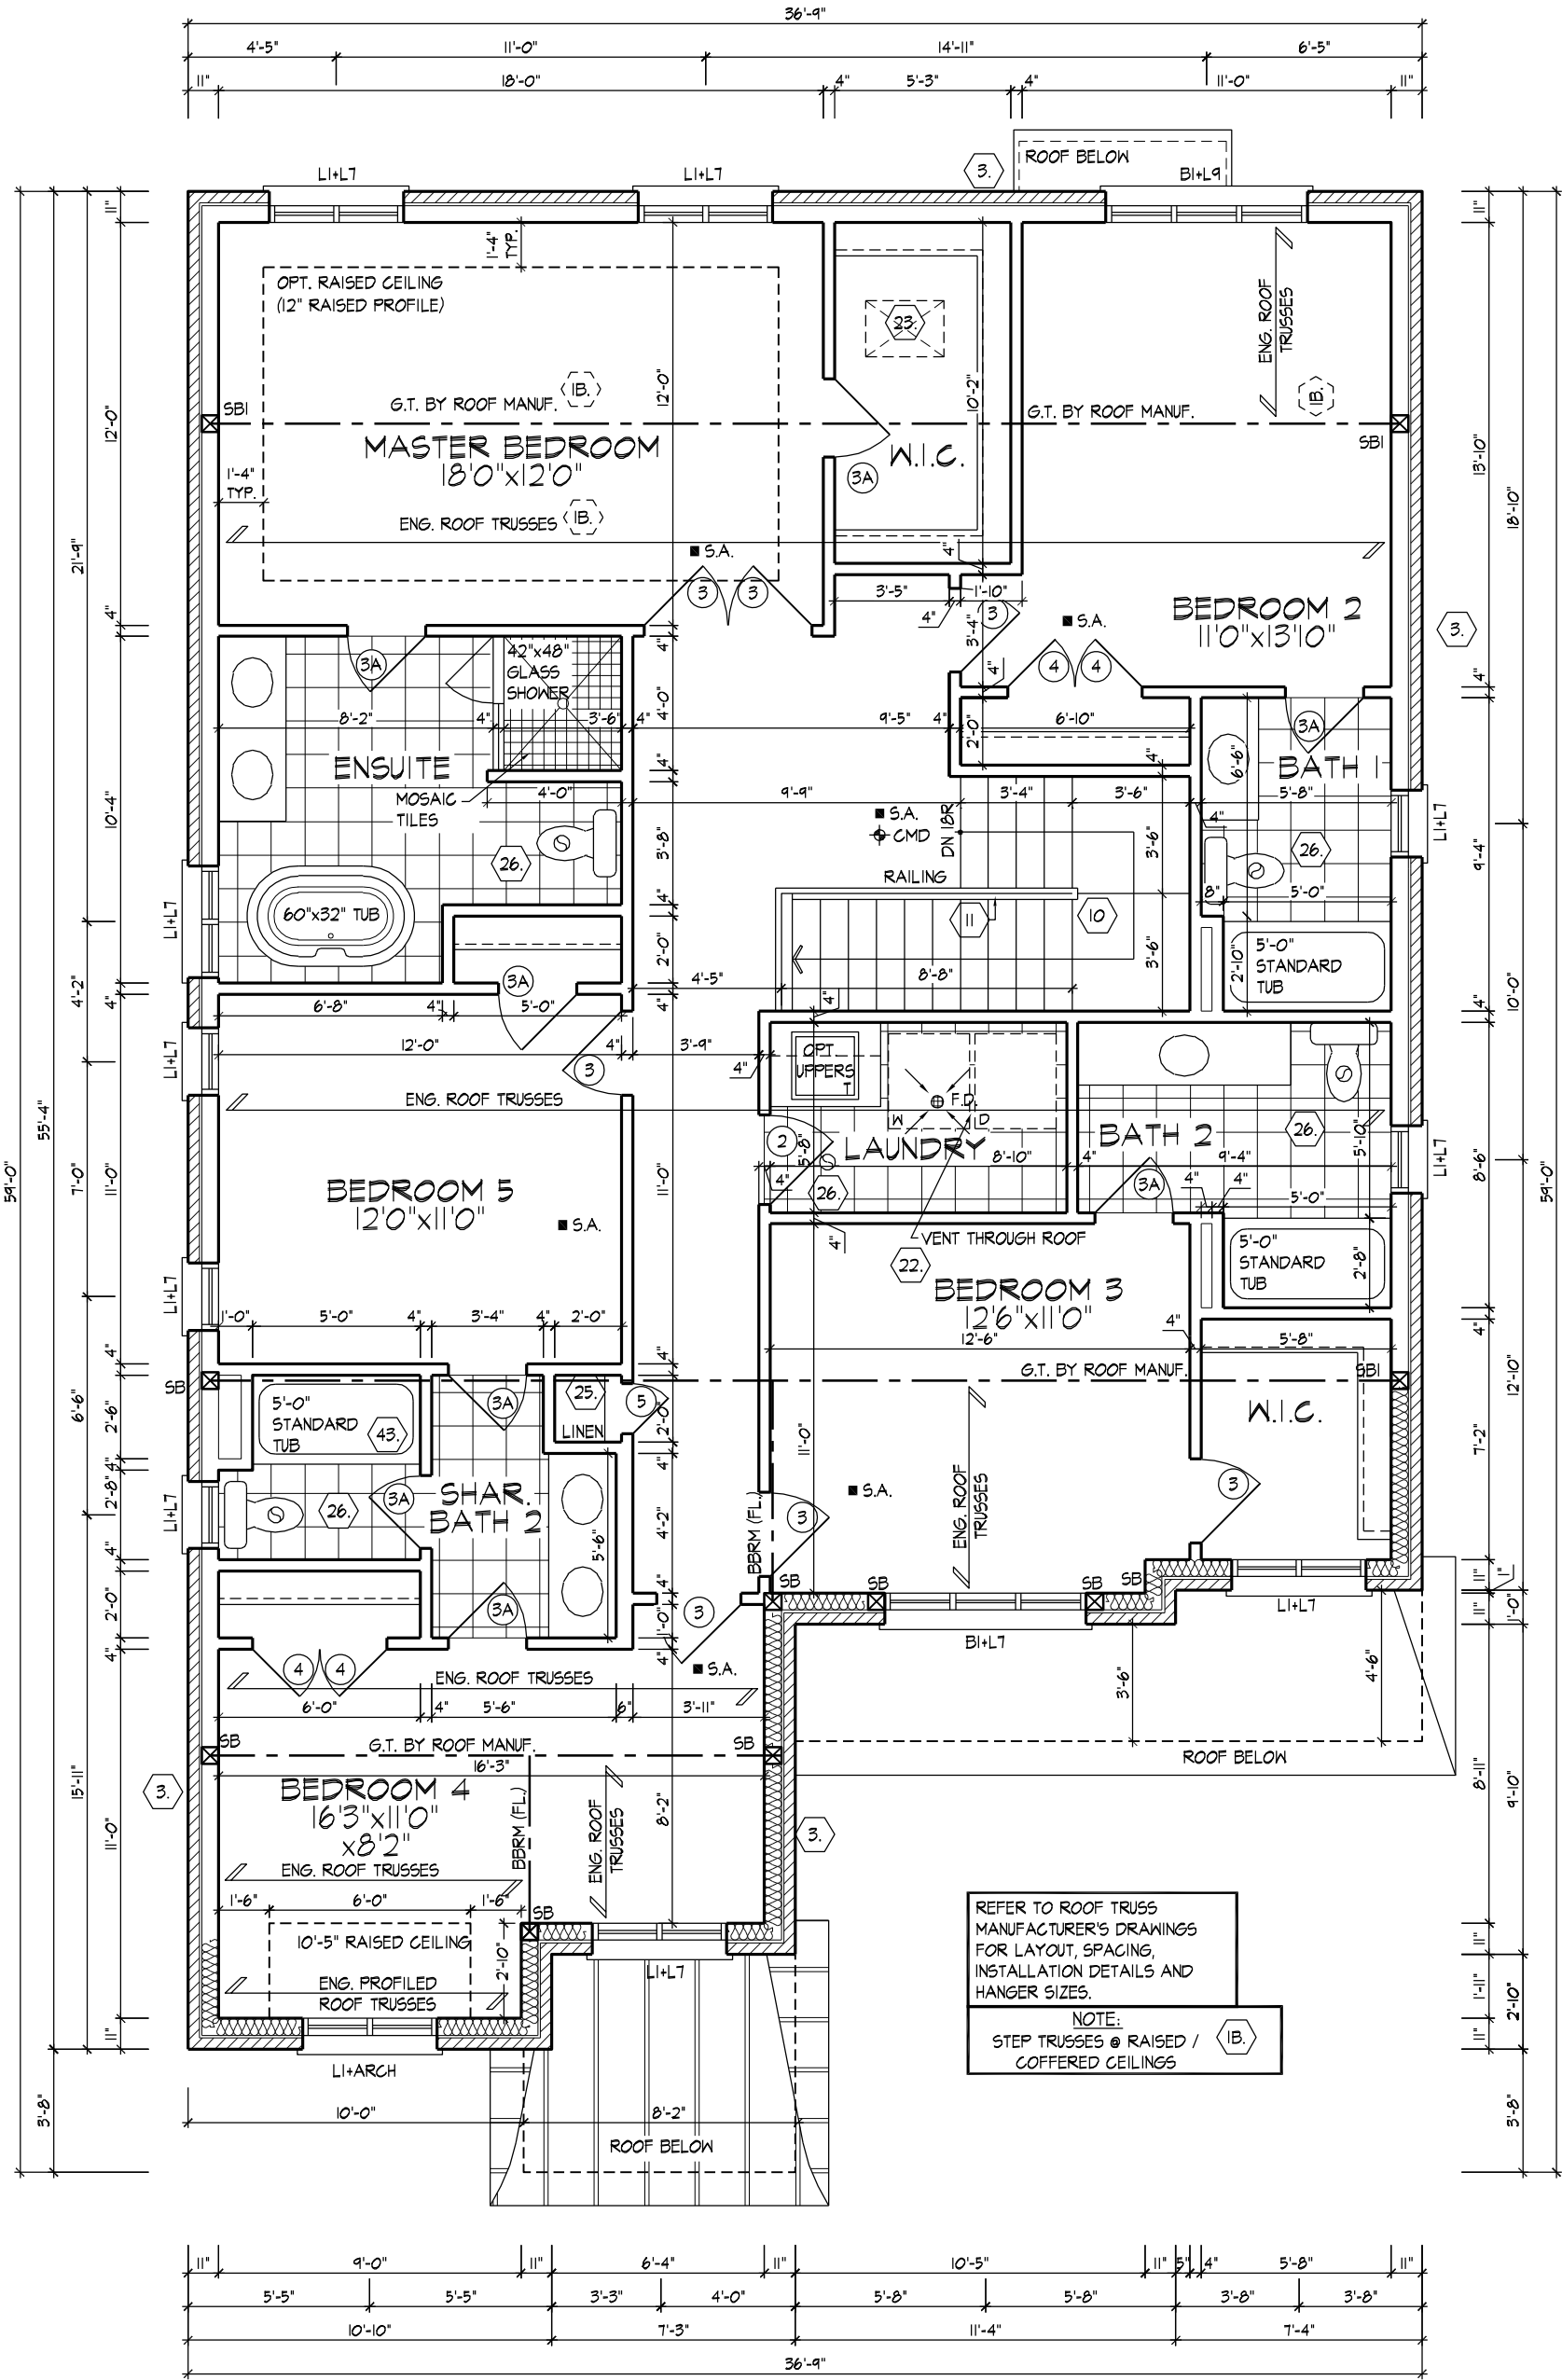

OPT. SECOND FLOOR PLAN, ELEVATION 'A'
(W/ 5 BEDROOM, 4 BATHROOM CONDITION LAYOUT)



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

ALL POSTS NOTED AS "SB" SHALL
BE MIN. 2/2"x4" OR 2/2"x6", UNLESS
OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS
GREATER THAN THE STUD SPACING SHALL HAVE
A SINGLE JACK AND KING POST ON EACH SIDE.
OPENINGS LARGER THAN 5'-6", SHALL HAVE A
MINIMUM OF TWO JACK POSTS AND ONE KING
POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

OPT. SECOND FLOOR PLAN EL. 'A' (W/ 5 BEDROOM, 4 BATHROOM)

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN


HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON

UNIT 4504 "THE DUNCAN"
REV.2021.05.07

Drawn By SK/MM Checked By VL Scale 3/16"=1'-0" File Number 216102WS4504.dwg Page Number 10 of 39
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

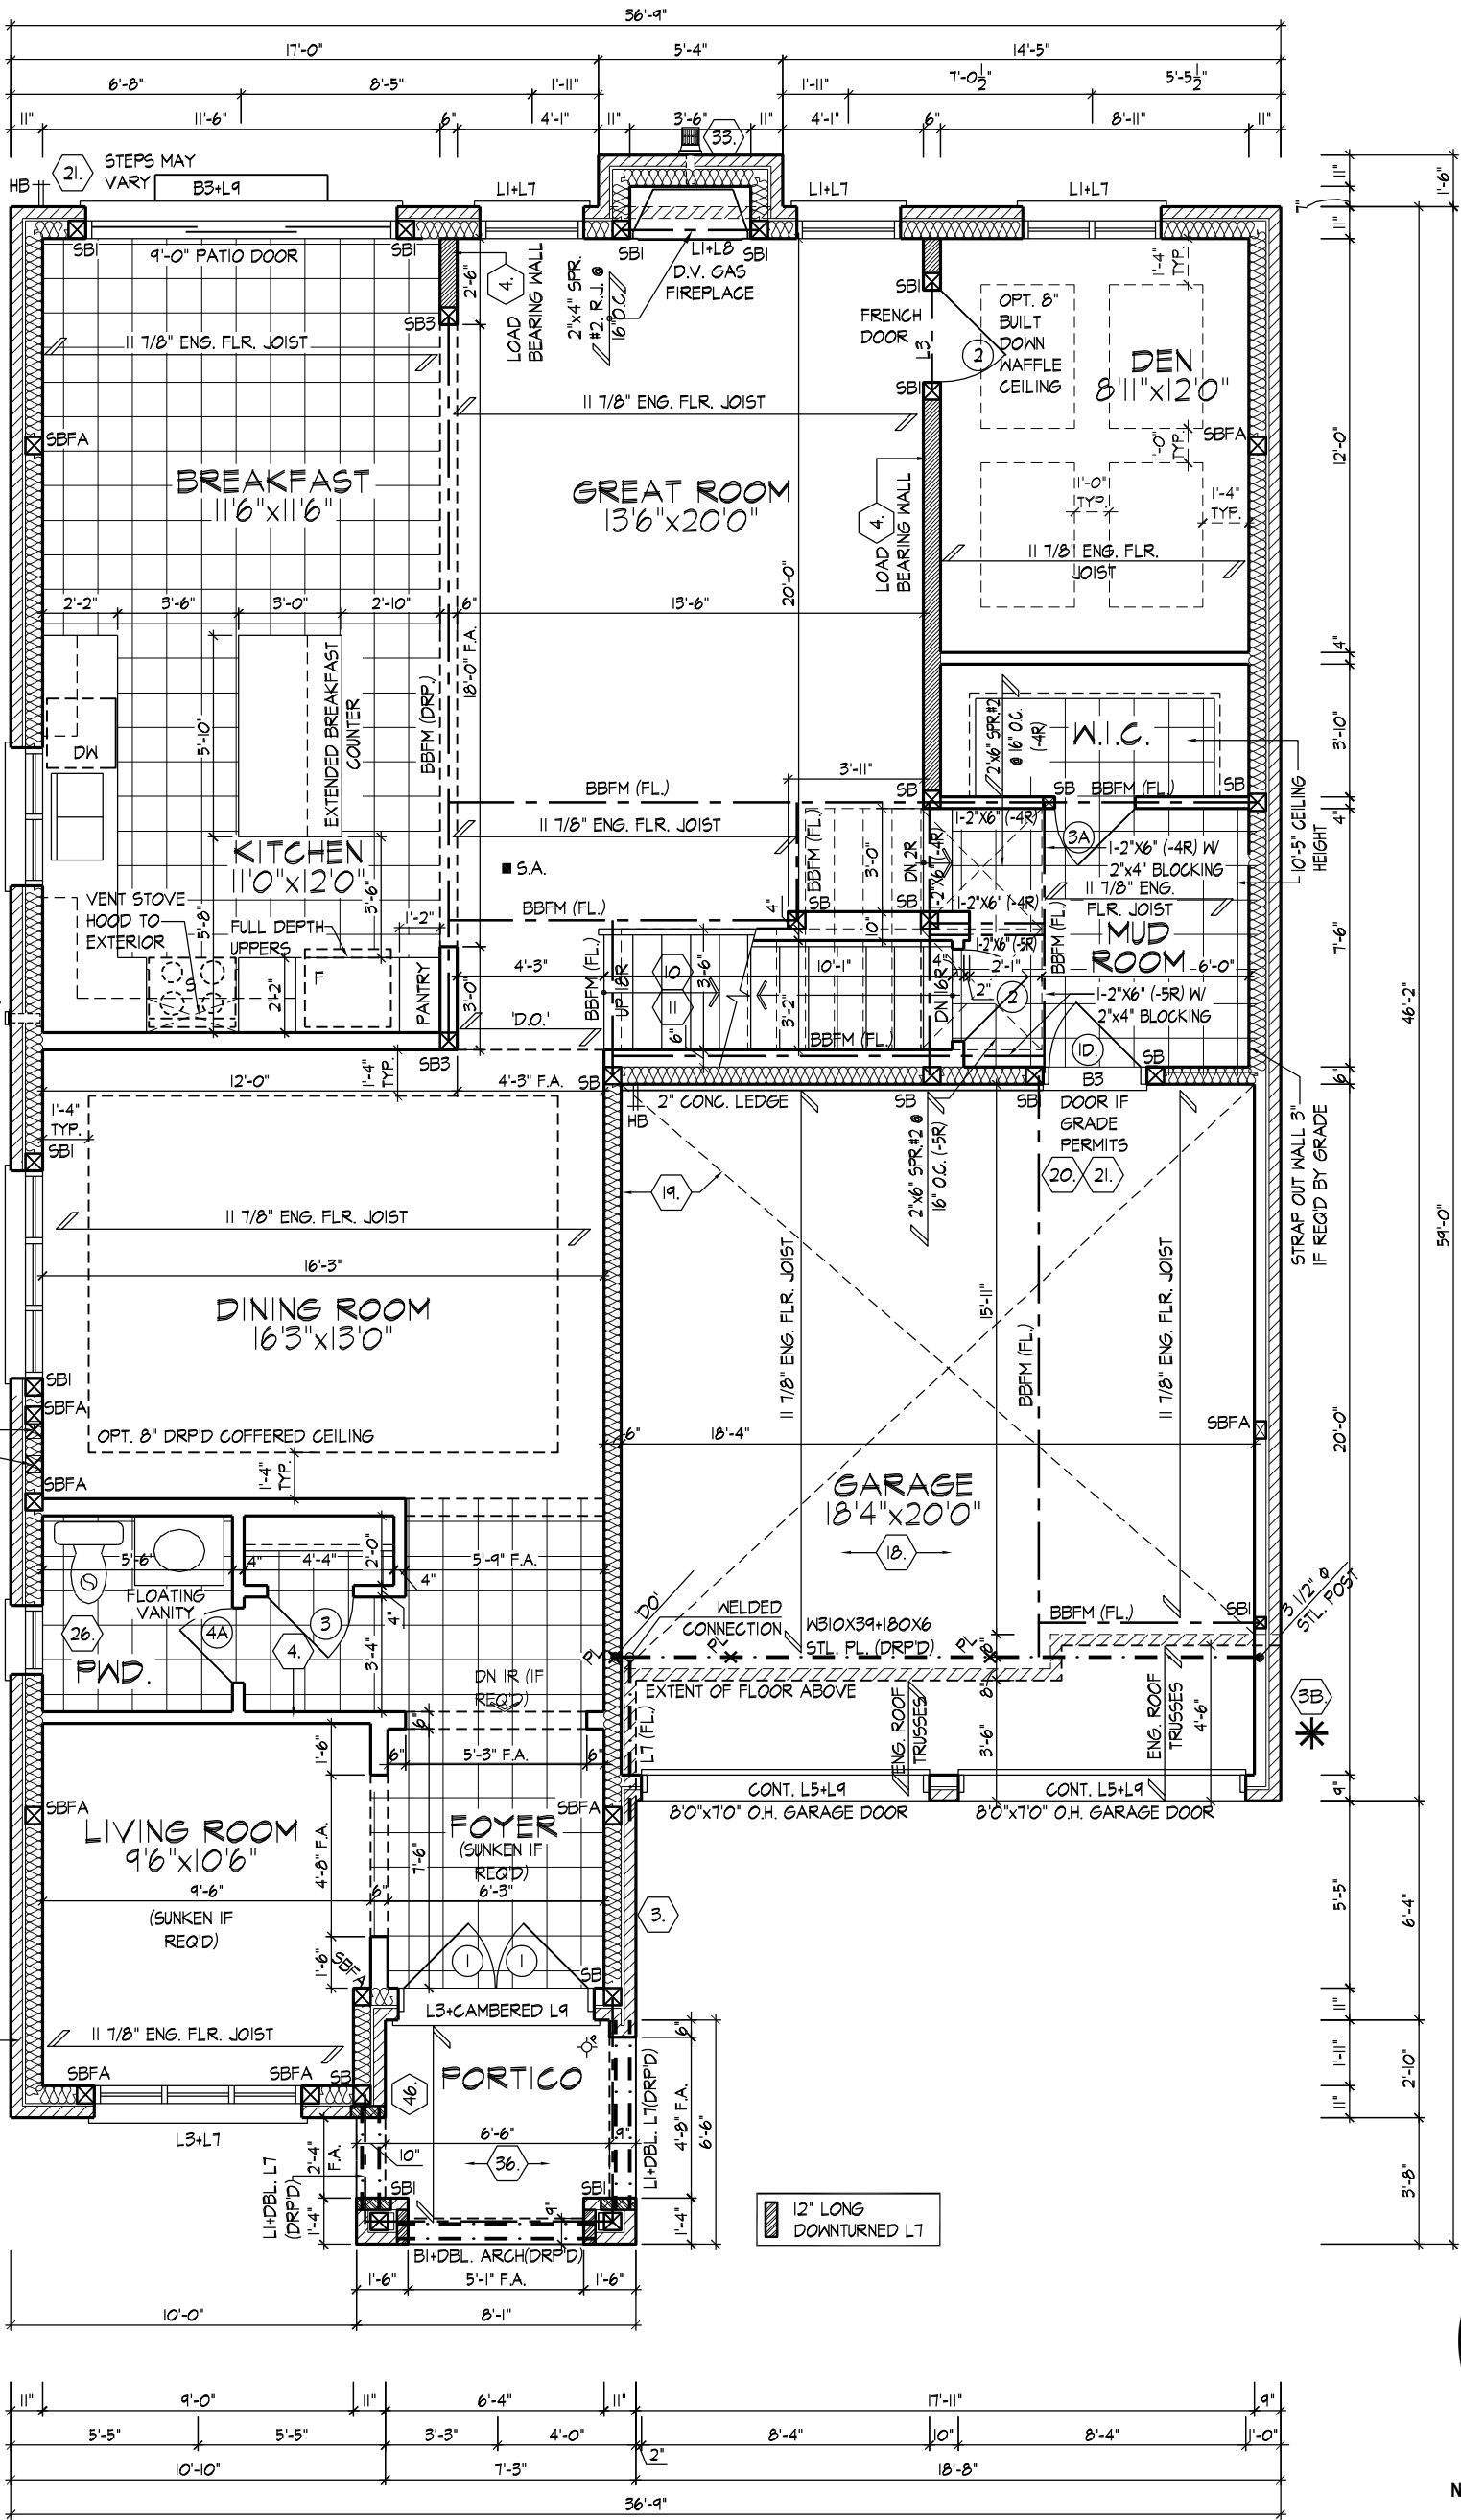

GROUND FLOOR PLAN EL. 'B'

REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BLOCKING & STRAPPING REQUIREMENTS, INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

*** 2"x4" STUD WALL ASSEMBLY EXCEEDING MAX. UNSUPPORTED HEIGHT**
FOR WALLS GREATER THAN 9'-10" TO MAX. 12'-0" HIGH,
- W/O FLOOR LOAD, DOUBLE UP EVERY STUD @ 16" O.C.
- W FLOOR LOAD DOUBLE UP EVERY STUD @ 12" O.C.
PROVIDE BLOCKING EVERY 4'-0" O.C. VERTICAL.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

GROUND FLOOR PLAN EL. 'B'

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG


THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
Drawn By
SK/MM
Checked By
VL
Scale
3/16"=1'-0"
File Number
216102WS4504.dwg
Page Number
11 of 39

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

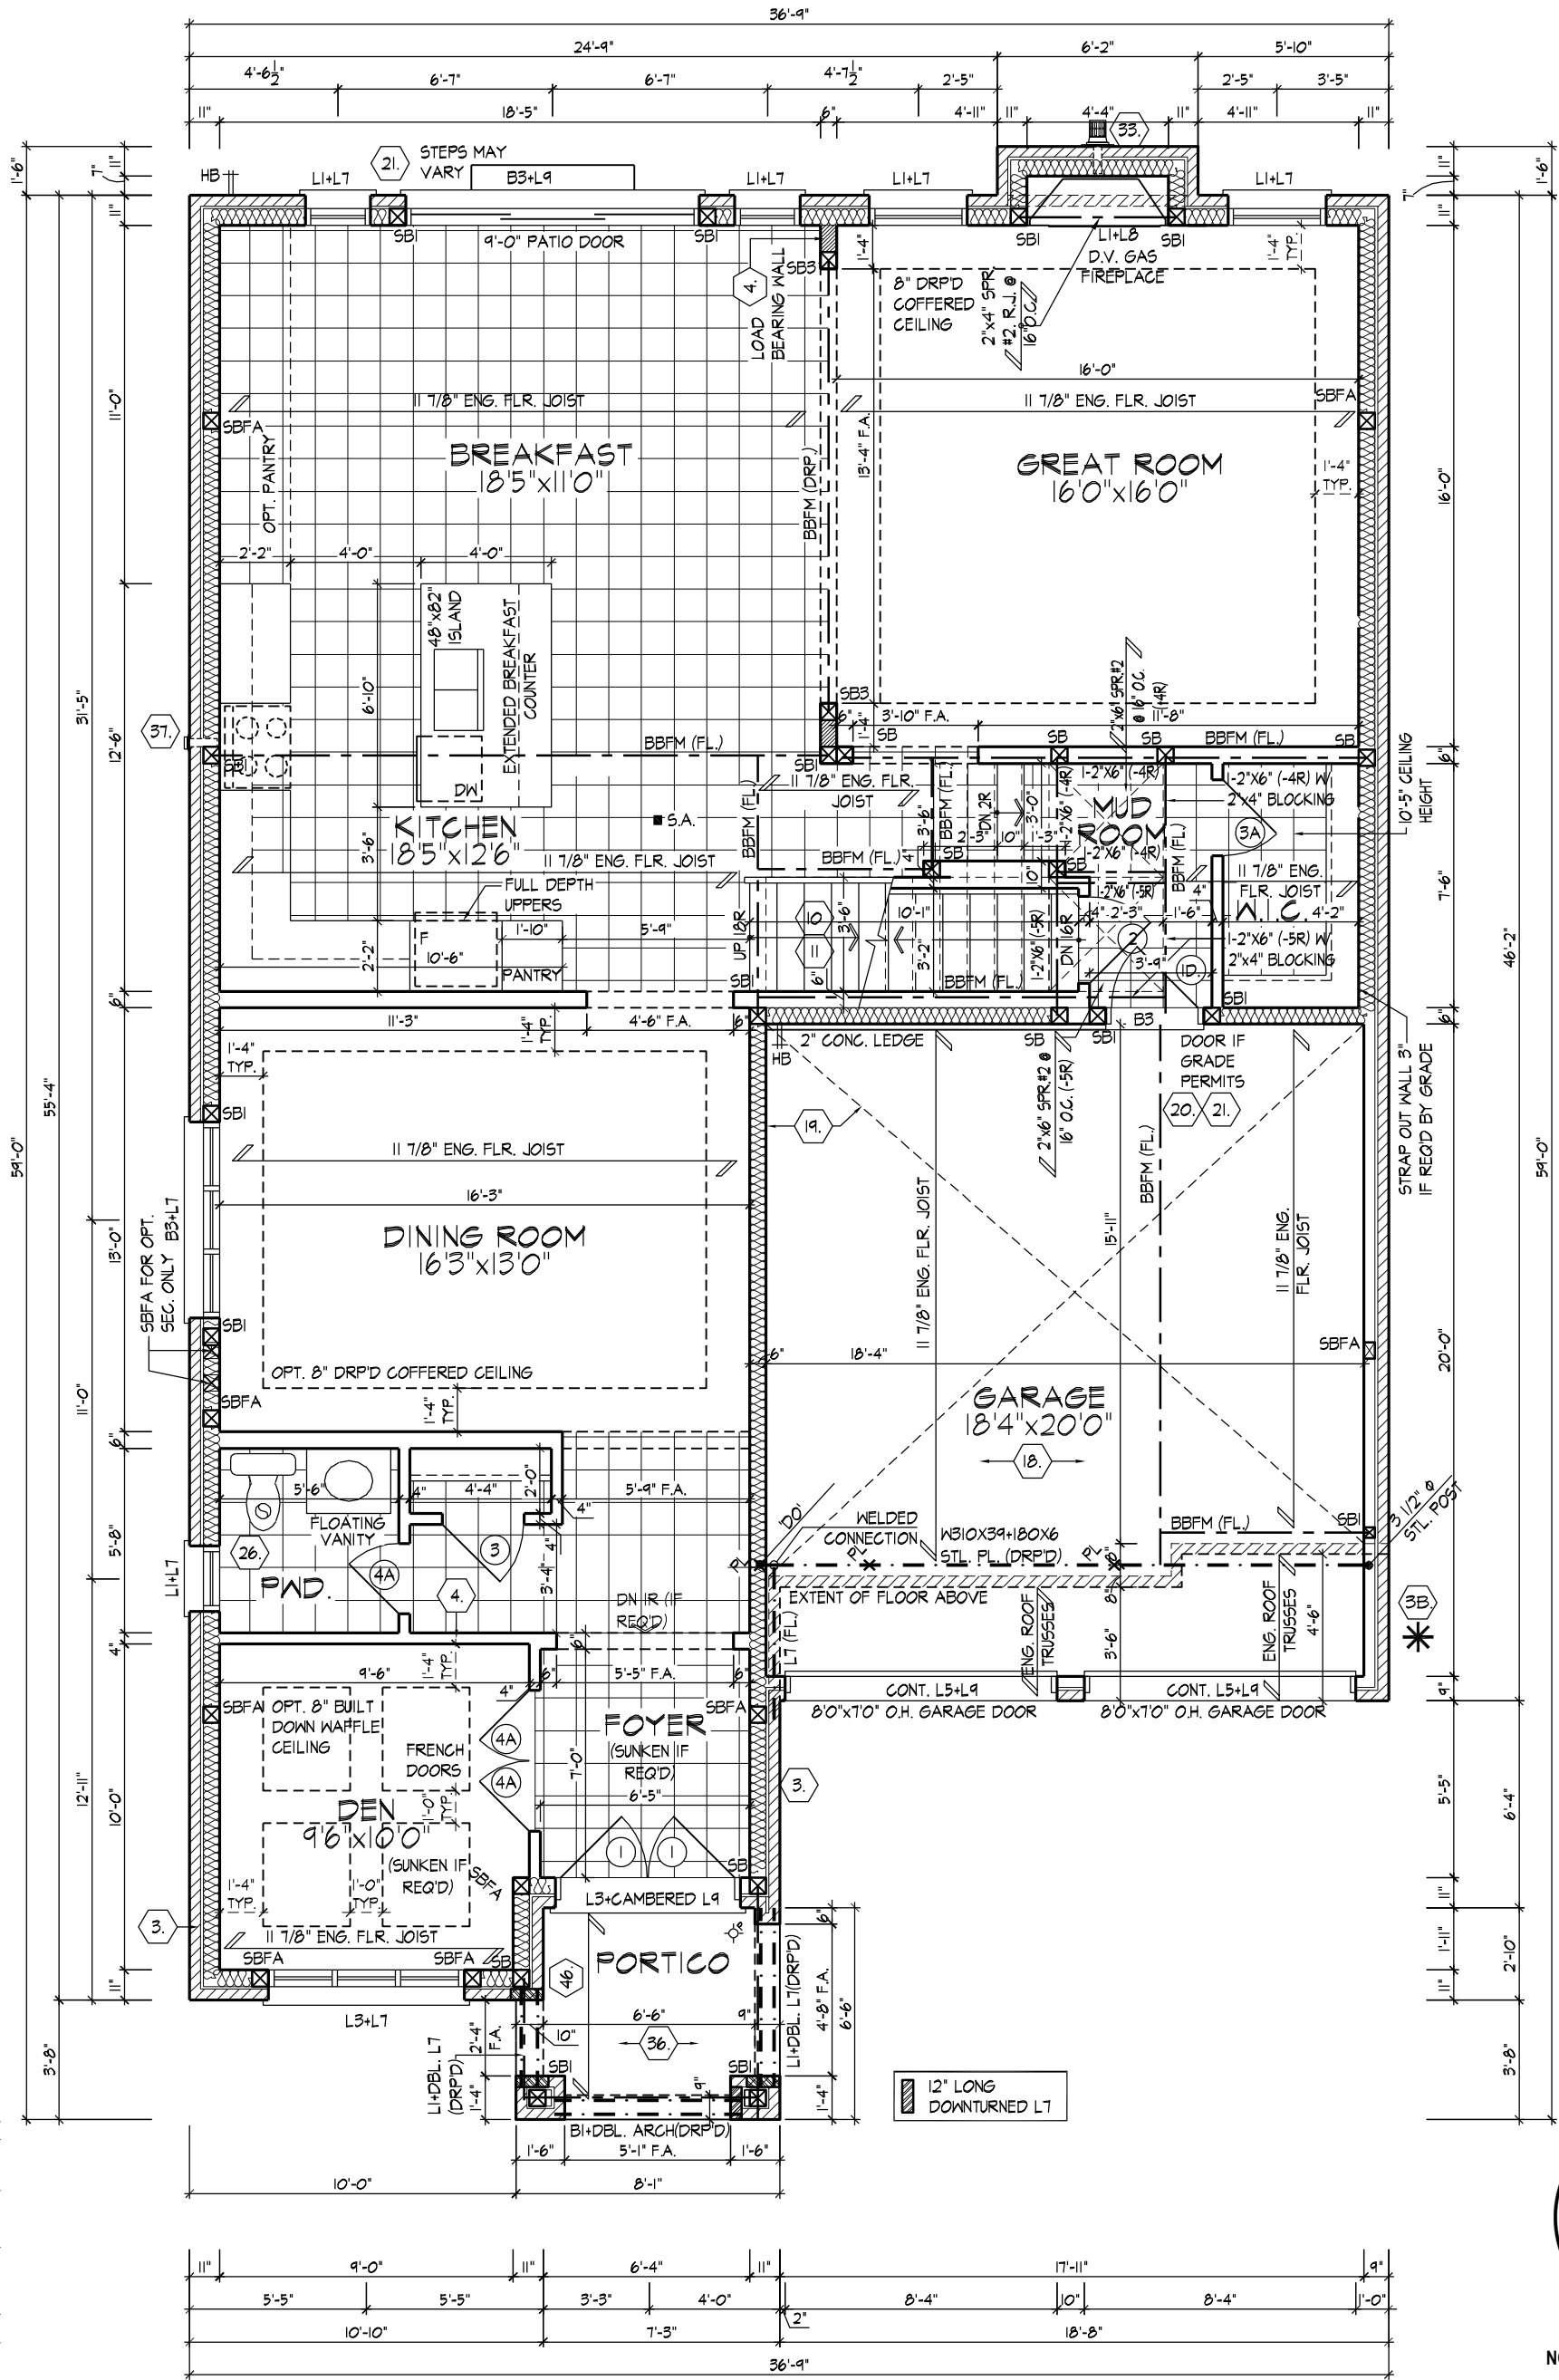

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

OPT. GROUND FLOOR PLAN 'B'

REFER TO FLOOR JOIST
MANUFACTURER'S DRAWINGS FOR
LAYOUT, SPACING, BLOCKING &
STRAPPING REQUIREMENTS,
INSTALLATION DETAILS AND HANGER
SIZES, & SUBFLOOR THICKNESS

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS
GREATER THAN THE STUD SPACING SHALL HAVE
A SINGLE JACK AND KING POST ON EACH SIDE.
OPENINGS LARGER THAN 5'-6", SHALL HAVE A
MINIMUM OF TWO JACK POSTS AND ONE KING
POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL
BE MIN. 2/2"x4" OR 2/2"x6", UNLESS
OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

* 2"x4" STUD WALL ASSEMBLY EXCEEDING
MAX. UNSUPPORTED HEIGHT
FOR WALLS GREATER THAN 9'-10" TO MAX. 12'-0" HIGH,
- W/O FLOOR LOAD, DOUBLE UP EVERY STUD @ 16" O.C.
- W/ FLOOR LOAD DOUBLE UP EVERY STUD @ 12" O.C.
PROVIDE BLOCKING EVERY 4'-0" O.C. VERTICAL.

OPT. GROUND FLOOR PLAN 'B'

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
UNIT 4504 "THE DUNCAN"
REV.2021.05.07
Drawn By
SK/MM
Checked By
VL
Scale
3/16"=1'-0"
File Number
216102WS4504.dwg
Page Number
13 of 39
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

OPT. SECOND FLOOR PLAN 'B' 5 BEDROOM CONDITION


WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SB1 - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

OPT. 5 BEDROOM SECOND FLOOR PLAN EL. 'B'

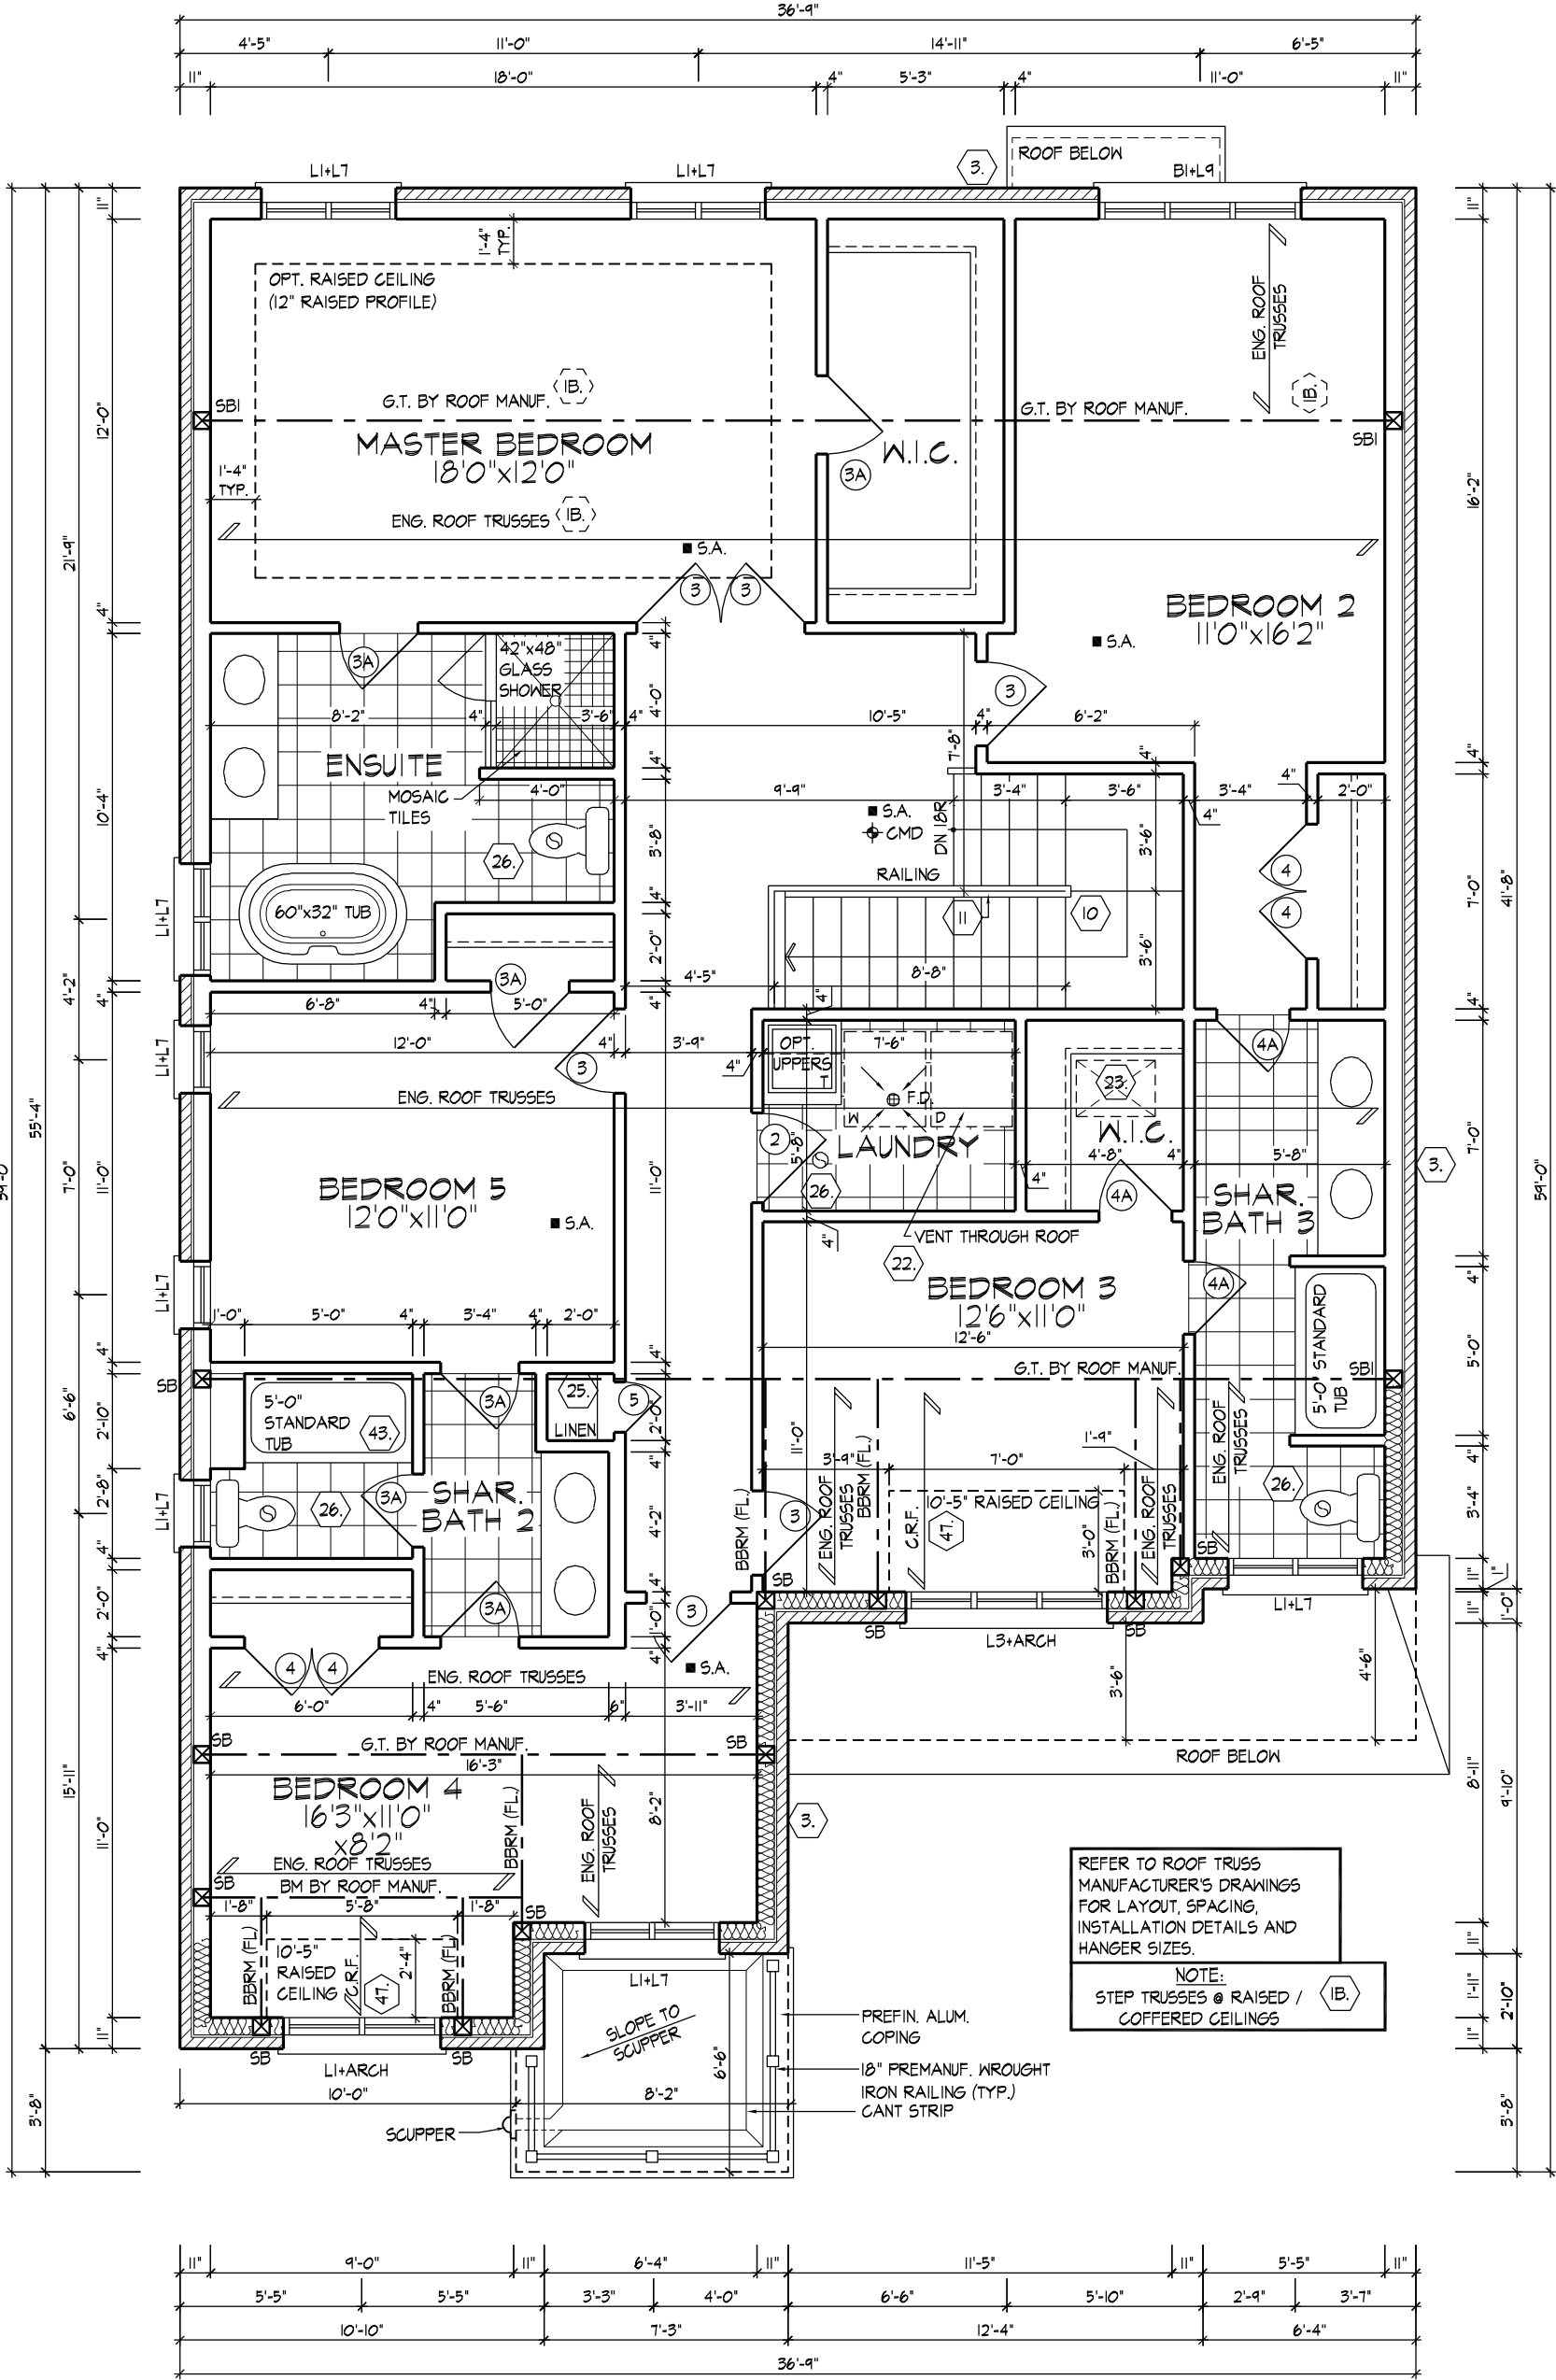

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG



THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102 UNIT 4504 "THE DUNCAN"
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV.2021.05.07
Drawn By SK/MM
Checked By VL
Scale 3/16"=1'-0"
File Number 216102WS4504.dwg
Page Number 14 of 39
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

OPT. SECOND FLOOR PLAN, ELEVATION 'B' (W/ 5 BEDROOM, 4 BATHROOM CONDITION LAYOUT)

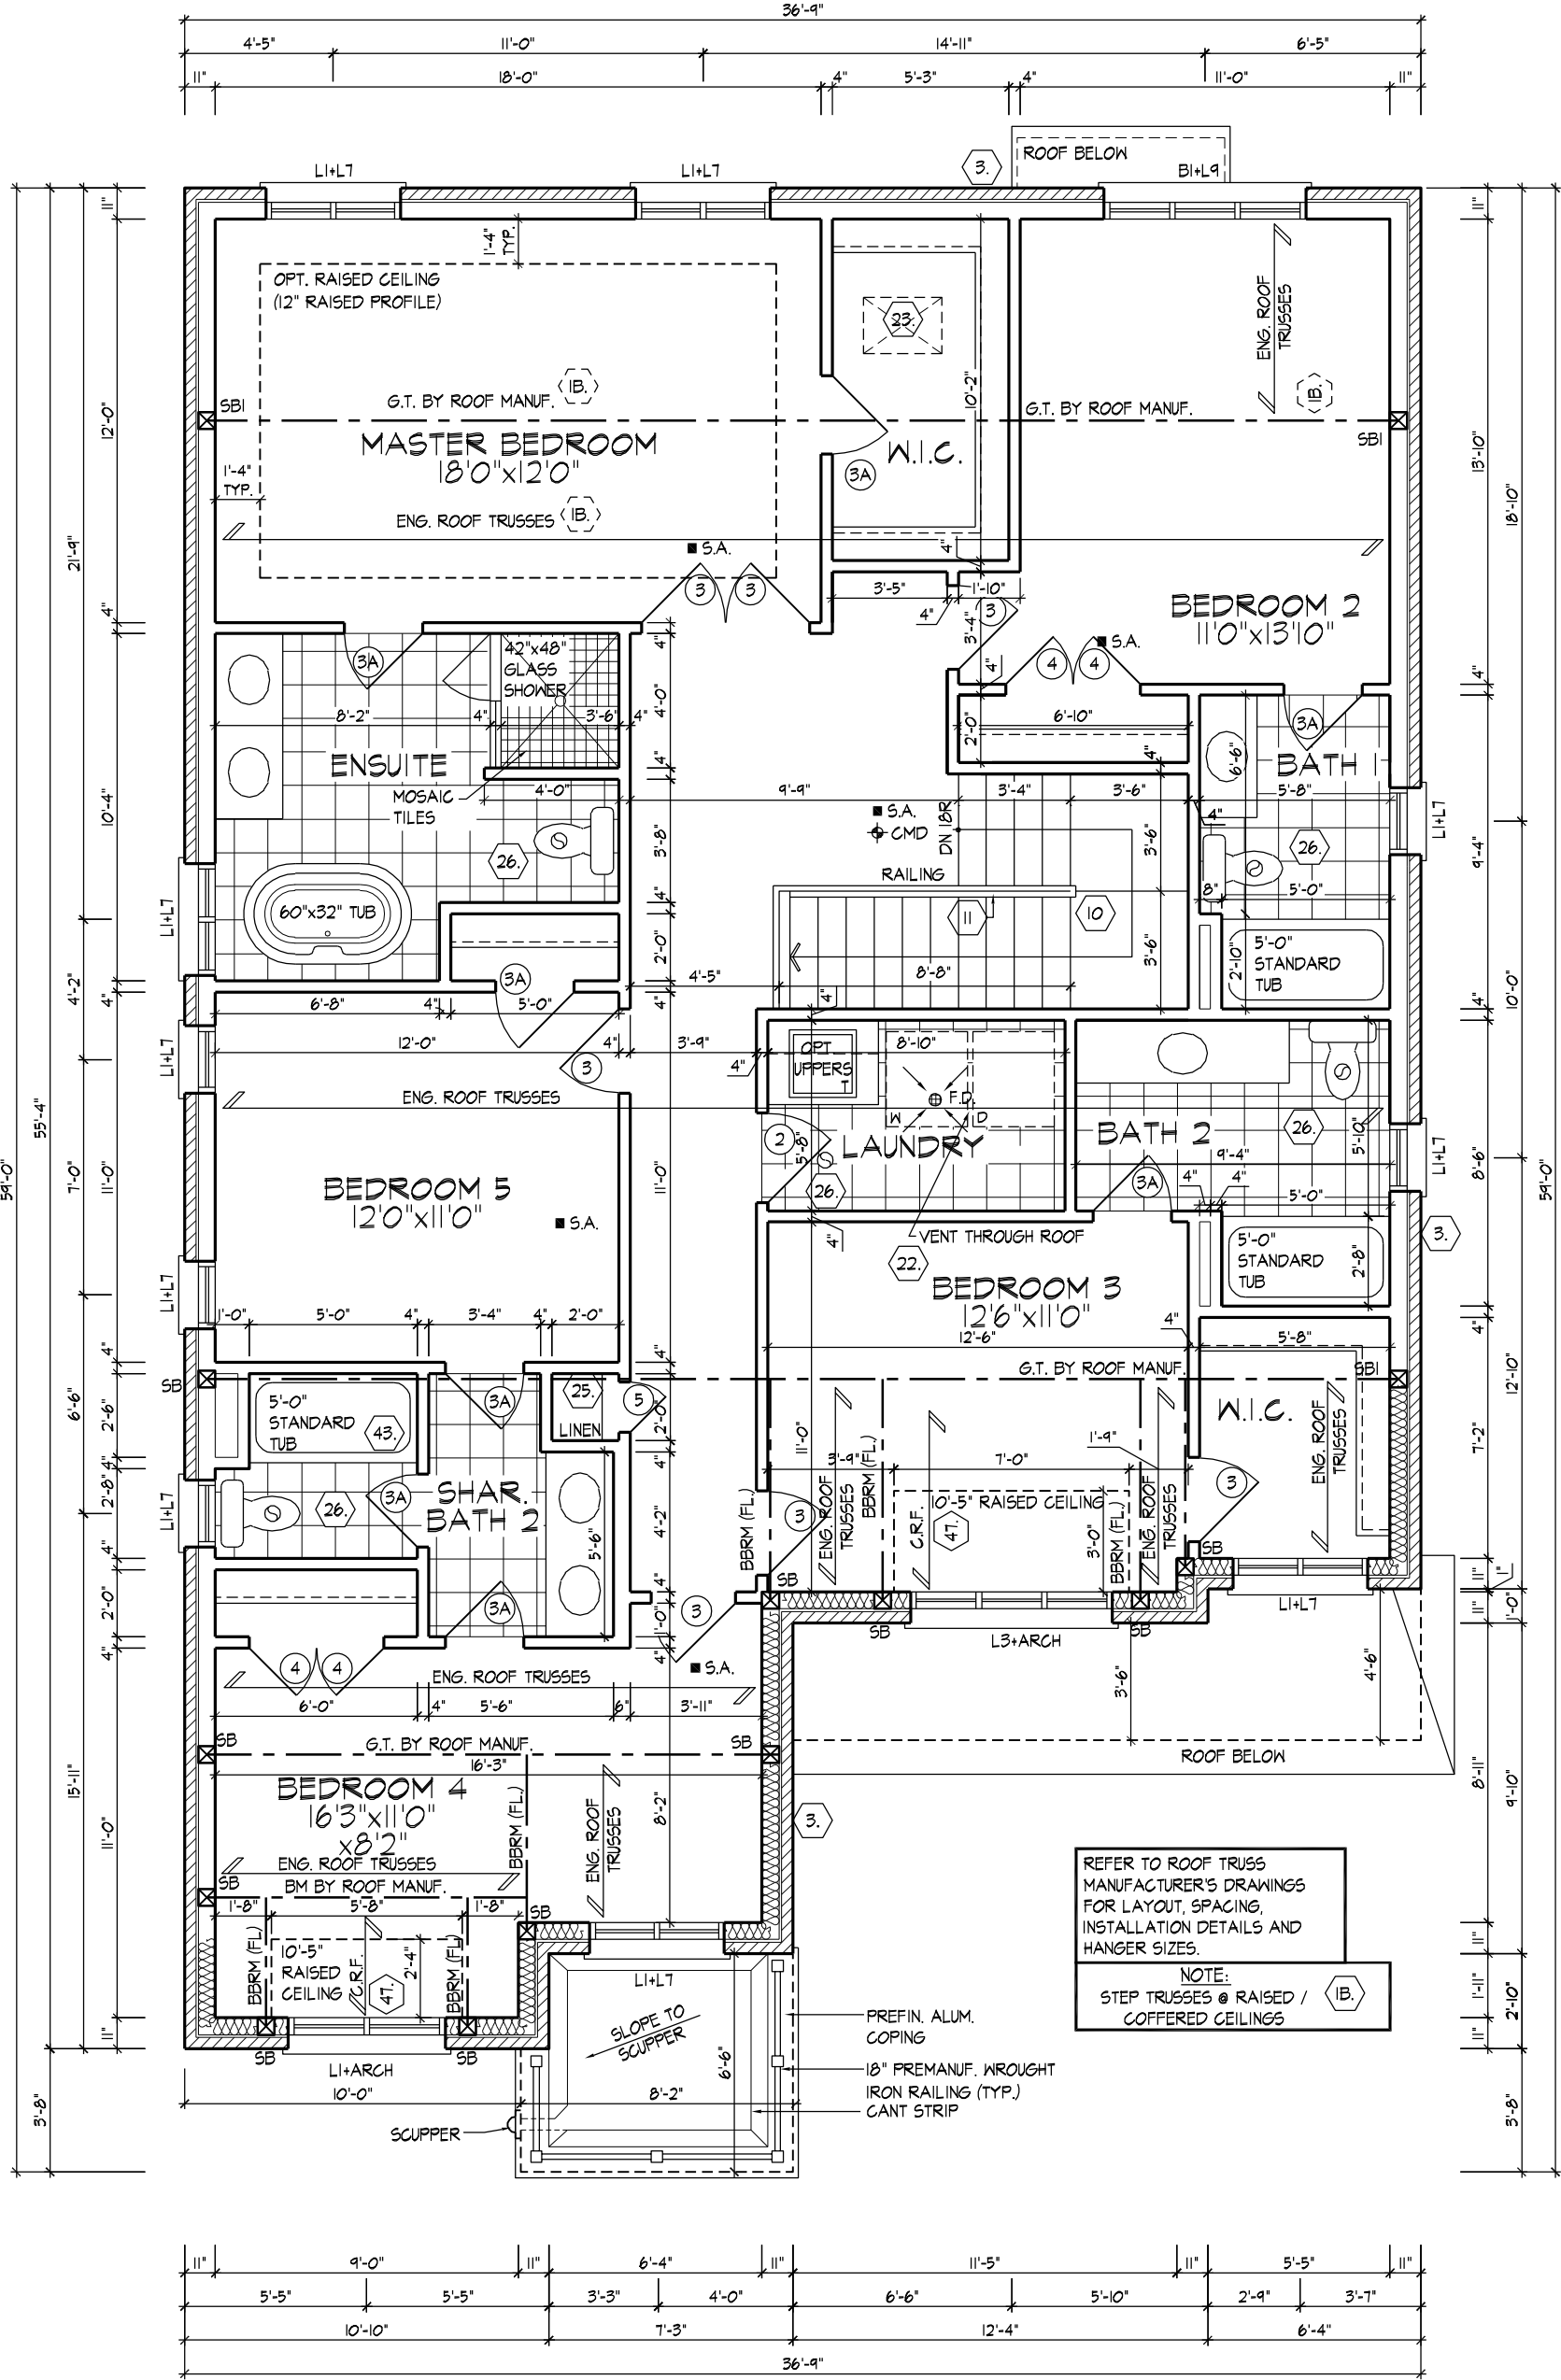

**FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM**

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.


37308
BCIN

21695

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102 UNIT 4504 "THE DUNCAN"
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV.2021.05.07
Drawn By SK/MM Checked By VL Scale 3/16"=1'-0" File Number 216102WS4504.dwg Page Number 17 of 39
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

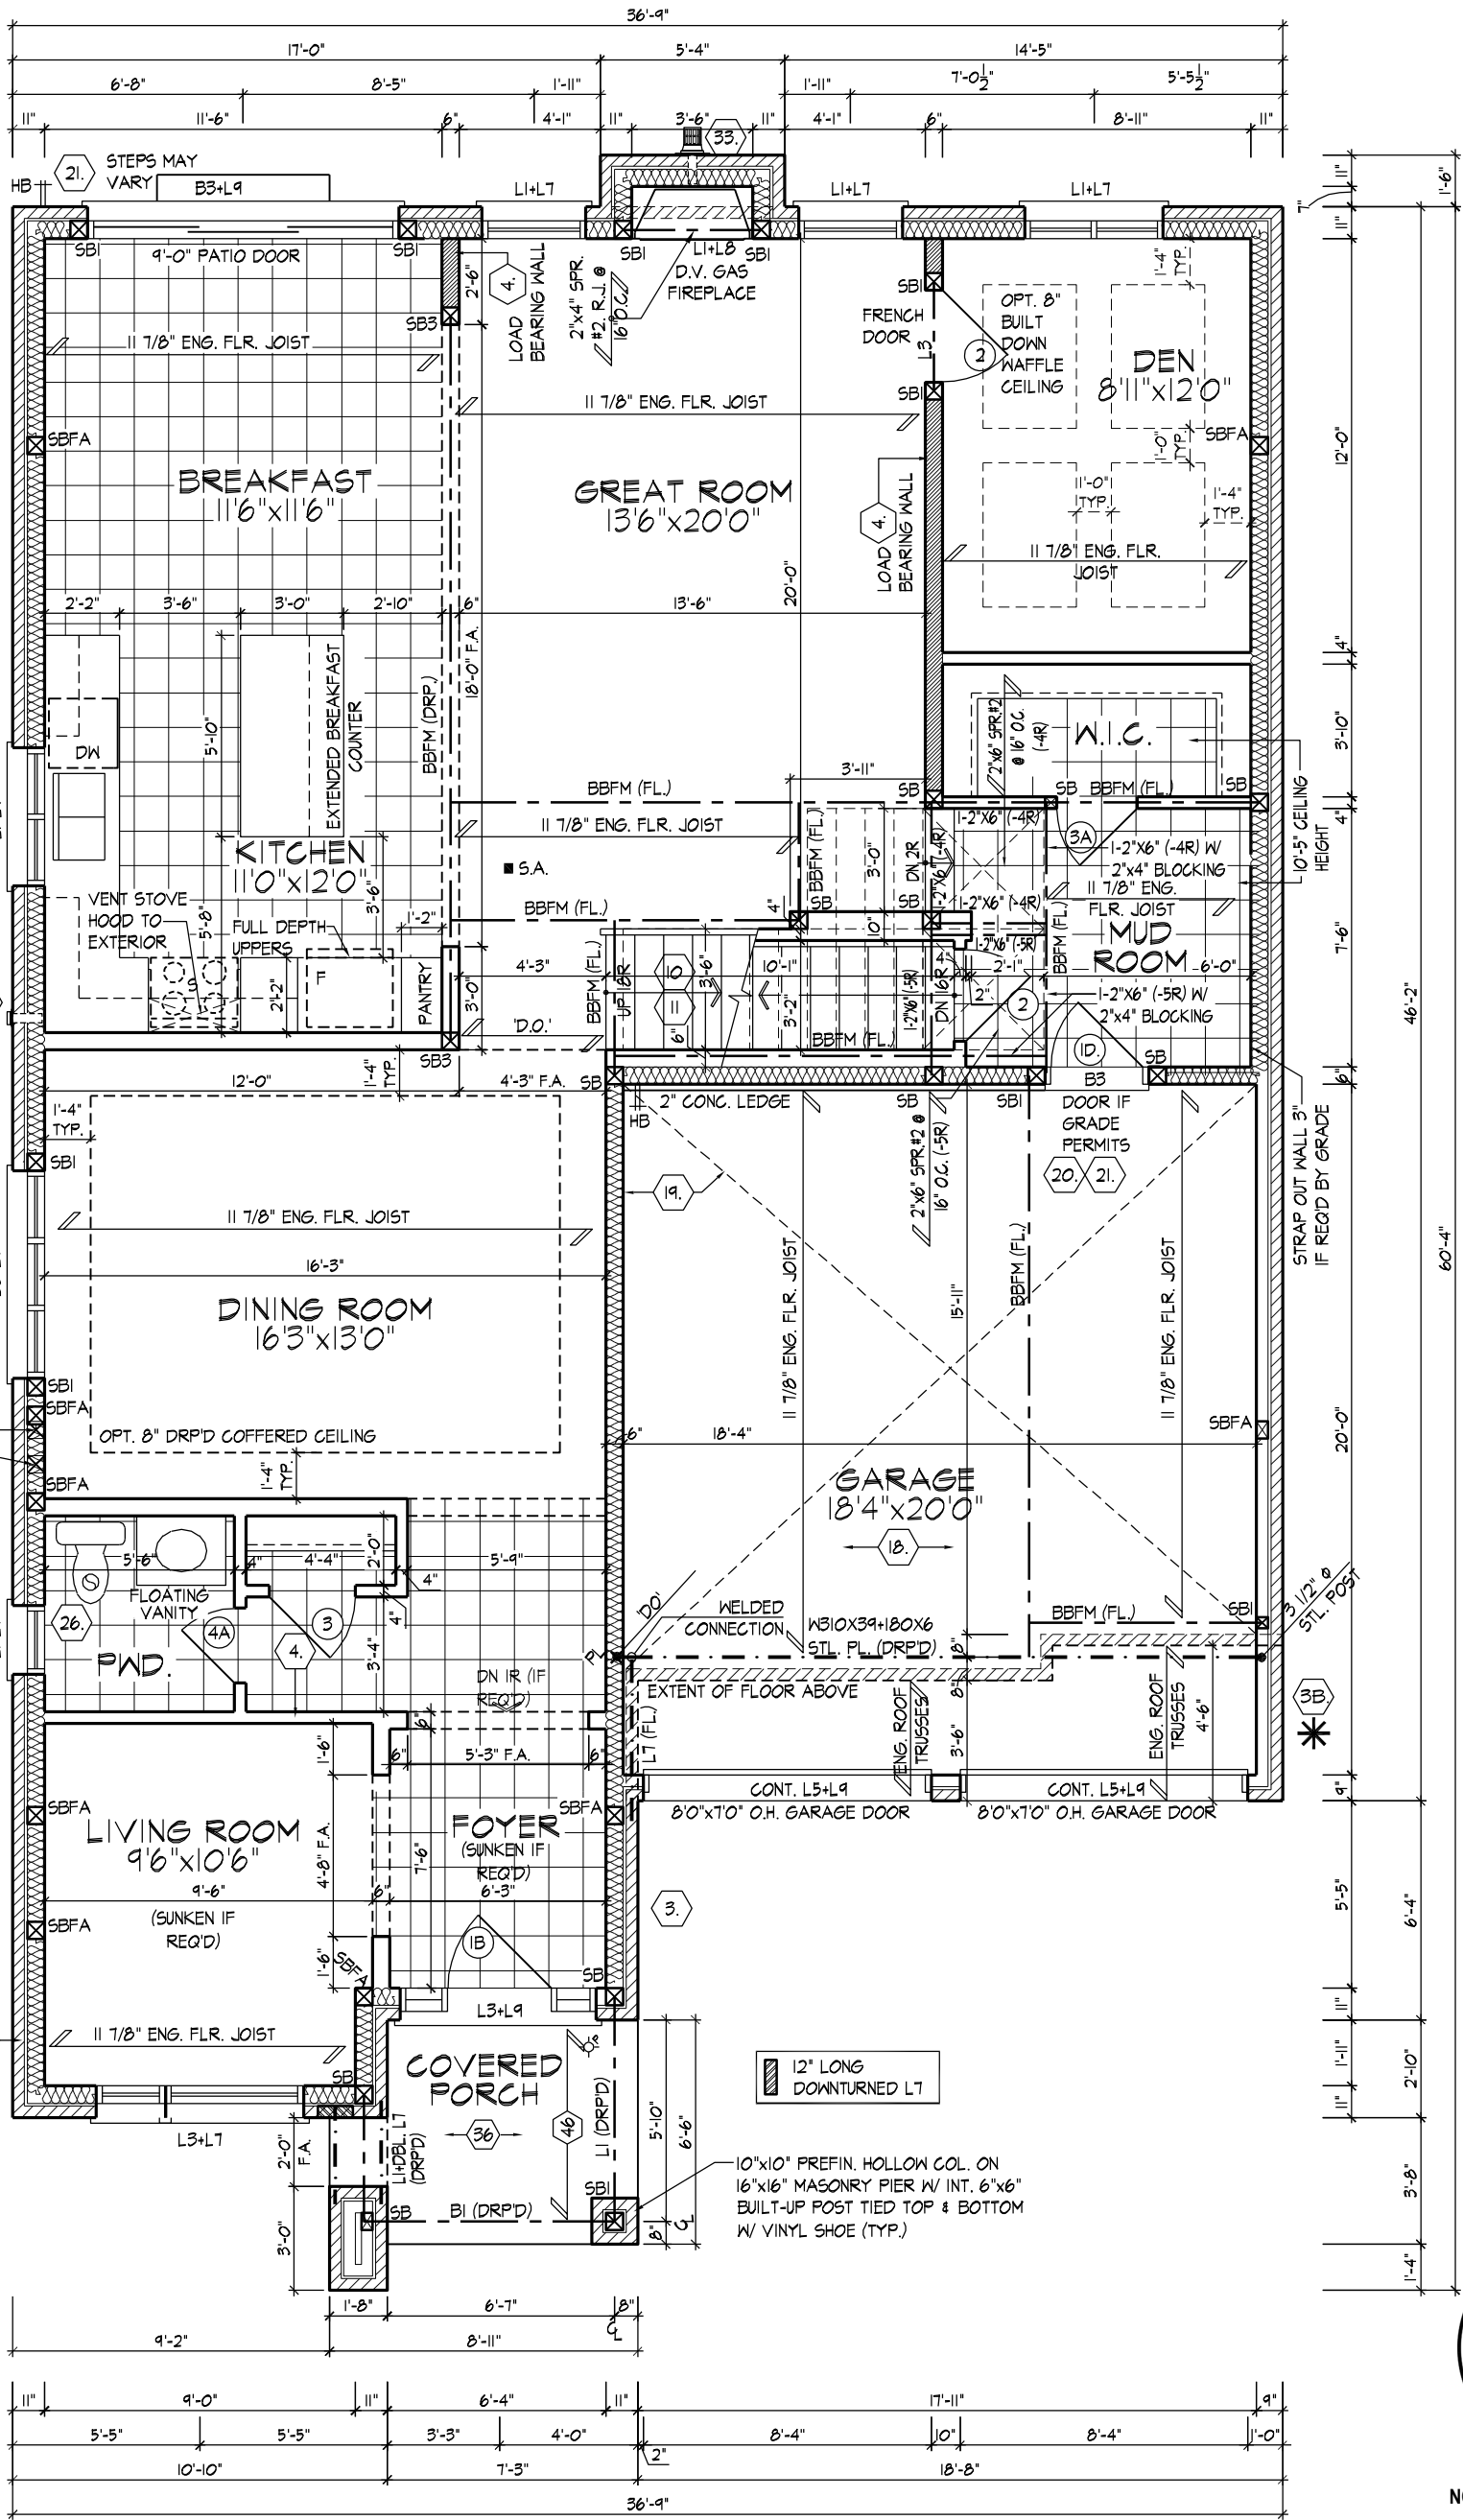

GROUND FLOOR PLAN EL. 'C'

REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BLOCKING & STRAPPING REQUIREMENTS, INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

* 2"x4" STUD WALL ASSEMBLY EXCEEDING MAX. UNSUPPORTED HEIGHT
FOR WALLS GREATER THAN 9'-10" TO MAX. 12'-0" HIGH,
- W/O FLOOR LOAD, DOUBLE UP EVERY STUD @ 16" O.C.
- W/ FLOOR LOAD DOUBLE UP EVERY STUD @ 12" O.C.
PROVIDE BLOCKING EVERY 4'-0" O.C. VERTICAL.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

GROUND FLOOR PLAN EL. 'C'

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.

37308
BCIN

19695

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca


ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON

UNIT 4504 "THE DUNCAN"
REV.2021.05.07

Drawn By
SK/MM
Checked By
VL
Scale
3/16"=1'-0"
File Number
216102WS4504.dwg
Page Number
18 of 39

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

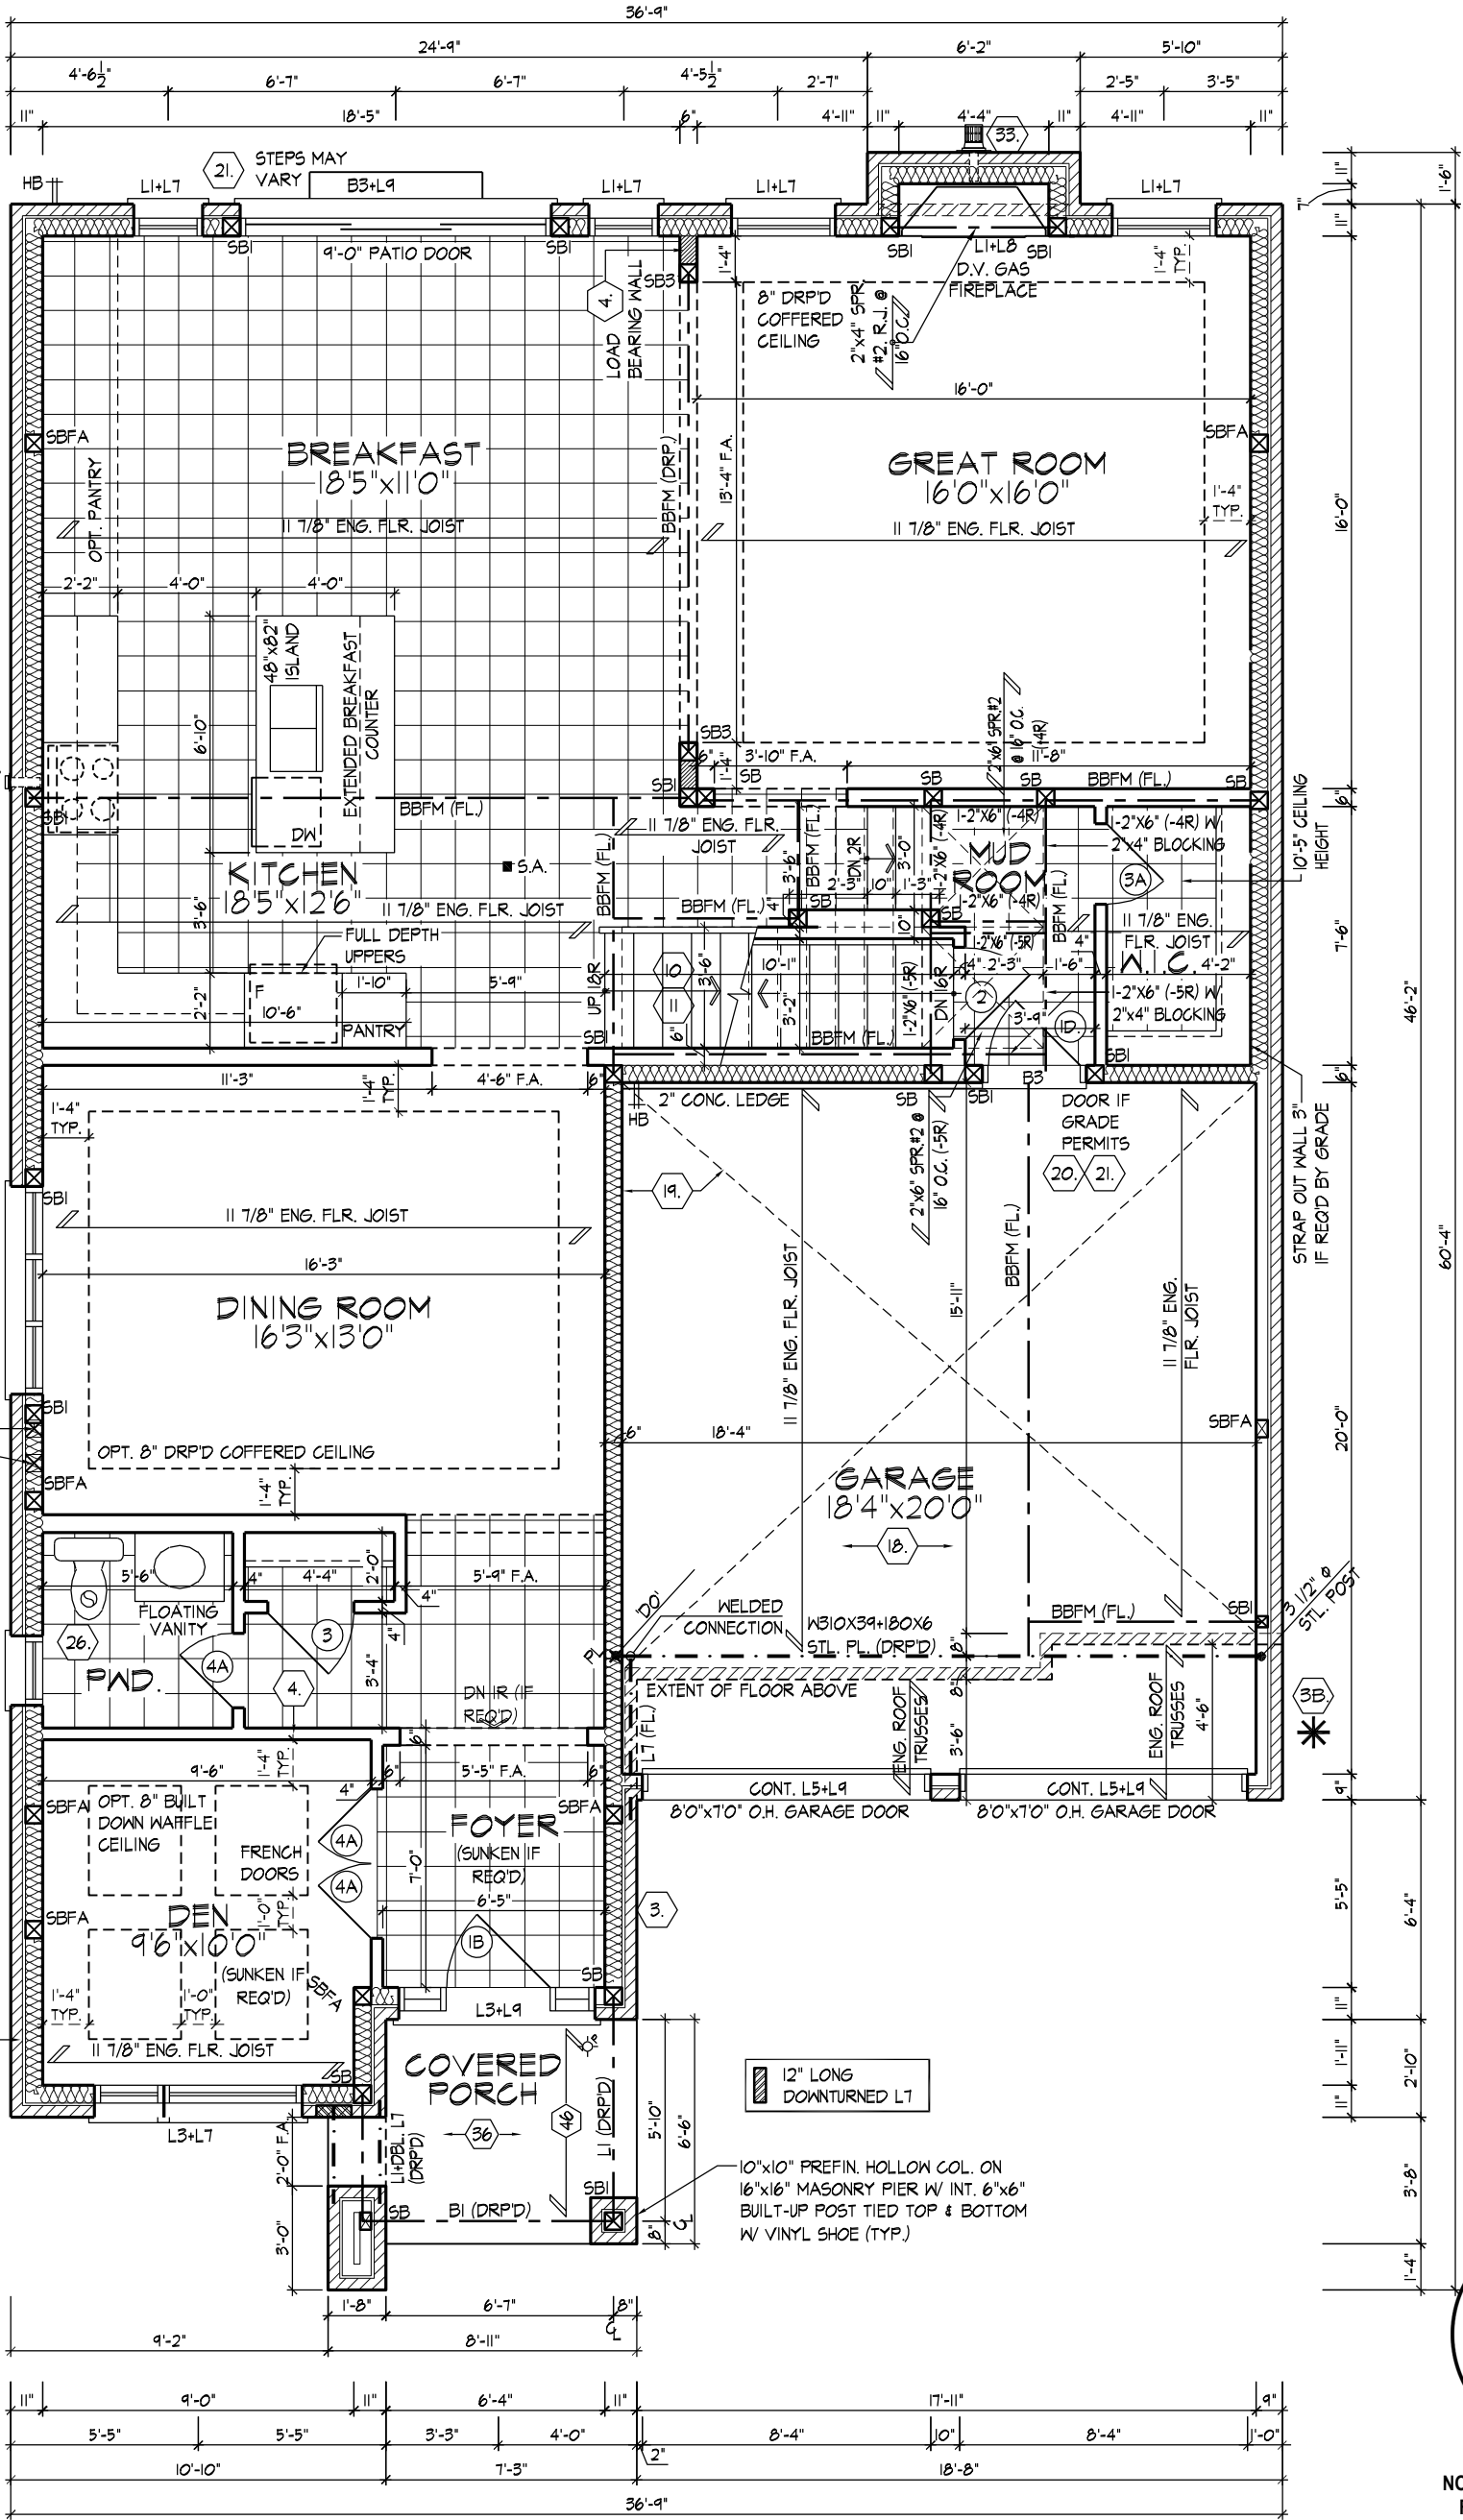

OPT. GROUND FLOOR PLAN 'C'

WOOD LINTEL NOTES:

ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"


* 2"x4" STUD WALL ASSEMBLY EXCEEDING MAX. UNSUPPORTED HEIGHT

FOR WALLS GREATER THAN 9'-10" TO MAX. 12'-0" HIGH, - W/O FLOOR LOAD, DOUBLE UP EVERY STUD @ 16" O.C.
- W/ FLOOR LOAD DOUBLE UP EVERY STUD @ 12" O.C.
PROVIDE BLOCKING EVERY 4'-0" O.C. VERTICAL.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

OPT. GROUND FLOOR PLAN 'C'

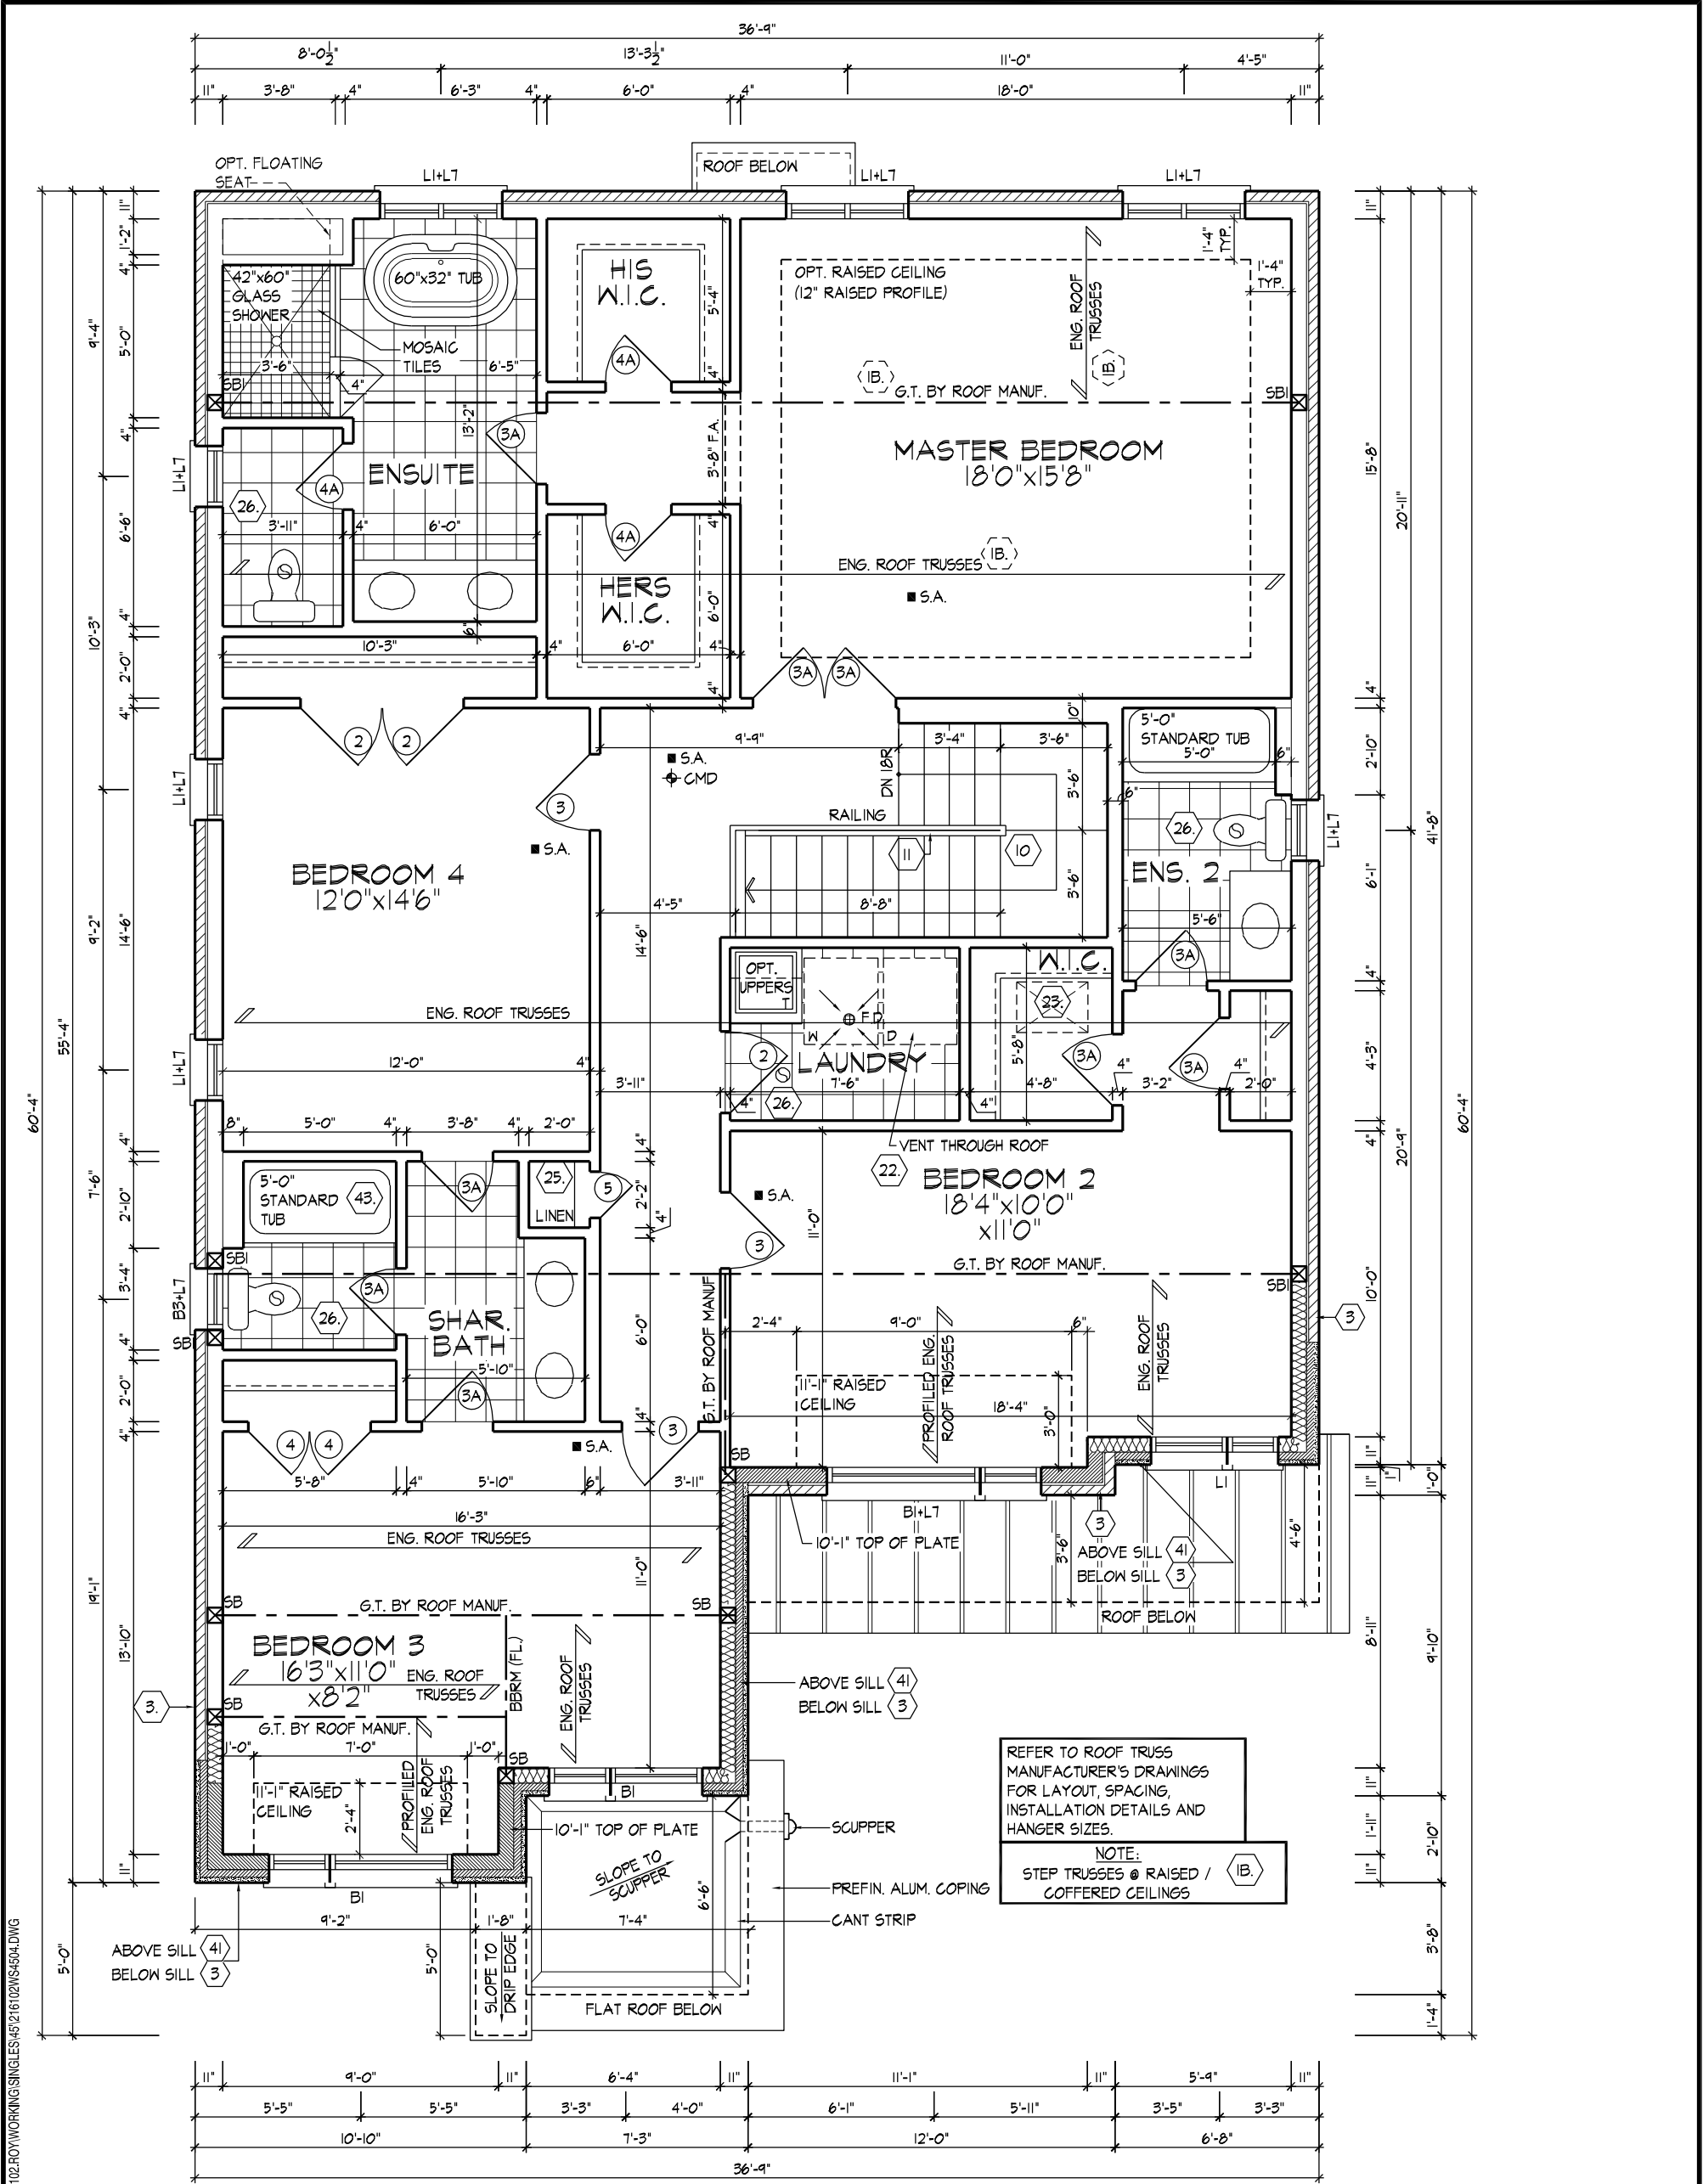

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102.ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.
37308
BCIN
19695


SIGNATURE

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
Unit 4504 "THE DUNCAN"
REV.2021.05.07
216102WS4504.dwg
20 of 39

OPT. SECOND FLOOR PLAN 'C' 5 BEDROOM CONDITION

WOOD LINTEL NOTES:


ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

OPT. 5 BEDROOM SECOND FLOOR PLAN EL. 'C'

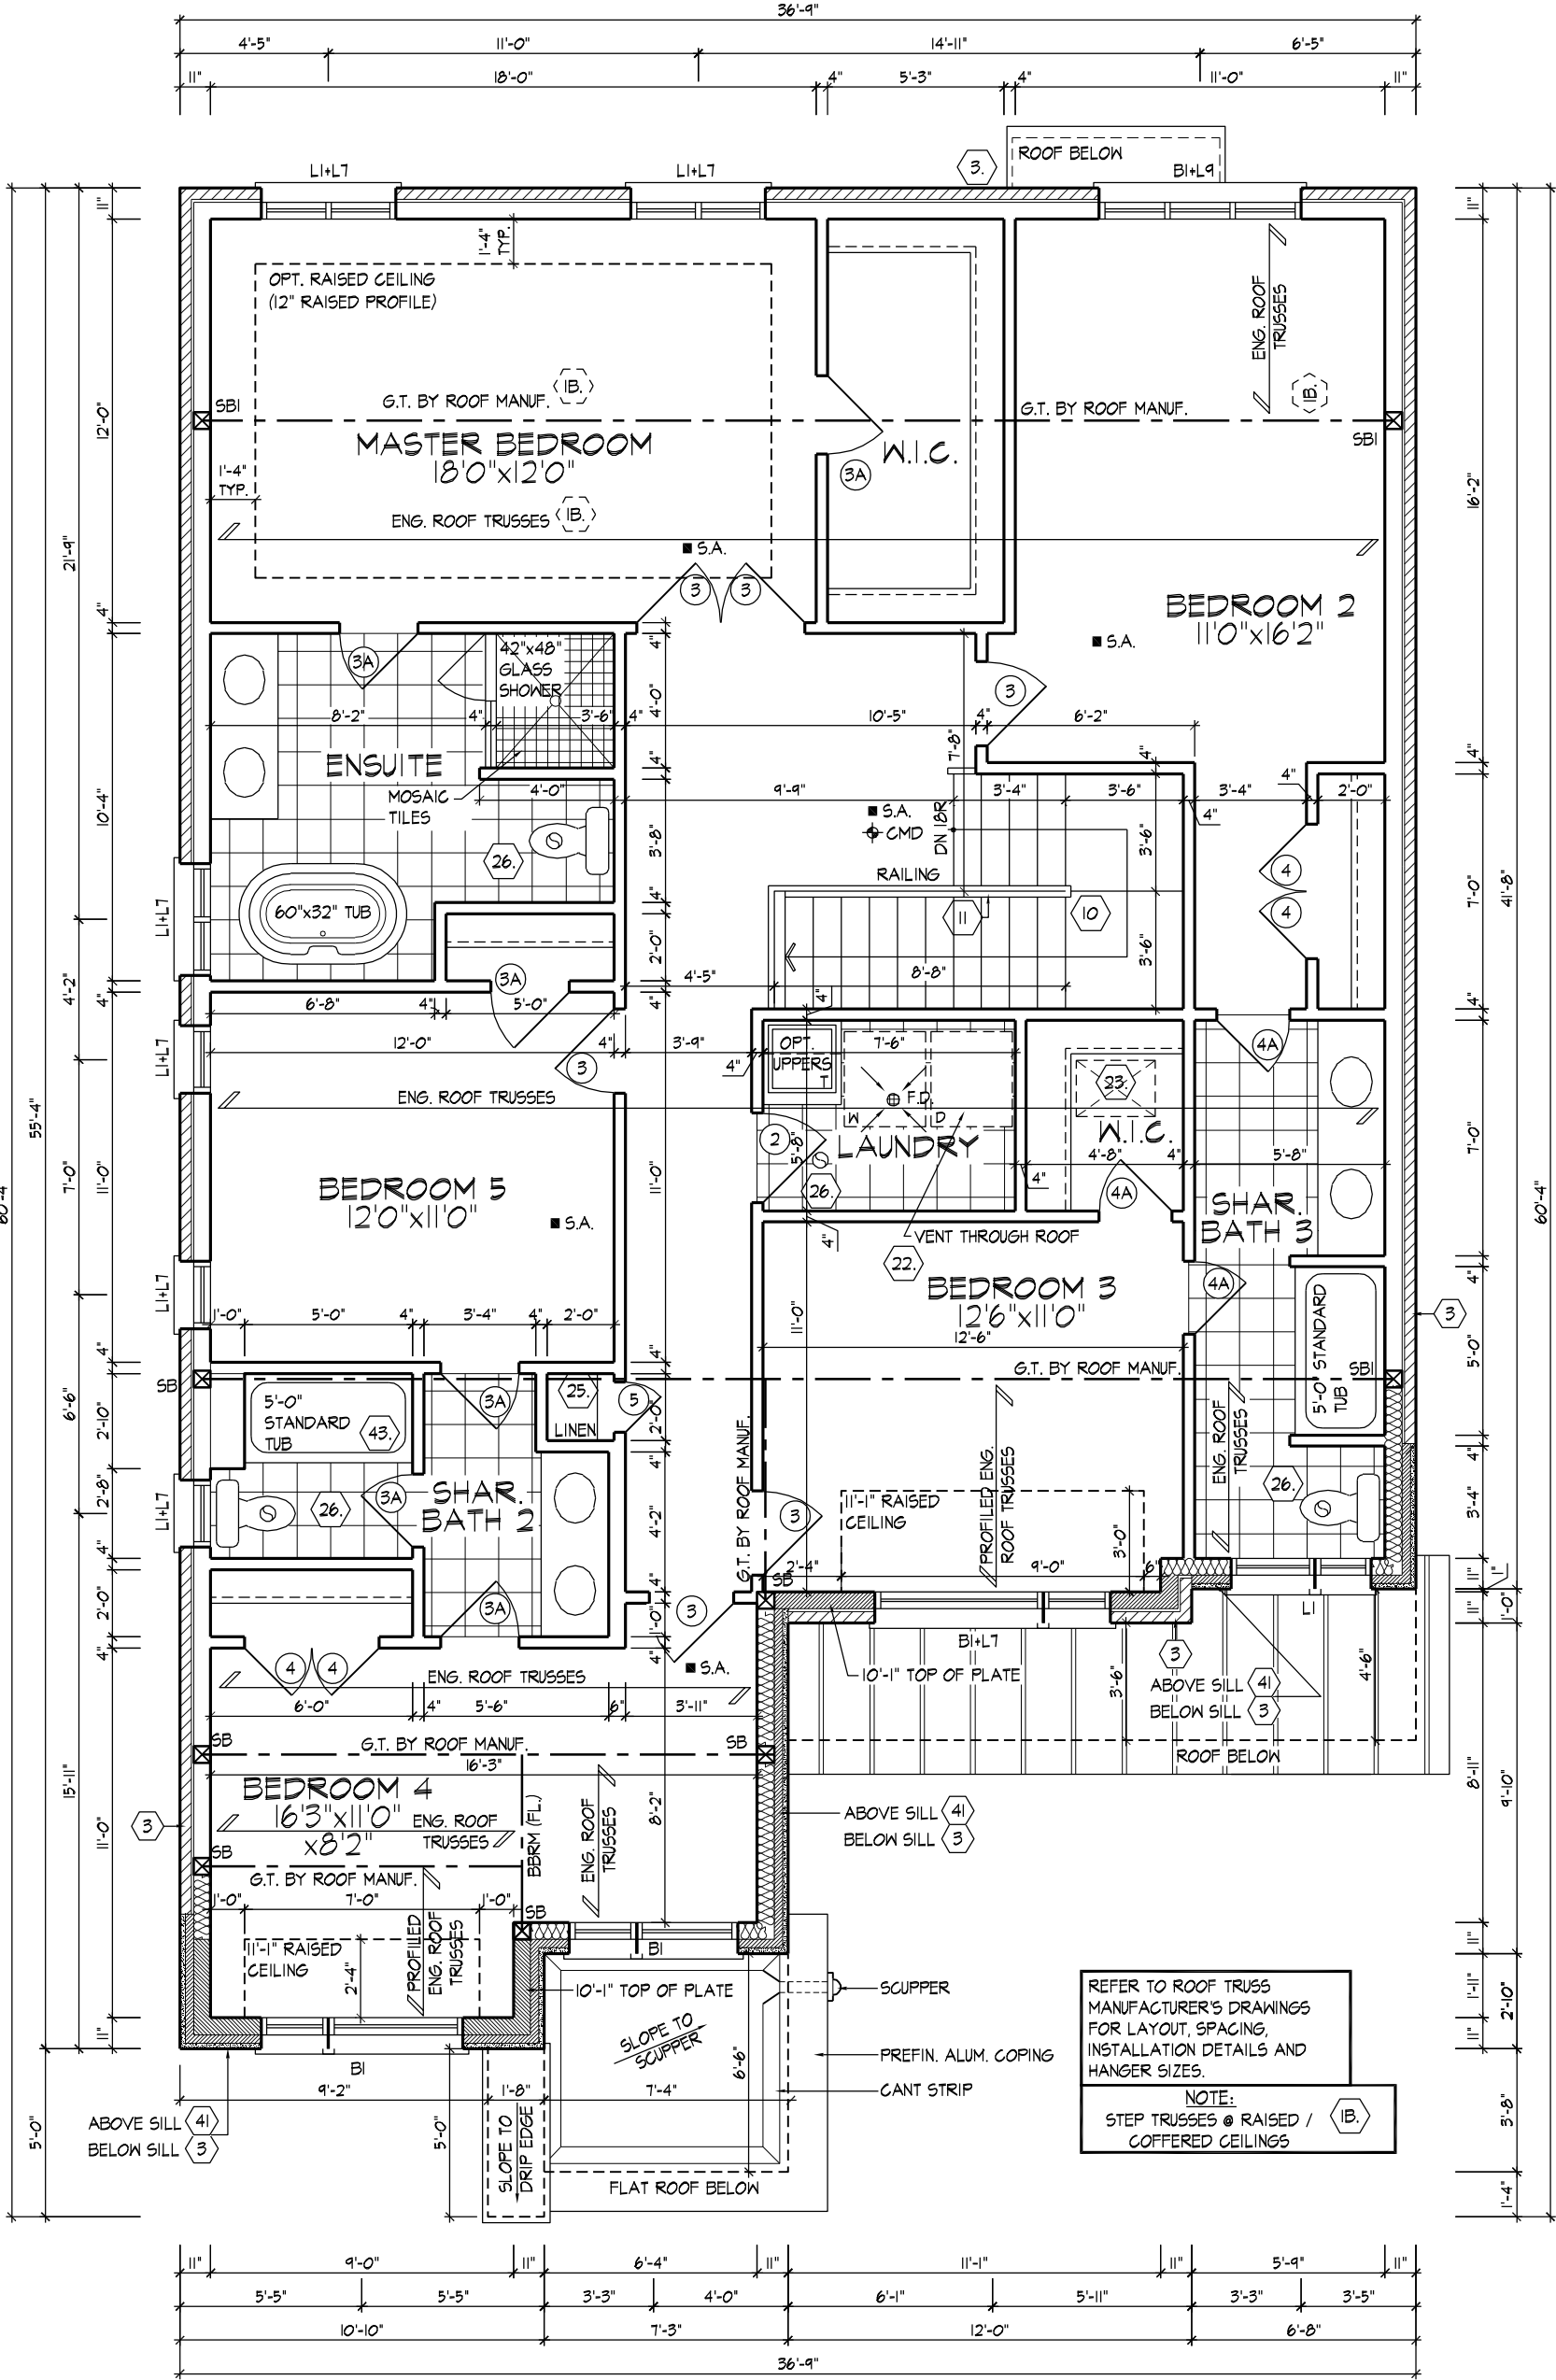

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.




37308
BCIN

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
UNIT 4504 "THE DUNCAN"
REV.2021.05.07
216102WS4504.dwg
21 of 39

OPT. SECOND FLOOR PLAN, ELEVATION 'C' (W/ 5 BEDROOM, 4 BATHROOM CONDITION LAYOUT)

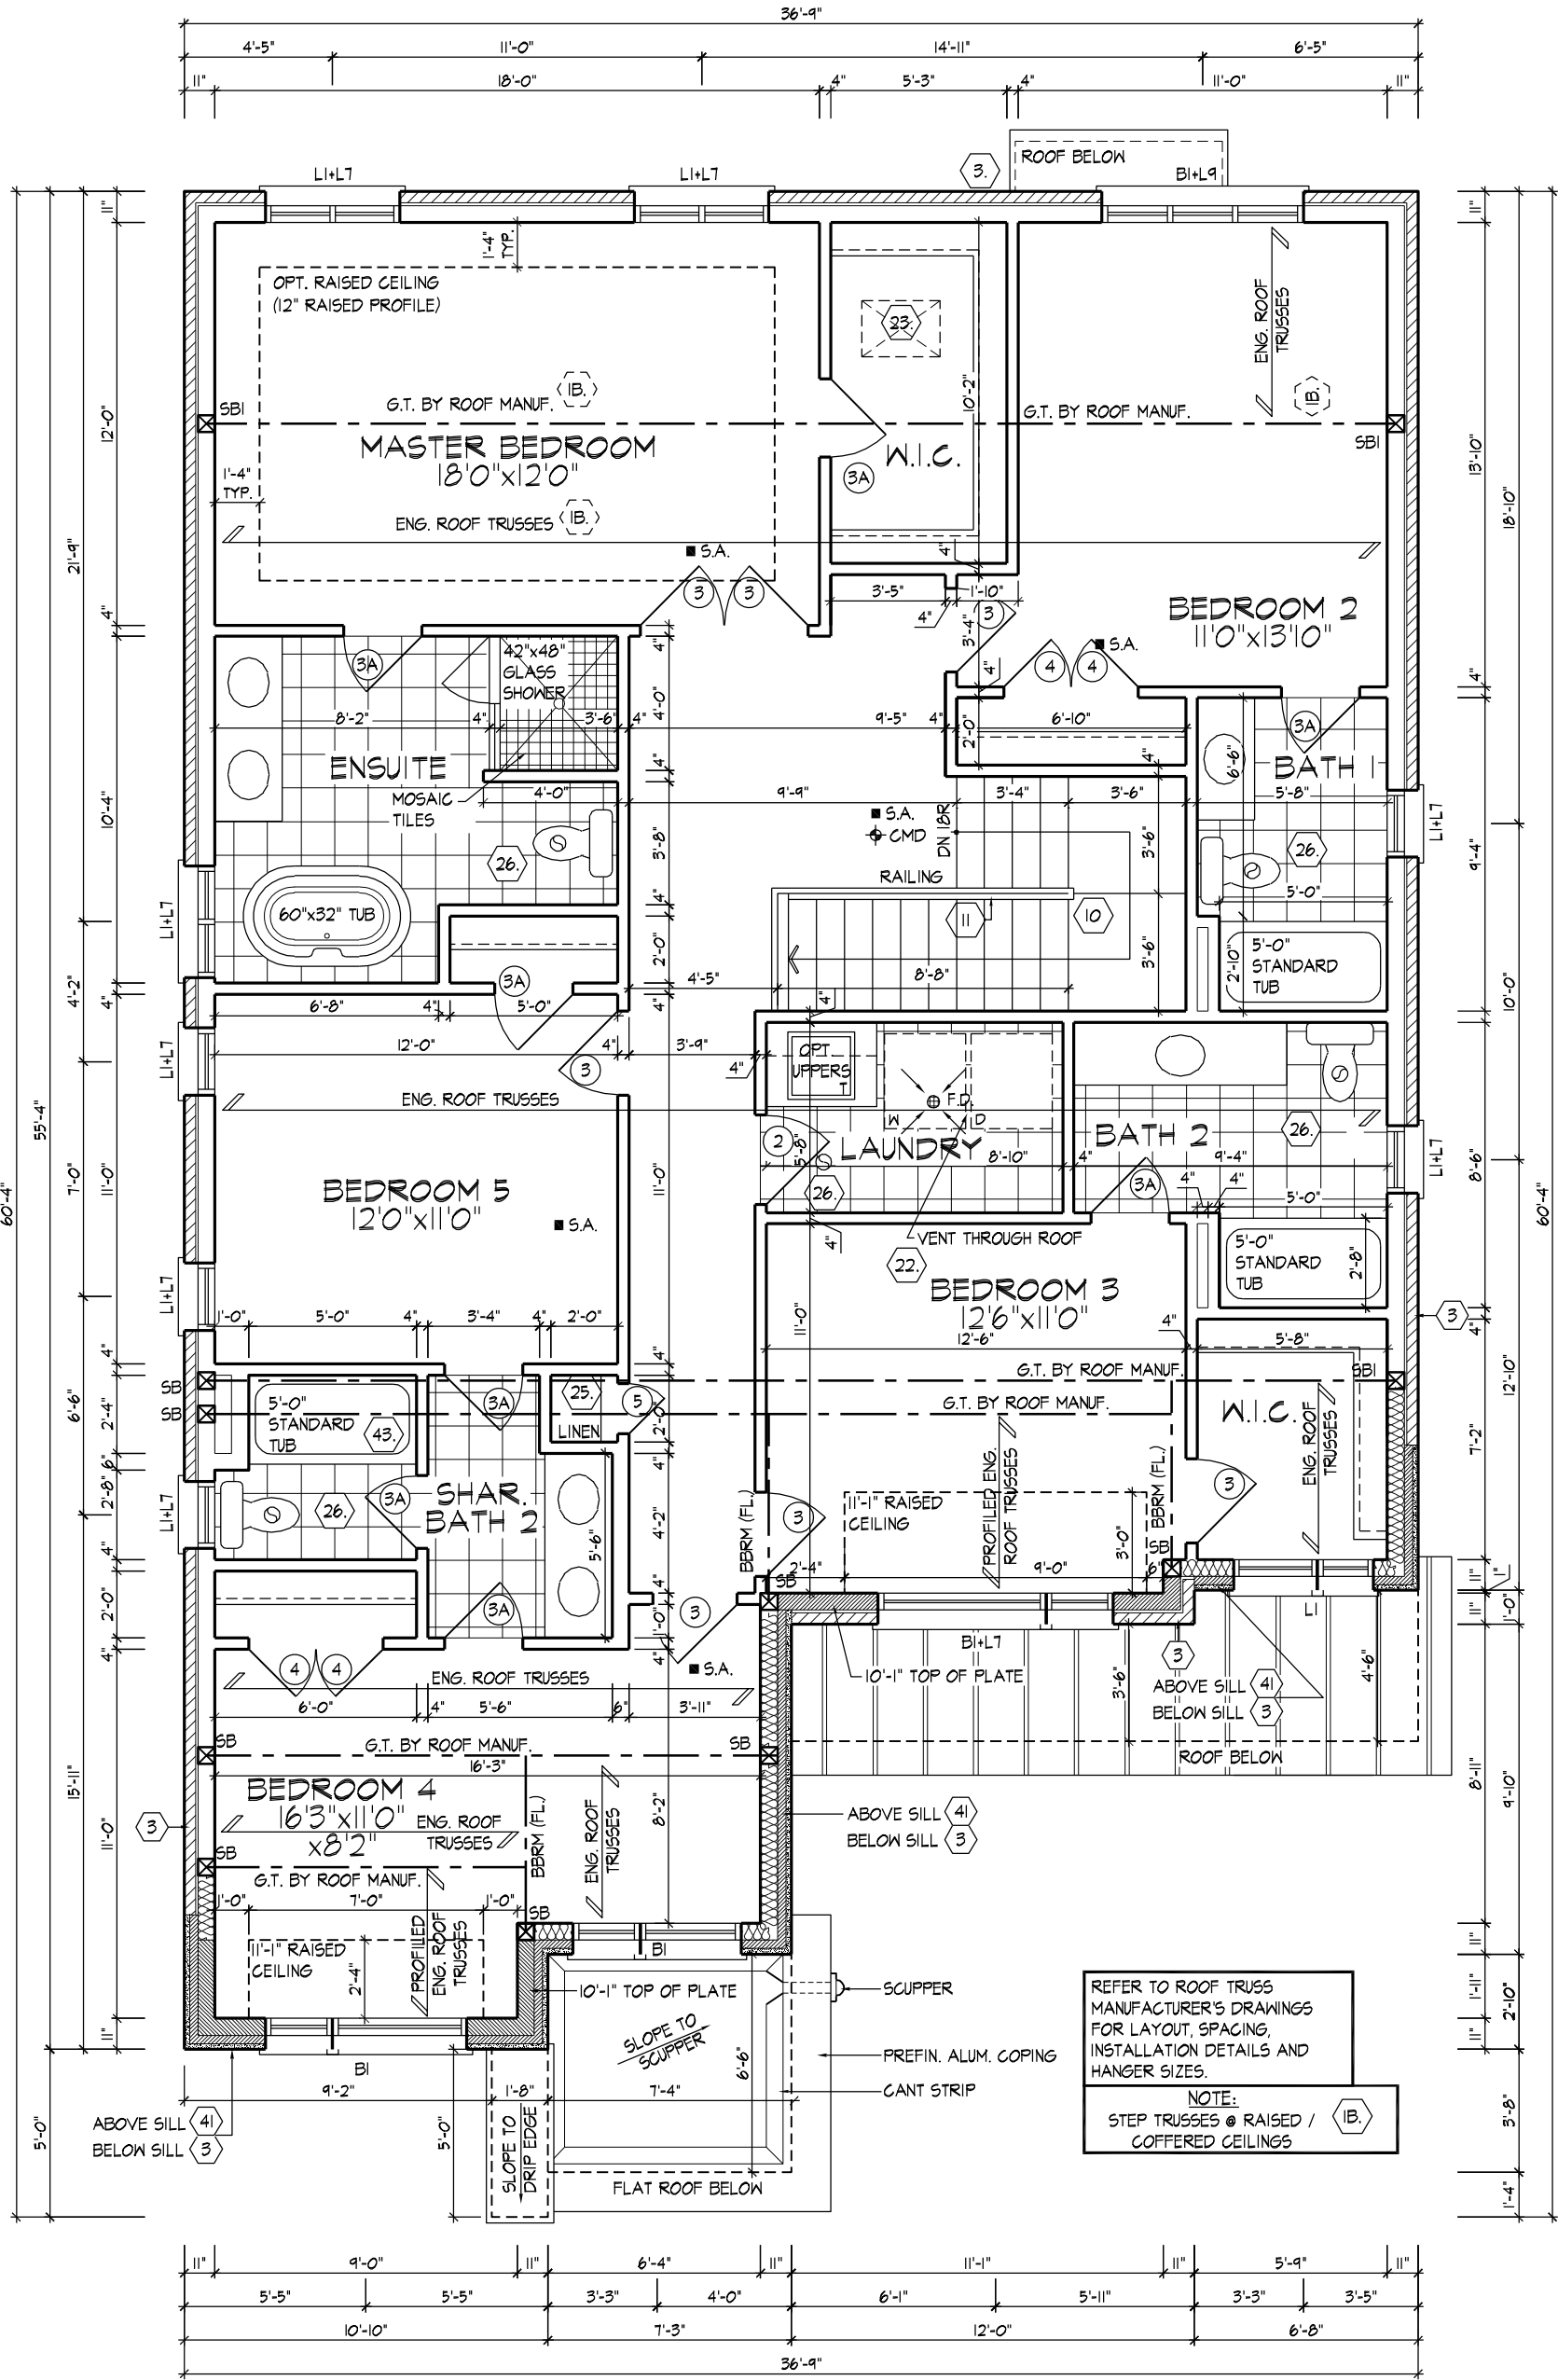

ALL POSTS NOTED AS "SB" SHALL BE MIN. 2/2"x4" OR 2/2"x6", UNLESS OTHERWISE NOTED AS FOLLOWS:
SBI - MIN. 3/2"x4" OR 3/2"x6"
SB2 - MIN. 4/2"x4" OR 4/2"x6"
SB3 - MIN. 5/2"x4" OR 5/2"x6"

WOOD LINTEL NOTES:
ALL OPENINGS IN LOAD BEARING WALLS GREATER THAN THE STUD SPACING SHALL HAVE A SINGLE JACK AND KING POST ON EACH SIDE. OPENINGS LARGER THAN 5'-6", SHALL HAVE A MINIMUM OF TWO JACK POSTS AND ONE KING POST ON EACH SIDE, UNLESS NOTED OTHERWISE.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

N.T.S.


ROOF OVERHANGS ARE TO
BE 12" UNLESS NOTED
OTHERWISE

W Architect Inc.
DESIGN CONTROL REVIEW

MAY 31, 2021

FINAL

FINAL BY: [Signature]
This stamp is only for the purposes of design control and carries no other professional obligation



**FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM**

FRONT ELEVATION 'A'

UNIT 4504 "THE DUNCAN"
HILL, ON REV.2021.05.07

File Number	Page Number
-------------	-------------

WS4504.dwg 22 of 39

19895 HUNT DESIGN ASSOCIATES INC. www.huntdesign.ca 8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326



HUNT
DESIGN ASSOCIATES INC.

HUNT DESIGN ASSOCIATES INC. 19695

All drawings specifications related documents and design are the copyright


W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021

FINAL BY: *Alb*
This stamp is only for the purposes of design control and carries no other professional obligations.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE ELEVATION A				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	68"		30.22
3	24"	52"		20.00
2	24"	48"		12.22
1	48"	52"		14.67
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
SPATIAL CALCULATION				
WALL AREA		1217.33	S.F.	
LIMITING DISTANCE		1.2 m		
MAX. % OPENINGS		7	%	
OPENINGS ALLOWED		85.21	S.F.	
OPENINGS PROVIDED		81.44	S.F.	
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

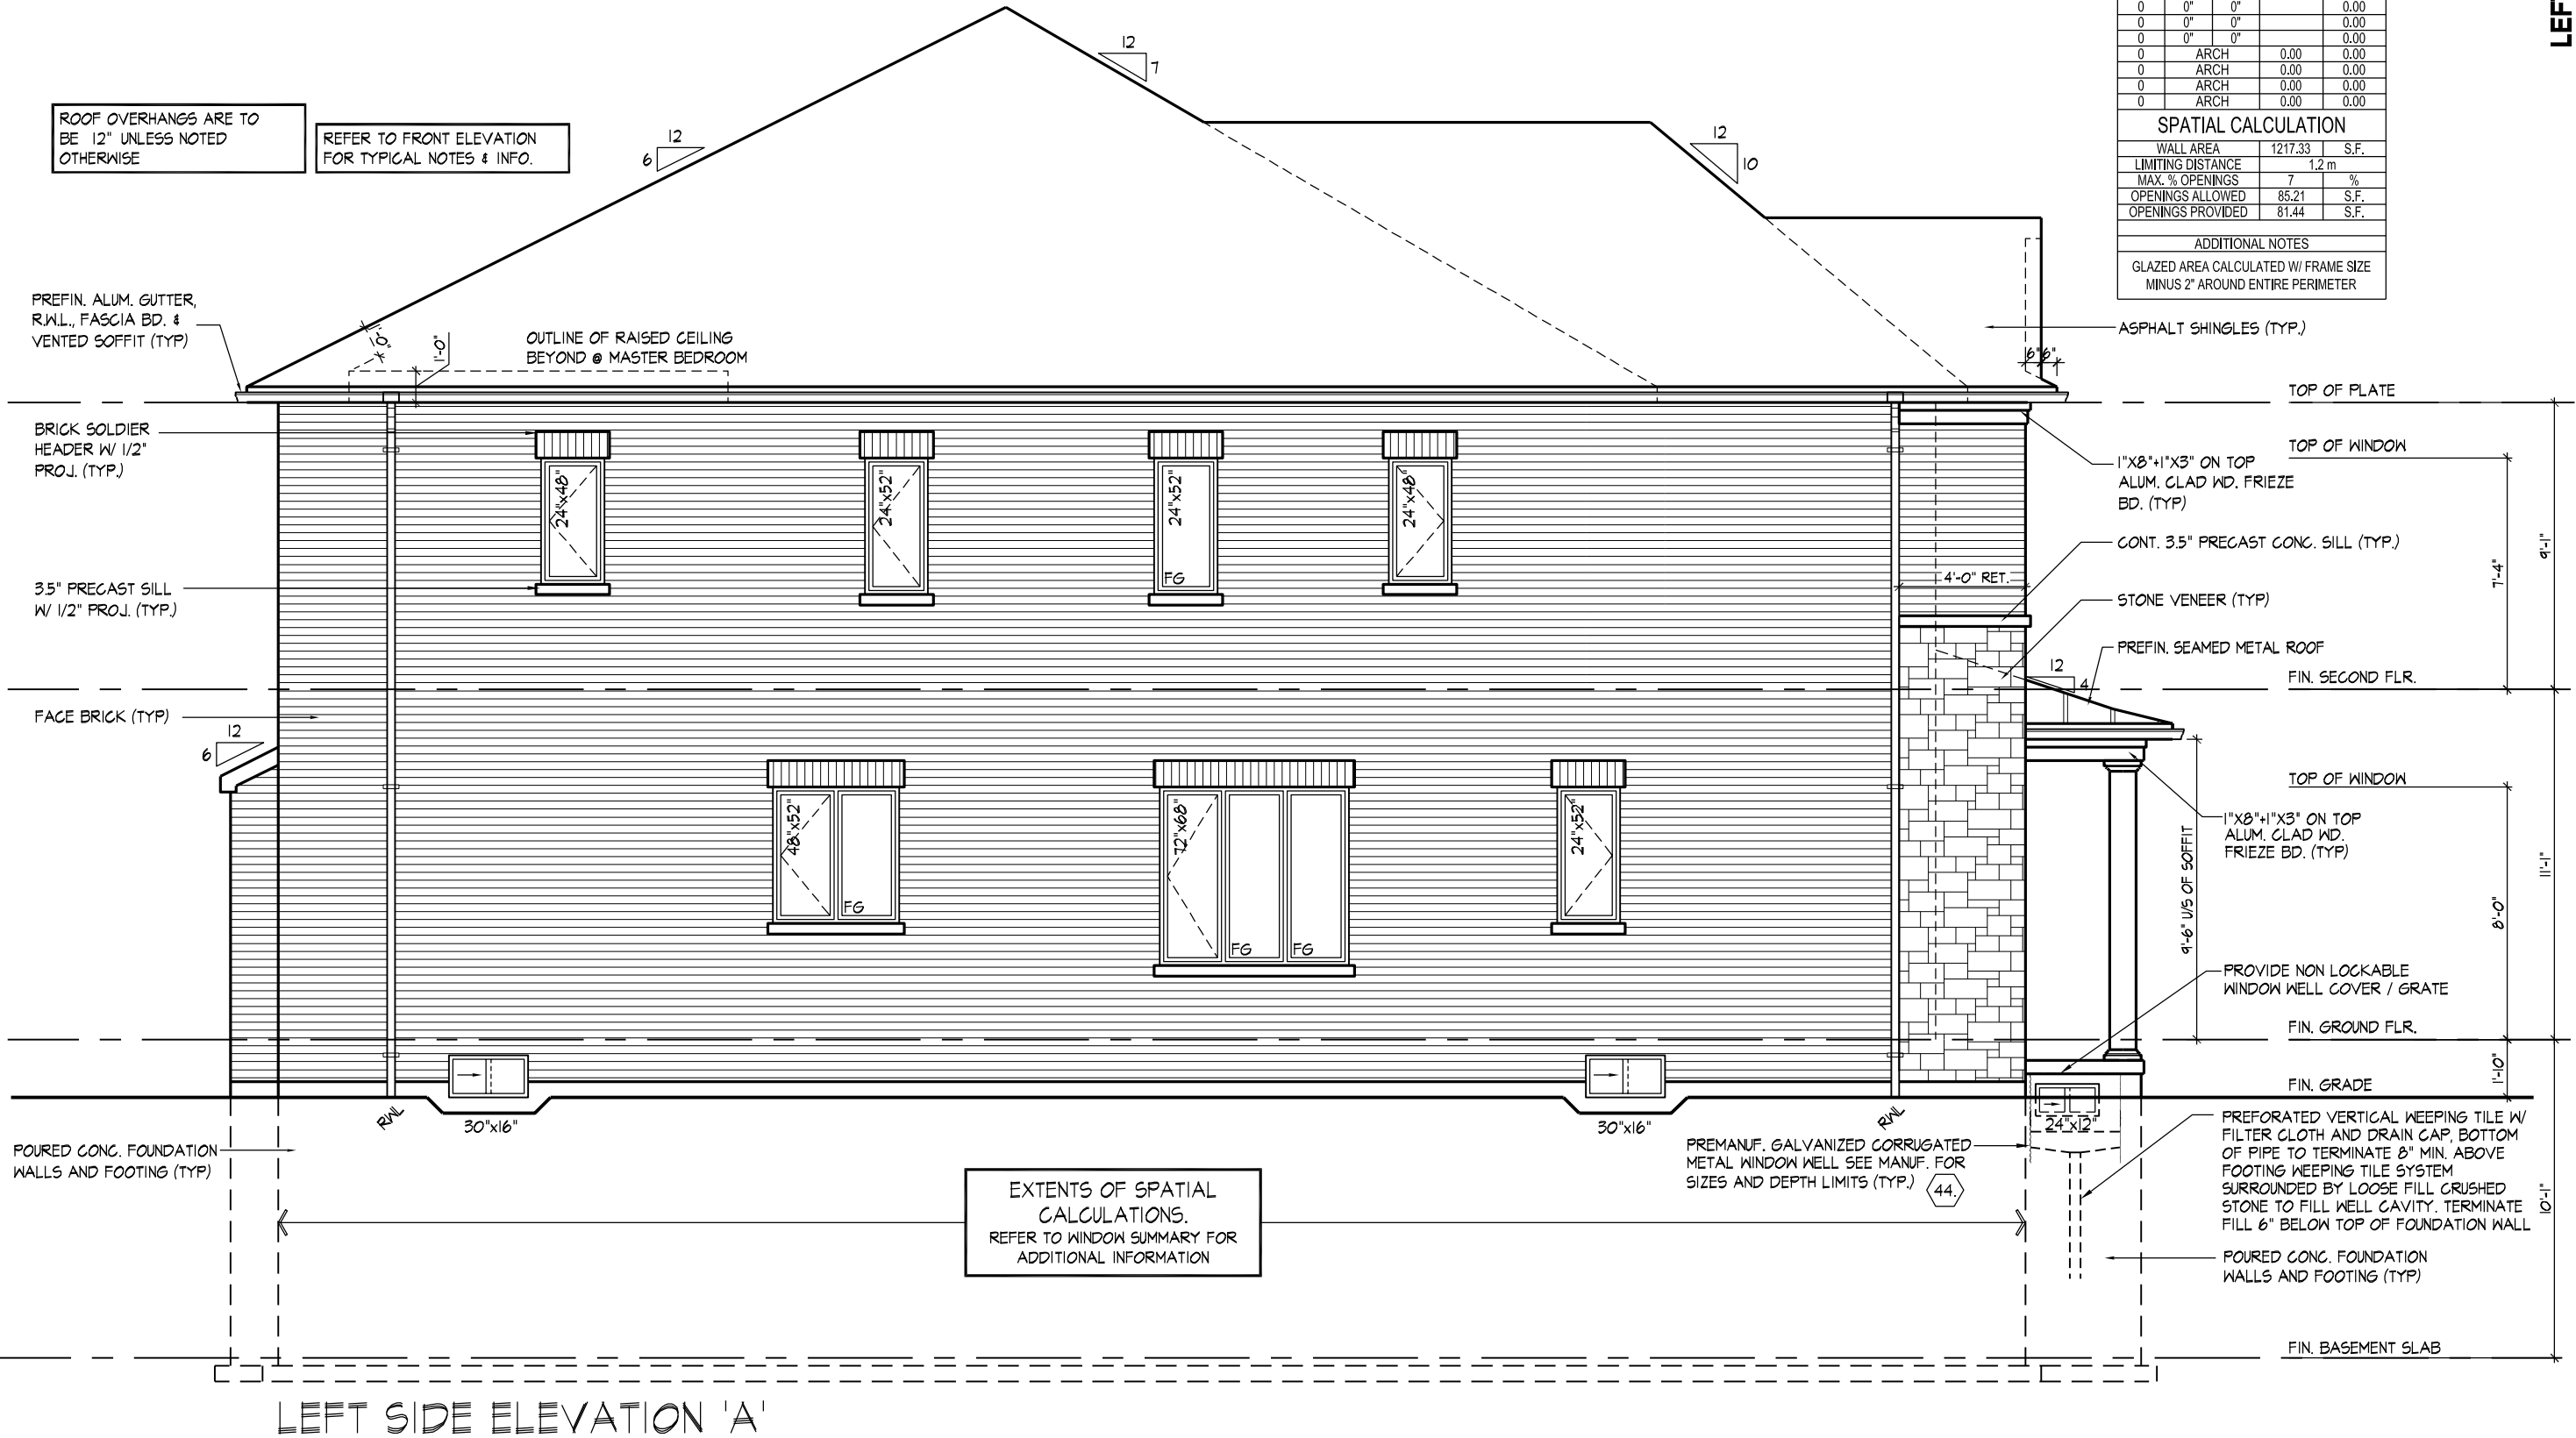

LEFT SIDE ELEVATION 'A'

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV.2021.05.07

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

Drawn By: SK/MM
Checked By: VL
Scale: 3/16" = 1'-0"
File Number: 216102WS4504.dwg
Page Number: 23 of 39

NAME: Derek R. Santos
REGISTRATION INFORMATION: 37308 BCN
HUNT DESIGN ASSOCIATES INC.
19695

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

SIGNATURE

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCN number and original signature.).

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE EL. A W/ OPT. SEC.				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	56"		24.56
1	48"	56"		15.89
1	24"	52"		6.67
1	40"	52"		12.00
2	24"	52"		13.33
1	24"	48"		6.11
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
SPATIAL CALCULATION				
WALL AREA	1217.33	S.F.		
LIMITING DISTANCE	1.2 m			
MAX. % OPENINGS	7	%		
OPENINGS ALLOWED	85.21	S.F.		
OPENINGS PROVIDED	82.89	S.F.		
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

ROOF OVERHANGS ARE TO BE 12" UNLESS NOTED OTHERWISE

REFER TO FRONT ELEVATION FOR TYPICAL NOTES & INFO.


W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021
FINAL BY: *Alt*
This stamp is only for the purposes of design control and carries no other professional obligations.

LICENSED PROFESSIONAL ENGINEER
2021-05-14
D. FERRARI
100168929
PROV. IN CHARGE OF

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED FLOOR OR ROOF SYSTEM

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE EL. A W/ OPT. GRD				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	24	48"	12.22	
2	24"	52"	13.33	
1	72"	68"	30.22	
1	24"	52"	6.67	
2	30"	16"	4.33	
0	0"	0"	0.00	
0	0"	0"	0.00	
0	0"	0"	0.00	
0	0"	0"	0.00	
0	0"	0"	0.00	
0	0"	0"	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
SPATIAL CALCULATION				
WALL AREA	1217.33	S.F.		
LIMITING DISTANCE	1.2 m			
MAX. % OPENINGS	7	%		
OPENINGS ALLOWED	85.21	S.F.		
OPENINGS PROVIDED	66.78	S.F.		
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE EL. A OPT. SEC&GRD				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	56"		24.56
1	24"	52"		6.67
1	40"	52"		12.00
2	24"	52"		13.33
0	0"	0"		6.11
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
SPATIAL CALCULATION				
WALL AREA	1217.33	S.F.		
LIMITING DISTANCE	1.2 m			
MAX. % OPENINGS	7	%		
OPENINGS ALLOWED	85.21	S.F.		
OPENINGS PROVIDED	67.00	S.F.		
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

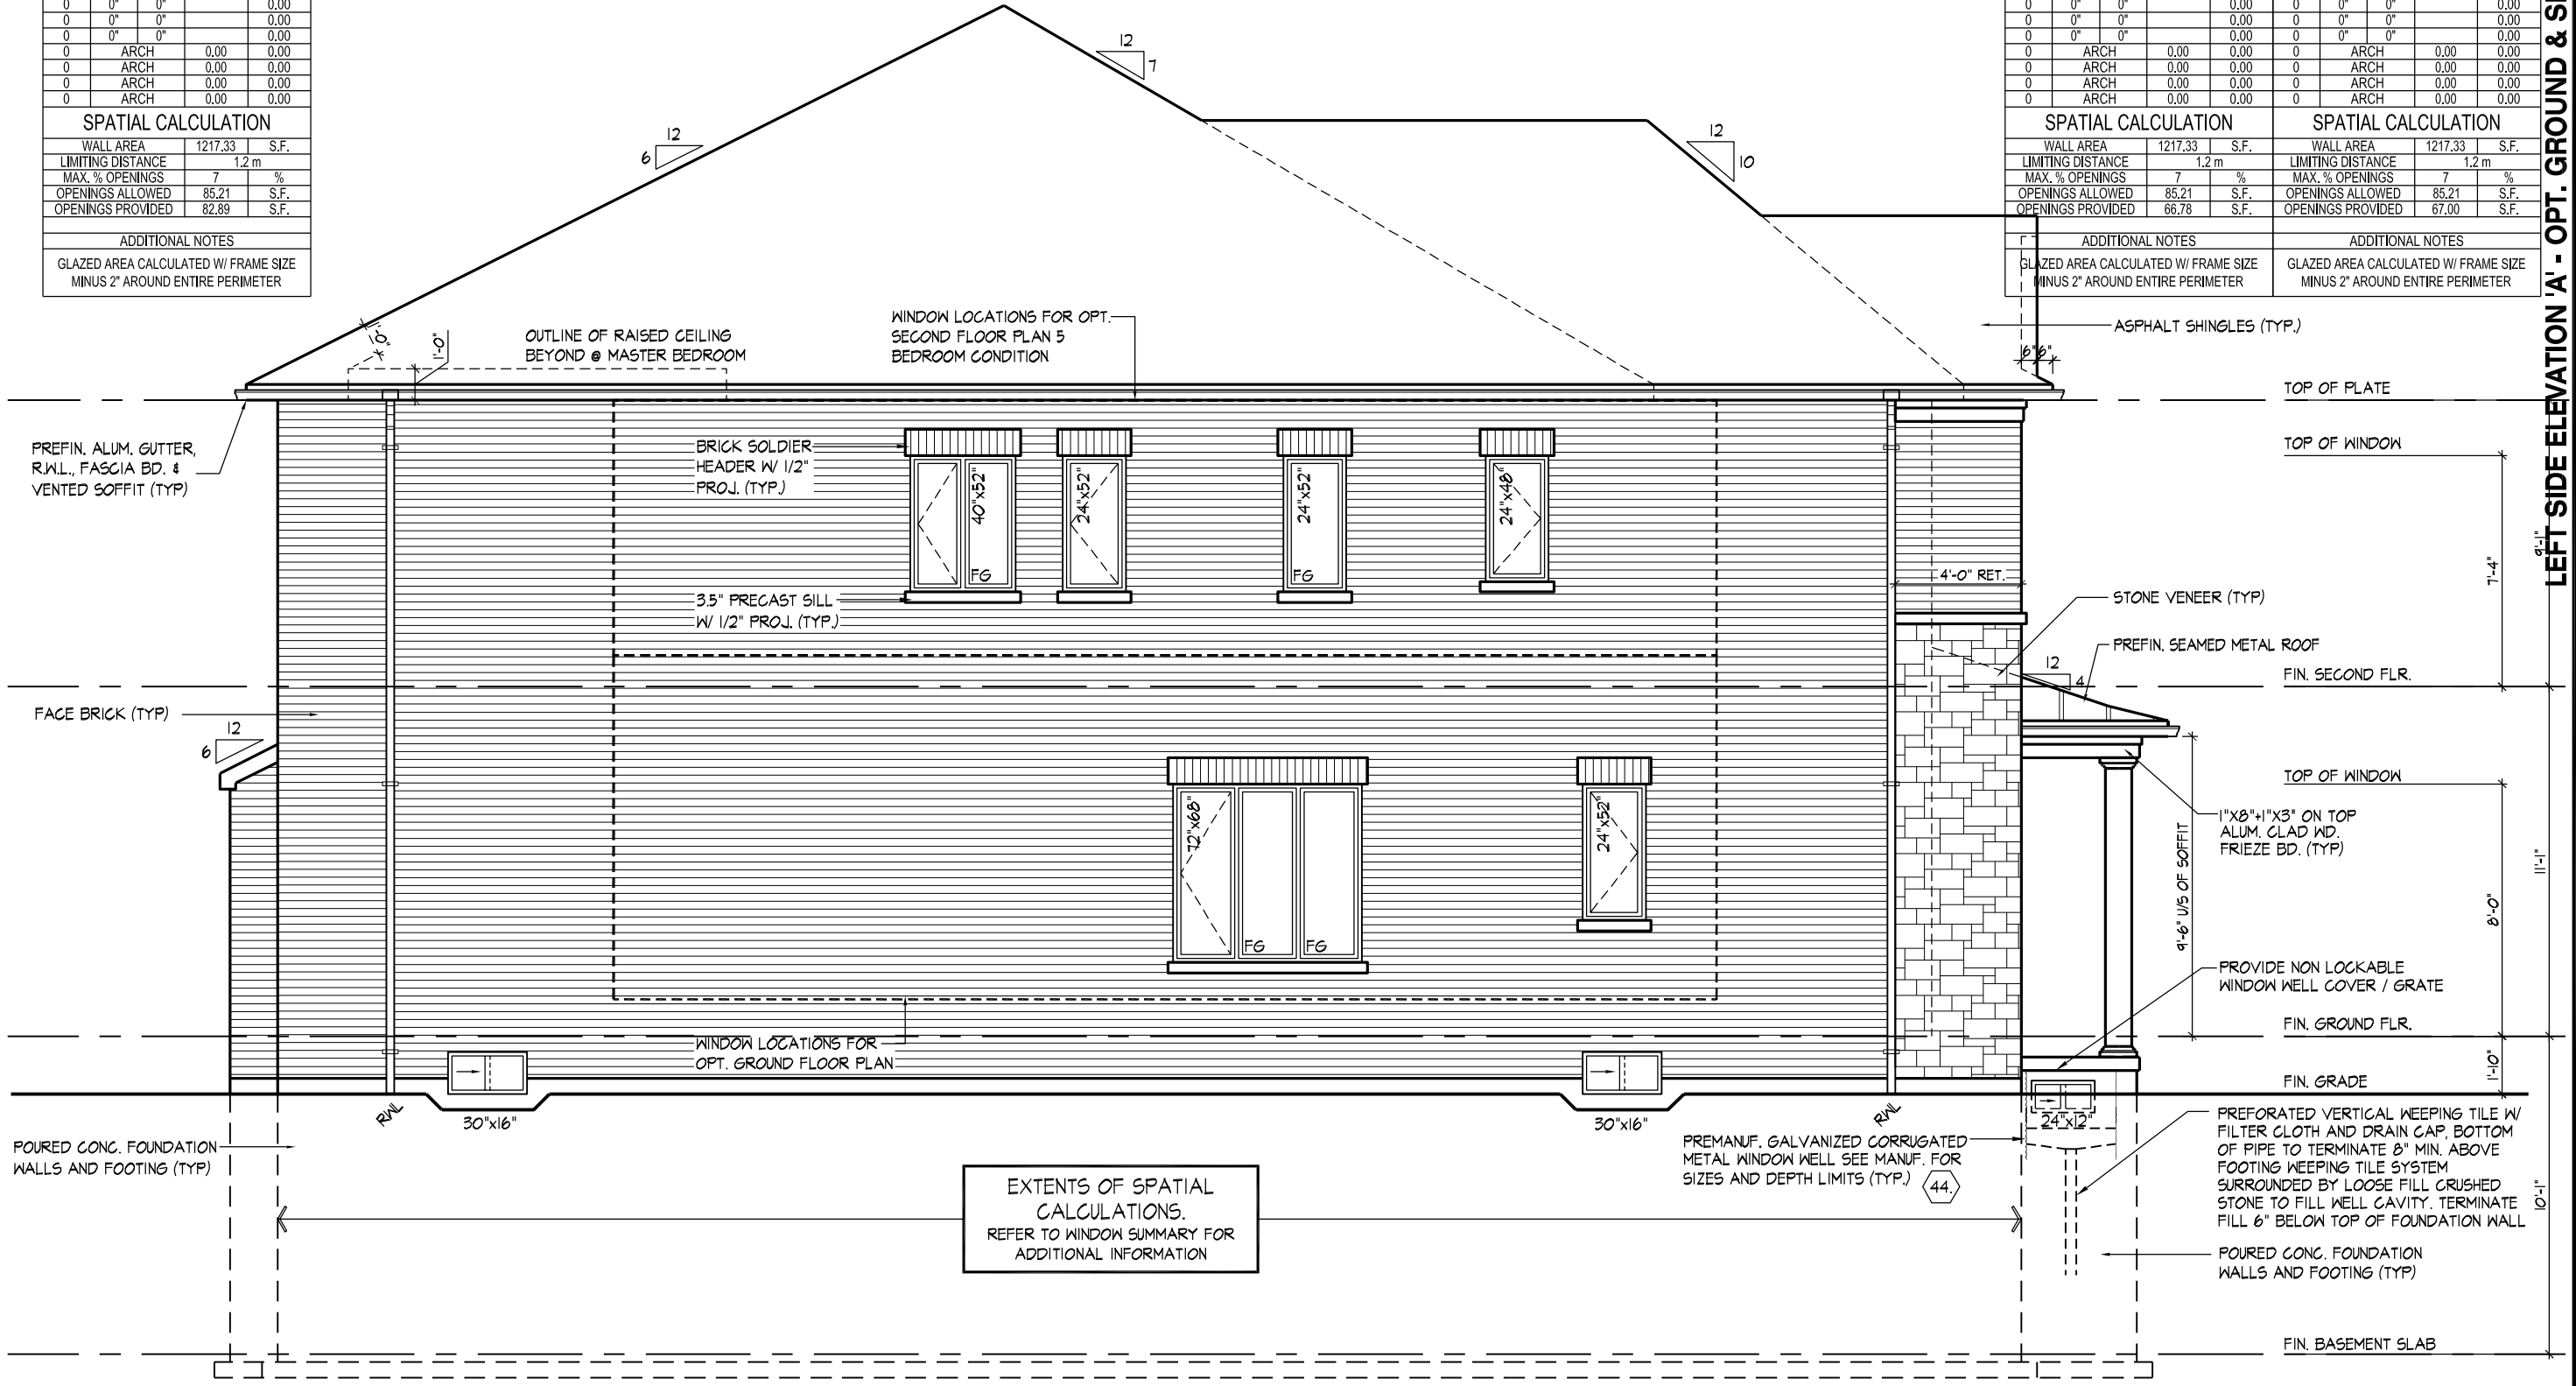

LEFT SIDE ELEVATION 'A' - OPT. GROUND & SECOND FLOOR PLAN

9'-1" LEFT SIDE ELEVATION 'A' - OPT. GROUND & SECOND FLOOR PLAN

ROYAL PINE HOMES - 216102 UNIT 4504 'THE DUNCAN'

"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON REV.2021.05.07

Page Number 24 of 39

File Number 216102WS4504.dwg

Scale 3/16" = 1'-0"

Checked By VL

Drawn By SK/MM

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

www.huntassociates.ca

HUNT ASSOCIATES INC.

DESIGN ASSOCIATES INC.

37308 BCN 19695

NAME Derek R. Santos

REGISTRATION INFORMATION

ALL DRAWINGS SPECIFICATIONS RELATED DOCUMENTS AND DESIGN ARE THE COPYRIGHT PROPERTY OF HUNT DESIGN ASSOCIATES (H.D.A.). REPRODUCTION OF THIS PROPERTY IN WHOLE OR IN PART IS STRICTLY PROHIBITED WITHOUT H.D.A.'S WRITTEN PERMISSION (H.D.A. ASSUMES NO RESPONSIBILITY OR LIABILITY FOR THIS PROPERTY UNLESS IT BEARS THE APPROPRIATE BCN NUMBER AND ORIGINAL SIGNATURE).

ROOF OVERHANGS ARE TO BE 12" UNLESS NOTED OTHERWISE

REFER TO FRONT ELEVATION FOR TYPICAL NOTES & INFO.

W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021


FINAL BY: *ACE*

This stamp is only for the purposes of design control and carries no other professional obligations.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE ELEVATION B				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	68"		30.22
3	24"	52"		20.00
2	24"	48"		12.22
1	48"	52"		14.67
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
SPATIAL CALCULATION				
WALL AREA		1217.33	S.F.	
LIMITING DISTANCE		1.2 m		
MAX. % OPENINGS		7	%	
OPENINGS ALLOWED		85.21	S.F.	
OPENINGS PROVIDED		81.44	S.F.	
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

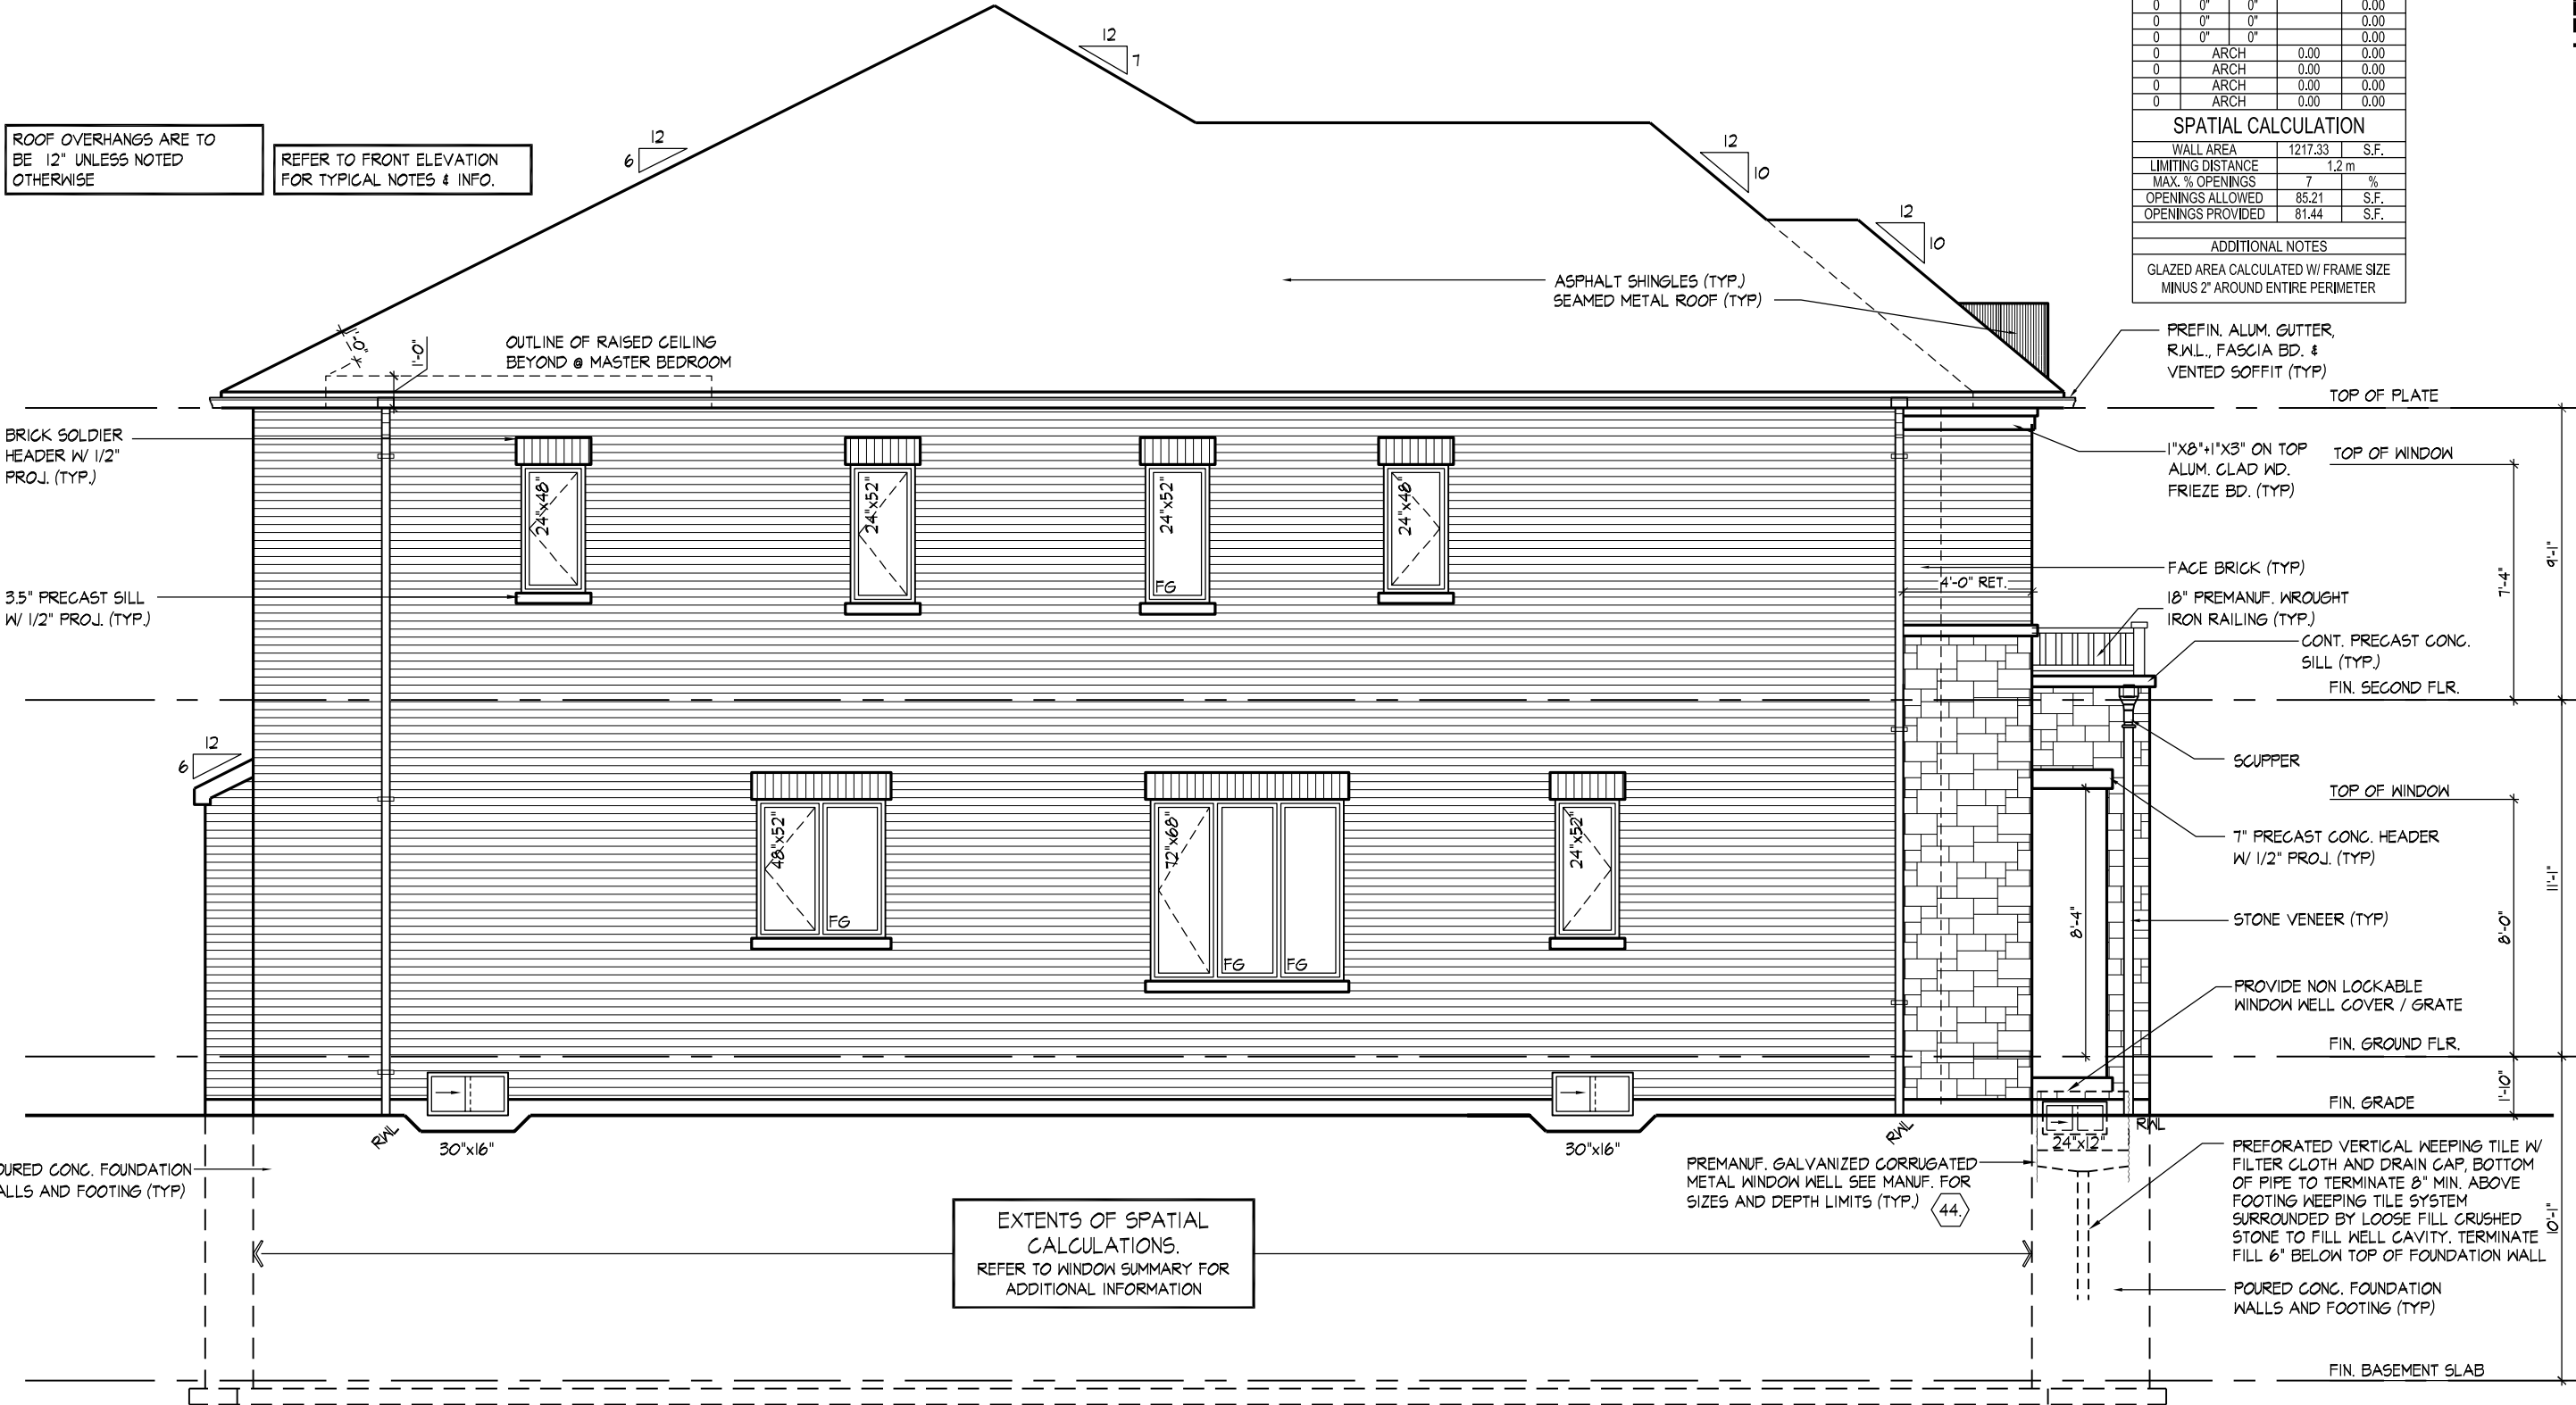

LEFT SIDE ELEVATION 'B'

EXTENTS OF SPATIAL CALCULATIONS. REFER TO WINDOW SUMMARY FOR ADDITIONAL INFORMATION

LEFT SIDE ELEVATION 'B'

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV.2021.05.07

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

NAME: Derek R. Santos
REGISTRATION INFORMATION: 37308 BCN
SIGNATURE: *[Signature]*
HUNT DESIGN ASSOCIATES INC.
19695

Drawn By: SK/MM
Checked By: VL
Scale: 3/16" = 1'-0"
File Number: 216102WS4504.dwg
Page Number: 29 of 39


All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCN number and original signature.)

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE EL. B W/ OPT. SEC.				
QVAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	56"		24.56
1	48"	56"		15.89
1	24"	52"		6.67
1	40"	52"		12.00
2	24"	52"		13.33
1	24"	48"		6.11
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
SPATIAL CALCULATION				
WALL AREA	1217.33	S.F.		
LIMITING DISTANCE	1.2 m			
MAX. % OPENINGS	7	%		
OPENINGS ALLOWED	85.21	S.F.		
OPENINGS PROVIDED	82.89	S.F.		
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

ROOF OVERHANGS ARE TO BE 12" UNLESS NOTED OTHERWISE


REFER TO FRONT ELEVATION FOR TYPICAL NOTES & INFO.

W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021
FINAL BY: *ALL*
This stamp is only for the purposes of design control and carries no other professional obligations.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

WINDOW SUMMARY					WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4					PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE EL. B W/ OPT. GRD					LEFT SIDE EL. B OPT. SEC&GRD				
QVAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)		QVAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	24"	48"	12.22		2	30"	16"	4.33	
2	24"	52"	13.33		1	72"	56"	24.56	
1	72"	68"	30.22		1	24"	52"	6.67	
1	24"	52"	6.67		1	40"	52"	12.00	
2	30"	16"	4.33		2	24"	52"	13.33	
0	0"	0"	0.00		1	24"	48"	6.11	
0	0"	0"	0.00		0	0"	0"	0.00	
0	0"	0"	0.00		0	0"	0"	0.00	
0	0"	0"	0.00		0	0"	0"	0.00	
0	0"	0"	0.00		0	0"	0"	0.00	
0	0"	0"	0.00		0	0"	0"	0.00	
0	ARCH		0.00	0.00	0	ARCH		0.00	0.00
0	ARCH		0.00	0.00	0	ARCH		0.00	0.00
0	ARCH		0.00	0.00	0	ARCH		0.00	0.00
0	ARCH		0.00	0.00	0	ARCH		0.00	0.00
SPATIAL CALCULATION					SPATIAL CALCULATION				
WALL AREA	1217.33	S.F.			WALL AREA	1217.33	S.F.		
LIMITING DISTANCE	1.2 m				LIMITING DISTANCE	1.2 m			
MAX. % OPENINGS	7	%			MAX. % OPENINGS	7	%		
OPENINGS ALLOWED	85.21	S.F.			OPENINGS ALLOWED	85.21	S.F.		
OPENINGS PROVIDED	66.78	S.F.			OPENINGS PROVIDED	67.00	S.F.		
ADDITIONAL NOTES					ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER					GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

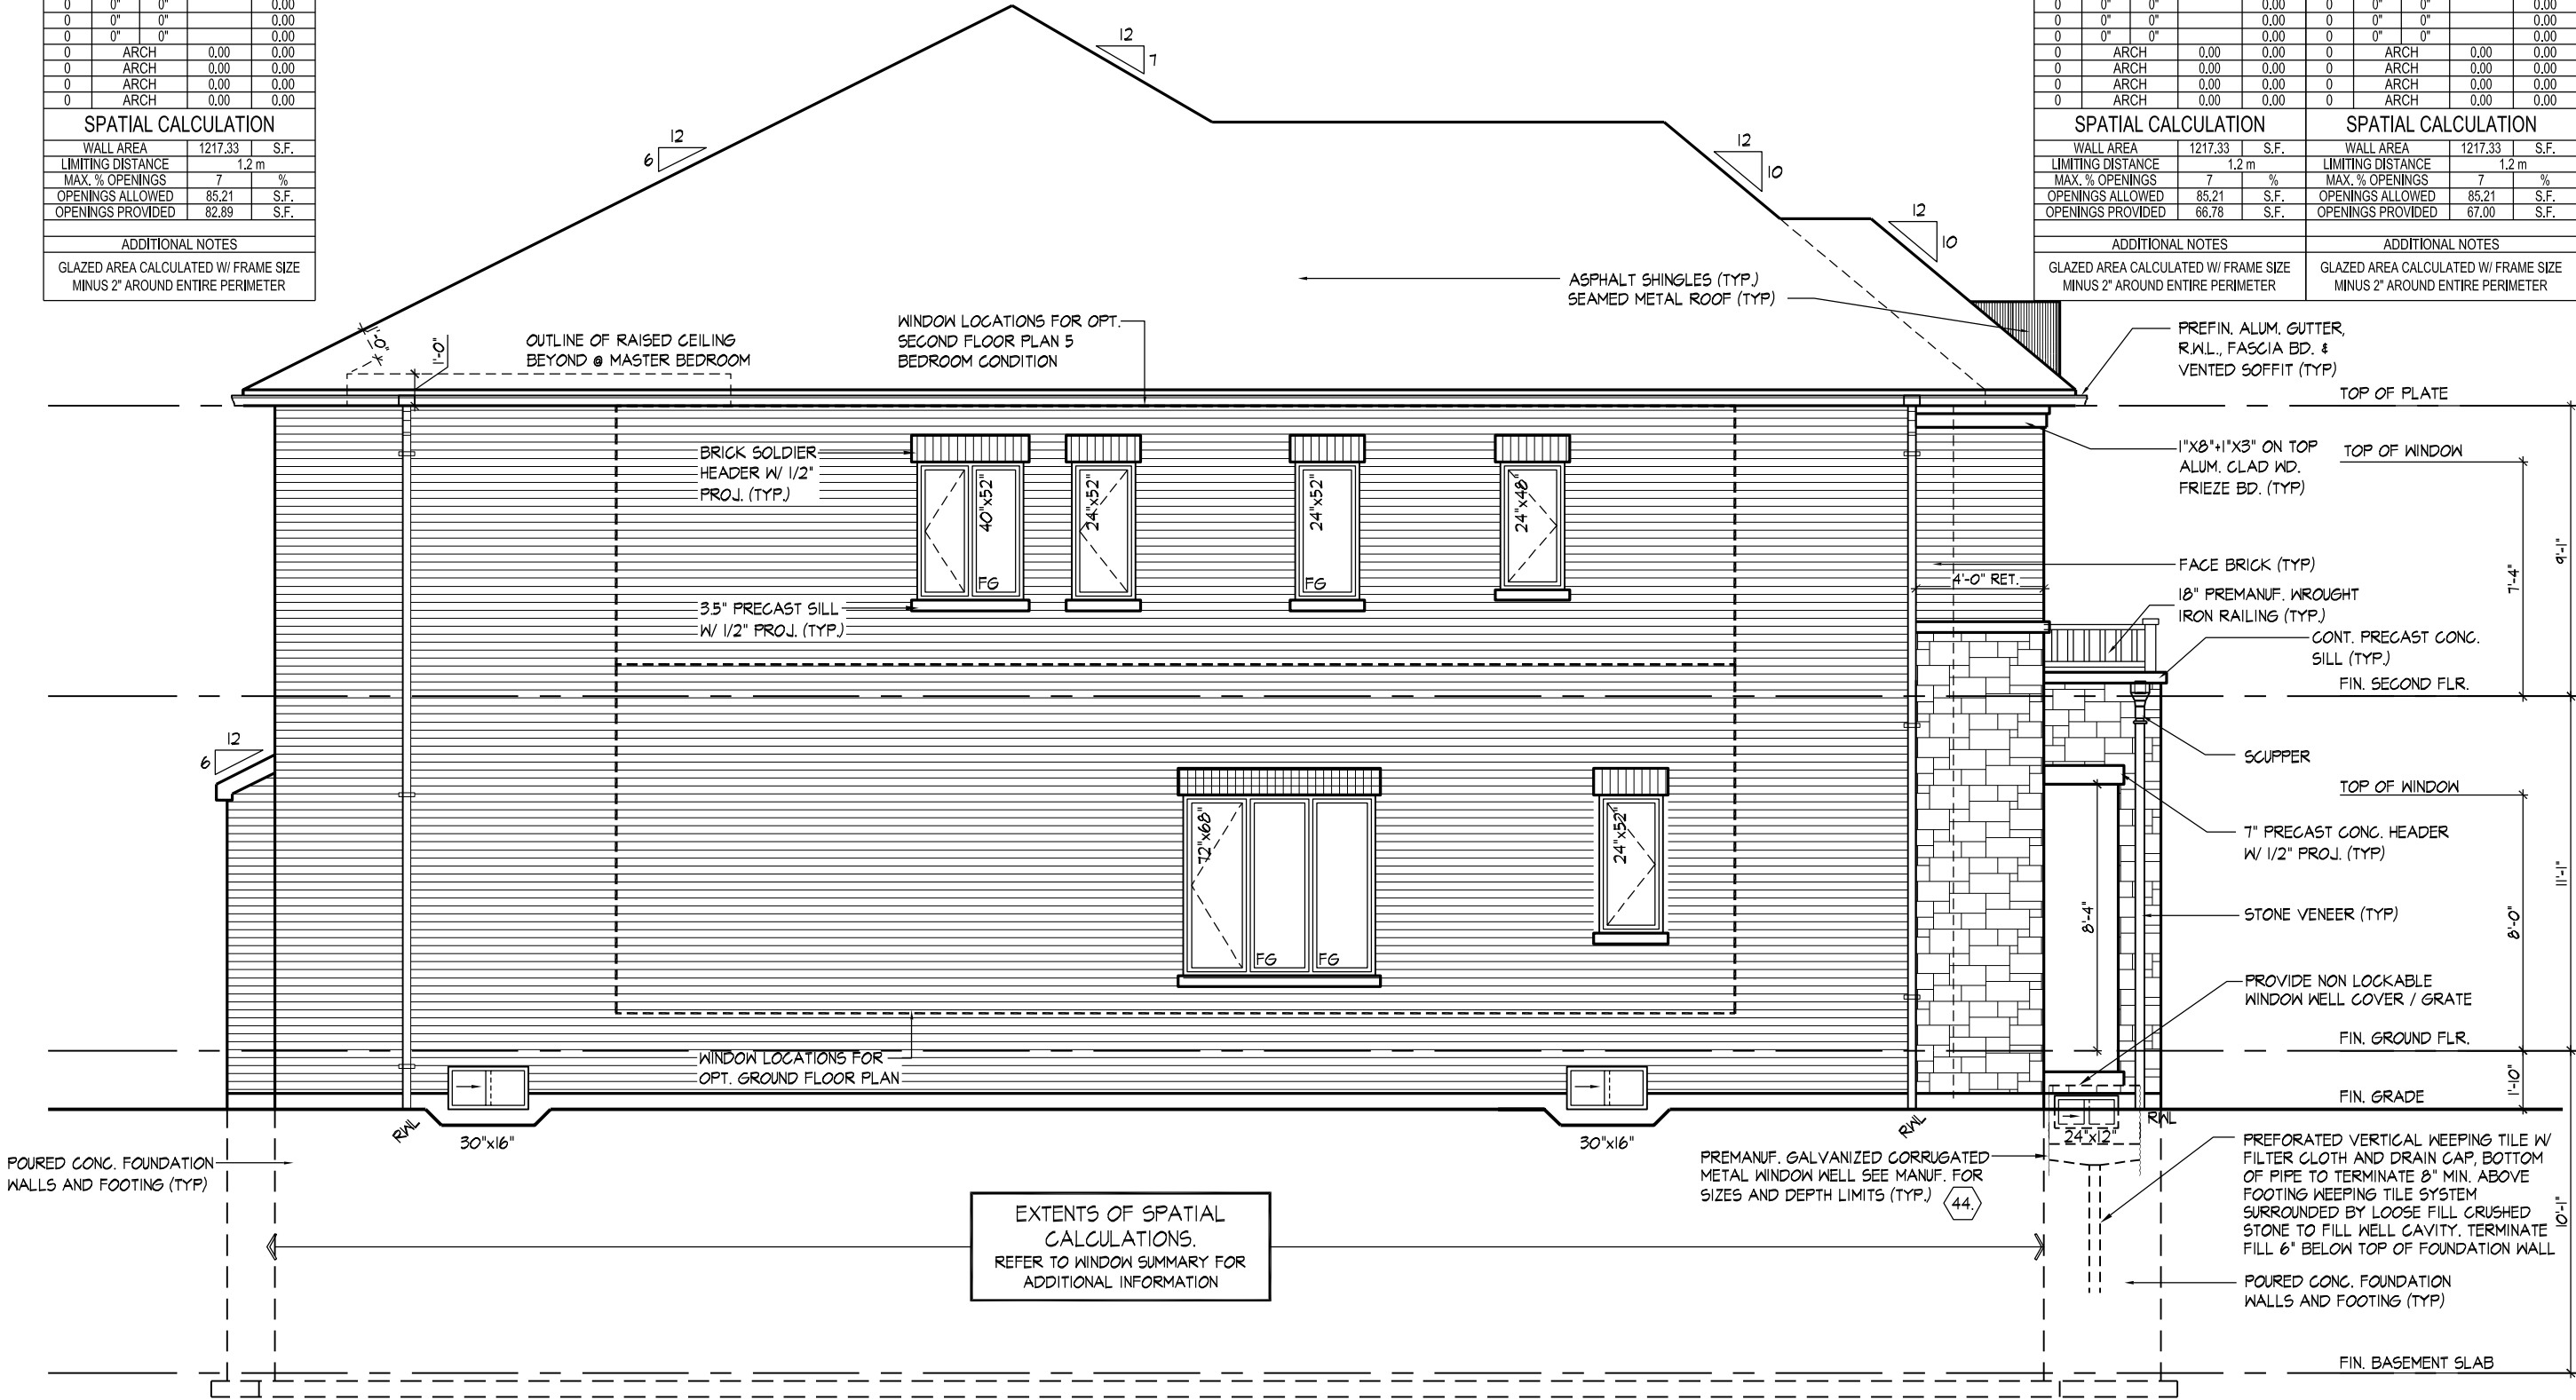

LEFT SIDE ELEVATION 'B' - OPT. GROUND & SECOND FLOOR PLAN

LEFT SIDE ELEVATION 'B' - OPT. GROUND & SECOND FLOOR PLAN

ROYAL PINE HOMES - 216102 UNIT 4504 "THE DUNCAN"
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON REV.2021.05.07

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

NAME: Derek R. Santos
REGISTRATION INFORMATION: 37308 BCN
SIGNATURE: *[Signature]*
HUNT DESIGN ASSOCIATES INC.
19695

Drawn By: SK/MM
Checked By: VL
Scale: 3/16" = 1'-0"
File Number: 216102WS4504.dwg
Page Number: 30 of 39

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCN number and original signature.)

ROOF OVERHANGS ARE TO BE 12" UNLESS NOTED OTHERWISE

REFER TO FRONT ELEVATION FOR TYPICAL NOTES & INFO.

PREFIN. ALUM. GUTTER, R.W.L., FASCIA BD. & VENTED SOFFIT (TYP)

BRICK SOLDIER HEADER W/ 1/2" PROJ. (TYP)

3.5" PRECAST SILL W/ 1/2" PROJ. (TYP)

FACE BRICK (TYP)

POURED CONG. FOUNDATION WALLS AND FOOTING (TYP)

R/W

30"x16"


30"x16"

R/W

EXTENTS OF SPATIAL CALCULATIONS. REFER TO WINDOW SUMMARY FOR ADDITIONAL INFORMATION

LEFT SIDE ELEVATION 'C'

W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021
FINAL BY: *Alb*
This stamp is only for the purposes of design control and carries no other professional obligations.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE ELEVATION C				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
2	30"	16"		4.33
1	72"	68"		30.22
3	24"	52"		20.00
2	24"	48"		12.22
1	48"	52"		14.67
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
0	ARCH		0.00	0.00
SPATIAL CALCULATION				
WALL AREA		1217.33	S.F.	
LIMITING DISTANCE		1.2 m		
MAX. % OPENINGS		7	%	
OPENINGS ALLOWED		85.21	S.F.	
OPENINGS PROVIDED		81.44	S.F.	
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

6" MTL. FLASHING W/ CAULKING BEYOND (TYP)
VALLEY FLASHING (TYP)

ASPHALT SHINGLES (TYP)

TOP OF PLATE

TOP OF WINDOW

1"x8"+1"x3" ON TOP ALUM. CLAD WD. FRIEZE BD. (TYP)

1" STUCCO REVEAL (TYP)

STUCCO FINISH (TYP)

CONT. 3.5" PRECAST CONC. SILL (TYP)

STONE VENEER (TYP)

FIN. SECOND FLR.

TOP OF WINDOW

FIN. GROUND FLR.

FIN. GRADE

FIN. BASEMENT SLAB

LEFT SIDE ELEVATION 'C'

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV.2021.05.07

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Derek R. Santos

SIGNATURE

37308

BCIN

HUNT DESIGN ASSOCIATES INC.

19695

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
216102WS4504.dwg
3/16"=1'-0"
VL
SK/MM
Checked By
Scale
File Number
Page Number
33 of 39


All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

WINDOW SUMMARY			
PER O.B.C. TABLE 9.10.15.4			
LEFT SIDE EL. A W/ OPT. SEC.			
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)
2	30"	16"	4.33
1	72"	56"	24.56
1	48"	56"	15.89
1	24"	52"	6.67
1	40"	52"	12.00
2	24"	52"	13.33
1	24"	48"	6.11
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
WALL AREA	1217.33	S.F.	
LIMITING DISTANCE	1.2 m		
MAX. % OPENINGS	7	%	
OPENINGS ALLOWED	85.21	S.F.	
OPENINGS PROVIDED	82.89	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			

ROOF OVERHANGS ARE TO BE 12" UNLESS NOTED OTHERWISE

REFER TO FRONT ELEVATION FOR TYPICAL NOTES & INFO.


W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021
FINAL BY: *ALC*
This stamp is only for the purposes of design control and carries no other professional obligations.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED FLOOR OR ROOF SYSTEM

WINDOW SUMMARY			
PER O.B.C. TABLE 9.10.15.4			
LEFT SIDE EL. A W/ OPT. GRD			
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)
2	24"	48"	12.22
2	24"	52"	13.33
1	72"	68"	30.22
1	24"	52"	6.67
2	30"	16"	4.33
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
WALL AREA	1217.33	S.F.	
LIMITING DISTANCE	1.2 m		
MAX. % OPENINGS	7	%	
OPENINGS ALLOWED	85.21	S.F.	
OPENINGS PROVIDED	66.78	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			

WINDOW SUMMARY			
PER O.B.C. TABLE 9.10.15.4			
LEFT SIDE EL. A OPT. SEC&GRD			
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)
2	30"	16"	4.33
1	72"	56"	24.56
1	24"	52"	6.67
1	40"	52"	12.00
2	24"	52"	13.33
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
WALL AREA	1217.33	S.F.	
LIMITING DISTANCE	1.2 m		
MAX. % OPENINGS	7	%	
OPENINGS ALLOWED	85.21	S.F.	
OPENINGS PROVIDED	67.00	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			

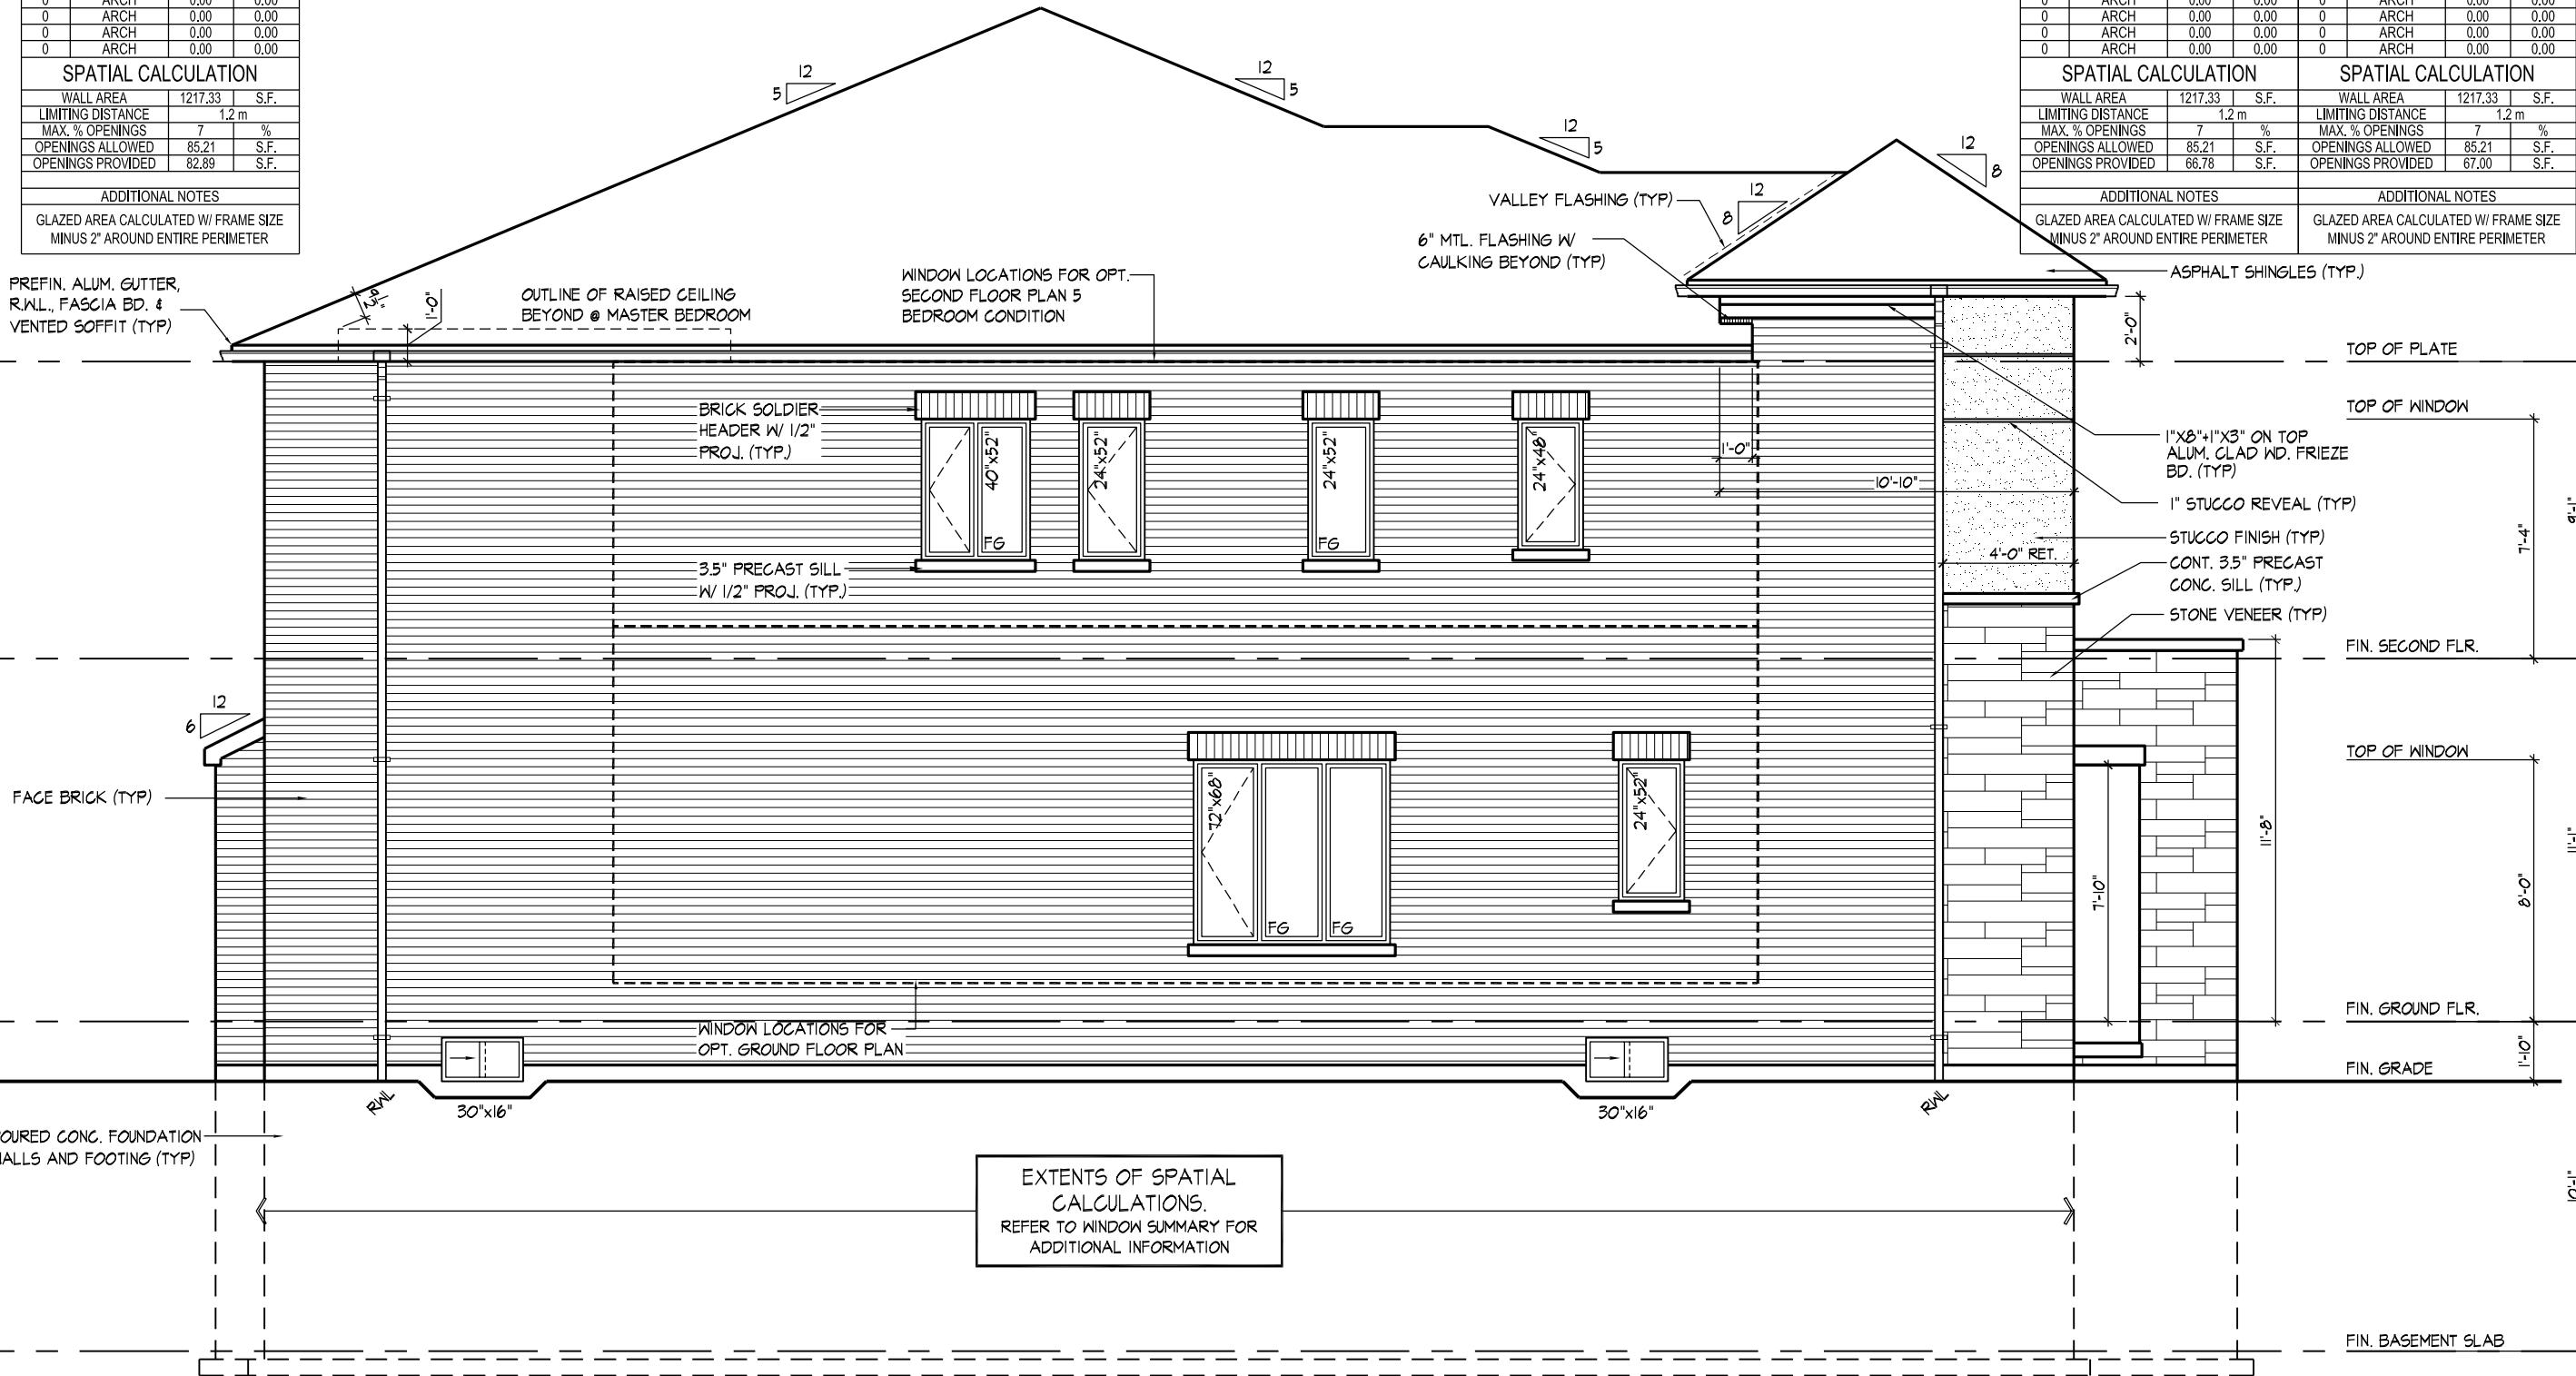

LEFT SIDE ELEVATION 'C' - OPT. GROUND & SECOND FLOOR PLAN

LEFT SIDE ELEVATION 'C' - OPT. GROUND & SECOND FLOOR PLAN

ROYAL PINE HOMES - 216102 UNIT 4504 "THE DUNCAN"

"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON

REV.2021.05.07

DESIGN ASSOCIATES INC.

www.huntdesign.ca

Drawn By: SK/MM

Checked By: VL

Scale: 3/16" = 1'-0"

File Number: 216102WS4504.dwg

Page Number: 34 of 39

NAME: Derek R. Santos



REGISTRATION INFORMATION: 37308 BCN

19695

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

ALL drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCN number and original signature.)

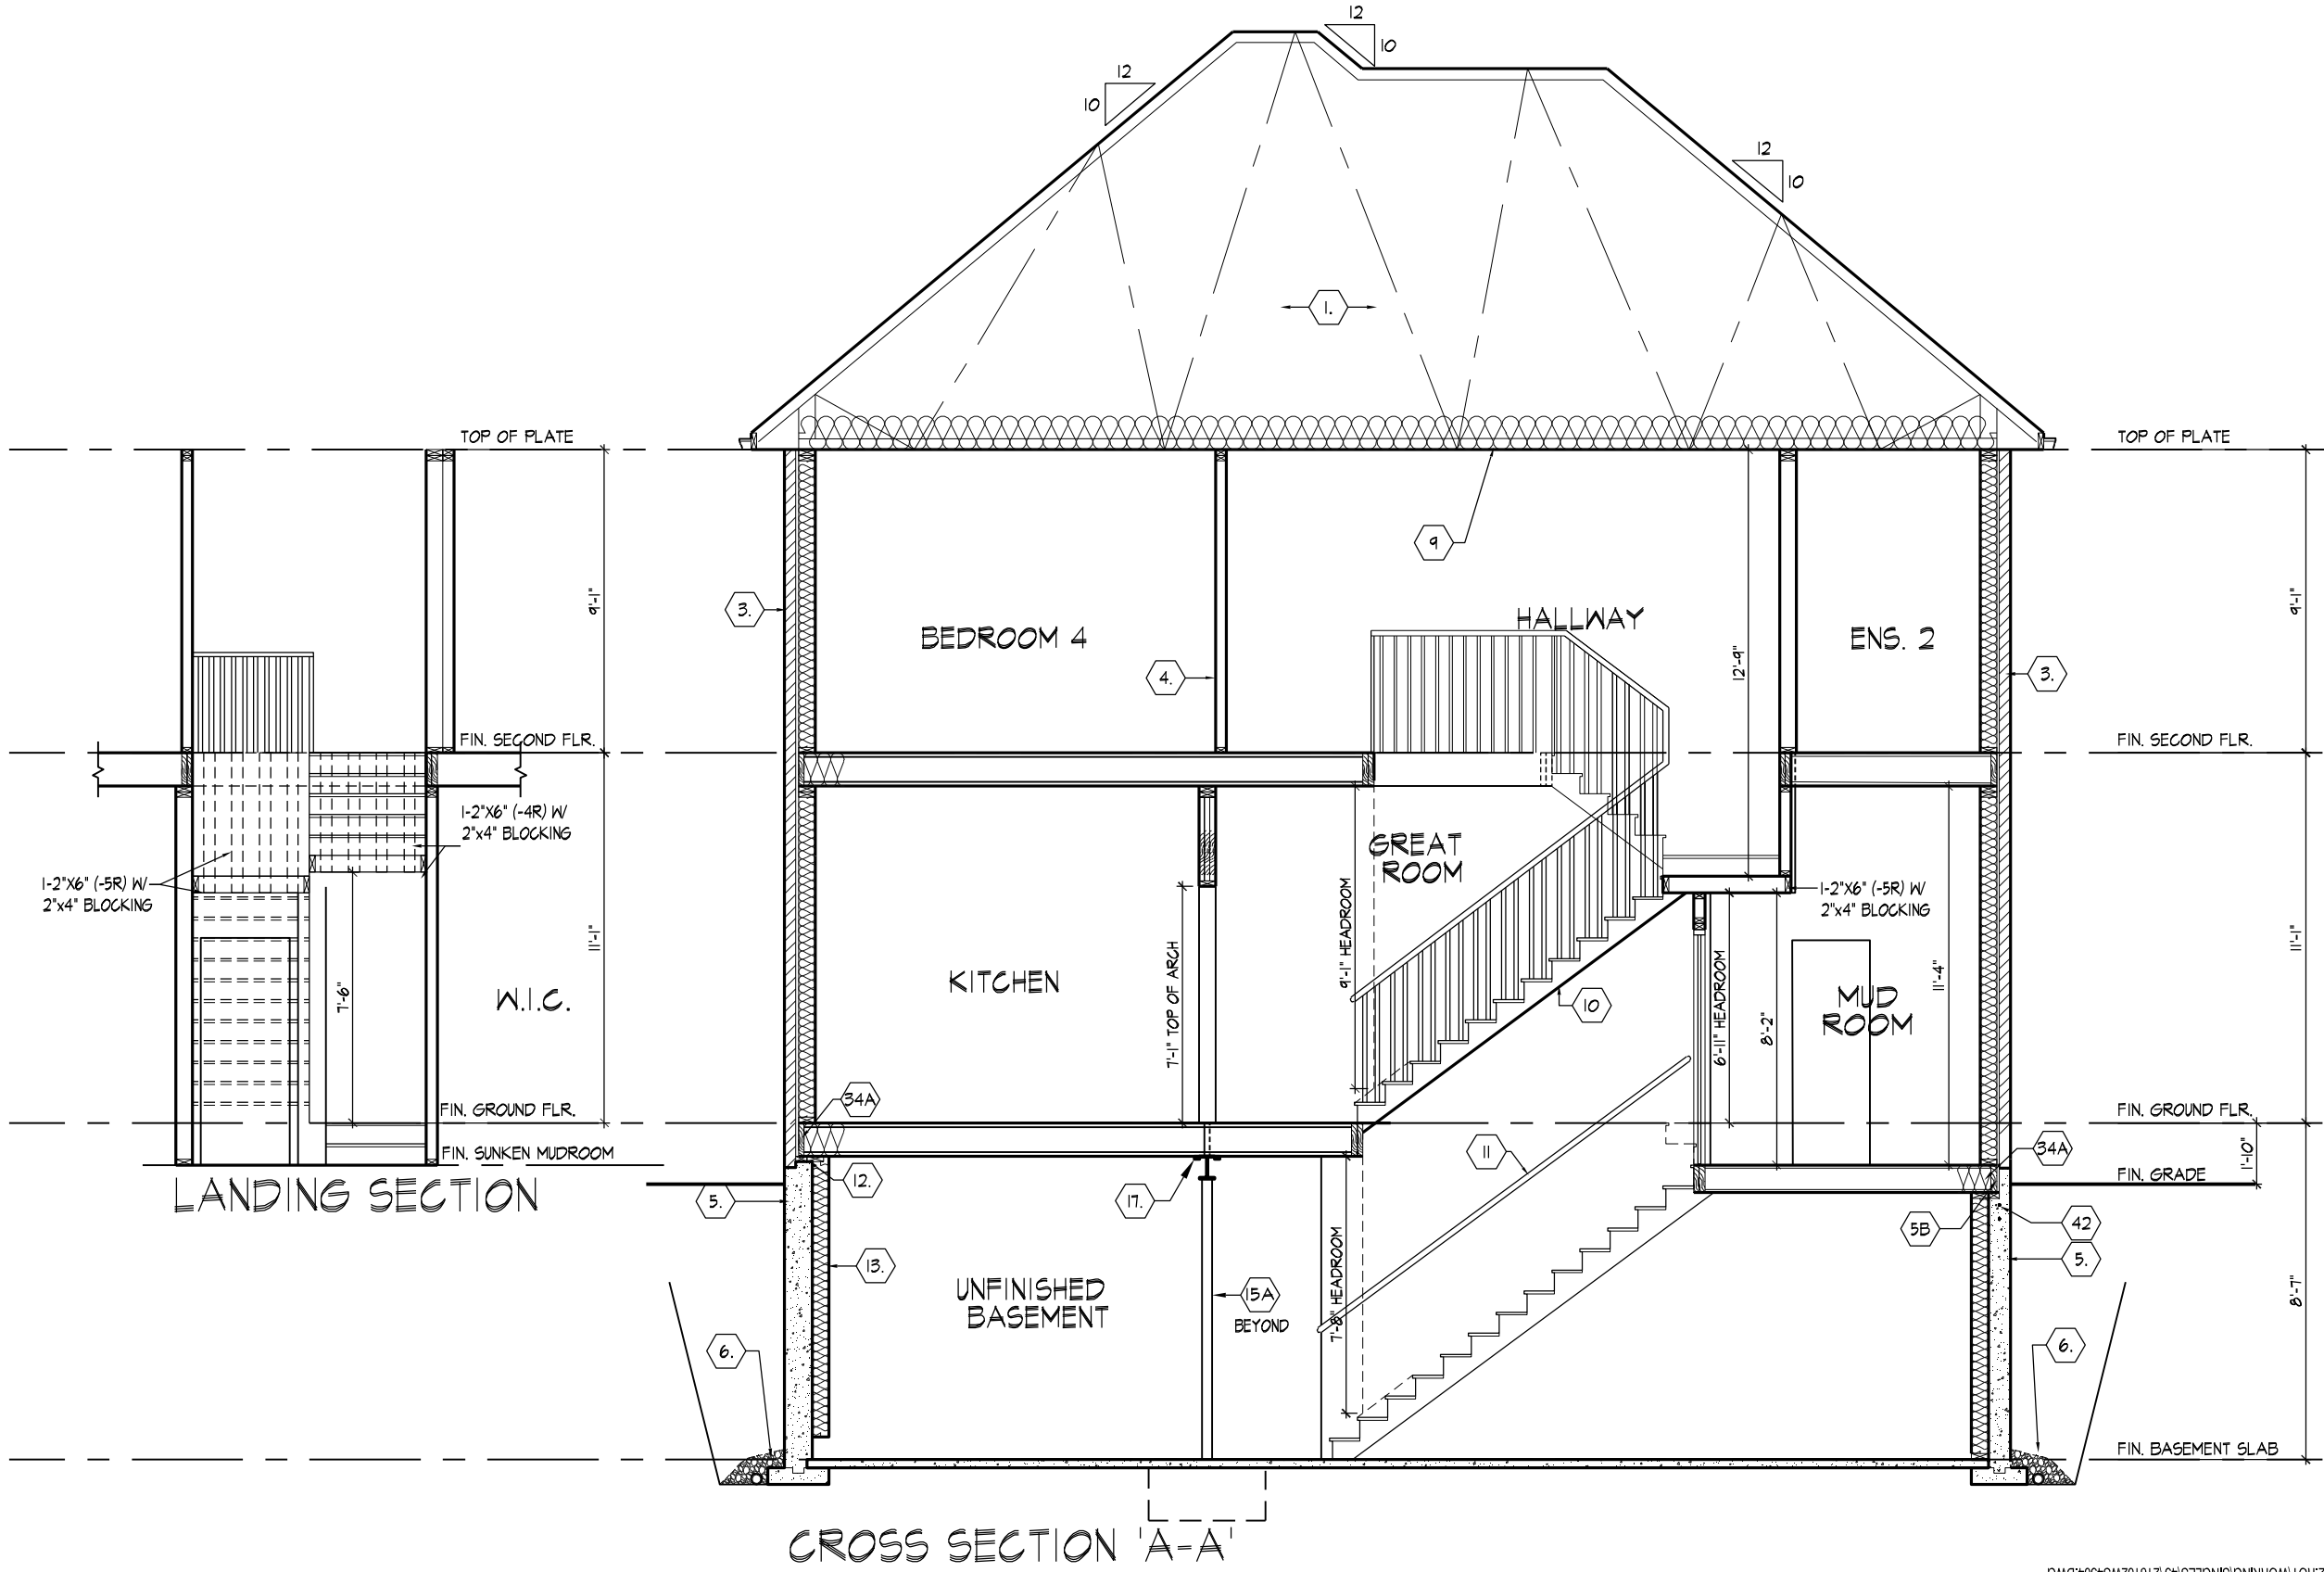

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM


CROSS SECTION 'A-A'

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
REV. 2021.05.07
Drawn By: SK/MM
Checked By: VL
Scale: 3/16" = 1'-0"
File Number: 216102WS4504.dwg
Page Number: 36 of 39


HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

NAME: Derek R. Santos
SIGNATURE: [Signature]
BCIN: 37308
19695
HUNT DESIGN ASSOCIATES INC.


ALL DRAWINGS ARE THE PROPERTY OF HUNT DESIGN ASSOCIATES (H.D.A.). REPRODUCTION OF THIS PROPERTY IN WHOLE OR IN PART IS STRICTLY PROHIBITED WITHOUT H.D.A.'S WRITTEN PERMISSION (H.D.A. ASSUMES NO RESPONSIBILITY OR LIABILITY FOR THIS PROPERTY UNLESS IT BEARS THE APPROPRIATE BCIN NUMBER AND ORIGINAL SIGNATURE).

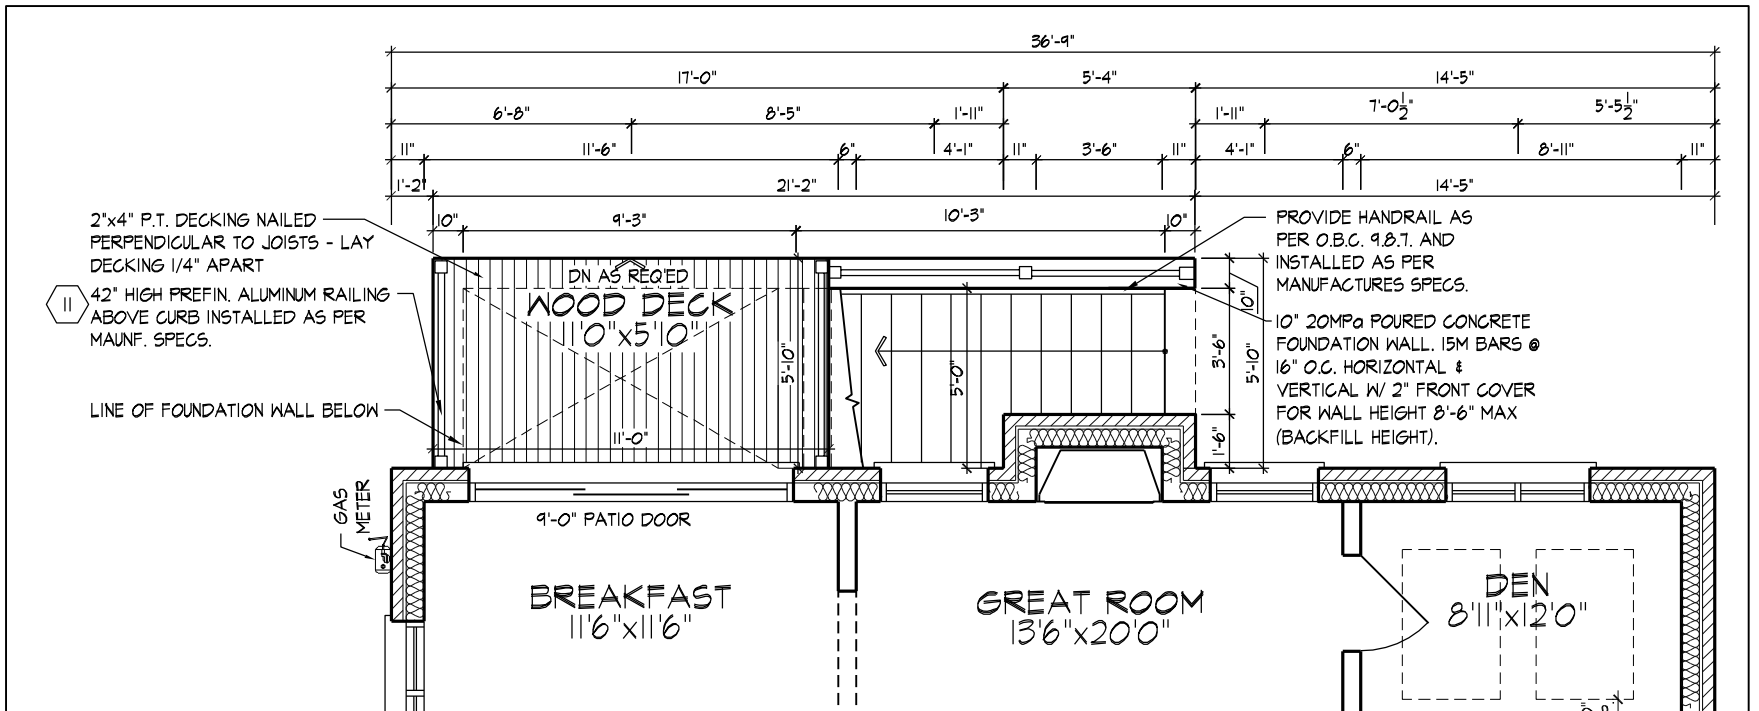

PART. GROUND FLOOR PLAN - W.U.B. CONDITION

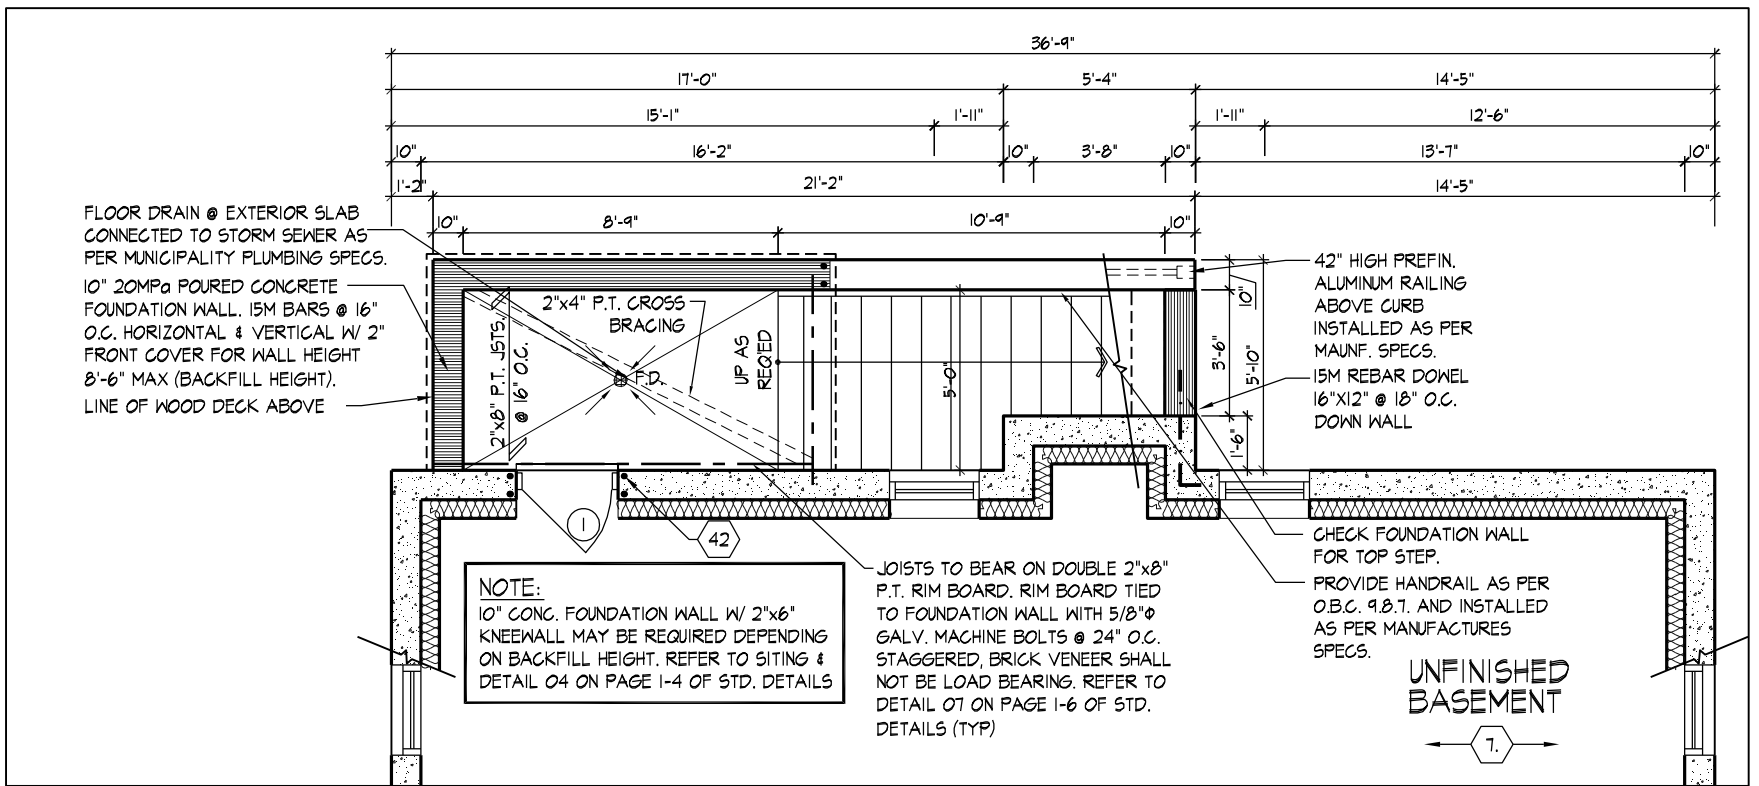

PART. BASEMENT PLAN - W.U.B. CONDITION

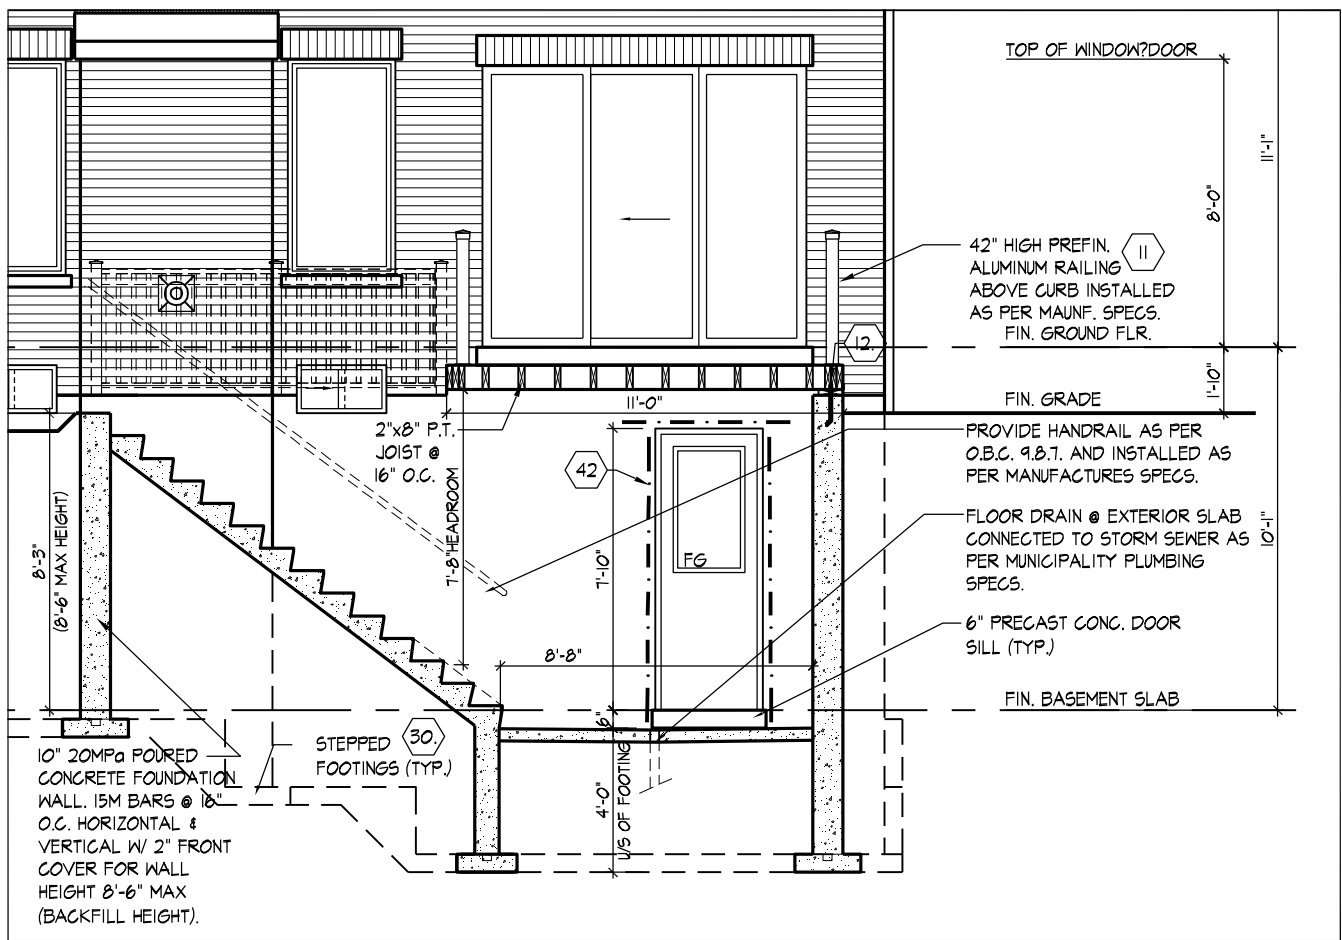

PART. REAR ELEVATION - W.U.B. CONDITION

WALK-UP BASEMENT CONDITION

ULTRABALLO | FRI MAY 7 21 04:25 PM | K:\PROJECTS\2016\216102\ROY\WORKING\SINGLES\451216102WS4504.DWG

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos
NAME
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.
37308
BCIN
19695

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216102
"CENTREFIELD" WEST GORMLEY, RICHMOND HILL, ON
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
UNIT 4504 "THE DUNCAN"
REV.2021.05.07
Scale 3/16"=1'-0"
File Number 216102WS4504.dwg
Page Number 37 of 39

W Architect Inc.
DESIGN CONTROL REVIEW
MAY 31, 2021
FINAL BY: *[Signature]*
This stamp is only for the purposes of design control and carries no other professional obligations.

LICENCED PROFESSIONAL ENGINEER
2021-05-14
D. FERRARI
100166929
PROVINCE OF ONTARIO

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

cont. SECTION 1.0. CONSTRUCTION NOTES

39

TWO STOREY VOLUME SPACES

(9.23.10.1., 9.23.11., 9.23.16.)

WALL ASSEMBLY		WIND LOADS			
EXTERIOR	STUDS	<= 0.5 kPa (q50)		> 0.5 kPa (q50)	
		SPACING	MAX HEIGHT	SPACING	MAX HEIGHT
BRICK	2-2"x6" (2-38x140) SPR. #2	12" (305) O.C.	18'-4" (5588)	8" (200) O.C.	18'-4" (5588)
SIDING		16" (406) O.C.	18'-4" (5588)	12" (305) O.C.	18'-4" (5588)
BRICK	2-2"x8" (2-38x184) SPR. #2	12" (305) O.C.	21'-0" (6400)	12" (305) O.C.	21'-0" (6400)
SIDING		16" (406) O.C.	21'-0" (6400)	16" (406) O.C.	21'-0" (6400)
** STUD SIZE & SPACING TO BE VERIFIED BY STRUCTURAL ENGINEER **					

STUDS ARE TO BE CONTINUOUS, C/W 3/8" (9.5) THICK EXTERIOR PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 4'-0" (1220) O.C. VERTICALLY.

- FOR HORIZ. DISTANCES LESS THAN 9'-6" (2896) PROVIDE 2"x6" (38x140) STUDS @ 16" (406) O.C. WITH CONTIN. 2-2"x6" (2-38x140) TOP PLATE + 1-2"x6" (1-38x140) BOTTOM PLATE & MIN. OF 3-2"x8" (3-38x184) CONT. HEADER AT GROUND FLOOR CEILING LEVEL TOE-NAILED & GLUED AT TOP, BOTTOM PLATES & HEADERS.

40

1 HR. PARTY WALL (CONC. BLOCK)

((SB-3] WALL TYPE 'B6e' & 'B1b')

1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WD. STRAPPING @ 24" (610) O.C. ON 8" (200) CONC. BLOCK FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE, FILL & SAND ALL GYPSUM JOINTS. EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT OR FURRED WITH 2"x2" (38x38) WD. STRAPPING & 1/2" (12.7) GYPSUM SHEATHING.

40

1 HR. PARTY WALL (DOUBLE STUD)

((SB-3] WALL TYPE 'W13c')

5/8" (15.9) TYPE 'X' GYPSUM SHEATHING ON EXTERIOR SIDE OF 2 ROWS OF 2"x4" (38x89) STUDS @ 16" (406) O.C., MIN. 1" (25) APART ON SEPARATE 2"x4" (38x89) SILL PLATES. (2"x6" (38x140) AS REQUIRED) FILL ONE SIDE OF STUD CAVITY WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE FILL AND SAND ALL GYPSUM JOINTS.

40A

2 HR. FIREWALL

((SB-3] WALL TYPE 'B6e' & 'B1b')

1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WOOD STRAPPING @ 24" (610) O.C ON 8" (200) CONC. BLOCK 75% SOLID. FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE, FILL & SAND ALL GYPSUM JOINTS. AT UNFINISHED AREAS, EXTERIOR FACE OF CONC. BLOCK TO BE SEALED WITH 2 COATS OF PAINT. GYPSUM SHEATHING TO BE ATTACHED TO CONC. BLOCK. (REFER TO DETAILS)

41

STUCCO WALL CONSTRUCTION (2"x6")

STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.I.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BOARD ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)

41A

STUCCO WALL CONSTRUCTION (2"x6") W/ CONTIN. INSUL.

STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.I.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 7/16" EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)

41B

STUCCO WALL @ GARAGE CONST.

STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.F.I.S (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYSPUM BRD. ON STUDS CONFORMING TO O.B.C (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQ.)
*** FOR DWELLINGS USING CONTIN. INSULATION CONSTRUCTION, PROVIDE APPROVED DRAINAGE MAT ON 7/16" (11) EXTERIOR TYPE SHEATHING OVER FURRING (AS REQ.) AND STUDS IN LIEU OF 1 1/2" (38) E.F.I.S (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2"(12.7) DENSGLASS GOLD GYSPUM BRD.

42

UNSUPPORTED FOUNDATION WALLS

(9.15.4.2.)

REINFORCING AT STAIRS AND SUNKEN FLOOR AREAS
2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
- BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL
REINFORCING AT BASEMENT WINDOWS
2-15M HORIZ. REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SILL. EXTEND BARS 24" (610) BEYOND THE OPENING. 2-15M VERTICAL REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL ON EACH SIDE OF THE WINDOW OPENING.
- BARS TO HAVE MIN. 1" (25) CONC. COVER
- BARS TO EXTEND 2'-0" (610) BEYOND BOTH SIDES OF OPENING

43

STUD WALL REINFORCEMENT

PROVIDE STUD WALL REINFORCEMENT IN MAIN BATHROOM CONFORMING TO O.B.C. (9.5.2.3.(1)) (REFER TO DETAILS)

44

WINDOW WELLS

WHERE A WINDOW OPENS INTO A WINDOW WELL, A CLEARANCE OF NOT LESS THAN 21 5/8" (550) SHALL BE PROVIDED IN FRONT OF THE WINDOW. EVERY WINDOW WELL SHALL BE DRAINED TO THE FOOTING LEVEL OR OTHER SUITABLE LOCATION WITH A 4" (100) WEEPING TILE C/W A FILTER CLOTH WRAP AND FILLED WITH CRUSHED STONE. (9.9.10.1.(5), 9.14.6.3.)

45

SLOPED CEILING CONSTRUCTION

((SB-12] 3.1.1.8., 9.23.4.2.)

2"x12" (38x286) ROOF JOISTS @ 16" (406) O.C. MAX. (UNLESS OTHERWISE NOTED) W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO ROOF JOIST (PURLINS NOT REQ. W/ SPRAY FOAM), W/ INSULATION BETWEEN JOIST, 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH OR APPROVED EQ. INSULATION VALUE DIRECTLY ABOVE THE INNER SURFACE OF EXTERIOR WALLS SHALL NOT BE LESS THAN R20 (3.52 RSI).

46

FLAT ROOF/BALCONY CONSTRUCTION

WATERPROOFING MEMBRANE (9.26.11, 9.26.15, 9.26.16) FULLY ADHERED TO 5/8" (15.9) T&G EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x2" (38x38) PURLINS ANGLED TOWARDS SCUPPER @ 2% MINIMUM LAID PERPENDICULAR TO 2"x8" (38x184) FLOOR JOISTS @ 16" (406) O.C. (UNLESS OTHERWISE NOTED). BUILT UP CURB TO BE 4" (100) MIN. ABOVE FINISHED BALCONY FLOOR. CONTINUOUS 'L' TRIM DRIP EDGE TO BE PROVIDED ON OUTSIDE FACE OF CURB. SCUPPER DRAIN TO BE LOCATED 24" (610) MIN. AWAY FROM HOUSE. PREFINISHED ALUMINUM OR PANEL FOR UNDERSIDE OF SOFFIT (9.23.2.3). REMOVE CURB WHERE REQ.
BALCONY CONDITION
SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE. INCLUDE 2"x4" (38x89) PT. DECKING W/ 1/4" (6.4) GAPS LAID FLAT PARALLEL TO JOISTS ON 2"x4" (38x89) PT. SLEEPERS @ 12" (305) O.C. LAID FLAT PERPENDICULAR TO JOISTS
BALCONY OVER HEATED SPACE CONDITION
SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE FOR ASSEMBLY. REFER TO PLANS FOR FLOOR JOIST SIZE & REFER TO HEX NOTE 9 FOR INSULATION AND INTERIOR FINISH

47

BARREL VAULT CONSTRUCTION

CANTILEVERED 2"x4" (38x89) SPACERS LAID FLAT ON 2"x10" (38x235) SPR. #2 ROOF JOIST NAILED TO BUILT-UP 3-3/4" (19) PLYWOOD HEADER PROFILED FOR BARREL. SPRAY FOAM INSULATION BETWEEN JOISTS W/ GYPSUM BOARD. INTERIOR FIN. (REFER TO DETAILS)

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

SECTION 1.1. WALL STUDS

- REFER TO THIS CHART FOR STUD SIZE & SPACING AS REQUIRED FOR EXTERIOR WALLS ONLY. REFER TO SITING & GRADING PLAN OF THIS UNIT FOR CONFIRMATION OF TOP OF FOUNDATION WALL AND ADDITIONAL INFORMATION.

- IF STUD WALL HEIGHT EXCEEDS MAX. UNSUPPORTED HEIGHT, WALL NEEDS TO BE REVIEWED AND APPROVED BY ENGINEER.

SIZE & SPACING OF STUDS: (OBC REFERENCE - TABLE 9.23.10.1.)					
MIN. STUD SIZE, in (mm)	SUPPORTED LOADS (EXTERIOR)				
	ROOF w/ OR w/o ATTIC	ROOF w/ OR w/o ATTIC & 1 FLOOR	ROOF w/ OR w/o ATTIC & 2 FLOOR	ROOF w/ OR w/o ATTIC & 3 FLOOR	
	MAX. STUD SPACING, in (mm) O.C.				
	MAX. UNSUPPORTED HGT., ft-in (m)				
2"x4" (38x89)	24" (610)	16" (405)	12" (305)		N/A
	9'-10" (3.0)	9'-10" (3.0)	9'-10" (3.0)		N/A
2"x6" (38x140)	-	24" (610)	16" (406)	12" (305)	
	-	9'-10" (3.0)	11'-10" (3.6)	5'-11" (1.8)	

SECTION 2.0. GENERAL NOTES

- 2.1. WINDOWS**
- 1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IS TO HAVE AT LEAST ONE OUTSIDE WINDOW W/ MIN. 0.35m2 UNOBSTRUCTED OPEN PORTION W/ NO DIMENSION LESS THAN 1'-3" (380), CAPABLE OF MAINTAINING THE OPENING WITHOUT THE NEED FOR ADDITIONAL SUPPORT, CONFORMING TO 9.9.10.
- 2) WINDOW GUARDS: A GUARD OR A WINDOW WITH A MAXIMUM RESTRICTED OPENING WIDTH OF 4" (100) IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 1'-7" (480) ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FINISHED FLOOR TO THE ADJACENT GRADE IS GREATER THAN 5'-11" (1800), (9.8.8.1.)
- 3) WINDOWS IN EXIT STAIRWAYS THAT EXTEND TO LESS THAN 2'-11" (900) [3'-6" (1070) FOR ALL OTHER BUILDINGS] SHALL BE PROTECTED BY GUARDS IN ACCORDANCE WITH NOTE #2 (ABOVE), OR THE WINDOW SHALL BE NON-OPERABLE AND DESIGNED TO WITHSTAND THE SPECIFIED LOADS FOR BALCONY GUARDS AS PROVIDED IN 4.1.5.15 OR 9.8.8.2
- 4) REFER TO TITLE PAGE FOR MAX. U-VALUE REQUIREMENTS

- 2.2. CEILING HEIGHTS**
- THE CEILING HEIGHTS OF ROOMS AND SPACES SHALL CONFORM TO TABLE 9.5.3.1.

ROOM OR SPACE	MINIMUM HEIGHTS
LIVING ROOM, DINING ROOM AND KITCHEN	7'-7" OVER 75% OF REQUIRED FLOOR AREA WITH A CLEAR HEIGHT OF 6'-11" AT ANY POINT
BEDROOM	7'-7" OVER 50% OF REQUIRED FLOOR AREA OR 6'-11" OVER ALL OF THE REQUIRED FLOOR AREA.
BASEMENT	6'-11" OVER AT LEAST 75% OF THE BASEMENT AREA EXCEPT THAT UNDER BEAMS AND DUCTS THE CLEARANCE IS PERMITTED TO BE REDUCED TO 6'-5".
BATHROOM, LAUNDRY AREA ABOVE GRADE	6'-11" IN ANY AREA WHERE A PERSON WOULD NORMALLY BE STANDING
FINISHED ROOM NOT MENTIONED ABOVE	6'-11"
MEZZANINES	6'-11" ABOVE & BELOW FLOOR ASSEMBLY (9.5.3.2.)
STORAGE GARAGE	6'-7" (9.5.3.3.)

- 2.3. MECHANICAL / PLUMBING**
- 1) MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.7 AIR CHANGE PER HOUR IF NOT AIR CONDITIONED 1 PER HOUR IF AIR CONDITIONED AVERAGED OVER 24 HOURS, WHEN A VENTILATION FAN (PRINCIPAL EXHAUST) IS REQUIRED, CONFORM TO OBC 9.32.3.4. WHEN A HRV IS REQUIRED, CONFORM TO 9.32.3.11. REFER TO MECHANICAL DRAWINGS.
- 2) REFER TO HOT WATER TANK MANUFACTURER SPECS. CONFORM TO OBC 9.31.6.
- 3) REFER TO TITLE PAGE FOR SPACE HEATING EQUIPMENT, HRV AND DOMESTIC HOT WATER HEATER MINIMUM EFFICIENCIES.
- 4) DRAIN WATER HEAT RECOVERY UNIT(S) WILL BE INSTALLED CONFORMING TO THE REQUIREMENTS OF SB12 - 3.1.1.12. OF THE O.B.C.
- 2.4. LUMBER**
- 1) ALL LUMBER SHALL BE SPRUCE No.2 GRADE OR BETTER, UNLESS NOTED OTHERWISE.
- 2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.
- 3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No. 2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
- 4) ALL LAMINATED VENEER LUMBER (LVL) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY FLOOR AND ROOF TRUSS MANUFACTURER.
- 5) JOIST HANGERS: PROVIDE APPROVED METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING WITH FLUSH BUILT-UP WOOD MEMBERS.
- 6) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE. IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2 mil POLYETHYLENE FILM. No.50 (45lbs) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 6" (152) ABOVE THE GROUND.

- 2.5. STEEL** (9.23.4.3.)
- 1) STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W. HOLLOW STRUCT. SECTIONS SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350W CLASS "H".
- 2) REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

- 2.6. FLAT ARCHES**
- 1) FOR 8'-0" (2440) CEILINGS, FLAT ARCHES SHALL BE 6'-10" (2080) A.F.F.
- 2) FOR 9'-0" (2740) CEILINGS, FLAT ARCHES SHALL BE 7'-10" (2400) A.F.F.
- 3) FOR 10'-0" (3040) CEILINGS, FLAT ARCHES SHALL BE 8'-6" (2600) A.F.F.

- 2.7. ROOF OVERHANGS**
- 1) ALL ROOF OVERHANGS SHALL BE 1'-0" (305), UNLESS NOTED OTHERWISE.

- 2.8. FLASHING** (9.20.13., 9.26.4, & 9.27.3.)
- 1) FLASHING MATERIALS & INSTALLATION SHALL CONFORM TO O.B.C.
- 2.9. GRADING**
- 1) THE BUILDING SHALL BE LOCATED OR THE BUILDING SITE GRADED SO THE WATER WILL NOT ACCUMULATE AT OR NEAR THE BUILDING AND WILL NOT ADVERSELY AFFECT ADJACENT PROPERTIES. CONFORM TO 9.14.6.

- 2.10. ULC SPECIFIED ASSEMBLIES**
- ALL REQUIRED INDIVIDUAL COMPONENTS THAT FORM PART OF ANY '*ULC LISTED ASSEMBLY*', SPECIFIED WITHIN THESE DRAWINGS, CANNOT BE ALTERED OR SUBSTITUTED FOR ANY OTHER MATERIAL/PRODUCT OR SPECIFIED MANUFACTURER THAT IS IDENTIFIED IN THAT '*SPECIFIED ULC LISTING*'. THERE SHALL BE NO DEVIATIONS UNDER ANY CIRCUMSTANCES IN ANY '*ULC LISTED ASSEMBLY*' IDENTIFIED IN THESE DRAWINGS.

SECTION 3.0. LEGEND

3.1. WOOD LINTELS AND BUILT-UP WOOD (DIVISION B PART 9, TABLE A8 TO A10 AND A12, A15 & A16) FORMING PART OF SENTENCE 9.23.4.2.(3), 9.23.4.2.(4), 9.23.12.3.(1),(3), 9.23.13.8.(2), 9.37.3.1.(1)					
L1	2"x8" SPRUCE #2	2"x10" SPRUCE #2	2"x12" SPRUCE #2		
B1	2/2"x8" (2/38x184)	L3 2/2"x10" (2/38x235)	L5 2/2"x12" (2/38x286)		
	3/2"x8" (3/38x184)	B3 3/2"x10" (3/38x235)	B5 3/2"x12" (3/38x286)		
B2	4/2"x8" (4/38x184)	B4 4/2"x10" (4/38x235)	B6 4/2"x12" (4/38x286)		
B7	5/2"x8" (5/38x184)	B8 5/2"x10" (5/38x235)	B9 5/2"x12" (5/38x286)		
ENGINEERED LUMBER SCHEDULE					
	1 3/4" x 9 1/2" LVL	1 3/4" x 11 7/8" LVL	1 3/4" x 14" LVL		
LVL2	1-1 3/4"x9 1/2"	LVL3 1-1 3/4"x11 7/8"	LVL10 1-1 3/4"x14"		
LVL4	2-1 3/4"x9 1/2"	LVL6 2-1 3/4"x11 7/8"	LVL11 2-1 3/4"x14"		
LVL5	3-1 3/4"x9 1/2"	LVL7 3-1 3/4"x11 7/8"	LVL12 3-1 3/4"x14"		
LVL8	4-1 3/4"x9 1/2"	LVL9 4-1 3/4"x11 7/8"	LVL13 4-1 3/4"x14"		
3.2. STEEL LINTELS SUPPORTING MASONRY VENEER (DIVISION B PART 9, TABLE 9.20.5.2.B.) FORMING PART OF SENTENCE 9.20.5.2.(2) & 9.20.5.2.(3)					
CODE	SIZE	BRICK	STONE		
L7	3 1/2" x 3 1/2" x 1/4" (89 x 89 x 6.4)	8'-1" (2.47m)	7'-6" (2.30m)		
L8	4" x 3 1/2" x 1/4" (102 x 89 x 6.4)	8'-9" (2.66m)	8'-1" (2.48m)		
L9	4 7/8" x 3 1/2" x 5/16" (127 x 89 x 7.9)	10'-10" (3.31m)	10'-1" (3.03m)		
L10	4 7/8" x 3 1/2" x 3/8" (127 x 89 x 11)	11'-5" (3.48m)	10'-7" (3.24m)		
L11	5 7/8" x 3 1/2" x 3/8" (152 x 89 x 11)	12'-6" (3.82m)	11'-7" (3.54m)		
L12	7 1/8" x 4" x 3/8" (178 x 102 x 11)	14'-1" (4.30m)	13'-1" (3.99m)		

3.3. DOOR SCHEDULE					
CONFORMING TO SECTIONS 9.5.11, 9.6., 9.7.2.1, 9.7.5.2, & 9.10.13.10					
1	EXTERIOR	2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45)	INSULATED MIN. R4 (RSI 0.7)		
1A	EXTERIOR	2'-10" x 6'-8" x 1-3/4" (865 x 2030 x 45)	INSULATED MIN. R4 (RSI 0.7)		
1B	EXTERIOR	3'-0" x 6'-8" x 1-3/4" (915 x 2030 x 45)	INSULATED MIN. R4 (RSI 0.7)		
1C	EXTERIOR	2'-6" x 6'-8" x 1-3/4" (760 x 2030 x 45)	INSULATED MIN. R4 (RSI 0.7)		
1D	EXTERIOR	2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45)	INS. MIN. R4 (RSI 0.7) (SEE HEX NOTE 20)		
1E	EXTERIOR	3'-0" x 8'-0" x 1-3/4" (915 x 2440 x 45)	INSULATED MIN. R4 (RSI 0.7)		
1F	EXTERIOR	2'-8" x 8'-0" x 1-3/4" (815 x 2440 x 45)	INSULATED MIN. R4 (RSI 0.7)		
2A	EXTERIOR	2'-8" x 6'-8" x 1-3/4" (815 x 2030 x 45)	20 MIN. F.R.R. DOOR/FRAME WITH APP. SELF CLOSING DEVICE.		
2	INTERIOR	2'-8" x 6'-8" x 1-3/8" (815 x 2030 x 35)	PROVIDE 8'-0" HIGH INTERIOR DOORS FOR ALL 10' CEILING CONDITIONS		
3	INTERIOR	2'-6" x 6'-8" x 1-3/8" (760 x 2030 x 35)			
3A	INTERIOR	2'-4" x 6'-8" x 1-3/8" (710 x 2030 x 35)			
4	INTERIOR	2'-0" x 6'-8" x 1-3/8" (610 x 2030 x 35)			
4A	INTERIOR	2'-2" x 6'-8" x 1-3/8" (660 x 2030 x 35)			
5	INTERIOR	1'-6" x 6'-8" x 1-3/8" (460 x 2030 x 35)			

3.4. ACRONYMS			
AFF	ABOVE FINISHED FLOOR	JST	JOIST
BBFM	BEAM BY FLOOR MANUFACTURER	LIN	LINEN CLOSET
BG	FIXED GLASS W/ BLACK BACKING	LVL	LAMINATED VENEER LUMBER
BM	BEAM	OTB/A	OPEN TO BELOW/ABOVE
BBRM	BEAM BY ROOF MANUFACTURER	PL	POINT LOAD
CRF	CONVENTIONAL ROOF FRAMING	PLT	PLATE
C/W	COMPLETE WITH	PT	PRESSURE TREATED
DJ/TJ	DOUBLE JOIST/ TRIPLE JOIST	PTD	PAINTED
DO	DO OVER	PWD	POWDER ROOM
DRP	DROPPED	RWL	RAIN WATER LEADER
ENG	ENGINEERED	SB	SOLID BEARING WOOD POST
EST	ESTIMATED	SBFA	SB FROM ABOVE
FA	FLAT ARCH	SJ	SINGLE JOIST
FD	FLOOR DRAIN	SPR	SPRUCE
FG	FIXED GLASS	STL	STEEL
FL	FLUSH	T/O	TOP OF
FLR	FLOOR	TYP	TYPICAL
GT	GIRDER TRUSS	U/S	UNDERSIDE
HB	HOSE BIB	WD	WOOD
HRV	HEAT RETURN VENTILATION UNIT	WIC	WALK IN CLOSET
HWT	HOT WATER TANK	WP	WEATHER PROOF

3.5. SYMBOLS			
ALL ELECTRICAL FACILITIES SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 9.34.			
	CLASS 'B' VENT		EXHAUST VENT
	DUPLEX OUTLET (12" HIGH)		DUPLEX OUTLET (HEIGHT AS NOTED A.F.F.)
	HEAVY DUTY OUTLET		SWITCH (2/3/4 WAY)
	POT LIGHT		LIGHT FIXTURE (CEILING MOUNTED)
	LIGHT FIXTURE (PULL CHAIN)		LIGHT FIXTURE (WALL MOUNTED)
	CABLE T.V. JACK		TELEPHONE JACK
	CENTRAL VACUUM OUTLET		CHANDELIER (CEILING MOUNTED)

- SA **SMOKE ALARM** (9.10.19.)
PROVIDE ONE PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL. ALARMS ARE TO BE INSTALLED IN EACH SLEEPING ROOM AND IN A LOCATION BETWEEN SLEEPING ROOMS AND CONNECTING HALLWAYS AND WIRED TO BE INTERCONNECTED TO ACTIVATE ALL ALARMS IF ONE SOUNDS. ALARMS ARE TO BE CONNECTED TO AN ELECTRICAL CIRCUIT AND WITH A BATTERY BACKUP. ALARM SIGNAL SHALL MEET TEMPORAL SOUND PATTERNS MIN. ALARMS SHALL HAVE A VISUAL SIGNALLING COMPONENT AS PER THE "NATIONAL FIRE ALARM AND SIGNALING CODE 72".

- ⚠ CMD **CARBON MONOXIDE ALARM** (9.33.4.)
** CHECK LOCAL BY-LAWS FOR REQUIREMENTS ** A CARBON MONOXIDE ALARM(S) CONFORMING TO CAN/CGA-6.19 SHALL BE INSTALLED ON OR NEAR THE CEILING IN EACH DWELLING UNIT ADJACENT TO EACH SLEEPING AREA. CARBON MONOXIDE ALARM(S) SHALL BE PERMANENTLY WIRED WITH NO DISCONNECT SWITCH, WITH AN ALARM THAT IS AUDIBLE WITHIN SLEEPING ROOMS WHEN THE INTERVENING DOORS ARE CLOSED.

- ☑ SB **SOLID BEARING (BUILT-UP WOOD COLUMNS AND STUD POSTS)**
THE WIDTH OF A WOOD COLUMN SHALL NOT BE LESS THAN THE WIDTH OF SUPPORTED MEMBER. BUILT-UP WOOD COLUMNS SHALL BE NAILED TOGETHER WITH NOT LESS THAN 3" (76) NAILS SPACED NOT MORE THAN 11 3/4" (300) O.C. THE NUMBER OF STUDS IN A WALL DIRECTLY BELOW A GRIDER TRUSS OR ROOF BEAM SHALL CONFORM TO TABLES A-34 TO A-37. (9.17.4., 9.23.10.7.)

	TWO STOREY VOLUME SPACE. SEE CONSTRUCTION NOTE 39.
	VARYING PLATES, BUILT-OUT FLOORS, BEARING WALLS