



Job Track: **51004**

Plan Log: **203043**


Layout ID: **418924**

Builder / Location:			
ROYAL PINE HOMES / RICHMOND HILL			
Project: CENTREFIELD			
Date:	2021-06-04	Sales:	Mario DiCano
		Designer:	JG
THESE DRAWINGS OR REDISTRIBUTED WITHOUT THE WRITTEN PERMISSION OF TMAPROCK PAPERROCK			

Model / Elevation:

UNIT - 4500 / A

Mitek ver 8.4.2.286

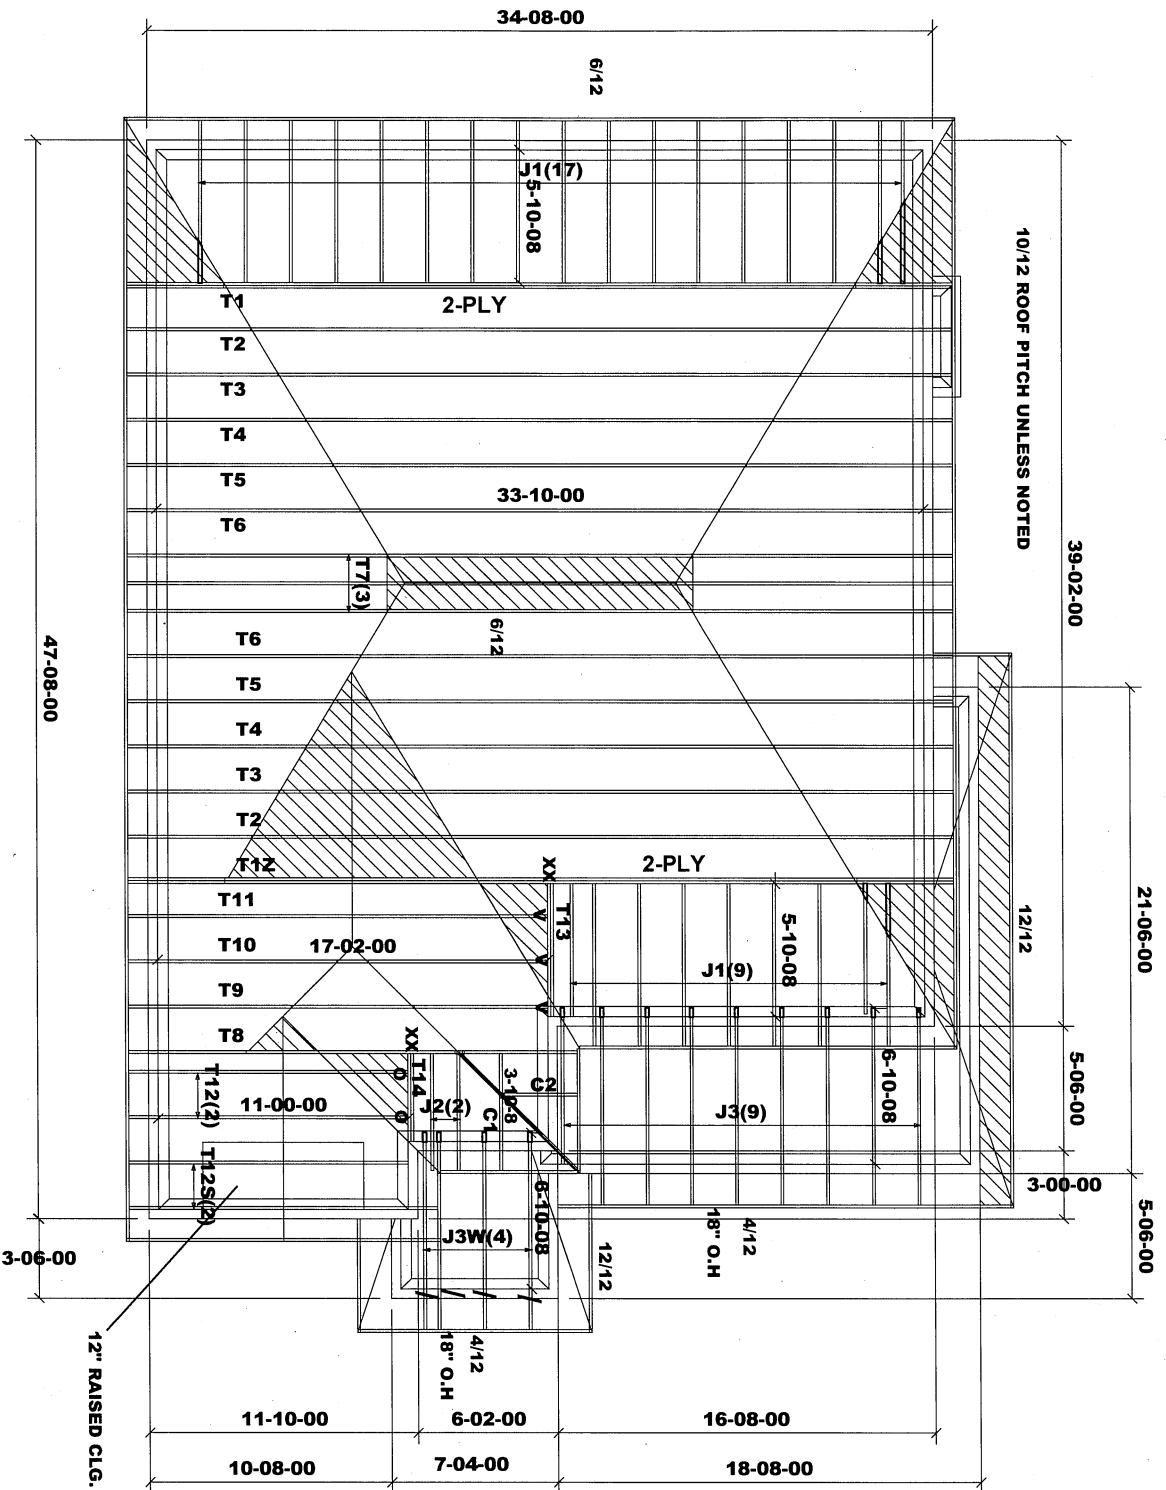

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post and points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TCSL = 25.6 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
H2.5T - (I)

DENOTES:
CONVENTIONAL
FRAMING

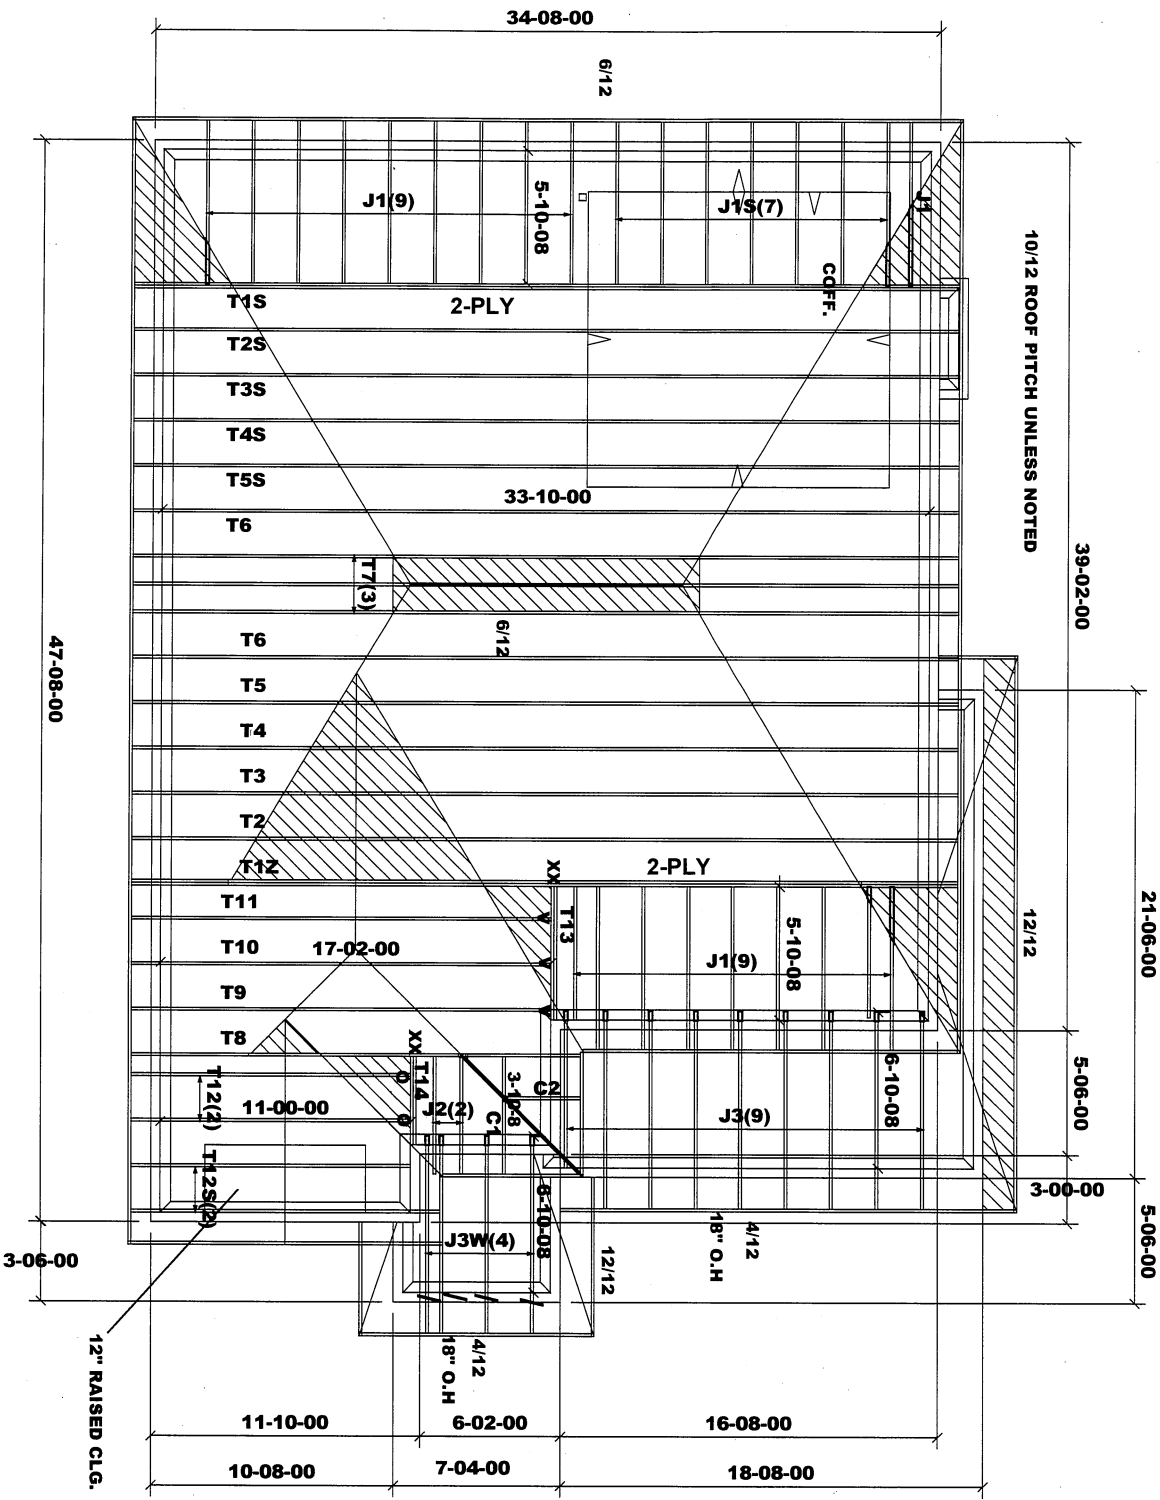

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
H2.5T - (I)

 DENOTES:
CONVENTIONAL FRAMING

M14081



TAMARACK ROOF TRUSSES INC.

Job Track: **51004**

Plan Log: **203043**

Layout ID: **410887**

Builder / Location: **ROYAL PINE HOMES / RICHMOND HILL**

Project: **CENTREFIELD**

Date: **2021-06-04**


Sales: **Mario DiCano**

Designer: **JG**

Model / Elevation: **UNIT - 4500 / A-OPT.**

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Milek ver 8.4.2.286

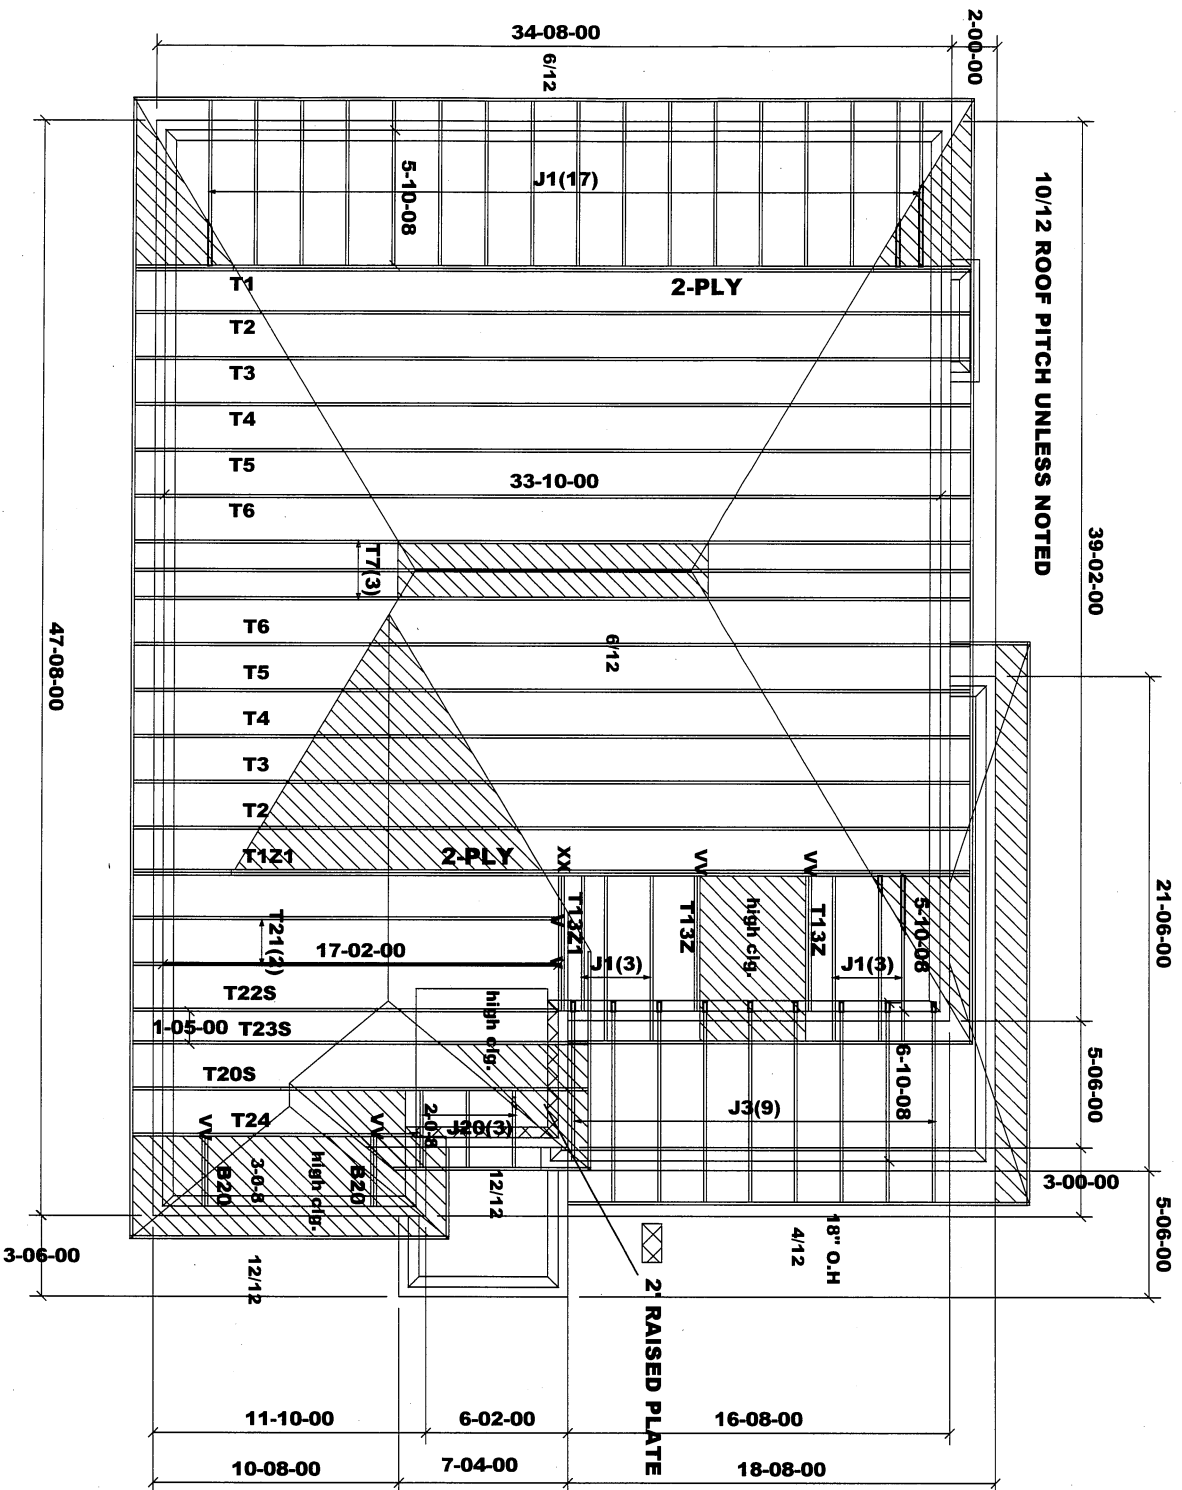

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9

Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:


TCSL = 25.6 psf
TCDL = 6.0 psf
BCIL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:

LUS24 - (O)
LUS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

BEAMS:

B20 = 2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

M14034




TAMARACK
ROOF TRUSSES INC.
1800 JEFFERSON AVE
TAMARACK, ALABAMA 36081

Job Track: **51004**
Plan Log: **203043**
Layout ID: **418925**

Builder / Location:
ROYAL PINE HOMES / RICHMOND HILL
Project: **CENTREFIELD**
Date: **2021-06-04**
Sales: **Mario DiCano**
Designer: **JG**

Model / Elevation:
UNIT - 4500 / B

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC. AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

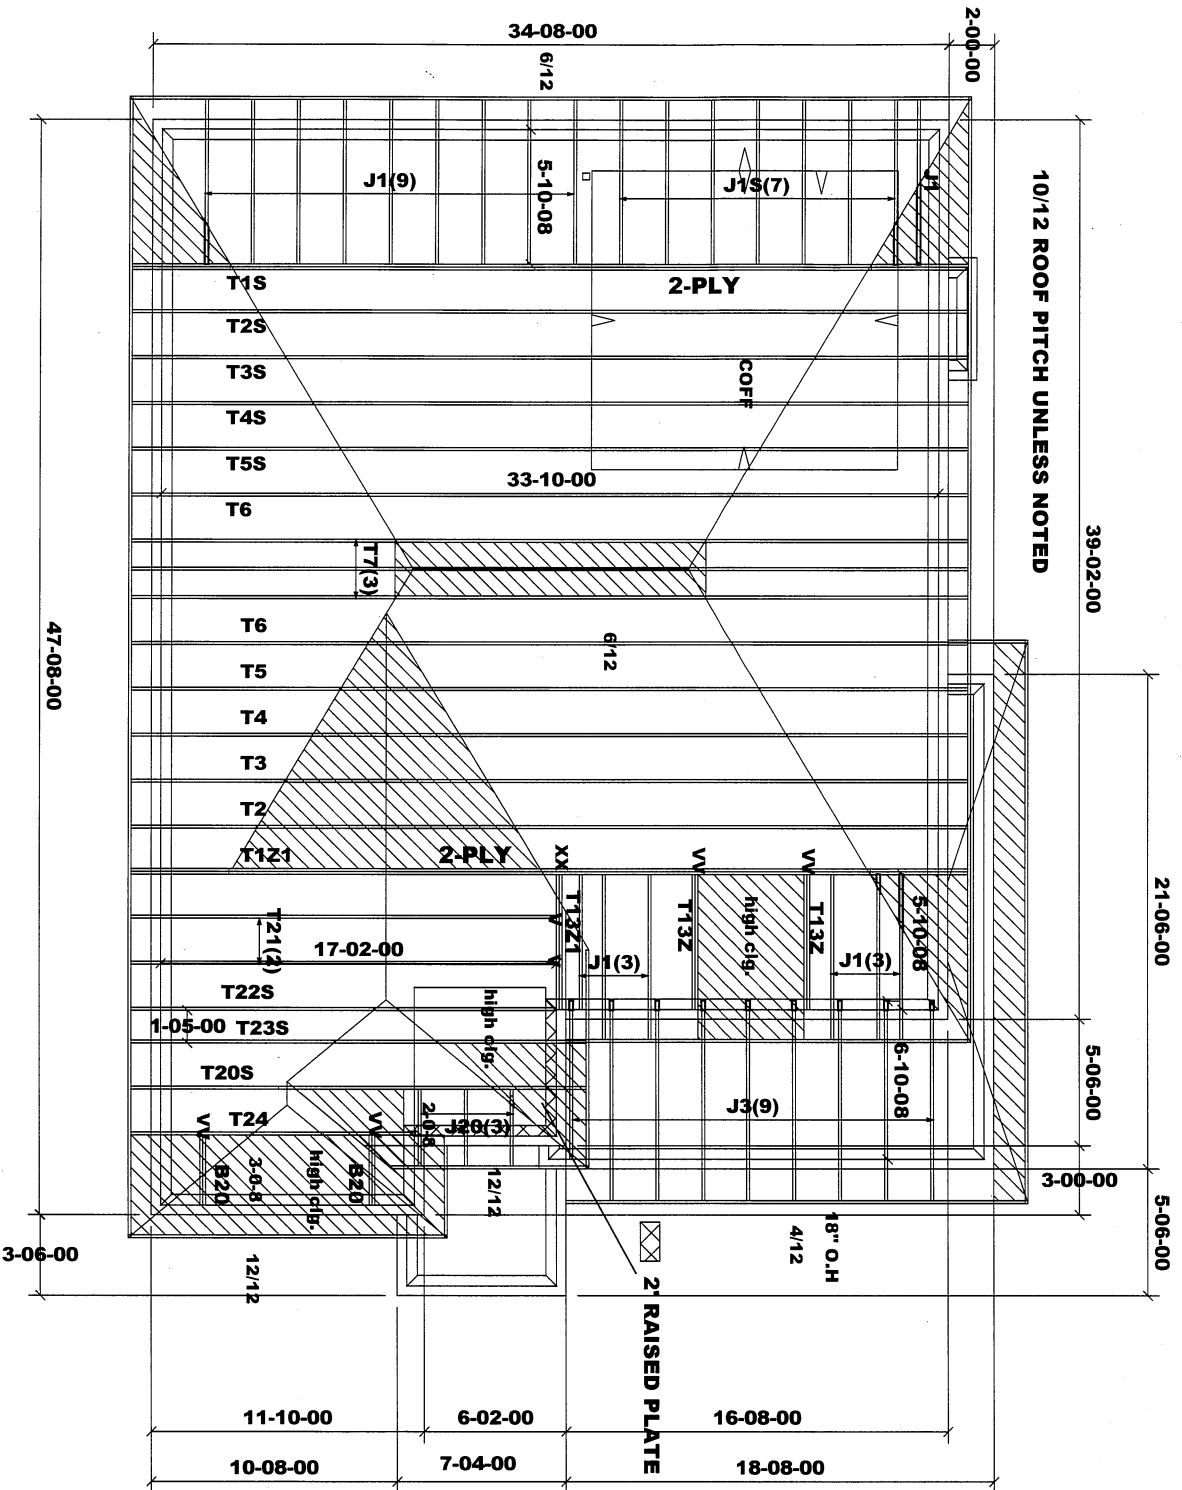

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9

Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TC SL = 25.6 psf
TC DL = 6.0 psf
BC LL = 0.0 psf
BC DL = 7.4 psf

HARDWARE:

LUS24 - (O)
LUS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

BEAMS:

B20 = 2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

M14034



TAMARACK
ROOF TRUSSES INC.


Job Track: 51004
Plan Log: 203043
Layout ID: 410888

Builder / Location:
ROYAL PINE HOMES / RICHMOND HILL
Project: CENTREFIELD
Date: 2021-06-04
Sales: Mario DiCarno
Designer: JG

Model / Elevation:
UNIT - 4500 / B-OPT.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Milek ver 6.4.2.286

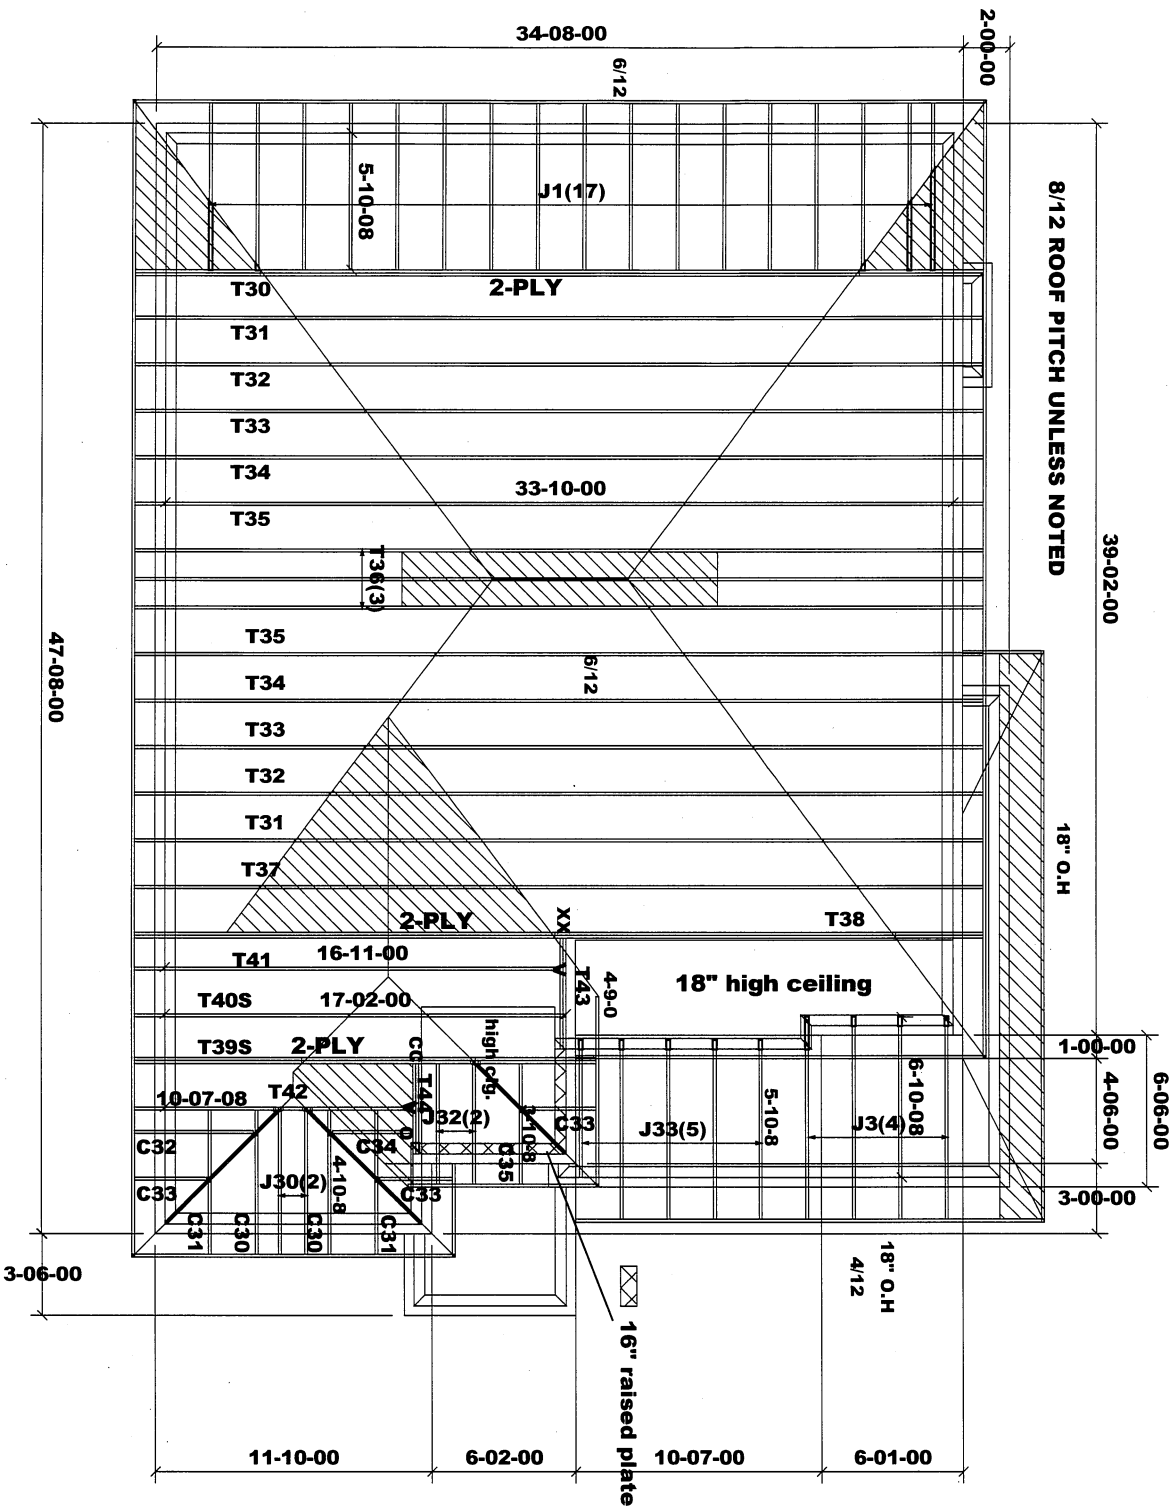


ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)
HUSC-2 - (CC)

 DENOTES:
CONVENTIONAL
FRAMING

M14034

		Job Track: 51004 Plan Log: 203043 Layout ID: 418926		Builder / Location: ROYAL PINE HOMES / RICHMOND HILL		Model / Elevation: UNIT - 4500 / C	
Project: CENTREFIELD Date: 2021-06-04		Sales: Mario DiCano Designer: JG		THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.			
Mitek ver 8.4.2.286							



TAMARACK
ROOF TRUSSES INC.

Job Track: **51004**

Plan Log: **203043**

Layout ID: **410889**

Builder / Location:		ROYAL PINE HOMES / RICHMOND HILL	
Project:		CENTREFIELD	
Date:	2021-06-04	Sales:	Mario DiCanno
		Designer:	JG TAVARRACK


Model / Elevation:

UNIT - 4500 / C-OPT.

NOTE THE PROPERTY OF TAMARACK ROOF TRIM SHALL NOT BE USED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THAT SPECIFIED HEREIN AND WILL BE RETRACTED BY TAMARACK ROOF TRIM.

TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM THE MANUFACTURER OF TRUSSES BY MTLK, INC. NO PART OF THIS PUBLICATION MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM THE MANUFACTURER OF TRUSSES BY MTLK, INC. IF UTILIZED FOR ANY OTHER PURPOSE, THE USER ASSUMES ALL LIABILITY.

Mtlk, Inc. 847 296

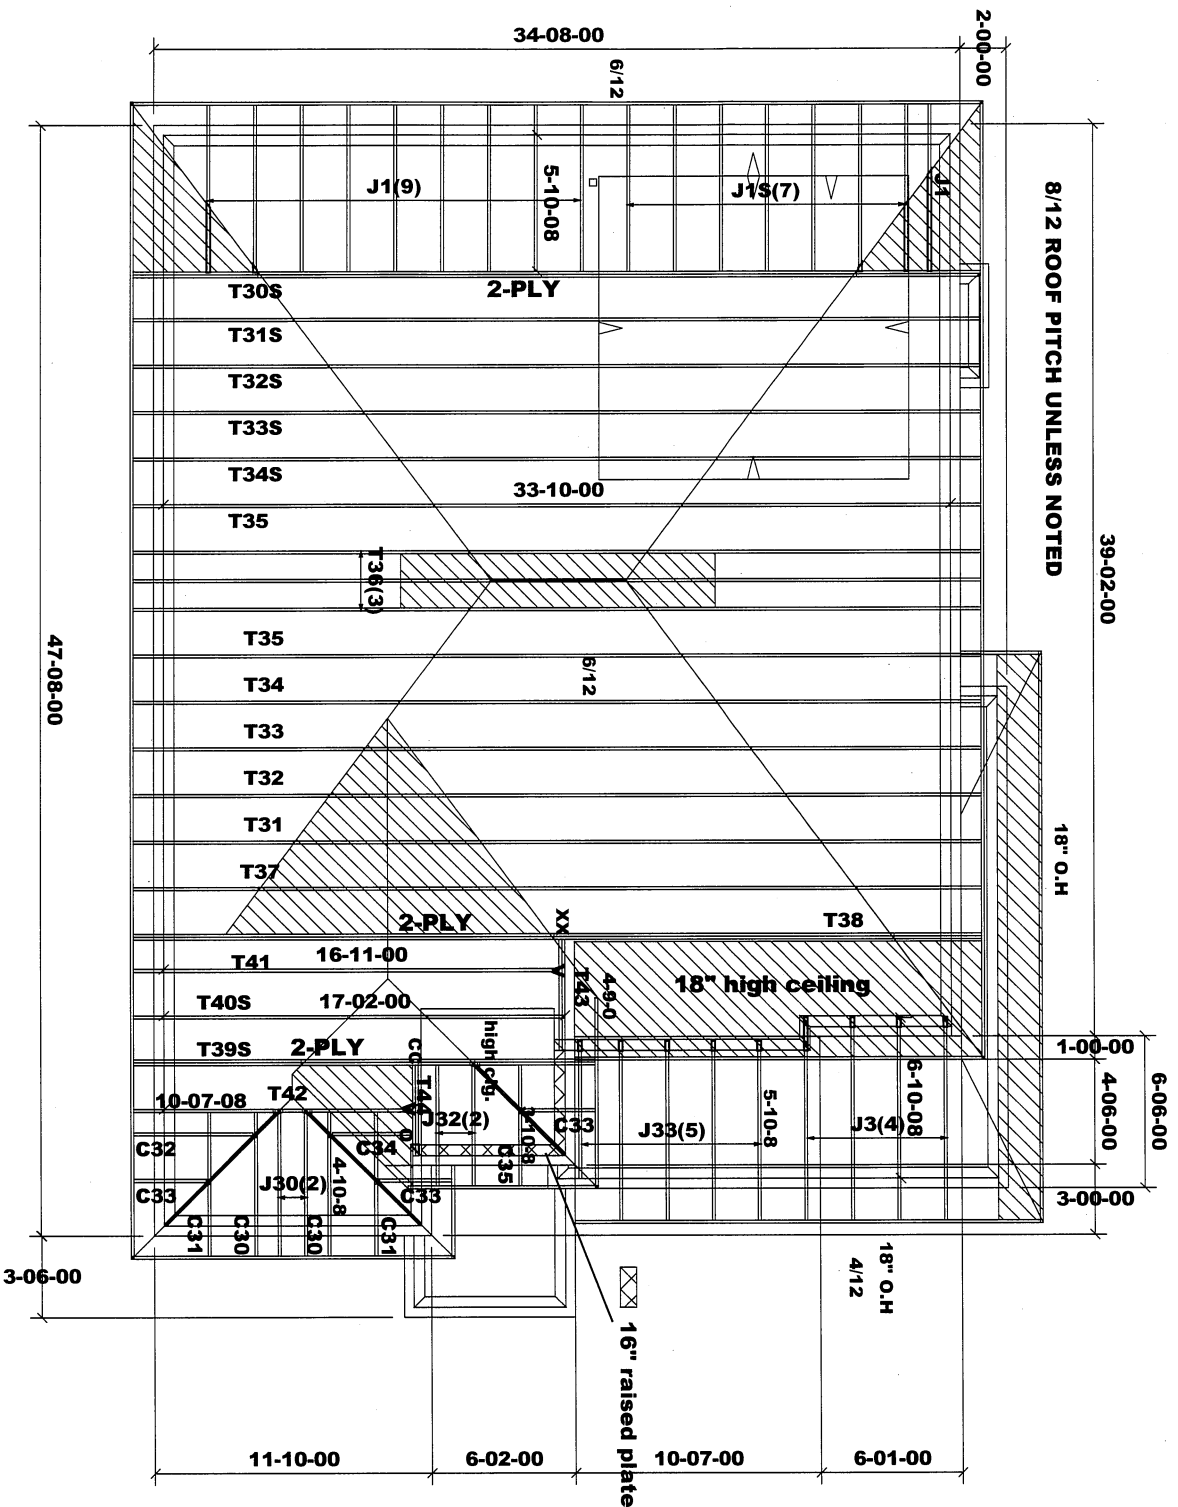

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:

RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TCSL = 25.6 psf

ICDL = 6.0 p
BCIL = 0.0 p

BCDL = 7.4 psf

HARDWARE:

LUS24 - (O)


LJS26DS - (V)

HGUS26-2 - (XX)
HUSC-2 - (CC)

DENOTES:
CONVENTIONAL
FRAMING

Mitek ver 8.4.2.286

DELIVERY SHIPLIST

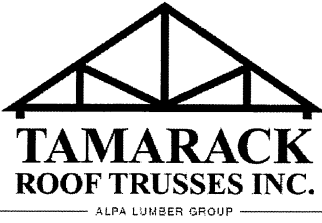


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: A







Job Track: 51004
 PlanLog: 203043
 Layout ID: 418924
 Ref #
 Page: 1 of 2
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 /12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	386.21 229.33		
	1 2-ply	T1Z Hip Girder	10 /12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	353.8 210.00		
	2	T2 Hip	10 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	273.97 173.67		
	2	T3 Hip	10 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	288.83 180.67		
	2	T4 Hip	10 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.3 186.00		
	2	T5 Hip	10 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	311.55 196.67		
	2	T6 Hip	10 /12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.03 202.33		
	3	T7 Hip	10 /12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	508.24 318.00		
	1	T8 Hip Girder	10 /12	17-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	87.41 56.50		
	1	T9 Hip	10 /12	17-02-00	6-06-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	75.68 48.00		
	1	T10 Hip	10 /12	17-02-00	8-02-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	89 57.33		
	1	T11 Common	10 /12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	84.05 54.33		
	2	T12 Common	10 /12	11-00-00	6-02-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	98.18 64.67		
	2	T12S Roof Special	10 /12	11-00-00	6-02-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	116.07 78.33		

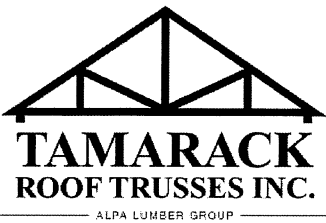 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: A	Job Track: 51004 PlanLog: 203043 Layout ID: 418924 Ref # Page: 2 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T13 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.65 37.00		
	1 2-ply	T14 Jack-Closed Girder	10 /12	3-10-08	4-10-07	2 x 4 2 x 6		1-07-11 4-10-07	43.15 29.33		
	26	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	436.71 277.33		
	2	J2 Jack-Open	10 /12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	31.15 20.33		
	9	J3 Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	220.24 144.00		
	4	J3W Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	97.89 64.00		
	1	C1 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-11-09	1-07-11 3-02-13	12.28 8.33		
	1	C2 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-01	1-07-11 3-02-13	10.14 7.00		


TOTAL # TRUSS= 72 TOTAL BFT OF ALL TRUSSES= 2643.15 BFT. TOTAL WEIGHT OF ALL TRSSES 4205.53 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	H2.5T	
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 11

DELIVERY SHIPLIST

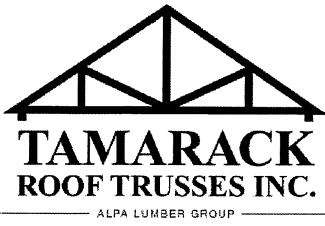


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: A-OPT.

Job Track: 51004
 PlanLog: 203043
 Layout ID: 410887
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1Z Hip Girder	10 / 12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	386.21 229.33		
	1 2-ply	T1S Hip Girder	10 / 12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	414.09 252.00		
	1	T2 Hip	10 / 12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	136.98 86.83		
	1	T2S Hip	10 / 12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	151.39 97.83		
	1	T3 Hip	10 / 12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	144.41 90.33		
	1	T3S Hip	10 / 12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	157.81 101.00		
	1	T4 Hip	10 / 12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	151.77 94.67		
	1	T4S Hip	10 / 12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	170.44 106.83		
	1	T5 Hip	10 / 12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	159.39 100.33		
	1	T5S Hip	10 / 12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	170.13 108.83		
	2	T6 Hip	10 / 12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.03 202.33		
	3	T7 Hip	10 / 12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	508.24 318.00		
	1	T8 Hip Girder	10 / 12	17-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	87.41 56.50		
	1	T9 Hip	10 / 12	17-02-00	6-06-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	75.68 48.00		

DELIVERY SHIPLIST

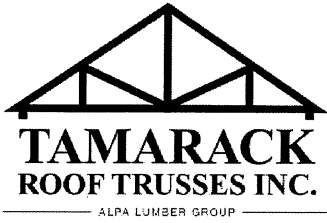

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: A-OPT.

Job Track: 51004
 PlanLog: 203043
 Layout ID: 410887
 Ref #
 Page: 2 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T10 Hip	10 /12	17-02-00	8-02-07	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	89.47 58.00		
	1	T11 Common	10 /12	17-02-00	8-09-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	84.05 54.33		
	2	T12 Common	10 /12	11-00-00	6-02-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	98.18 64.67		
	2	T12S Roof Special	10 /12	11-00-00	6-02-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	116.07 78.33		
	1 2-ply	T13 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.65 37.00		
	1 2-ply	T14 Jack-Closed Girder	10 /12	3-10-08	4-10-07	2 x 4 2 x 6		1-07-11 4-10-07	43.15 29.33		
	19	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	319.13 202.67		
	7	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	148.74 106.17		
	2	J2 Jack-Open	10 /12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	31.15 20.33		
	9	J3 Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	223.05 144.00		
	4	J3W Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	99.13 64.00		
	1	C1 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-11-09	1-07-11 3-02-13	12.28 8.33		
	1	C2 Jack-Open	10 /12	1-10-15	3-02-13	2 x 4	1-03-08 1-01	1-07-11 3-02-13	10.14 7.00		

TOTAL # TRUSS= 72

TOTAL BFT OF ALL TRUSSES= 2766.97

BFT.

TOTAL WEIGHT OF ALL TRSSES 4372.19 LBS

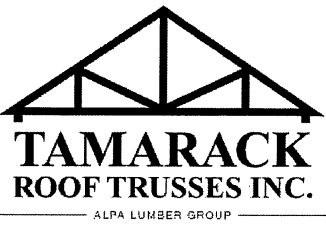
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard:	TAMARACK LUMBER
	Builder:	ROYAL PINE HOMES
	Project:	CENTREFIELD
	Location:	RICHMOND HILL
	Model:	UNIT - 4500
	Lot #:	
	Elevation:	A-OPT.
	Job Track:	51004
	PlanLog:	203043
	Layout ID:	410887
	Ref #	
	Page:	3 of 3
	Date:	06-04-2021
	Designer:	
	Sales Rep:	Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	H2.5T	
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 11



DELIVERY SHIPLIST

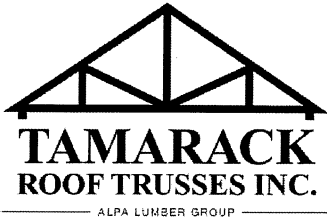


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: B



Job Track: 51004
 PlanLog: 203043
 Layout ID: 418925
 Ref #
 Page: 1 of 2
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 / 12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	353.8 210.00		
	1 2-ply	T1Z1 Hip Girder	10 / 12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	353.8 210.00		
	2	T2 Hip	10 / 12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	273.97 173.67		
	2	T3 Hip	10 / 12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	288.83 180.67		
	2	T4 Hip	10 / 12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.3 186.00		
	2	T5 Hip	10 / 12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	311.55 196.67		
	2	T6 Hip	10 / 12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.03 202.33		
	3	T7 Hip	10 / 12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	508.24 318.00		
	2 2-ply	T13Z Jack-Closed	6 / 12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	115.31 74.00		
	1 2-ply	T13Z1 Jack-Closed Girder	6 / 12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.65 37.00		
	1	T20S Hip Girder	10 / 12	17-02-00	5-11-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	83.89 54.33		
	2	T21 Common	10 / 12	17-02-00	9-09-08	2 x 4	1-03-08	1-07-11 3-07-11	170.42 108.33		
	1	T22S Hip	10 / 12	17-02-00	9-04-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	98.57 62.50		
	1	T23S Hip	10 / 12	17-02-00	7-11-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	93.01 60.00		

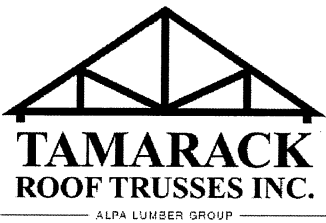 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: B	Job Track: 51004 PlanLog: 203043 Layout ID: 418925 Ref # Page: 2 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T24 Hip Girder	10 /12	11-00-00	4-11-00	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	58.75 39.50		
	23	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	386.32 245.33		
	9	J3 Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	220.24 144.00		
	3	J20 Jack-Open	12 /12	1-10-08	3-09-00	2 x 4	1-03-08	1-10-08 3-09-00	32.47 21.00		

TOTAL # TRUSS= 64 TOTAL BFT OF ALL TRUSSES= 2523.33 BFT. TOTAL WEIGHT OF ALL TRSSES 4030.14 LBS







HARDWARE


QTY	TYPE	MODEL	LENGTH
2	Hardware	LJS26DS	
4	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 7



DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER	Job Track:	51004
	Builder:	ROYAL PINE HOMES	PlanLog:	203043
	Project:	CENTREFIELD	Layout ID:	410888
	Location:	RICHMOND HILL	Ref #	
	Model:	UNIT - 4500	Page:	1 of 2
	Lot #:		Date:	06-04-2021
	Elevation:	B-OPT.	Designer:	
		Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	10 /12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	383.17 233.00		
	1 2-ply	T1Z1 Hip Girder	10 /12	33-10-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	386.21 229.33		
	1	T2 Hip	10 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	136.98 86.83		
	1	T2S Hip	10 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	151 97.50		
	1	T3 Hip	10 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	144.41 90.33		
	1	T3S Hip	10 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	157.81 101.00		
	1	T4 Hip	10 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	148.65 93.00		
	1	T4S Hip	10 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	164.77 103.67		
	1	T5 Hip	10 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	155.77 98.33		
	1	T5S Hip	10 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	163.54 105.17		
	2	T6 Hip	10 /12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.03 202.33		
	3	T7 Hip	10 /12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	508.24 318.00		
	2 2-ply	T13Z Jack-Closed	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	115.31 74.00		
	1 2-ply	T13Z1 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.65 37.00		

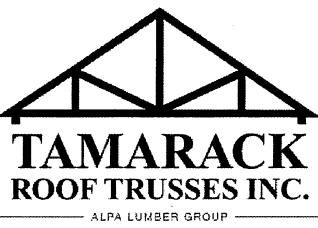 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST									
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: B-OPT.					Job Track: 51004 PlanLog: 203043 Layout ID: 410888 Ref # Page: 2 of 2 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano				

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T20S Hip Girder	10 / 12	17-02-00	5-11-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	83.89 54.33		
	2	T21 Common	10 / 12	17-02-00	9-09-08	2 x 4	1-03-08	1-07-11 3-07-11	170.42 108.33		
	1	T22S Hip	10 / 12	17-02-00	9-04-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	98.57 62.50		
	1	T23S Hip	10 / 12	17-02-00	7-11-00	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	93.01 60.00		
	1	T24 Hip Girder	10 / 12	11-00-00	4-11-00	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	58.75 39.50		
	16	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.74 170.67		
	7	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	148.74 106.17		
	9	J3 Jack-Open	4 / 12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	220.24 144.00		
	3	J20 Jack-Open	12 / 12	1-10-08	3-09-00	2 x 4	1-03-08	1-10-08 3-09-00	32.47 21.00		


TOTAL # TRUSS= 64 TOTAL BFT OF ALL TRUSSES= 2635.99 BFT. TOTAL WEIGHT OF ALL TRSSES 4174.38 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LJS26DS	
4	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 7

DELIVERY SHIPLIST

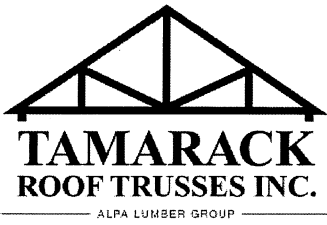


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: C












Job Track: 51004
 PlanLog: 203043
 Layout ID: 418926
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	8 /12	33-10-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	334.96 200.00		
	2	T31 Hip	8 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	272.01 171.67		
	2	T32 Hip	8 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	280.09 175.00		
	2	T33 Hip	8 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	301.67 190.33		
	2	T34 Hip	8 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	295.67 182.00		
	2	T35 Hip	8 /12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	308.66 190.33		
	3	T36 Hip	8 /12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	480.94 300.00		
	1	T37 Hip	8 /12	33-10-00	4-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	133.28 84.17		
	1 2-ply	T38 Roof Special Girder	8 /12	33-10-00	7-09-10	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	374.15 231.00		
	1 2-ply	T39S Hip Girder	8 /12	17-02-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	195.99 123.67		
	1	T40S Hip	8 /12	17-02-00	6-07-13	2 x 4	1-03-08	1-04-13 1-04-13	85 54.33		
	1	T41 Common	8 /12	16-11-00	7-09-08	2 x 4	1-03-08	1-04-13 2-10-13	77.4 50.50		
	1	T42 Hip Girder	8 /12	10-07-08	4-07-13	2 x 4	1-03-08	1-04-13 1-07-13	48.44 32.50		
	1 2-ply	T43 Flat Girder	0 /12	4-09-00	1-04-00	2 x 6		1-04-00 1-04-00	42.76 27.67		

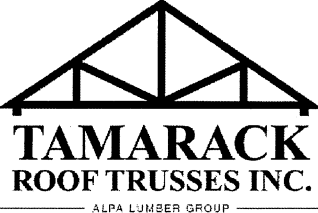 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: C	Job Track: 51004 PlanLog: 203043 Layout ID: 418926 Ref # Page: 2 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano		

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T44 Jack-Closed Girder	8 /12	3-10-08	5-03-13	2 x 4 2 x 6		2-08-13 5-03-13	46.45 29.33		
	17	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	285.54 181.33		
	4	J3 Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	97.89 64.00		
	2	J30 Jack-Open	8 /12	4-10-08	4-07-13	2 x 4	1-03-08	1-04-13 4-07-13	34.13 21.67		
	2	J32 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	28.34 18.00		
	5	J33 Jack-Open	4 /12	5-10-08	3-00-11	2 x 4	1-09-08	1-01-03 3-00-11	83.53 53.33		
	2	C30 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 11-09	1-04-13 4-00-02	31.49 20.33		
	2	C31 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 2-11-09	1-04-13 2-08-02	25.17 16.67		
	1	C32 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.11 7.67		
	3	C33 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	27.92 19.00		
	1	C34 Jack-Open	8 /12	1-06-00	3-11-02	2 x 4	1-10-15	1-07-13 2-07-13	9.19 7.00		
	1	C35 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 2-01-01	1-04-13 2-07-02	11.19 7.00		

TOTAL # TRUSS= 67 TOTAL BFT OF ALL TRUSSES= 2458.5 BFT. TOTAL WEIGHT OF ALL TRSSES 3923.97 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: C	Job Track: 51004 PlanLog: 203043 Layout ID: 418926 Ref # Page: 3 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LJS26DS	
1	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 5

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: UNIT - 4500
 Lot #:
 Elevation: C-OPT.








Job Track: 51004
 PlanLog: 203043
 Layout ID: 410889
 Ref #
 Page: 1 of 3
 Date: 06-04-2021
 Designer:
 Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30S Hip Girder	8 /12	33-10-00	4-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	389.83 242.00		
	1	T31 Hip	8 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	136.01 85.83		
	1	T31S Hip	8 /12	33-10-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	147.62 93.17		
	1	T32 Hip	8 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	143.01 89.17		
	1	T32S Hip	8 /12	33-10-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	155.67 98.17		
	1	T33 Hip	8 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	150.84 95.17		
	1	T33S Hip	8 /12	33-10-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	158.09 100.50		
	1	T34 Hip	8 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	147.84 91.00		
	1	T34S Hip	8 /12	33-10-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	167.1 105.50		
	2	T35 Hip	8 /12	33-10-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	308.66 190.33		
	3	T36 Hip	8 /12	33-10-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	480.94 300.00		
	1	T37 Hip	8 /12	33-10-00	4-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	133.28 84.17		
	1 2-ply	T38 Roof Special Girder	8 /12	33-10-00	7-09-08	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	367 225.00		
	1 2-ply	T39S Hip Girder	8 /12	17-02-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	195.99 123.67		




DELIVERY SHIPLIST				
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track:	51004
	Builder:	ROYAL PINE HOMES	PlanLog:	203043
	Project:	CENTREFIELD	Layout ID:	410889
	Location:	RICHMOND HILL	Ref #	
	Model:	UNIT - 4500	Page:	2 of 3
	Lot #:		Date:	06-04-2021
	Elevation:	C-OPT.	Designer:	
		Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T40S Hip	8 /12	17-02-00	6-07-13	2 x 4	1-03-08	1-04-13 1-04-13	85 54.33		
	1	T41 Common	8 /12	16-11-00	7-09-08	2 x 4	1-03-08	1-04-13 2-10-13	77.4 50.50		
	1	T42 Hip Girder	8 /12	10-07-08	4-07-13	2 x 4	1-03-08	1-04-13 1-07-13	48.44 32.50		
	1 2-ply	T43 Flat Girder	0 /12	4-09-00	1-04-00	2 x 6		1-04-00 1-04-00	43.3 28.00		
	1 2-ply	T44 Jack-Closed Girder	8 /12	3-10-08	5-03-13	2 x 4 2 x 6		2-08-13 5-03-13	46.45 29.33		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.97 106.67		
	7	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	148.74 106.17		
	4	J3 Jack-Open	4 /12	6-10-08	3-04-11	2 x 4	1-09-08	1-01-03 3-04-11	99.13 64.00		
	2	J30 Jack-Open	8 /12	4-10-08	4-07-13	2 x 4	1-03-08	1-04-13 4-07-13	34.13 21.67		
	2	J32 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	28.34 18.00		
	5	J33 Jack-Open	4 /12	5-10-08	3-00-11	2 x 4	1-09-08	1-01-03 3-00-11	83.53 53.33		
	2	C30 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 11-09	1-04-13 4-00-02	31.49 20.33		
	2	C31 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 2-11-09	1-04-13 2-08-02	25.17 16.67		
	1	C32 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.11 7.67		

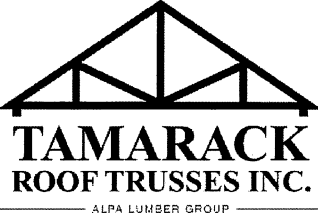 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: UNIT - 4500 Lot #: Elevation: C-OPT.	Job Track: 51004 PlanLog: 203043 Layout ID: 410889 Ref # Page: 3 of 3 Date: 06-04-2021 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	C33 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	27.92 19.00		
	1	C34 Jack-Open	8 /12	1-06-00	3-11-02	2 x 4	1-10-15	1-07-13 2-07-13	9.19 7.00		
	1	C35 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 2-01-01	1-04-13 2-07-02	11.19 7.00		

TOTAL # TRUSS= 67 TOTAL BFT OF ALL TRUSSES= 2565.85 BFT. TOTAL WEIGHT OF ALL TRSSES 4061.36 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
2	Hardware	LJS26DS	
1	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 5

JOB NAME 418924	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:13:27 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-nal4YHJKK?fi132wz?8oOFOGUhT5m4qnGu4SClazzEIDM

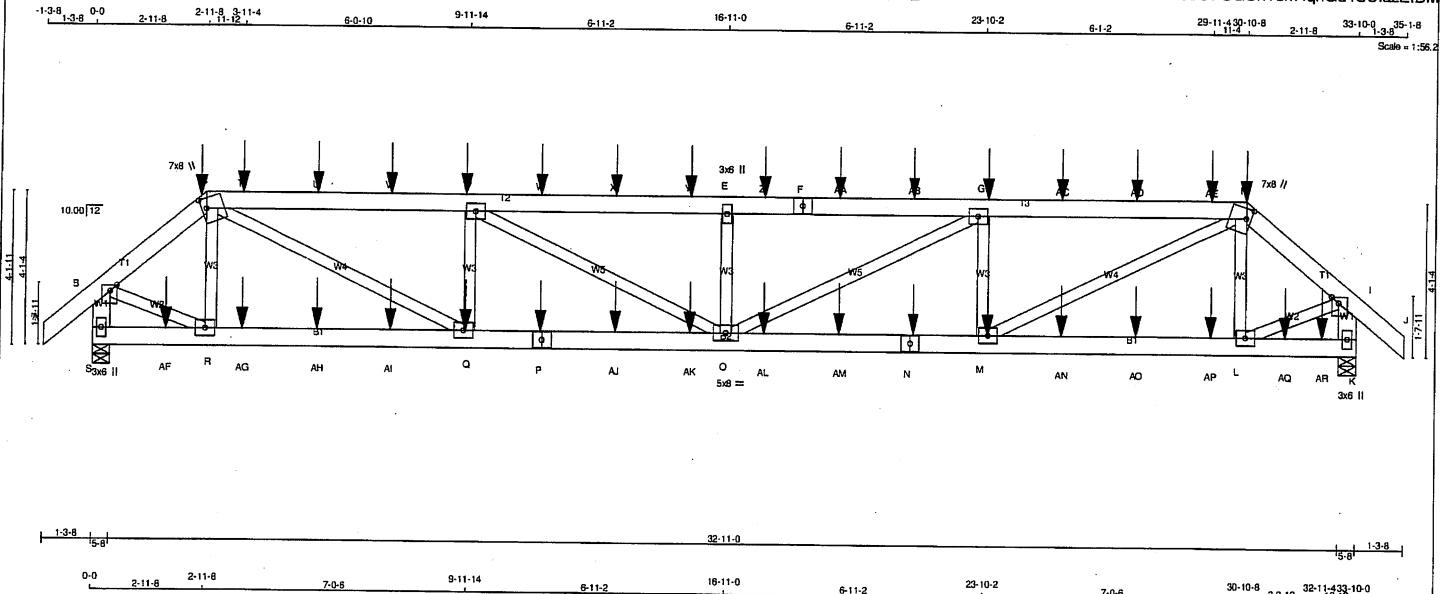

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x6	DRY	No.2	SPF	
J - L	2x6	DRY	No.2	SPF	
L - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	2	12
C - F	2	12
F - H	2	12
H - J	2	12
J - L	2	12
L - N	2	12
N - K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	2	12
P - N	2	12
N - K	2	12

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION				
JT VERT	3210	0	3210	0
S VERT	3240	0	3240	0
K VERT	3240	0	3240	0
UNFACTORED REACTIONS				
1ST LOASE				
JT COMBINED	2269	1498 / 0	0 / 0	0 / 0
S COMBINED	2292	1499 / 0	0 / 0	0 / 0
K COMBINED	2292	1499 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UPLIFT (PLF)	W E B S	MEMB.	FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UPLIFT (PLF)
FR-TO							FR-TO					
A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	0.06 (1)	R-C	-651 / 0	0.06 (1)	0.06 (1)	0.06 (1)	0.06 (1)
B-C	-3215 / 0	-91.8	-91.8	0.05 (1)	6.13	0.06 (1)	L-H	-645 / 0	0.06 (1)	0.06 (1)	0.06 (1)	0.06 (1)
C-T	-6161 / 0	-91.8	-91.8	0.33 (1)	4.49	0.23 (1)	B-R	0 / 2609	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)
T-U	-6161 / 0	-91.8	-91.8	0.33 (1)	4.49	0.23 (1)	L-I	0 / 2618	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)
U-V	-6161 / 0	-91.8	-91.8	0.33 (1)	4.49	0.37 (1)	M-H	0 / 4185	0.37 (1)	0.37 (1)	0.37 (1)	0.37 (1)
V-D	-6161 / 0	-91.8	-91.8	0.33 (1)	4.49	0.37 (1)	C-Q	0 / 4191	0.37 (1)	0.37 (1)	0.37 (1)	0.37 (1)
D-W	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16	0.15 (1)	M-G	-1710 / 0	0.15 (1)	0.15 (1)	0.15 (1)	0.15 (1)
W-X	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16	0.15 (1)	Q-D	-1712 / 0	0.15 (1)	0.15 (1)	0.15 (1)	0.15 (1)
X-Y	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16	0.11 (1)	C-G	0 / 1237	0.11 (1)	0.11 (1)	0.11 (1)	0.11 (1)
Y-E	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16	0.11 (1)	D-O	0 / 1241	0.11 (1)	0.11 (1)	0.11 (1)	0.11 (1)
E-Z	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16	0.08 (1)	O-E	-934 / 0	0.08 (1)	0.08 (1)	0.08 (1)	0.08 (1)
Z-F	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16							
F-AA	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16							
AA-AB	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16							
AB-G	-7258 / 0	-91.8	-91.8	0.36 (1)	4.16							
G-AC	-6165 / 0	-91.8	-91.8	0.33 (1)	4.49							
AC-AD	-6165 / 0	-91.8	-91.8	0.33 (1)	4.49							
AD-AE	-6165 / 0	-91.8	-91.8	0.33 (1)	4.49							
AE-H	-6165 / 0	-91.8	-91.8	0.33 (1)	4.49							
H-I	-3226 / 0	-91.8	-91.8	0.05 (1)	6.12							
I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00							
S-B	-3223 / 0	0.0	0.0	0.12 (1)	7.71							
K-I	-3234 / 0	0.0	0.0	0.12 (1)	7.71							
S-AF	0 / 0	-18.5	-18.5	0.07 (4)	10.00							
AF-R	0 / 0	-18.5	-18.5	0.07 (4)	10.00							
R-AG	0 / 2429	-18.5	-18.5	0.22 (1)	10.00							
AG-AH	0 / 2429	-18.5	-18.5	0.22 (1)	10.00							
AH-AI	0 / 2429	-18.5	-18.5	0.22 (1)	10.00							
AI-Q	0 / 2429	-18.5	-18.5	0.22 (1)	10.00							
Q-P	0 / 6161	-18.5	-18.5	0.46 (1)	10.00							
P-AJ	0 / 6161	-18.5	-18.5	0.46 (1)	10.00							
AJ-AK	0 / 6161	-18.5	-18.5	0.46 (1)	10.00							
AK-O	0 / 6161	-18.5	-18.5	0.46 (1)	10.00							
O-AL	0 / 6165	-18.5	-18.5	0.46 (1)	10.00							
AL-AM	0 / 6165	-18.5	-18.5	0.46 (1)	10.00							
AM-N	0 / 6165	-18.5	-18.5	0.46 (1)	10.00							
N-M	0 / 6165	-18.5	-18.5	0.46 (1)	10.00							
M-AN	0 / 2438	-18.5	-18.5	0.22 (1)	10.00							
AN-AO	0 / 2438	-18.5	-18.5	0.22 (1)	10.00							
AO-AP	0 / 2438	-18.5	-18.5	0.22 (1)	10.00							
AP-L	0 / 2438	-18.5	-18.5	0.22 (1)	10.00							
L-AQ	0 / 0	-18.5	-18.5	0.07 (4)	10.00							

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL)= L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.36/1.00 (E-G:1), BC=0.46/1.00 (M-O:1),
WB=0.37/1.00 (C-Q:1), SSI=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (C) (INPUT = 0.90)
JSI METAL= 0.59 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115202

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
418924	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:13:27 2021 Page 2

ID:GzzEEXDtkQt BH M?wImSz?k45-naI4YHJUKK?1132wZ?8oOFOGUhT5m4qnGu4SClazeIDM

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTWW+m	MT20	7.0	8.0	3.25	1.50
D	TMWW-t	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	3.25	1.50
I	TMVW+p	MT20	5.0	6.0	2.00	2.25
K	BMV1+p	MT20	3.0	6.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

NOTES (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC	MAX. MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			LENGTH FR-TO		
AQ-AR	0 / 0	-18.5 -18.5	0.07 (4)	10.00			
AR-K	0 / 0	-18.5 -18.5	0.07 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
D	9-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
G	23-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
H	30-10-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
H	30-10-8	-127	-127	---	FRONT	VERT	SNOW	---	C1
M	23-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
N	21-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
P	11-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
Q	9-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
T	3-11-4	-77	-77	---	BACK	VERT	TOTAL	---	C1
U	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
V	7-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
W	11-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
X	13-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Y	15-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Z	17-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AA	19-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AB	21-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AC	25-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AD	27-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AE	29-11-4	-78	-78	---	BACK	VERT	TOTAL	---	C1
AF	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AG	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AH	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AI	7-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AJ	13-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AK	15-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AL	17-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AM	19-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AN	25-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AO	27-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AP	29-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AQ	31-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AR	32-11-4	-22	-22	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

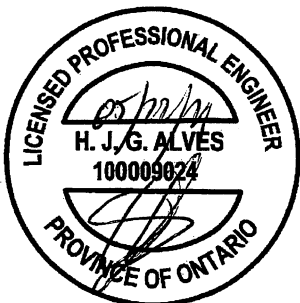

Structural component only
DWG# T-2115202 *m*

JOB NAME 410887	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:47:50 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-hls4Pm935fRwGclHn7Y5?apionzVO8eMatVqzEJTd

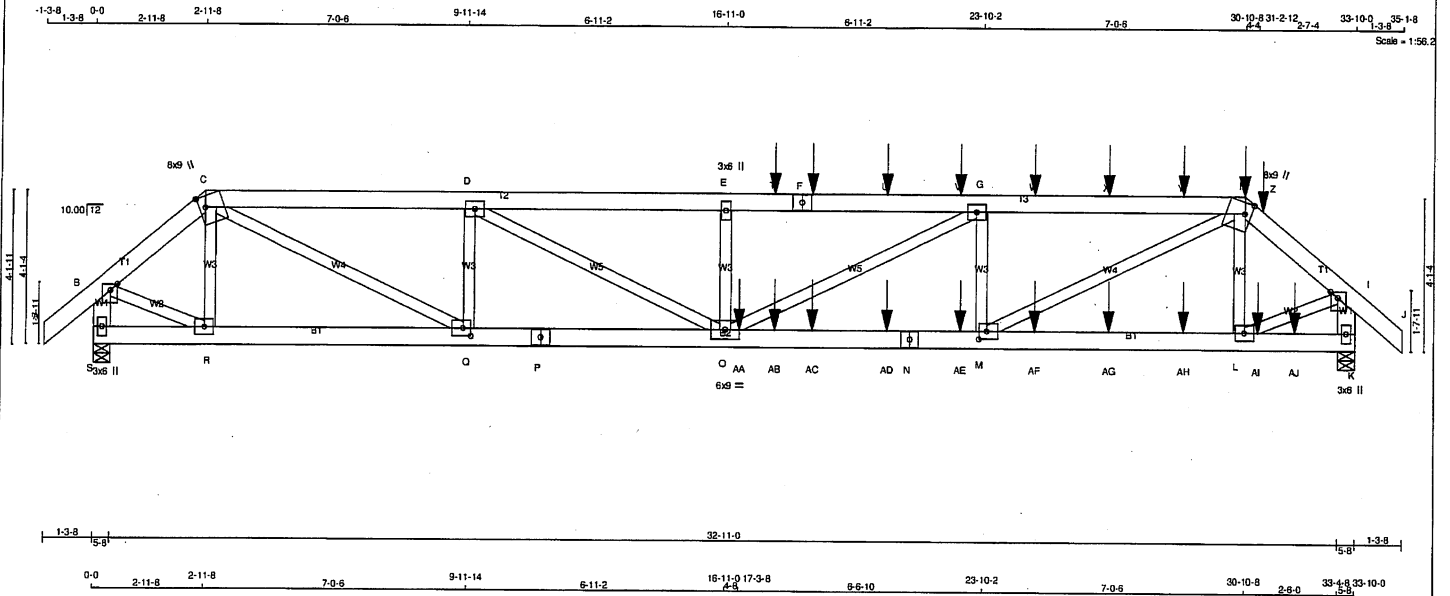

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
J - L	2x6	DRY	No.2	SPF
L - M	2x6	DRY	No.2	SPF
M - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2	12
C-F	2	12
F-H	2	12
H-J	2	12
J-L	2	12
L-M	2	12
M-N	2	12
N-K	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	12
P-N	2	12
N-K	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6
O-E	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	3120	0	3120	0	5-8
K	3872	0	3872	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
S	2201	1474 / 0	0 / 0	0 / 0	0 / 0	727 / 0	0 / 0
K	2732	1826 / 0	0 / 0	0 / 0	0 / 0	907 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED	FACTORED	FACTORED	FACTORED	FACTORED	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	CSI (LC)	UNBRAC	FR-TO	
A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	R-C	-677 / 0
B-C	-3126 / 0	-91.8	-91.8	0.05 (1)	6.20	L-H	-850 / 0
C-D	-6769 / 0	-91.8	-91.8	0.25 (1)	4.42	B-R	0 / 2536
D-E	-9656 / 0	-91.8	-91.8	0.34 (1)	3.74	L-I	0 / 3167
E-T	-9656 / 0	-91.8	-91.8	0.47 (1)	3.58	M-H	0 / 5399
T-F	-9656 / 0	-91.8	-91.8	0.47 (1)	3.58	C-Q	0 / 4951
F-U	-9656 / 0	-91.8	-91.8	0.47 (1)	3.58	M-G	-2166 / 0
U-V	-9656 / 0	-91.8	-91.8	0.47 (1)	3.58	Q-D	-2206 / 0
V-G	-9656 / 0	-91.8	-91.8	0.47 (1)	3.58	O-G	0 / 2151
G-W	-7755 / 0	-91.8	-91.8	0.40 (1)	4.01	D-O	0 / 3267
W-X	-7755 / 0	-91.8	-91.8	0.40 (1)	4.01	O-E	-769 / 0
X-Y	-7755 / 0	-91.8	-91.8	0.40 (1)	4.01		
Y-H	-7755 / 0	-91.8	-91.8	0.40 (1)	4.01		
H-Z	-3868 / 0	-91.8	-91.8	0.07 (1)	5.70		
Z-I	-3868 / 0	-91.8	-91.8	0.07 (1)	5.70		
I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00		
S-B	-3141 / 0	0.0	0.0	0.11 (1)	7.79		
K-I	-3872 / 0	0.0	0.0	0.14 (1)	7.19		

S-R		0 / 0	-18.5	-18.5	0.06 (1)	10.00
R-Q	0 / 2360	-18.5	-18.5	0.21 (1)	10.00	
Q-P	0 / 6769	-18.5	-18.5	0.51 (1)	10.00	
P-O	0 / 6769	-18.5	-18.5	0.51 (1)	10.00	
O-AA	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
AA-AB	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
AB-AC	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
AC-AD	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
AD-N	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
N-AE	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
AE-M	0 / 7755	-18.5	-18.5	0.67 (1)	10.00	
M-AF	0 / 2947	-18.5	-18.5	0.24 (1)	10.00	
AF-AG	0 / 2947	-18.5	-18.5	0.24 (1)	10.00	
AG-AH	0 / 2947	-18.5	-18.5	0.24 (1)	10.00	
AH-L	0 / 2947	-18.5	-18.5	0.24 (1)	10.00	
L-AI	0 / 0	-18.5	-18.5	0.07 (4)	10.00	
AI-AJ	0 / 0	-18.5	-18.5	0.07 (4)	10.00	
AJ-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIRL	TYPE	HEEL	CONN.
F	19-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
H	30-10-8	-30	-30	---	FRONT	VERT	DEAD	---	C1
H	30-10-8	-127	-127	---	FRONT	VERT	SNOW	---	C1

TOTAL WEIGHT = 2 X 193 = 386 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/990 (0.41")

CSI: TC=0.47/1.00 (E-G:1), BC=0.67/1.00 (M-O:1), WB=0.48/1.00 (H-M:1), SS=0.55/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.75 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115143

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:47:50 2021 Page 2
ID:GzzEEXDtkQt BH M?wlmisz?k45-hls4Pm935fRwGclHZN7IY5?aPionzVO8eMatVqzEJTc

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTWW+m	MT20	8.0	9.0	3.50	2.00
D	TMWW-t	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TTWW+m	MT20	8.0	9.0	3.50	2.00
I	TMVW+p	MT20	5.0	6.0	2.00	2.25
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.50
N	BS-t	MT20	5.0	6.0		
O	BMWWW-t	MT20	6.0	9.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.50
R	BMWW-t	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

SPECIFIED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	18-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
U	21-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
V	23-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
W	25-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
X	27-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	29-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	31-2-12	-96	-96	---	FRONT	VERT	TOTAL	---	C1
AA	17-3-8	-1138	-1138	---	FRONT	VERT	TOTAL	---	C1
AB	18-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AC	19-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AD	21-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AE	23-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AF	25-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AG	27-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	29-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	31-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	32-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2115143 *ML*

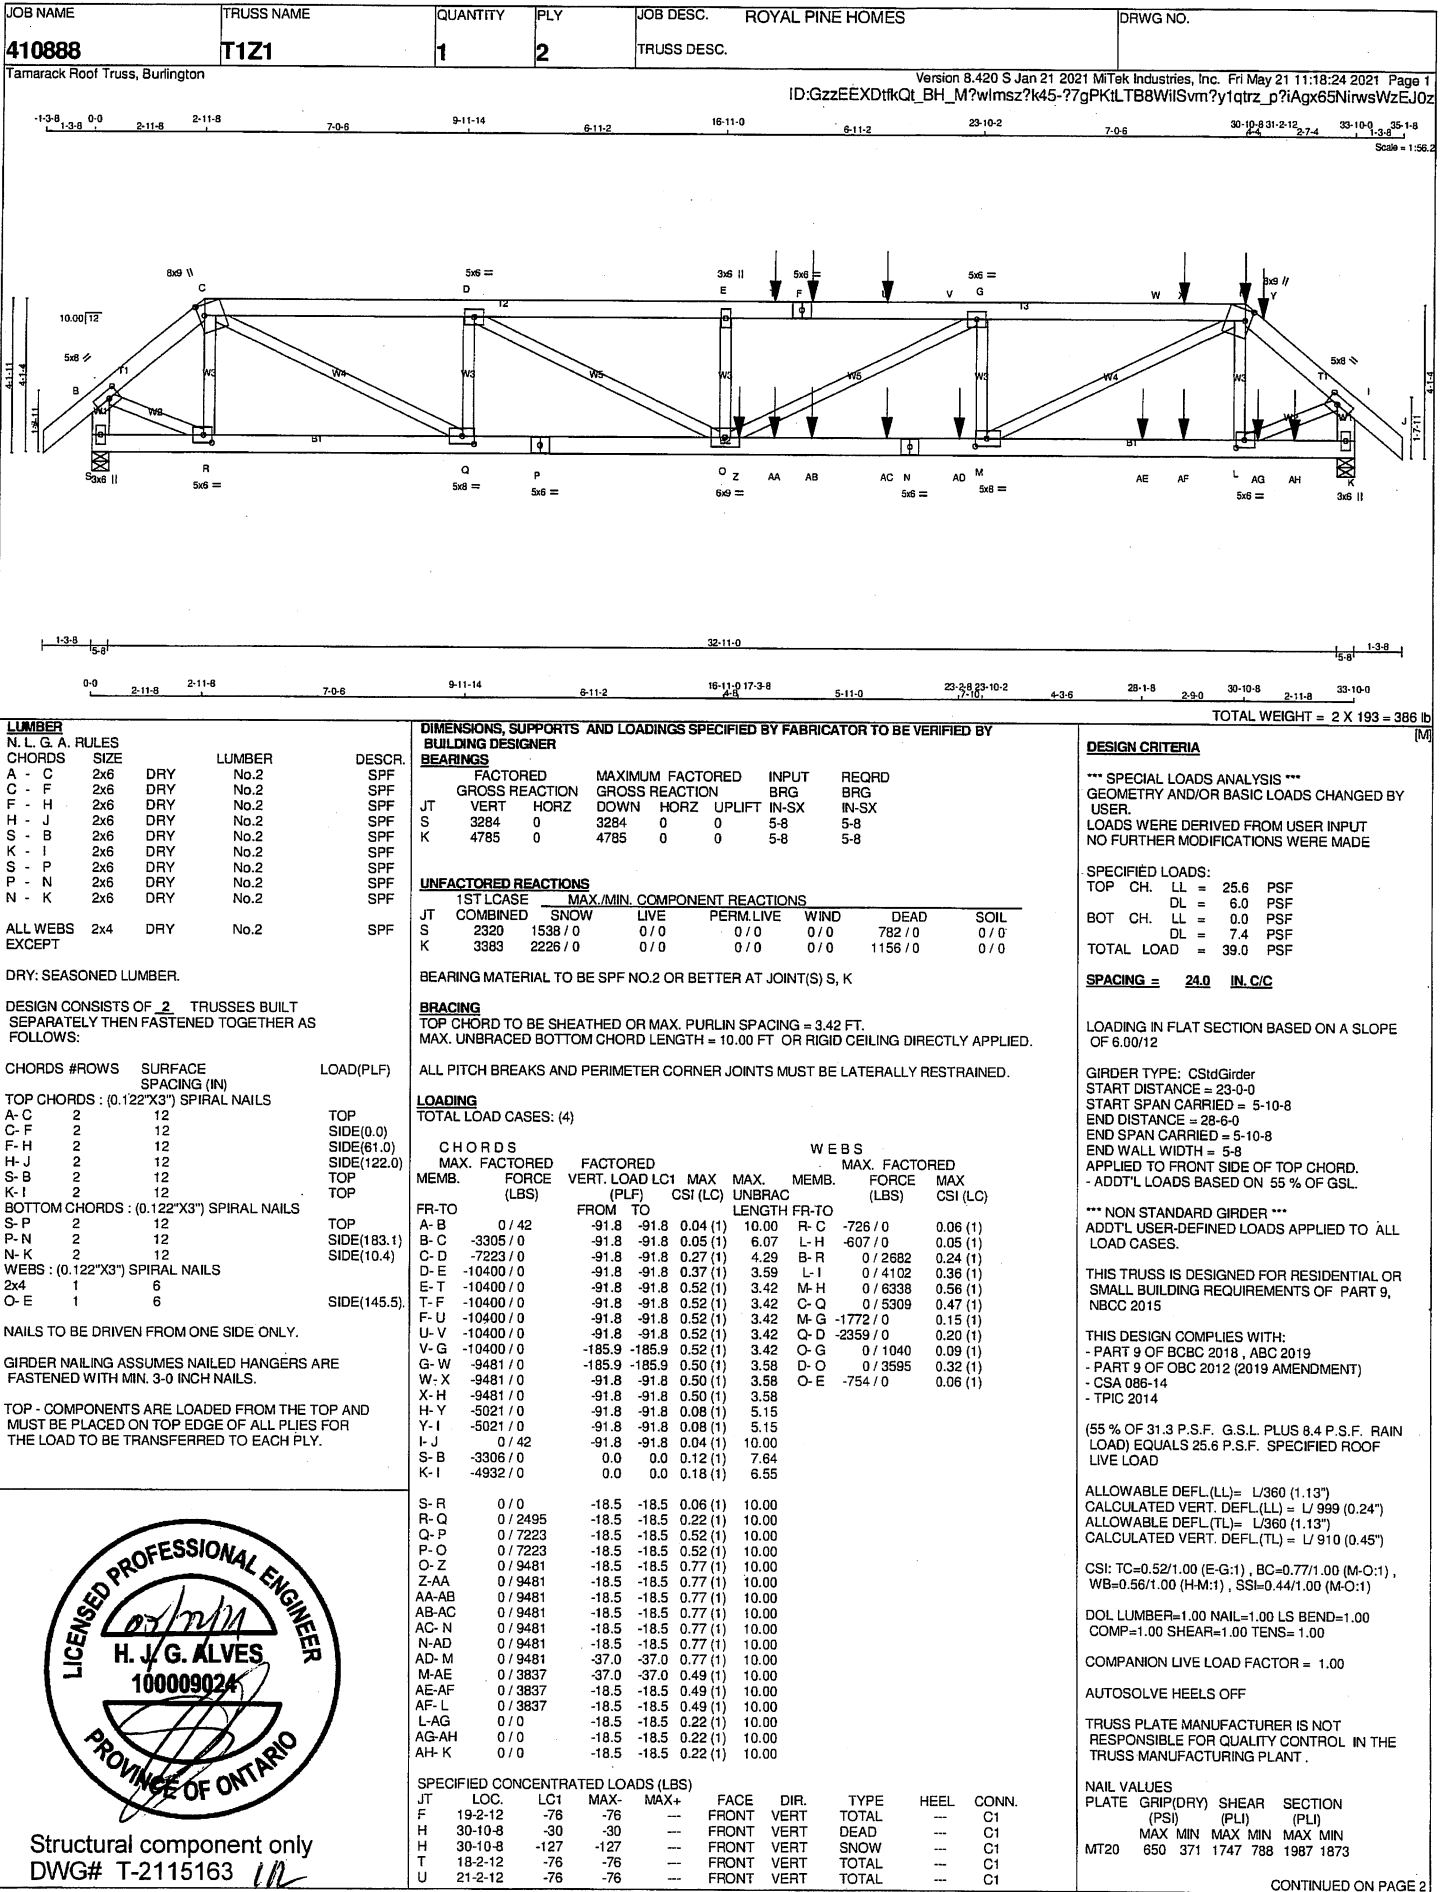

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410888	T1Z1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:24 2021 Page 2
ID:GzzEEEXDtkQt BH M?wlmSz?k45-7?gPKiLTB8WiiSvm?y1qtrz_p?iAqx65NirwsWzEJOz

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW-m	MT20	8.0	9.0	3.50	1.75
D	TMWW-t	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	8.0	9.0	3.50	1.75
I	TMVW-t	MT20	5.0	8.0	2.50	3.25
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.75
M	BMWW-t	MT20	5.0	8.0	2.50	3.75
N	BS-t	MT20	5.0	6.0		
O	BMWWW-t	MT20	6.0	9.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	3.75
R	BMWW-t	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	29-2-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	31-2-12	-96	-96	---	FRONT	VERT	TOTAL	---	C1
Z	17-3-8	-887	-887	---	FRONT	VERT	TOTAL	---	C1
AA	18-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AB	19-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AC	21-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AD	23-2-8	-436	-436	---	FRONT	VERT	TOTAL	---	C1
AE	28-1-8	-436	-436	---	FRONT	VERT	TOTAL	---	C1
AF	29-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AG	31-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	32-2-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.90)
JSI METAL= 0.89 (P) (INPUT = 1.00)

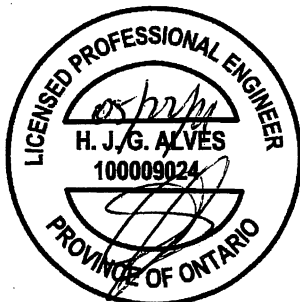


Structural component only
DWG# T-2115163 *W*

JOB NAME 410887	TRUSS NAME T1S	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:48 2021 Page 1
ID:GzzEEEXDtfkQt_BH_M?wmsz?k45-lwkK_47pa1BC1IZuSM5HTgwGMv6yVbwsB35mQxzEJT

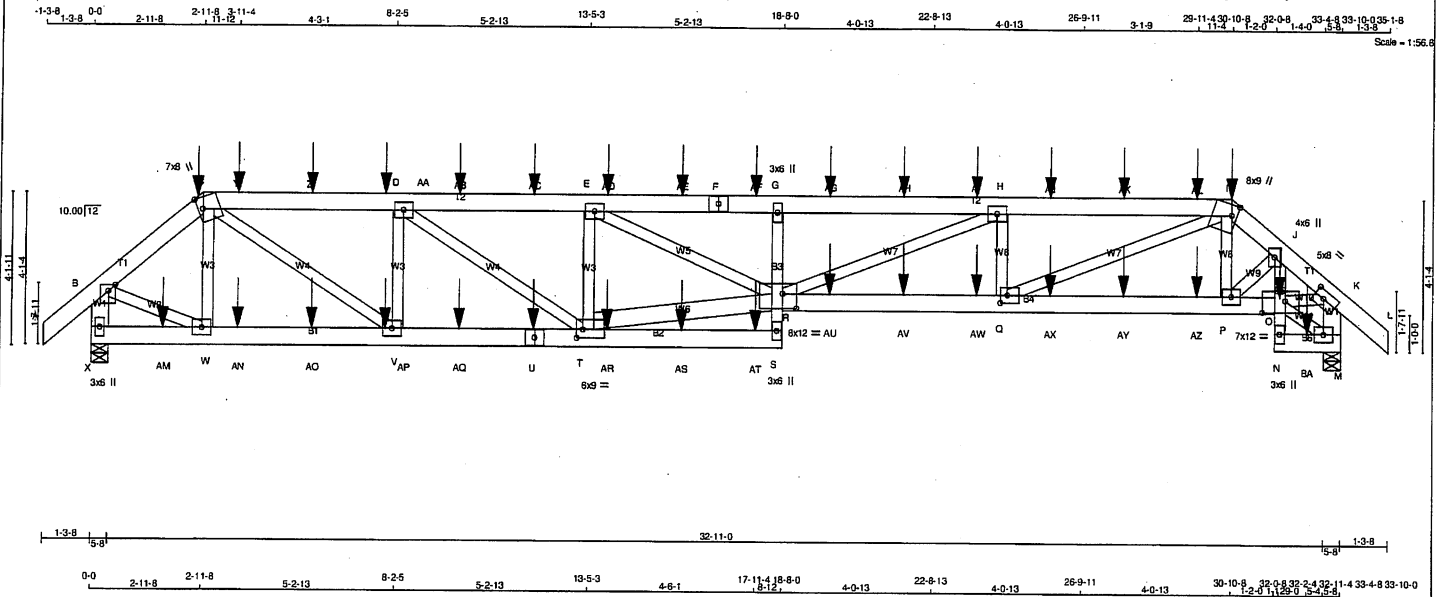

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES								*** SPECIAL LOADS ANALYSIS ***			
CHORDS SIZE LUMBER DESCR.								GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.			
A - C 2x6 DRY No.2 SPF								LOADS WERE DERIVED FROM USER INPUT			
C - F 2x6 DRY No.2 SPF								NO FURTHER MODIFICATIONS WERE MADE			
F - I 2x6 DRY No.2 SPF											
I - L 2x6 DRY No.2 SPF											
X - B 2x6 DRY No.2 SPF											
M - K 2x6 DRY No.2 SPF											
X - U 2x6 DRY No.2 SPF											
U - S 2x6 DRY No.2 SPF											
S - G 2x4 DRY No.2 SPF											
R - O 2x6 DRY No.2 SPF											
N - J 2x4 DRY No.2 SPF											
N - M 2x6 DRY No.2 SPF											
ALL WEBS 2x4 DRY No.2 SPF											
EXCEPT											
T - R 2x6 DRY No.2 SPF											
DRY: SEASONED LUMBER.											
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:											
CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)											
TOP CHORDS : (0.122"x3") SPIRAL NAILS											
A-C 2 12 SIDE(122.0)											
C-F 2 12 SIDE(183.1)											
F-I 2 12 SIDE(61.0)											
I-L 2 12 SIDE(122.0)											
X-B 2 12 TOP											
M-K 2 12 TOP											
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS											
X-U 2 12 SIDE(183.1)											
U-S 2 12 SIDE(0.0)											
R-O 2 12 SIDE(61.0)											
N-M 2 12 SIDE(0.0)											
S-G 1 12 TOP											
J-N 1 12 TOP											
WEBS : (0.122"x3") SPIRAL NAILS											
2x4 1 6											
2x6 2 6											
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.											



Structural component only
DWG# T-2115142

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T1S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:48 2021 Page 2
ID:GzzEEEXDtKQt BH M?wmsz?k45-lwkK 47pa1BC1IZuSM5HTgwGMv6yVbwsB35mQxzEJT

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.							LOADING										TOTAL LOAD CASES: (4)				J/SI GRIP= 0.89 (T) (INPUT = 0.90) J/SI METAL= 0.60 (T) (INPUT = 1.00)			
PLATES (table is in inches)							CHORDS							WEBS										
JT	TYPE	PLATES	W	LEN	Y	X	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)									
B	TMVW+p	MT20	5.0	6.0	2.00	2.25	FR-TO						FR-TO											
C	TTWW+m	MT20	7.0	8.0	3.75	1.50	R-AU	0 / 8731	-18.5	-18.5	0.69 (1)	10.00												
D, E, H							AU-AV	0 / 8731	-18.5	-18.5	0.69 (1)	10.00												
D	TMVW-t	MT20	5.0	6.0			AV-AW	0 / 8731	-18.5	-18.5	0.69 (1)	10.00												
F	TS-t	MT20	5.0	6.0			AW-Q	0 / 8731	-18.5	-18.5	0.69 (1)	10.00												
G	TMV+p	MT20	3.0	6.0			Q-AX	0 / 3771	-18.5	-18.5	0.37 (1)	10.00												
I	TTWW+m	MT20	8.0	9.0	3.50	1.75	AX-AY	0 / 3771	-18.5	-18.5	0.37 (1)	10.00												
J	TMVW+p	MT20	4.0	6.0			AY-AZ	0 / 3771	-18.5	-18.5	0.37 (1)	10.00												
K	TMVW-t	MT20	5.0	8.0	2.50	3.25	AZ-P	0 / 3771	-18.5	-18.5	0.37 (1)	10.00												
M	BMVW1-t	MT20	5.0	6.0			P-O	0 / 3603	-18.5	-18.5	0.36 (1)	10.00												
N	BMV+p	MT20	3.0	6.0			N-O	0 / 35	0.0	0.0	0.07 (1)	10.00												
O	BVMWV-t	MT20	7.0	12.0	3.75	7.50	O-J	-154 / 0	0.0	0.0	0.07 (1)	7.81												
P, V, W							N-BA	0 / 90	-18.5	-18.5	0.01 (4)	10.00												
P	BMVW-t	MT20	5.0	6.0			BA-M	0 / 90	-18.5	-18.5	0.01 (4)	10.00												
Q	BMVW-t	MT20	5.0	6.0	2.50	2.25	SPECIFIED CONCENTRATED LOADS (LBS)																	
R	BVMWVW-t	MT20	8.0	12.0	4.75	4.50	JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.								
S	BMV+p	MT20	3.0	6.0			C	2-11-8	-30	-30	---	FRONT	VERT	DEAD	---	C1								
T	BVMWVW-t	MT20	6.0	9.0	2.75	2.00	C	2-11-8	-127	-127	---	FRONT	VERT	SNOW	---	C1								
U	BS-t	MT20	5.0	6.0			I	30-10-8	-30	-30	---	FRONT	VERT	DEAD	---	C1								
X	BMV1+p	MT20	3.0	6.0			I	30-10-8	-127	-127	---	FRONT	VERT	SNOW	---	C1								
							O	32-2-4	-77	-77	---	BACK	VERT	TOTAL	---	C1								
							U	11-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							Y	3-11-4	-77	-77	---	BACK	VERT	TOTAL	---	C1								
							Z	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AA	7-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AB	9-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AC	11-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AD	13-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AE	15-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AF	17-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1								
							AG	19-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1								
							AH	21-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1								
							AI	23-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1								
							AJ	25-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1								
							AK	27-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1								
							AL	29-11-4	-72	-72	---	BACK	VERT	TOTAL	---	C1								
							AM	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AN	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AO	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AP	7-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AQ	9-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AR	13-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AS	15-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1								
							AT	17-11-4	-24	-24	---	BACK	VERT	TOTAL	---	C1								
							AU	19-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							AV	21-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							AW	23-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							AX	25-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							AY	27-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							AZ	29-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1								
							BA	32-11-4	-24	-24	---	BACK	VERT	TOTAL	---	C1								

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2


CONNECTION REQUIREMENTS				1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.			
-------------------------	--	--	--	---	--	--	--



Structural component only
DWG# T-2115142

JOB NAME 410887	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:51 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-AVPSc69hsyanumHT7Uf_5JYew6A3izdt0JQ1GzEJTC

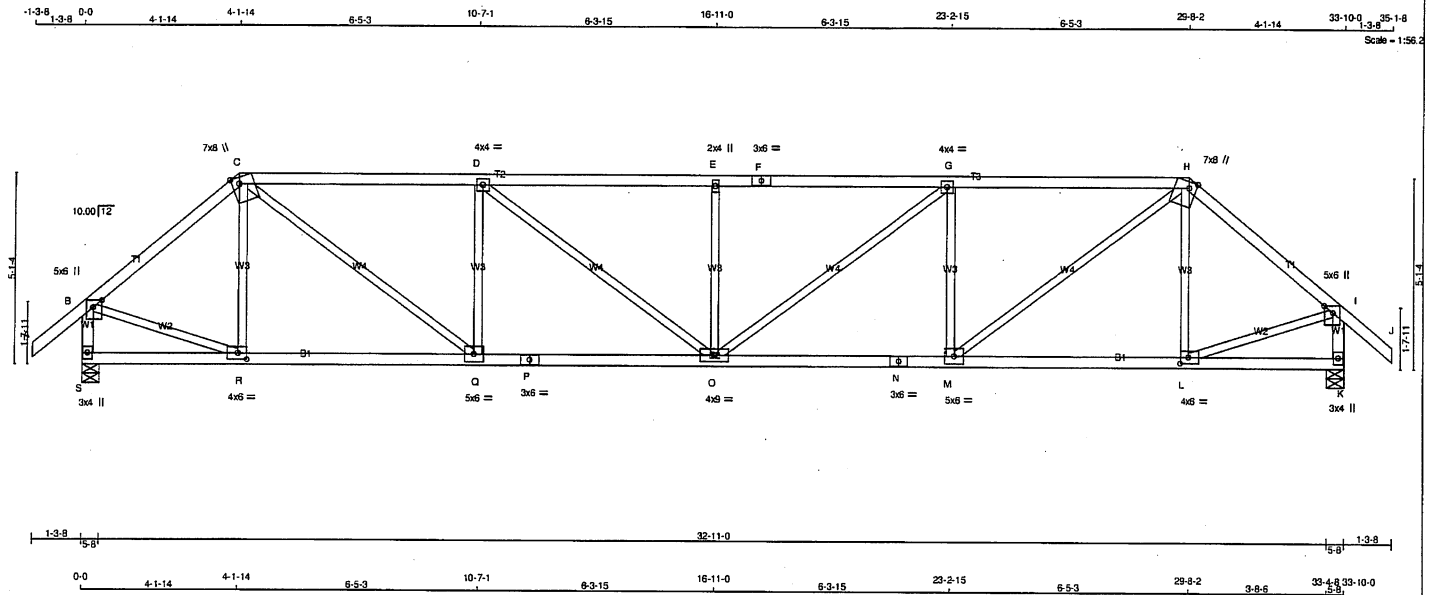

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 137 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	SPF
C - F	2x4	DRY	SPF
F - H	2x4	DRY	SPF
H - J	2x4	DRY	SPF
S - B	2x4	DRY	SPF
K - I	2x4	DRY	SPF
S - P	2x4	DRY	SPF
P - N	2x4	DRY	SPF
N - K	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	2.75
C	TTWW+m	MT20	7.0	8.0	Edge	2.25
D	TMVW-t	MT20	4.0	4.0		
E	TMVW+w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	7.0	8.0	Edge	2.25
I	TMVW+p	MT20	5.0	6.0	Edge	2.75
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	6.0	2.00	2.75
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-w	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-t	MT20	4.0	6.0	2.00	2.75
S	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
S	1992	0	1992	0
K	1992	0	1992	0

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
K	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
(LBS)	(PLF)	LC1 (LC)	UNBRAC	(LBS)
FR-TO	FROM	TO	LENGTH	FR-TO
A-B	0 / 41	-91.8	-91.8	10.00
B-C	-1879 / 0	-91.8	-91.8	4.54
C-D	-2909 / 0	-91.8	-91.8	3.24
D-E	-3337 / 0	-91.8	-91.8	2.97
E-F	-3337 / 0	-91.8	-91.8	2.97
F-G	-3337 / 0	-91.8	-91.8	2.97
G-H	-2909 / 0	-91.8	-91.8	4.54
H-I	-1879 / 0	-91.8	-91.8	10.00
I-J	0 / 41	-91.8	-91.8	3.24
S-B	-1966 / 0	0.0	0.0	6.01
K-I	-1966 / 0	0.0	0.0	6.01

S-R	0 / 0	-18.5	-18.5	10.00
R-Q	0 / 1432	-18.5	-18.5	10.00
Q-P	0 / 2909	-18.5	-18.5	10.00
P-O	0 / 2909	-18.5	-18.5	10.00
O-N	0 / 2909	-18.5	-18.5	10.00
N-M	0 / 2909	-18.5	-18.5	10.00
M-L	0 / 1432	-18.5	-18.5	10.00
L-K	0 / 0	-18.5	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL)= L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.93/1.00 (E-G:1), BC=0.53/1.00 (M-O:1),
WB=0.41/1.00 (C-Q:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (M) (INPUT = 0.90)
JSI METAL= 0.85 (P) (INPUT = 1.00)




Structural component only
DWG# T-2115144

JOB NAME 410887	TRUSS NAME T2S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:52 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmssz?k45-ehzqqSAJdGieVsfhCADDW5rUWUnROP6g3zZizEJTb

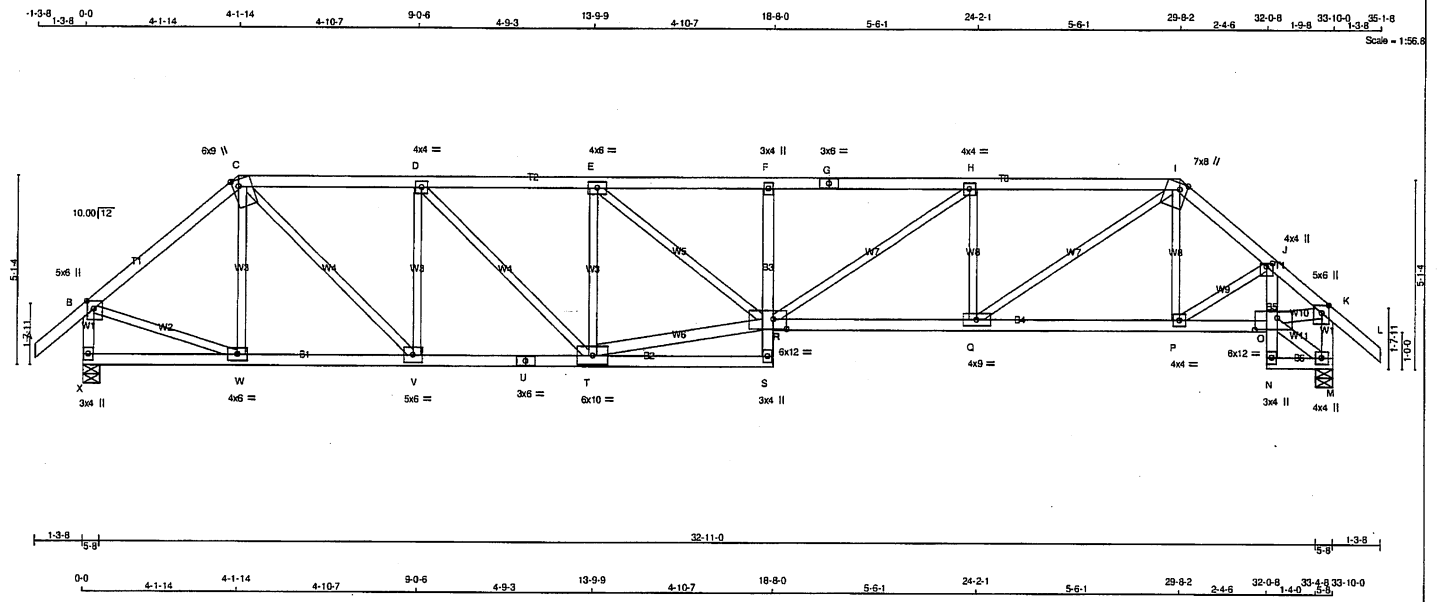

TOTAL WEIGHT = 151 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
X - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
X - U	2x4	DRY	No.2
U - S	2x4	DRY	No.2
S - F	2x4	DRY	No.2
F - O	2x4	DRY	No.2
O - J	2x4	DRY	No.2
N - M	2x4	DRY	No.2
N - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - M	2x4	DRY	No.2
O - K	2x4	DRY	No.2
T - R	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.50	2.25
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-p	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0		
I	TTWW+m	MT20	7.0	8.0	Edge	2.25
J	TMVW+p	MT20	4.0	4.0	1.00	2.00
K	TMVW+p	MT20	5.0	6.0	2.50	2.25
M	BMVW1+p	MT20	4.0	4.0		
N	BMV+p	MT20	3.0	4.0		
O	BVMWV-I	MT20	6.0	12.0	3.75	7.25
P	BMVW-t	MT20	4.0	4.0		
R	BMVW-t	MT20	4.0	9.0		
R	BVMWVW-I	MT20	6.0	12.0	3.25	4.25
S	BMV+p	MT20	3.0	4.0		
T	BMVWVW-t	MT20	6.0	10.0		
U	BS-t	MT20	3.0	6.0		
V	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
X	1990	0	0	5-8
M	1995	0	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
X	1405	935 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
M	1408	938 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (CSI) (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	W-C	-342 / 0
B-C	-1872 / 0	-91.8	-91.8	0.35 (1)	4.55	R-H	0 / 804
C-D	-2608 / 0	-91.8	-91.8	0.43 (1)	3.88	Q-H	-1029 / 0
D-E	-3187 / 0	-91.8	-91.8	0.49 (1)	3.50	Q-I	0 / 2027
E-F	-4099 / 0	-91.8	-91.8	0.52 (1)	3.12	P-I	0 / 72
F-G	-4128 / 0	-91.8	-91.8	0.82 (1)	2.83	P-J	-76 / 0
G-H	-4128 / 0	-91.8	-91.8	0.82 (1)	2.83	B-W	0 / 1500
H-I	-3466 / 0	-91.8	-91.8	0.71 (1)	3.17	O-M	-64 / 0
I-J	-2334 / 0	-91.8	-91.8	0.16 (1)	4.36	O-K	0 / 1819
J-K	-2391 / 0	-91.8	-91.8	0.18 (1)	4.28	C-V	0 / 1657
K-L	0 / 41	-91.8	-91.8	0.13 (1)	10.00	T-E	-1141 / 0
X-B	-1960 / 0	0.0	0.0	0.21 (1)	6.01	V-D	-1082 / 0
M-K	-1943 / 0	0.0	0.0	0.21 (1)	6.04	D-T	0 / 830
X-W	0 / 0	-18.5	-18.5	0.09 (4)	10.00	T-R	0 / 3159
W-V	0 / 1427	-18.5	-18.5	0.28 (1)	10.00	E-R	0 / 1149
V-U	0 / 2608	-18.5	-18.5	0.46 (1)	10.00		
U-T	0 / 2608	-18.5	-18.5	0.46 (1)	10.00		
T-S	0 / 112	-18.5	-18.5	0.11 (4)	10.00		
S-R	0 / 40	0.0	0.0	0.16 (1)	10.00		
R-F	-450 / 0	0.0	0.0	0.17 (1)	7.81		
R-Q	0 / 3466	-18.5	-18.5	0.63 (1)	10.00		
Q-P	0 / 1786	-18.5	-18.5	0.35 (1)	10.00		
P-O	0 / 1852	-18.5	-18.5	0.36 (1)	10.00		
N-O	0 / 17	0.0	0.0	0.08 (1)	10.00		
O-J	-92 / 0	0.0	0.0	0.08 (1)	7.81		
N-M	0 / 53	-18.5	-18.5	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.13")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.24")
ALLOWABLE DEFL.(TL) = $L/360$ (1.13")
CALCULATED VERT. DEFL.(TL) = $L/919$ (0.44")

CSI: TC=0.82/1.00 (F-H:1), BC=0.63/1.00 (Q-R:1),
WB=0.51/1.00 (R-T:1), SS=0.24/1.00 (H-I:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (W) (INPUT = 0.90)
JSI METAL= 0.78 (U) (INPUT = 1.00)

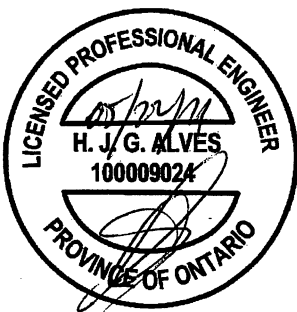

Structural component only
DWG# T-2115145

CONTINUED ON PAGE 2

JOB NAME 410887	TRUSS NAME T2S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:52 2021 Page 2
ID:GzzEEXDtfkQt BH M?wlmsz?k45-ehzqgSAJdGieVvsfhCADdW5rUWUnROPR6g3zZizEJTb

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
W	BMWV-t	MT20	4.0	6.0		
X	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115145 *2m*

JOB NAME 410887	TRUSS NAME T3	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:53 2021 Page 1
ID:GzzEEXDtKtQl_BH_M?wlmz?k45-6tXD10BxOaqV73RsEvhSAkd2lwssAqRbKKoX68zEJTa

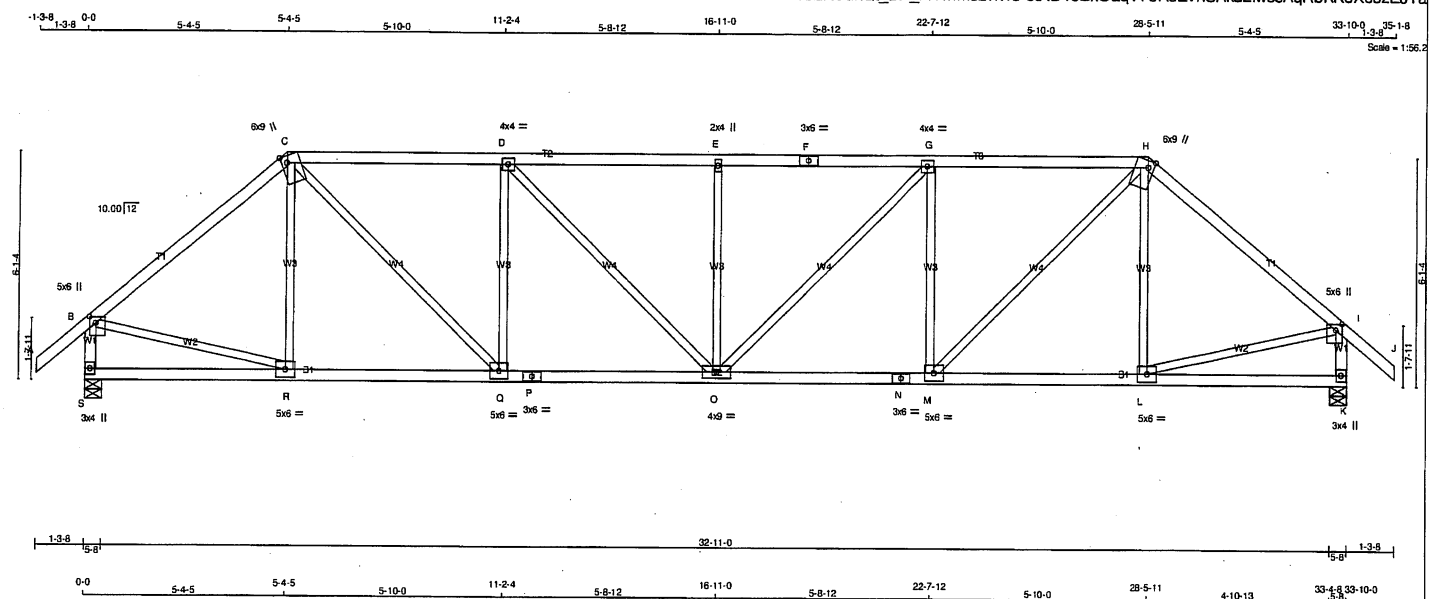

TOTAL WEIGHT = 144 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								DESIGN CRITERIA	
CHORDS	SIZE	LUMBER	DESCR.	BEARINGS								SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	FACTORED								TOP CH. LL	= 25.6 PSF
C - F	2x4	DRY	No.2	GROSS REACTION								DL	= 6.0 PSF
F - H	2x4	DRY	No.2	DOWN								BOT CH. LL	= 0.0 PSF
H - J	2x4	DRY	No.2	UP								DL	= 7.4 PSF
J - L	2x4	DRY	No.2	REACT								TOTAL LOAD	= 39.0 PSF
L - N	2x4	DRY	No.2	UNFACTORED REACTIONS								SPACING = 24.0 IN. C/C	
N - K	2x4	DRY	No.2	1ST LOSE								LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
ALL WEBS	2x3	DRY	No.2	COMBINED								THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015	
EXCEPT				S								THIS DESIGN COMPLIES WITH:	
				K								- PART 9 OF CBC 2018, ABC 2019	
												- PART 9 OF CBC 2012 (2019 AMENDMENT)	
												- CSA 086-14	
												- TPIC 2014	
												(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
												ALLOWABLE DEFL.(LL)= L/360 (1.13")	
												CALCULATED VERT. DEFL.(LL) = L/999 (0.14")	
												ALLOWABLE DEFL.(TL)= L/360 (1.13")	
												CALCULATED VERT. DEFL.(TL) = L/999 (0.25")	
												CSI: TC=0.66/1.00 (D-E:1), BC=0.45/1.00 (O-Q:1), WB=0.52/1.00 (D-Q:1), SS=0.25/1.00 (C-D:1)	
												DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
												COMP=1.10 SHEAR=1.10 TENS=1.10	
												COMPANION LIVE LOAD FACTOR = 1.00	
												TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT	
												NAIL VALUES	
												PLATE GRIP(DRY) SHEAR SECTION	
												(PSI) (PLI) (PLI)	
												MAX MIN MAX MIN MAX MIN	
												MT20 650 371 1747 788 1987 1873	
												PLATE PLACEMENT TOL. = 0.250 inches	
												PLATE ROTATION TOL. = 5.0 Deg.	
												JSI GRIP= 0.83 (I) (INPUT = 0.90)	
												JSI METAL= 0.70 (P) (INPUT = 1.00)	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.00
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	6.0	9.0	Edge	1.75
I	TMVW+p	MT20	5.0	6.0	2.00	2.00
K	BMV1+p	MT20	3.0	4.0		
L, M, Q, R						
L	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-w	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
S	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES:

- 1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115146

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T3S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:54 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-a45bF8Ca9yLiD02odChjxABgJC7vHQKZ_Y4ebzEJTZ

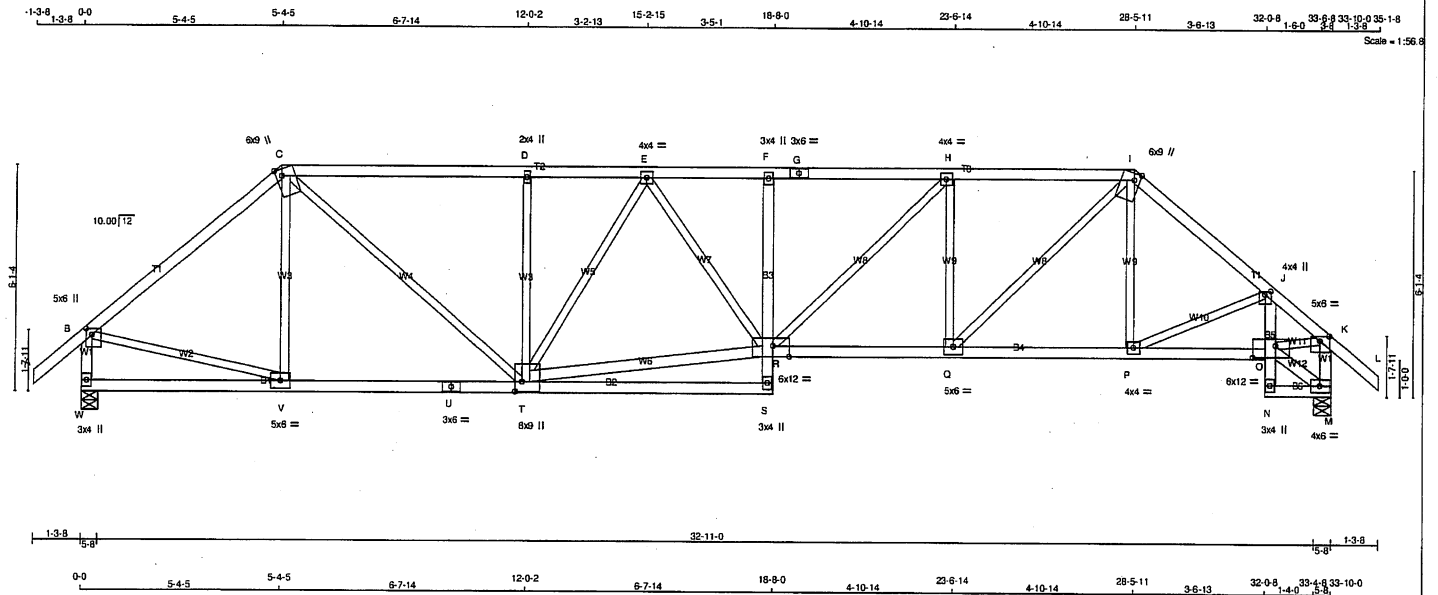

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
W - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
W - U	2x4	DRY	No.2	SPF
U - S	2x4	DRY	No.2	SPF
S - F	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
N - J	2x4	DRY	No.2	SPF
N - M	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
T - R	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	2.00	2.00
C TTWW+m	MT20	6.0	9.0	Edge 1.75	
D TMVW+w	MT20	2.0	4.0		
E TMVW-t	MT20	4.0	4.0		
F TMV+p	MT20	3.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMVW-t	MT20	4.0	4.0		
I TTWW+m	MT20	6.0	9.0	Edge 1.75	
J TMVW+p	MT20	4.0	4.0	1.00	2.00
K TMVW-p	MT20	5.0	6.0	1.50	3.00
M BMVW-t	MT20	4.0	6.0		
N BMV+p	MT20	3.0	4.0		
O BVWVW-t	MT20	6.0	12.0	3.75	7.50
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	5.0	6.0		
R BVWVW-t	MT20	6.0	12.0	Edge 5.25	
S BMV+p	MT20	3.0	4.0		
T BMVWVW-t	MT20	8.0	9.0	3.25	2.25
U BS-t	MT20	3.0	6.0		
V BMVW-t	MT20	5.0	6.0		
W BMV-t+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
W	1990	0	5-8	5-8
M	1995	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE COMBINED	MAX/MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1405	935 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
W	1405	935 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
M	1408	938 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	V-C	-229 / 13	0.13 (1)
B-C	-1912 / 0	-91.8	-91.8 0.82 (1)	4.20	C-T	0 / 1447	0.33 (1)
C-D	-2552 / 0	-91.8	-91.8 0.77 (1)	3.55	T-D	-615 / 0	0.36 (1)
D-E	-2554 / 0	-91.8	-91.8 0.80 (1)	3.55	T-R	0 / 2852	0.46 (1)
E-F	-3244 / 0	-91.8	-91.8 0.31 (1)	3.64	R-H	0 / 607	0.14 (1)
F-G	-3263 / 0	-91.8	-91.8 0.54 (1)	3.41	Q-H	-937 / 0	0.36 (1)
G-H	-3263 / 0	-91.8	-91.8 0.49 (1)	3.41	Q-I	0 / 1495	0.34 (1)
H-I	-2828 / 0	-91.8	-91.8 0.26 (1)	4.30	P-I	0 / 92	0.03 (4)
I-J	-2292 / 0	-91.8	-91.8 0.18 (1)	4.26	P-J	-160 / 0	0.05 (1)
J-K	-2416 / 0	-91.8	-91.8 0.13 (1)	10.00	B-V	0 / 1507	0.34 (1)
K-L	0 / 41	-91.8	-91.8 0.21 (1)	6.03	O-M	-71 / 0	0.01 (1)
W-B	-1950 / 0	0.0	0.0 0.21 (1)	6.04	O-K	0 / 1859	0.42 (1)
M-K	-1939 / 0	0.0	0.0 0.21 (1)	6.04	E-R	0 / 596	0.13 (1)
					T-E	-729 / 0	0.54 (1)
W-V	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
V-U	0 / 1462	-18.5	-18.5 0.33 (1)	10.00			
U-T	0 / 1462	-18.5	-18.5 0.33 (1)	10.00			
T-S	0 / 90	-18.5	-18.5 0.19 (4)	10.00			
S-R	0 / 54	0.0	0.0 0.13 (1)	10.00			
R-F	-395 / 0	0.0	0.0 0.17 (1)	7.81			
R-Q	0 / 2828	-18.5	-18.5 0.51 (1)	10.00			
Q-P	0 / 1748	-18.5	-18.5 0.33 (1)	10.00			
P-O	0 / 1894	-18.5	-18.5 0.35 (1)	10.00			
N-O	0 / 17	0.0	0.0 0.09 (1)	10.00			
O-J	-111 / 0	0.0	0.0 0.09 (1)	7.81			
N-M	0 / 59	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.33")

CSI: TC=0.77/1.00 (C-D:1), BC=0.51/1.00 (Q-R:1),
WB=0.54/1.00 (E-T:1), SSI=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	650	371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (T) (INPUT = 0.90)
JSI METAL= 0.59 (T) (INPUT = 1.00)




Structural component only
DWG# T-2115147

JOB NAME 410887	TRUSS NAME T4	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:47:55 2021 Page 1
ID:GzzEEXdtfkQt_BH_M?wmsz7k45-2GfzSTDCwB4CMNbEMKjwF9JL7YHeibtoeHeA1zEJTY

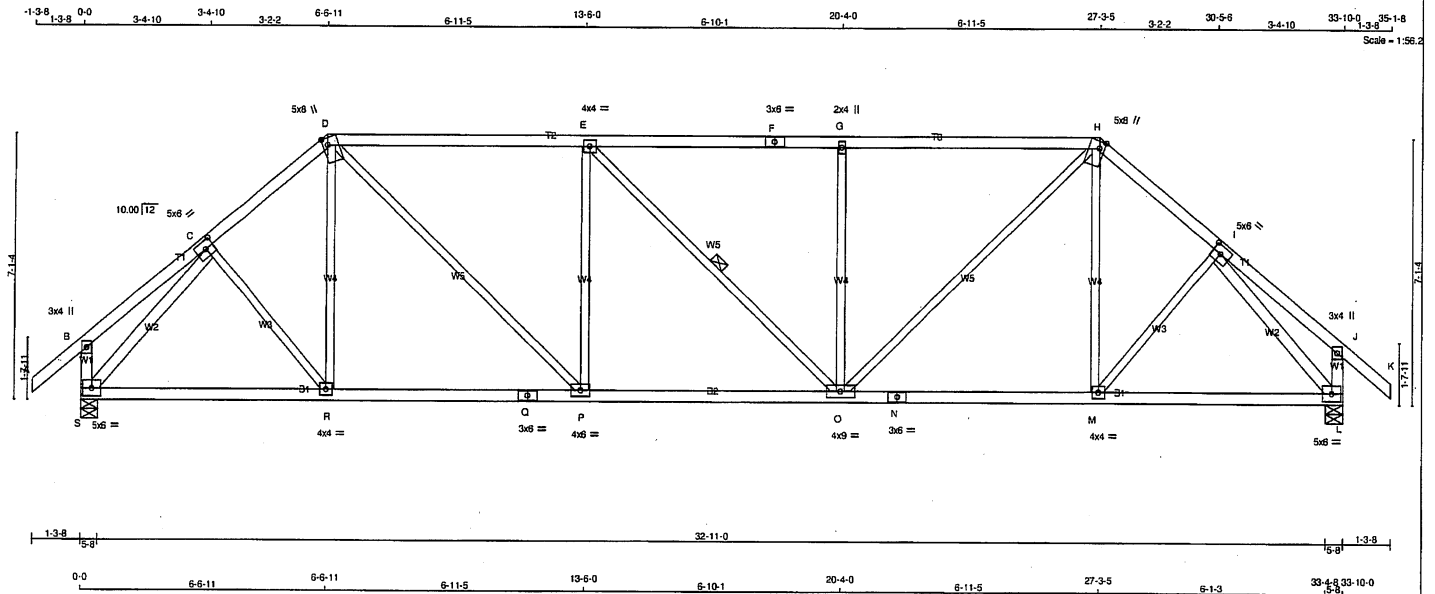

TOTAL WEIGHT = 152 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
Q - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
S - C	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.75
D	TTWW+m	MT20	5.0	8.0	2.25	1.50
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW+m	MT20	5.0	8.0	2.25	1.50
I	TMWW-t	MT20	5.0	6.0	2.50	2.75
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-t	MT20	5.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVWW-t	MT20	4.0	9.0		
P	BMVW-t	MT20	4.0	6.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	4.0	4.0		
S	BMVW1-t	MT20	5.0	6.0		

NOTES:

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
S	1992	0	1992	0
L	1992	0	1992	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
L	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	C-R	0 / 138	0.03 (1)
B-C	0 / 20	-91.8 -91.8	0.14 (1)	10.00	R-D	0 / 91	0.03 (4)
C-D	-1933 / 0	-91.8 -91.8	0.20 (1)	4.67	D-P	0 / 1157	0.26 (1)
D-E	-2292 / 0	-91.8 -91.8	0.86 (1)	3.56	P-E	-686 / 0	0.60 (1)
E-F	-2291 / 0	-91.8 -91.8	0.85 (1)	3.56	E-O	-2 / 0	0.00 (1)
F-G	-2291 / 0	-91.8 -91.8	0.85 (1)	3.56	O-G	-685 / 0	0.60 (1)
G-H	-2291 / 0	-91.8 -91.8	0.85 (1)	3.56	O-H	0 / 1155	0.26 (1)
H-I	-1933 / 0	-91.8 -91.8	0.20 (1)	4.67	M-H	0 / 91	0.03 (4)
I-J	0 / 20	-91.8 -91.8	0.14 (1)	10.00	M-I	0 / 138	0.03 (1)
J-K	0 / 41	-91.8 -91.8	0.13 (1)	10.00	S-C	-2186 / 0	0.67 (1)
S-B	-244 / 0	0.0 0.0	0.03 (1)	7.81	I-L	-2186 / 0	0.67 (1)
L-J	-244 / 0	0.0 0.0	0.03 (1)	7.81			
S-R	0 / 1375	-18.5 -18.5	0.34 (1)	10.00			
R-Q	0 / 1465	-18.5 -18.5	0.35 (1)	10.00			
Q-P	0 / 1465	-18.5 -18.5	0.35 (1)	10.00			
P-O	0 / 2292	-18.5 -18.5	0.45 (1)	10.00			
O-N	0 / 1465	-18.5 -18.5	0.35 (1)	10.00			
N-M	0 / 1465	-18.5 -18.5	0.35 (1)	10.00			
M-L	0 / 1375	-18.5 -18.5	0.34 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.86/1.00 (D-E:1), BC=0.45/1.00 (O-P:1), WB=0.67/1.00 (I-L:1), SSI=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.49 (I) (INPUT = 1.00)




Structural component only
DWG# T-2115148

JOB NAME 410887	TRUSS NAME T4S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:57 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-enjt5ESSoKwchldTIIoKaojhXF56crAFymkFwzEJTW

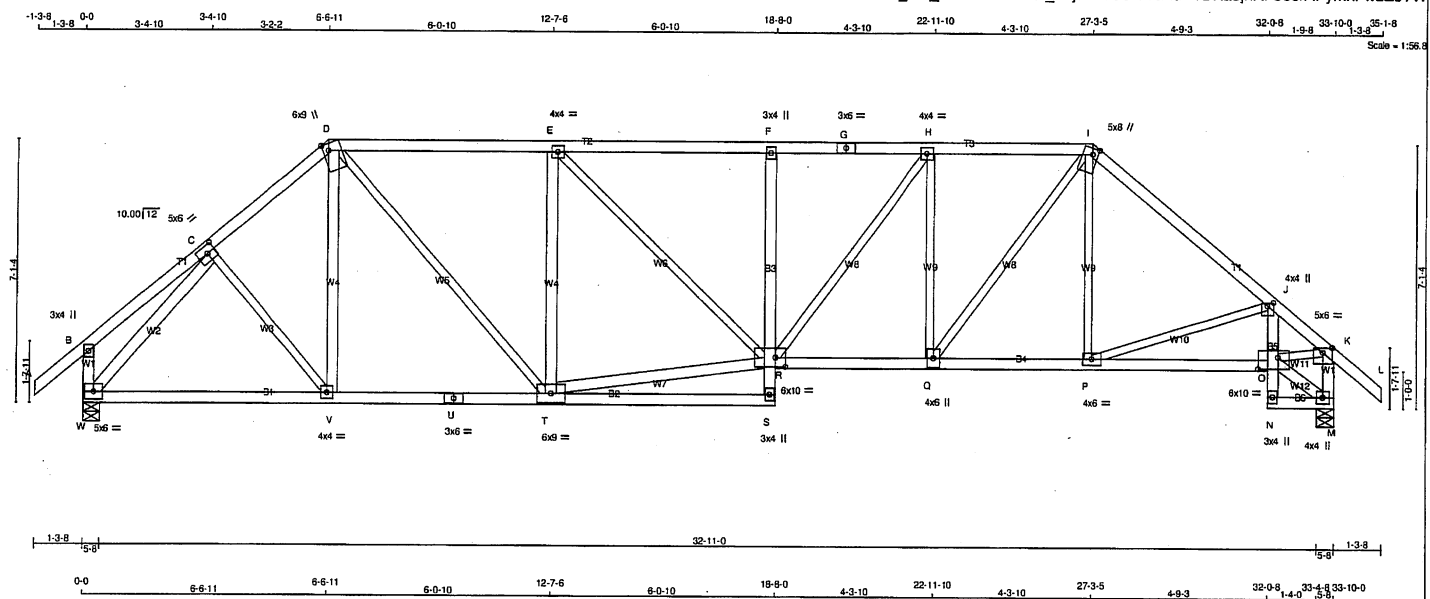

TOTAL WEIGHT = 170 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
W - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
W - U	2x4	DRY	No.2	SPF	
U - S	2x4	DRY	No.2	SPF	
S - F	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
N - M	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT					
V - D	2x4	DRY	No.2	SPF	
T - E	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
W - C	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0	2.50	2.75
D	TTVW+m	MT20	6.0	9.0	Edge	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0		
I	TTVW+m	MT20	5.0	8.0	2.00	1.75
J	TMVW+p	MT20	4.0	4.0	1.00	2.00
K	TMVW-p	MT20	5.0	6.0	1.50	3.00
M	BMVW-t	MT20	4.0	4.0		
N	BMV+p	MT20	3.0	4.0		
O	BMVW-t	MT20	6.0	10.0	3.75	6.50
P	BMVW-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	4.0	6.0		
R	BMVW-t	MT20	6.0	10.0	3.00	3.25
S	BMV+p	MT20	3.0	4.0		
T	BMVW-t	MT20	6.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	IN-SX	
W	1990	0	1990	0	0	5-8	5-8	5-8	
M	1995	0	1995	0	0	5-8	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS							
W	1405	935 / 0	0 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	0 / 0
M	1408	938 / 0	0 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	C-V	0 / 137	0.03 (1)
B-C	0 / 20	-91.8	-91.8 0.14 (1)	10.00	V-D	0 / 81	0.02 (4)
C-D	-1928 / 0	-91.8	-91.8 0.20 (1)	4.68	D-T	0 / 1136	0.26 (1)
D-E	-2213 / 0	-91.8	-91.8 0.67 (1)	3.85	T-E	-1100 / 0	0.69 (1)
E-F	-2699 / 0	-91.8	-91.8 0.72 (1)	3.47	T-R	0 / 2195	0.35 (1)
F-G	-2709 / 0	-91.8	-91.8 0.35 (1)	3.91	E-R	0 / 666	0.15 (1)
G-H	-2709 / 0	-91.8	-91.8 0.35 (1)	3.91	R-H	0 / 517	0.12 (1)
H-I	-2399 / 0	-91.8	-91.8 0.32 (1)	4.14	Q-H	-840 / 0	0.49 (1)
I-J	-2234 / 0	-91.8	-91.8 0.42 (1)	4.21	Q-I	0 / 1157	0.26 (1)
J-K	-2460 / 0	-91.8	-91.8 0.29 (1)	4.09	P-I	0 / 131	0.04 (4)
K-L	0 / 41	-91.8	-91.8 0.13 (1)	10.00	P-J	-276 / 0	0.13 (1)
W-B	-244 / 0	0.0	0.0 0.03 (1)	7.81	W-C	-2180 / 0	0.67 (1)
M-K	-1938 / 0	0.0	0.0 0.21 (1)	6.04	O-M	-73 / 0	0.01 (1)
W-V	0 / 1372	-18.5	-18.5 0.32 (1)	10.00	O-K	0 / 1923	0.43 (1)
V-U	0 / 1462	-18.5	-18.5 0.34 (1)	10.00			
U-T	0 / 1462	-18.5	-18.5 0.34 (1)	10.00			
T-S	0 / 59	-18.5	-18.5 0.14 (4)	10.00			
S-R	0 / 51	0.0	0.0 0.09 (1)	10.00			
R-F	-439 / 0	0.0	0.0 0.21 (1)	7.81			
R-Q	0 / 2399	-18.5	-18.5 0.43 (1)	10.00			
Q-P	0 / 1698	-18.5	-18.5 0.33 (1)	10.00			
P-O	0 / 1958	-18.5	-18.5 0.37 (1)	10.00			
N-O	0 / 17	0.0	0.0 0.10 (1)	10.00			
O-J	-122 / 0	0.0	0.0 0.09 (1)	7.81			
N-M	0 / 60	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CSI: TC=0.72/1.00 (E-F:1), BC=0.43/1.00 (Q-R:1), WB=0.69/1.00 (E-T:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.49 (C) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115149

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T4S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:57 2021 Page 2
ID:GzzEEXDtkQt BH M?wlmsz?k45- enjt9ESSokWchldTlOKaoihXF56crAFymkFwzEJTW

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
U	BS-1	MT20	3.0	6.0		
V	BMWV1-1	MT20	4.0	4.0		
W	BMWV1-1	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115149 *ML*

JOB NAME 410887	TRUSS NAME T5	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:58 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-SrL64VF4D6SnDrJp1SHdtnLwJxb2r?IKUcWinMzEJTV

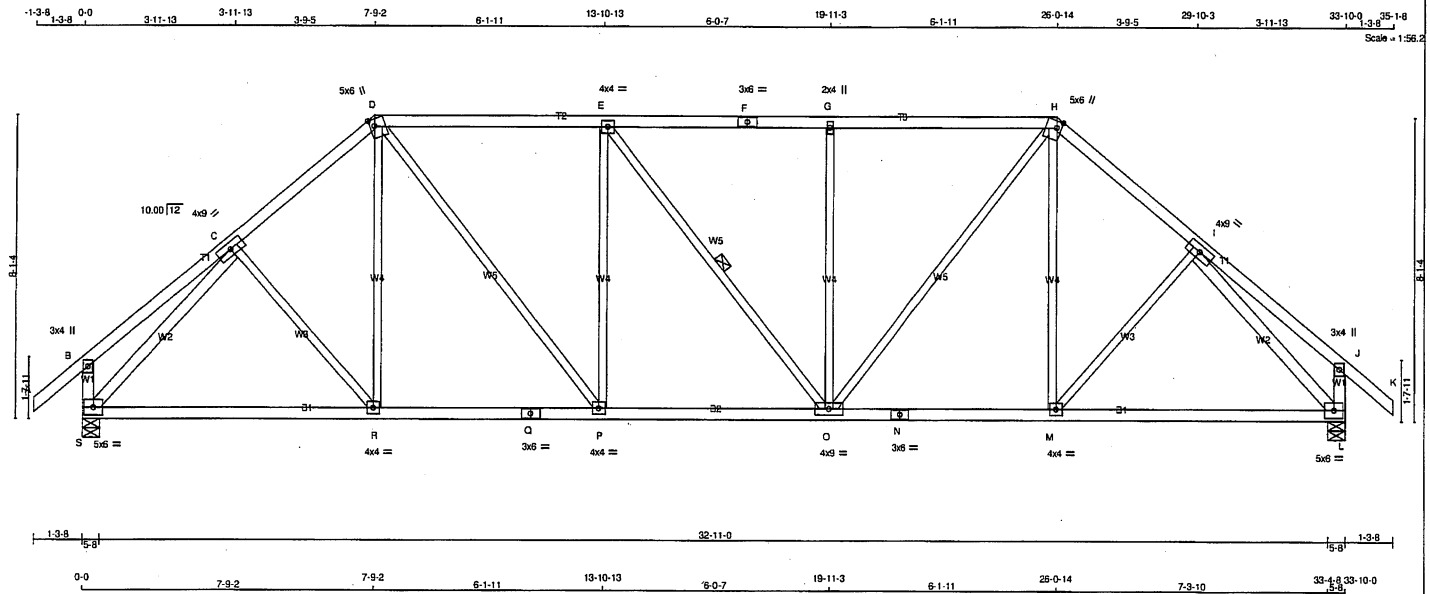

TOTAL WEIGHT = 159 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	9.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW+m	MT20	5.0	6.0	2.25	1.50
I	TMWW-t	MT20	4.0	9.0		
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-t	MT20	5.0	6.0		
M, P, R						
M	BMWW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMWW-t	MT20	4.0	9.0		
Q	BS-t	MT20	3.0	6.0		
S	BMVW1-t	MT20	5.0	6.0		

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
S	1992	0	1992	0	0	5-8	5-8	5-8	
L	1992	0	1992	0	0	5-8	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS						
S	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
L	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	
	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-R	0 / 58	0.02 (4)	
B-C	0 / 26	-91.8	-91.8	0.21 (1)	10.00	R-D	0 / 129	0.04 (4)	
C-D	-1910 / 0	-91.8	-91.8	0.28 (1)	4.60	D-P	0 / 901	0.20 (1)	
D-E	-2002 / 0	-91.8	-91.8	0.60 (1)	4.10	P-E	-605 / 0	0.77 (1)	
E-F	-2001 / 0	-91.8	-91.8	0.60 (1)	4.10	E-O	-2 / 0	0.00 (1)	
F-G	-2001 / 0	-91.8	-91.8	0.60 (1)	4.10	O-G	-604 / 0	0.77 (1)	
G-H	-2001 / 0	-91.8	-91.8	0.60 (1)	4.11	H-I	0 / 898	0.20 (1)	
H-I	-1910 / 0	-91.8	-91.8	0.28 (1)	4.60	M-H	0 / 130	0.04 (4)	
I-J	0 / 26	-91.8	-91.8	0.21 (1)	10.00	M-I	0 / 58	0.02 (4)	
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	S-C	-2194 / 0	0.93 (1)	
S-B	-263 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2194 / 0	0.93 (1)	
L-J	-263 / 0	0.0	0.0	0.03 (1)	7.81				
S-R	0 / 1423	-18.5	-18.5	0.37 (1)	10.00				
R-Q	0 / 1445	-18.5	-18.5	0.37 (4)	10.00				
Q-P	0 / 1445	-18.5	-18.5	0.37 (4)	10.00				
P-O	0 / 2003	-18.5	-18.5	0.38 (1)	10.00				
O-N	0 / 1445	-18.5	-18.5	0.37 (1)	10.00				
N-M	0 / 1445	-18.5	-18.5	0.37 (1)	10.00				
M-L	0 / 1423	-18.5	-18.5	0.37 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.60/1.00 (D-E:1), BC=0.38/1.00 (O-P:1), WB=0.93/1.00 (L-L:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (P) (INPUT = 0.90)
JSI METAL= 0.45 (N) (INPUT = 1.00)



Structural component only
DWG# T-2115150

JOB NAME 410887	TRUSS NAME T5S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:59 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-x1uUlrGi_Qaer_u7bAosQ?7t?9KvtaSZTJGFrJozEJTU

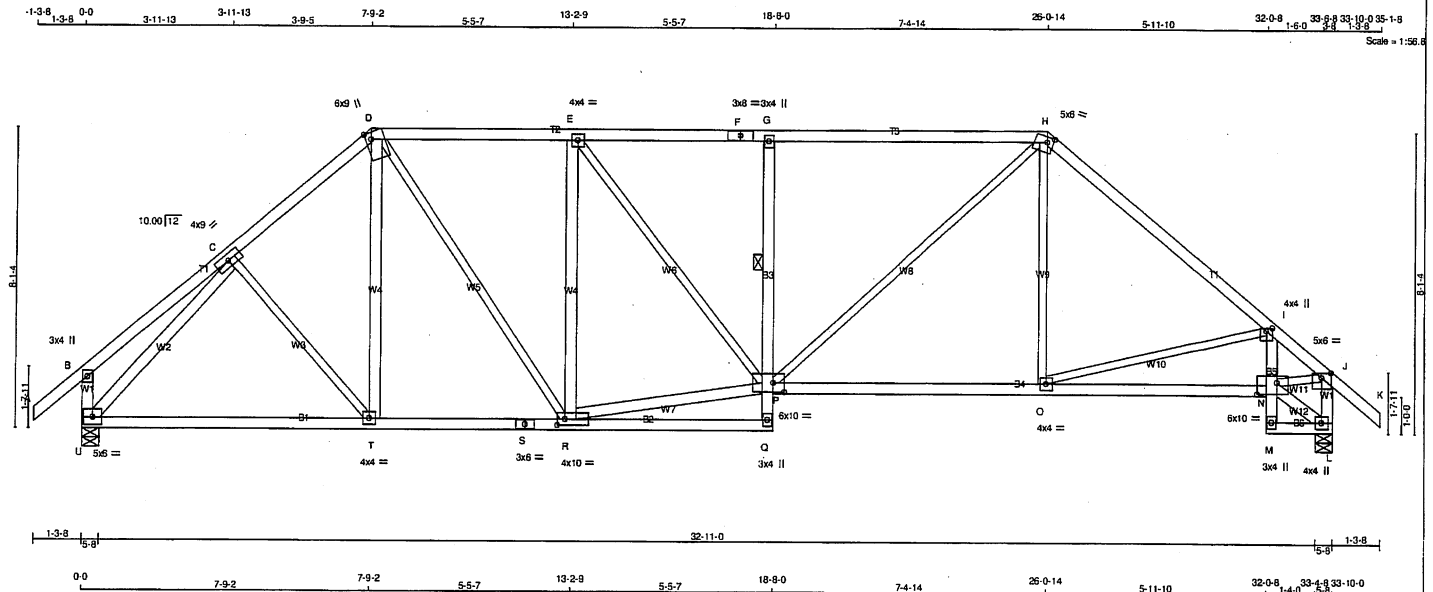

TOTAL WEIGHT = 170 lb

LUMBER			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
T - D	2x4	DRY	No.2
R - E	2x4	DRY	No.2
U - C	2x4	DRY	No.2
N - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	9.0		
D	TTVW+m	MT20	6.0	9.0	Edge	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMV+p	MT20	3.0	4.0		
H	TTVW-m	MT20	5.0	6.0	1.75	2.00
I	TMVW+p	MT20	4.0	4.0	1.00	2.00
J	TMVW+p	MT20	5.0	6.0	1.50	3.00
L	BMVW1+p	MT20	4.0	4.0		
N	BMV+p	MT20	3.0	4.0		
O	BMVW-t	MT20	6.0	10.0	3.75	6.50
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	6.0	10.0	3.00	3.50
R	BMVW-t	MT20	4.0	4.0		
S	BS-t	MT20	3.0	6.0		
T	BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	1990	0	1990	0	5-8
L	1995	0	1995	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1405	935 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
L	1408	938 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRACED LENGTH	MEMB.	FORCE (LBS)	LC1 MAX	LC2 MAX
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-T	0 / 58	0.02 (4)	
B-C	0 / 26	-91.8	-91.8	0.21 (1)	10.00	D-T	0 / 124	0.03 (4)	
C-D	-1905 / 0	-91.8	-91.8	0.28 (1)	4.60	D-R	0 / 881	0.20 (1)	
D-E	-1944 / 0	-91.8	-91.8	0.43 (1)	4.38	R-E	-987 / 0	0.89 (1)	
E-F	-2348 / 0	-91.8	-91.8	0.80 (1)	3.41	R-P	0 / 1942	0.31 (1)	
F-G	-2348 / 0	-91.8	-91.8	0.80 (1)	3.41	E-P	0 / 645	0.15 (1)	
G-H	-2354 / 0	-91.8	-91.8	0.98 (1)	3.39	P-H	0 / 949	0.21 (1)	
H-I	-2177 / 0	-91.8	-91.8	0.59 (1)	4.04	O-H	0 / 218	0.07 (4)	
I-J	-2519 / 0	-91.8	-91.8	0.48 (1)	3.76	O-I	-411 / 0	0.31 (1)	
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	U-C	-2199 / 0	0.93 (1)	
U-B	-263 / 0	0.0	0.0	0.03 (1)	7.81	N-L	-74 / 0	0.01 (1)	
L-J	-1937 / 0	0.0	0.0	0.21 (1)	6.04	N-J	0 / 2007	0.45 (1)	

U-T	0 / 1420	-18.5	-18.5	0.36 (1)	10.00
T-S	0 / 1442	-18.5	-18.5	0.37 (1)	10.00
S-R	0 / 1442	-18.5	-18.5	0.37 (1)	10.00
R-Q	0 / 43	-18.5	-18.5	0.12 (4)	10.00
Q-P	0 / 48	0.0	0.0	0.07 (1)	10.00
P-G	-690 / 0	0.0	0.0	0.09 (1)	6.25
P-O	0 / 1649	-18.5	-18.5	0.41 (1)	10.00
O-N	0 / 2043	-18.5	-18.5	0.47 (1)	10.00
M-N	0 / 17	0.0	0.0	0.10 (1)	10.00
N-I	-137 / 0	0.0	0.0	0.10 (1)	7.81
M-L	0 / 61	-18.5	-18.5	0.02 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.98/1.00 (G-H:1), BC=0.47/1.00 (N-O:1),
WB=0.93/1.00 (C-U:1), SSI=0.32/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.46 (J) (INPUT = 1.00)




Structural component only
DWG# T-2115151

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T5S	1	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:59 2021 Page 2
ID:GzzEEEXDtfkQt BH M?wmsz?k45-x1uUlrGi Qaer u?bAosQ?t?9KvtaSZTIGFrJozEJTU

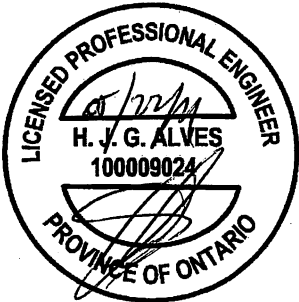PLATES (table is in inches) JT TYPE PLATES W LEN Y X U BMWV1-t MT20 5.0 6.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2x4 SPF #2  Structural component only DWG# T-2115151		
---	--	--

JOB NAME 410887	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:48:00 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-PDSsVBGKjiVT8TC9HJyCQCdkHj0kdxw?PsEzEJT

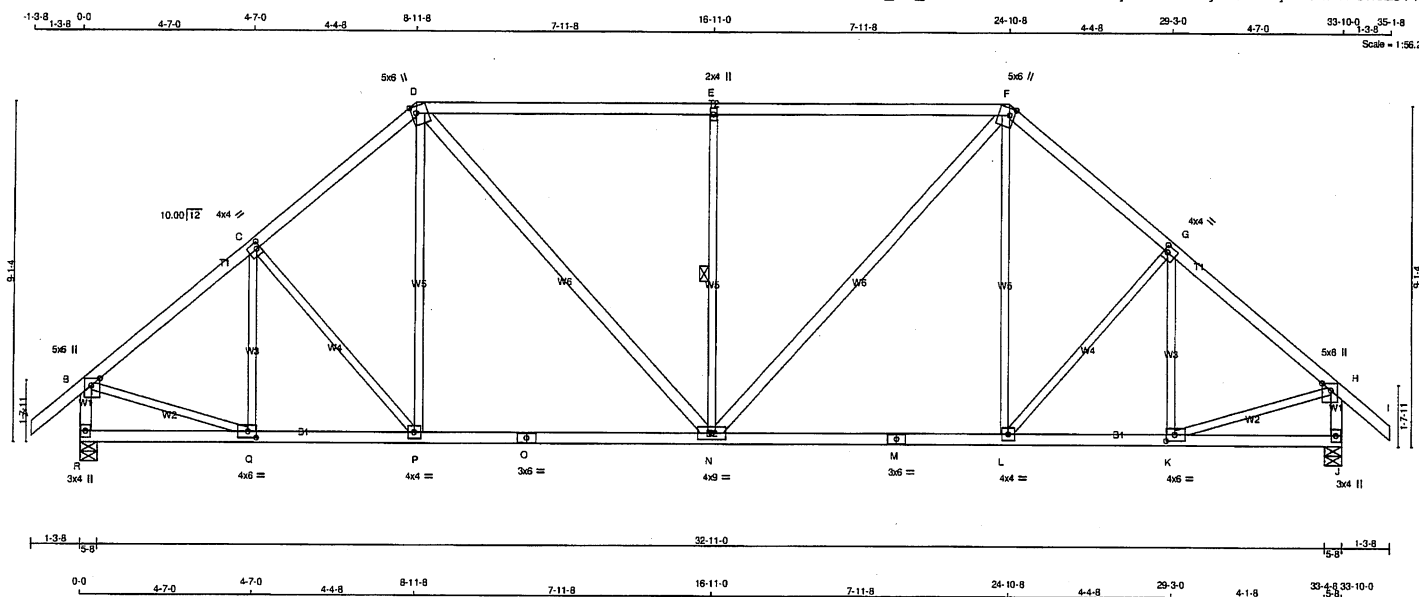

TOTAL WEIGHT = 2 X 163 = 326 lb
(M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	Edge	2.75
C TMVW-t	MT20	4.0	4.0	2.00	1.25
D TTWW+m	MT20	5.0	6.0	2.25	1.50
E TMVW+w	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	6.0	2.25	1.50
G TMVW-t	MT20	4.0	4.0	2.00	1.25
H TMVW+p	MT20	5.0	6.0	Edge	2.75
J BMV1+p	MT20	3.0	4.0		
K BMVW-t	MT20	4.0	6.0	2.00	2.75
L BMVW-t	MT20	4.0	4.0		
M BS-t	MT20	3.0	6.0		
N BMVW-wt	MT20	4.0	9.0		
O BS-t	MT20	3.0	6.0		
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	4.0	6.0	2.00	2.75
R BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES-

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	1992	0	1992	0	0	5-8	5-8		
J	1992	0	1992	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
J	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	Q-C	-348 / 0	0.16 (1)
B-C	-1906 / 0	-91.8 -91.8	0.29 (1)	4.61	C-P	-128 / 0	0.11 (1)
C-D	-1863 / 0	-91.8 -91.8	0.28 (1)	4.66	P-D	0 / 218	0.05 (4)
D-E	-1882 / 0	-91.8 -91.8	0.87 (1)	3.54	D-N	0 / 710	0.11 (1)
E-F	-1882 / 0	-91.8 -91.8	0.87 (1)	3.54	N-E	-899 / 0	0.49 (1)
F-G	-1863 / 0	-91.8 -91.8	0.28 (1)	4.66	N-F	0 / 710	0.11 (1)
G-H	-1906 / 0	-91.8 -91.8	0.29 (1)	4.61	L-F	0 / 218	0.05 (4)
H-I	0 / 41	-91.8 -91.8	0.13 (1)	10.00	L-G	-128 / 0	0.11 (1)
R-B	-1953 / 0	0.0 0.0	0.21 (1)	6.03	K-G	-348 / 0	0.16 (1)
J-H	-1953 / 0	0.0 0.0	0.21 (1)	6.03	B-Q	0 / 1547	0.35 (1)
R-Q	0 / 0	-18.5 -18.5	0.09 (4)	10.00	K-H	0 / 1547	0.35 (1)
Q-P	0 / 1488	-18.5 -18.5	0.33 (1)	10.00			
P-O	0 / 1406	-18.5 -18.5	0.37 (4)	10.00			
O-N	0 / 1406	-18.5 -18.5	0.37 (4)	10.00			
N-M	0 / 1406	-18.5 -18.5	0.37 (4)	10.00			
M-L	0 / 1406	-18.5 -18.5	0.37 (4)	10.00			
L-K	0 / 1488	-18.5 -18.5	0.33 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.87/1.00 (D-E:1), BC=0.37/1.00 (N-P:4), WB=0.49/1.00 (E-N:1), SSI=0.35/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.85 (H) (INPUT = 0.90)
JSI METAL= 0.53 (O) (INPUT = 1.00)



Structural component only
DWG# T-2115152

JOB NAME 410887	TRUSS NAME T7	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MitTek Industries, Inc. Fri May 21 10:48:01 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-tQ0EjXhZw1qM4I2OibqKVQzRj8eq2SHmAakyOhzEJTS

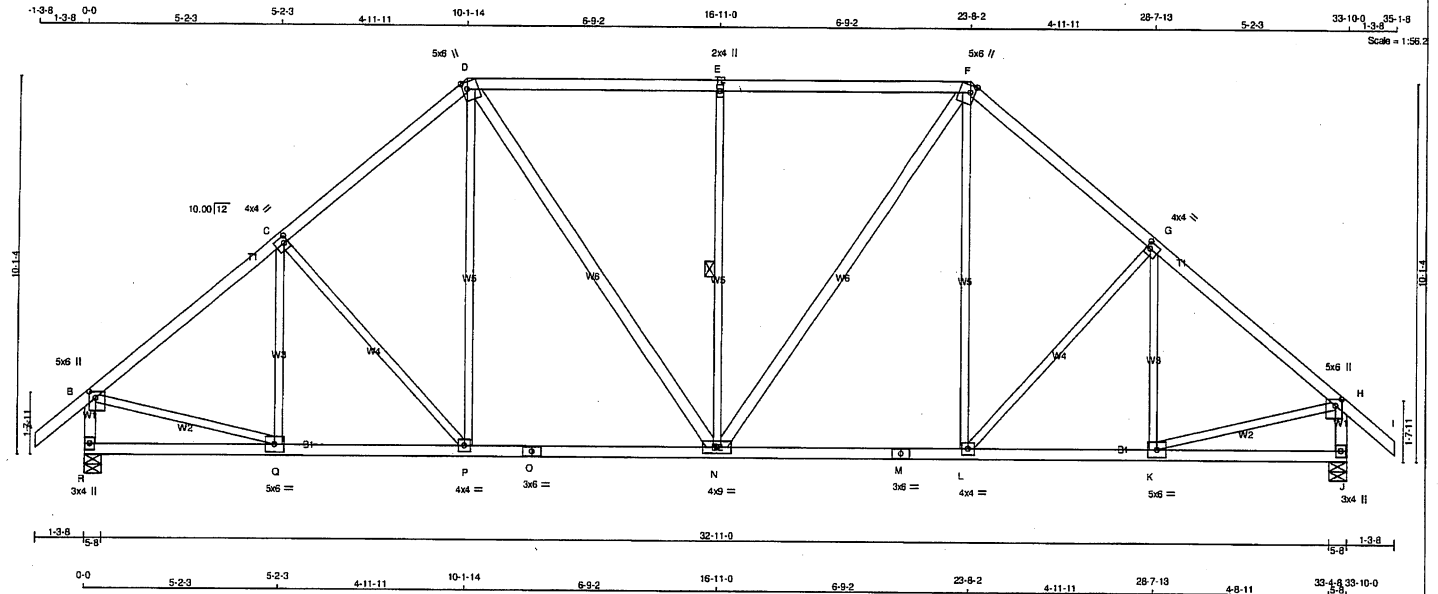

TOTAL WEIGHT = 3 X 169 = 508 lb (M/F)

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00 2.00
C	TMVW-t	MT20	4.0	4.0	2.00 1.25
D	TTWW+m	MT20	5.0	6.0	2.25 1.50
E	TMVW-w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	6.0	2.25 1.50
G	TMVW-t	MT20	4.0	4.0	2.00 1.25
H	TMVW+p	MT20	5.0	6.0	2.00 2.00
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	6.0	
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVWV-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	5.0	6.0	
R	BMV1-p	MT20	3.0	4.0	

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	1992	0	DOWN	0	5-8
J	1992	0	HORIZ	0	5-8

UNFACTORED REACTIONS		1ST LOOSE	MAX/MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1406	936 / 0	0 / 0	0 / 0	0 / 0
J	1406	936 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	Q-C	-283 / 0
B-C	-1933 / 0	-91.8	-91.8 0.38 (1)	C-P	-231 / 0
C-D	-1807 / 0	-91.8	-91.8 0.36 (1)	P-D	0 / 281
D-E	-1667 / 0	-91.8	-91.8 0.59 (1)	D-N	0 / 540
E-F	-1667 / 0	-91.8	-91.8 0.59 (1)	N-E	-761 / 0
F-G	-1807 / 0	-91.8	-91.8 0.36 (1)	N-F	0 / 540
G-H	-1933 / 0	-91.8	-91.8 0.38 (1)	L-F	0 / 281
H-I	0 / 41	-91.8	-91.8 0.13 (1)	L-G	-231 / 0
R-B	-1951 / 0	0.0	0.0 0.21 (1)	K-G	-283 / 0
J-H	-1951 / 0	0.0	0.0 0.21 (1)	B-Q	0 / 1559
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	K-H	0 / 1559
Q-P	0 / 1512	-18.5	-18.5 0.31 (1)		
P-O	0 / 1360	-18.5	-18.5 0.31 (1)		
O-N	0 / 1360	-18.5	-18.5 0.31 (1)		
N-M	0 / 1360	-18.5	-18.5 0.31 (1)		
M-L	0 / 1360	-18.5	-18.5 0.31 (1)		
L-K	0 / 1512	-18.5	-18.5 0.31 (1)		
K-J	0 / 0	-18.5	-18.5 0.10 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.59/1.00 (D-E:1), BC=0.31/1.00 (N-P:1), WB=0.53/1.00 (E-N:1), SS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (H) (INPUT = 0.90)


JSI METAL = 0.44 (O) (INPUT = 1.00)



Structural component only
DWG# T-2115153

JOB NAME 410887	TRUSS NAME T8	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:48:02 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmss?k45-LcacwtbHLyDiSdaGILZ1dVdPYsXnxhvPEUVw7zEJTR

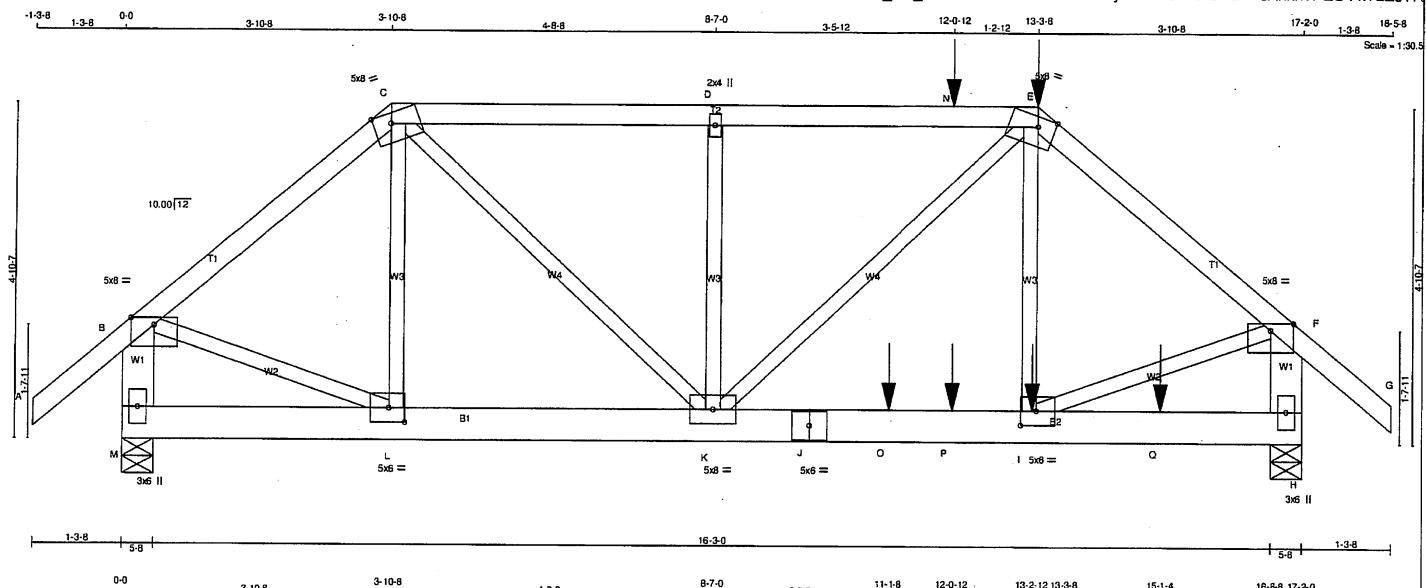

TOTAL WEIGHT = 87 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
M - B	2x6	DRY	No.2	SPF
H - F	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
J - H	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	5.0	8.0	Edge	3.00
D	TMW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	Edge	3.00
F	TMVW-p	MT20	5.0	8.0	Edge	
H	BMV1-p	MT20	3.0	6.0		
I	BMVW-t	MT20	5.0	6.0	2.50	2.75
J	BS-t	MT20	5.0	6.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	5.0	6.0	2.50	2.75
M	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES:

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	GROSS REACTION	BRG	BRG
M	1505	0	1505	0	5-8
H	1992	0	1992	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
M	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
M	1059	722 / 0	0 / 0	0 / 0	337 / 0	0 / 0
H	1402	958 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.14 (1)	L-C	-309 / 0	0.10 (1)	
B-C	-1315 / 0	-91.8 -91.8	0.30 (1)	C-K	0 / 1170	0.29 (1)	
C-D	-1848 / 0	-91.8 -91.8	0.47 (1)	K-D	-546 / 0	0.19 (1)	
D-N	-1848 / 0	-91.8 -91.8	0.47 (1)	E-K	0 / 449	0.11 (1)	
N-E	-1848 / 0	-91.8 -91.8	0.47 (1)	I-E	0 / 297	0.07 (1)	
E-F	-1978 / 0	-91.8 -91.8	0.35 (1)	B-L	0 / 1053	0.26 (1)	
F-G	0 / 41	-91.8 -91.8	0.14 (1)	I-F	0 / 1585	0.39 (1)	
M-B	-1459 / 0	0.0 0.0	0.11 (1)				
H-F	-2041 / 0	0.0 0.0	0.15 (1)				
M-L	0 / 0	-18.5 -18.5	0.04 (1)	10.00			
L-K	0 / 1000	-18.5 -18.5	0.34 (1)	10.00			
K-J	0 / 1522	-18.5 -18.5	0.80 (1)	10.00			
J-O	0 / 1522	-18.5 -18.5	0.80 (1)	10.00			
O-P	0 / 1522	-18.5 -18.5	0.80 (1)	10.00			
P-I	0 / 1522	-18.5 -18.5	0.80 (1)	10.00			
I-Q	0 / 0	-18.5 -18.5	0.28 (1)	10.00			
Q-H	0 / 0	-18.5 -18.5	0.28 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	13-3-8	-175	-175	---	FRONT	VERT	TOTAL	C1
I	13-2-12	-14	-14	---	FRONT	VERT	TOTAL	C1
N	12-0-12	-59	-59	---	FRONT	VERT	TOTAL	C1
O	11-1-8	-671	-671	---	FRONT	VERT	TOTAL	C1
P	12-0-12	-14	-14	---	FRONT	VERT	TOTAL	C1
Q	15-1-4	-14	-14	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.47/1.00 (D-E:1), BC=0.80/1.00 (I-K:1), WB=0.39/1.00 (F-I:1), SS=0.40/1.00 (H-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.82 (C) (INPUT = 0.90)
JSI METAL = 0.58 (J) (INPUT = 1.00)



Structural component only
DWG# T-2115154

JOB NAME 410887	TRUSS NAME T9	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:48:03 2021 Page 1
ID:GzzEEXDtKtQt_BH_M?wmsz?k45-po8?6CJD2e44KcCnq0soar2pvyMEWSw3duD3SzEJtQ

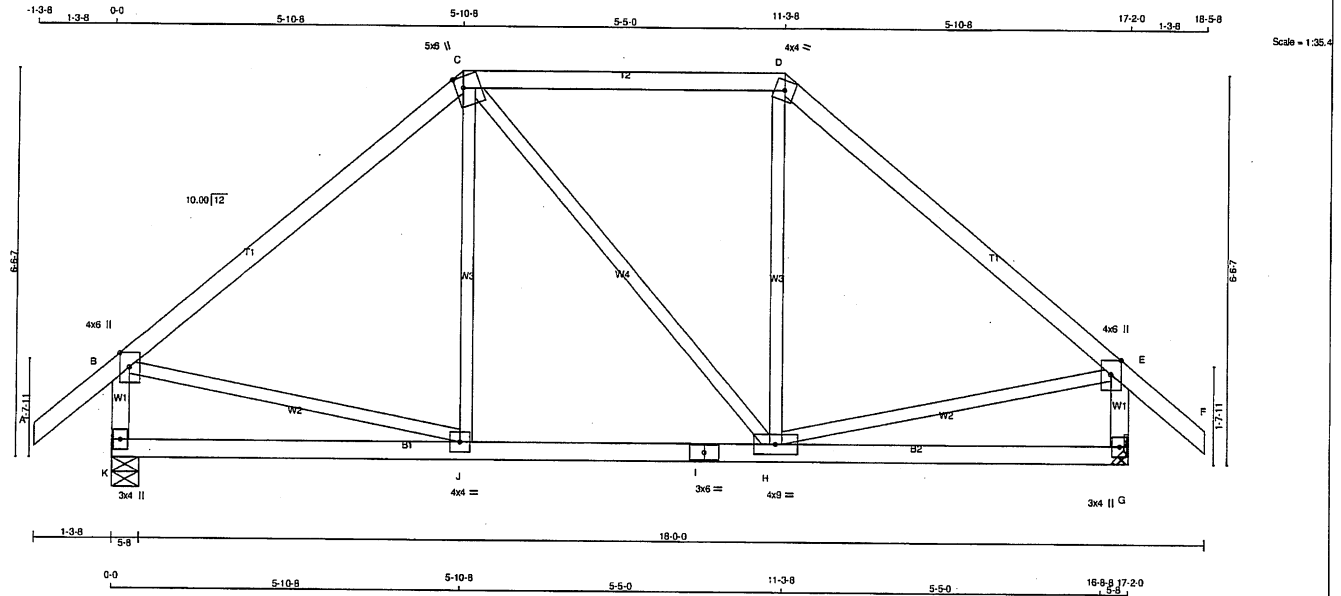

TOTAL WEIGHT = 76 lb [M/F]

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	6.0	Edge		
C TTW+m	MT20	5.0	6.0	2.25	1.50	
D TTW-m	MT20	4.0	4.0			
E TMVW+p	MT20	4.0	6.0	Edge		
G BMV1+p	MT20	3.0	4.0			
H BMVWV-t	MT20	4.0	9.0			
I BS-t	MT20	3.0	6.0			
J BMVW-t	MT20	4.0	4.0			
K BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	1073	0	1073	0
G	1073	0	1073	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
G	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.24 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE	VERT.	LC1	MAX	UNBRAC	W E B S	MEMB.	FORCE	MAX
		(LBS)			(PLF)	LENGTH			(LBS)	(LC)
FR-TO			FROM	TO			FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	J-C	-19 / 80	0.03 (4)		
B-C	-779 / 0	-91.8	-91.8	0.42 (1)	6.24	C-H	0 / 2	0.00 (4)		
C-D	-598 / 0	-91.8	-91.8	0.35 (1)	6.25	H-D	-17 / 81	0.03 (4)		
D-E	-780 / 0	-91.8	-91.8	0.42 (1)	6.24	B-J	0 / 612	0.14 (1)		
E-F	0 / 41	-91.8	-91.8	0.13 (1)	10.00	H-E	0 / 612	0.14 (1)		
K-B	-1027 / 0	0.0	0.0	0.11 (1)	7.74					
G-E	-1027 / 0	0.0	0.0	0.11 (1)	7.74					
K-J	0 / 0	-18.5	-18.5	0.13 (4)	10.00					
J-I	0 / 597	-18.5	-18.5	0.19 (4)	10.00					
I-H	0 / 597	-18.5	-18.5	0.19 (4)	10.00					
H-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.42/1.00 (D-E:1), BC=0.19/1.00 (H-J:4), WB=0.14/1.00 (E-H:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)	
	MAX MIN	MAX MIN	MAX MIN	
	MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.67 (J) (INPUT = 0.90)
JSI METAL= 0.43 (E) (INPUT = 1.00)



Structural component only
DWG# T-2115155

JOB NAME 410887	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 Mittek Industries, Inc. Fri May 21 10:48:04 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-H?INLYKroyCxxmnzOjO172b1eLgIFosCsYzc?0zEJTP

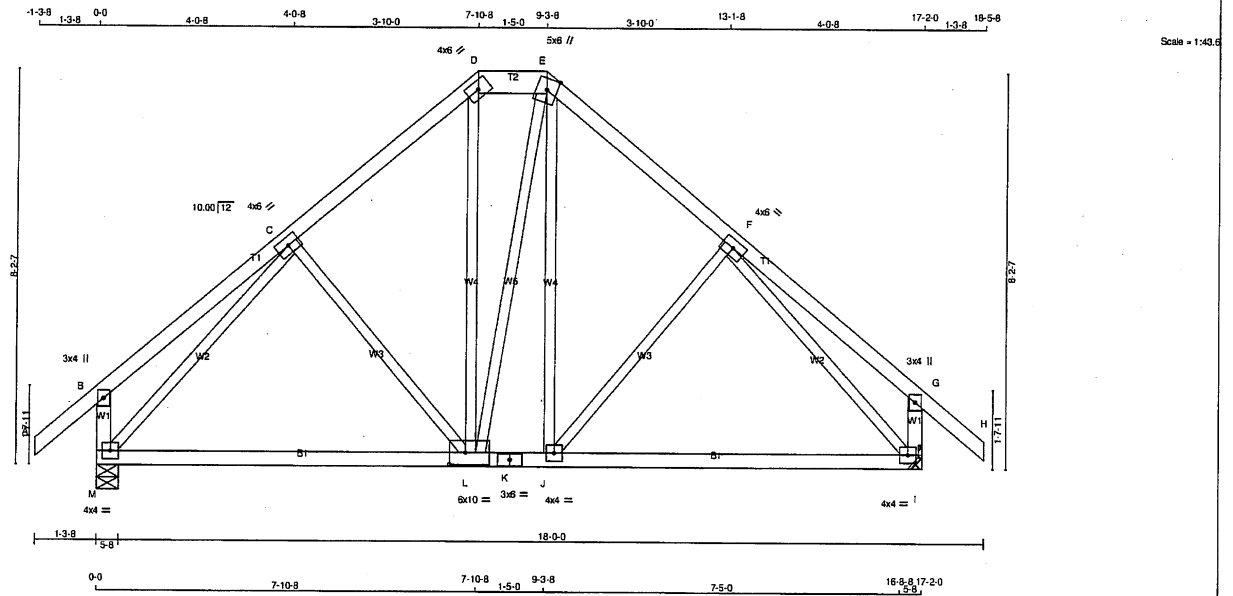

TOTAL WEIGHT = 89 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x6	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTW-h	MT20	4.0	6.0		
E	TTWW+m	MT20	5.0	6.0	Edge	
F	TMWW-t	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	4.0		
J	BMWW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	6.0		
L	BMVW1-t	MT20	6.0	10.0	3.00	4.00
M	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
M	1073	0	1073	0
I	1073	0	1073	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
I	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 41	-91.8 -91.8 0.13 (1)	C-L	-175 / 0
B-C	0 / 27	-91.8 -91.8 0.23 (1)	L-D	0 / 234
C-D	-715 / 0	-91.8 -91.8 0.18 (1)	L-E	0 / 5
D-E	-527 / 0	-91.8 -91.8 0.01 (1)	J-E	0 / 229
E-F	-714 / 0	-91.8 -91.8 0.18 (1)	J-F	-176 / 0
F-G	0 / 27	-91.8 -91.8 0.23 (1)	M-C	-989 / 0
G-H	0 / 41	-91.8 -91.8 0.13 (1)	F-I	-988 / 0
M-B	-264 / 0	0.0 0.0 0.03 (1)		
I-G	-264 / 0	0.0 0.0 0.03 (1)		
M-L	0 / 644	-18.5 -18.5 0.30 (4)		
L-K	0 / 526	-18.5 -18.5 0.30 (4)		
K-J	0 / 526	-18.5 -18.5 0.30 (4)		
J-I	0 / 643	-18.5 -18.5 0.29 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (F-G:1), BC=0.30/1.00 (L-M:4), WB=0.61/1.00 (C-M:1), SS=0.13/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 786 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (K) (INPUT = 0.90)
JSI METAL= 0.54 (K) (INPUT = 1.00)




Structural component only
DWG# T-2115156

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T11	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:48:05 2021 Page 1
ID:GzzEEXDtKtQt_BH_M?wlmSz?k45-IBGIyukTZGKoZvM9xQvGfG7Bil1_D3M5Ci9XSzEJTC

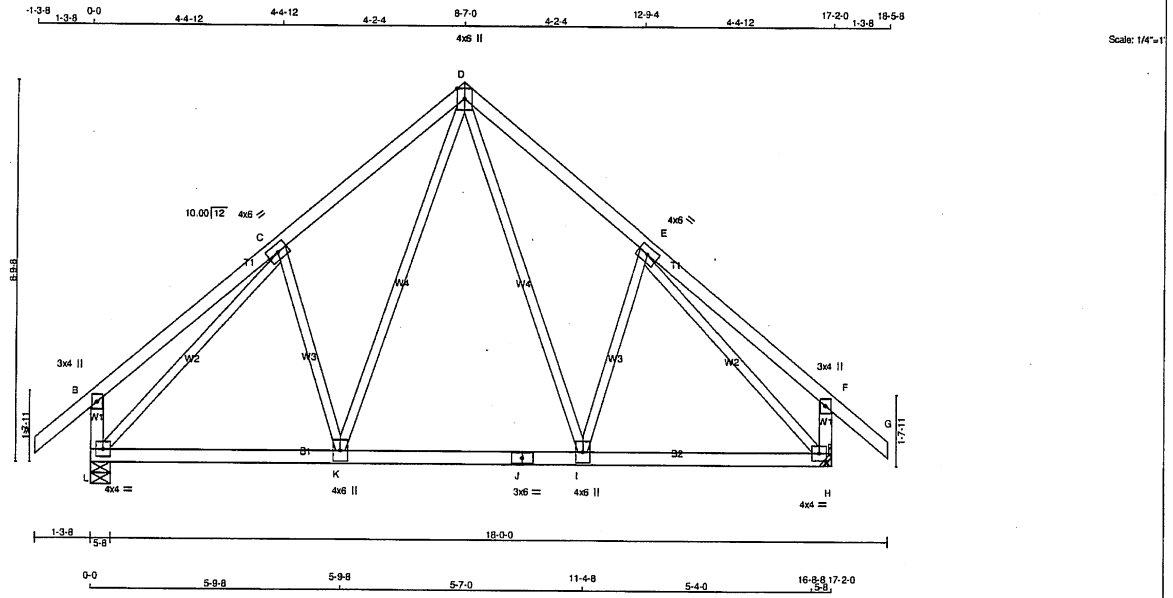

TOTAL WEIGHT = 84 lb [M/F]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMWW-t	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMWW1-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	6.0		
L	BMWW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
L	1073	0	0	5-8
H	1073	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
L	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
H	757	510 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	D-I	0 / 356	0.08 (1)	
B-C	0 / 30	-91.8	-91.8 0.27 (1)	I-E	-235 / 0	0.11 (1)	
C-D	-797 / 0	-91.8	-91.8 0.22 (1)	K-D	0 / 356	0.08 (1)	
D-E	-797 / 0	-91.8	-91.8 0.22 (1)	C-K	-235 / 0	0.11 (1)	
E-F	0 / 30	-91.8	-91.8 0.27 (1)	L-C	-1003 / 0	0.74 (1)	
F-G	0 / 41	-91.8	-91.8 0.13 (1)	E-H	-1003 / 0	0.74 (1)	
L-B	-275 / 0	0.0	0.0 0.03 (1)				
H-F	-275 / 0	0.0	0.0 0.03 (1)				
L-K	0 / 661	-18.5	-18.5 0.19 (4)				
K-J	0 / 478	-18.5	-18.5 0.18 (4)				
J-I	0 / 478	-18.5	-18.5 0.18 (4)				
I-H	0 / 661	-18.5	-18.5 0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.57")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.57")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.27/1.00 (B-C:1), BC=0.19/1.00 (K-L:4), WB=0.74/1.00 (C-L:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (L) (INPUT = 0.90)
JSI METAL = 0.25 (E) (INPUT = 1.00)




Structural component only
DWG# T-2115157

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T12	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mittek Industries, Inc. Fri May 21 10:48:06 2021 Page 1
ID:GzzEEXDtKt_BH_M?wlmz?k45-DNp7mEL5KZSeB3xMV8QVCTgL99NQjqkVKsSj3uzEJTN

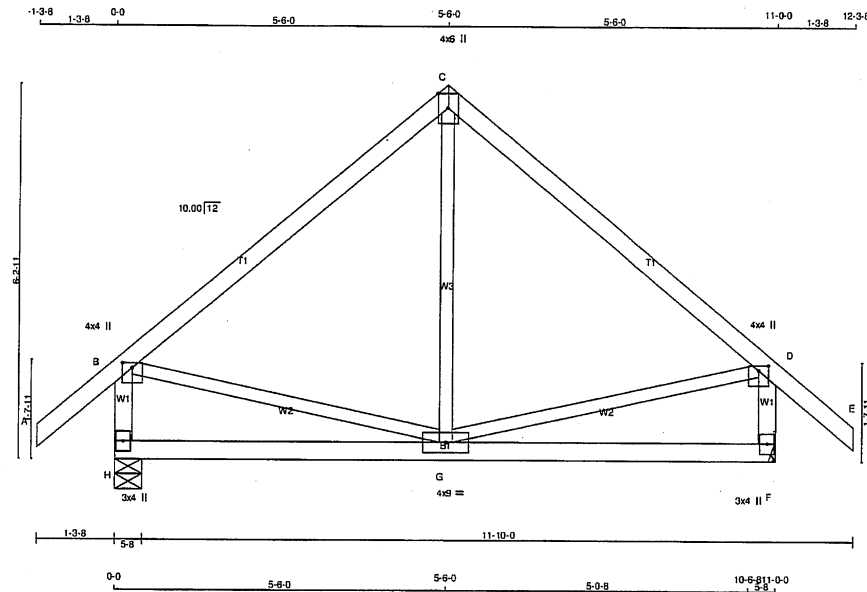

Scale = 1/32"

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. **DESIGN CRITERIA** SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF TOTAL WEIGHT = 2 X 49 = 98 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
H - B	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	733	0	733	0	0	5-8	5-8
F	733	0	733	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	516	352 / 0	0 / 0	0 / 0	0 / 0	164 / 0	0 / 0
F	516	352 / 0	0 / 0	0 / 0	0 / 0	164 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	G-C	-14 / 90	0.03 (4)
B-C	-383 / 0	-91.8 -91.8	0.36 (1)	6.25	B-G	0 / 302	0.07 (1)
C-D	-383 / 0	-91.8 -91.8	0.36 (1)	6.25	G-D	0 / 302	0.07 (1)
D-E	0 / 41	-91.8 -91.8	0.13 (1)	10.00			
H-B	-694 / 0	0.0 0.0	0.07 (1)	7.81			
F-D	-694 / 0	0.0 0.0	0.07 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.16 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.16 (4)	10.00			

DESIGN CRITERIA

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

SPACING = 24.0 IN./C

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.36/1.00 (B-C:1), BC=0.16/1.00 (G-H:4), WB=0.07/1.00 (B-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115158

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T12S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:48:07 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-laNVzaMj5bVoDVY3rxkkhDZ7ZkBSHAeYWBGbKzEJTM

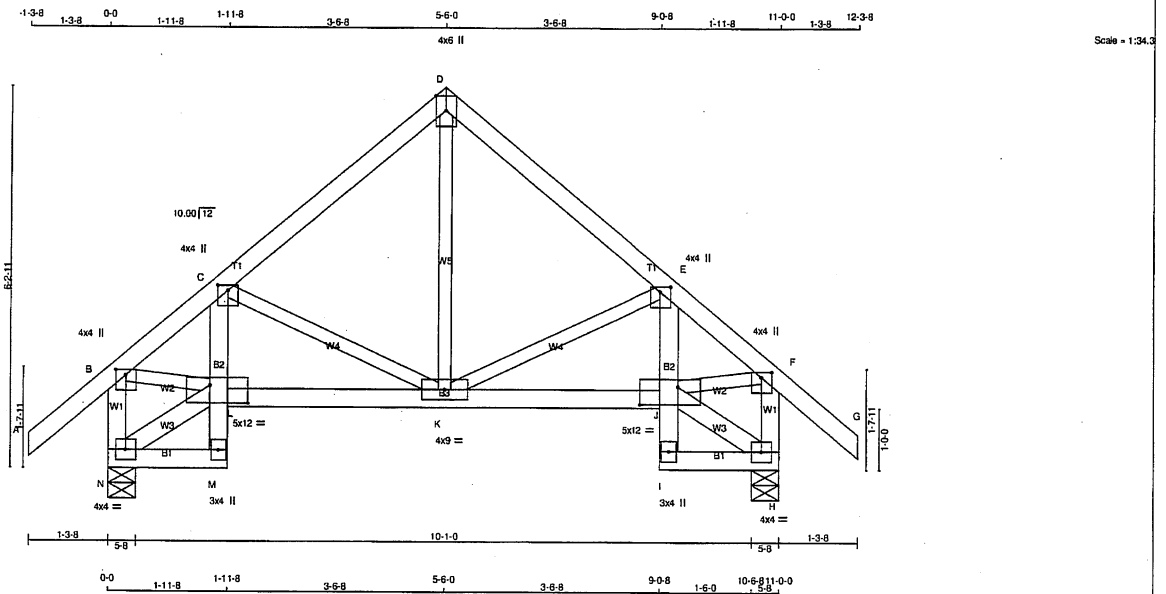

TOTAL WEIGHT = 2 X 58 = 116 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								DESIGN CRITERIA	
CHORDS	SIZE	LUMBER	DESCR.	BEARINGS								SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD					TOP CH. LL = 25.6 PSF
D - B	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG					DL = 6.0 PSF
N - B	2x4	DRY	No.2	SPF	JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
H - F	2x4	DRY	No.2	SPF	N	733	0	733	0	5-8	5-8		
N - M	2x4	DRY	No.2	SPF	H	733	0	733	0	0	5-8		
M - C	2x4	DRY	No.2	SPF									DL = 7.4 PSF
L - E	2x4	DRY	No.2	SPF									TOTAL LOAD = 39.0 PSF
I - E	2x4	DRY	No.2	SPF									
I - H	2x4	DRY	No.2	SPF									
ALL WEBS	2x3	DRY	No.2	SPF									
EXCEPT				SPF									
N - L	2x4	DRY	No.2	SPF									
J - H	2x4	DRY	No.2	SPF									

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B, C, E, F					
B TMVW+p	MT20	4.0	4.0	1.00	2.00
D TTW+p	MT20	4.0	6.0	Edge	
H BMVW-1	MT20	4.0	4.0		
I BMV+p	MT20	3.0	4.0		
J BMVW-1	MT20	5.0	12.0	3.50	7.50
K BMVW-1	MT20	4.0	9.0		
L BMVW-1	MT20	5.0	12.0	3.50	7.50
M BMV+p	MT20	3.0	4.0		
N BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES

1) Lateral braces to be a minimum of 2x4 SPF #2

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	K-D	0 / 258	0.06 (1)
B-C	-691 / 0	-91.8	-91.8 0.10 (1)	6.25	K-E	-238 / 0	0.07 (1)
C-D	-444 / 0	-91.8	-91.8 0.15 (1)	6.25	C-K	-238 / 0	0.07 (1)
D-E	-444 / 0	-91.8	-91.8 0.15 (1)	6.25	N-L	-20 / 0	0.00 (1)
E-F	-691 / 0	-91.8	-91.8 0.10 (1)	6.25	B-L	0 / 534	0.12 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	J-H	-20 / 0	0.00 (1)
N-B	-706 / 0	0.0	0.0 0.08 (1)	7.81	J-F	0 / 534	0.12 (1)
H-F	-706 / 0	0.0	0.0 0.08 (1)	7.81			
N-M	0 / 17	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 19	0.0	0.0 0.03 (1)	10.00			
L-C	-3 / 32	0.0	0.0 0.02 (4)	10.00			
L-K	0 / 543	-18.5	-18.5 0.13 (1)	10.00			
K-J	0 / 543	-18.5	-18.5 0.13 (1)	10.00			
I-J	0 / 19	0.0	0.0 0.03 (1)	10.00			
J-E	-3 / 32	0.0	0.0 0.02 (4)	10.00			
I-H	0 / 17	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.37")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.37")

CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15/1.00 (C-D:1), BC=0.13/1.00 (K-L:1),

WB=0.12/1.00 (B-L:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (F) (INPUT = 0.90)

JSI METAL= 0.21 (F) (INPUT = 1.00)

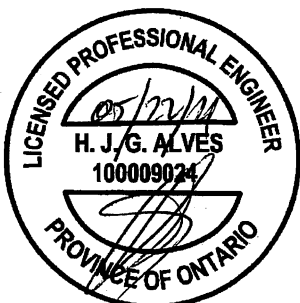


Structural component only
DWG# T-2115159

JOB NAME 410887	TRUSS NAME T13	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 10:48:08 2021 Page 1
ID:GzzEEXDthKQI_BH_M?wlmisz7k45-AmxuBwNmSBJMQN4kdZSszHuIBz1WBIXonAxq8nzEJTL

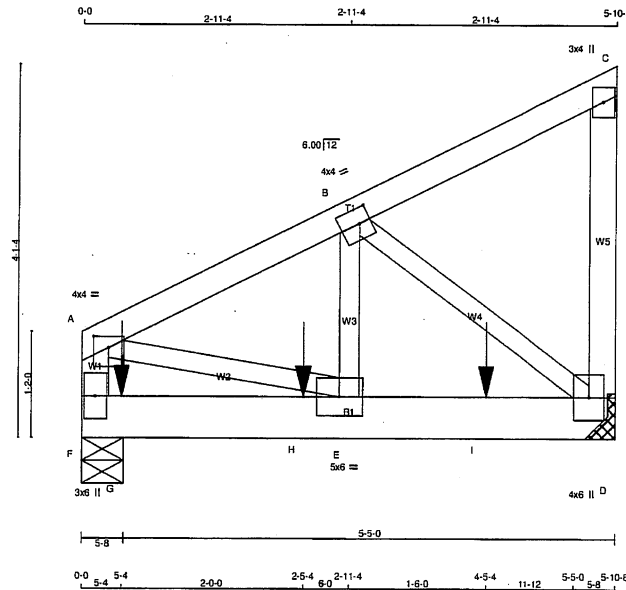

Scale = 1:23

TOTAL WEIGHT = 2 X 29 = 58 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	6	SIDE(305.2)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	4.0	1.50	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TMVW-p	MT20	3.0	4.0		
D	BMVW1-p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	2181	0	2181	0
D	1637	0	1637	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1535	1046 / 0	0 / 0	0 / 0	0 / 0	0 / 0	490 / 0	0 / 0
D	1153	785 / 0	0 / 0	0 / 0	0 / 0	0 / 0	368 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
F-A	-1212 / 0	0.0	0.0 0.07 (1)	A-E	0 / 1487	0.18 (1)	
A-B	-1598 / 0	-91.8	-91.8 0.06 (1)	E-B	0 / 1504	0.19 (1)	
B-C	-10 / 0	-91.8	-91.8 0.05 (1)	B-D	-1810 / 0	0.22 (1)	
D-C	-113 / 0	0.0	0.0 0.01 (1)				
F-G	0 / 0	-18.5	-18.5 0.16 (1)				
G-H	0 / 0	-18.5	-18.5 0.16 (1)				
H-E	0 / 0	-18.5	-18.5 0.16 (1)				
E-I	0 / 1438	-18.5	-18.5 0.31 (1)				
I-D	0 / 1438	-18.5	-18.5 0.31 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	5-4	-746	-746	---	BACK	VERT	TOTAL	---	C1
H	2-5-4	-742	-742	---	BACK	VERT	TOTAL	---	C1
I	4-5-4	-742	-742	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

CS: TC=0.07/1.00 (A-F:1), BC=0.31/1.00 (D-E:1), WB=0.22/1.00 (B-D:1), SS=0.40/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (B) (INPUT = 0.90)
JSI METAL= 0.32 (D) (INPUT = 1.00)



Structural component only
DWG# T-2115160

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410887	T13	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:48:08 2021 Page 2
ID:GzzEEXDtIkQt BH M?wlmsz?k45-AmxuBwNMsbjMON4kdZSzHulBz1WBixonAxc8nzEJTL

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2



Structural component only
DWG# T-2115160 *nr*

JOB NAME 410888	TRUSS NAME T13Z	QUANTITY 2	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:25 2021 Page 1 ID:GzzEEXDfKQt_BH_M?wlmz7k45-TKenXDM5ySeYvcJyZY3Q3WGfDOPVzEbMaTPzzEJ0y			

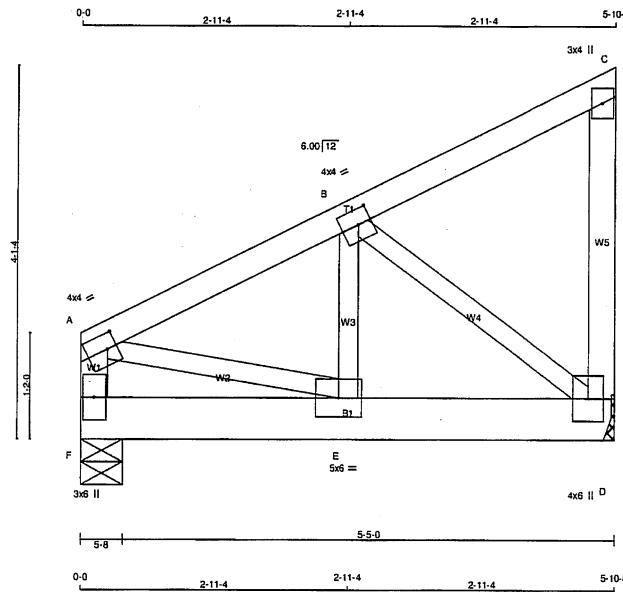

TOTAL WEIGHT = 4 X 29 = 115 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS		2x3	DRY	No.2
DRY: SEASONED LUMBER.				SPF

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE(53.4)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	2.00	1.25
B	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

NOTES (1)

(1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
F	638	0	638	0
D	638	0	638	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	451	296 / 0	0 / 0	0 / 0	0 / 0	155 / 0	0 / 0
D	451	296 / 0	0 / 0	0 / 0	0 / 0	155 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH
FR-TO		FROM TO			FR-TO		
F-A	-477 / 0	0.0	0.0	0.03 (1)	7.81	A-E	0 / 504
A-B	-531 / 0	-91.8	-91.8	0.07 (1)	6.25	E-B	0 / 287
B-C	-13 / 0	-91.8	-91.8	0.07 (1)	6.25	B-D	-613 / 0
D-C	-105 / 0	0.0	0.0	0.01 (1)	7.81		
F-E	0 / 0	-125.3	-125.3	0.04 (1)	10.00		
E-D	0 / 487	-125.3	-125.3	0.07 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

GIRDER TYPE: CSldGirder
START DISTANCE = 0-0
START SPAN CARRIED = 6-0-0
END DISTANCE = 5-10-8
END SPAN CARRIED = 6-0-0
END WALL WIDTH = 1-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL(LL) = $L/999$ (0.00")
ALLOWABLE DEFL(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL(TL) = $L/999$ (0.01")

CSI: TC=0.07/1.00 (A-B:1), BC=0.07/1.00 (D-E:1), WB=0.07/1.00 (B-D:1), SS=0.07/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.42 (A) (INPUT = 0.90)
JSI METAL = 0.11 (D) (INPUT = 1.00)



Structural component only
DWG# T-2115164

JOB NAME 410888	TRUSS NAME T13Z1	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:26 2021 Page 1			

ID:GzzEEXDtKQt_BH_M?wimsz?k45-xWo9kZnjmmPXm387N4IzG2SvpX08xYOq0K1xPzEJ0x

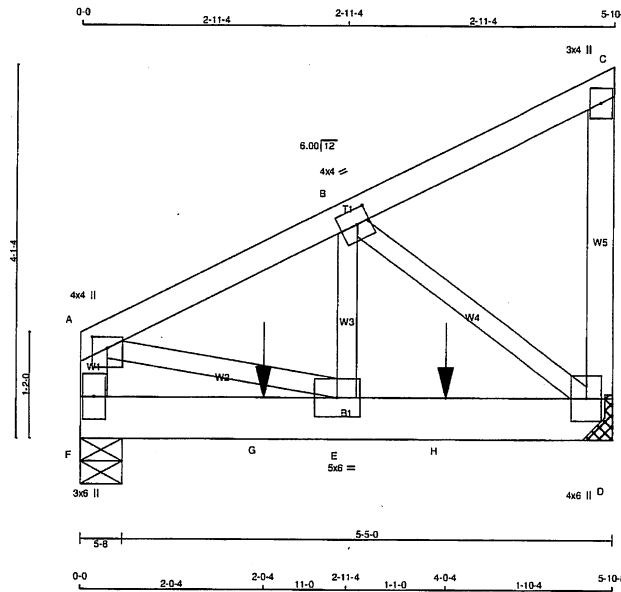

TOTAL WEIGHT = 2 X 29 = 58 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	1 12	TOP
A - C	1 12	TOP
C - D	1 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	2 12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.50	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TMV+p	MT20	3.0	4.0		
D	BMVW+1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX
F	1225	0	1225	0	0	5-8	5-8
D	1278	0	1278	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	865	577 / 0	0 / 0	0 / 0	0 / 0	288 / 0	0 / 0
D	902	602 / 0	0 / 0	0 / 0	0 / 0	300 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 MAX CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-A	-1028 / 0	0.0	0.0 0.06 (1)	A-E	0 / 1242	0.15 (1)	
A-B	-1332 / 0	-91.8	-91.8 0.06 (1)	E-B	0 / 1200	0.15 (1)	
B-C	-11 / 0	-91.8	-91.8 0.05 (1)	B-D	-1511 / 0	0.18 (1)	
D-C	-111 / 0	0.0	0.0 0.01 (1)				
F-G	0 / 0	-18.5	-18.5 0.13 (1)				
G-E	0 / 0	-18.5	-18.5 0.13 (1)				
E-H	0 / 1201	-18.5	-18.5 0.24 (1)				
H-D	0 / 1201	-18.5	-18.5 0.24 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1
H	4-0-4	-654	-654	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.06/1.00 (A-B:1), BC=0.24/1.00 (D-E:1), WB=0.18/1.00 (B-D:1), SSI=0.26/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (B) (INPUT = 0.90)
JSI METAL= 0.27 (D) (INPUT = 1.00)

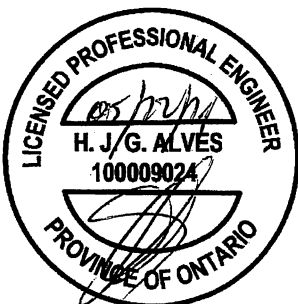

Structural component only
DWG# T-2115165

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410888	T1321	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:26 2021 Page 2
ID:GzzEEEXDtkQt BH M?wlrmsz?k45-xWo9kZnjrmPXm387N4lzG2SVpX08xYOq0K1xPzEJ0x

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2




Structural component only
DWG# T-2115165 *21*

JOB NAME 410887	TRUSS NAME T14	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

ID:GzzEEXDtKt BH_M?wlmz?k45-eyVGOGN_dUrD2XfwAGzCq6lvzMNwCYx0qgNgDzEJTK

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:48:09 2021 Page 1

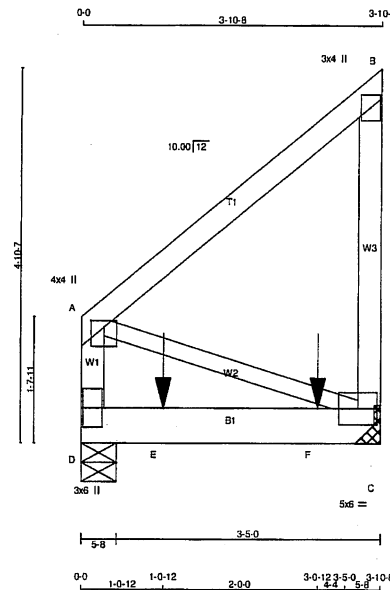

Scale = 1:27.3

TOTAL WEIGHT = 2 X 22 = 43 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
C - B	2x4	DRY	No.2
D - C	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D - A	12	TOP
A - B	12	TOP
B - C	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D - C	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
B	TMV+p	MT20	3.0	4.0	
C	BMVW1-t	MT20	5.0	6.0	
D	BMV1+p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
D	883	0	883	0
C	976	0	976	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	620	429 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0
C	686	474 / 0	0 / 0	0 / 0	0 / 0	212 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
D-A	-178 / 0	0.0	0.0 0.01 (1)	A-C	0 / 0	0.00 (1)	
A-B	0 / 0	-91.8	-91.8 0.13 (1)				
C-B	-178 / 0	0.0	0.0 0.03 (1)				
D-E	0 / 0	-18.5	-18.5 0.27 (1)				
E-F	0 / 0	-18.5	-18.5 0.27 (1)				
F-C	0 / 0	-18.5	-18.5 0.27 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-0-12	-502	-502	---	BACK	VERT	TOTAL	---	C1
F	3-0-12	-503	-503	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.13/1.00 (A-B:1), BC=0.27/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115161

JOB NAME 410888	TRUSS NAME T20S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitak Industries, Inc. Fri May 21 11:18:27 2021 Page 1
ID:GzzEEXDfKQI_BH_M?wmsz?k45-PiLYvNLU3uG9weKg4bXVubWKDEIOX3g3aTrzEJOw

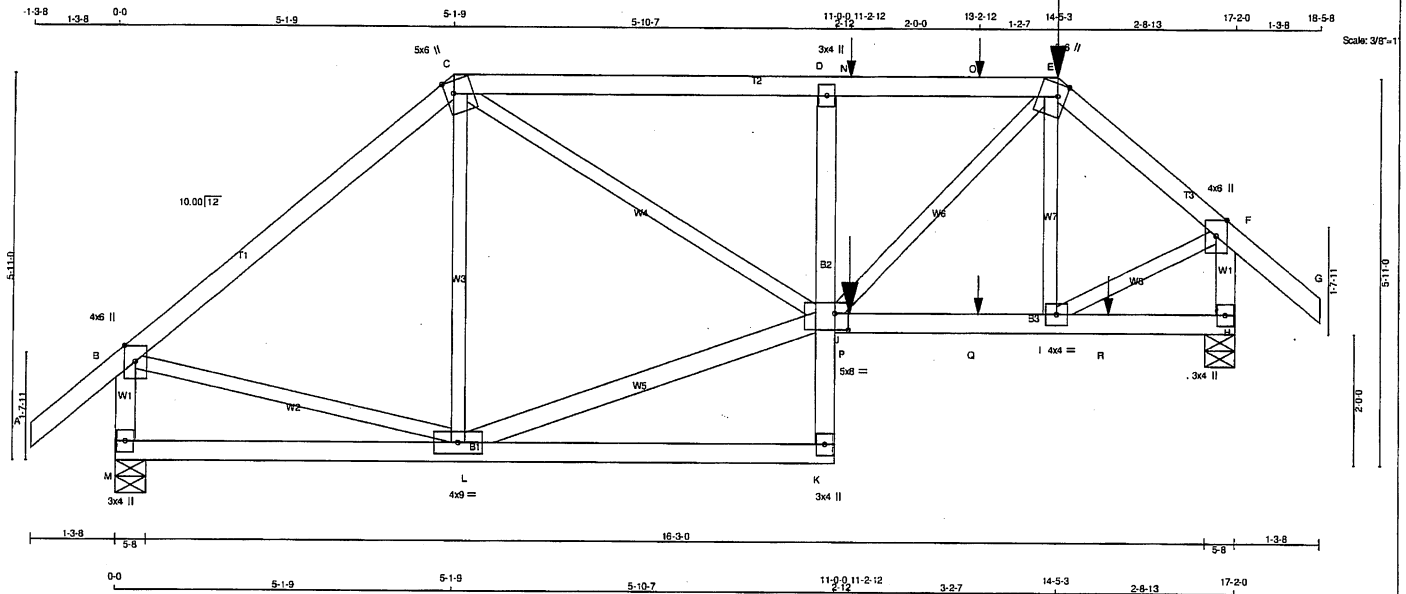

TOTAL WEIGHT = 84 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
K - D	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
L - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMV+p	MT20	3.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-i	MT20	4.0	4.0		
J	BMVW-i	MT20	5.0	8.0	3.00	2.50
K	BMV+p	MT20	3.0	4.0		
L	BMVW-i	MT20	4.0	9.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES - (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1091	0	1091	0	0	5-8	5-8	5-8	5-8
H	1158	0	1158	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	769	519 / 0	0 / 0	0 / 0	0 / 0	250 / 0	0 / 0	0 / 0
H	815	555 / 0	0 / 0	0 / 0	0 / 0	261 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS			WEBS						
MEMB.	FORCE	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FORCE	MAX
	(LBS)	(PLF)			CSI (LC)	UNBRAC		(LBS)	CSI (LC)
FR-TO		FROM	TO			LENGTH	FR-TO		
A-B	0 / 41	-91.8	-91.8	0.14 (1)		10.00	L-C	-257 / 5	0.14 (1)
B-C	-836 / 0	-91.8	-91.8	0.50 (1)		5.87	L-J	0 / 655	0.12 (1)
C-D	-1162 / 0	-91.8	-91.8	0.46 (1)		5.25	C-J	0 / 634	0.16 (1)
D-N	-1168 / 0	-92.7	-92.7	0.43 (1)		5.24	J-E	0 / 701	0.17 (1)
N-O	-1168 / 0	-92.7	-92.7	0.43 (1)		5.24	I-E	-239 / 0	0.06 (1)
O-E	-1168 / 0	-92.7	-92.7	0.43 (1)		5.24	B-L	0 / 659	0.16 (1)
E-F	-891 / 0	-91.8	-91.8	0.14 (1)		6.25	I-F	0 / 750	0.19 (1)
F-G	0 / 41	-91.8	-91.8	0.14 (1)		10.00			
M-B	-1052 / 0	0.0	0.0	0.12 (1)		7.64			
H-F	-1139 / 0	0.0	0.0	0.13 (1)		7.42			
M-L	0 / 0	-18.5	-18.5	0.17 (4)		10.00			
L-K	0 / 12	-18.5	-18.5	0.17 (4)		10.00			
K-J	0 / 42	0.0	0.0	0.04 (1)		10.00			
J-D	-540 / 0	0.0	0.0	0.06 (1)		7.81			
J-P	0 / 675	-18.7	-18.7	0.15 (1)		10.00			
P-Q	0 / 675	-18.7	-18.7	0.15 (1)		10.00			
Q-I	0 / 675	-18.7	-18.7	0.15 (1)		10.00			
I-R	0 / 0	-18.7	-18.7	0.06 (4)		10.00			
R-H	0 / 0	-18.7	-18.7	0.06 (4)		10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
E	14-5-3	-29	-29	---	FRONT	VERT	TOTAL	C1
E	14-5-3	-7	-7	---	FRONT	VERT	DEAD	C1
E	14-5-3	-28	-28	---	FRONT	VERT	SNOW	C1
N	11-2-12	1	1	78	FRONT	VERT	TOTAL	C1
O	13-2-12	1	1	78	FRONT	VERT	TOTAL	C1
P	11-2-12	-4	-4	---	FRONT	VERT	TOTAL	C1
Q	13-2-12	1	1	---	FRONT	VERT	TOTAL	C1
R	15-2-12	1	1	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

GIRDER TYPE: CPrimeHip

LEFT SETBACK = 0-0

RIGHT SETBACK = 2-8-13

END SETBACK = 2-6-0

END WALL WIDTH = 5-8

CORNER FRAMING TYPE: CONVENTIONAL

END JACK TYPE: CONVENTIONAL

APPLIED TO FRONT SIDE

- ADDTL. LOADS BASED ON 55 % OF GSL.

LOADS APPLIED TO FIRST 6-2-0 OF SPAN

MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL

LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-14

- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.57")

CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")

ALLOWABLE DEFL.(TL) = L/360 (0.57")

CALCULATED VERT. DEFL.(TL) = L/ 999 (0.06")

CSI: TC=0.50/1.00 (B-C:1), BC=0.17/1.00 (K-L:4),

WB=0.19/1.00 (F-I:1), SSI=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

CONTINUED ON PAGE 2



Structural component only
DWG# T-2115166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410888	T20S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 11:18:27 2021 Page 2
ID:GzzEEEXDtfkQt BH M?wlmsz?k45-PiLYyvNLU3uG9weKq4bXVUUbWKDtEiOjX3g3aTrzEJ0w

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	650 371	1747 788	1987 1873


PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.
JSI GRIP= 0.83 (C) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115166

JOB NAME 410888	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:28 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-tvw9EOzFN07m3DXEo6m2h7kLcB1cfihKp8?HzEJ0v

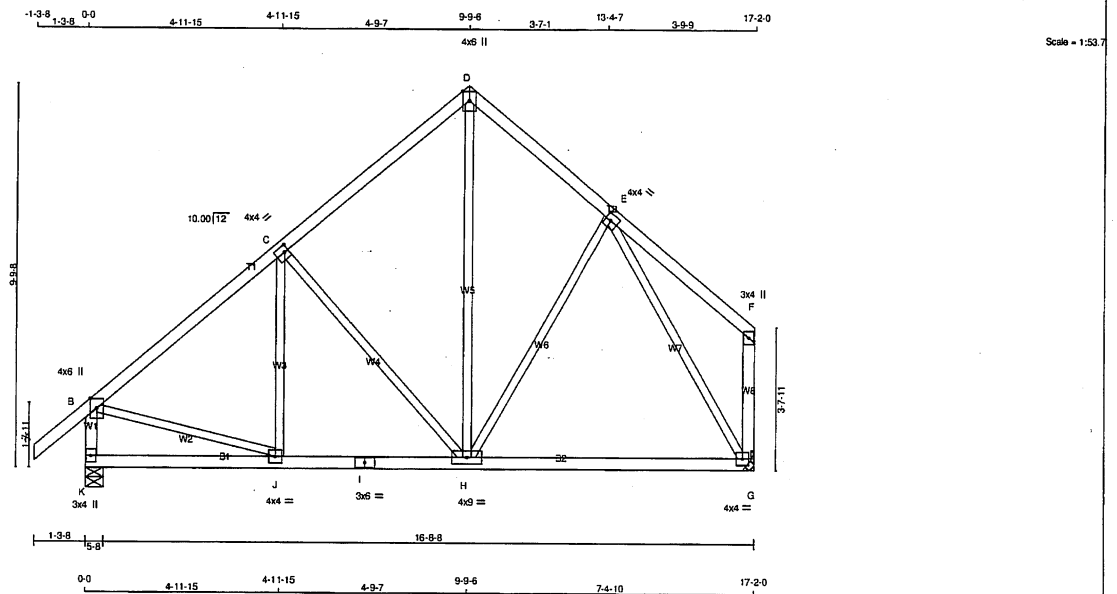

TOTAL WEIGHT = 2 X 85 = 170 lb [M/F]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge
C	TMVW-t	MT20	4.0	4.0	2.00 1.25
D	TTW+p	MT20	4.0	6.0	Edge
E	TMVW-t	MT20	4.0	4.0	2.00 1.75
F	TMV+p	MT20	3.0	4.0	
G	BMVW-t	MT20	4.0	4.0	
H	BMVW-t	MT20	4.0	9.0	
I	BS-t	MT20	3.0	6.0	
J	BMVW-t	MT20	4.0	4.0	
K	BMV+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES - (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	1073	0	1073	0
G	946	0	946	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	757	510 / 0	0 / 0	0 / 0	0 / 0	0 / 0	247 / 0	0 / 0
G	669	439 / 0	0 / 0	0 / 0	0 / 0	0 / 0	230 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX	CS1 (LC)
FR-TO									
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	J-C	-91 / 36	0.05 (1)	
B-C	-833 / 0	-91.8	-91.8	0.29 (1)	6.25	C-H	-359 / 0	0.37 (1)	
C-D	-596 / 0	-91.8	-91.8	0.29 (1)	6.25	H-D	0 / 425	0.10 (1)	
D-E	-585 / 0	-91.8	-91.8	0.16 (1)	6.25	H-E	-21 / 36	0.02 (1)	
E-F	0 / 25	-91.8	-91.8	0.20 (1)	10.00	B-J	0 / 689	0.16 (1)	
K-B	-1032 / 0	0.0	0.0	0.11 (1)	7.72	E-G	-877 / 0	0.91 (1)	
G-F	-132 / 0	0.0	0.0	0.03 (1)	7.81				
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
J-I	0 / 666	-18.5	-18.5	0.27 (4)	10.00				
I-H	0 / 666	-18.5	-18.5	0.27 (4)	10.00				
H-G	0 / 440	-18.5	-18.5	0.24 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL)= L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.29/1.00 (B-C:1), BC=0.27/1.00 (H-J:4), WB=0.91/1.00 (E-G:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (E) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

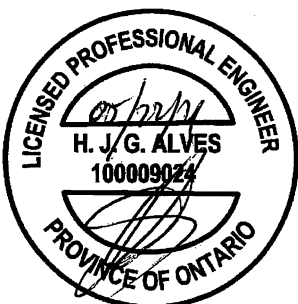


Structural component only
DWG# T-2115167

JOB NAME 410888	TRUSS NAME T22S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:29 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-L5TINaPc0h8_ODojoVd?avgva0Z0LIQqW_YhYkzEJ0u

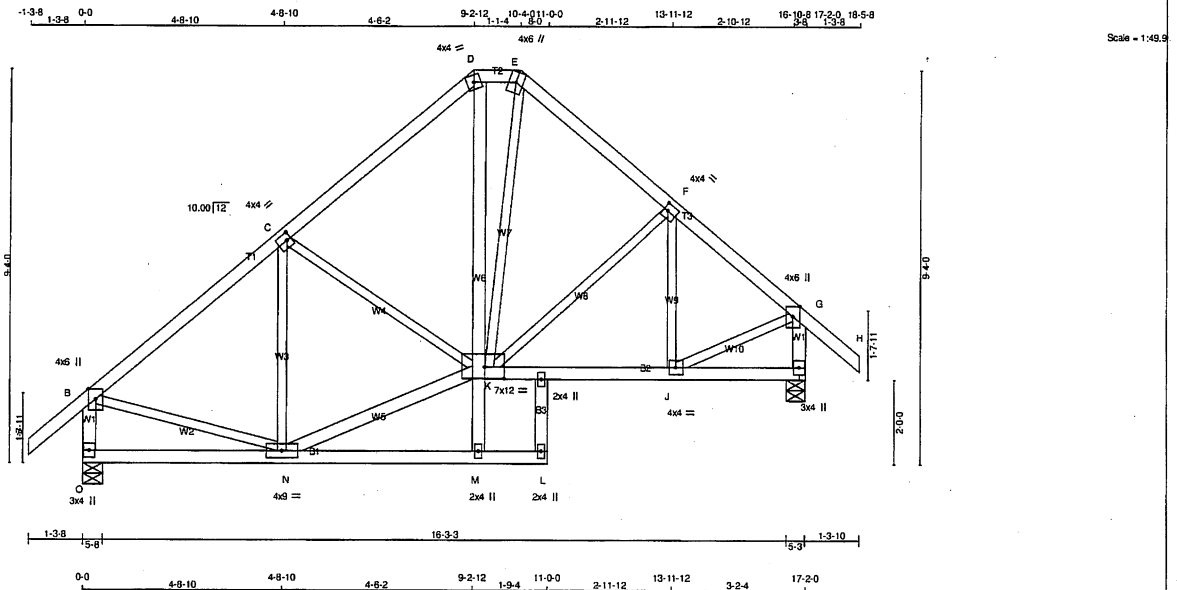

TOTAL WEIGHT = 99 lb
[M/F]

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
M - D	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTW-m	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	6.0		
F	TMVW-t	MT20	4.0	4.0	2.00	1.25
G	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-t	MT20	4.0	4.0		
L	NP-w	MT20	2.0	4.0		
M	BMVW-w	MT20	2.0	4.0		
N	BMVW-w-t	MT20	4.0	9.0		
O	BMV1+p	MT20	3.0	4.0		
P	NP-w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
O	1086	0	1086	0	0	5-8	5-8		
I	1089	0	1089	0	0	5-3	5-3		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
O	767	510 / 0	0 / 0	0 / 0	0 / 0	257 / 0	0 / 0		
I	769	510 / 0	0 / 0	0 / 0	0 / 0	259 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED		MEMB.	FORCE	FACTORED	
	(LBS)	VERT. LOAD	LC1 MAX		(LBS)	MAX. FORCE	MAX
		(PLF)	CSI (LC)			(LBS)	CSI (LC)
FR-TO		FROM	TO	FR-TO		LENGTH	FR-TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-C	-368 / 0	0.17 (1)
B-C	-864 / 0	-91.8	-91.8 0.26 (1)	6.25	M-K	0 / 68	0.02 (4)
C-D	-784 / 0	-91.8	-91.8 0.26 (1)	6.25	K-D	0 / 268	0.05 (1)
D-E	-587 / 0	-91.8	-91.8 0.02 (1)	6.25	B-N	0 / 712	0.16 (1)
E-F	-744 / 0	-91.8	-91.8 0.14 (1)	6.25	J-F	-189 / 2	0.05 (1)
F-G	-849 / 0	-91.8	-91.8 0.14 (1)	6.25	J-G	0 / 726	0.16 (1)
G-H	0 / 41	-91.8	-91.8 0.13 (1)	10.00	K-E	0 / 293	0.07 (1)
O-B	-1050 / 0	0.0	0.0 0.11 (1)	7.68	K-F	-157 / 0	0.09 (1)
I-G	-1068 / 0	0.0	0.0 0.11 (1)	7.63	N-K	0 / 728	0.12 (1)
					C-K	-121 / 0	0.06 (1)
O-N	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
N-M	0 / 8	-18.5	-18.5 0.12 (4)	10.00			
M-L	0 / 0	-18.5	-18.5 0.06 (4)	10.00			
K-J	0 / 672	-18.5	-18.5 0.15 (1)	10.00			
J-I	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.26/1.00 (B-C:1), BC=0.15/1.00 (J-K:1), WB=0.17/1.00 (C-N:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.77 (J) (INPUT = 0.90)
JSI METAL= 0.45 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115168

JOB NAME 410888	TRUSS NAME T24	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:32 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-mg9R?cRUJcWZfXITdAICXIPNEYWYf2GCynL83zEJ0r

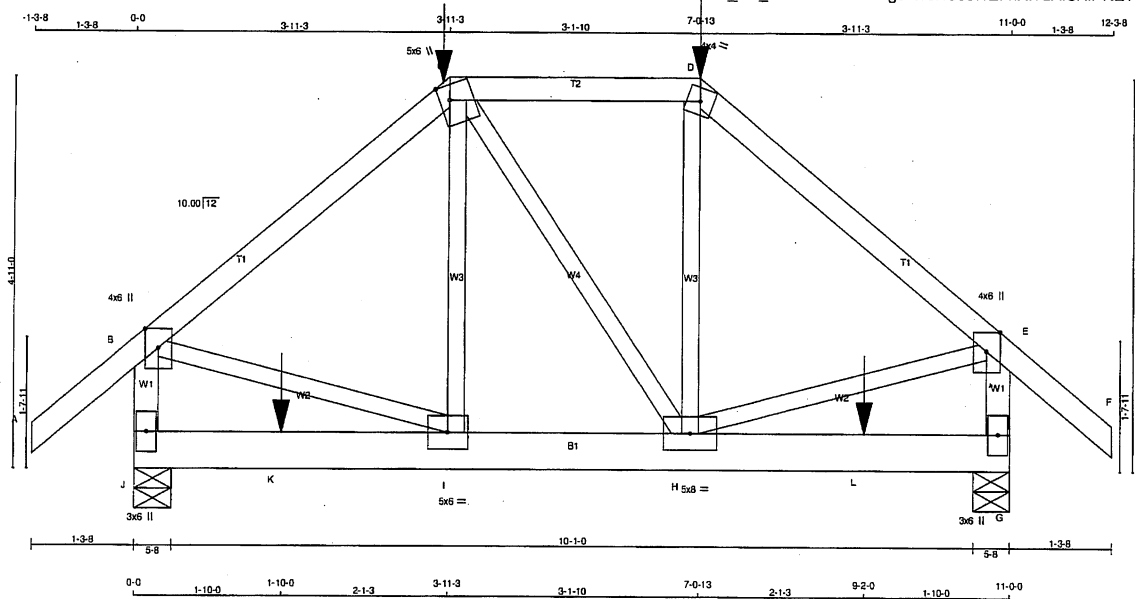

TOTAL WEIGHT = 59 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMVW+p	MT20	4.0	6.0	Edge
G	BMV1+p	MT20	3.0	6.0	
H	BMVWW-t	MT20	5.0	8.0	
I	BMVWW-t	MT20	5.0	6.0	
J	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
J	1383	0	1383	0	0	5-8	5-8	5-8	5-8
G	1383	0	1383	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	973	666 / 0	0 / 0	0 / 0	0 / 0	307 / 0	0 / 0
G	973	666 / 0	0 / 0	0 / 0	0 / 0	307 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 (LBS)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO					FR-TO		
A-B	0 / 41	-91.8	-91.8	0.14 (1)	I-C	0 / 139	0.04 (4)
B-C	-906 / 0	-91.8	-91.8	0.29 (1)	C-H	0 / 6	0.00 (4)
C-D	-700 / 0	-105.1	-105.1	0.20 (1)	H-D	0 / 145	0.04 (4)
D-E	-907 / 0	-91.8	-91.8	0.29 (1)	B-I	0 / 725	0.18 (1)
E-F	0 / 41	-91.8	-91.8	0.14 (1)	H-E	0 / 725	0.18 (1)
J-B	-1100 / 0	0.0	0.0	0.13 (1)			
G-E	-1098 / 0	0.0	0.0	0.13 (1)			
J-K	0 / 0	-21.2	-21.2	0.36 (1)			
K-I	0 / 0	-21.2	-21.2	0.36 (1)			
I-H	0 / 697	-21.2	-21.2	0.23 (1)			
H-L	0 / 0	-21.2	-21.2	0.36 (1)			
L-G	0 / 0	-21.2	-21.2	0.36 (1)			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-11-3	-64	-64	---	FRONT	VERT	TOTAL	---	C1
D	7-0-13	-64	-64	---	FRONT	VERT	TOTAL	---	C1
K	1-10-0	-367	-367	---	FRONT	VERT	TOTAL	---	C1
L	9-2-0	-367	-367	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 3-11-3
END SETBACK = 3-0-8
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.37")
CALCULATED VERT. DEFL.(LL)= L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.37")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.29/1.00 (D-E:1), BC=0.36/1.00 (G-H:1), WB=0.18/1.00 (E-H:1), SSI=0.21/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.70 (E) (INPUT = 0.90)
JSI METAL= 0.46 (E) (INPUT = 1.00)



Structural component only
DWG# T-2115170

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
418926	T30	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:19:38 2021 Page 2
ID:GzzEEXDtkQt BH M?wmsz?k45-QygKP8p1y OO33ntEZyOnd7kb0IHVeTtClqKqZzEI7Z

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.00	1.75
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMWW-t	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	1.75	3.50
I	TMVW-t	MT20	5.0	6.0	2.00	1.75
K	BMV1+p	MT20	3.0	6.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRAC LENGTH	FR-TO
FR-TO		FROM TO					
AQ-AR	0 / 0	-18.5	-18.5 0.06 (4)			10.00	
AR-K	0 / 0	-18.5	-18.5 0.06 (4)			10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-41	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-81	-81	---	BACK	VERT	TOTAL	---	C1
C	4-0-11	-173	-173	---	FRONT	VERT	SNOW	---	C1
F	19-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
H	29-9-5	-41	-41	---	FRONT	VERT	DEAD	---	C1
H	29-9-5	-81	-81	---	BACK	VERT	TOTAL	---	C1
H	29-9-5	-173	-173	---	FRONT	VERT	SNOW	---	C1
N	19-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
P	13-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
R	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
T	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
V	9-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
W	11-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
X	13-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Y	15-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Z	17-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AA	21-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AB	23-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AC	25-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AD	27-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AE	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AF	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AG	7-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AH	9-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AI	11-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AJ	15-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AK	17-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AL	21-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AM	23-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AN	25-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AO	27-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AP	29-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AQ	31-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AR	32-11-4	-22	-22	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2115203 2/2

[illegible]

JOB NAME

410889

TRUSS NAME

T30S

QUANTITY

1

PLY

2

JOB DESC.

ROYAL PINE HOMES

TRUSS DESC.

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:12 2021 Page 2

ID:GzzEEEXDtRkQt BH M?wImSz?k45-WzD?RaVkWdZkmeL12UeW yic0UXUmKMvSae1IKzEIIH

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.00	1.75
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMVW-t	MT20	5.0	6.0	2.50	2.75
E	TMV+p	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW+m	MT20	5.0	8.0	Edge	
I	TMVW-t	MT20	4.0	4.0	2.00	1.00
J	TMVW-p	MT20	5.0	8.0	Edge	
L	BMVW-t	MT20	5.0	6.0		
M	BMV+p	MT20	3.0	4.0		
N	BMVW-t	MT20	6.0	12.0	3.75	7.50
O	BMVW-t	MT20	5.0	6.0		
P	BMVW-t	MT20	5.0	6.0	2.50	2.75
Q	BMVW-t	MT20	8.0	12.0	5.00	4.25
R	BMV+p	MT20	3.0	6.0		
S	BMVW-t	MT20	6.0	10.0	3.00	2.75
T	BS-t	MT20	5.0	6.0		
U	BMVW-t	MT20	5.0	6.0		
V	BMV+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES:

(1)

1) Lateral braces to be a minimum of 2x4 SPF #2

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. FACTORED CSI (LC)	UNBRAC LENGTH	FR-TO
M-N	0 / 35	0.0	0.0	0.18 (1)	10.00	
N-I	0 / 451	0.0	0.0	0.22 (1)	10.00	
M-AR	0 / 204	-18.5	-18.5	0.03 (4)	10.00	
AR-L	0 / 204	-18.5	-18.5	0.03 (4)	10.00	

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-41	-41	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-81	-81	---	BACK	VERT	TOTAL	---	C1
C	4-0-11	-173	-173	---	FRONT	VERT	SNOW	---	C1
F	19-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1
G	23-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1
H	29-9-5	-41	-41	---	FRONT	VERT	DEAD	---	C1
H	29-9-5	-75	-75	---	BACK	VERT	TOTAL	---	C1
H	29-9-5	-173	-173	---	FRONT	VERT	SNOW	---	C1
N	32-2-4	-77	-77	---	BACK	VERT	TOTAL	---	C1
O	29-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
P	23-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
T	9-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
U	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
W	5-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
X	7-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Y	9-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Z	11-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AA	13-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AB	15-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AC	17-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
AD	21-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1
AE	25-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1
AF	27-11-4	-70	-70	---	BACK	VERT	TOTAL	---	C1
AG	1-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AH	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AI	7-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AJ	11-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AK	13-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AL	15-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AM	17-11-4	-24	-24	---	BACK	VERT	TOTAL	---	C1
AN	19-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
AO	21-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
AP	25-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
AQ	27-11-4	-71	-71	---	BACK	VERT	TOTAL	---	C1
AR	32-11-4	-24	-24	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

LICENSED PROFESSIONAL ENGINEER

H. J. G. ALVES

1000090247

PROVINCE OF ONTARIO


Structural component only

DWG# T-2115183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T31	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:13 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-AnNewWMHW5bOowDcB9IXAGkauvBVoJ2hEOaHmzEIIg

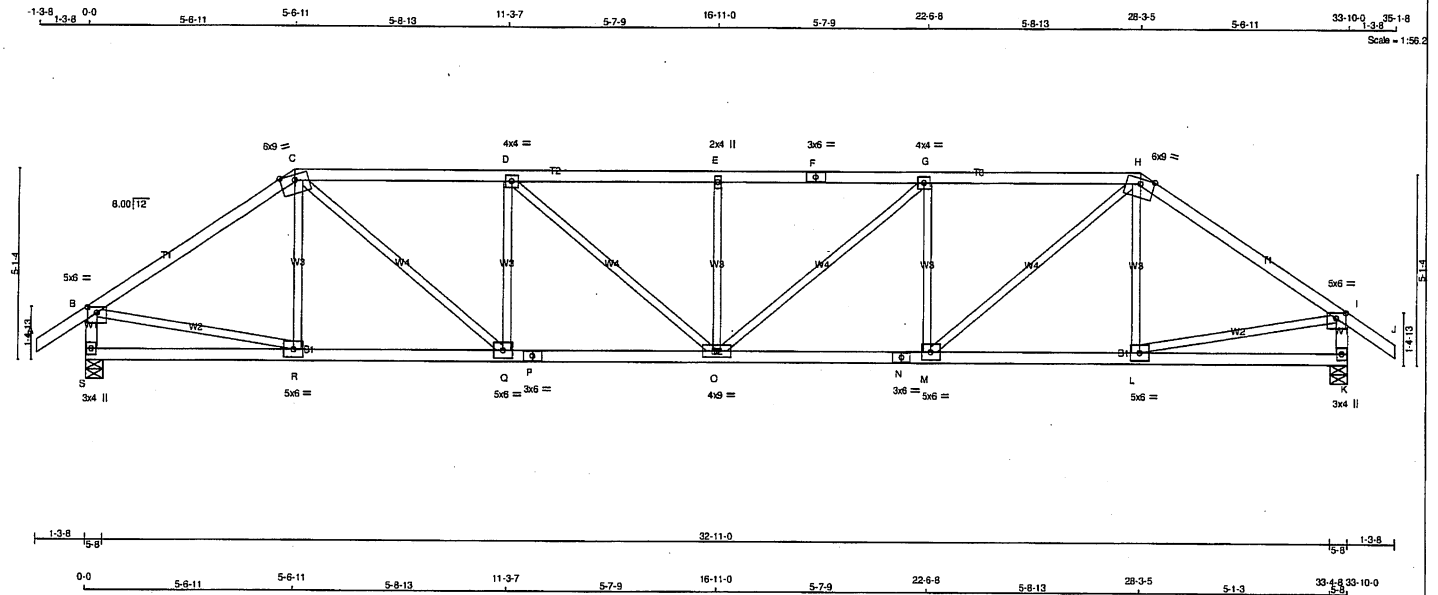

TOTAL WEIGHT = 136 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-t	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	6.0	1.75	3.00
K	BMV1-p	MT20	3.0	4.0		
L, M, Q, R						
L	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES:

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
S	1991	0	0	5-8
K	1991	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
K	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	MAX	
	FORCE	VERT. LOAD	LC1		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	R-C	-229 / 13	0.09 (1)
B-C	-2194 / 0	-91.8	-91.8 0.69 (1)	3.87	C-Q	0 / 1521	0.34 (1)
C-D	-2984 / 0	-91.8	-91.8 0.67 (1)	3.42	Q-D	-877 / 0	0.34 (1)
D-E	-3323 / 0	-91.8	-91.8 0.71 (1)	3.22	D-O	0 / 446	0.10 (1)
E-F	-3323 / 0	-91.8	-91.8 0.71 (1)	3.22	O-E	-476 / 0	0.18 (1)
F-G	-3323 / 0	-91.8	-91.8 0.71 (1)	3.22	G-O	0 / 446	0.10 (1)
G-H	-2984 / 0	-91.8	-91.8 0.67 (1)	3.42	M-G	-877 / 0	0.34 (1)
H-I	-2194 / 0	-91.8	-91.8 0.69 (1)	3.87	M-H	0 / 1521	0.34 (1)
I-J	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-H	-229 / 13	0.09 (1)
S-B	-1949 / 0	0.0	0.0 0.20 (1)	6.03	B-R	0 / 1856	0.42 (1)
K-I	-1949 / 0	0.0	0.0 0.20 (1)	6.03	L-I	0 / 1856	0.42 (1)
S-R	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
R-Q	0 / 1818	-18.5	-18.5 0.37 (1)	10.00			
Q-P	0 / 2984	-18.5	-18.5 0.53 (1)	10.00			
P-O	0 / 2984	-18.5	-18.5 0.53 (1)	10.00			
O-N	0 / 2984	-18.5	-18.5 0.53 (1)	10.00			
N-M	0 / 2984	-18.5	-18.5 0.53 (1)	10.00			
M-L	0 / 1818	-18.5	-18.5 0.37 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.13")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.18")
ALLOWABLE DEFL.(TL) = $L/360$ (1.13")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.34")

CSI: TC=0.71/1.00 (E-G:1), BC=0.53/1.00 (M-O:1), WB=0.42/1.00 (I-L:1), SSI=0.25/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (L) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)




Structural component only
DWG# T-2115184

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T31S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:14 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-SMLsGX_2qDS?yUP9vg_3NotIEEqECnCWu78pDzElIF

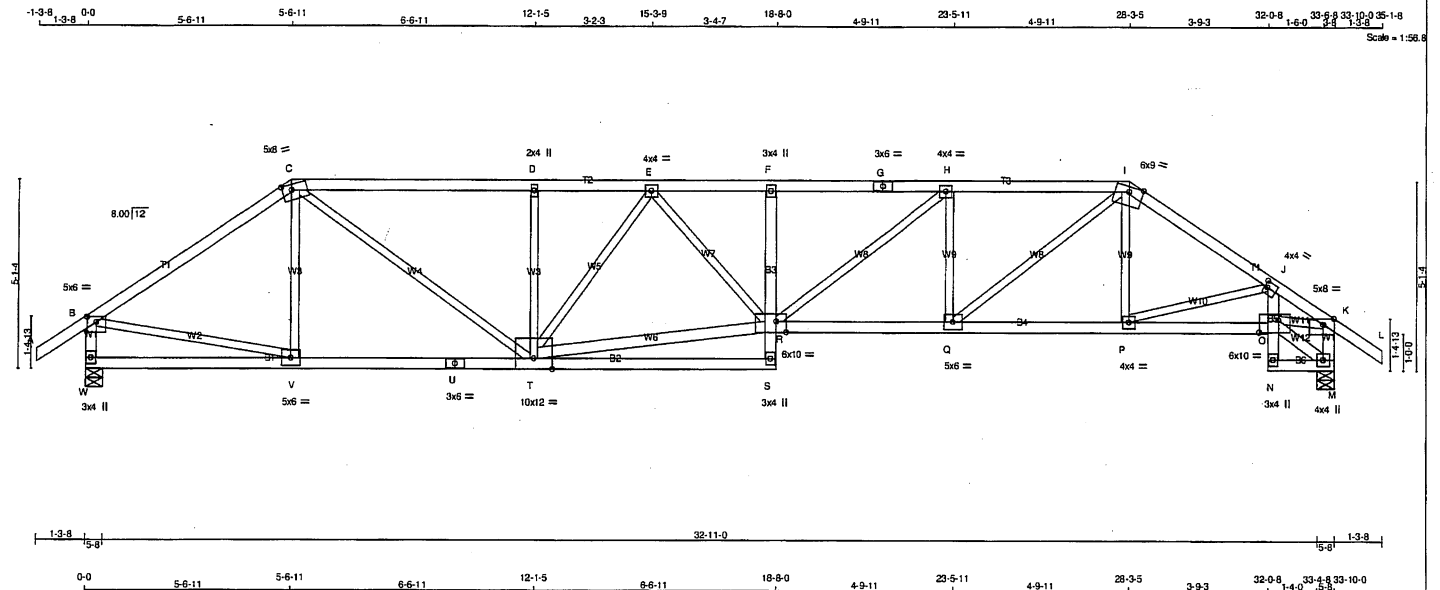

TOTAL WEIGHT = 148 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
W - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
W - U	2x4	DRY	No.2	SPF	
U - S	2x4	DRY	No.2	SPF	
S - F	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
N - M	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	3.00
C TTWW-m	MT20	5.0	8.0	1.75	3.00
D TMVW-w	MT20	2.0	4.0		
E TMVW-t	MT20	4.0	4.0		
F TMVW-p	MT20	3.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMVW-t	MT20	4.0	4.0		
I TTWW-m	MT20	6.0	9.0	Edge	
J TMVW-t	MT20	4.0	4.0	2.00	1.00
K TMVW-p	MT20	5.0	8.0	Edge	3.50
M BMVW1+p	MT20	4.0	4.0		
N BMV-p	MT20	3.0	4.0		
O BVWWV-I	MT20	6.0	10.0	4.00	6.25
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	5.0	6.0		
R BVWWV-I	MT20	6.0	10.0	Edge	3.25
S BMV-p	MT20	3.0	4.0		
T BVWWV-I	MT20	10.0	12.0	Edge	
U BS-t	MT20	3.0	6.0		
V BMVW-t	MT20	5.0	6.0		
W BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
W	1988	0	1988	0
M	1994	0	1994	0

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
W	1404	934 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	
M	1407	937 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)			LENGTH	FR-TO	MAX. FORCE (LBS)
FR-TO		FROM TO						
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	V-C	-225 / 16	0.09 (1)
B-C	-2191 / 0	-91.8	-91.8	0.69 (1)	3.67	C-T	0 / 1578	0.36 (1)
C-D	-3088 / 0	-91.8	-91.8	0.84 (1)	3.23	T-D	-607 / 0	0.23 (1)
D-E	-3090 / 0	-91.8	-91.8	0.62 (1)	3.23	T-R	0 / 3484	0.56 (1)
E-F	-4080 / 0	-91.8	-91.8	0.37 (1)	3.23	R-H	0 / 679	0.15 (1)
F-G	-4115 / 0	-91.8	-91.8	0.62 (1)	3.00	Q-H	-923 / 0	0.24 (1)
G-H	-4115 / 0	-91.8	-91.8	0.62 (1)	3.00	Q-I	0 / 1656	0.37 (1)
H-I	-3581 / 0	-91.8	-91.8	0.55 (1)	3.27	P-I	0 / 145	0.04 (4)
I-J	-2735 / 0	-91.8	-91.8	0.34 (1)	3.90	P-J	-530 / 0	0.16 (1)
J-K	-3194 / 0	-91.8	-91.8	0.22 (1)	3.74	B-V	0 / 1854	0.42 (1)
K-L	0 / 35	-91.8	-91.8	0.12 (1)	10.00	O-M	-147 / 0	0.02 (1)
W-B	-1947 / 0	0.0	0.0	0.20 (1)	6.03	O-K	0 / 2645	0.60 (1)
M-K	-1895 / 0	0.0	0.0	0.20 (1)	6.10	T-E	-882 / 0	0.46 (1)
						E-R	0 / 776	0.17 (1)
W-V	0 / 0	-18.5	-18.5	0.15 (4)	10.00			
V-U	0 / 1816	-18.5	-18.5	0.38 (1)	10.00			
U-T	0 / 1816	-18.5	-18.5	0.38 (1)	10.00			
T-S	0 / 136	-18.5	-18.5	0.19 (4)	10.00			
S-R	0 / 54	0.0	0.0	0.19 (1)	10.00			
R-F	-386 / 0	0.0	0.0	0.20 (1)	7.81			
R-Q	0 / 3582	-18.5	-18.5	0.64 (1)	10.00			
Q-P	0 / 2272	-18.5	-18.5	0.42 (1)	10.00			
P-O	0 / 2778	-18.5	-18.5	0.50 (1)	10.00			
N-O	0 / 17	0.0	0.0	0.19 (1)	10.00			
O-J	0 / 159	0.0	0.0	0.21 (1)	10.00			
N-M	0 / 121	-18.5	-18.5	0.03 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.24")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/875 (0.46")

CSI: TC=0.84/1.00 (C-D:1), BC=0.84/1.00 (Q-R:1), WB=0.60/1.00 (K-O:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (O) (INPUT = 0.90)
JSI METAL = 0.58 (R) (INPUT = 1.00)

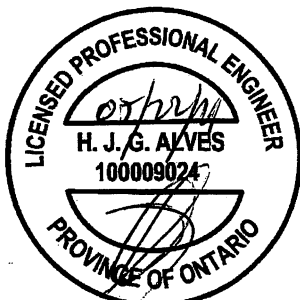


Structural component only
DWG# T-2115185

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T32	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:15 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-wYu73bYcp7LJd63jcCDobL3FhcBzewL9YthMfzEIE

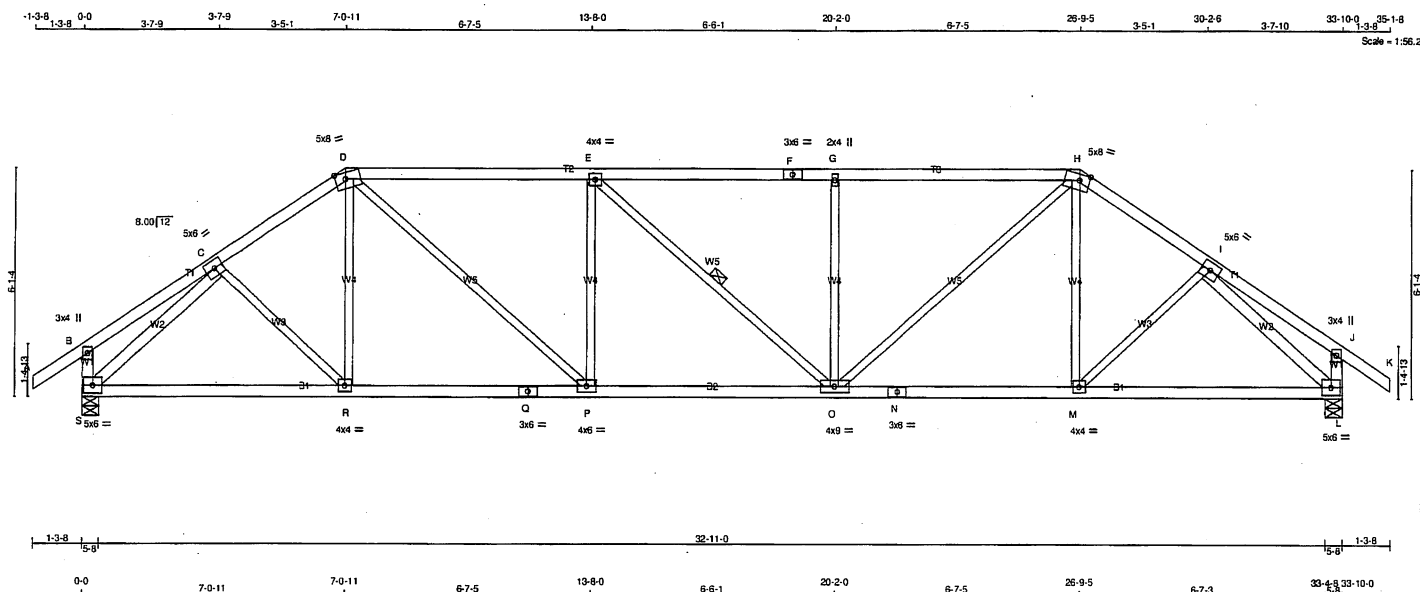

TOTAL WEIGHT = 143 lb

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER			
CHORDS					
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMW-w	MT20	5.0	6.0		
D	TTWW-m	MT20	5.0	8.0	2.00	3.25
E	TMW-w	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	3.25
I	TMW-w	MT20	5.0	6.0		
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-t	MT20	5.0	6.0		
M	BMVW1-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW1-t	MT20	4.0	6.0		
P	BMVW1-t	MT20	4.0	6.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW1-t	MT20	4.0	4.0		
S	BMVW1-t	MT20	5.0	6.0		

NOTES-

1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION					
VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
JT		1991	0	0	5-8
S		1991	0	0	5-8
L		1991	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED						
S	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
L	1406	936 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 35	C-R	0 / 113
B-C	0 / 19	D	0 / 103
C-D	-2200 / 0	D-P	0 / 1164
D-E	-2688 / 0	E	-853 / 0
E-F	-2688 / 0	E-O	-2 / 0
F-G	-2688 / 0	O-G	-852 / 0
G-H	-2688 / 0	O-H	0 / 1162
H-I	-2200 / 0	H	0 / 103
I-J	0 / 19	M-I	0 / 113
J-K	0 / 35	S-C	-2414 / 0
S-B	-254 / 0	L-L	-2414 / 0
L-J	-254 / 0		

S-R	0 / 1729	-18.5	-18.5	0.40 (1)	10.00
R-Q	0 / 1813	-18.5	-18.5	0.41 (1)	10.00
Q-P	0 / 1813	-18.5	-18.5	0.41 (1)	10.00
P-O	0 / 2688	-18.5	-18.5	0.50 (1)	10.00
O-N	0 / 1813	-18.5	-18.5	0.41 (1)	10.00
N-M	0 / 1813	-18.5	-18.5	0.41 (1)	10.00
M-L	0 / 1729	-18.5	-18.5	0.40 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.82/1.00 (D-E:1), BC=0.50/1.00 (O-P:1), WB=0.67/1.00 (I-L:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)
JSI METAL= 0.55 (N) (INPUT = 1.00)




Structural component only
DWG# T-2115186

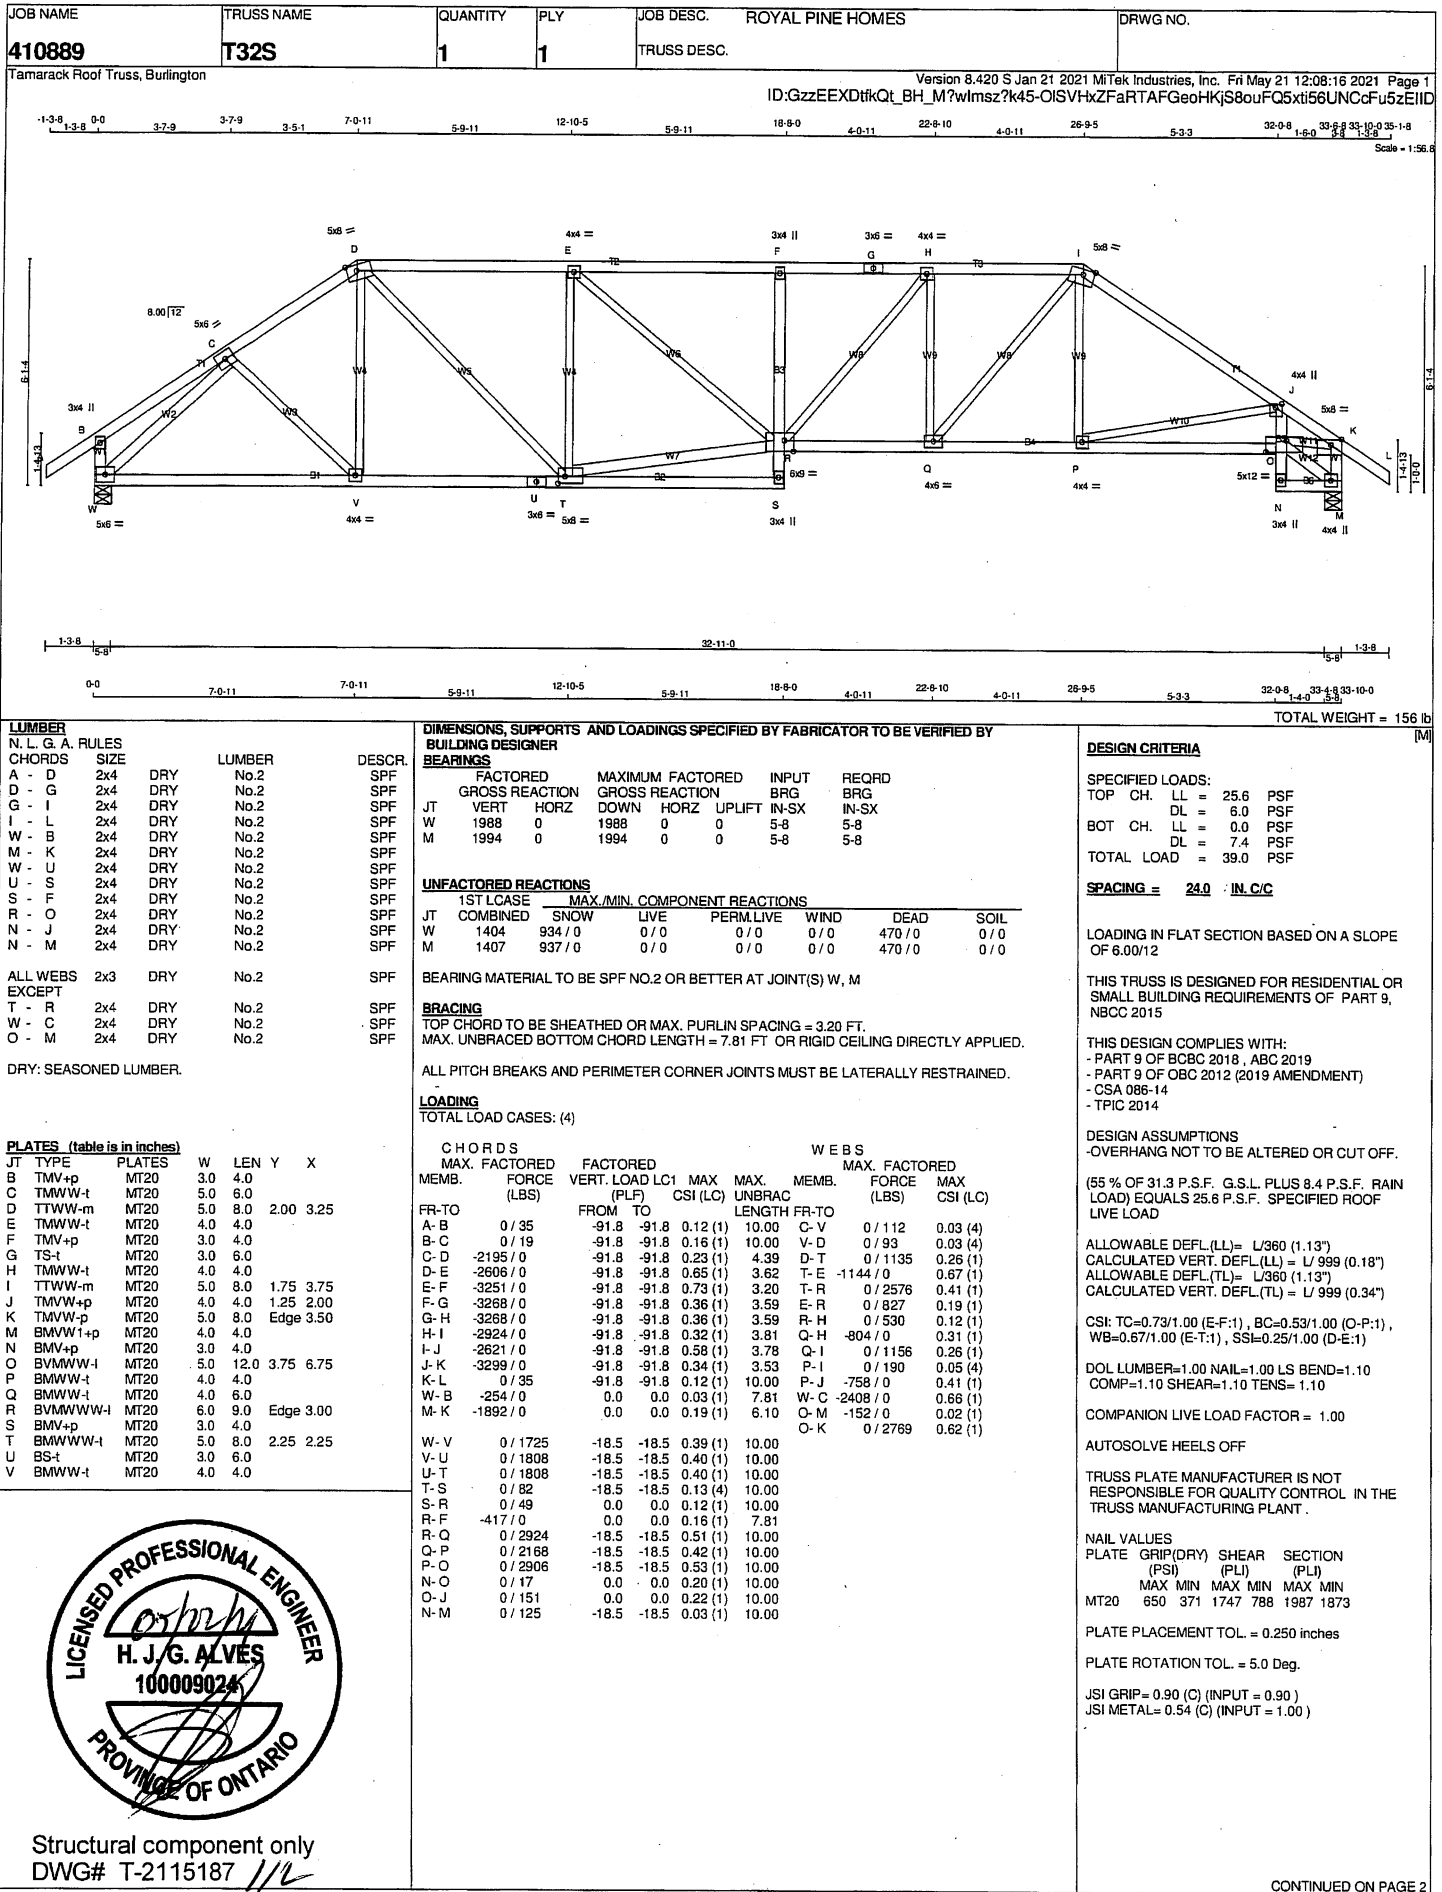


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.														
410889	T32S	1	1	TRUSS DESC.																
Tamarack Roof Truss, Burlington				Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:17 2021 Page 2																
				ID:GzzEEXDtKQt BH M?wImSz?k45-sx0uUHZiKib1sPD r1Ehh0QQAVG6RYMecsMoQYzEiIC																
PLATES (table is in inches) <table border="1"><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>W</td><td>BMVW1-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2x4 SPF #2							JT	TYPE	PLATES	W	LEN	Y	X	W	BMVW1-t	MT20	5.0	6.0		
JT	TYPE	PLATES	W	LEN	Y	X														
W	BMVW1-t	MT20	5.0	6.0																
 Structural component only DWG# T-2115187 <i>mr</i>																				

[illegible]

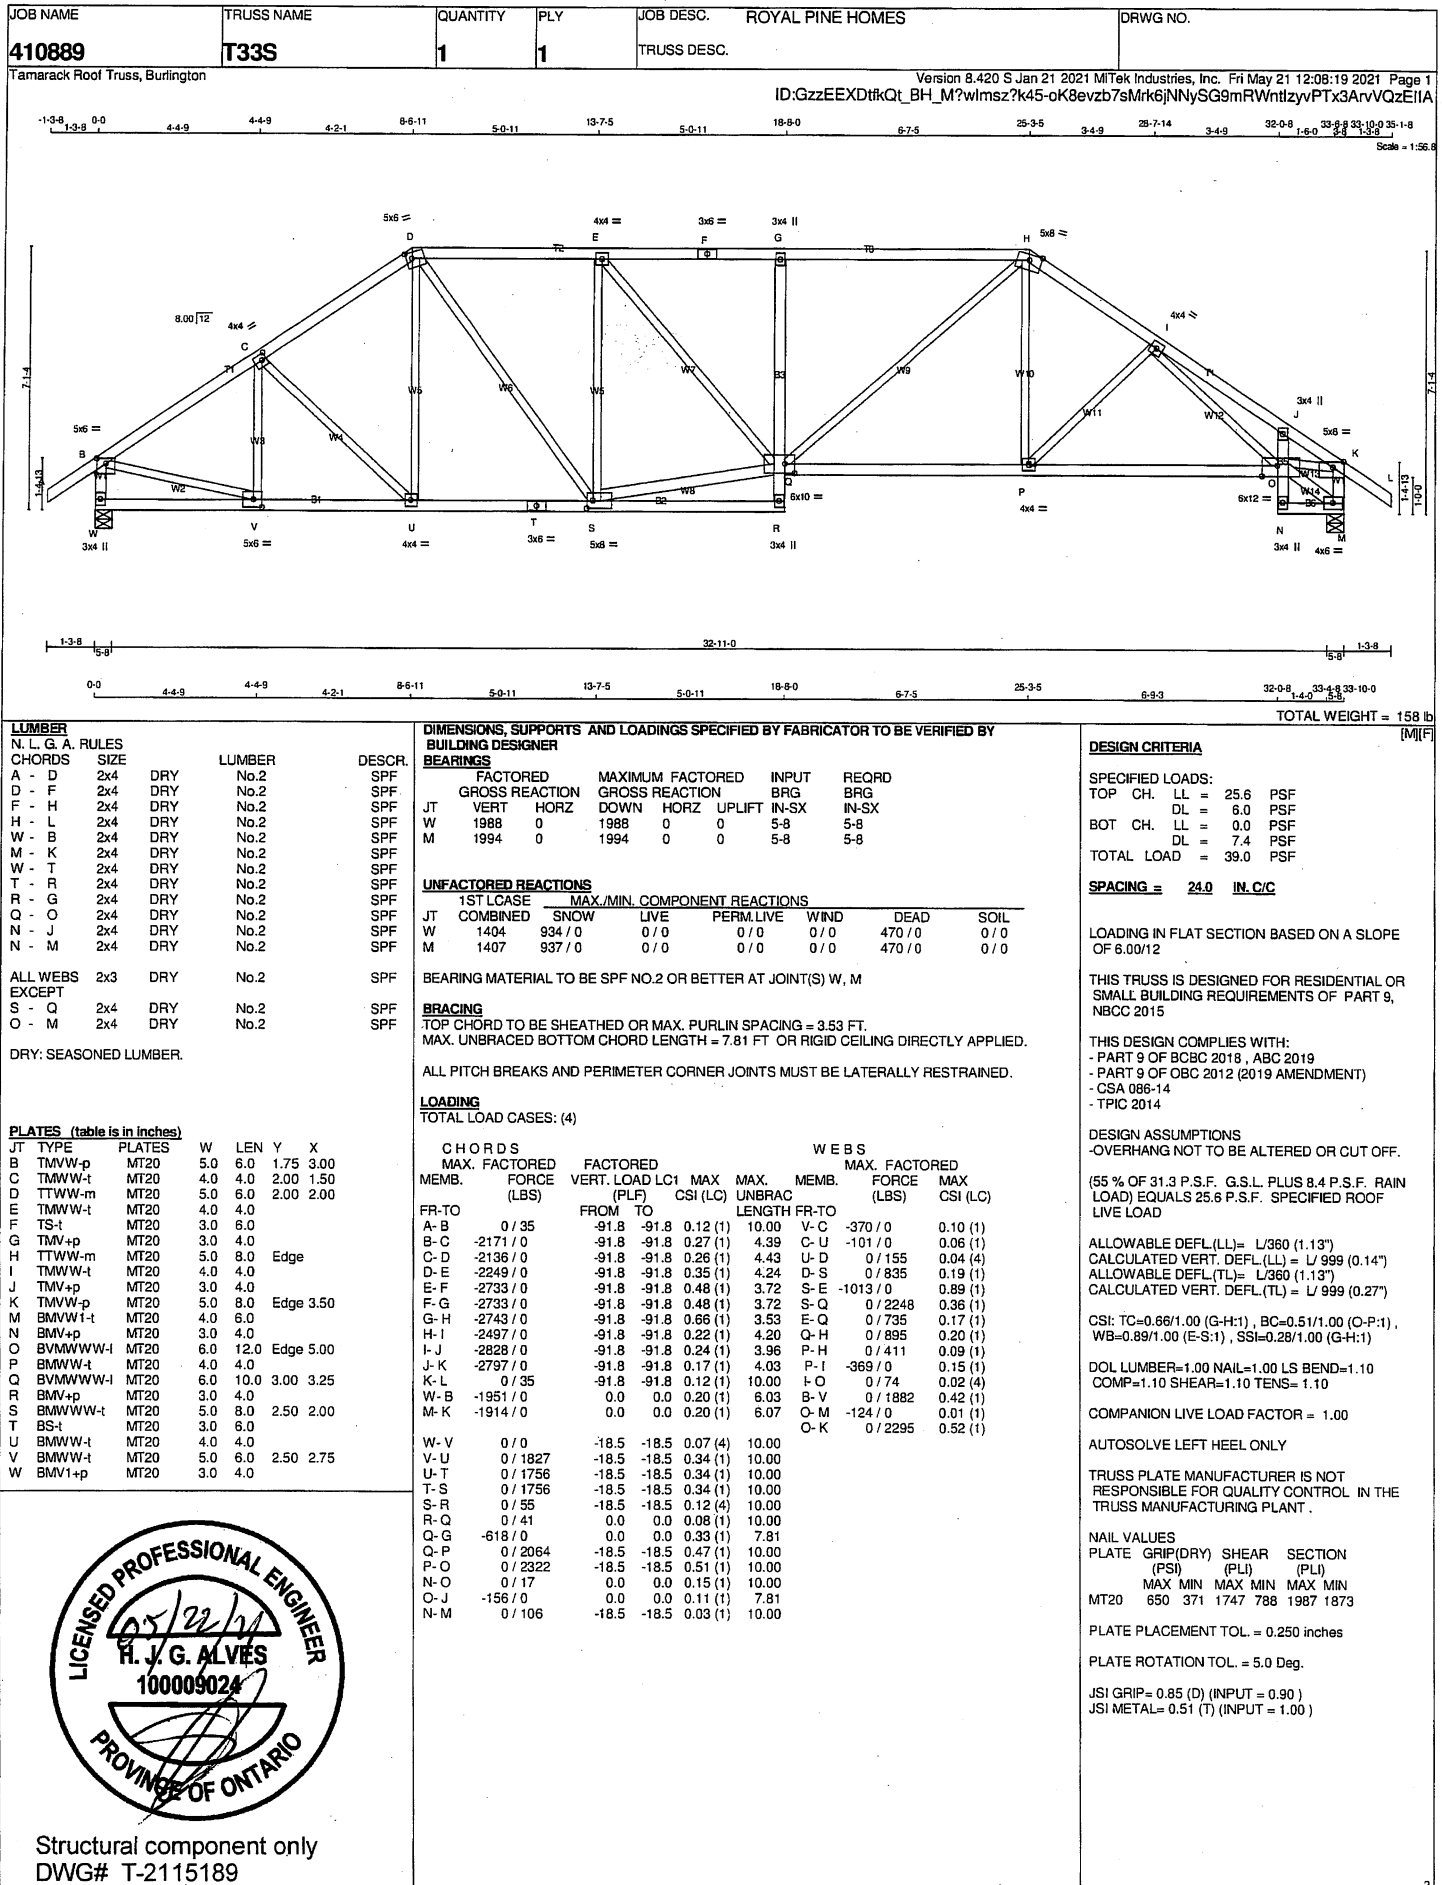

Version 8.420 S Jan 21 2021 MITek Industries, Inc. Fri May 21 12:08:20 2021 Page 1
ID:GzzEEXDtftkQt_BH_M?wlmisz?k45-HW06JcldgzbjtyZWAnOJe2ymilGegG4lpaS1szEI19




Structural component only
DWG# T-2115190

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T34S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:21 2021 Page 1
ID:GzEEXDtkQt_BH_M?wimsz?k45-liGOKfCNOZ5SL1Xl4tdrscCj8fkNndEXTK?ZJzEII8

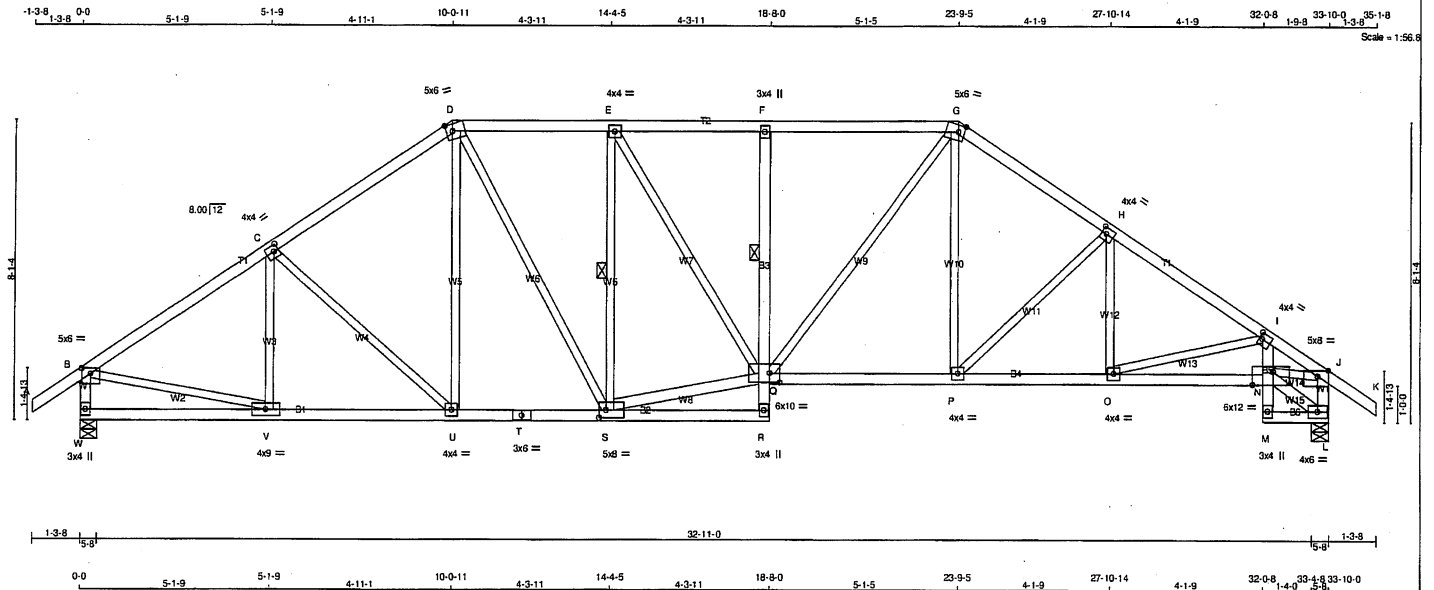

TOTAL WEIGHT = 167 lb
[MIF]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - K	2x4	DRY	No.2	SPF	
W - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
W - T	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - F	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
M - I	2x4	DRY	No.2	SPF	
M - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - Q	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-t	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TMVW-t	MT20	4.0	4.0	2.00	1.50
I	TMVW-t	MT20	4.0	4.0	2.00	1.00
J	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMVW-t	MT20	4.0	6.0		
M	BMV-p	MT20	3.0	4.0		
N	BVMW-t	MT20	6.0	12.0	4.25	6.75
O, P, U						
O	BMVW-t	MT20	4.0	4.0		
Q	BVMW-t	MT20	6.0	10.0	3.00	3.25
R	BMV-p	MT20	3.0	4.0		
S	BMVW-t	MT20	5.0	8.0	2.50	2.25
T	BS-t	MT20	3.0	6.0		
V	BMVW-t	MT20	4.0	9.0		
W	BMV-t+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	UPLIFT	IN-SX	BRG	BRG
W	1988	0	1988	0	0	5-8	5-8		
L	1994	0	1994	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
W	1404	934 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0
L	1407	937 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-Q, E-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	CSI (LC)	UNBRAC LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. CSI (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	V-C	-292 / 0	0.10 (1)	
B-C	-2217 / 0	-91.8	-91.8	0.38 (1)	4.25	C-U	-243 / 0	0.20 (1)	
C-D	-2062 / 0	-91.8	-91.8	0.36 (1)	4.39	U-D	0 / 246	0.06 (1)	
D-E	-1987 / 0	-91.8	-91.8	0.24 (1)	4.58	D-S	0 / 618	0.14 (1)	
E-F	-2313 / 0	-91.8	-91.8	0.29 (1)	4.24	S-E	-920 / 0	0.38 (1)	
F-G	-2319 / 0	-91.8	-91.8	0.37 (1)	4.16	S-Q	0 / 2008	0.32 (1)	
G-H	-2349 / 0	-91.8	-91.8	0.27 (1)	4.25	E-Q	0 / 613	0.14 (1)	
H-I	-2732 / 0	-91.8	-91.8	0.30 (1)	3.96	Q-G	0 / 624	0.14 (1)	
I-J	-3167 / 0	-91.8	-91.8	0.19 (1)	3.80	P-G	0 / 449	0.10 (1)	
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	P-H	-501 / 0	0.29 (1)	
W-B	-1947 / 0	0.0	0.0	0.20 (1)	6.03	O-H	0 / 106	0.03 (4)	
L-J	-1895 / 0	0.0	0.0	0.20 (1)	6.10	O-I	-466 / 0	0.15 (1)	
						B-V	0 / 1910	0.43 (1)	
W-V	0 / 0	-18.5	-18.5	0.11 (4)	10.00	N-L	-145 / 0	0.02 (1)	
V-U	0 / 1869	-18.5	-18.5	0.34 (1)	10.00	N-J	0 / 2613	0.59 (1)	
U-T	0 / 1691	-18.5	-18.5	0.32 (1)	10.00				
T-S	0 / 1691	-18.5	-18.5	0.32 (1)	10.00				
S-R	0 / 39	-18.5	-18.5	0.08 (4)	10.00				
R-Q	0 / 35	0.0	0.0	0.06 (1)	10.00				
Q-F	-484 / 0	0.0	0.0	0.06 (1)	6.25				
Q-P	0 / 1937	-18.5	-18.5	0.37 (1)	10.00				
P-O	0 / 2294	-18.5	-18.5	0.43 (1)	10.00				
O-N	0 / 2744	-18.5	-18.5	0.49 (1)	10.00				
M-N	0 / 17	0.0	0.0	0.19 (1)	10.00				
N-I	0 / 160	0.0	0.0	0.21 (1)	10.00				
M-L	0 / 119	-18.5	-18.5	0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.13")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.13")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.38/1.00 (B-C:1), BC=0.49/1.00 (N-O:1), WB=0.59/1.00 (J-N:1), SS=0.22/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.84 (B) (INPUT = 0.90)
JSI METAL=0.49 (T) (INPUT = 1.00)



Structural component only
DWG# T-2115191

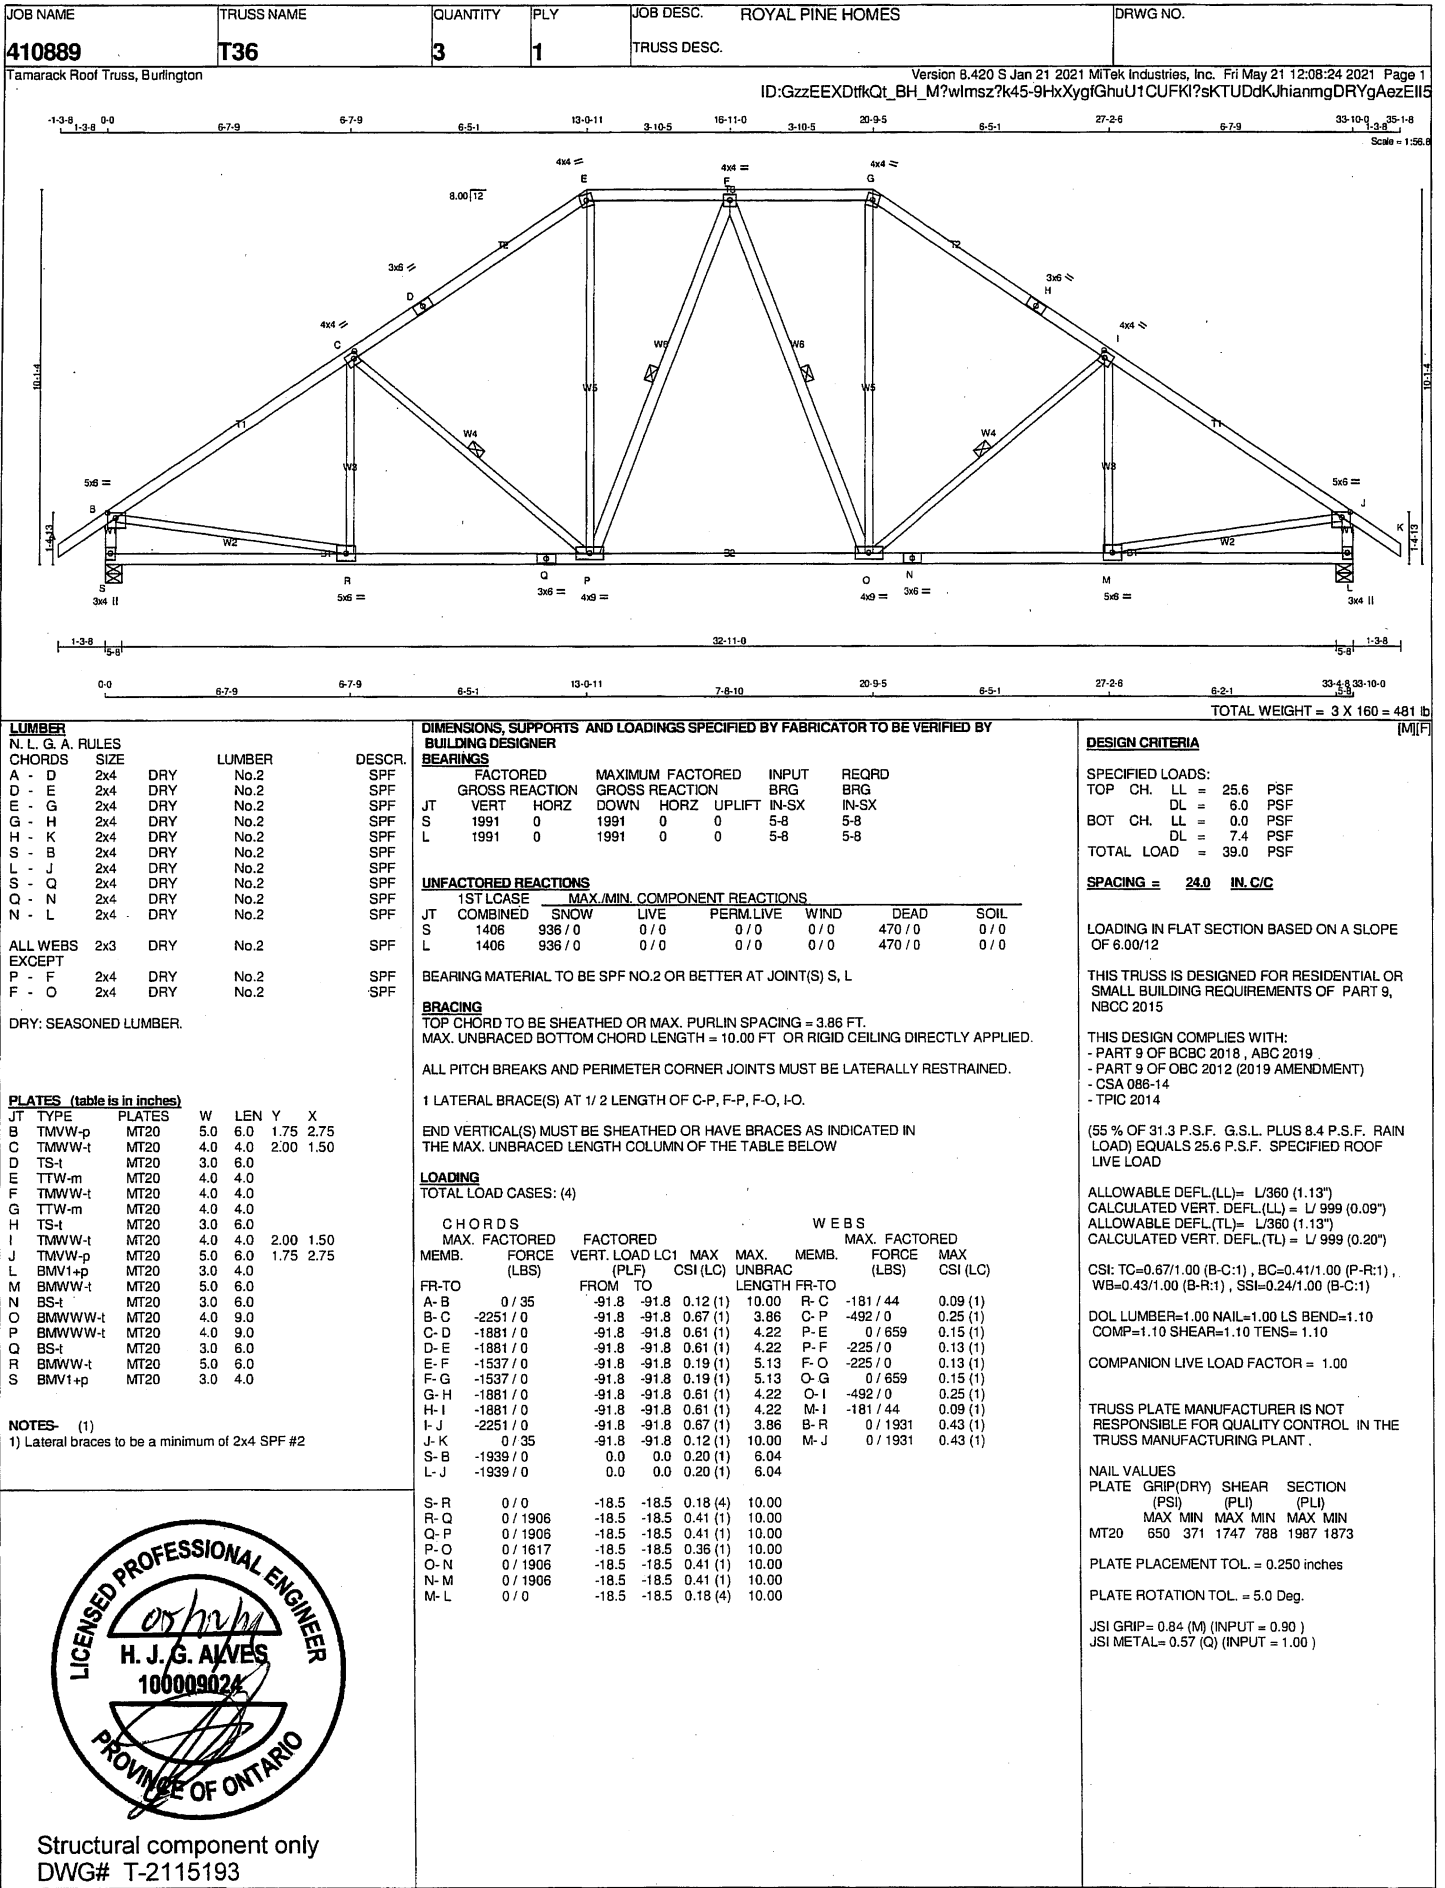

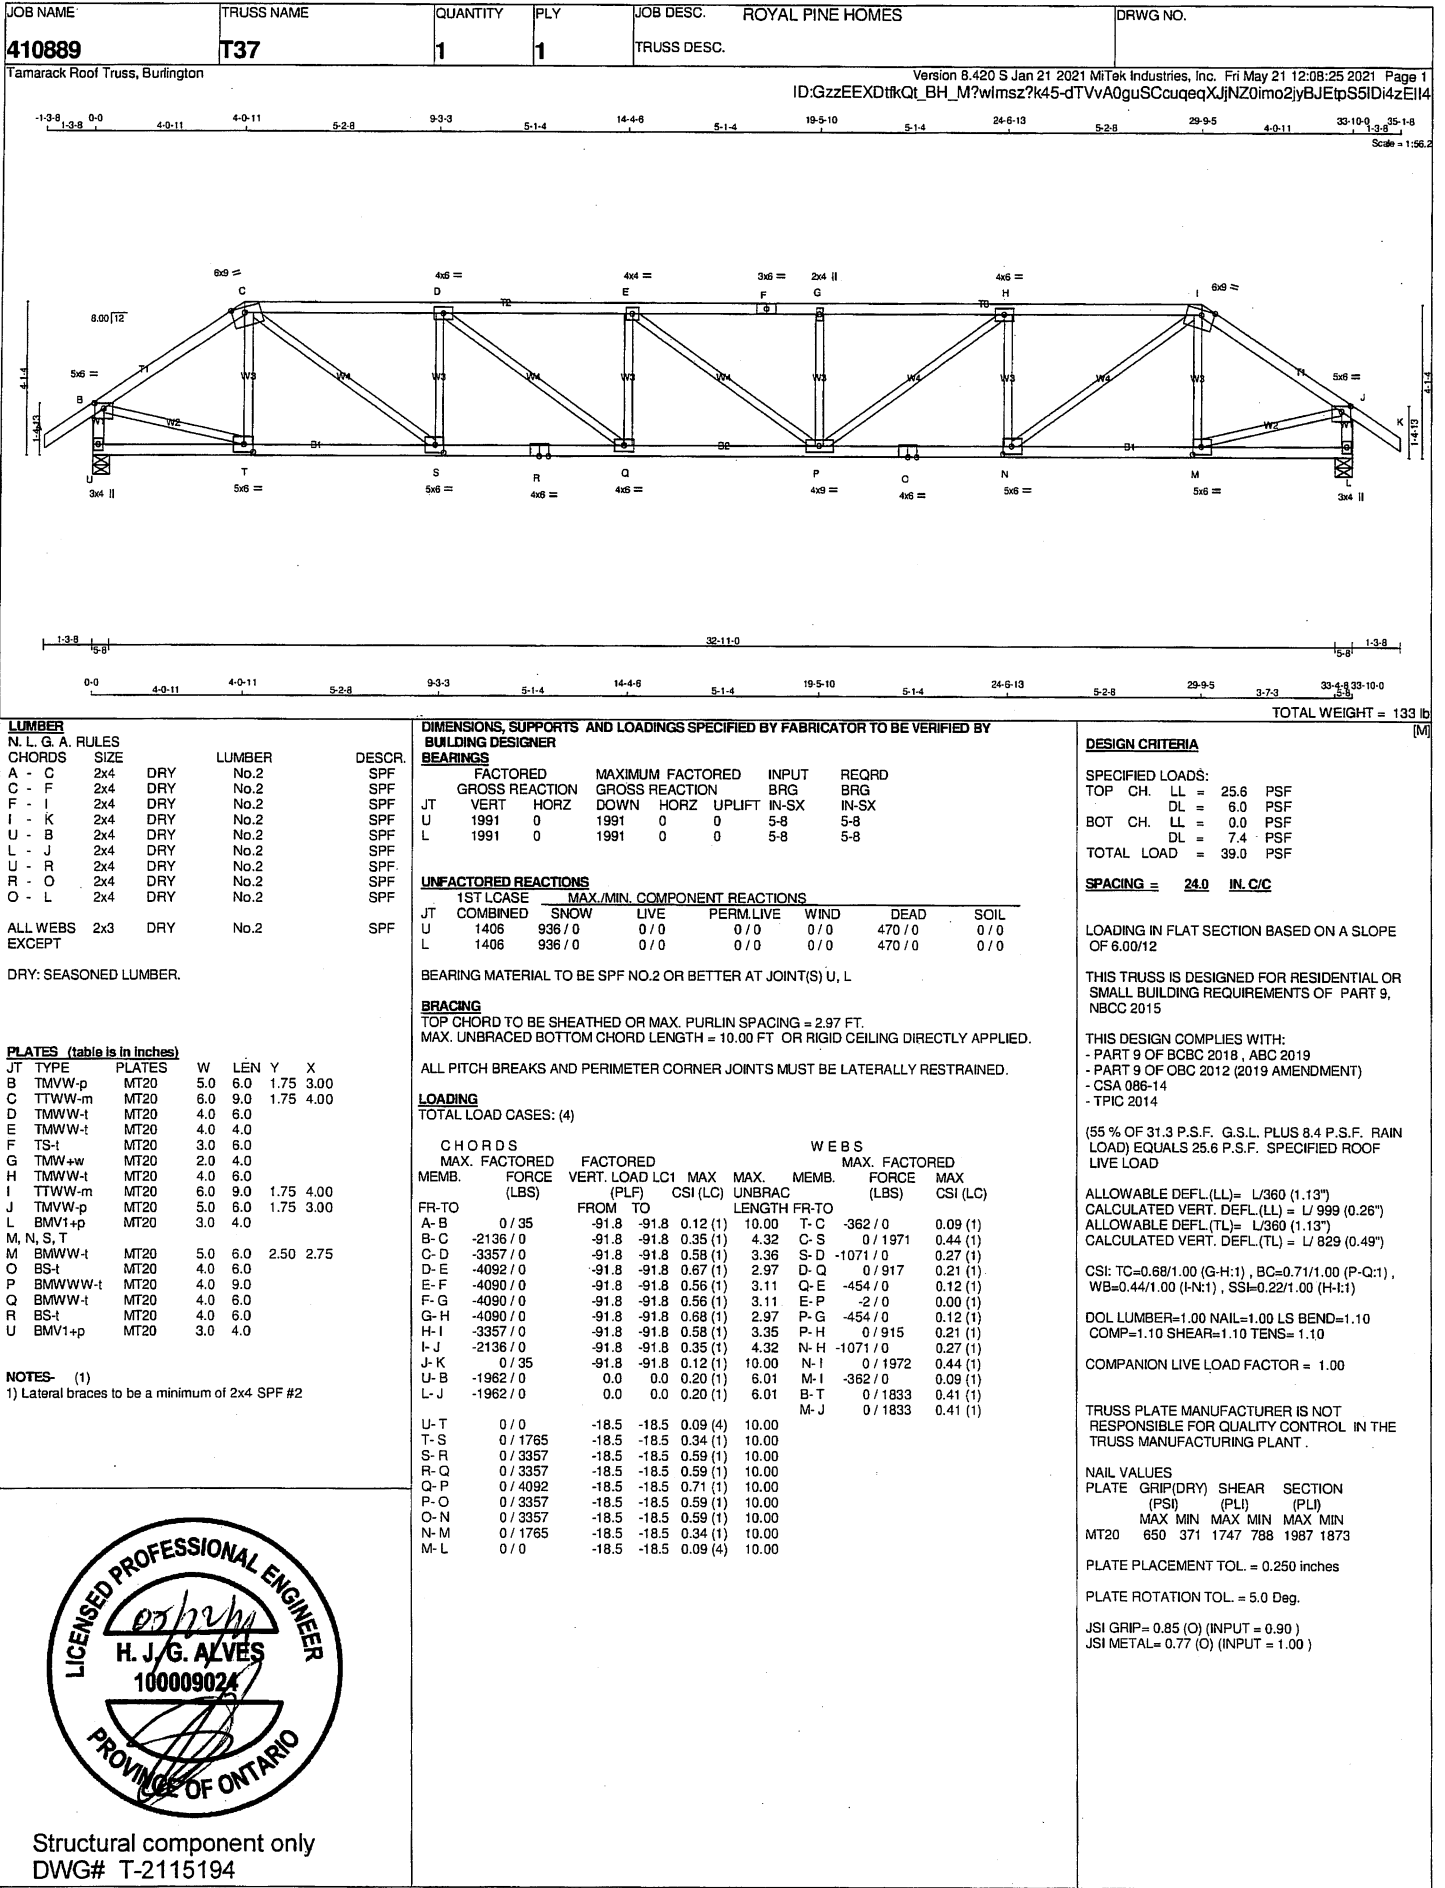

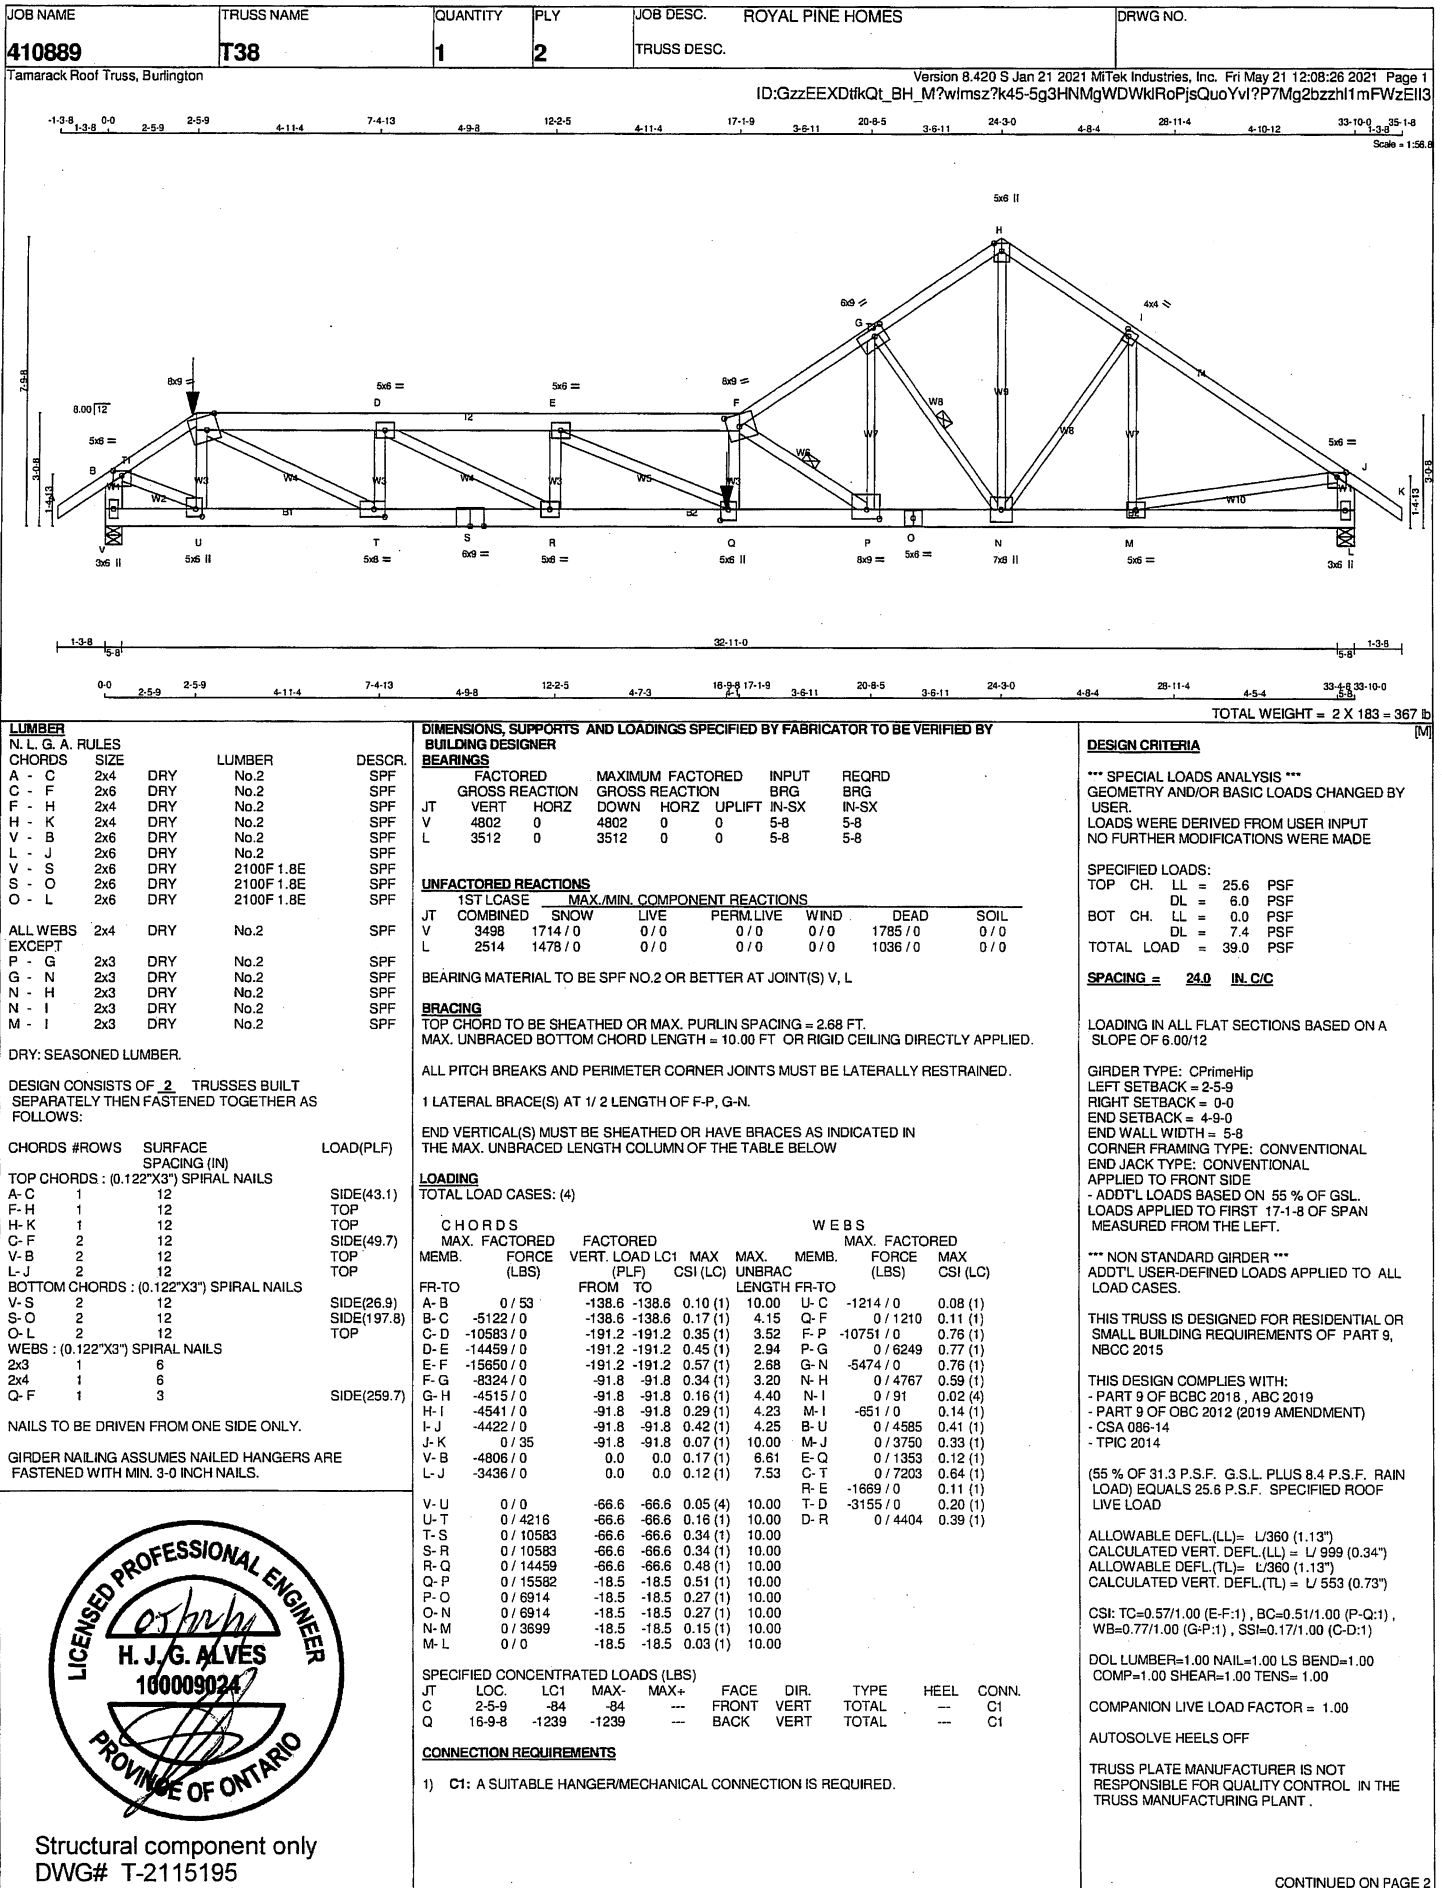

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.																																																																																																																																																																											
410889	T38	1	2	TRUSS DESC.																																																																																																																																																																													
Tamarack Roof Truss, Burlington																																																																																																																																																																																	
Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:26 2021 Page 2																																																																																																																																																																																	
ID:GzzEEXDtkQt BH M?wlmsz?k45-Sq3HNMqWDWkiRoPisQuoYvl?P7Mg2bzzh1mFWzEII3																																																																																																																																																																																	
PLATES (table is in inches) <table><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>B</td><td>TMVW-p</td><td>MT20</td><td>5.0</td><td>6.0</td><td>1.50</td><td>3.00</td></tr><tr><td>C</td><td>TTWW-m</td><td>MT20</td><td>8.0</td><td>9.0</td><td>4.50</td><td>3.75</td></tr><tr><td>D</td><td>TMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>E</td><td>TMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>F</td><td>TTWW-m</td><td>MT20</td><td>8.0</td><td>9.0</td><td>4.00</td><td>4.00</td></tr><tr><td>G</td><td>TMWW-t</td><td>MT20</td><td>6.0</td><td>9.0</td><td>2.50</td><td>3.50</td></tr><tr><td>H</td><td>TTW+p</td><td>MT20</td><td>5.0</td><td>6.0</td><td>Edge</td><td></td></tr><tr><td>I</td><td>TMWW-t</td><td>MT20</td><td>4.0</td><td>4.0</td><td>2.00</td><td>1.50</td></tr><tr><td>J</td><td>TMVW-p</td><td>MT20</td><td>5.0</td><td>6.0</td><td>1.50</td><td>3.00</td></tr><tr><td>L</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr><tr><td>M</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>N</td><td>BMWWWW-t</td><td>MT20</td><td>7.0</td><td>8.0</td><td></td><td></td></tr><tr><td>O</td><td>BS-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>P</td><td>BMWW-t</td><td>MT20</td><td>8.0</td><td>9.0</td><td>3.00</td><td>4.00</td></tr><tr><td>Q</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td>3.50</td><td>2.50</td></tr><tr><td>R</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>S</td><td>BS-t</td><td>MT20</td><td>6.0</td><td>9.0</td><td></td><td></td></tr><tr><td>T</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>8.0</td><td>2.50</td><td>3.50</td></tr><tr><td>U</td><td>BMWW-t</td><td>MT20</td><td>5.0</td><td>6.0</td><td>2.50</td><td>2.00</td></tr><tr><td>V</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2x4 SPF #2 LICENSED PROFESSIONAL ENGINEER 05/22/11 H. J. G. ALVES 100009824 PROVINCE OF ONTARIO Structural component only DWG# T-2115195 NAIL VALUES <table><thead><tr><th>PLATE</th><th>GRIP(DRY)</th><th>SHEAR</th><th>SECTION</th></tr><tr><th></th><th>(PSI)</th><th>(PLI)</th><th>(PLI)</th></tr></thead><tbody><tr><td></td><td>MAX</td><td>MIN</td><td>MAX</td></tr><tr><td>MT20</td><td>650</td><td>371</td><td>1747</td></tr><tr><td></td><td></td><td>788</td><td>1987</td></tr><tr><td></td><td></td><td></td><td>1873</td></tr></tbody></table> PLATE PLACEMENT TOL = 0.250 inches PLATE ROTATION TOL = 5.0 Deg. JSI GRIP= 0.90 (G) (INPUT = 0.90) JSI METAL= 0.85 (S) (INPUT = 1.00)							JT	TYPE	PLATES	W	LEN	Y	X	B	TMVW-p	MT20	5.0	6.0	1.50	3.00	C	TTWW-m	MT20	8.0	9.0	4.50	3.75	D	TMWW-t	MT20	5.0	6.0			E	TMWW-t	MT20	5.0	6.0			F	TTWW-m	MT20	8.0	9.0	4.00	4.00	G	TMWW-t	MT20	6.0	9.0	2.50	3.50	H	TTW+p	MT20	5.0	6.0	Edge		I	TMWW-t	MT20	4.0	4.0	2.00	1.50	J	TMVW-p	MT20	5.0	6.0	1.50	3.00	L	BMV1+p	MT20	3.0	6.0			M	BMWW-t	MT20	5.0	6.0			N	BMWWWW-t	MT20	7.0	8.0			O	BS-t	MT20	5.0	6.0			P	BMWW-t	MT20	8.0	9.0	3.00	4.00	Q	BMWW-t	MT20	5.0	6.0	3.50	2.50	R	BMWW-t	MT20	5.0	6.0			S	BS-t	MT20	6.0	9.0			T	BMWW-t	MT20	5.0	8.0	2.50	3.50	U	BMWW-t	MT20	5.0	6.0	2.50	2.00	V	BMV1+p	MT20	3.0	6.0			PLATE	GRIP(DRY)	SHEAR	SECTION		(PSI)	(PLI)	(PLI)		MAX	MIN	MAX	MT20	650	371	1747			788	1987				1873
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																																																																																											
B	TMVW-p	MT20	5.0	6.0	1.50	3.00																																																																																																																																																																											
C	TTWW-m	MT20	8.0	9.0	4.50	3.75																																																																																																																																																																											
D	TMWW-t	MT20	5.0	6.0																																																																																																																																																																													
E	TMWW-t	MT20	5.0	6.0																																																																																																																																																																													
F	TTWW-m	MT20	8.0	9.0	4.00	4.00																																																																																																																																																																											
G	TMWW-t	MT20	6.0	9.0	2.50	3.50																																																																																																																																																																											
H	TTW+p	MT20	5.0	6.0	Edge																																																																																																																																																																												
I	TMWW-t	MT20	4.0	4.0	2.00	1.50																																																																																																																																																																											
J	TMVW-p	MT20	5.0	6.0	1.50	3.00																																																																																																																																																																											
L	BMV1+p	MT20	3.0	6.0																																																																																																																																																																													
M	BMWW-t	MT20	5.0	6.0																																																																																																																																																																													
N	BMWWWW-t	MT20	7.0	8.0																																																																																																																																																																													
O	BS-t	MT20	5.0	6.0																																																																																																																																																																													
P	BMWW-t	MT20	8.0	9.0	3.00	4.00																																																																																																																																																																											
Q	BMWW-t	MT20	5.0	6.0	3.50	2.50																																																																																																																																																																											
R	BMWW-t	MT20	5.0	6.0																																																																																																																																																																													
S	BS-t	MT20	6.0	9.0																																																																																																																																																																													
T	BMWW-t	MT20	5.0	8.0	2.50	3.50																																																																																																																																																																											
U	BMWW-t	MT20	5.0	6.0	2.50	2.00																																																																																																																																																																											
V	BMV1+p	MT20	3.0	6.0																																																																																																																																																																													
PLATE	GRIP(DRY)	SHEAR	SECTION																																																																																																																																																																														
	(PSI)	(PLI)	(PLI)																																																																																																																																																																														
	MAX	MIN	MAX																																																																																																																																																																														
MT20	650	371	1747																																																																																																																																																																														
		788	1987																																																																																																																																																																														
			1873																																																																																																																																																																														

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T39S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:28 2021 Page 2
ID:GzzEEXDtKQt BH M?wImSz?k45-22B2o2iml7 Th6Z6 rwGdKOR5x8JWdLF83WtJPzEII1


PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.50	1.75
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMV+p	MT20	3.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW-t	MT20	5.0	6.0	2.50	1.75
I	BMV1+p	MT20	3.0	6.0		
J	BMWW-t	MT20	5.0	6.0		
K	BVMWWW-I	MT20	8.0	12.0	4.50	4.50
L	BMV+p	MT20	3.0	6.0		
M	BMWWW-t	MT20	7.0	8.0		
N	BMWW-t	MT20	5.0	6.0		
O	BMV1+p	MT20	3.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2




LICENSED PROFESSIONAL ENGINEER
H. J. G. ALVES
100009024
PROVINCE OF ONTARIO

Structural component only
DWG# T-2115196

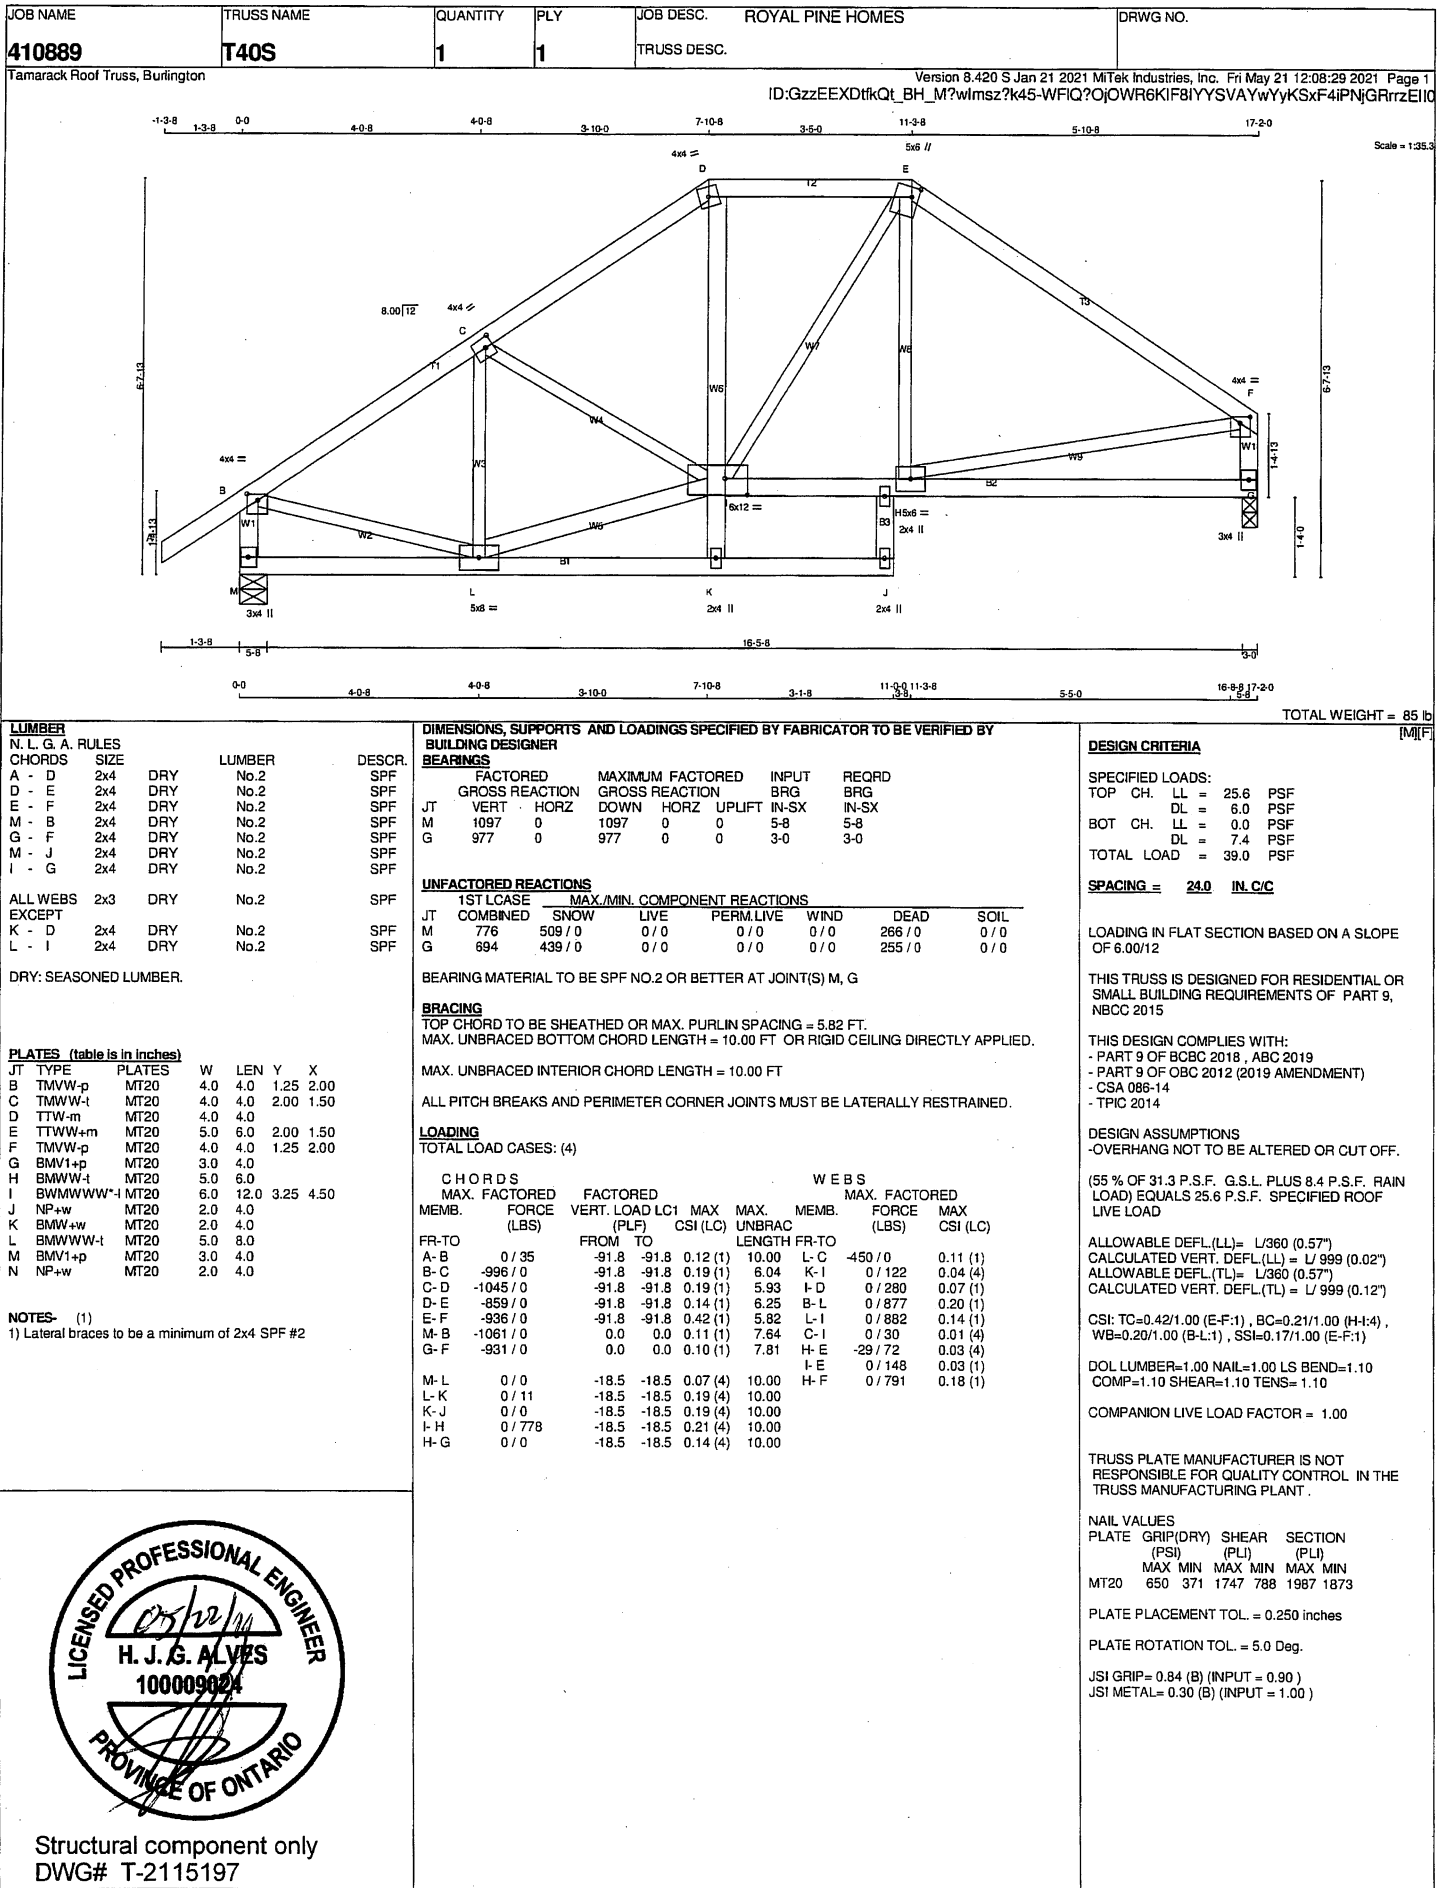

JOB NAME 410889	TRUSS NAME T42	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:31 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmssz?k45-SdsAQ4k12M11YZlgfzUzFz?tw86aj_r1q1XwkzEII

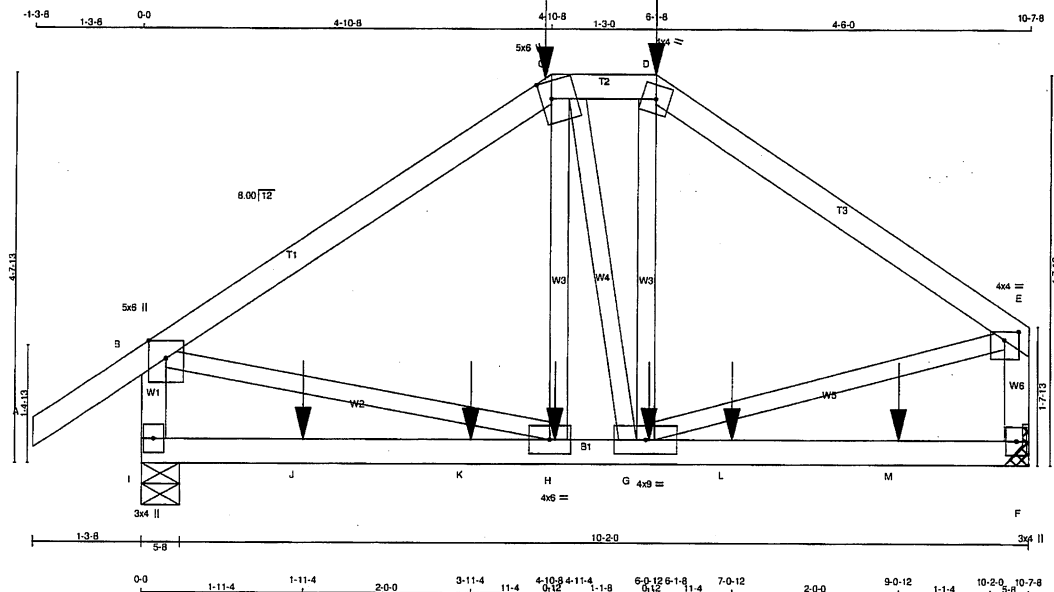

TOTAL WEIGHT = 48 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
I - F	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.50	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMVWW-t	MT20	4.0	6.0		
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
I	1171	0	5-8	5-8
F	1078	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
I	826 551 / 0 0 / 0 0 / 0 0 / 0 0 / 0
F	763 496 / 0 0 / 0 0 / 0 0 / 0 267 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.48 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. MEMB. FORCE (LBS)	MAX. FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	
A-B	0 / 35	-91.8 -91.8 0.14 (1)	10.00	H-C -52 / 84 0.03 (4)
B-C	-1040 / 0	-91.8 -91.8 0.46 (1)	5.48	C-G -47 / 0 0.02 (1)
C-D	-852 / 0	-91.8 -91.8 0.04 (1)	6.25	G-D -86 / 67 0.03 (1)
D-E	-1031 / 0	-91.8 -91.8 0.39 (1)	5.62	B-H 0 / 884 0.22 (1)
I-B	-1116 / 0	0.0 0.0 0.13 (1)	7.48	G-E 0 / 890 0.22 (1)
F-E	-1022 / 0	0.0 0.0 0.12 (1)	7.72	
I-J	0 / 0	-18.5 -18.5 0.19 (4)	10.00	
J-K	0 / 0	-18.5 -18.5 0.19 (4)	10.00	
K-H	0 / 0	-18.5 -18.5 0.19 (4)	10.00	
H-G	0 / 863	-18.5 -18.5 0.27 (4)	10.00	
G-L	0 / 0	-18.5 -18.5 0.18 (4)	10.00	
L-M	0 / 0	-18.5 -18.5 0.18 (4)	10.00	
M-F	0 / 0	-18.5 -18.5 0.18 (4)	10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-273	-273	---	FRONT	VERT	TOTAL	---	C1
D	6-1-8	-273	-273	---	FRONT	VERT	TOTAL	---	C1
G	6-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
H	4-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
J	1-11-4	-22	-22	---	FRONT	VERT	TOTAL	---	C1
K	3-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
L	7-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
M	9-0-12	-22	-22	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.46/1.00 (B-C:1), BC=0.27/1.00 (G-H:4), WB=0.22/1.00 (E-G:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.82 (E) (INPUT = 0.90)
JSI METAL= 0.45 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115199

JOB NAME 410889	TRUSS NAME T43	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:32 2021 Page 1
ID:GzzEEEXDtKQt_BH_M?wlmSz?k45-wqQYePiHoMUuAjtDh?CoAY06YRISUXr3hU5RAzEIHz

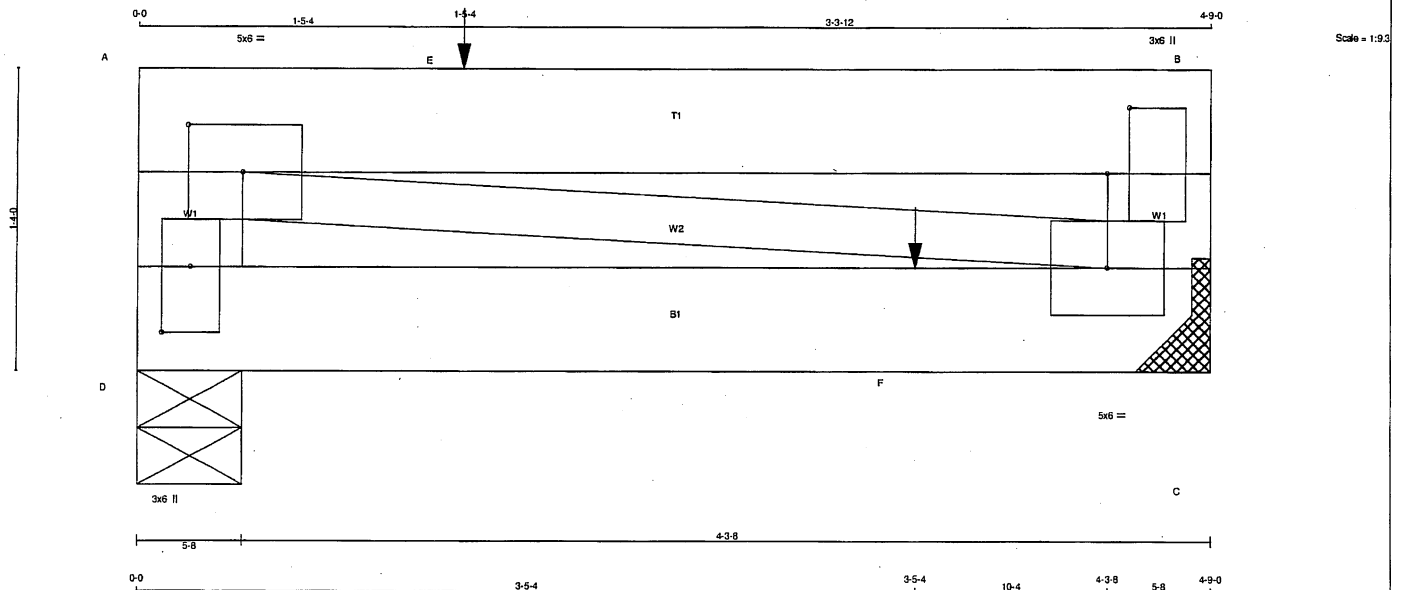

TOTAL WEIGHT = 2 X 22 = 43 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x6	DRY	No.2	SPF
A - B	2x6	DRY	No.2	SPF
C - B	2x6	DRY	No.2	SPF
D - C	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD(PLF)
SIZE	SPACING (IN)	
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D - A	2	12
A - B	2	12
B - C	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D - C	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	2.50	3.00
B	TMVW-p	MT20	3.0	6.0	3.50	1.25
C	BMVW1-t	MT20	5.0	6.0		
D	BMV1+p	MT20	3.0	6.0	3.50	1.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	1713	0	1713	0	5-8
C	1772	0	1772	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	1214	781 / 0	0 / 0	0 / 0	0 / 0	433 / 0	0 / 0
C	1253	822 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO
D - A	-1416 / 0	0.0 0.0 0.05 (1)	7.81 A - C
A - E	0 / 0	-336.4 -336.4 0.62 (1)	0 / 0
E - B	0 / 0	-336.4 -336.4 0.62 (1)	10.00
C - B	-1067 / 0	0.0 0.0 0.04 (1)	7.81
D - F	0 / 0	-18.5 -18.5 0.33 (1)	10.00
F - C	0 / 0	-18.5 -18.5 0.33 (1)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-5-4	-631	-631	---	TOP	VERT	TOTAL	---	C1
F	3-5-4	-645	-645	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

GIRDER TYPE: CStd Girder
START DISTANCE = 0-0
START SPAN CARRIED = 11-0-0
END DISTANCE = 4-9-0
END SPAN CARRIED = 11-0-0
END WALL WIDTH = 1-8
APPLIED TO FRONT SIDE OF TOP CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.62/1.00 (A-B:1), BC=0.33/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.47/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)		
MAX	MIN	MAX	MIN	MAX
MT20	650	371	1747	788
			1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (A) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)

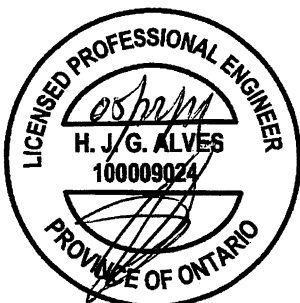


Structural component only
DWG# T-2115200

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	T44	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:33 2021 Page 1
ID:GzzEEEXDtkQt_BH_M?wmsz?k45-O0_xrlvmZfclntR3nOWRK05laymhBxn?lLEzczElHy

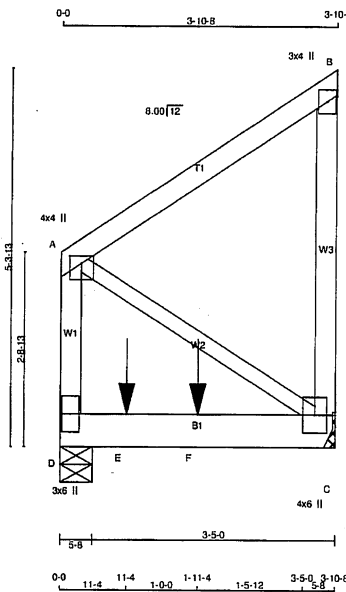

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
D - A	2x4	DRY	No.2		SPF
A - B	2x4	DRY	No.2		SPF
C - B	2x4	DRY	No.2		SPF
D - C	2x6	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS	SPACING (IN)	
D-A 1	12	TOP
A-B 1	12	TOP
B-C 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMV+p	MT20	3.0	4.0		
C	BMVW1+p	MT20	4.0	6.0		
D	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX
JT VERT HORZ	DOWN HORZ	UPLIFT	IN-SX	5-8
D 863 0	863 0	0	5-8	5-8
C 782 0	782 0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 2'-0.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	608	413 / 0	0 / 0	0 / 0	0 / 0	194 / 0	0 / 0
C	552	368 / 0	0 / 0	0 / 0	0 / 0	183 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		MAX. FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX		
(LBS)	(PLF)	(LC)	CSI	(LC)	(LBS)	(LC)			
FR-TO	FROM	TO	LENGTH	FR-TO					
D-A	-178 / 0	0.0	0.0	0.01 (1)	7.81	A-C	0 / 0		
A-B	0 / 0	-91.8	-91.8	0.13 (1)	10.00		0.00 (1)		
C-B	-178 / 0	0.0	0.0	0.04 (1)	7.81				
D-E	0 / 0	-18.5	-18.5	0.42 (1)	10.00				
E-F	0 / 0	-18.5	-18.5	0.42 (1)	10.00				
F-C	0 / 0	-18.5	-18.5	0.42 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	11-4	-109	-109	---	BACK	VERT	TOTAL	---	C1
F	1-11-4	-748	-748	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL)= L/360 (0.19")
CALCULATED VERT. DEFL(LL) = L/999 (0.02")
ALLOWABLE DEFL(TL)= L/360 (0.19")
CALCULATED VERT. DEFL(TL) = L/999 (0.04")

CSI: TC=0.13/1.00 (A-B:1), BC=0.42/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.06 (A) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)

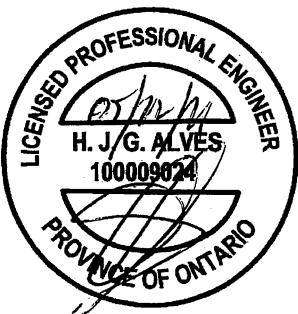


Structural component only
DWG# T-2115201

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	J1	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:06:04 2021 Page 1
ID:GzzEEXDtKtKt_BH_M?wlmz?k45-IRKzlrPjOlytpQkUaoVefGOFTGwOuqbjdKicTozEIIP

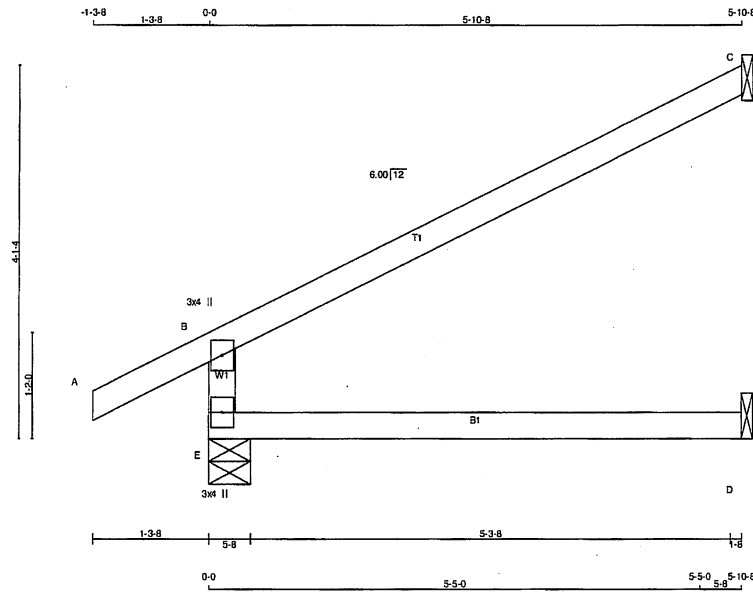

Scale = 1/20.1

TOTAL WEIGHT = 10 X 17 = 168 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES-

(1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
E	525	0	5-8	5-8
C	202	0	1-8	1-8
D	45	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	LC1	MAX	UNBRACED LENGTH	FR-TO
E-B	-461 / 0	0.0	0.0	0.13 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-30 / 0	-91.8	-91.8	0.54 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14.
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

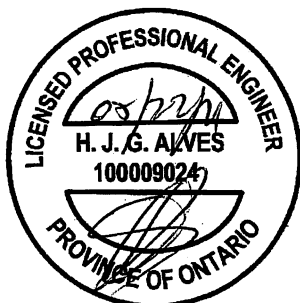


Structural component only
DWG# T-2115177

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	J1S	7	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 12:08:05 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-DdlzBQL934jQZlh8W0tCUXUOfCtGdGXtr_S9?EzEII0

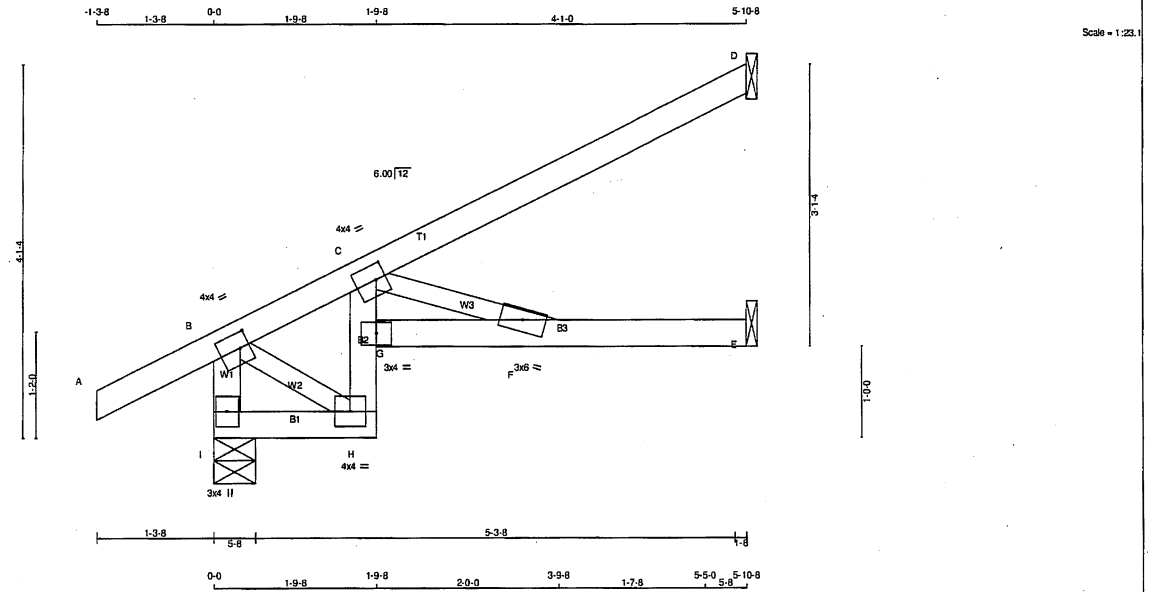

TOTAL WEIGHT = 7 X 21 = 149 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED
I - B	2x4	DRY	No.2	SPF		GROSS REACTION	INPUT
A - D	2x4	DRY	No.2	SPF		DOWN	BRG
I - H	2x4	DRY	No.2	SPF		HORIZ	UPLIFT
H - C	2x4	DRY	No.2	SPF			IN-SX
G - E	2x4	DRY	No.2	SPF			IN-SX
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-I	MT20	4.0	4.0	2.00 1.25
C	TMVW-I	MT20	4.0	4.0	2.00 1.25
F	BMVW-w	MT20	3.0	6.0	
G	BMVH-I	MT20	3.0	4.0	
H	BMVW-I	MT20	4.0	4.0	
I	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

UNFACTORED REACTIONS							
JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
I	325	228 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
D	133	103 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
E	86	39 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
I-B	-448 / 0	0.0	0.0 0.05 (1)	B-H	0 / 223	0.05 (1)	
A-B	0 / 28	-91.8	-91.8 0.12 (1)	C-F	-522 / 0	0.08 (1)	
B-C	-241 / 0	-91.8	-91.8 0.12 (1)				
C-D	0 / 3	-91.8	-91.8 0.27 (1)				
I-H	0 / 0	-18.5	-18.5 0.01 (4)				
H-G	-88 / 0	0.0	0.0 0.27 (1)				
G-C	0 / 63	0.0	0.0 0.28 (1)				
G-F	0 / 486	-18.5	-18.5 0.40 (1)				
F-E	0 / 0	-18.5	-18.5 0.32 (1)				

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/625 (0.11")

CSI: TC=0.27/1.00 (C-D:1), BC=0.40/1.00 (F-G:1), WB=0.08/1.00 (C-F:1), SS=0.23/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.42 (C) (INPUT = 0.90)
JSI METAL= 0.16 (G) (INPUT = 1.00)




Structural component only
DWG# T-2115178

JOB NAME 410887	TRUSS NAME J2	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 10:47:44 2021 Page 1
ID:GzzEEXDtKQt_BH_M?wmsz?k45-t8Up8j4IWphmYhF7DW1LJqmdHvZuMGGR7YHazeJTJ

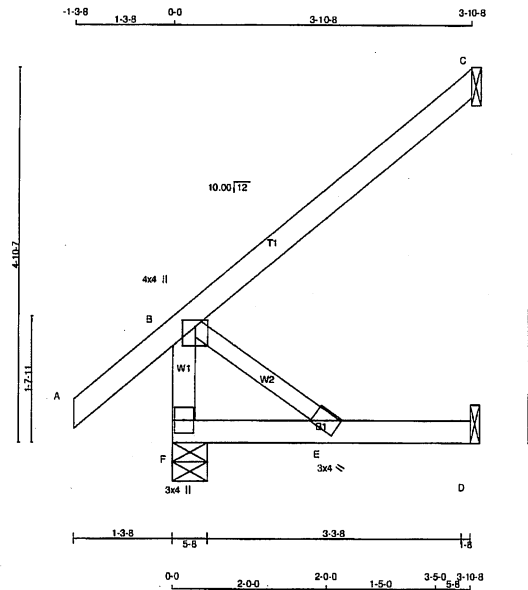

Scale = 1:27.3

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL = 25.6	PSF	
F - B	2x4	DRY	No.2	DL	= 6.0	PSF	
A - C	2x4	DRY	No.2	BOT CH.	LL = 0.0	PSF	
F - D	2x4	DRY	No.2	DL	= 7.4	PSF	
ALL WEBS	2x3	DRY	No.2	TOTAL LOAD	= 39.0	PSF	
DRY: SEASONED LUMBER.				TOTAL WEIGHT = 2 X 16 = 31 lb			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	341	0	341	0	5-8
C	178	0	178	0	1-8
D	36	0	40	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	239	170 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO
F-B	-305 / 0	0.0 0.0 0.03 (1)	7.81
A-B	0 / 41	-91.8 -91.8 0.14 (5)	10.00
B-C	0 / 0	-91.8 -91.8 0.23 (1)	10.00
F-E	0 / 0	-18.5 -18.5 0.08 (4)	10.00
E-D	0 / 0	-18.5 -18.5 0.08 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115139

JOB NAME 410889	TRUSS NAME J3	QUANTITY 4	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:06 2021 Page 1
ID:GzzEEXDtkQt_BH_M7wmsz?k45-hpsjAWRzwNca2jthDX6khTg13bPMjc04eBjXgzEiIN

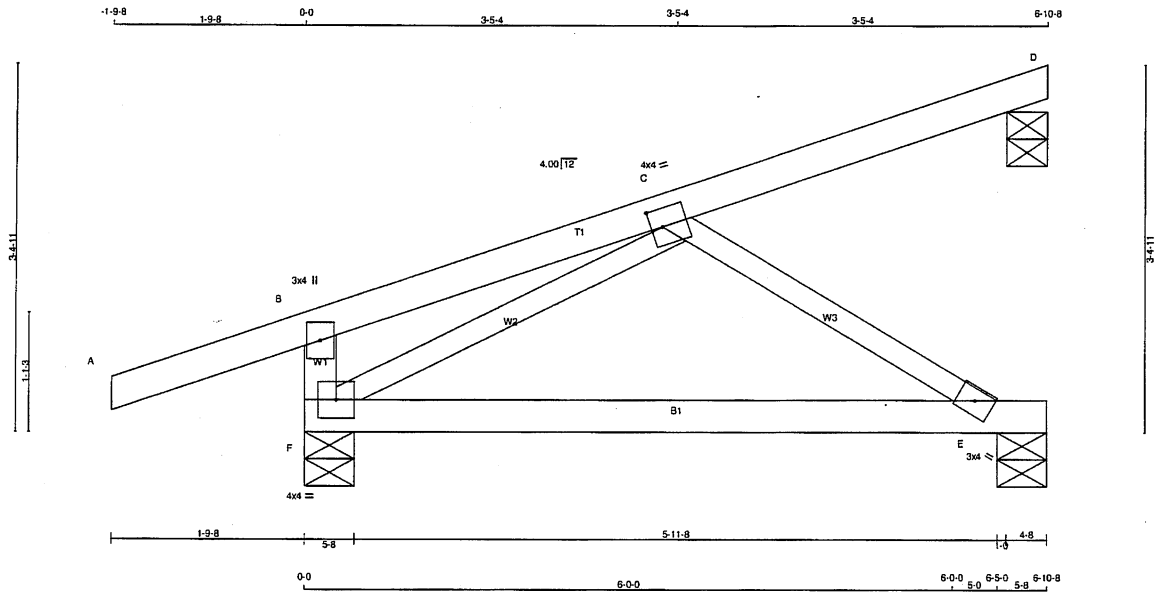

TOTAL WEIGHT = 4 X 25 = 99 lb

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
F - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMV-W-t	MT20	4.0	4.0	2.00	1.25
E	BMV1-w	MT20	3.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		

NOTES-

- (1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	521	0	5-8	5-8
D	124	0	4-8	4-8
E	269	0	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	365	259 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0	0 / 0
D	86	69 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0	0 / 0
E	191	118 / 0	0 / 0	0 / 0	0 / 0	74 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO			
F-B		-286 / 0	0.0	0.0	0.03 (1)	C-E		-377 / 0	0.10 (1)
A-B		0 / 27	-91.8	-91.8	0.22 (1)	F-C		-359 / 0	0.09 (1)
B-C		0 / 12	-91.8	-91.8	0.17 (1)				
C-D		-11 / 0	-91.8	-91.8	0.17 (1)				
F-E		0 / 312	-18.5	-18.5	0.22 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.22/1.00 (A-B:1), BC=0.22/1.00 (E-F:4),
WB=0.10/1.00 (C-E:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
		MAX MIN	MAX MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.34 (F) (INPUT = 0.90)
JSI METAL = 0.13 (E) (INPUT = 1.00)

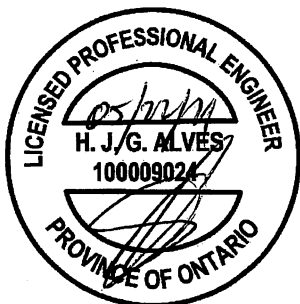


Structural component only
DWG# T-2115179

JOB NAME 410887	TRUSS NAME J3W	QUANTITY 4	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mittek Industries, Inc. Fri May 21 10:47:46 2021 Page 1
ID:GzzEEEXDtkQt_BH_M?wmsz?k45-pXcZZO6Y2QxUn_PWKx3pOFryQ5Wa1nSZJcIM2zEJTH

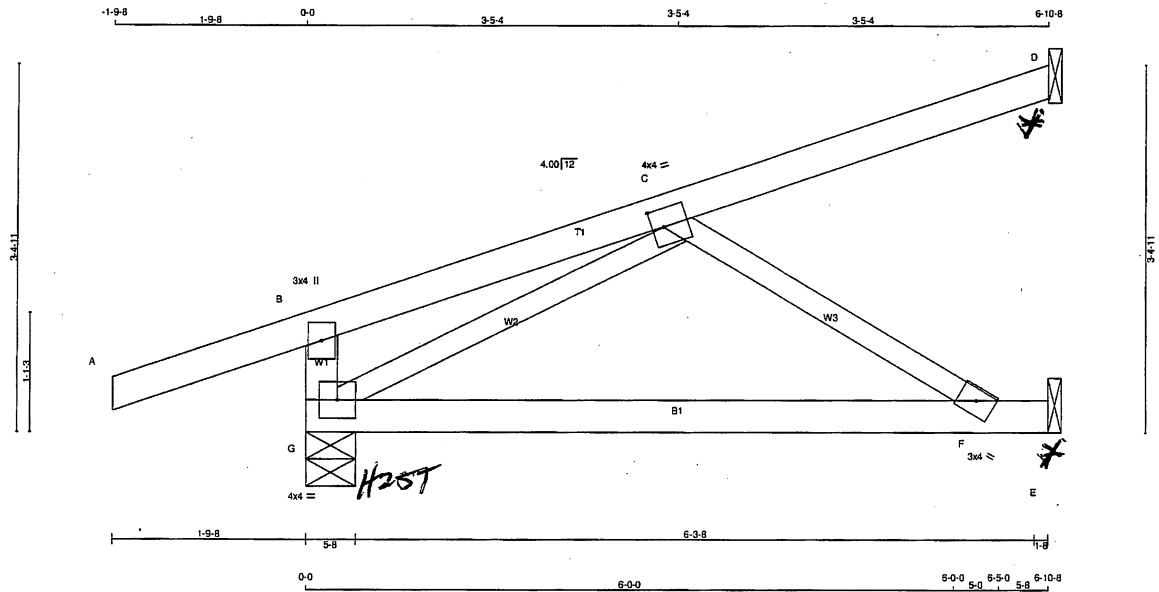

Scale = 1:19.4

TOTAL WEIGHT = 4 X 25 = 99 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF	SPF
G - B	2x4	DRY	No.2	SPF			
A - D	2x4	DRY	No.2	SPF			
G - E	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWV-t	MT20	4.0	4.0	2.00 1.25
F	BMW+w	MT20	3.0	4.0	
G	BMVW1-t	MT20	4.0	4.0	

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

END VERTICALS ARE NOT EXPOSED TO WIND.

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX	IN-SX
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX
G	548	0	548	166	-306
D	136	0	136	0	-91
E	243	0	243	0	-235

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) D, E

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 306 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT E FOR 235 LBS. FACTORED UPLIFT

PROVIDE FOR 166 LBS. FACTORED HORIZONTAL REACTION AT JOINT G

UNFACTORED REACTIONS		1ST LOASE	MAX./MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	384	270 / 0	0 / 0	0 / 0	0 / -292	114 / 0	0 / 0
D	95	73 / 0	0 / 0	0 / 0	0 / -79	22 / 0	0 / 0
E	173	103 / 0	0 / 0	0 / 0	0 / -213	70 / 0	0 / 0

HORIZONTAL REACTIONS							
G	---	0 / 0	0 / 0	0 / 0	119 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (12)

CHORDS		MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
G-B	-298 / 161	0.0	0.0 0.03 (1)	C-F	-353 / 240
A-B	0 / 27	-91.8	-91.8 0.22 (1)	G-C	-340 / 37
B-C	0 / 63	-91.8	-91.8 0.13 (1)		
C-D	-35 / 0	-91.8	-91.8 0.14 (1)		
G-F	-199 / 292	-18.5	-18.5 0.30 (1)		
F-E	0 / 0	-18.5	-18.5 0.21 (1)		

WIND LOAD APPLIED IS DERIVED FROM REFERENCE VELOCITY PRESSURE OF (9.2) PSF AT (15'-0") FT-IN-SX REFERENCE HEIGHT ABOVE GRADE AND USING EXTERNAL PEAK COEFFICIENTS, C_p , C_g , BASED ON THE (MAIN WIND FORCE RESISTING SYSTEM). INTERNAL WIND PRESSURE IS BASED ON DESIGN (CATEGORY 2). BUILDING MAY BE LOCATED ON (OPEN TERRAIN), AND TRUSS IS DESIGNED TO BE LOCATED AT LEAST (0'-0") FT-IN-SX AWAY FROM EAVE. TRUSS UPLIFT IS BASED ON TOP AND BOTTOM CHORD DEAD LOADS OF 6.0 PSF AND 7.4 PSF RESPECTIVELY.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.23")
CALCULATED VERT. DEFL.(LL) = $L/400$ (0.21")
ALLOWABLE DEFL.(TL) = $L/360$ (0.23")
CALCULATED VERT. DEFL.(TL) = $L/458$ (0.18")

CSI: TC=0.22/1.00 (A-B:1), BC=0.30/1.00 (F-G:1), WB=0.09/1.00 (C-F:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.32 (G) (INPUT = 0.90)
JSI METAL = 0.13 (F) (INPUT = 1.00)




Structural component only
DWG# T-2115141

JOB NAME 410888	TRUSS NAME J20	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 11:18:22 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-21YfVbKDXF_28mNuX?MoQukRCCTC9NovOMppeEJ1?

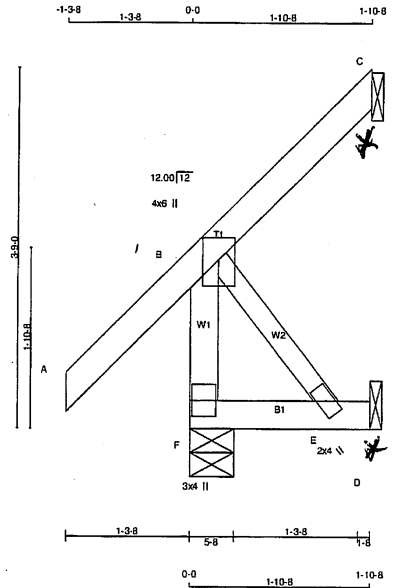

Scale = 1/2" = 1'-0"

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.75	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT.	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
F	279	0	279	0	0	5-8	5-8		
C	38	0	38	0	-37	1-8	1-8		
D	17	0	19	0	0	1-8	1-8		

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	194	146 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0	0 / 0
C	26	21 / -27	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)	MAX. (LC)
FR-TO		FROM TO		FR-TO			
F-B	-262 / 0	0.0	0.0 0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 45	-91.8	-91.8 0.13 (1)	10.00			
B-C	-34 / 0	-91.8	-91.8 0.12 (1)	6.25			
F-E	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
E-D	0 / 0	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 11 = 32 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.07/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115162

JOB NAME 410889	TRUSS NAME J32	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:09 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-5OXspYTsDlb9vBcSNM5pMK5AZHfKZ5qSmcQN8?zEIIK

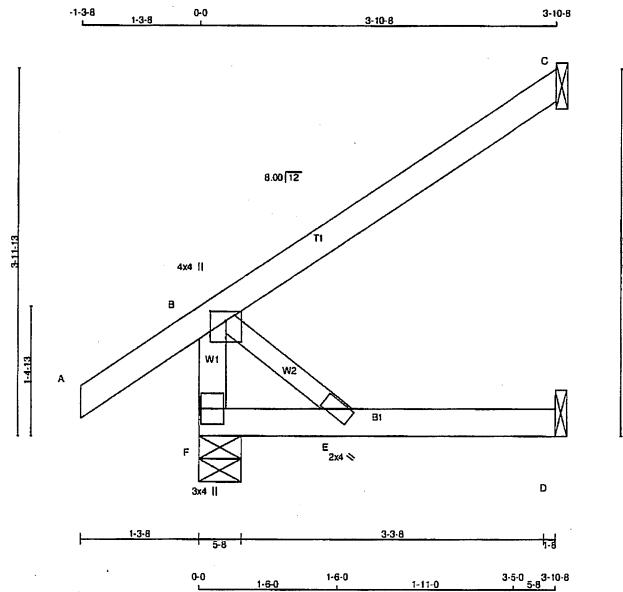

Scale = 1:22.5

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:	
F - B	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	UPLIFT	TOP CH. LL = 25.6 PSF	
A - C	2x4	DRY	No.2	SPF						DL = 6.0 PSF	
F - D	2x4	DRY	No.2	SPF						BOT CH. LL = 0.0 PSF	
ALL WEBS	2x3	DRY	No.2	SPF						DL = 7.4 PSF	
DRY: SEASONED LUMBER.										TOTAL LOAD = 39.0 PSF	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	340	0	340	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	238	169 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	UNBRAC LENGTH FR-TO
F-B	-304 / 0	0.0	0.0 0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8 0.14 (5)	10.00			
B-C	0 / 0	-91.8	-91.8 0.23 (1)	10.00			
F-E	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
E-D	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

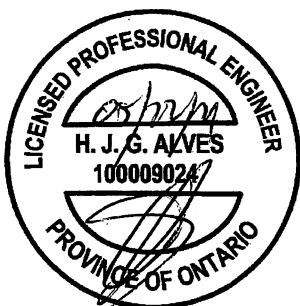


Structural component only
DWG# T-2115181

JOB NAME 410889	TRUSS NAME J33	QUANTITY 5	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MTek Industries, Inc. Fri May 21 12:08:09 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmisz?k45-5OXspYTsDlb9vBcSNM5pMK55CheXZ5qSmcQN8?zEIIK

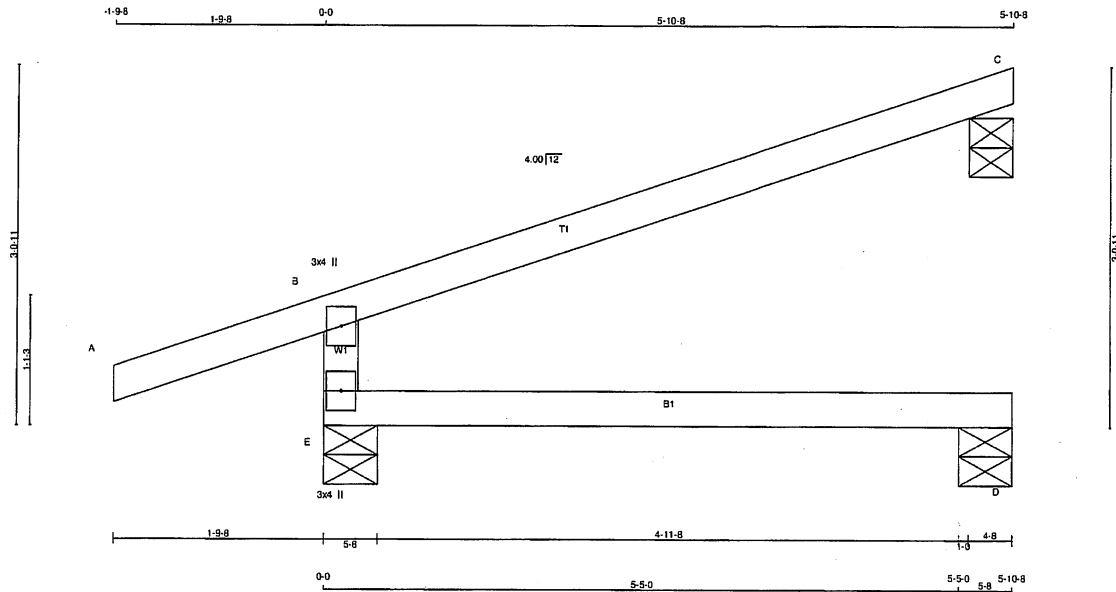

TOTAL WEIGHT = 5 X 17 = 84 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED
E - B	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION	GROSS REACTION
A - C	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN
E - D	2x4	DRY	No.2	SPF	VERT	HORZ	UPLIFT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES:

1) Lateral braces to be a minimum of 2x4 SPF #2

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	399	282 / 0	0 / 0	0 / 0	0 / 0	117 / 0	0 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-505 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 27	-91.8	-91.8 0.22 (1)	10.00			
B-C	-21 / 0	-91.8	-91.8 0.54 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)




Structural component only
DWG# T-2115182

JOB NAME 410887	TRUSS NAME C1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:40 2021 Page 1
ID:GzzEEXDtfkQI_BH_M?wimsz?k45_NFIJLtoSaBL33xM_gyO8_by1gWZd4MgLP9L8PzEJTn

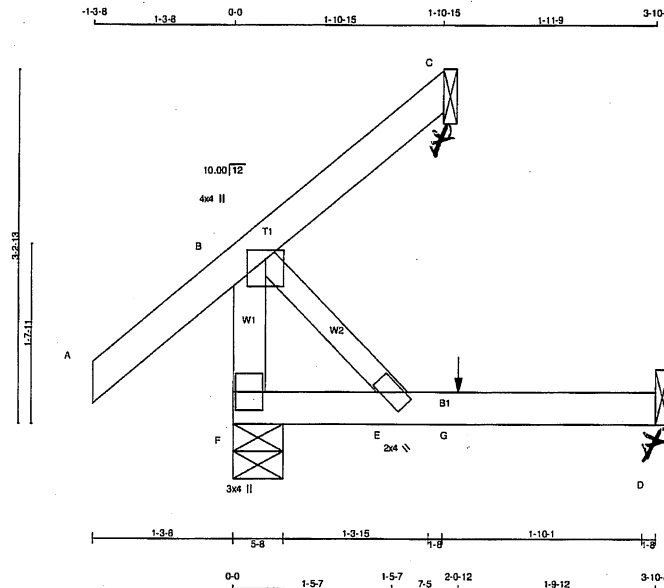

Scale = 1:19.2

TOTAL WEIGHT = 12 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4 DRY	No.2		
A - C	2x4 DRY	No.2		
F - D	2x4 DRY	No.2		
ALL WEBS	2x3 DRY	No.2		
DRY: SEASONED LUMBER.				

DESCR.	SPF
SPF	
SPF	
SPF	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	297	0	297	0
C	42	0	42	0
D	36	0	40	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	208	145 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
C	29	23 / -26	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
		FORCE	(PLF)			CS1 (LC)	UNBRAC		FORCE
FR-TO		(LBS)					LENGTH	FR-TO	(LBS)
F-B	-261 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 41	-91.8	-91.8	0.15 (5)	10.00				
B-C	-29 / 0	-91.8	-91.8	0.14 (5)	6.25				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
G-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	1	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

(1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.15/1.00 (A-B-5), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS1=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

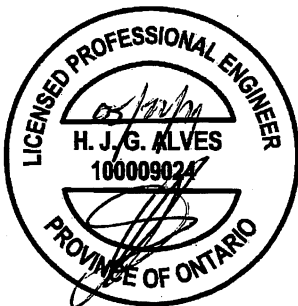

Structural component only
DWG# T-2115135

JOB NAME 410887	TRUSS NAME C2	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 10:47:41 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wlmz?k45-SZpgWh2QDuJChDWYXOTdhC8844tkMXcqaTuhrzEJtm

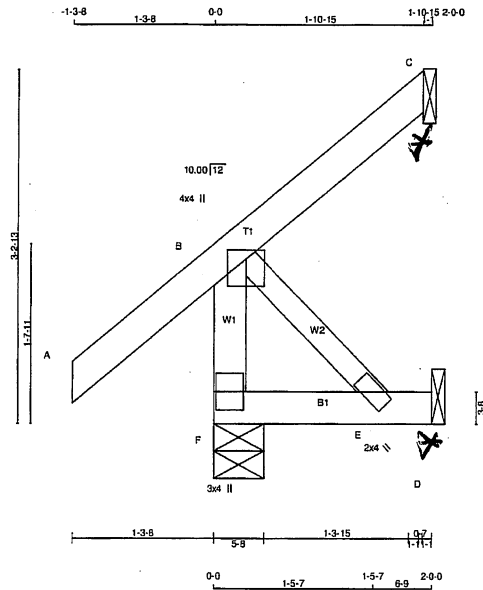

Scale = 1:19.2

TOTAL WEIGHT = 10 lb [M]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	279	0	279	0	5-8
C	42	0	42	-36	1-8
D	18	0	21	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	194	145 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
C	29	23 / -26	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (LC1) (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
F-B	-261 / 0	0.0	0.0 0.03 (1)	B-E	0 / 0
A-B	0 / 41	-91.8	-91.8 0.13 (1)		
B-C	-29 / 0	-91.8	-91.8 0.12 (1)		
F-E	0 / 0	-18.5	-18.5 0.02 (4)		
E-D	0 / 0	-18.5	-18.5 0.02 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

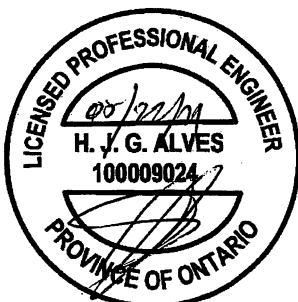


Structural component only
DWG# T-2115136

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	C31	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MTek Industries, Inc. Fri May 21 12:07:59 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wmsz?k45-OTx4i7LaaDKaierXnFvTyDhVEFDEDZM_T2?mazEIIU

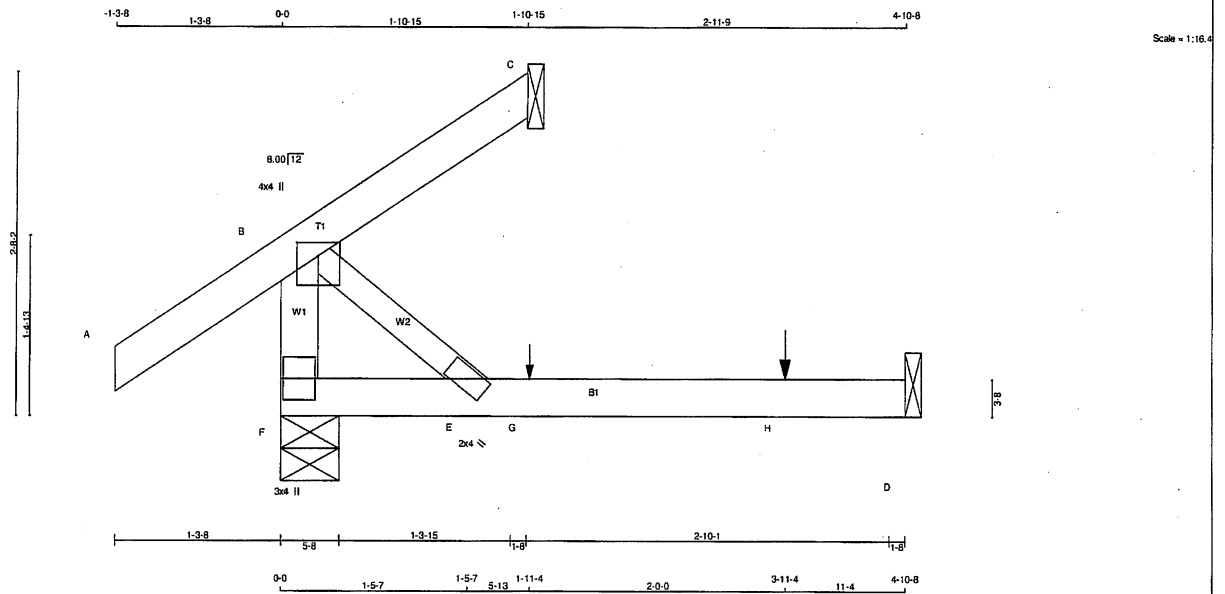

TOTAL WEIGHT = 2 X 13 = 25 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED
F - B	2x4	DRY	No.2	SPF	VERT	GROSS REACTION	GROSS REACTION
A - C	2x4	DRY	No.2	SPF	HORZ	DOWN	HORZ
F - D	2x4	DRY	No.2	SPF	UPLIFT	IN-SX	IN-SX
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00	
E	BMVW+w	MT20	2.0	4.0			
F	BMV1+p	MT20	3.0	4.0			

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT
F	304	0	0
C	42	0	0
D	46	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	214	144 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
C	29	24 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
(LBS)	(PLF)	LC1	(LBS)	CSI (LC)
FR-TO	FROM	TO	LENGTH	FR-TO
F-B	-259 / 0	0.0	0.03 (1)	7.81
A-B	0 / 35	-91.8	-91.8 (1)	10.00
B-C	-25 / 0	-91.8	-91.8 (1)	6.25
F-E	0 / 0	-18.5	-18.5 (4)	10.00
E-G	0 / 0	-18.5	-18.5 (4)	10.00
G-H	0 / 0	-18.5	-18.5 (4)	10.00
H-D	0 / 0	-18.5	-18.5 (4)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	---	BACK	VERT	TOTAL	---	C1
H	3-11-4	-0	-0	---	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (A-B:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115172

JOB NAME 410889	TRUSS NAME C32	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 12:08:00 2021 Page 1
ID:GzzEEXDtkQt_BH_M?wimsz?k45-sgUSwTMCLXSRKoQjLzQIVQDeBeb9y0c8iikOK1zEiIT

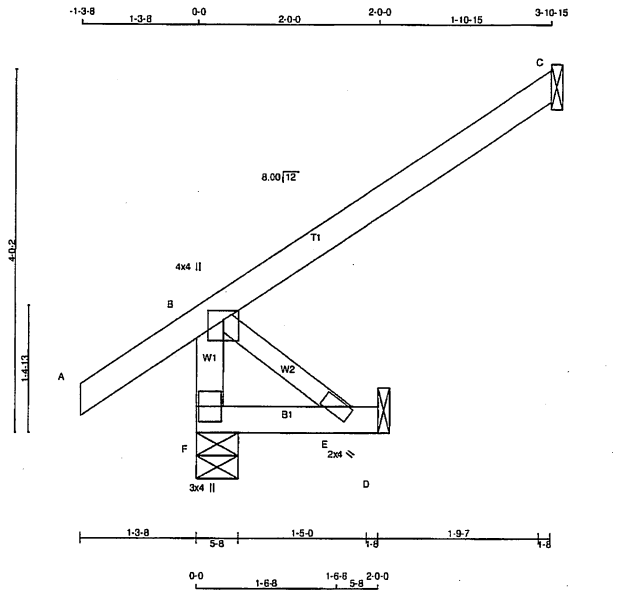

TOTAL WEIGHT = 12 lb

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS SIZE	LUMBER
F - B 2x4 DRY No.2	SPF
A - C 2x4 DRY No.2	SPF
F - D 2x4 DRY No.2	SPF
ALL WEBS 2x3 DRY No.2	SPF
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW+p MT20	4.0	4.0	1.25	2.00
E BMW+w MT20	2.0	4.0		
F BMV1+p MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	324	0	324	0
C	179	0	179	0
D	19	0	21	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT COMBINED						
F	225	170 / 0	0 / 0	0 / 0	55 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. FORCE (LBS)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. MEMB. FORCE (LBS)
FR-TO		FROM TO	CSI (LC)	UNBRAC LENGTH	FR-TO		
F-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0
A-B	0 / 35	-91.8	-91.8	0.13 (5)	10.00		
B-C	0 / 0	-91.8	-91.8	0.24 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2115173

JOB NAME 410889	TRUSS NAME C33	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:01 2021 Page 1
ID:GzzEEEXDtkQt_BH_M?wimsz?k45-Ks2q7pNq6qalxy?vgxx1emij2xOhTsHxMUysTzEiIS

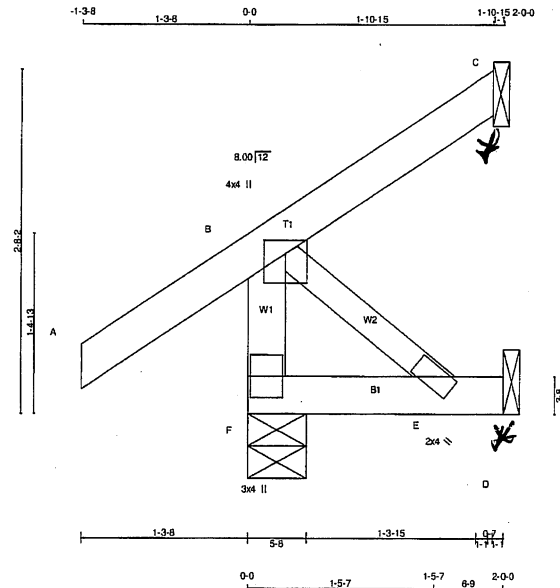

Scale = 1/8"

TOTAL WEIGHT = 3 X 9 = 28 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	277	0	277	0	5-8
C	42	0	42	-35	1-8
D	18	0	21	0	1-8

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	193	144 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-259 / 0	0.0	0.0 0.03 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)				
B-C	-25 / 0	-91.8	-91.8 0.12 (1)				
F-E	0 / 0	-18.5	-18.5 0.02 (4)				
E-D	0 / 0	-18.5	-18.5 0.02 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

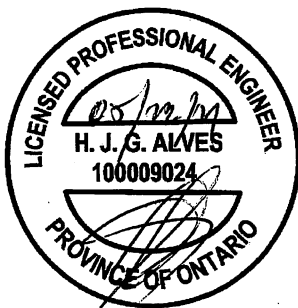


Structural component only
DWG# T-2115174

JOB NAME 410889	TRUSS NAME C34	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 Mitek Industries, Inc. Fri May 21 12:08:02 2021 Page 1
ID:GzzEEXDtfkQt_BH_M?wlmisz?k45-o2cDL9OT18I9Z6a6SOTAarJ?ZSHmQw5R90DVOzEIIR

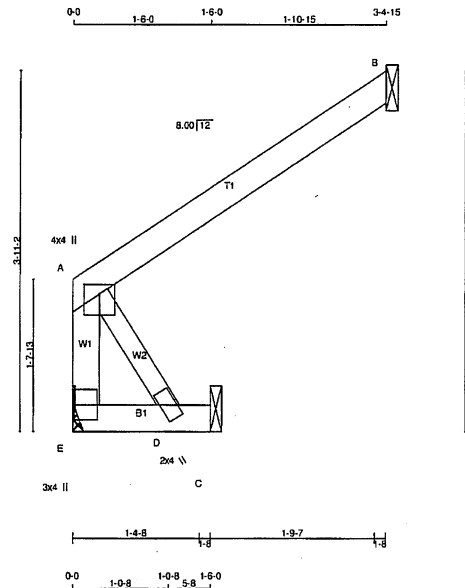

Scale = 1:22.9

TOTAL WEIGHT = 9 lb

LUMBER **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **DESIGN CRITERIA**

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV+w	MT20	2.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	170	170	0	0
B	157	157	0	0
C	14	16	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	119	87/0	0/0	0/0	0/0	0/0	32/0	0/0
B	108	87/0	0/0	0/0	0/0	0/0	20/0	0/0
C	11	0/0	0/0	0/0	0/0	0/0	11/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LC1)	MAX. FACTORED UNBRACED LENGTH (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC)
FR-TO	E-A	-157/0	0.0	0.0	0.02 (1)	7.81	A-D	0/0	0.00 (1)
	A-B	0/0	-91.8	-91.8	0.18 (1)	10.00			
	E-D	0/0	-18.5	-18.5	0.01 (4)	10.00			
	D-C	0/0	-18.5	-18.5	0.01 (4)	10.00			

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.18/1.00 (A-B:1), BC=0.01/1.00 (D-E:4), WB=0.00/1.00 (A-D:1), SS=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (A) (INPUT = 0.90)
JSI METAL = 0.03 (A) (INPUT = 1.00)

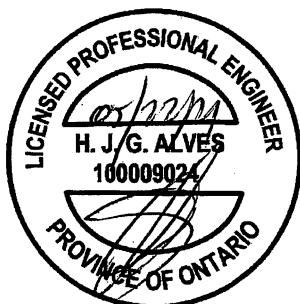


Structural component only
DWG# T-2115175

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
410889	C35	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Fri May 21 12:08:03 2021 Page 1
ID:GzzEEEXDtkQt_BH_M?wmsz?k45-GFABYVO5eSq0BG9I05_P73rAyscw9NLaOgz3wMzEIIQ

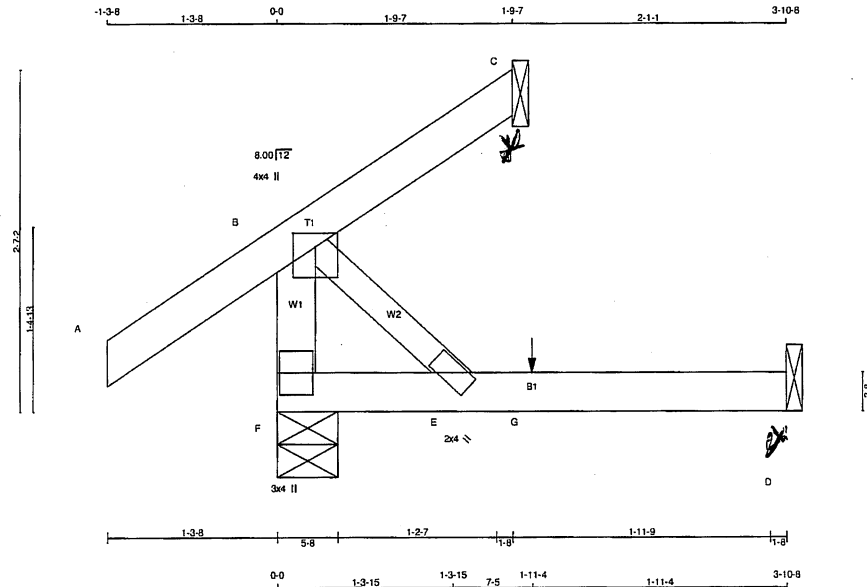

TOTAL WEIGHT = 11 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	292	0	292	0	5-8	5-8
C	34	0	34	0	1-8	1-8
D	36	0	40	0	1-8	1-8

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	1ST LOASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM.	LIVE			
F	205	143 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0	0 / 0
C	23	19 / -27	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
F-B	-256 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00				
B-C	-27 / 0	-91.8	-91.8	0.13 (5)	6.25				
F-E	0 / 0	-18.5	-18.5	0.07 (4)	10.00				
E-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
G-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.14/1.00 (A-B:5), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

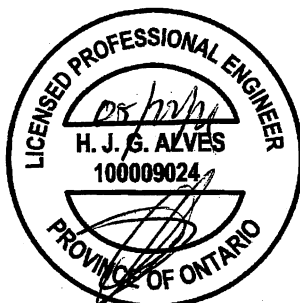

Structural component only
DWG# T-2115176



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components

2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.

3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.

4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.

5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.

2- Lumber is to be the sizes and grade specified on the truss drawing.

3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.

4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings

5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.

6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)

7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.

8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering *em and General Safety notes.

7-1900213

Feb 09, 2018

TOE-NAIL CAPACITY DETAILS

LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
2x4 SPF	2	2	3	3	3
2x6 SPF	4	4	4	5	5
2x4 D. FIR	2	2	2	2	2
2x6 D. FIR	3	3	3	4	4

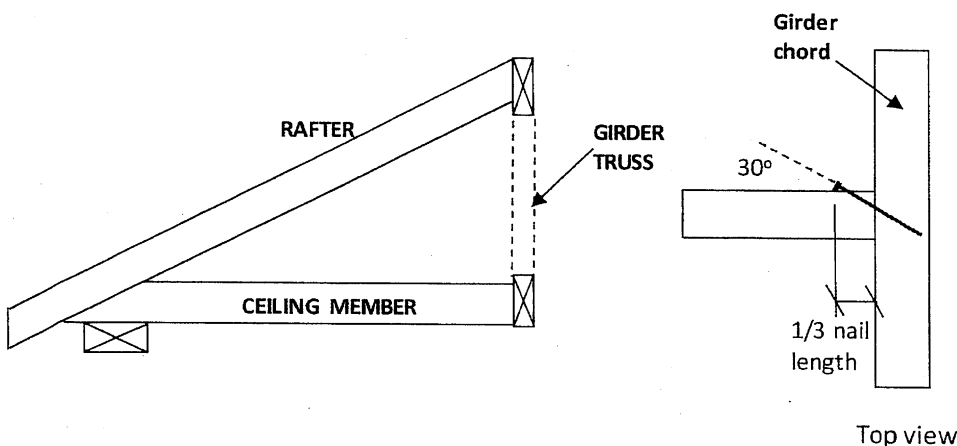



Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss



December 21, 2020

TOE-NAIL CAPACITY DETAILS

Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

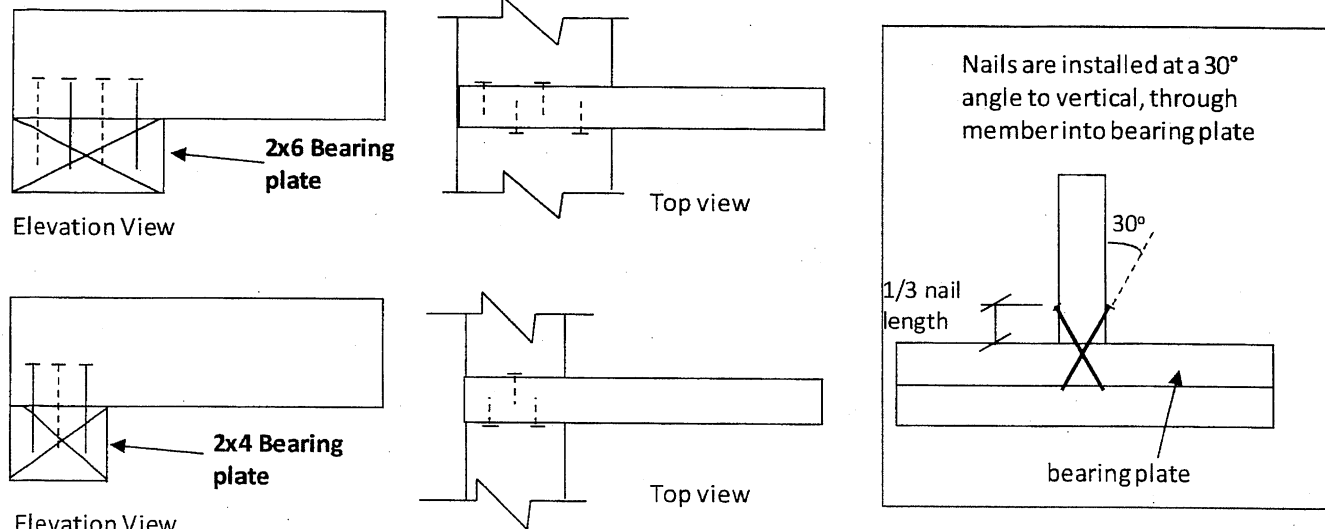

NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of $G = 0.42$ (SPF) and $G = 0.49$ (D. Fir).
5. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 (K_D factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO
Certificate No. 10889485



LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 217–218.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on pp. 105–107.



Double-Shear
Nailing
Top View






Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing
Side View
(available on
some models)


Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

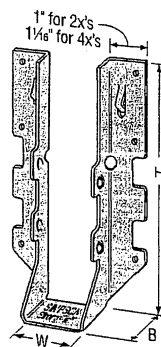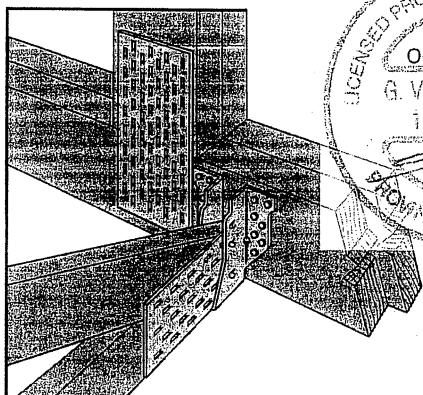


✓ LUS28

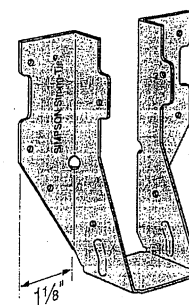


LU26L

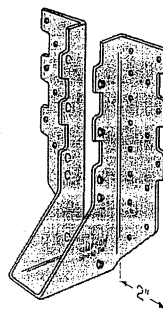


✓ HUS210
(HUS26, HUS28,
and HHUS similar)

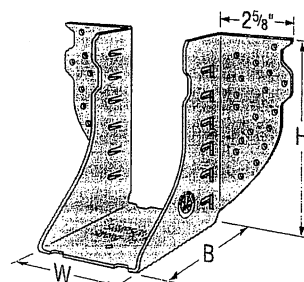

✓ HGUS28-2

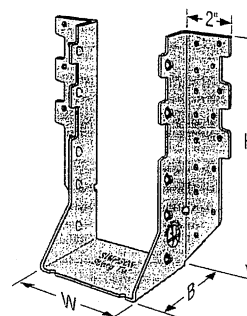

✓ HHUS210-2



LJS26DS

TECHNICAL BULLETIN

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire,
10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

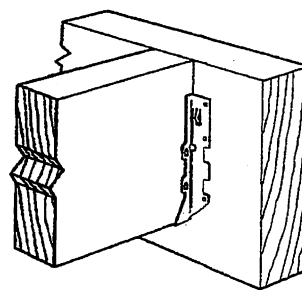


Typical LUS
Installation

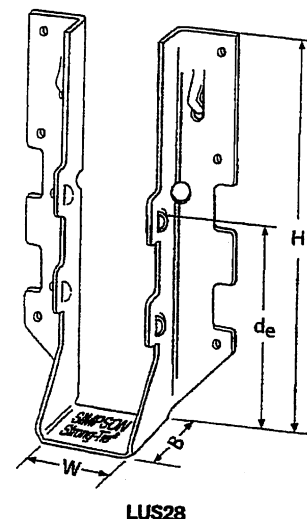

LUS28


Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist		D.Fir-L		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _u =1.15)	(K _u =1.00)	(K _u =1.15)	(K _u =1.00)
LUS24	18	1 1/16	3 3/8	1 3/4	1 15/16	(4) 10d	(2) 10d		710	1630	645	1155
LUS24-2	18	3 1/8	3 3/8	2	1 13/16	(4) 16d	(2) 16d		835	2020	590	1435
LUS26	18	1 1/16	4 3/8	1 3/4	3 3/8	(4) 10d	(4) 10d		1420	2170	1290	1630
LUS26-2	18	3 1/8	4 7/8	2	4	(4) 16d	(4) 16d		1720	2595	1545	1920
LUS26-3	18	4 3/8	4 1/16	2	3 1/4	(4) 16d	(4) 16d		1720	2595	1545	2340
LUS28	18	1 1/16	6 3/8	1 3/4	3 3/4	(6) 10d	(6) 10d		1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d		1720	3325	1545	2575
LUS28-3	18	4 3/8	6 1/4	2	3 3/4	(6) 16d	(4) 16d		1720	3325	1545	2375
LUS210	18	1 1/16	7 13/16	1 3/4	3 3/8	(8) 10d	(4) 10d		1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d		2580	4500	2320	3195
LUS210-3	18	4 3/8	8 3/8	2	5 1/4	(8) 16d	(6) 16d		2580	3345	2320	2375

1. d_e is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).

U.S. Patent
5,603,580



Double
Shear
Nailing
Top View.

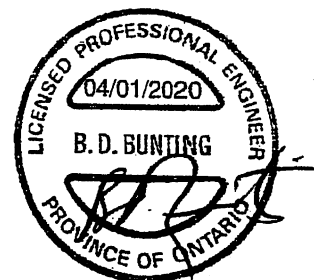

**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECLUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HUS/LJS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation

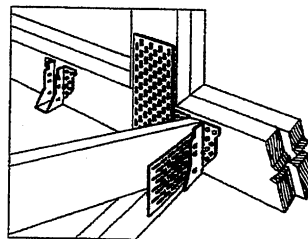

Typical HUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K ₁ =1.15) lb.	Normal (K ₂ =1.00) lb.	Uplift (K ₁ =1.15) lb.	Normal (K ₂ =1.00) lb.
LJS26DS	18	1 1/16	5	3 1/2	4 5/8	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1 1/8	5 1/4	3	3 15/16	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1 1/8	7 3/32	3	6 7/32	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1 1/8	9 7/32	3	7 31/32	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1 11/16	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200

1. d₁ is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
5,803,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HGUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:



- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:

- See current catalogue for options

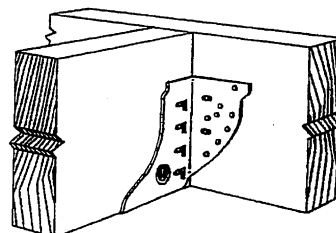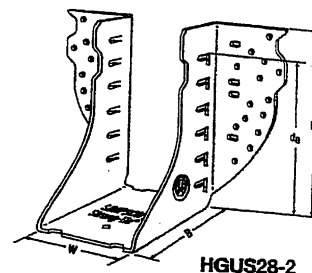


Typical HGUS Installation

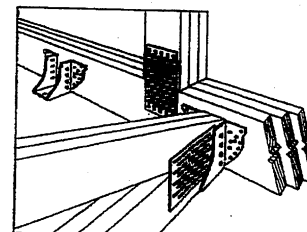


Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁ ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)	Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)
HGUS26	12	1½	5½	5	4½	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6½	5½	4	4½	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1½	7½	5	6½	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6½	7½	4	6½	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1½	9½	5	7½	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3½	9½	4	8½	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4½	9½	4	8½	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6½	9½	4	8½	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6½	10½	4	10½	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6½	12½	4	11½	(66) 16d	(22) 16d	10130	16400	7195	11645


1. d₁ is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HHUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HHUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 14 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:

- See current catalogue for options

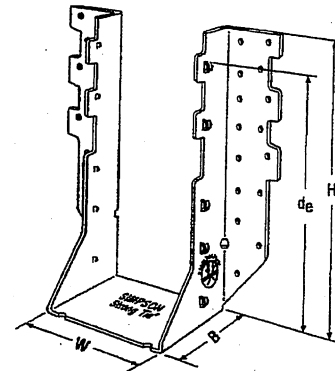


HHUS410

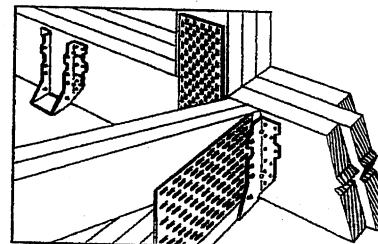


Typical HHUS Installation
(Truss Designer to provide
fastener quantity for connecting
multiple members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _u =1.00)	Uplift (K _u =1.15)	Normal (K _u =1.00)
HHUS26-2	14	3 1/16	5 13/16	3	3 15/16	(14) 16d	(6) 16d	2850	7335	2065	5205
HHUS28-2	14	3 5/16	7 7/32	3	6 5/32	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS210-2	14	3 5/16	9 3/32	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
HHUS210-3	14	4 11/16	9	3	7 15/16	(30) 16d	(10) 16d	4670	9670	4235	6865
HHUS210-4	14	6 1/4	8 29/32	3	7 27/32	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS46	14	3 5/8	5 13/32	3	3 15/16	(14) 16d	(6) 16d	2540	7335	2065	5205
HHUS48	14	3 5/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS410	14	3 5/8	9	3	8	(30) 16d	(10) 16d	4670	9855	4235	7000
HHUS5.50/10	14	5 1/2	9	3	8	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS7.25/10	14	7 1/4	9	3 3/16	7 29/32	(30) 16d	(10) 16d	4670	10155	3370	7210


1. d_e is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580



Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.



Typical HHUS
Installation



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020.
This information is updated periodically and should not be relied upon after June 30, 2022.
Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.


© 2020 Simpson Strong-Tie Company Inc.

T-SPECHHUS20 3/20 exp. 6/22


(800) 999-5099
strongtie.com

H/TSP


Seismic and Hurricane Ties (cont.)




1 H1 Installation




2 H2A Installation




3 TSP Installation




4 H2.5A Installation
(Nails into both top plates)




5 H2.5T Installation
(Nails into both top plates)




6 H2.5T Installation




7 H3 Installation
(Nails into upper top plate)




8 H6 Stud to Top Plate Installation

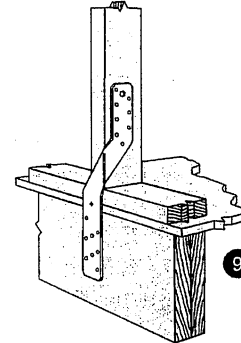


9 H6 Stud to Band Joist Installation

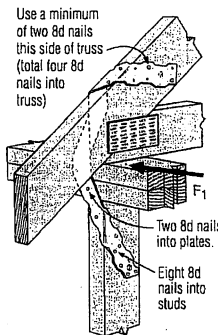


10 H7Z Installation




11 H8 Attaching Rafter to Double Top Plates




12 H8 attaching Stud to Sill
((4) 8d into plate, (5) 8d into stud)




13 H8 attaching I-Joist to Double Top Plates




14 H10A Field-Bent Installation



15 H10S Installation




16 H10S Installation with Stud Offset




17 H10A Installation

H10A optional positive angle nailing connects shear blocking to rafter. Use 8d common nails. Slot allows maximum field-bending up to a pitch of 6/12, use 75% of the table uplift value; bend one time only.

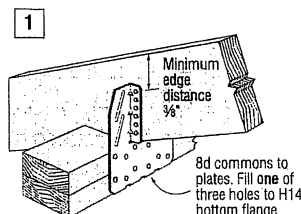


18 H14 Installation to Double Top Plates



19 H14 Installation to Double 2x Header

Avoid a Misinstallation



Do not make new holes or overdrive nails.

H/TSP

Seismic and Hurricane Ties

Simpson Strong-Tie® hurricane ties provide a positive connection between truss/rafter and the wall of the structure to resist wind and seismic forces. New additions to the line provide even more options.


- H10AR — The heavy-duty design of the H10A available with a 2" wide throat to accommodate rough lumber
- H10A-2 — The H10A design with a 3" throat for double 2x members
- H2ASS, H2.5ASS and H10ASS — Popular ties now available in stainless steel

Material: See table




Finish: Galvanized. H7Z and H11Z — ZMAX® coating. Some models available in stainless steel or ZMAX; see Corrosion Information, pp. 20–24 or visit strongtie.com.

Installation:


- Use all specified fasteners; see General Notes.
- H1 can be installed with flanges facing inward (reverse of H1 installation drawing; number 1).
- H2.5T, H3 and H6 ties are shipped in equal quantities of right and left versions (right versions shown).
- Hurricane ties do not replace solid blocking.
- When installing ties on plated trusses (on the side opposite the truss plate) do not fasten through the truss plate from behind. This can force the truss plate off of the truss and compromise truss performance.
- H10A optional nailing to connect shear blocking, use 8d nails. Slots allow maximum field bending up to a pitch of 6:12; use H10A sloped loads for field bent installation.

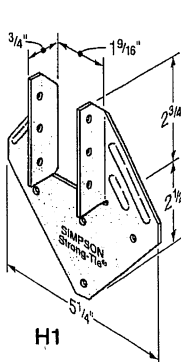


H1

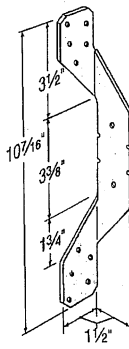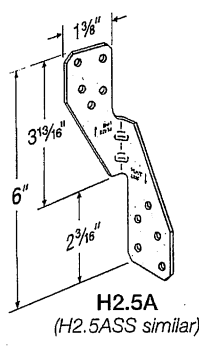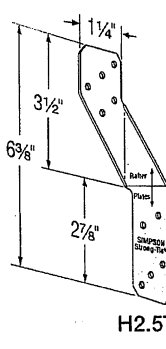H2A
(H2ASS similar)H2.5A
(H2.5ASS similar)


H2.5T

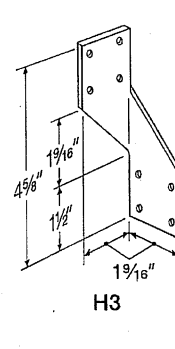


H3

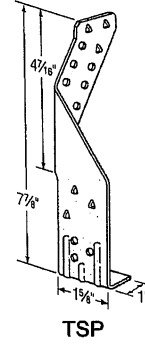


TSP




H6





H7Z

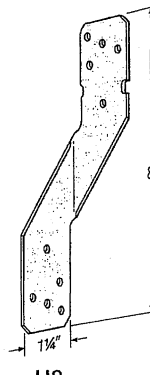


H8

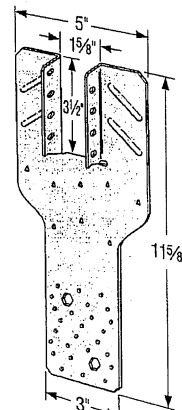


H10S

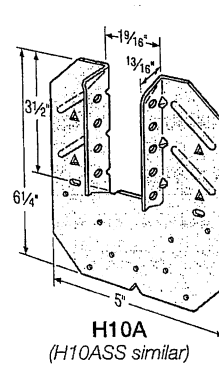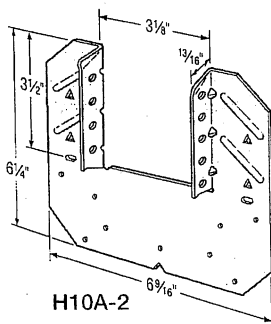H10A
(H10ASS similar)


H10A-2

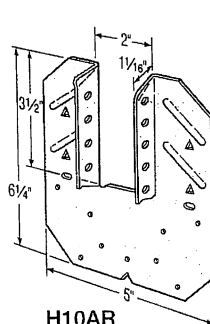


H10AR

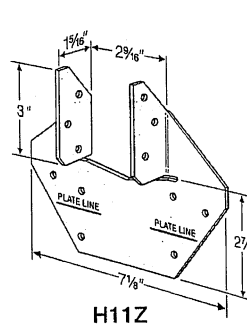

H11Z

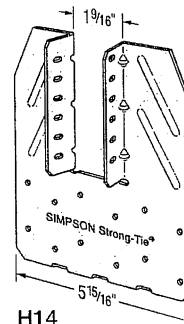

H14

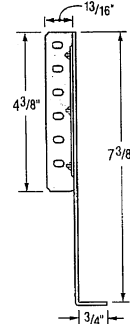H14
Profile

TECHNICAL BULLETIN

H – Seismic and Hurricane Ties

SIMPSON
Strong-Tie

The H connector series provides wind and seismic ties for trusses and rafters.

Material: 18 gauge **Finish:** G90 galvanized

Design: • Factored resistances are in accordance with CSA O86-14


- Factored resistances have been increased 15%. No further increase is permitted.

Installation: • Use all specified fasteners

- Nails: 8d = 0.131" dia. x 2½" long common wire, 8d x 1½" = 0.131" x 1½" long, 10d x 1½" = 0.146" x 1½" long
- H1 can be installed with flanges facing outwards
- Hurricane ties do not replace solid blocking


Factored resistances for more than one direction for a single connection cannot be added together. A factored load which can be divided into components in the directions given must be evaluated as follows: Factored Shear/Resisting Shear + Factored Tension/Resisting Tension ≤ 1.0.

Hurricane Tie Installations to Achieve Twice the Load (Top View)

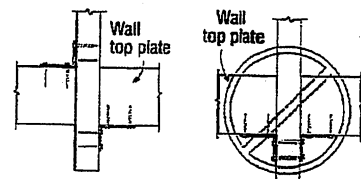


Install diagonally across from each other for minimum 2x truss.


Nailing into both sides of a single ply 2x truss may cause the wood to split.




H1




H1 Installation




H2A




H2A Installation




H2.5A




H2.5A Installation




H2.5T




H2.5T Installation
(Nails into both top plates)




H3



H3 Installation



H10A



H10A Installation

Model No.	Ga.	Fasteners			Factored Resistance (lb.)					
					D.Fir-L			S-P-F		
		To Rafter	To Plates	To Studs	Uplift	Normal		Uplift	Normal	
						F ₁	F ₂		F ₁	F ₂
						(K _u =1.15)			(K _u =1.15)	
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
H2.5T	18	(5) 8d	(5) 8d	—	835	175	240	740	160	210
H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
H10A	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
2. Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on each side of the joist and on the same side of the plate.

3. When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
4. Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a Continuous Load Path, connections must be on same side of the wall.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECH20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

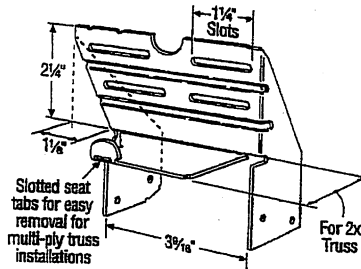


TC24
U.S. Patent 4,932,173

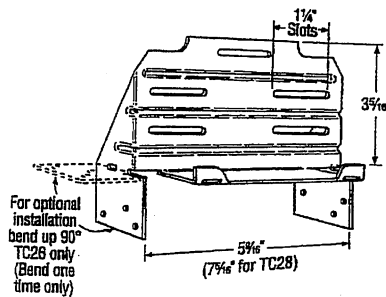


TC26
(TC28 Similar)

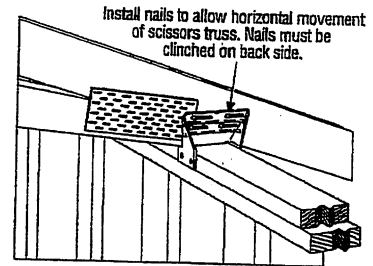

Typical TC24 Installation

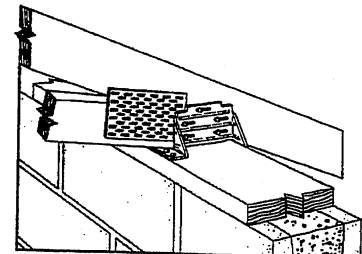

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

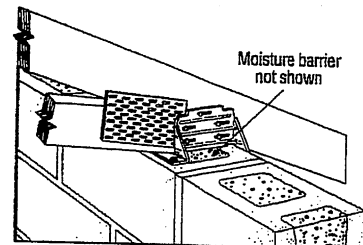

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC26	(5) 10d	(6) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - ¾" x 2¼" Titen screws has a factored uplift resistance of 275 lb.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECTC20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HTU


Face-Mount Truss Hanger (cont.)

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Alternate Installation for (2) 2x4 and (2) 2x6 Headers

Model No.	Min. Heel Height (in.)	Minimum Header Size	Fasteners		Factored Resistance			
			Header	Joist	D.Fir-L		S-P-F	
					Uplift	Normal	Uplift	Normal
					(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
HTU26 (Min.)	3%	(2) 2x4	(10) 16d	(14) 10d x 1 1/2"	1740	3340	1235	2370
					7.74	14.86	5.49	10.54
HTU26 (Max.)	5 1/2	(2) 2x4	(10) 16d	(20) 10d x 1 1/2"	2470	4015	1755	2850
					10.99	17.86	7.81	12.68
HTU28 (Max.)	3%	(2) 2x6	(20) 16d	(26) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19
HTU210 (Max.)	7 1/4	(2) 2x6	(20) 16d	(32) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19

See table footnotes on p. 260.




Hanger Options


See Hanger Options Information on pp. 125-127.

Skewed Seat

- Skewable up to 67 1/2°
- Available in single and 2-ply size
- No bevel cut required



Top View HTU Hanger
Skewed Right < 51°



Top View HTU Hanger
Skewed Right ≥ 51°

Factored Resistances for Skewed HTU Hangers

Model No.	Skew Angle (Degrees)	Fasteners		Factored Resistance			
		Header	Joist	D.Fir-L		S-P-F	
				Uplift	Normal	Uplift	Normal
				(K _D =1.15)	(K _D =1.00)	(K _D =1.15)	(K _D =1.00)
				lbs	lbs	lbs	lbs
				kN	kN	kN	kN
HTU26	< 51	(20) 16d	(14) 10d x 1 1/2"	1935	4110	1300	2905
	51-67 1/2	(20) 16d	(12) 10d x 1 1/2"	8.16	18.28	5.78	12.92
HTU28	< 51	(26) 16d	(20) 10d x 1 1/2"	1350	3620	955	2560
	51-67 1/2	(26) 16d	(17) 10d x 1 1/2"	6.01	18.10	4.25	11.39
HTU210	< 51	(32) 16d	(26) 10d x 1 1/2"	2810	4270	1985	3030
	51-67 1/2	(32) 16d	(22) 10d x 1 1/2"	12.50	18.99	8.83	13.48
HTU26-2	< 51	(20) 16d	(14) 10d	2075	3930	1465	2780
	51-67 1/2	(20) 16d	(12) 10d	9.23	17.48	6.52	12.37
HTU28-2	< 51	(26) 16d	(20) 10d	3785	4430	2675	3135
	51-67 1/2	(26) 16d	(17) 10d	16.84	19.71	11.90	13.95
HTU210-2	< 51	(32) 16d	(26) 10d	2795	4240	1980	3000
	51-67 1/2	(32) 16d	(22) 10d	12.43	18.86	8.81	13.35
HTU26-2	< 51	(20) 16d	(14) 10d	2140	3715	1515	2625
	51-67 1/2	(20) 16d	(12) 10d	9.52	16.53	6.74	11.68
HTU28-2	< 51	(26) 16d	(20) 10d	1610	3920	1140	2785
	51-67 1/2	(26) 16d	(17) 10d	7.16	17.44	5.07	12.39
HTU210-2	< 51	(32) 16d	(26) 10d	3960	5425	2815	3855
	51-67 1/2	(32) 16d	(22) 10d	17.62	24.13	12.52	17.15
HTU26-2	< 51	(20) 16d	(14) 10d	2385	5425	1695	3855
	51-67 1/2	(20) 16d	(12) 10d	10.61	24.13	7.54	17.15
HTU28-2	< 51	(26) 16d	(20) 10d	5025	6890	3570	4890
	51-67 1/2	(26) 16d	(17) 10d	22.35	30.65	15.88	21.75
HTU210-2	< 51	(32) 16d	(26) 10d	3145	6680	2225	4745
	51-67 1/2	(32) 16d	(22) 10d	13.99	29.72	9.90	21.10


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Reduced heel heights are not permitted for skewed HTU's.
3. Nails: 16d = 0.162" dia. x 3 1/2" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 10d = 0.148" dia. x 3" long. See pp. 27-28 for other nail sizes and information.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

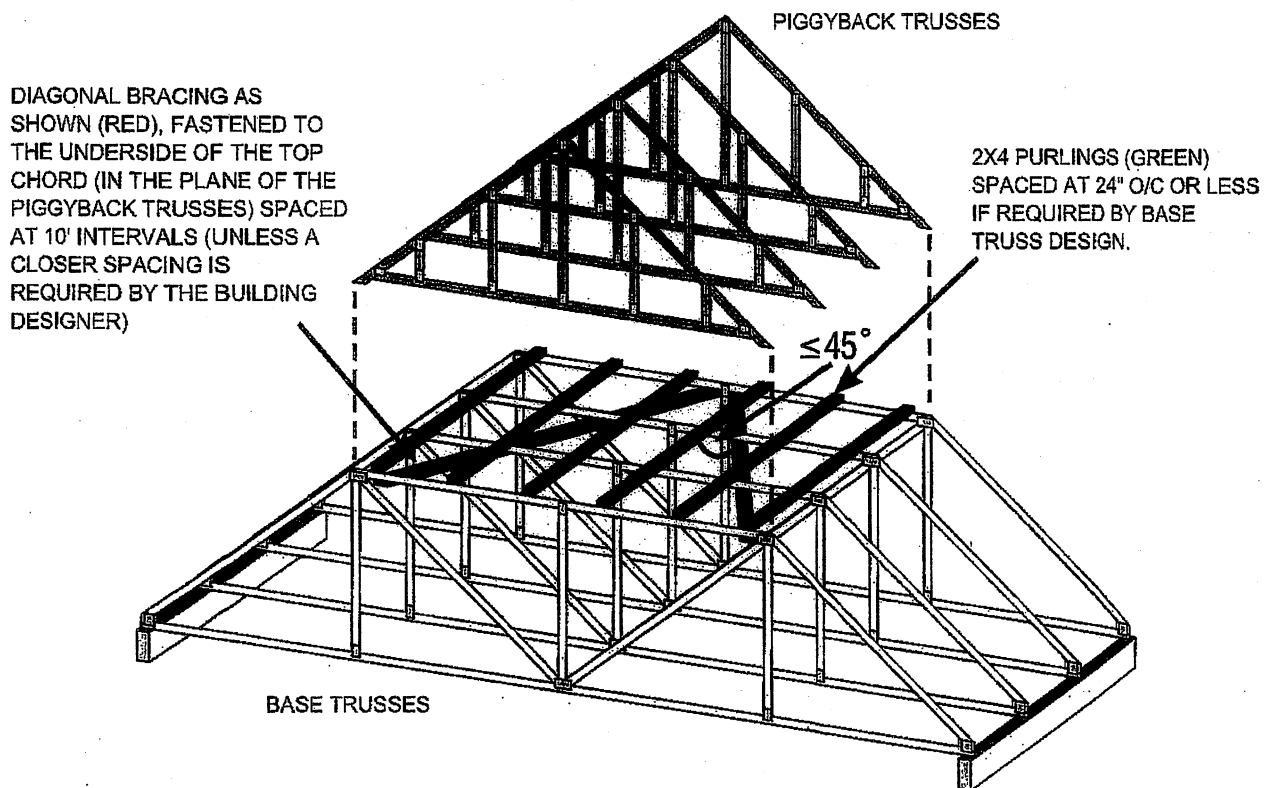

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties

Straps are designed to transfer tension loads in a wide variety of applications.

HRS — Heavy strap designed for installation on the edge of 2x members. The HRS416Z installs with Strong-Drive® SDS Heavy-Duty Connector screws.

LSTA and MSTA — Designed for use on the edge of 2x members, with a nailing pattern that reduces the potential for splitting.

LSTI and MSTI — Light and medium straps that are suitable where pneumatic-nailing is necessary through diaphragm decking and wood chord open-web trusses.


MST — High-capacity strap that can be installed with either nails or bolts. Suitable for double 2x member connections or greater.

MSTC — High-capacity strap that utilizes a staggered nail pattern to help minimize wood splitting. Nail slots have been countersunk to provide a lower nail head profile.


Finish: Galvanized. Some products are available in stainless steel, ZMAX® coating or black powder coat (add PC to sku); contact Simpson Strong-Tie. See Corrosion Information, pp. 18–20.

Installation: Use all specified fasteners; see General Notes


Options: Special sizes can be made to order; contact Simpson Strong-Tie for longer lengths

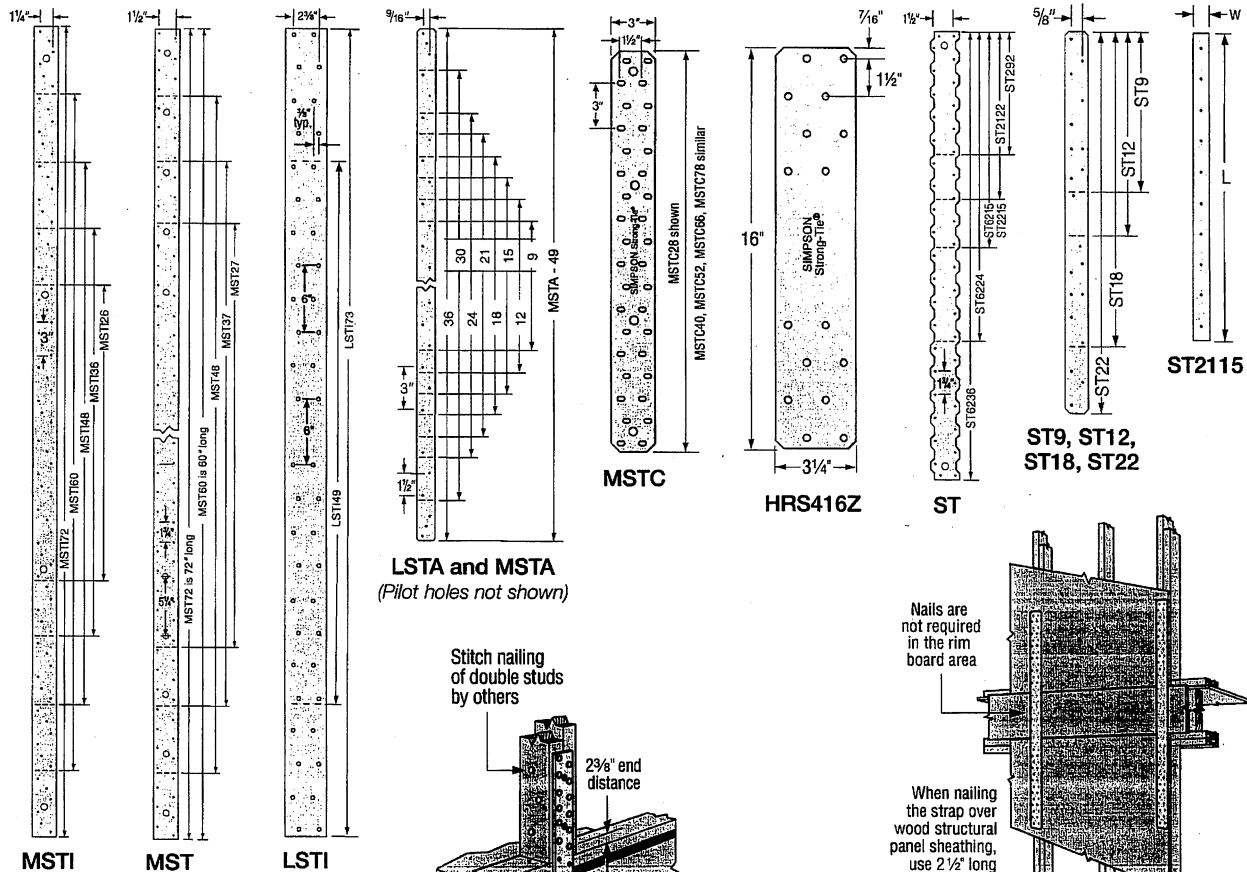

Stitch nailing
of double studs
by others

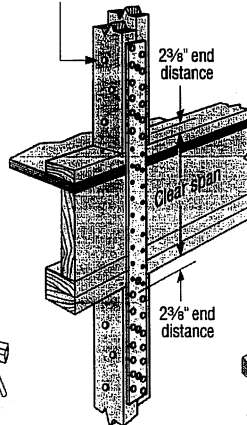


Floor-to-Floor Tie
Installation
Showing a
Clear Span




Typical MSTI Installation
(MIT hanger shown)
LSTI similar

Nails are
not required
in the rim
board area

When nailing
the strap over
wood structural
panel sheathing,
use 2 1/2\"/>

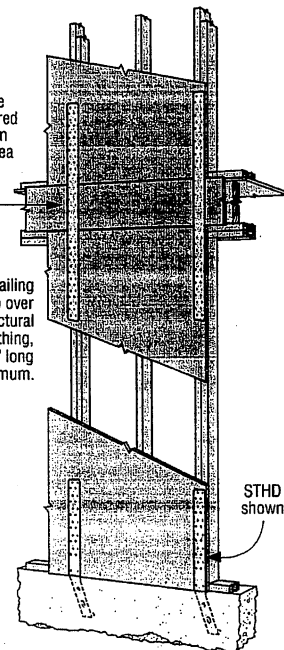

Typical Detail with
Strap Installed over
Wood Structural Panel
Sheathing

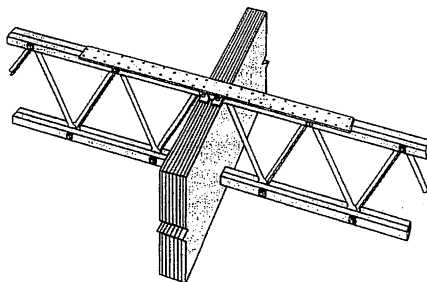

Typical LSTI Installation


HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI**SIMPSON**
Strong-Tie

Strap Ties (cont.)


These products are available with additional corrosion protection. For more information, see p. 20.

SD Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366–370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
		W	L		D.Fir-L		S-P-F	
					(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
LSTA9	20	1¼	9	(6) 10d	600	690	555	635
					2.67	3.07	2.47	2.82
		1¼	12	(8) 10d	800	920	735	845
					3.56	4.09	3.27	3.76
		1¼	15	(10) 10d	1000	1150	920	1060
					4.45	5.12	4.09	4.72
		1¼	18	(12) 10d	1200	1380	1105	1270
					5.34	6.14	4.92	5.65
		1¼	21	(14) 10d	1400	1610	1290	1485
					6.23	7.16	5.74	6.61
1¼	24	(16) 10d	1600	1840	1475	1695		
			7.12	8.19	6.56	7.54		
ST292	2⅝	9⅝	(8) 8d	585	675	535	615	
				2.60	3.00	2.38	2.74	
ST2122	2⅝	12⅜	(12) 8d	940	1085	865	995	
				4.18	4.83	3.85	4.43	
ST2115	¾	16⅝	(8) 8d	670	770	615	710	
				2.98	3.43	2.74	3.16	
ST2215	2⅝	16⅝	(16) 8d	1335	1540	1235	1420	
				5.94	6.85	5.49	6.32	
LSTA30	18	1¼	30	(20) 10d	2235	2465	2075	2385
					9.94	10.97	9.23	10.61
		1¼	36	(24) 10d	2465	2465	2465	2465
					10.97	10.97	10.97	10.97
		3¾	49	(32) 10d x 1½"	3115	3580	2852	3280
					13.86	15.93	12.69	14.59
		3¾	73	(48) 10d x 1½"	4670	5370	4280	4920
					20.77	23.89	19.04	21.89
		1¼	9	(6) 10d	670	770	625	715
					2.98	3.43	2.78	3.18
1¼	12	(8) 10d	895	1030	830	955		
			3.98	4.58	3.69	4.25		
1¼	15	(10) 10d	1120	1285	1040	1195		
			4.98	5.72	4.63	5.32		
1¼	18	(12) 10d	1340	1545	1245	1430		
			5.96	6.87	5.54	6.36		
1¼	21	(14) 10d	1565	1800	1455	1670		
			6.96	8.01	6.47	7.43		
1¼	24	(16) 10d	1790	2060	1660	1910		
			7.96	9.16	7.38	8.50		
MSTA9	16	1¼	30	(20) 10d	2470	2840	2260	2595
					10.99	12.63	10.05	11.54
		1¼	36	(24) 10d	2965	3070	2710	3070
					13.19	13.66	12.06	13.66
		1¼	49	(28) 8d	2725	2725	2545	2725
					12.12	12.12	11.32	12.12
		2⅝	16⅝	(16) 8d	1405	1615	1300	1500
					6.25	7.18	5.78	6.67
		2⅝	23⅝	(24) 8d	2305	2650	2155	2475
					10.25	11.79	9.59	11.01
1¼	9	(6) 8d	525	605	490	560		
			2.34	2.69	2.18	2.49		
1¼	11⅝	(8) 8d	700	805	650	750		
			3.11	3.58	2.89	3.34		
1¼	17¾	(12) 8d	1050	1210	975	1125		
			4.67	5.38	4.34	5.00		
1¼	21⅝	(18) 8d	1580	1790	1465	1685		
			7.03	7.96	6.52	7.50		

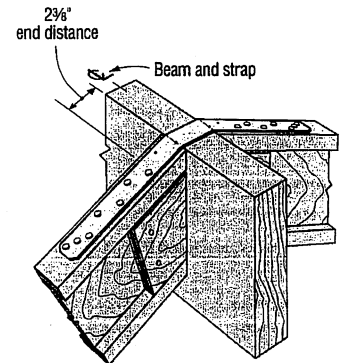

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

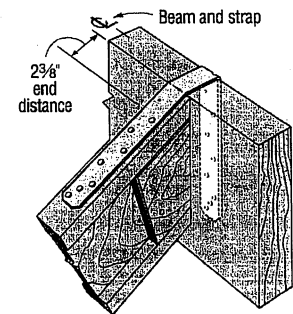

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

- Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
- Use half of the nails in each member being connected to achieve the listed resistances.
- Nails:** 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long. See pp. 22–23 for other nail sizes and information.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI
Strap Ties (cont.)


These products are available with additional corrosion protection. For more information, see p. 20.




Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366–370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
					D.Fir-L		S-P-F	
		W	L		(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	
MSTC28	16	3	28¼	(32) 10d	3955	4545	3615	4155
					17.59	20.22	16.08	18.48
MSTC40		3	40¼	(48) 10d	5930	6820	5420	6235
					26.38	30.34	24.11	27.74
MSTC52		3	52¼	(54) 10d	6670	6940	6100	6940
					29.67	30.87	27.14	30.87
MSTC66	14	3	65¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
MSTC78		3	77¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
ST6236		2⅞	33⅜	(36) 8d	3735	4295	3270	3760
					16.61	19.11	14.55	16.73
MSTI26	12	2⅞	26	(22) 10d x 1 ½"	2825	3250	2475	2850
					12.57	14.46	11.01	12.68
MSTI36		2⅞	36	(32) 10d x 1 ½"	4110	4725	3600	4140
					18.28	21.02	16.01	18.42
MSTI48		2⅞	48	(44) 10d x 1 ½"	5650	6500	4955	5695
					25.13	28.91	22.04	25.33
MSTI60		2⅞	60	(56) 10d x 1 ½"	7195	7360	6305	7250
					32.01	32.74	28.05	32.25
MSTI72		2⅞	72	(68) 10d x 1 ½"	7360	7360	7240	7360
					32.74	32.74	32.21	32.74
MST27		2⅞	27	(26) 8d	2685	3090	2355	2710
					11.94	13.75	10.48	12.06
MST37		2⅞	37 ½	(38) 8d	3930	4515	3440	3960
					17.48	20.08	15.30	17.62
MST48		2⅞	48	(50) 8d	5170	5945	4530	5210
					23.00	26.45	20.15	23.18
HRS416Z		¾	16	(16) ¼" x 1 ½" SDS	2400	2760	2120	2440
					10.68	12.28	9.43	10.85
MST60	10	2⅞	60	(64) 8d	6620	7610	5800	6670
					29.45	33.85	25.80	29.67
MST72		2⅞	72	(78) 8d	8065	9135	7065	8125
					35.88	40.64	31.43	36.14

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
2. Use half of the nails in each member being connected to achieve the listed resistances.
3. Nails: 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long. See pp. 22–23 for other nail sizes and information.

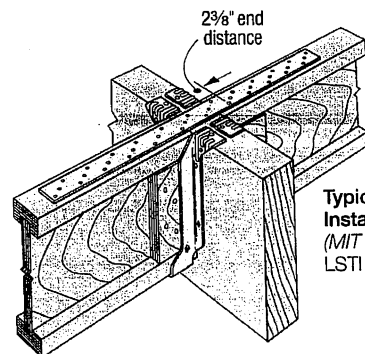


Typical MSTI Installation
(MIT hanger shown)
LSTI similar



Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.



*Plate location details available in Mitek software or upon request.

PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.


4 X 4

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
Design Standard for Bracing.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

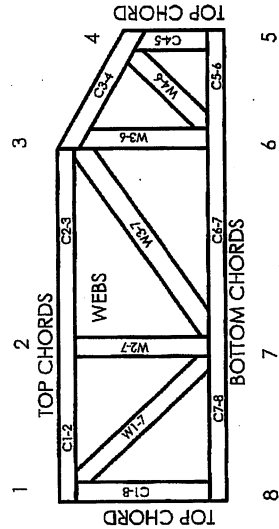

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

Mitek
POWER TO PERFORM.™

Mitek Engineering Reference Sheet: MII-7473C rev. 10-'08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSL.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.