

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name Unit 4001 - Elev. A,B and C		Lot: 4001	
Municipality Brampton		Postal code	Plan number/ other description
B. Individual who reviews and takes responsibility for design activities			
Name Doug McCallum		Firm McCallum HVAC Design Inc.	
Street address 2 Dewside Drive Unit 208		Unit no.	Lot/con.
Municipality Brampton	Postal code L6R 3Y5	Province Ontario	E-mail info@mccallumhvac.com
Telephone number (905) 840-8166	Fax number	Cell number (647) 229-0380	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 of Division C]			
House ☒	HVAC – House	Building Structural	
Small Buildings	Building Services	Plumbing – House	
Large Buildings	Detection, Lighting and Power	Plumbing – All Buildings	
Complex Buildings	Fire Protection	On-site Sewage Systems	
Description of designer's work		Model Certification	
Heating and Cooling Load Calculations Air System Design Residential mechanical ventilation Design Summary Residential System Design per CAN/CSA-F280-12 Residential New Construction - Forced Air		Project #: RP23050	
		Builder	Royal Pine Homes
		Project	Forestside Estates
		Model	Unit 4001 - Elev. A,B and C
		SB-12	SB 12 Performance 28
D. Declaration of Designer			
I, <u>Doug McCallum</u> declare that (choose one as appropriate): (print name)			
☒ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 Division C of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: <u>25896</u> Firm BCIN: <u>102614</u>			
I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code. Individual BCIN: _____ Basis for exemption from registration: _____ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that: 1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
<u>2023-06-07</u> Date		 Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d), of Division C, Article 3.2.5.1. of Division C and all other persons who are exempt from qualifications under Subsections 3.2.4 . and 3.2.5. of Division C.
- Schedule 1 does not require to be completed a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited licence to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

2 Dewside Drive Unit 208, Brampton, Ontario L6R 3Y5 Tel: 905-840-8166

e-mail - info@mccallumhvac.com

Heat loss and gain calculation summary sheet		CSA-F280-M12 Standard Form No. 1
These documents issued for the use of <u>Royal Pine Homes</u>		Project No. RP23050
and may not be used by any other persons without authorization. Documents for permit and/or construction are signed in red.		
Building Location		
Address (Model): <u>Unit 4001 - Elev. A,B and C</u>	Site: <u>Forestside Estates</u>	
Model:	Lot: <u>4001</u>	
City and Province: <u>Brampton</u>	Postal code:	
Calculations based on		
Dimensional information based on:		
Attachment: <u>Detached</u>	Front facing: <u>East</u>	Assumed? Yes
No. of Levels: <u>3</u> Ventilated? Included	Air tightness: <u>-1</u>	Assumed? Yes
Weather location: <u>Brampton</u>	Wind exposure: Shelterd	
HRV? <u>VanEE</u> <u>65H</u>	Internal shading: Light-translucent	Occupants: <u>5</u>
Sensible Eff. at -25C <u>60.0 %</u> Apparent Effect. at -0C <u>75.0 %</u>	Units: Imperial	
Heating design conditions		Cooling design conditions
Outdoor temp: -2.2°F Indoor temp: 72.0°F Mean soil temp: 48.2°F		Outdoor temp: 86.0°F Indoor temp: 72.0°F Latitude: 43.68
Above grade walls		Below grade walls
Style A: As per Selected OBC SB12 SB 1 R 22+1.	Style A: As per Selected OBC SB12 SB 1 R 20ci	
Style B: Existing Walls (When Applicable) R 12	Style B:	
Style C:	Style C:	
Style D:	Style D:	
Floors on soil		Ceilings
Style A: As per Selected OBC SB12 SB 12 F	Style A: As per Selected OBC SB12 SB 12 P R 60.0	
Style B:	Style B: As per Selected OBC SB12 SB 12 P R 31.0	
Exposed floors		Style C:
Style A: As per Selected OBC SB12 SB 12 R 31	Doors	
Style B:	Style A: As per Selected OBC SB12 SB 12 R 3.01	
Windows		Style B:
Style A: As per Selected OBC SB12 SB 12 I R 3.57	Style C:	
Style B: Existing Windows (When Applicable) R	Skylights	
Style C:	Style A: As per Selected OBC SB12 SB 12 R 2.04	
Style D:	Style B:	
Attached documents: As per Shedule 1		
Notes: Residential New Construction - Forced Air		
Calculations performed by		
Name: Doug McCallum	Postal code: L6R 3Y5	
Company: McCallum HVAC Design Inc.	Telephone: (905) 840-8166	
Address: 2 Dewside Drive Unit 208	Mobile: (647) 229-0380	
City: Brampton	E-mail info@mccallumhvac.com	

Project: Forestside Estates

Model: Unit 4001 - Elev. A.B and C

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

For systems serving one dwelling unit & conforming to the Ontario Building Code, O.geg 159/93

Location of Installation	
Lot #	Plan #
Township Brampton	
Roll #	Permit #
Address	

Total Ventilation Capacity 9.32.3.3(1)					
Bsmt & Master Bdrm	2	@ 21.2	cfm	42.4	cfm
Other Bedrooms	3	@ 10.6	cfm	31.8	cfm
Bathrooms & Kitchen	5	@ 10.6	cfm	53.0	cfm
Other rooms	5	@ 10.6	cfm	53.0	cfm
Total				<u>180.2</u>	

Builder	
Name	Royal Pine Homes
Address	
City	
Tel	Fax

Principal Ventilation Capacity 9.32.3.4(1)					
Master bedroom	1	@ 31.8	cfm	31.8	cfm
Other bedrooms	3	@ 15.9	cfm	47.7	cfm
Total				<u>79.5</u>	

Installing Contractor	
Name	
Address	
City	
Tel	Fax

Principal Exhaust Fan Capacity			
Make	Model	Location	
VanEE	65H	BASE	
129	cfm	64	Sones

Heat Recovery Ventilator			
Make	VanEE		
Model	65H		
	129	cfm high	64 cfm low
Sensible efficiency @ -25 deg C	60 %		
Sensible efficiency @ 0 deg C	75 %		


Combustion Appliances 9.32.3.1(1)	
a)	☒ Direct vent (sealed combustion) only
b)	☐ Positive venting induced draft (except fireplaces)
c)	☐ Natural draft, B-vent or induced draft fireplaces
d)	☐ Solid fuel (including fireplaces)
e)	☐ No combustion Appliances

Supplemental Ventilation Capacity	
Total ventilation capacity	180.2
Less principal exhaust capacity	79.5
REQUIRED supplemental vent. Capacity	<u>100.7</u> cfm

Heating System	
☒	Forced air
☐	Non forced air
☐	Electric space heat (if over 10% of heat load)

Supplemental Fans 9.32.3.5.			
Location	cfm	Model	Sones
ENSUITE	50	770	2.5
POWDER	50	770	2.5
		None	
		None	
all fans HVI listed		Make	Broan or Equiv.

House Type 9.32.3.1(2)	
I	☒ Type a) or b) appliances only, no solid fuel
II	☐ Type I except with solid fuel (including fireplace)
III	☐ Any type c) appliance
IV	☐ Type I or II either electric space heat
Other	☐ Type I, II or IV no forced air

Designer Certification	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name	Doug McCallum
Signature	
HRAI #	BCIN # 25896
Date	2023-06-07

System Design Option	
1	☐ Exhaust only / forced air system
2	☐ HRV WITH DUCTING / forced air system
3	☒ HRV simplified connection to forced air system
4	☐ HRV full ducting/not coupled to forced air system
	☐ Part 6 design

Project: Forestside Estates

Model: Unit 4001 - Elev. A,B and C

Air Leakage Calculations

Air Leakage Calculations	Building Air Leakage Heat Loss					Building Air Leakage Heat Gain					
	B	LRairh	Vb	HL^T	HLleak	B	LRairh	Vb	HG^T	HG Leak	
	0.018	0.339	43205.0	74.2	19584.61	0.018	0.1183429	43205	14.00	1288.48	
Air Leakage Calculations	Air Leakage Heat Loss/Gain Multiplier Table (Section 11)					Levels					
	Level	Level Factor (LF)	Building Air Leakage	Level Conductive Heat Loss (HLclevel)	Air Leakage Heat Loss Multiplier	1	2	3	4		
	1	0.5	19585	5448	1.79741	(LF)	(LF)	(LF)	(LF)		
	2	0.3		13473	0.43609	1.0	0.6	0.5	0.4		
Air Leakage Calculations	3	0.2		12984	0.30167		0.4	0.3	0.3		
	4	0		0	0.00000			0.2	0.2		
									0.1		
Air Leakage Calculations						Levels this Dwelling					
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											
Air Leakage Calculations											


Envelope Air Leakage Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Brampton			
Region:	ON			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavv			
Flue:	Heavv			
Highest Ceiling Height (m):	6.71			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1224			
Air Leakage/Ventilation				
Air Tightness Type:	Custom - DBT values			
Custom BDT Data:	ELA @ 10 Pa.		1547.929	
	3		ACH @ 50 Pa	
Mechanical Ventilation (L/s):	Total Supply:	Total Exhaust:		
	0	0		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Envelope Air Leakage Rate				
Heating Air Leakage Rate (ACH/H):		0.339		
Cooling Air Leakage Rate (ACH/H):		0.118		

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

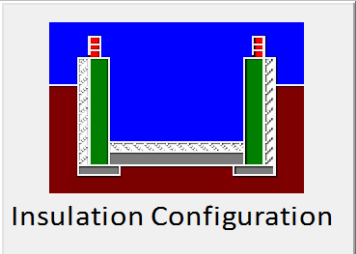Weather Station Description		
Province:	Brampton	
Region:	ON	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Deep (>10 m, >33 Ft)	
Foundation Dimensions		
Floor Length (m):	22.1	 Insulation Configuration BCIN_1
Floor Width (m):	5.64	
Exposed Perimeter (m):	55.4	
Wall Height (m):	3.05	
Depth Below Grade (m):	2.44	
Window Area (m ²):	1.49	
Door Area (m ²):	0	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	23	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1499	

SYSTEM A

DESIGN LOAD SPECIFICATIONS				AIR DISTRIBUTION AND PRESSURE			
LEVEL 1 NET LOAD	15512 btu/h			EQUIPMENT EXTERNAL STATIC PRESSURE	0.500"W.C.		
LEVEL 2 NET LOAD	20020 btu/h			ADDITIONAL EQUIPMENT PRESSURE DROP	0.250"W.C.		
LEVEL 3 NET LOAD	18370 btu/h			AVAILABLE DESIGN PRESSURE	0.250"W.C.		
LEVEL 4 NET LOAD	0 btu/h			RETURN BRANCH LONGEST EFFECTIVE LENGTH	300ft		
SYSTEM HEATLOSS	53902 btu/h			R/A PLENUM PRESSURE	0.120"W.C.		
SYSTEM HEATGAIN	32617 btu/h			S/A PLENUM PRESSURE	0.130"W.C.		
BUILDING VOLUME Vb	43205.00 ft3			HEATING AIR FLOW PROPORTIONING FACTOR	0.0212 cfm/btuh		
VENTILATION LOAD	1593.00 btu/h			COOLING AIR FLOW PROPORTIONING FACTOR	0.0351 cfm/btuh		
VENTILATION PVC	79.50 cfm			R/A TEMP. 70°F	S/A TEMP. 121.75°F	DIFFUSER LOSS 0.01"W.C.	
FURNACE/AIR HANDLER DATA				BLOWER DATA			
MAKE	LENNOX			HEATING CHECK	1146.00 CFM		
MODEL	EL296UH070XE36B			SELECTED CFM	1145.00 CFM		
HIGH INPUT btu/h	66000	LOW INPUT btu/h	0	COOLING CHECK	1146.00 CFM		
HIGH OUTPUT btu/h	64000	LOW OUTPUT btu/h	0	COOLING AIR FLOW RATE	1145.00 CFM		
E.S.P.	0.50			BLOWER TYPE ECM (BRUSHLESS DC OBC 12.3.1.5.(2))			
WATER TEMP.				A/C UNIT DATA			
AFUE	96.97%			MAKER	3.0 TON		
AUX. HEAT	0			CONDENSER	3.0 TON		
SB-12 PACKAGE	SB 12 Performance 28			COIL	3.0 TON		
TEMP. RISE	51.75°F						

SUPPLY BRANCH AND GRILL SIZING

OUTLET #	ROOM USE	BTU/H OUTLET	HEATING AIR FLOW RATE CFM	COOLING AIR FLOW RATE CFM	DUCT DESIGN PRESSURE	ACTUAL DUCT LENGTH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	DUCT SIZE ROUND	OUTLET SIZE	TRUNK
24	BASE	3877	81	39	0.13	46	115	161	0.07	6.0	4x10	A1
25	BASE	3877	81	39	0.13	38	125	163	0.07	6.0	4x10	B1
26	BASE	3877	81	39	0.13	51	145	196	0.06	6.0	4x10	C1
27	BASE	3877	81	39	0.13	23	175	198	0.06	6.0	4x10	D1
13	FAM ROOM	3167	66	78	0.13	49	175	224	0.05	6.0	4x10	A1
14	KIT/BREK	2089	44	74	0.13	39	155	194	0.06	6.0	4x10	A1
15	KIT/BREK	2089	44	74	0.13	50	175	225	0.05	6.0	4x10	A1
16	DEN	1087	23	47	0.13	30	145	175	0.07	5.0	4x10	B1
17	LAUD	1155	24	36	0.13	20	125	145	0.08	5	4x10	E1
19	FOYER	3917	82	45	0.13	48	155	203	0.06	6.0	4x10	C1
21	PWD	1276	27	15	0.13	40	135	175	0.07	5	4x10	D1
1	PRI. ENS	1888	40	53	0.13	46	165	211	0.06	6	4x10	B1
2	PRI. BED	1524	32	51	0.13	40	155	195	0.06	5.0	4x10	A1
3	PRI. BED	1524	32	51	0.13	48	145	193	0.06	5.0	4x10	A1
5	SHD BATH	844	18	12	0.13	22	155	177	0.07	5	4x10	E1
8	MEDIA RM	2092	44	56	0.13	45	185	230	0.05	6.0	4x10	C1
9	MEDIA RM	2092	44	56	0.13	54	155	209	0.06	5.0	4x10	C1
10	ENS-2	627	13	15	0.13	31	165	196	0.06	5	4x10	D1
22	LIV/DIN	1316	28	37	0.13	31	165	196	0.06	5.0	4x10	D1
23	LIV/DIN	1316	28	37	0.13	29	155	184	0.07	5.0	4x10	B1
12	PRI. WIC	517	11	6	0.13	38	175	213	0.06	5	4x10	B1
20	SIDE ENTR	1559	33	10	0.13	40	185	225	0.05	5.0	4x10	C1
18	MUD RM	1036	22	7	0.13	10	115	125	0.10	5	4x10	E1
4	BED-2	1687	35	37	0.13	8	130	138	0.09	5	4x10	PL
6	BED-3	2313	48	73	0.13	53	145	198	0.06	6.0	4x10	D1
7	BED-3	2313	48	73	0.13	48	195	243	0.05	6.0	4x10	C1
11	BED-4	1732	36	47	0.13	42	175	217	0.06	5.0	4x10	D1

RETURN BRANCH AND GRILL SIZING

R/A INLET #	INLET AIR VOLUME CFM	DUCT DESIGN PRESSU RE	ACTUAL DUCT LENGTH	EQUIVAL ENT LENGTH	TOTAL EFFECTIV E LENGTH	ADJUSTE D PRESSU RE	DUCT SIZE ROUND	INLET SIZE	TRUNK
1R	70	0.12	32	160	192	0.05	6	14x8	Z1
2R	150	0.12	29	120	149	0.07	7.5	14x8	Z1
3R	145	0.12	44	160	204	0.05	8	14x8	Y1
4R	75	0.12	47	130	177	0.06	6	14x8	X1
5R	70	0.12	48	170	218	0.05	6	14x8	X1
6R	385	0.12	30	160	190	0.05	11.5	30x8	Z1
7R	140	0.12	32	120	152	0.07	7.5	14x8	Y1
8R	110	0.12	23	120	143	0.07	7	FLC	Y1

RETURN TRUNK DUCT SIZING

TRUNK	CFM	PRESSU RE	ROUND	RECT. SIZE	SIZE ALTERNA TE
DROP	1145	0.05		0	
Z1	1145	0.05	17	26x10	26x10
Y1	540	0.05	13	18x8	14x10
X1	145	0.05	8	8x8	10x6

SUPPLY TRUNK DUCT SIZING

TRUNK	CFM	PRESSU RE	ROUND	RECT. SIZE	SIZE ALTERNA TE
A1	299	0.05	10.5	12x8	16x6
B1	482	0.05	12.5	18x8	24x6
C1	332	0.05	11	14x8	18x6
D1	565	0.05	13	18x8	14x10
E1	1111	0.05	17	26x10	26x10
PL	35	0.09	4		

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



WEATHER DATA [Brampton] [43.68] [-2.20] [86.00] [51.80] [48.20] [74.20] [14.00]

LEVEL 1																							
BASE		TOTALS H.L.: 15512 btuh						H.G.: 4486 btuh				AREA: 1341 ft2		Above Grade: 2		GROSS EXP. WALL				NEW 364 ft		EXIST 0 ft	
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT							
NEW: 182 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2					
Eff. R-V	21.12	8.50		59.22	22.86			27.65	22.05			29.80	22.05			2.04	2.03						
LOSS	3.5	0 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.7	231 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS							
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 8.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 4.0 ft2		EXIST: 0.0 ft2		NEW: 4 ft2		EXIST: 0 ft2					
Eff. R-V	3.01	3.01		3.57	1.99			0	0			3.57	1.99			3.57	1.99						
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	166 btuh	37.3	0 btuh	0	0	0	20.8	83 btuh	37.3	0 btuh	20.8	83 btuh	37.3	0 btuh				
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	225 btuh	14.9	0 btuh	0	0	0	21.7	87 btuh	14.9	0 btuh	11.7	47 btuh	14.9	0 btuh				
FUND. CONDUCTIVE HEATLOSS				5115 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3							
TOTAL CONDUCTIVE				LOSS	5448 btuh	LOSS	1.7974	9792 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	272.0 btuh	239	5532	LOSS	0%	0 btuh				
TOTAL CONDUCTIVE				GAIN	590 btuh	GAIN	0.0837	49 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	46 btuh	0	50%	2766 btuh	GAIN	0%	0 btuh			
LEVEL 2																							
FAM ROOM		TOTALS H.L.: 3169 btuh						H.G.: 2246 btuh				AREA: 295 ft2		C.Height: 11		GROSS EXP. WALL				NEW 407 ft		EXIST 0 ft	
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT							
NEW: 37 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2					
Eff. R-V	18.53	8.50		59.22	22.86			27.65	22.05			29.80	22.05			2.04	2.03						
LOSS	4.0	1510 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	285 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS							
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 30.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2					
Eff. R-V	3.01	3.01		3.57	1.99			0	0			3.57	1.99			3.57	1.99						
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	624 btuh	37.3	0 btuh	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh				
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	845 btuh	14.9	0 btuh	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh				
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3							
TOTAL CONDUCTIVE				LOSS	2133 btuh	LOSS	0.4361	930 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	106.5 btuh	239	5532	LOSS	0%	0 btuh				
TOTAL CONDUCTIVE				GAIN	1130 btuh	GAIN	0.0837	95 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	88 btuh	0	8%	415 btuh	GAIN	0%	0 btuh			
KIT/BREK		TOTALS H.L.: 4180 btuh						H.G.: 4246 btuh				AREA: 266 ft2		C.Height: 11		GROSS EXP. WALL				NEW 363 ft		EXIST 0 ft	
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT							
NEW: 33 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2					
Eff. R-V	18.53	8.50		59.22	22.86			27.65	22.05			29.80	22.05			2.04	2.03						
LOSS	4.0	1129 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	213 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS							
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 64.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 17 ft2		EXIST: 0 ft2					
Eff. R-V	3.01	3.01		3.57	1.99			0	0			3.57	1.99			3.57	1.99						
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	1330 btuh	37.3	0 btuh	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	353 btuh	37.3	0 btuh				
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1803 btuh	14.9	0 btuh	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	200 btuh	14.9	0 btuh				
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3							
TOTAL CONDUCTIVE				LOSS	2813 btuh	LOSS	0.4361	1227 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	140.4 btuh	239	5532	LOSS	0%	0 btuh				
TOTAL CONDUCTIVE				GAIN	2216 btuh	GAIN	0.0837	185 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	173 btuh	0	13%	692 btuh	GAIN	0%	0 btuh			
DEN		TOTALS H.L.: 1088 btuh						H.G.: 1344 btuh				AREA: 131 ft2		C.Height: 11		GROSS EXP. WALL				NEW 99 ft		EXIST 0 ft	
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT							
NEW: 9 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2					
Eff. R-V	18.53	8.50		59.22	22.86			27.65	22.05			29.80	22.05			2.04	2.03						
LOSS	4.0	316 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	60 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS							
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 20 ft2		EXIST: 0 ft2					
Eff. R-V	3.01	3.01		3.57	1.99			0	0			3.57	1.99			3.57	1.99						
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	416 btuh	37.3	0 btuh				
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	235 btuh	14.9	0 btuh				
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3							
TOTAL CONDUCTIVE				LOSS	732 btuh	LOSS	0.4361	319 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	36.5 btuh	239	5532	LOSS	0%	0 btuh				
TOTAL CONDUCTIVE				GAIN	294 btuh	GAIN	0.0837	25 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	23 btuh	0	13%	692 btuh	GAIN	0%	0 btuh			
LAUD		TOTALS H.L.: 1156 btuh																					

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



LOSS	4.0	633 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	119 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 7 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	145 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	82 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	778 btuh	LOSS	0.4361	339 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	38.8 btuh	239	5532	LOSS	0%	0 btuh	
TOTAL CONDUCTIVE				GAIN	202 btuh	GAIN	0.0837	17 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	16 btuh	0	0 btuh	10%	553 btuh	GAIN	0%
FOYER				TOTALS H.L.: 3920 btuh				H.G.: 1294 btuh				AREA: 151 ft2				C.Height: 11				
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT				
NEW: 39 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	1518 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	286 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 8.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 21 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	166 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	436 btuh	37.3	0 btuh
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	225 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	246 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	2638 btuh	LOSS	0.4361	1150 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	131.7 btuh	239	5532	LOSS	0%	0 btuh	
TOTAL CONDUCTIVE				GAIN	856 btuh	GAIN	0.0837	72 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	67 btuh	0	0 btuh	0%	0 btuh	GAIN	0%
PWD				TOTALS H.L.: 1277 btuh				H.G.: 433 btuh				AREA: 36 ft2				C.Height: 11				
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT				
NEW: 7 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	196 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	37 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 7.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	145 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	152 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	859 btuh	LOSS	0.4361	375 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	42.9 btuh	239	5532	LOSS	0%	0 btuh	
TOTAL CONDUCTIVE				GAIN	287 btuh	GAIN	0.0837	24 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	22 btuh	0	0 btuh	0%	0 btuh	GAIN	0%
LIV/DIN				TOTALS H.L.: 2633 btuh				H.G.: 2119 btuh				AREA: 296 ft2				C.Height: 11				
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT				
NEW: 25 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	941 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	178 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 40.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	831 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	868 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	1772 btuh	LOSS	0.4361	773 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	88.5 btuh	239	5532	LOSS	0%	0 btuh	
TOTAL CONDUCTIVE				GAIN	1046 btuh	GAIN	0.0837	87 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	82 btuh	0	0 btuh	8%	415 btuh	GAIN	0%
SIDE ENTR				TOTALS H.L.: 1560 btuh				H.G.: 299 btuh				AREA: 78 ft2				C.Height: 11				
EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT				
NEW: 14 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	533 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	100 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:												

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A/B and CLIENT: Royal Pine Homes
C
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



FUND. CONDUCTIVE HEATLOSS			0 btuh			AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	1050 btuh	LOSS	0.4361	458 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	52.4 btuh	239		5532		LOSS	0%	0 btuh					
TOTAL CONDUCTIVE	GAIN	198 btuh	GAIN	0.0837	17 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	16 btuh	0		0		GAIN	0%	0 btuh					
MUD RM																							
TOTALS					H.L.: 1037 btuh					H.G.: 199 btuh					AREA: 25 ft2		C.Height: 11		GROSS EXP. WALL				
NEW 6 ft			EXIST: 0 ft			NEW: 0			EXIST: 0			NEW: 0 ft2			EXIST: 0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	18.53	8.50	59.22	22.86	27.65	22.05	29.80	22.05	2.04	2.03													
LOSS	4.0	180 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	34 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS			EAST/WEST WINDOWS			SE/SW WINDOWS			SOUTH WINDOWS			NORTH WINDOWS											
NEW: 21.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	3.01	3.01	3.57	1.99	0	0	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99							
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS			0 btuh			AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	698 btuh	LOSS	0.4361	304 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	34.8 btuh	239		5532		LOSS	0%	0 btuh					
TOTAL CONDUCTIVE	GAIN	132 btuh	GAIN	0.0837	11 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	10 btuh	0		0		GAIN	0%	0 btuh					
LEVEL 3																							
PRI. ENS					TOTALS					H.L.: 1799 btuh					AREA: 110 ft2		C.Height: 8		GROSS EXP. WALL				
NEW: 21 ft			EXIST: 0 ft			NEW: 110 ft2			EXIST: 0			NEW: 0 ft2			EXIST: 0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	18.53	8.50	59.22	22.86	27.65	22.05	29.80	22.05	2.04	2.03													
LOSS	4.0	549 btuh	8.7	0 btuh	1.3	138 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	104 btuh	1.6	0 btuh	0.7	76 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS			EAST/WEST WINDOWS			SE/SW WINDOWS			SOUTH WINDOWS			NORTH WINDOWS											
NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 22.0 ft2			EXIST: 0.0 ft2			NEW: 9.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	3.01	3.01	3.57	1.99	0	0	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99							
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	457 btuh	37.3	0 btuh	0	0	0	0	20.8	187 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	620 btuh	14.9	0 btuh	0	0	0	0	21.7	195 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS			0 btuh			AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	1331 btuh	LOSS	0.3017	402 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	66.4 btuh	239		5532		LOSS	0%	0 btuh					
TOTAL CONDUCTIVE	GAIN	995 btuh	GAIN	0.0837	83 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	78 btuh	0		0		GAIN	0%	0 btuh					
PRI. BED																							
TOTALS					H.L.: 2903 btuh					H.G.: 2856 btuh					AREA: 336 ft2		C.Height: 8		GROSS EXP. WALL				
NEW: 34 ft			EXIST: 0 ft			NEW: 336 ft2			EXIST: 0			NEW: 0 ft2			EXIST: 0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	18.53	8.50	59.22	22.86	27.65	22.05	29.80	22.05	2.04	2.03													
LOSS	4.0	937 btuh	8.7	0 btuh	1.3	421 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	177 btuh	1.6	0 btuh	0.7	233 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS			EAST/WEST WINDOWS			SE/SW WINDOWS			SOUTH WINDOWS			NORTH WINDOWS											
NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 38.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	3.01	3.01	3.57	1.99	0	0	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99							
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	790 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1071 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS			0 btuh			AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	2148 btuh	LOSS	0.3017	648 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	107.2 btuh	239		5532		LOSS	0%	0 btuh					
TOTAL CONDUCTIVE	GAIN	1480 btuh	GAIN	0.0837	124 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	116 btuh	2		478 btuh		GAIN	0%	0 btuh					
SHD BATH																							
TOTALS					H.L.: 820 btuh					H.G.: 337 btuh					AREA: 101 ft2		C.Height: 8		GROSS EXP. WALL				
NEW: 6 ft			EXIST: 0 ft			NEW: 101 ft2			EXIST: 0			NEW: 40 ft2			EXIST: 0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2		
Eff. R-V	18.53	8.50	59.22	22.86	27.65	22.05	29.80	22.05	2.04	2.03													
LOSS	4.0	160 btuh	8.7	0 btuh	1.3	127 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	100 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	30 btuh	1.6	0 btuh	0.7	70 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	11 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
DOORS			EAST/WEST WINDOWS			SE/SW WINDOWS			SOUTH WINDOWS			NORTH WINDOWS											
NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 0.0 ft2			EXIST: 0.0 ft2			NEW: 8 ft2			EXIST: 0 ft2		
Eff. R-V	3.01	3.01	3.57	1.99	0	0	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99	3.57	1.99							
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	166 btuh	37.3	0 btuh			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	94 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS			0 btuh			AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3											

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



	NEW: 41 ft		EXIST: 0 ft		NEW: 243 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 76 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03		
LOSS	4.0	1081 btuh	8.7	0 btuh	1.3	304 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	189 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh	
GAIN	0.8	204 btuh	1.6	0 btuh	0.7	168 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	20 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh	
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 54.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99		
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	1122 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh	
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1522 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh	
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE			
TOTAL CONDUCTIVE		LOSS	2697 btuh	LOSS	0.3017	814 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	134.6 btuh	239	5532				LOSS	10%	351 btuh	
TOTAL CONDUCTIVE		GAIN	1914 btuh	GAIN	0.0837	160 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	149 btuh	0	0 btuh	0%	0 btuh	GAIN	10%	191 btuh		
ENS-2		TOTALS H.L.: 603 btuh				H.G.: 420 btuh				AREA: 76 ft2		C.Height: 8		GROSS EXP. WALL				NEW 48 ft		EXIST 0 ft	
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 6 ft		EXIST: 0 ft		NEW: 76 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 3 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03		
LOSS	4.0	156 btuh	8.7	0 btuh	1.3	95 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	7 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh	
GAIN	0.8	29 btuh	1.6	0 btuh	0.7	53 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	1 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh	
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 9.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99		
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	187 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh	
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	195 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh	
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE			
TOTAL CONDUCTIVE		LOSS	446 btuh	LOSS	0.3017	135 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	22.3 btuh	239	5532				LOSS	0%	0 btuh	
TOTAL CONDUCTIVE		GAIN	278 btuh	GAIN	0.0837	23 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	22 btuh	0	0 btuh	0%	0 btuh	GAIN	0%	0 btuh		
PRI. WIC		TOTALS H.L.: 480 btuh				H.G.: 156 btuh				AREA: 79 ft2		C.Height: 8		GROSS EXP. WALL				NEW 64 ft		EXIST 0 ft	
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 8 ft		EXIST: 0 ft		NEW: 79 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03		
LOSS	4.0	256 btuh	8.7	0 btuh	1.3	99 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh	
GAIN	0.8	48 btuh	1.6	0 btuh	0.7	55 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh	
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99		
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh	
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh	
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE			
TOTAL CONDUCTIVE		LOSS	355 btuh	LOSS	0.3017	107 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	17.7 btuh	239	5532				LOSS	0%	0 btuh	
TOTAL CONDUCTIVE		GAIN	103 btuh	GAIN	0.0837	9 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	8 btuh	0	0 btuh	0%	0 btuh	GAIN	0%	0 btuh		
BED-2		TOTALS H.L.: 1612 btuh				H.G.: 1035 btuh				AREA: 250 ft2		C.Height: 8		GROSS EXP. WALL				NEW 144 ft		EXIST 0 ft	
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 18 ft		EXIST: 0 ft		NEW: 250 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03		
LOSS	4.0	505 btuh	8.7	0 btuh	1.3	313 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh	
GAIN	0.8	95 btuh	1.6	0 btuh	0.7	173 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh	
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 18 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99		
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	374 btuh	37.3	0 btuh	
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	211 btuh	14.9	0 btuh	
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST											


**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and
C
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12

CLIENT: Royal Pine Homes
GTA: 3348
LOT: 4001
SITE: Forestside Estates



LOSS	24.7	0 btuh	24.7	0 btuh	20.8	1455 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1972 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh	AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.		
TOTAL CONDUCTIVE			LOSS	3041 btuh	LOSS	0.3017	917 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	151.8 btuh	239		5532		LOSS	10%	396 btuh
TOTAL CONDUCTIVE			GAIN	2333 btuh	GAIN	0.0837	195 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	182 btuh	1	239 btuh	0%	0 btuh	GAIN	10%	257 btuh
BED-4		TOTALS H.L.: 1650 btuh				H.G.: 1314 btuh				AREA: 248 ft2		C.Height: 8		GROSS EXP. WALL		NEW 152 ft		EXIST 0 ft		
	EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 19 ft		EXIST: 0 ft		NEW: 248 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2	
Eff. R-V	18.53	8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03		
LOSS	4.0	537 btuh	8.7	0 btuh	1.3	311 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	101 btuh	1.6	0 btuh	0.7	172 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
	DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 18.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2	
Eff. R-V	3.01	3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99		
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	374 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	391 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh	AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.		
TOTAL CONDUCTIVE			LOSS	1221 btuh	LOSS	0.3017	368 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	61.0 btuh	239		5532		LOSS	0%	0 btuh
TOTAL CONDUCTIVE			GAIN	664 btuh	GAIN	0.0837	56 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	52 btuh	1	239 btuh	0%	0 btuh	GAIN	0%	0 btuh
LEVEL 4																				

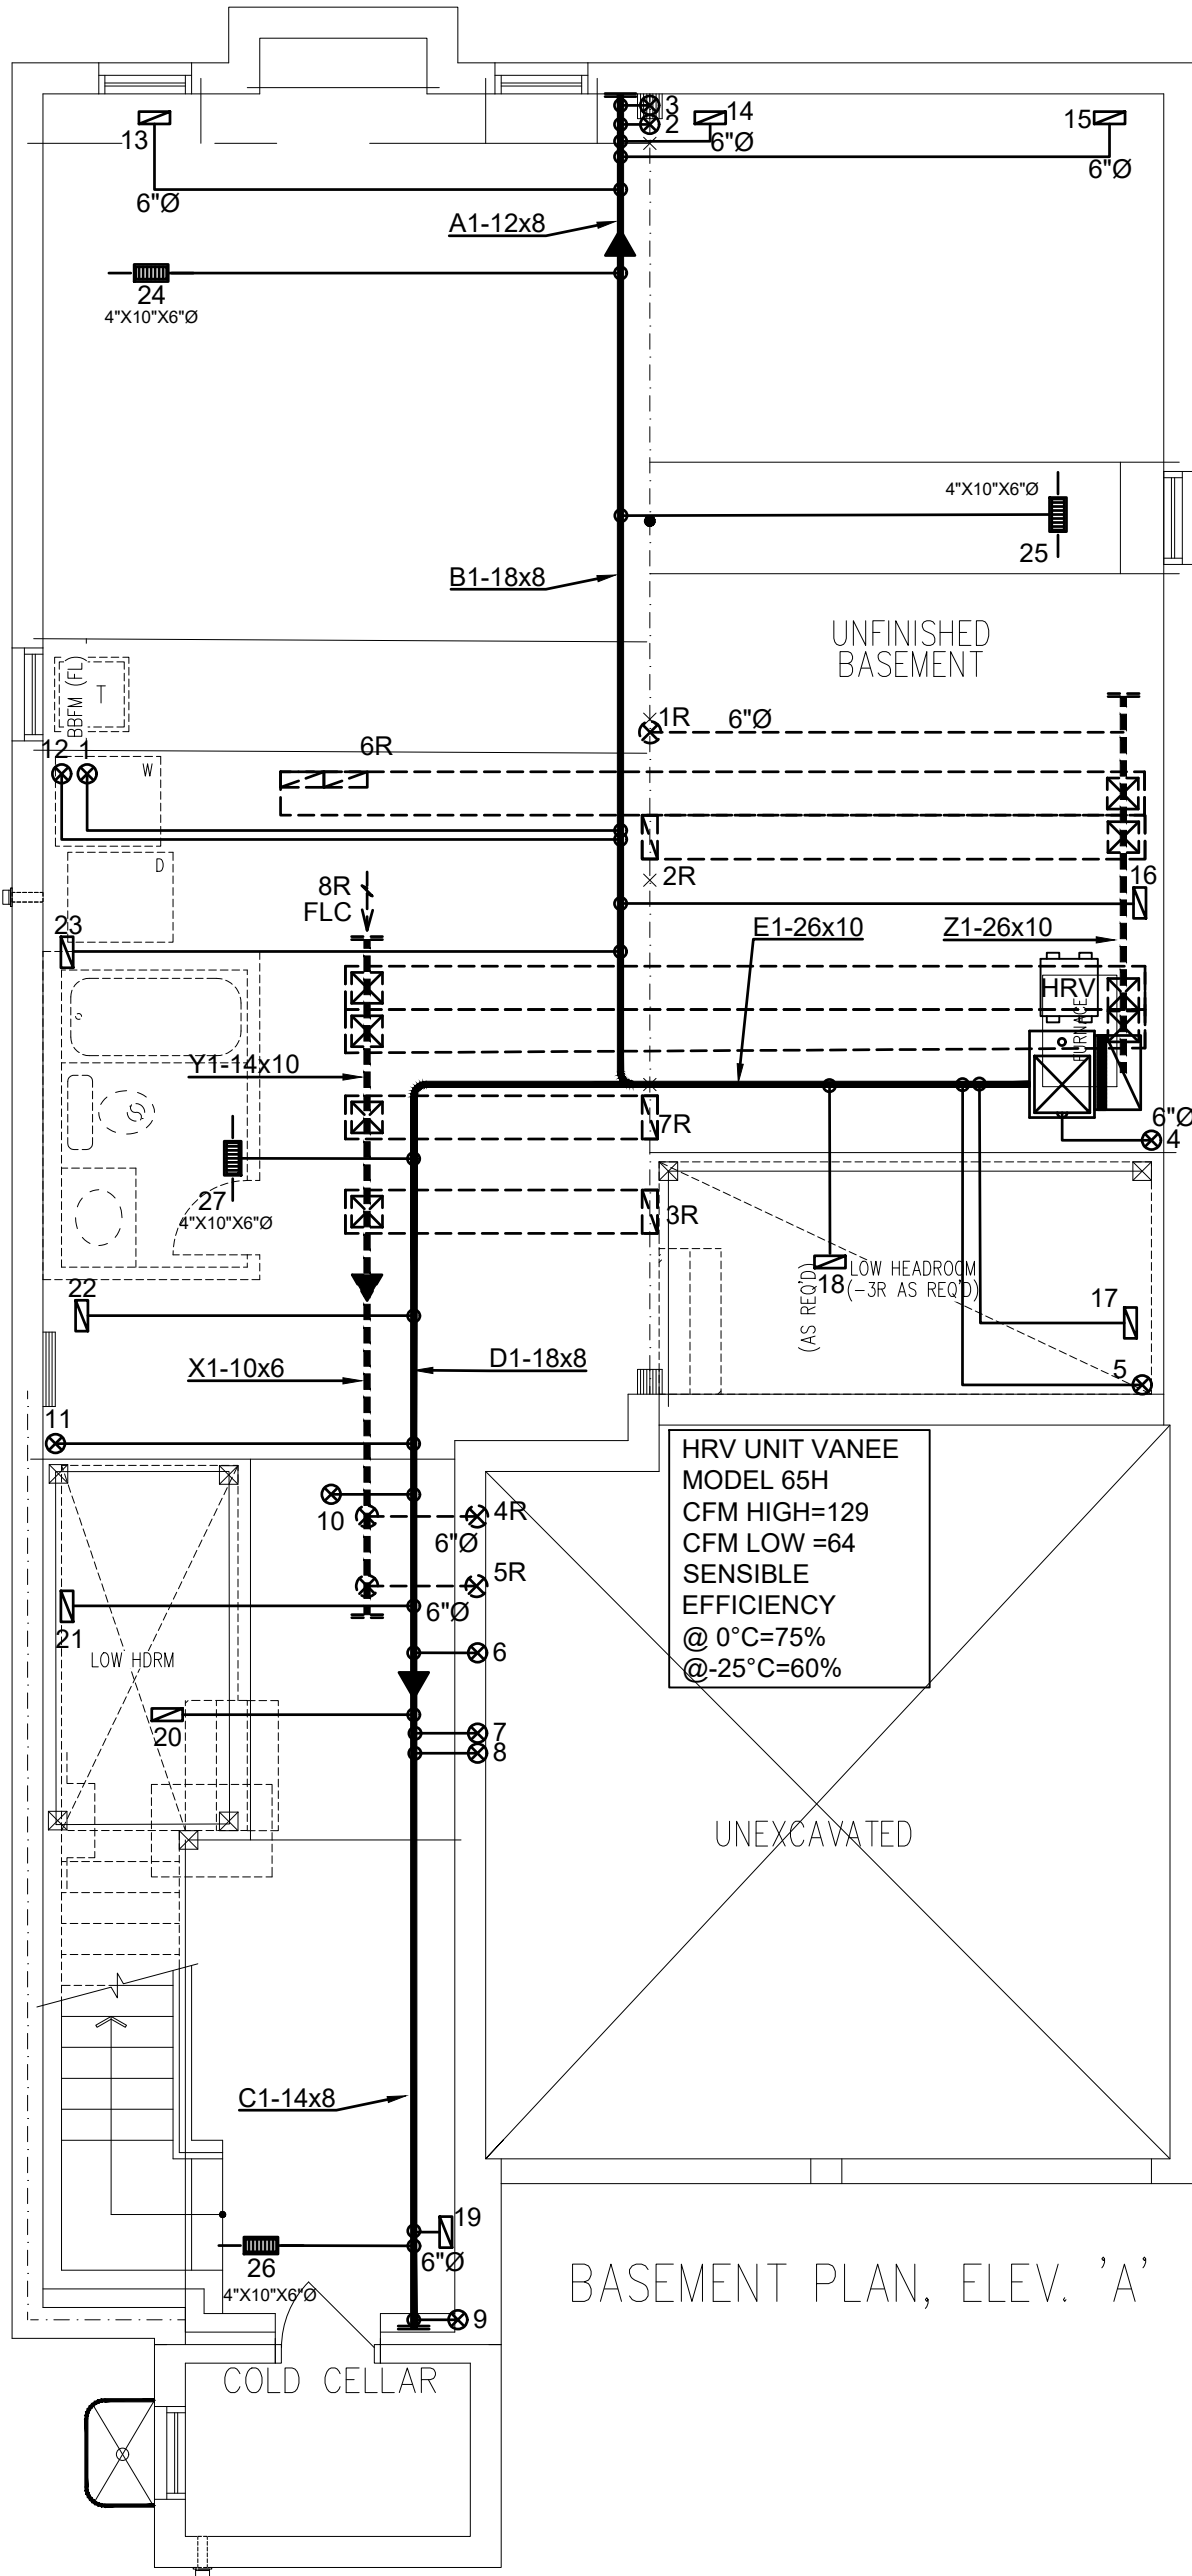

BASEMENT PLAN, ELEV. 'A'

3RD	# S/A	# R/A	# FANS
2ND	12	5	3
1ST	10	2	2
B	4	1	-
TOTAL	26	8	5

- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS.
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
- COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION.
- PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS.
- ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS
- ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.

PROPOSED BASEMENT

DATE: JUN/2023 SCALE: 3/16"=1'-0" DRAWN BY: MMA/MP

SB-12 PERFORMANCE
CSA F280-12

CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY		
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.		
Doug McCallum		102614
NAME	SIGNATURE	BCIN / BCDN


TOTAL LOSS	53,902 BTUH	
TOTAL GAIN	32,617 BTUH	
HEATING UNIT	LENNOX	
MODEL #	EL296UH070XE36B	3 TON
OUTPUT	64,000 BTUH	1145 CFM

MODEL:	Unit 4001 - Elev. A,B and C		
PROJECT #:	RP23050	SQFT: 3348	W%: 11.77
SITE:	Forestside Estates		
FOR:	Forestside Estates		
BUILDER:	Royal Pine Homes		

MCCALLUM
HVAC DESIGN INC


Brampton, Ontario, 905-840-8166, info@mccallumhvac.com

M1

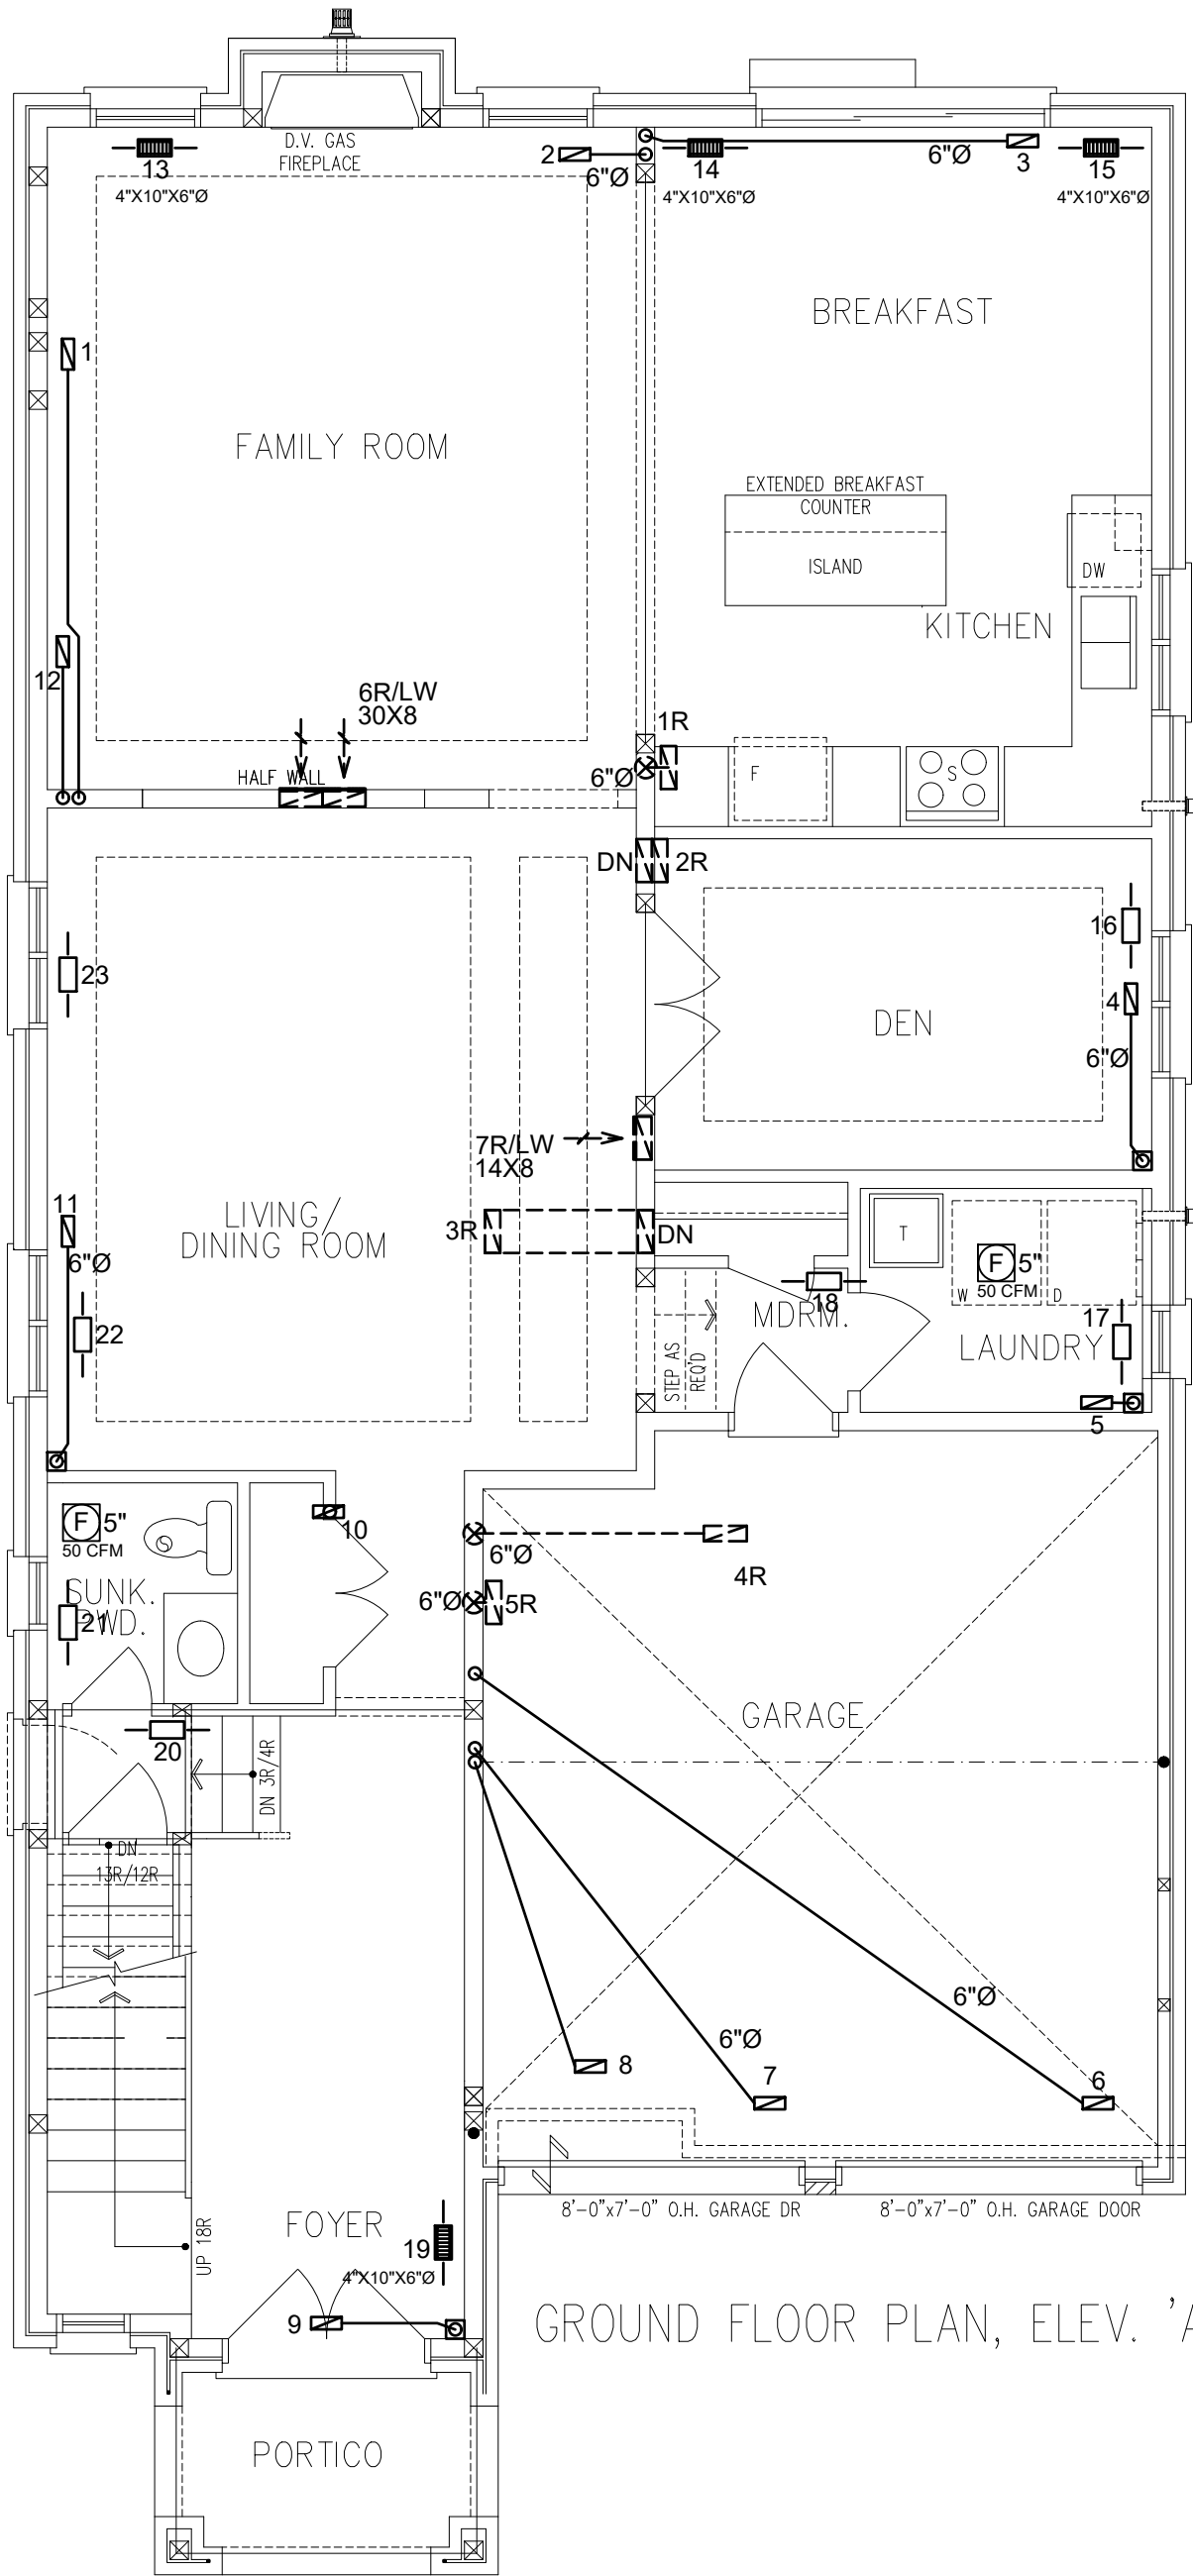


GROUND FLOOR PLAN, ELEV. 'A'

<table><tr><td>3RD</td><td># S/A</td><td># R/A</td><td># FANS</td></tr><tr><td>2ND</td><td>12</td><td>5</td><td>3</td></tr><tr><td>1ST</td><td>10</td><td>2</td><td>2</td></tr><tr><td>B</td><td>4</td><td>1</td><td>-</td></tr><tr><td>TOTAL</td><td>26</td><td>8</td><td>5</td></tr></table>				3RD	# S/A	# R/A	# FANS	2ND	12	5	3	1ST	10	2	2	B	4	1	-	TOTAL	26	8	5	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PROPOSED 1ST FLOOR <table><tr><td>DATE: JUN/2023</td><td>SCALE: 3/16"=1'-0"</td><td>DRAWN BY: MMA/MP</td></tr><tr><td colspan="3">SB-12 PERFORMANCE</td></tr><tr><td colspan="3">CSA F280-12</td></tr></table>			DATE: JUN/2023	SCALE: 3/16"=1'-0"	DRAWN BY: MMA/MP	SB-12 PERFORMANCE			CSA F280-12			
3RD	# S/A	# R/A	# FANS																																		
2ND	12	5	3																																		
1ST	10	2	2																																		
B	4	1	-																																		
TOTAL	26	8	5																																		
DATE: JUN/2023	SCALE: 3/16"=1'-0"	DRAWN BY: MMA/MP																																			
SB-12 PERFORMANCE																																					
CSA F280-12																																					
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum NAME SIGNATURE BCIN / BCDN 102614				<table><tr><td>TOTAL LOSS</td><td>53,902 BTUH</td><td>MODEL:</td><td colspan="3">Unit 4001 - Elev. A,B and C</td></tr><tr><td>TOTAL GAIN</td><td>32,617 BTUH</td><td>PROJECT #:</td><td>RP23050</td><td>SQFT: 3348</td><td>W%: 11.77</td></tr><tr><td>HEATING UNIT</td><td colspan="2">LENNOX</td><td>SITE:</td><td colspan="2">Forestside Estates</td></tr><tr><td>MODEL #</td><td>EL296UH070XE36B</td><td>3 TON</td><td>FOR:</td><td colspan="2">Forestside Estates</td></tr><tr><td>OUTPUT</td><td>64,000 BTUH</td><td>1145 CFM</td><td>BUILDER:</td><td colspan="2">Royal Pine Homes</td></tr></table>	TOTAL LOSS	53,902 BTUH	MODEL:	Unit 4001 - Elev. A,B and C			TOTAL GAIN	32,617 BTUH	PROJECT #:	RP23050	SQFT: 3348	W%: 11.77	HEATING UNIT	LENNOX		SITE:	Forestside Estates		MODEL #	EL296UH070XE36B	3 TON	FOR:	Forestside Estates		OUTPUT	64,000 BTUH	1145 CFM	BUILDER:	Royal Pine Homes		M C MCCALLUM HVAC DESIGN INC Brampton, Ontario, 905-840-8166, info@mccallumhvac.com M2		
TOTAL LOSS	53,902 BTUH	MODEL:	Unit 4001 - Elev. A,B and C																																		
TOTAL GAIN	32,617 BTUH	PROJECT #:	RP23050	SQFT: 3348	W%: 11.77																																
HEATING UNIT	LENNOX		SITE:	Forestside Estates																																	
MODEL #	EL296UH070XE36B	3 TON	FOR:	Forestside Estates																																	
OUTPUT	64,000 BTUH	1145 CFM	BUILDER:	Royal Pine Homes																																	

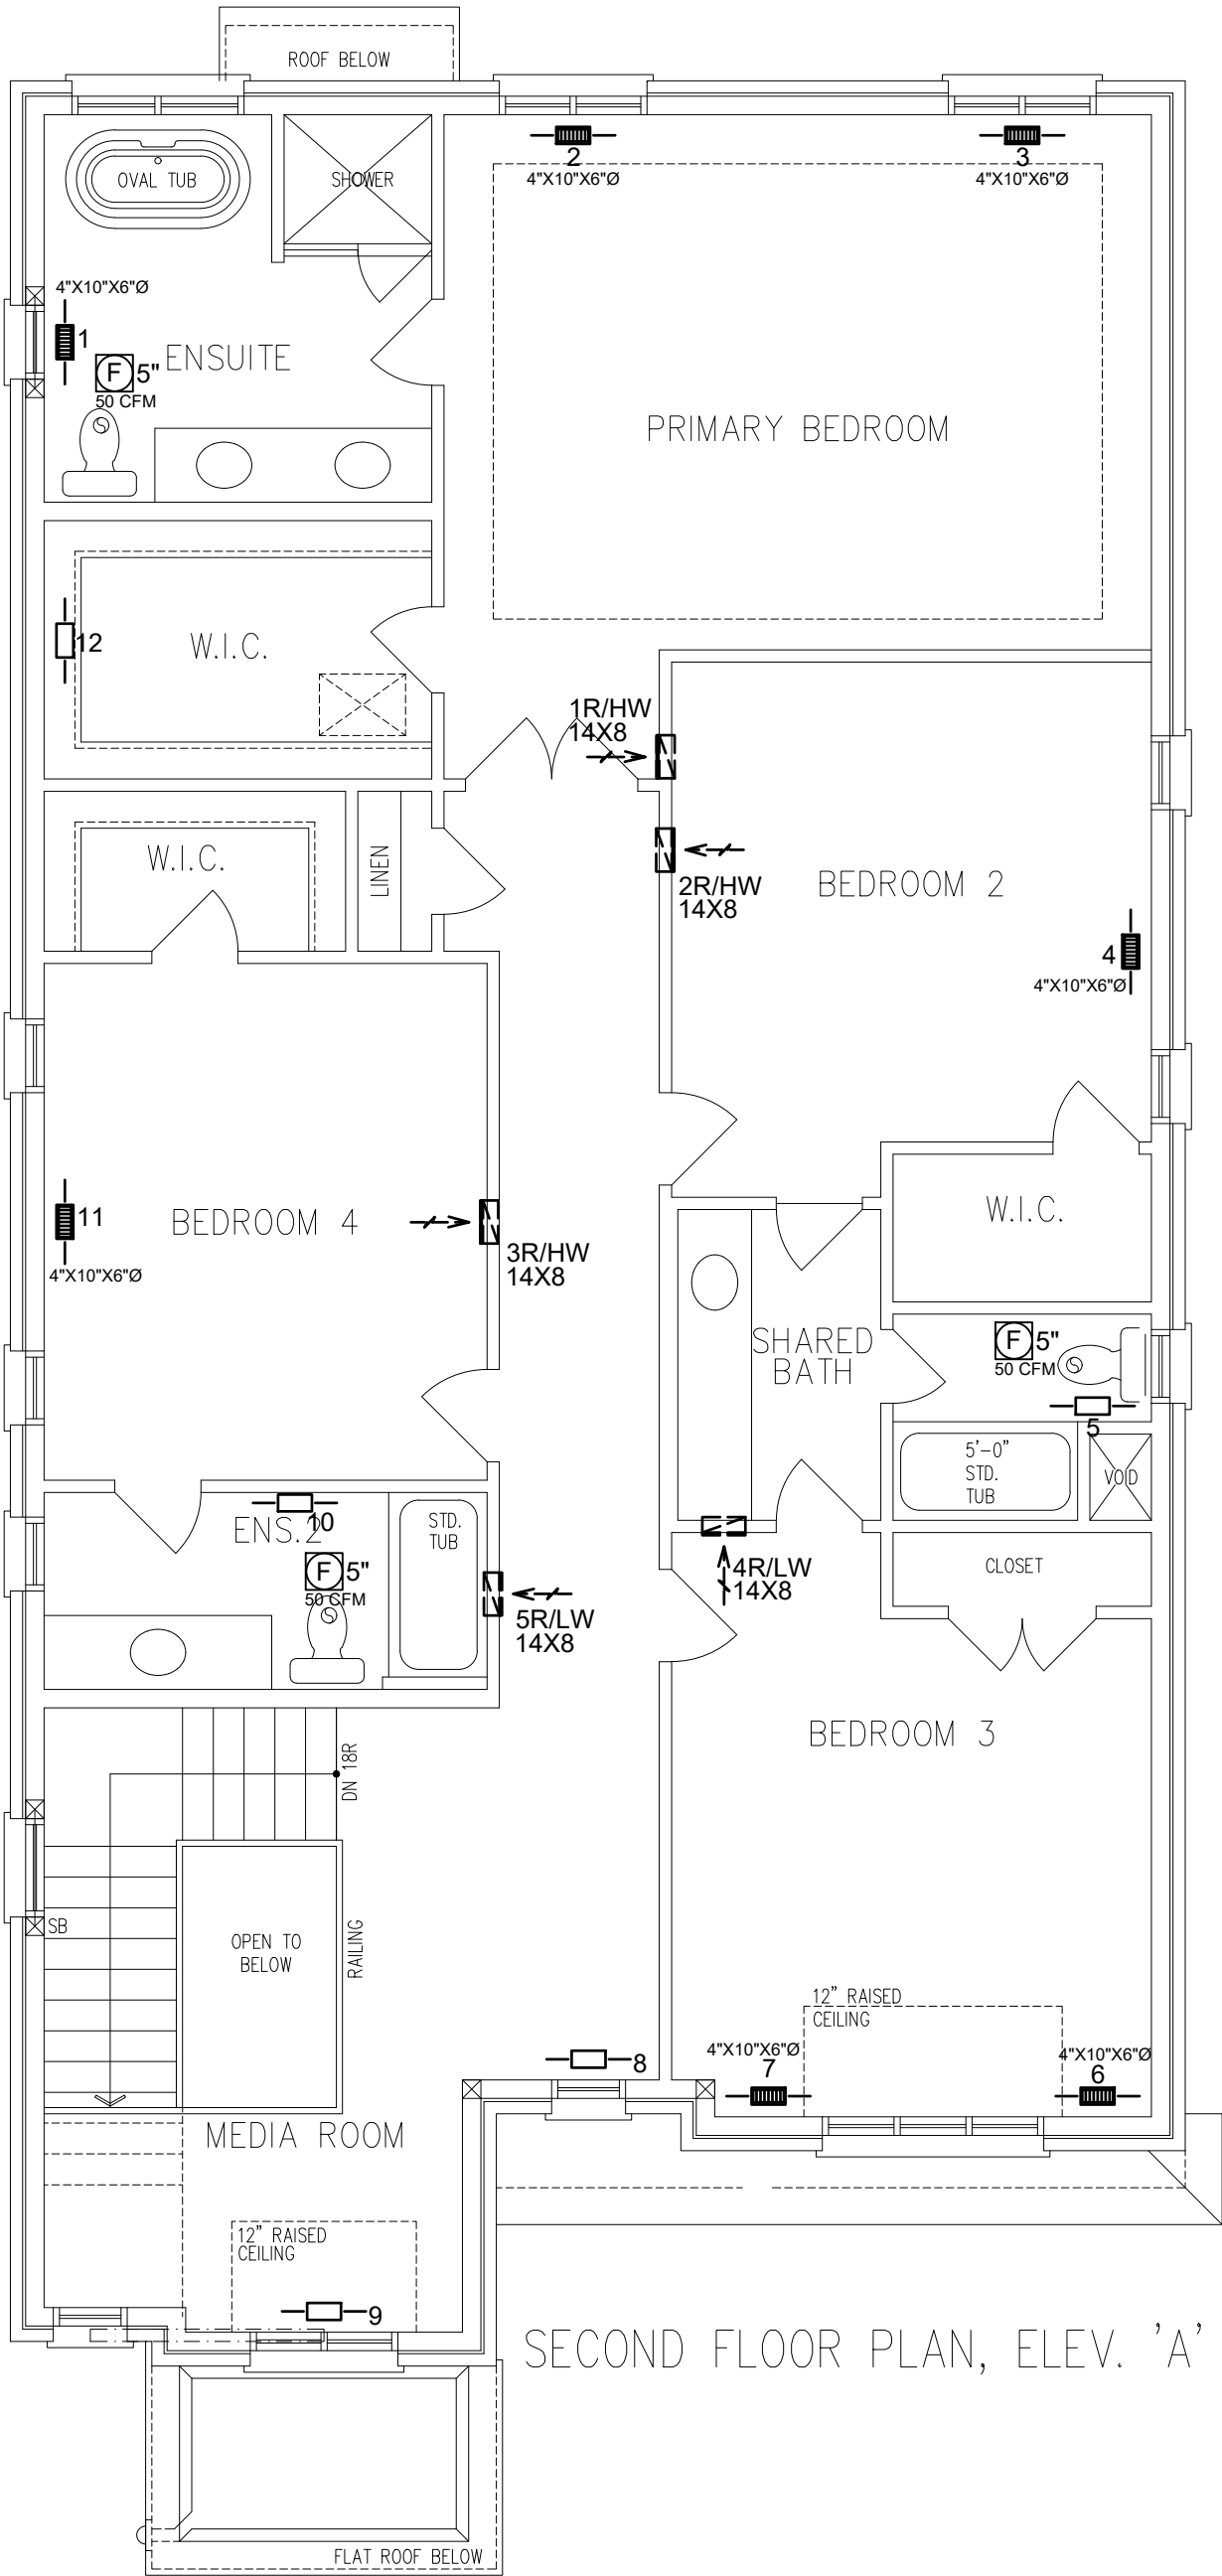


SECOND FLOOR PLAN, ELEV. 'A'


3RD	# S/A	# R/A	# FANS	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PROPOSED 2ND FLOOR DATE: JUN/2023SCALE: 3/16"=1'-0"DRAWN BY: MMA/MP SB-12 PERFORMANCE CSA F280-12				
2ND	12	5	3						
1ST	10	2	2						
B	4	1	-						
TOTAL	26	8	5						
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS	53,902 BTUH		MODEL:	Unit 4001 - Elev. A,B and C	
				TOTAL GAIN	32,617 BTUH		PROJECT #:	RP23050	SQFT: 3348 W%: 11.77
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum102614 NAMESIGNATUREBCIN / BCDN				HEATING UNIT	LENNOX		SITE:	Forestside Estates	
				MODEL #	EL296UH070XE36B	3 TON	FOR:	Forestside Estates	
				OUTPUT	64,000 BTUH	1145 CFM	BUILDER:	Royal Pine Homes	
				MCCALLUM HVAC DESIGN INC Brampton, Ontario, 905-840-8166, info@mccallumhvac.com M3					

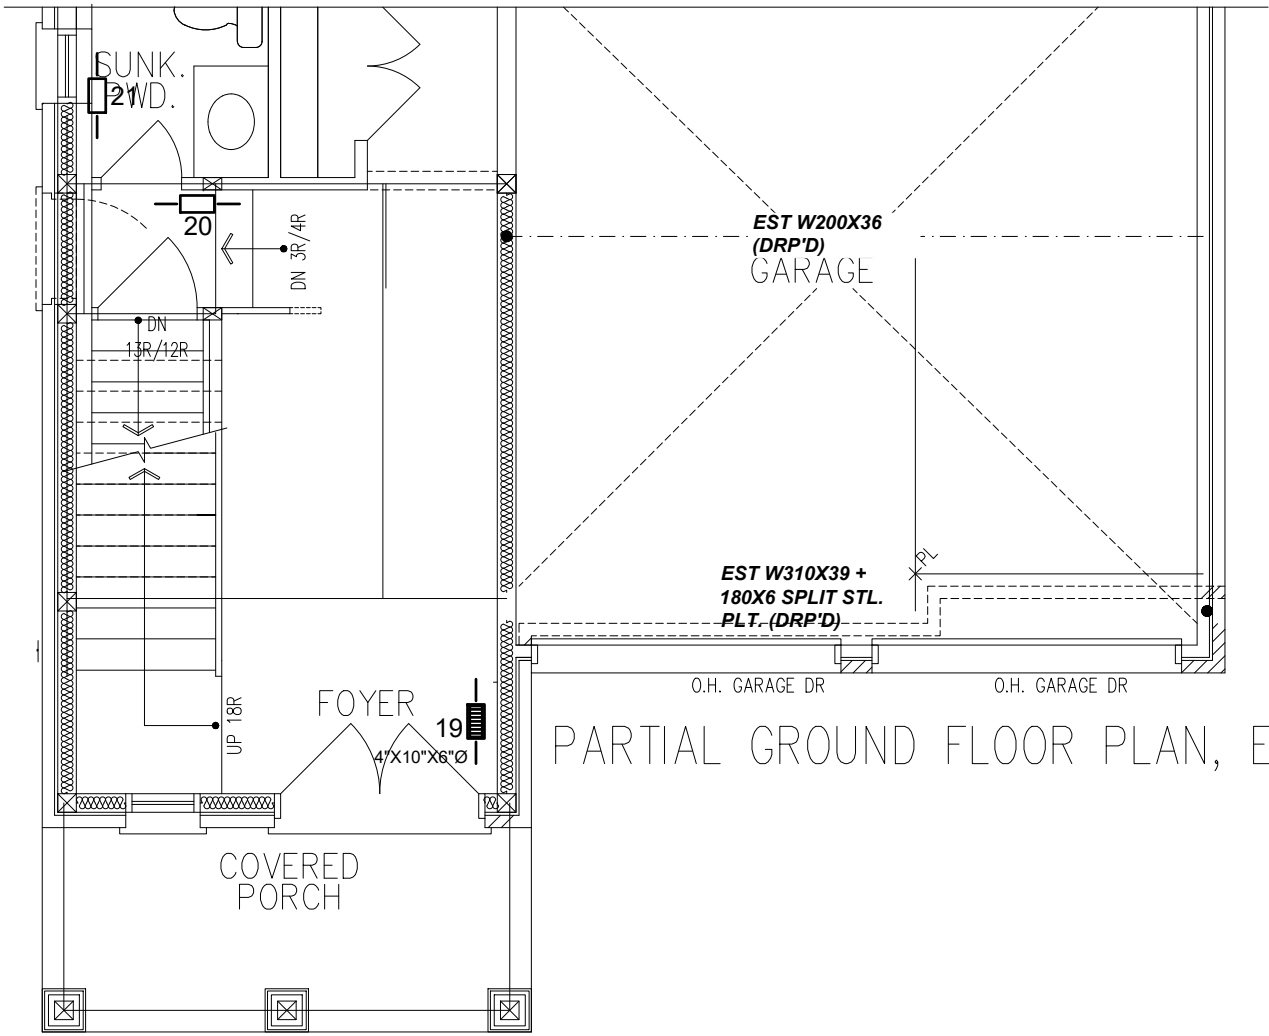


PARTIAL GROUND FLOOR PLAN, ELEV. 'B'

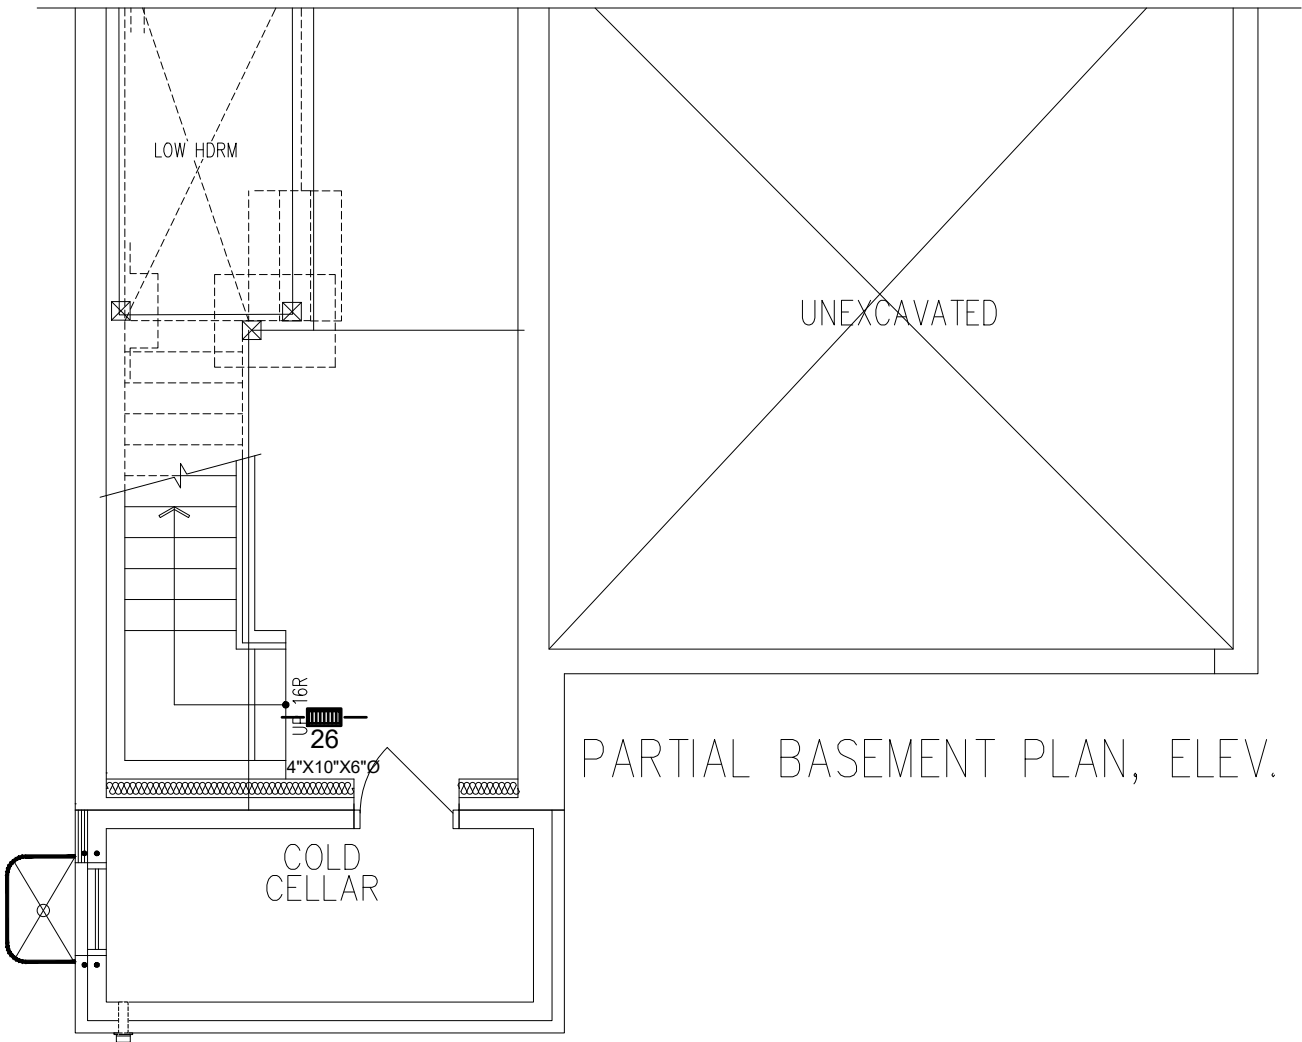


PARTIAL BASEMENT PLAN, ELEV. 'B'

<table><tr><td>3RD</td><td># S/A</td><td># R/A</td><td># FANS</td></tr><tr><td>2ND</td><td>12</td><td>5</td><td>3</td></tr><tr><td>1ST</td><td>10</td><td>2</td><td>2</td></tr><tr><td>B</td><td>4</td><td>1</td><td>-</td></tr><tr><td>TOTAL</td><td>26</td><td>8</td><td>5</td></tr></table>				3RD	# S/A	# R/A	# FANS	2ND	12	5	3	1ST	10	2	2	B	4	1	-	TOTAL	26	8	5	- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. - INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. - COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. - PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. - ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED - INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS - ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.				PARTIAL PLANS DATE: JUN/2023SCALE: 3/16"=1'-0"DRAWN BY: MMA/MP SB-12 PERFORMANCE CSA F280-12			
3RD	# S/A	# R/A	# FANS																												
2ND	12	5	3																												
1ST	10	2	2																												
B	4	1	-																												
TOTAL	26	8	5																												
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS		53,902 BTUH		MODEL:		Unit 4001 - Elev. A,B and C																					
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum  102614 NAMESIGNATUREBCIN / BCDN				TOTAL GAIN		32,617 BTUH		PROJECT #:		RP23050 SQFT: 3348 W%: 11.77																					
				HEATING UNIT		LENNOX		SITE:		Forestside Estates																					
				MODEL #		EL296UH070XE36B		3 TON		FOR:		Forestside Estates																			
				OUTPUT		64,000 BTUH		1145 CFM		BUILDER:		Royal Pine Homes																			

 Brampton, Ontario, 905-840-8166, info@mccallumhvac.com	M4
--	----

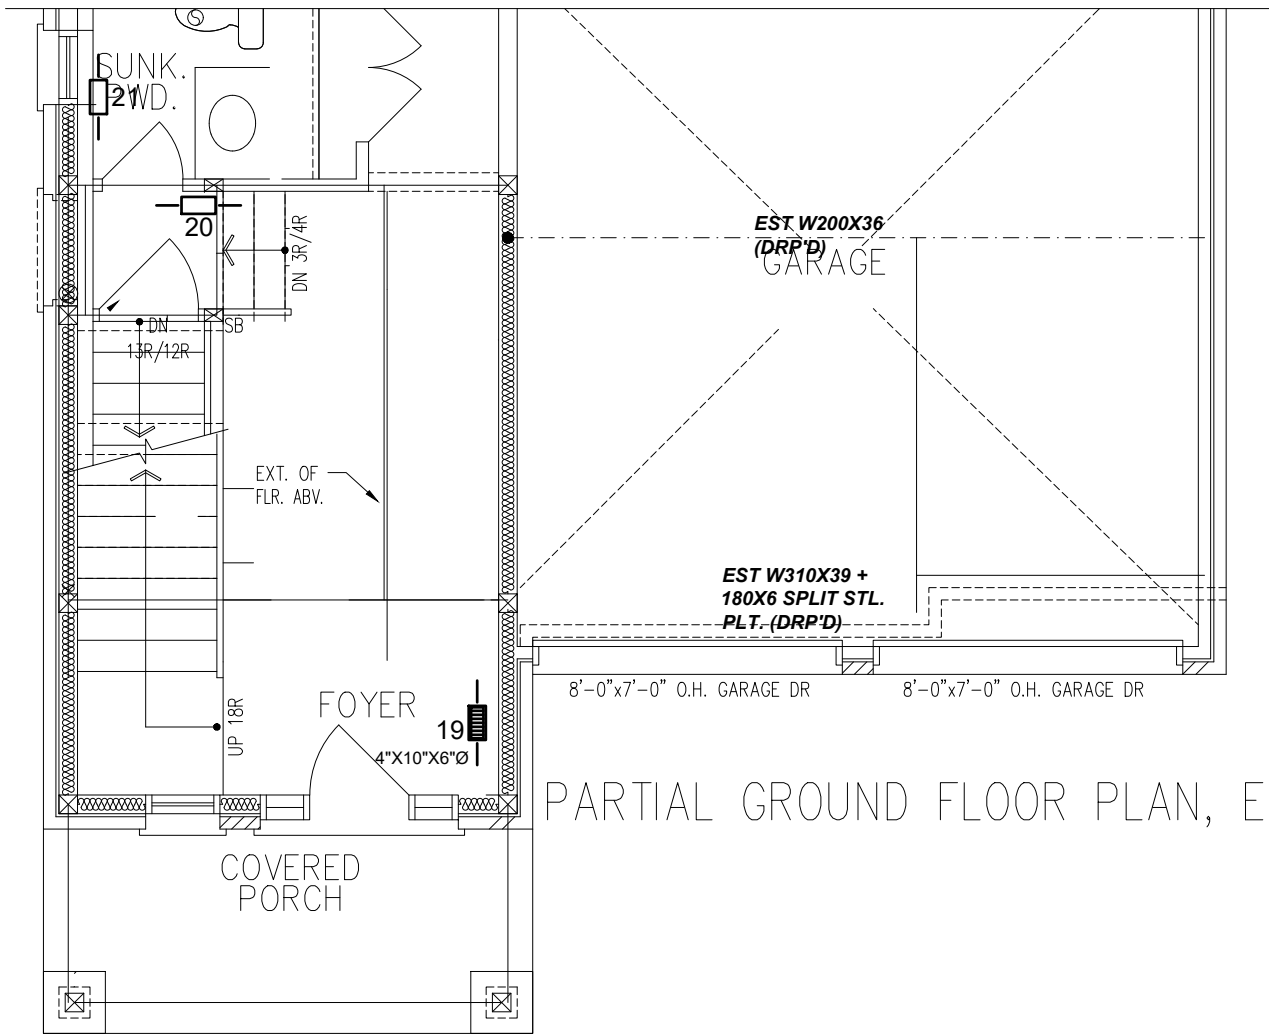

PARTIAL GROUND FLOOR PLAN, ELEV. 'C'

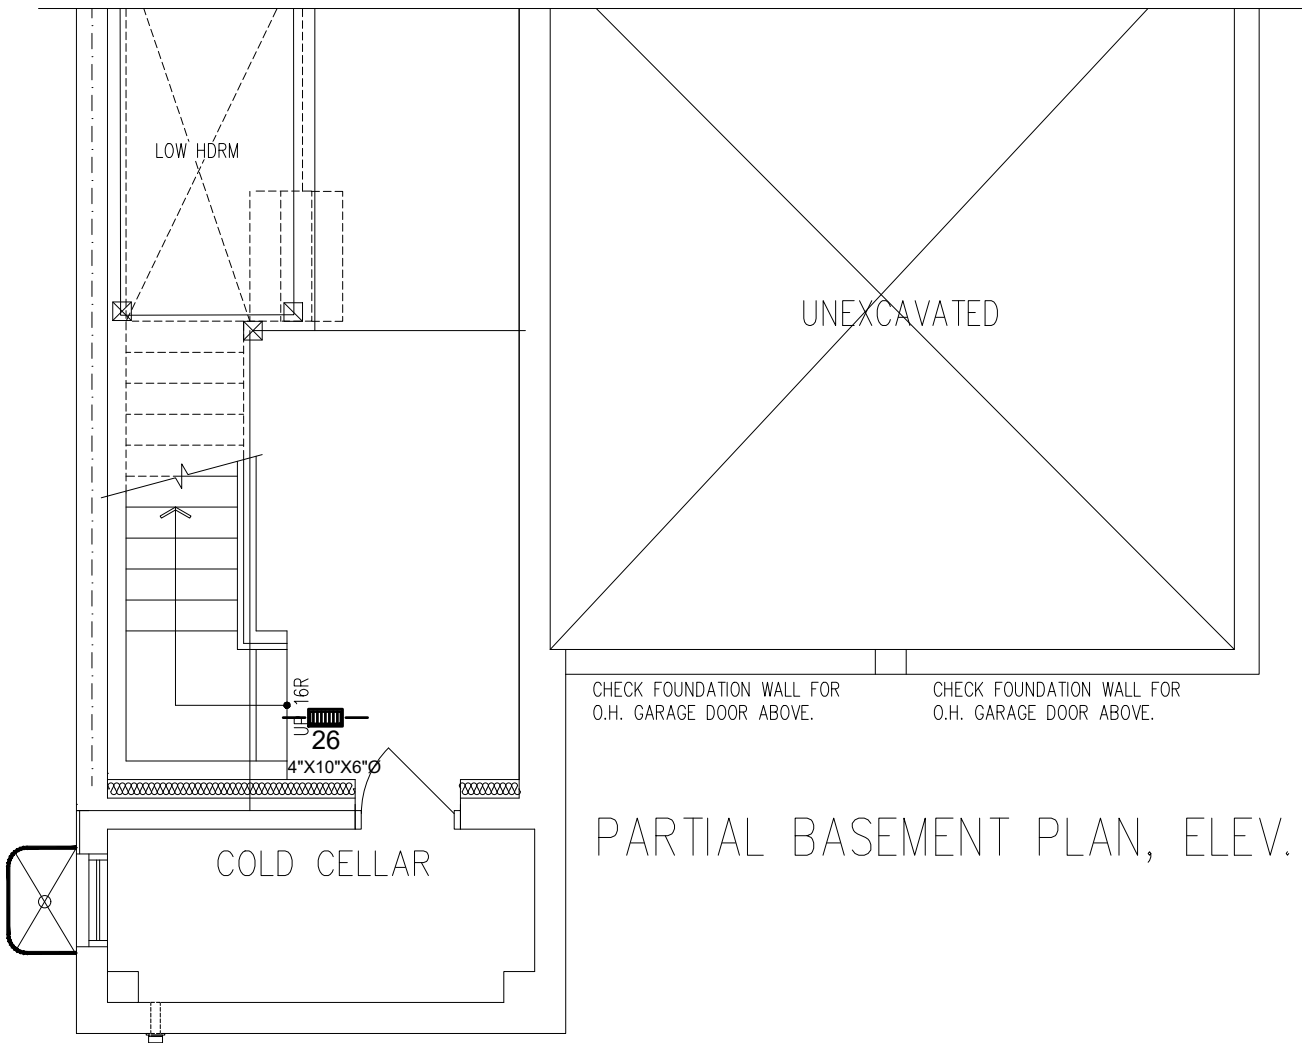

PARTIAL BASEMENT PLAN, ELEV. 'C'

3RD	# S/A	# R/A	# FANS	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.						
2ND	12	5	3							
1ST	10	2	2							
B	4	1	-							
TOTAL	26	8	5							
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum102614 NAMESIGNATUREBCIN / BCDN				TOTAL LOSS	53,902 BTUH		MODEL:	Unit 4001 - Elev. A,B and C		
				TOTAL GAIN	32,617 BTUH		PROJECT #:	RP23050	SQFT: 3348	W%: 11.77
				HEATING UNIT	LENNOX		SITE:	Forestside Estates		
				MODEL #	EL296UH070XE36B	3 TON	FOR:	Forestside Estates		
				OUTPUT	64,000 BTUH	1145 CFM	BUILDER:	Royal Pine Homes		

PARTIAL PLANS

DATE: JUN/2023SCALE: 3/16"=1'-0"DRAWN BY: MMA/MP

SB-12 PERFORMANCE

CSA F280-12



M

MCCALLUM

HVAC DESIGN INC

Brampton, Ontario, 905-840-8166, info@mccallumhvac.com

M5

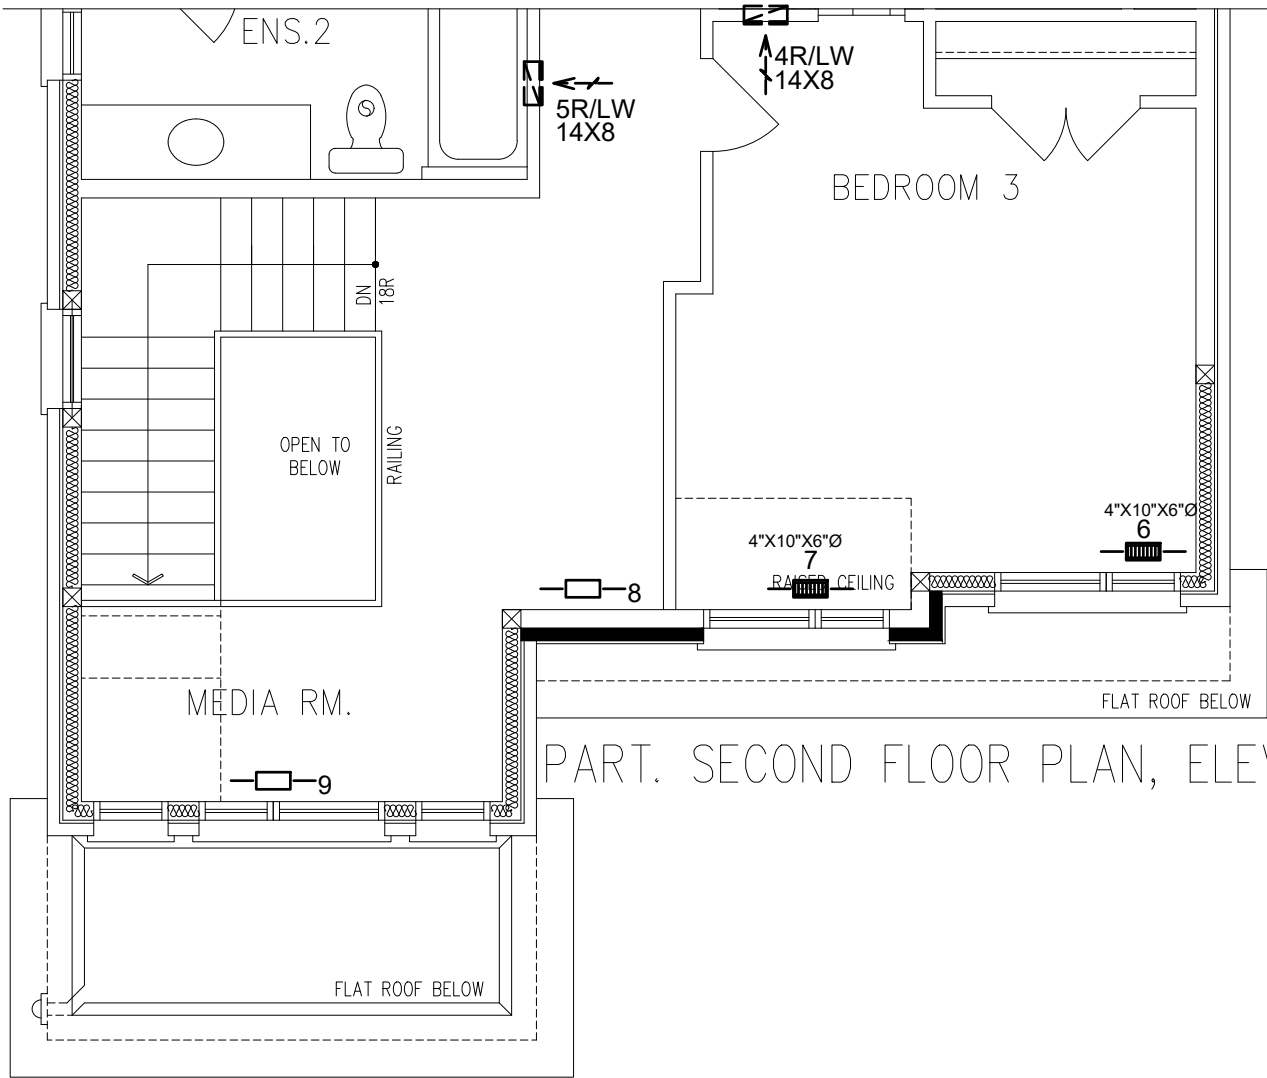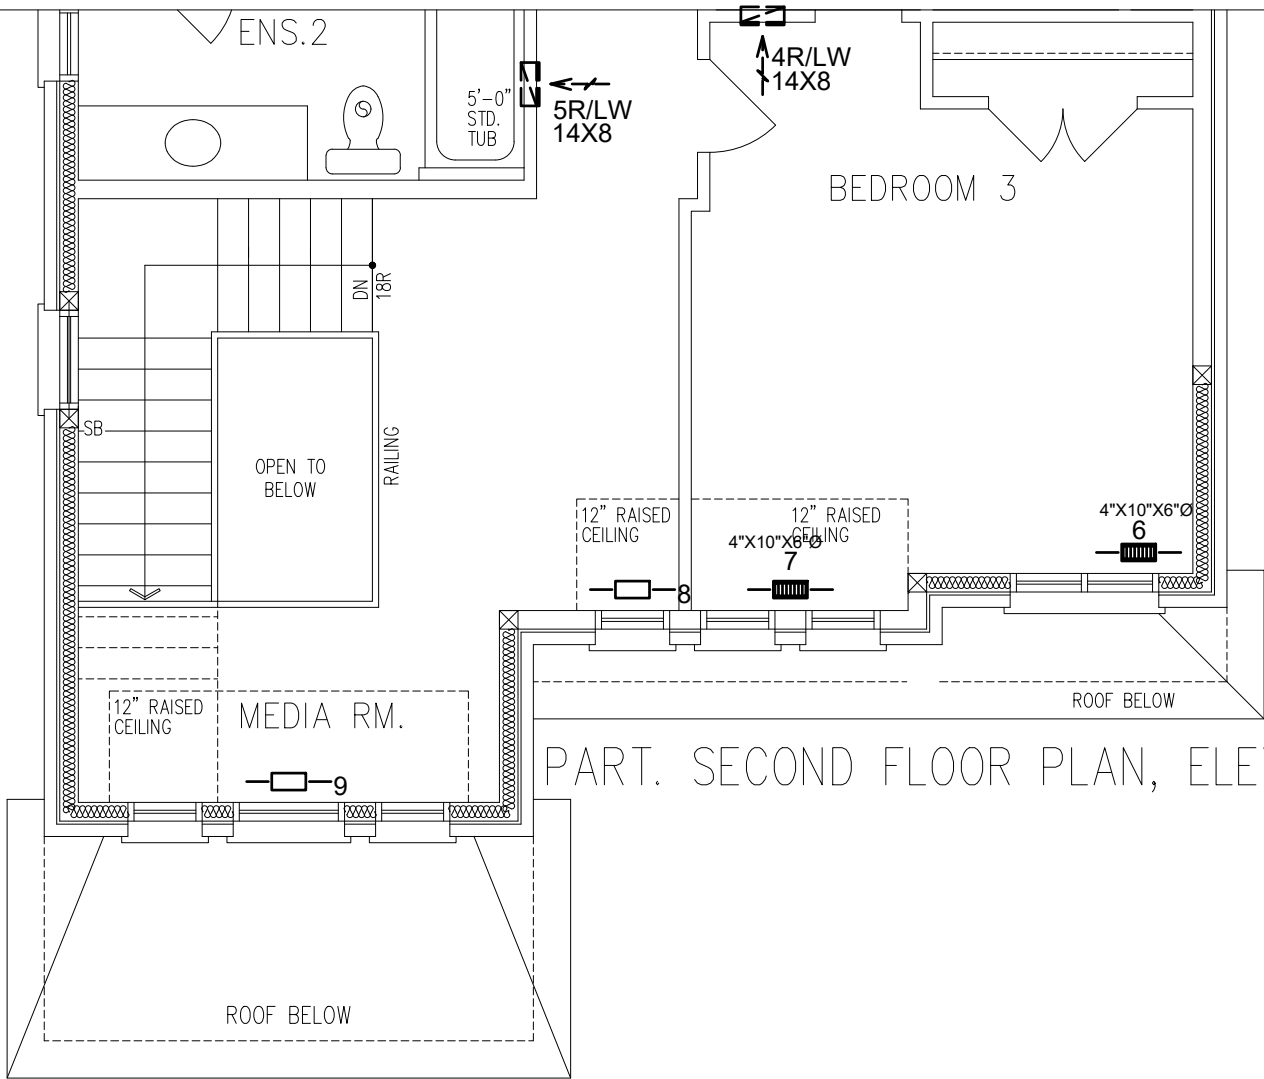

3RD	# S/A	# R/A	# FANS	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PARTIAL PLANS		
2ND	12	5	3		DATE: JUN/2023	SCALE: 3/16"=1'-0"	DRAWN BY: MMA/MP
1ST	10	2	2		SB-12 PERFORMANCE		
B	4	1	-		CSA F280-12		
TOTAL	26	8	5				
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS	53,902 BTUH		MODEL: Unit 4001 - Elev. A,B and C
				TOTAL GAIN	32,617 BTUH		PROJECT #: RP23050 SQFT: 3348 W%: 11.77
				HEATING UNIT	LENNOX		SITE: Forestside Estates
				MODEL #	EL296UH070XE36B	3 TON	FOR: Forestside Estates
				OUTPUT	64,000 BTUH	1145 CFM	BUILDER: Royal Pine Homes
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.				MCCALLUM HVAC DESIGN INC			
Doug McCallum				Brampton, Ontario, 905-840-8166, info@mccallumhvac.com			
NAME SIGNATURE BCIN / BCDN				M6			

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed		Lot: 4001	
Municipality Brampton		Postal code	Plan number/ other description
B. Individual who reviews and takes responsibility for design activities			
Name Doug McCallum		Firm McCallum HVAC Design Inc.	
Street address 2 Dewside Drive Unit 208		Unit no.	Lot/con.
Municipality Brampton	Postal code L6R 3Y5	Province Ontario	E-mail info@mccallumhvac.com
Telephone number (905) 840-8166	Fax number	Cell number (647) 229-0380	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 of Division C]			
House ☒	HVAC – House	Building Structural	
Small Buildings	Building Services	Plumbing – House	
Large Buildings	Detection, Lighting and Power	Plumbing – All Buildings	
Complex Buildings	Fire Protection	On-site Sewage Systems	
Description of designer's work		Model Certification	
Heating and Cooling Load Calculations Air System Design Residential mechanical ventilation Design Summary Residential System Design per CAN/CSA-F280-12 Residential New Construction - Forced Air		Project #: RP23050	
		Builder	Royal Pine Homes
		Project	Forestside Estates
		Model	Unit 4001 - Elev. A,B and C - Opt. 2nd
		SB-12	SB 12 Performance 28
D. Declaration of Designer			
I, <u>Doug McCallum</u> declare that (choose one as appropriate): (print name)			
☒ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 Division C of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: <u>25896</u> Firm BCIN: <u>102614</u>			
I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code. Individual BCIN: _____ Basis for exemption from registration: _____ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that: 1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
<u>2023-06-07</u> Date		 Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d), of Division C, Article 3.2.5.1. of Division C and all other persons who are exempt from qualifications under Subsections 3.2.4 . and 3.2.5. of Division C.
- Schedule 1 does not require to be completed a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited licence to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.



2 Dewside Drive Unit 208, Brampton, Ontario L6R 3Y5 Tel: 905-840-8166

e-mail - info@mccallumhvac.com

Heat loss and gain calculation summary sheet		CSA-F280-M12 Standard Form No. 1
These documents issued for the use of <u>Royal Pine Homes</u>		Project No. RP23050
and may not be used by any other persons without authorization. Documents for permit and/or construction are signed in red.		
Building Location		
Address (Model): Unit 4001 - Elev. A,B and C - Opt. 1	Site: Forestside Estates	
Model:	Lot: 4001	
City and Province: Brampton	Postal code:	
Calculations based on		
Dimensional information based on:		
Attachment: Detached	Front facing: East	Assumed? Yes
No. of Levels: 3 Ventilated? Included	Air tightness: -1	Assumed? Yes
Weather location: Brampton	Wind exposure: Shelterd	
HRV? VanEE 65H	Internal shading: Light-translucent	Occupants: 6
Sensible Eff. at -25C 60.0 % Apparent Effect. at -0C 75.0 %	Units: Imperial	
Heating design conditions		Cooling design conditions
Outdoor temp: -2.2°F Indoor temp: 72.0°F Mean soil temp: 48.2°F		Outdoor temp: 86.0°F Indoor temp: 72.0°F Latitude: 43.68
Above grade walls		Below grade walls
Style A: As per Selected OBC SB12 SB 1 R 22+1.	Style A: As per Selected OBC SB12 SB 1 R 20ci	
Style B: Existing Walls (When Applicable) R 8.50	Style B:	
Style C:	Style C:	
Style D:	Style D:	
Floors on soil		Ceilings
Style A: As per Selected OBC SB12 SB 12 F	Style A: As per Selected OBC SB12 SB 12 P R 60.0	
Style B:	Style B: As per Selected OBC SB12 SB 12 P R 22.8	
Exposed floors		Style C:
Style A: As per Selected OBC SB12 SB 12 R 31	Doors	
Style B:	Style A: As per Selected OBC SB12 SB 12 R 3.01	
Windows		Style B:
Style A: As per Selected OBC SB12 SB 12 I R 3.57	Style C:	
Style B: Existing Windows (When Applicable) R	Skylights	
Style C:	Style A: As per Selected OBC SB12 SB 12 R 2.04	
Style D:	Style B:	
Attached documents: As per Shedule 1		
Notes: Residential New Construction - Forced Air		
Calculations performed by		
Name: Doug McCallum	Postal code: L6R 3Y5	
Company: McCallum HVAC Design Inc.	Telephone: (905) 840-8166	
Address: 2 Dewside Drive Unit 208	Mobile: (647) 229-0380	
City: Brampton	E-mail: info@mccallumhvac.com	

Project: Forestside Estates

Model: Unit 4001 - Elev. A,B and C - Ont.

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

For systems serving one dwelling unit & conforming to the Ontario Building Code, O. reg 159/93

Location of Installation	
Lot #	Plan #
Township Brampton	
Roll #	Permit #
Address	

Total Ventilation Capacity 9.32.3.3(1)					
Bsmt & Master Bdrm	2	@ 21.2	cfm	42.4	cfm
Other Bedrooms	3	@ 10.6	cfm	31.8	cfm
Bathrooms & Kitchen	5	@ 10.6	cfm	53.0	cfm
Other rooms	5	@ 10.6	cfm	53.0	cfm
Total				<u>180.2</u>	

Builder	
Name	Royal Pine Homes
Address	
City	
Tel	Fax

Principal Ventilation Capacity 9.32.3.4(1)					
Master bedroom	1	@ 31.8	cfm	31.8	cfm
Other bedrooms	3	@ 15.9	cfm	47.7	cfm
Total				<u>79.5</u>	

Installing Contractor	
Name	
Address	
City	
Tel	Fax

Principal Exhaust Fan Capacity			
Make	Model	Location	
VanEE	65H	BASE	
129	cfm	64	Sones

Heat Recovery Ventilator			
Make	VanEE		
Model	65H		
	129	cfm high	64 cfm low
Sensible efficiency @ -25 deg C	60 %		
Sensible efficiency @ 0 deg C	75 %		


Combustion Appliances 9.32.3.1(1)	
a)	☒ Direct vent (sealed combustion) only
b)	☐ Positive venting induced draft (except fireplaces)
c)	☐ Natural draft, B-vent or induced draft fireplaces
d)	☐ Solid fuel (including fireplaces)
e)	☐ No combustion Appliances

Supplemental Ventilation Capacity	
Total ventilation capacity	180.2
Less principal exhaust capacity	79.5
REQUIRED supplemental vent. Capacity	<u>100.7</u> cfm

Heating System	
☒	Forced air
☐	Non forced air
☐	Electric space heat (if over 10% of heat load)

Supplemental Fans 9.32.3.5.			
Location	cfm	Model	Sones
ENSUITE	50	770	2.5
POWDER	50	770	2.5
		None	
		None	
all fans HVI listed		Make	Broan or Equiv.

House Type 9.32.3.1(2)	
I	☒ Type a) or b) appliances only, no solid fuel
II	☐ Type I except with solid fuel (including fireplace)
III	☐ Any type c) appliance
IV	☐ Type I or II either electric space heat
Other	☐ Type I, II or IV no forced air

Designer Certification		
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.		
Name	Doug McCallum	
Signature		
HRAI #	BCIN #	25896
Date	2023-06-07	

System Design Option	
1	☐ Exhaust only / forced air system
2	☐ HRV WITH DUCTING / forced air system
3	☒ HRV simplified connection to forced air system
4	☐ HRV full ducting/not coupled to forced air system
	☐ Part 6 design


Envelope Air Leakage Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Brampton			
Region:	ON			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavv			
Flue:	Heavv			
Highest Ceiling Height (m):	6.71			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1223			
Air Leakage/Ventilation				
Air Tightness Type:	Custom - DBT values			
Custom BDT Data:	ELA @ 10 Pa.		1547.929	
	3		ACH @ 50 Pa	
Mechanical Ventilation (L/s):	Total Supply:		Total Exhaust:	
	0		0	
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Envelope Air Leakage Rate				
Heating Air Leakage Rate (ACH/H):		0.340		
Cooling Air Leakage Rate (ACH/H):		0.118		

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

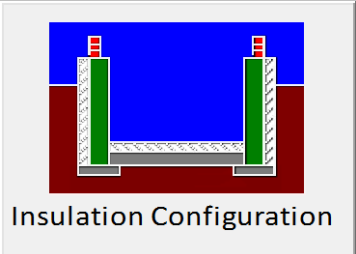Weather Station Description		
Province:	Brampton	
Region:	ON	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Deep (>10 m, >33 Ft)	
Foundation Dimensions		
Floor Length (m):	22.1	 Insulation Configuration BCIN_1
Floor Width (m):	5.64	
Exposed Perimeter (m):	55.4	
Wall Height (m):	3.05	
Depth Below Grade (m):	2.44	
Window Area (m ²):	1.49	
Door Area (m ²):	0	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	23	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1499	

SYSTEM A

DESIGN LOAD SPECIFICATIONS				AIR DISTRIBUTION AND PRESSURE			
LEVEL 1 NET LOAD	15513 btu/h			EQUIPMENT EXTERNAL STATIC PRESSURE	0.500"W.C.		
LEVEL 2 NET LOAD	20019 btu/h			ADDITIONAL EQUIPMENT PRESSURE DROP	0.250"W.C.		
LEVEL 3 NET LOAD	18523 btu/h			AVAILABLE DESIGN PRESSURE	0.250"W.C.		
LEVEL 4 NET LOAD	0 btu/h			RETURN BRANCH LONGEST EFFECTIVE LENGTH	300ft		
SYSTEM HEATLOSS	54055 btu/h			R/A PLENUM PRESSURE	0.120"W.C.		
SYSTEM HEATGAIN	33396 btu/h			S/A PLENUM PRESSURE	0.130"W.C.		
BUILDING VOLUME Vb	43187.00 ft3			HEATING AIR FLOW PROPORTIONING FACTOR	0.0212 cfm/btuh		
VENTILATION LOAD	1596.00 btu/h			COOLING AIR FLOW PROPORTIONING FACTOR	0.0343 cfm/btuh		
VENTILATION PVC	79.50 cfm			R/A TEMP. 70°F	S/A TEMP. 121.75°F	DIFFUSER LOSS 0.01"W.C.	
FURNACE/AIR HANDLER DATA				BLOWER DATA			
MAKE	LENNOX			HEATING CHECK	1150.00 CFM		
MODEL	EL296UH070XE36B			SELECTED CFM	1145.00 CFM		
HIGH INPUT btu/h	66000	LOW INPUT btu/h	0	COOLING CHECK	1143.00 CFM		
HIGH OUTPUT btu/h	64000	LOW OUTPUT btu/h	0	COOLING AIR FLOW RATE	1145.00 CFM		
E.S.P.	0.50			BLOWER TYPE ECM (BRUSHLESS DC OBC 12.3.1.5.(2))			
WATER TEMP.				A/C UNIT DATA			
AFUE	96.97%			MAKER	3.0 TON		
AUX. HEAT	0			CONDENSER	3.0 TON		
SB-12 PACKAGE	SB 12 Performance 28			COIL	3.0 TON		
TEMP. RISE	51.75°F						

SUPPLY BRANCH AND GRILL SIZING

OUTLET #	ROOM USE	BTU/H OUTLET	HEATING AIR FLOW RATE CFM	COOLING AIR FLOW RATE CFM	DUCT DESIGN PRESSURE	ACTUAL DUCT LENGTH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	DUCT SIZE ROUND	OUTLET SIZE	TRUNK
24	BASE	3877	81	38	0.13	45	175	220	0.05	6.0	4x10	A1
25	BASE	3877	81	38	0.13	38	115	153	0.08	6.0	4x10	B1
26	BASE	3877	81	38	0.13	51	145	196	0.06	6.0	4x10	C1
27	BASE	3877	81	38	0.13	23	175	198	0.06	6.0	4x10	D1
13	FAM ROOM	3167	66	76	0.13	49	175	224	0.05	6.0	4x10	A1
14	KIT/ BREK	2089	44	72	0.13	39	155	194	0.06	6.0	4x10	A1
15	KIT/ BREK	2089	44	72	0.13	50	175	225	0.05	6.0	4x10	A1
16	DEN	1087	23	46	0.13	30	165	195	0.06	5.0	4x10	B1
17	LAUD	1155	24	35	0.13	20	125	145	0.08	5	4x10	E1
19	FOYER	3917	82	44	0.13	48	155	203	0.06	6.0	4x10	C1
21	PWD	1276	27	15	0.13	40	135	175	0.07	5	4x10	D1
1	PRI. ENS	1943	41	52	0.13	46	175	221	0.05	6	4x10	B1
2	PRI. BED	1383	29	47	0.13	40	155	195	0.06	6	4x10	A1
3	PRI. BED	1383	29	47	0.13	48	145	193	0.06	6	4x10	A1
5	SHD BATH	937	20	12	0.13	18	150	168	0.07	5	4x10	E1
8	MEDIA RM	2038	43	54	0.13	45	185	230	0.05	6.0	4x10	C1
9	MEDIA RM	2038	43	54	0.13	54	155	209	0.06	5.0	4x10	C1
11	SHD BATH-2	674	14	15	0.13	38	165	203	0.06	5	4x10	B1
22	LIV/DIN	1316	27	36	0.13	31	165	196	0.06	5.0	4x10	D1
23	LIV/DIN	1316	27	36	0.13	29	155	184	0.07	5	4x10	B1
20	SIDE ENTR	1559	33	10	0.13	40	185	225	0.05	5.0	4x10	C1
18	MUD RM	1036	22	7	0.13	10	115	125	0.10	5	4x10	E1
28	M. WIC	338	7	4	0.13	34	155	189	0.06	5	4x10	B1
4	BED-2	1466	31	33	0.13	8	130	138	0.09	6	4x10	PL
6	BED-3	2183	46	71	0.13	53	145	198	0.06	6.0	4x10	D1
7	BED-3	2183	46	71	0.13	48	195	243	0.05	6.0	4x10	C1
12	BD-5	1277	27	40	0.13	39	185	224	0.05	6	4x10	B1

11	BED-4	1461	31	42	0.13	38	165	203	0.06	6	4x10	D1
----	-------	------	----	----	------	----	-----	-----	------	---	------	----

RETURN BRANCH AND GRILL SIZING

R/A INLET #	INLET AIR VOLUME CFM	DUCT DESIGN PRESSU RE	ACTUAL DUCT LENGTH	EQUIVAL ENT LENGTH	TOTAL EFFECTIV E LENGTH	ADJUSTE D PRESSU RE	DUCT SIZE ROUND	INLET SIZE	TRUNK
1R	70	0.12	40	160	200	0.05	6	14x8	Z1
2R	150	0.12	29	120	149	0.07	7.5	14x8	Z1
3R	145	0.12	44	160	204	0.05	8	14x8	Y1
4R	75	0.12	47	130	177	0.06	6	14x8	X1
5R	70	0.12	48	170	218	0.05	6	14x8	X1
6R	385	0.12	30	160	190	0.05	11.5	30X8	Z1
7R	140	0.12	32	120	152	0.07	7.5	14x8	Y1
8R	110	0.12	23	120	143	0.07	7	FLC	Y1

RETURN TRUNK DUCT SIZING

TRUNK	CFM	PRESSU RE	ROUND	RECT. SIZE	SIZE ALTERNA TE
DROP	1145	0.05		0	
Z1	1145	0.05	17	26x10	26x10
Y1	540	0.05	13	18x8	14x10
X1	145	0.05	8	8x8	10x6

SUPPLY TRUNK DUCT SIZING

TRUNK	CFM	PRESSU RE	ROUND	RECT. SIZE	SIZE ALTERNA TE
A1	293	0.05	10.5	12x8	16x6
B1	513	0.05	12.5	18x8	24x6
C1	328	0.05	10.5	12x8	16x6
D1	540	0.05	13	18x8	14x10
E1	1119	0.05	17	26x10	26x10
PL	31	0.09	4		

MCCALLUM
HVAC DESIGN INC.

LEVEL 1																																							
BASE		TOTALS H.L.: 15513 btuh						H.G.: 4482 btuh				AREA: 1341 ft2		Above Grade: 2		GROSS EXP. WALL NEW 364 ft EXIST 0 ft																							
	EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT																						
	NEW: 182 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2																				
Eff. R-V	21.12		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03																				
LOSS	3.5	0 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh																			
GAIN	0.7	231 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh																			
	DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS																						
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 8.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 4.0 ft2		EXIST: 0.0 ft2		NEW: 4 ft2		EXIST: 0 ft2																				
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99																				
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	166 btuh	37.3	0 btuh	0	0	0	0	20.8	83 btuh	37.3	0 btuh	20.8	83 btuh	37.3	0 btuh																			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	225 btuh	14.9	0 btuh	0	0	0	0	21.7	87 btuh	14.9	0 btuh	11.7	47 btuh	14.9	0 btuh																			
FUND. CONDUCTIVE HEATLOSS				5115 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE		APP. LOAD		DUCT PIPE L.															
TOTAL CONDUCTIVE				LOSS		5448 btuh		LOSS		1.7977		9794 btuh		LOSS		0.0000		0 btuh		LOSS		0.0		270.5 btuh		239		5530		LOSS		0%		0 btuh					
TOTAL CONDUCTIVE				GAIN		590 btuh		GAIN		0.0818		48 btuh		GAIN		0.0000		0 btuh		GAIN		0.08		45 btuh		0		0 btuh		50%		2765 btuh		GAIN		0%		0 btuh	
LEVEL 2																																							
FAM ROOM		TOTALS H.L.: 3169 btuh						H.G.: 2240 btuh				AREA: 295 ft2		C.Height: 11		GROSS EXP. WALL NEW 407 ft EXIST 0 ft																							
	EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT																						
	NEW: 37 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2																				
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03																				
LOSS	4.0	1510 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh																			
GAIN	0.8	285 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh																			
	DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS																						
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 30.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2																				
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99																				
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	624 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh																			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	845 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh																			
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE		APP. LOAD		DUCT PIPE L.															
TOTAL CONDUCTIVE				LOSS		2133 btuh		LOSS		0.4362		930 btuh		LOSS		0.0000		0 btuh		LOSS		0.0		105.9 btuh		239		5530		LOSS		0%		0 btuh					
TOTAL CONDUCTIVE				GAIN		1130 btuh		GAIN		0.0818		92 btuh		GAIN		0.0000		0 btuh		GAIN		0.08		86 btuh		0		0 btuh		8%		415 btuh		GAIN		0%		0 btuh	
KIT/BREK																																							

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C - Opt. 2nd floor - 5 bed
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12

GTA: 3348
LOT: 4001
SITE: Forestside Estates



LOSS	4.0	633 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	119 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 7 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	145 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	82 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	778 btuh	LOSS	0.4362	339 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	38.6 btuh	239	5530				
TOTAL CONDUCTIVE				GAIN	202 btuh	GAIN	0.0818	17 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	15 btuh	0	0 btuh	10%	553 btuh	LOSS	0%
FOYER				TOTALS H.L.: 3920 btuh				H.G.: 1288 btuh				AREA: 151 ft2				C.Height: 11				
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				
NEW: 39 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	1518 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	286 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 8.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 21 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	166 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	436 btuh	37.3	0 btuh
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	225 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	246 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	2638 btuh	LOSS	0.4362	1151 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	131.0 btuh	239	5530				
TOTAL CONDUCTIVE				GAIN	856 btuh	GAIN	0.0818	70 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	65 btuh	0	0 btuh	0%	0 btuh	LOSS	0%
PWD				TOTALS H.L.: 1277 btuh				H.G.: 432 btuh				AREA: 36 ft2				C.Height: 11				
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				
NEW: 7 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	196 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	37 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 7.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	145 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	152 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	859 btuh	LOSS	0.4362	375 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	42.7 btuh	239	5530				
TOTAL CONDUCTIVE				GAIN	287 btuh	GAIN	0.0818	23 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	22 btuh	0	0 btuh	0%	0 btuh	LOSS	0%
LIV/DIN				TOTALS H.L.: 2633 btuh				H.G.: 2115 btuh				AREA: 296 ft2				C.Height: 11				
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				
NEW: 25 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	941 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	178 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS				
NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 40.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2		
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	831 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	868 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				
TOTAL CONDUCTIVE				LOSS	1772 btuh	LOSS	0.4362	773 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	88.0 btuh	239	5530				
TOTAL CONDUCTIVE				GAIN	1046 btuh	GAIN	0.0818	86 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	80 btuh	0	0 btuh	8%	415 btuh	LOSS	0%
SIDE ENTR				TOTALS H.L.: 1560 btuh				H.G.: 298 btuh				AREA: 78 ft2				C.Height: 11				
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				
NEW: 14 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C - Opt. 2nd floor - 5 bed
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



FUND. CONDUCTIVE HEATLOSS		0 btuh		AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	1050 btuh	LOSS	0.4362	458 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	52.1 btuh	239		5530		LOSS	0%	0 btuh	LOSS	0%	0 btuh		
TOTAL CONDUCTIVE	GAIN	198 btuh	GAIN	0.0818	16 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	15 btuh	0		0 btuh		GAIN	0%	0 btuh	GAIN	0%	0 btuh		
MUD RM																							
				TOTALS H.L.: 1037 btuh				H.G.: 199 btuh				AREA: 25 ft2		C.Height: 11		GROSS EXP. WALL				NEW 66 ft		EXIST 0 ft	
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
		NEW: 6 ft		EXIST: 0 ft		NEW: 0		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2			
Eff. R-V	18.53	8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03					
LOSS	4.0	180 btuh	8.7	0 btuh	1.3	0 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	34 btuh	1.6	0 btuh	0.7	0 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
				DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
		NEW: 21.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2			
Eff. R-V	3.01	3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99					
LOSS	24.7	518 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	98 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS		0 btuh		AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	698 btuh	LOSS	0.4362	304 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	34.7 btuh	239		5530		LOSS	0%	0 btuh	LOSS	0%	0 btuh		
TOTAL CONDUCTIVE	GAIN	132 btuh	GAIN	0.0818	11 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	10 btuh	0		0 btuh		GAIN	0%	0 btuh	GAIN	0%	0 btuh		
LEVEL 3																							
PRI. ENS		TOTALS H.L.: 1849 btuh				H.G.: 1515 btuh				AREA: 117 ft2		C.Height: 8		GROSS EXP. WALL				NEW 176 ft		EXIST 0 ft			
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
		NEW: 22 ft		EXIST: 0 ft		NEW: 117 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2			
Eff. R-V	18.53	8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03					
LOSS	4.0	581 btuh	8.7	0 btuh	1.3	147 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	110 btuh	1.6	0 btuh	0.7	81 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
				DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 22.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 9.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2			
Eff. R-V	3.01	3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99					
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	457 btuh	37.3	0 btuh	0	0	0	0	20.8	187 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	620 btuh	14.9	0 btuh	0	0	0	0	21.7	195 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS		0 btuh		AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	1372 btuh	LOSS	0.2978	409 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	68.1 btuh	239		5530		LOSS	0%	0 btuh	LOSS	0%	0 btuh		
TOTAL CONDUCTIVE	GAIN	1006 btuh	GAIN	0.0818	82 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	77 btuh	0		0 btuh		GAIN	0%	0 btuh	GAIN	0%	0 btuh		
PRI. BED		TOTALS H.L.: 2634 btuh				H.G.: 2742 btuh				AREA: 259 ft2		C.Height: 8		GROSS EXP. WALL				NEW 248 ft		EXIST 0 ft			
				EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
		NEW: 31 ft		EXIST: 0 ft		NEW: 259 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2			
Eff. R-V	18.53	8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03					
LOSS	4.0	841 btuh	8.7	0 btuh	1.3	325 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh			
GAIN	0.8	159 btuh	1.6	0 btuh	0.7	179 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh			
				DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 38.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2			
Eff. R-V	3.01	3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99					
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	790 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh			
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1071 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh			
FUND. CONDUCTIVE HEATLOSS		0 btuh		AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.				
TOTAL CONDUCTIVE	LOSS	1955 btuh	LOSS	0.2978	582 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	97.1 btuh	239		5530		LOSS	0%	0 btuh	LOSS	0%	0 btuh		
TOTAL CONDUCTIVE	GAIN	1409 btuh	GAIN	0.0818	115 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	107 btuh	2		478 btuh		GAIN	0%	0 btuh	GAIN	0%	0 btuh		
SHD BATH		TOTALS H.L.: 914 btuh				H.G.: 358 btuh				AREA: 112 ft2		C.Height: 8		GROSS EXP. WALL				NEW 48 ft		EXIST 0 ft			

**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and CLIENT: Royal Pine Homes
C - Opt. 2nd floor - 5 bed
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12
GTA: 3348
LOT: 4001
SITE: Forestside Estates



	NEW: 40 ft		EXIST: 0 ft		NEW: 249 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 54 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2								
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03								
LOSS	4.0	1065 btuh	8.7	0 btuh	1.3	312 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	134 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh							
GAIN	0.8	201 btuh	1.6	0 btuh	0.7	172 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	14 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh							
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS									
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 54.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2								
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99								
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	1122 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh							
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1522 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh							
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE									
TOTAL CONDUCTIVE		LOSS	2634 btuh		LOSS	0.2978	784 btuh		LOSS	0.0000	0 btuh		LOSS	0.0	130.8 btuh		239	5530		LOSS	10%						
TOTAL CONDUCTIVE		GAIN	1909 btuh		GAIN	0.0818	156 btuh		GAIN	0.0000	0 btuh		GAIN	0.08	146 btuh		0	0 btuh		GAIN	10%						
SHD BATH-2		TOTALS H.L.: 644 btuh				H.G.: 434 btuh				AREA: 82 ft2		C.Height: 8		GROSS EXP. WALL				NEW 56 ft		EXIST 0 ft							
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT									
	NEW: 7 ft		EXIST: 0 ft		NEW: 82 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2								
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03								
LOSS	4.0	188 btuh	8.7	0 btuh	1.3	103 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh							
GAIN	0.8	36 btuh	1.6	0 btuh	0.7	57 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh							
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS									
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 9.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2								
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99								
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	187 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh							
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	195 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh							
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE									
TOTAL CONDUCTIVE		LOSS	478 btuh		LOSS	0.2978	142 btuh		LOSS	0.0000	0 btuh		LOSS	0.0	23.7 btuh		239	5530		LOSS	0%						
TOTAL CONDUCTIVE		GAIN	288 btuh		GAIN	0.0818	24 btuh		GAIN	0.0000	0 btuh		GAIN	0.08	22 btuh		0	0 btuh		GAIN	0%						
M. WIC		TOTALS H.L.: 316 btuh				H.G.: 107 btuh				AREA: 59 ft2		C.Height: 8		GROSS EXP. WALL				NEW 40 ft		EXIST 0 ft							
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT									
	NEW: 5 ft		EXIST: 0 ft		NEW: 59 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2								
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03								
LOSS	4.0	160 btuh	8.7	0 btuh	1.3	74 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh							
GAIN	0.8	30 btuh	1.6	0 btuh	0.7	41 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh							
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS									
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2								
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99								
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh							
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh							
FUND. CONDUCTIVE HEATLOSS		0 btuh				AIR LEAKAGE NEW				AIR LEAKAGE EXIST				VENTILATION CASE 3				H.G. PEOPLE									
TOTAL CONDUCTIVE		LOSS	234 btuh		LOSS	0.2978	70 btuh		LOSS	0.0000	0 btuh		LOSS	0.0	11.6 btuh		239	5530		LOSS	0%						
TOTAL CONDUCTIVE		GAIN	71 btuh		GAIN	0.0818	6 btuh		GAIN	0.0000	0 btuh		GAIN	0.08	5 btuh		0	0 btuh		GAIN	0%						
BED-2		TOTALS H.L.: 1404 btuh				H.G.: 961 btuh				AREA: 207 ft2		C.Height: 8		GROSS EXP. WALL				NEW 120 ft		EXIST 0 ft							
		EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT									
	NEW: 15 ft		EXIST: 0 ft		NEW: 207 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2								
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03								
LOSS	4.0	408 btuh	8.7	0 btuh	1.3	259 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh							
GAIN	0.8	77 btuh	1.6	0 btuh	0.7	143 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh							
		DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS									
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2																						


**HEATLOSS/GAIN
CALCULATIONS
CSA-F280-12**

ADDRESS/MODEL: Unit 4001 - Elev. A,B and
C - Opt. 2nd floor - 5 bed
PROJECT #: RP23050
COMPLIANCE PACKAGE: SB 12

CLIENT: Royal Pine Homes
GTA: 3348
LOT: 4001
SITE: Forestside Estates



LOSS	24.7	0 btuh	24.7	0 btuh	20.8	1455 btuh	37.3	0 btuh	0	0	0	0	20.8	0 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	1972 btuh	14.9	0 btuh	0	0	0	0	21.7	0 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh	AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.		
TOTAL CONDUCTIVE			LOSS	2873 btuh	LOSS	0.2978	856 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	142.7 btuh	239		5530		LOSS	10%	373 btuh
TOTAL CONDUCTIVE			GAIN	2300 btuh	GAIN	0.0818	188 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	175 btuh	1	239 btuh	0%	0 btuh	GAIN	10%	254 btuh
BD-5		TOTALS H.L.: 1227 btuh				H.G.: 1175 btuh				AREA: 179 ft2		C.Height: 8		GROSS EXP. WALL			NEW 96 ft		EXIST 0 ft	
	EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 12 ft		EXIST: 0 ft		NEW: 179 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2	
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	312 btuh	8.7	0 btuh	1.3	224 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	59 btuh	1.6	0 btuh	0.7	124 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
	DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 18.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2	
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	374 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	391 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh	AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.		
TOTAL CONDUCTIVE			LOSS	911 btuh	LOSS	0.2978	271 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	45.2 btuh	239		5530		LOSS	0%	0 btuh
TOTAL CONDUCTIVE			GAIN	574 btuh	GAIN	0.0818	47 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	44 btuh	1	239 btuh	0%	0 btuh	GAIN	0%	0 btuh
BED-4		TOTALS H.L.: 1399 btuh				H.G.: 1227 btuh				AREA: 204 ft2		C.Height: 8		GROSS EXP. WALL			NEW 120 ft		EXIST 0 ft	
	EXPOSED WALLS				EXPOSED CEILING W/ATTIC				EXPOSED CEILING NO ATTIC				EXPOSED FLOORS				SKYLIGHT			
	NEW: 15 ft		EXIST: 0 ft		NEW: 204 ft2		EXIST: 0		NEW: 0		EXIST: 0		NEW: 0 ft2		EXIST: 0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2	
Eff. R-V	18.53		8.50		59.22		22.86		27.65		22.05		29.80		22.05		2.04		2.03	
LOSS	4.0	408 btuh	8.7	0 btuh	1.3	256 btuh	3.2	0 btuh	2.7	0 btuh	3.4	0 btuh	2.5	0 btuh	3.4	0 btuh	36.4	0 btuh	37	0 btuh
GAIN	0.8	77 btuh	1.6	0 btuh	0.7	141 btuh	1.8	0 btuh	1.5	0 btuh	1.9	0 btuh	0.3	0 btuh	0.4	0 btuh	89.7	0 btuh	14.7	0 btuh
	DOORS				EAST/WEST WINDOWS				SE/SW WINDOWS				SOUTH WINDOWS				NORTH WINDOWS			
	NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW: 0.0 ft2		EXIST: 0.0 ft2		NEW:		EXIST:		NEW: 18.0 ft2		EXIST: 0.0 ft2		NEW: 0 ft2		EXIST: 0 ft2	
Eff. R-V	3.01		3.01		3.57		1.99		0		0		3.57		1.99		3.57		1.99	
LOSS	24.7	0 btuh	24.7	0 btuh	20.8	0 btuh	37.3	0 btuh	0	0	0	0	20.8	374 btuh	37.3	0 btuh	20.8	0 btuh	37.3	0 btuh
GAIN	4.7	0 btuh	4.7	0 btuh	28.2	0 btuh	14.9	0 btuh	0	0	0	0	21.7	391 btuh	14.9	0 btuh	11.7	0 btuh	14.9	0 btuh
FUND. CONDUCTIVE HEATLOSS				0 btuh	AIR LEAKAGE NEW			AIR LEAKAGE EXIST			VENTILATION CASE 3			H.G. PEOPLE		APP. LOAD		DUCT PIPE L.		
TOTAL CONDUCTIVE			LOSS	1038 btuh	LOSS	0.2978	309 btuh	LOSS	0.0000	0 btuh	LOSS	0.0	51.5 btuh	239		5530		LOSS	0%	0 btuh
TOTAL CONDUCTIVE			GAIN	609 btuh	GAIN	0.0818	50 btuh	GAIN	0.0000	0 btuh	GAIN	0.08	46 btuh	1	239 btuh	0%	0 btuh	GAIN	0%	0 btuh
LEVEL 4																				

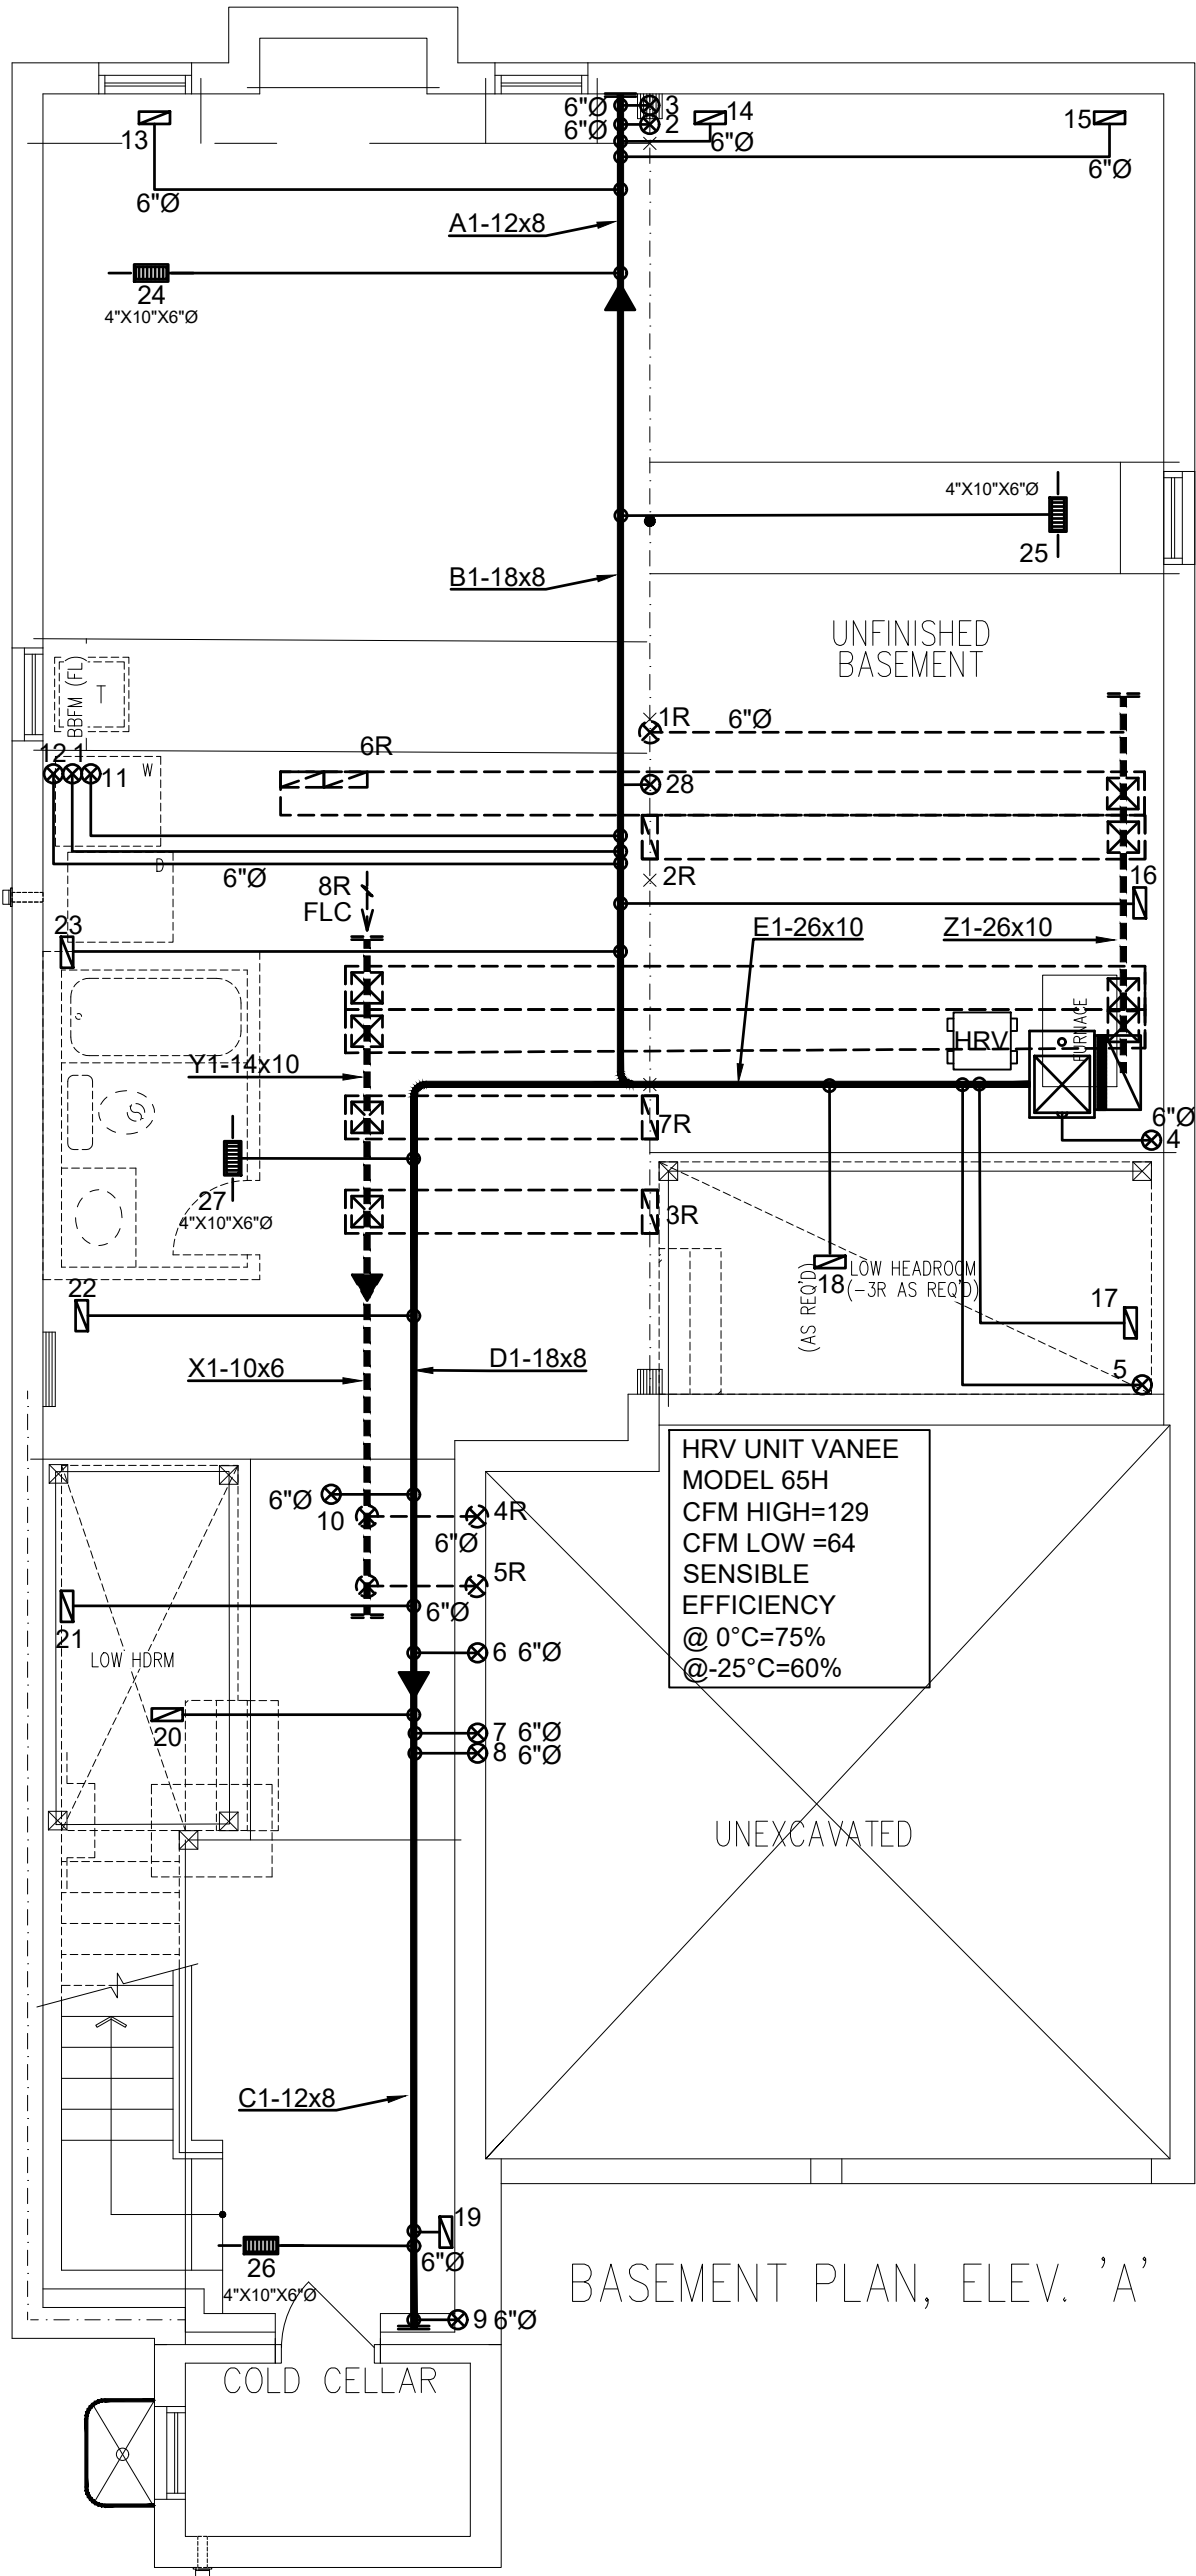

BASEMENT PLAN, ELEV. 'A'

3RD	# S/A	# R/A	# FANS
2ND	13	5	3
1ST	11	2	2
B	4	1	-
TOTAL	28	8	5

- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS.
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
- COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION.
- PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS.
- ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS
- ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.

PROPOSED BASEMENT

DATE: JUN/2023 SCALE: 3/16"=1'-0" DRAWN BY: MMA/MP

SB-12 PERFORMANCE
CSA F280-12

CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY		
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.		
Doug McCallum		102614
NAME	SIGNATURE	BCIN / BCDN


TOTAL LOSS	54,055 BTUH	
TOTAL GAIN	33,396 BTUH	
HEATING UNIT	LENNOX	
MODEL #	EL296UH070XE36B	3 TON
OUTPUT	64,000 BTUH	1145 CFM

MODEL:	Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed		
PROJECT #:	RP23050	SQFT: 3348	W%: 11.77
SITE:	Forestside Estates		
FOR:	Forestside Estates		
BUILDER:	Royal Pine Homes		




Brampton, Ontario, 905-840-8166, info@mccallumhvac.com

M1

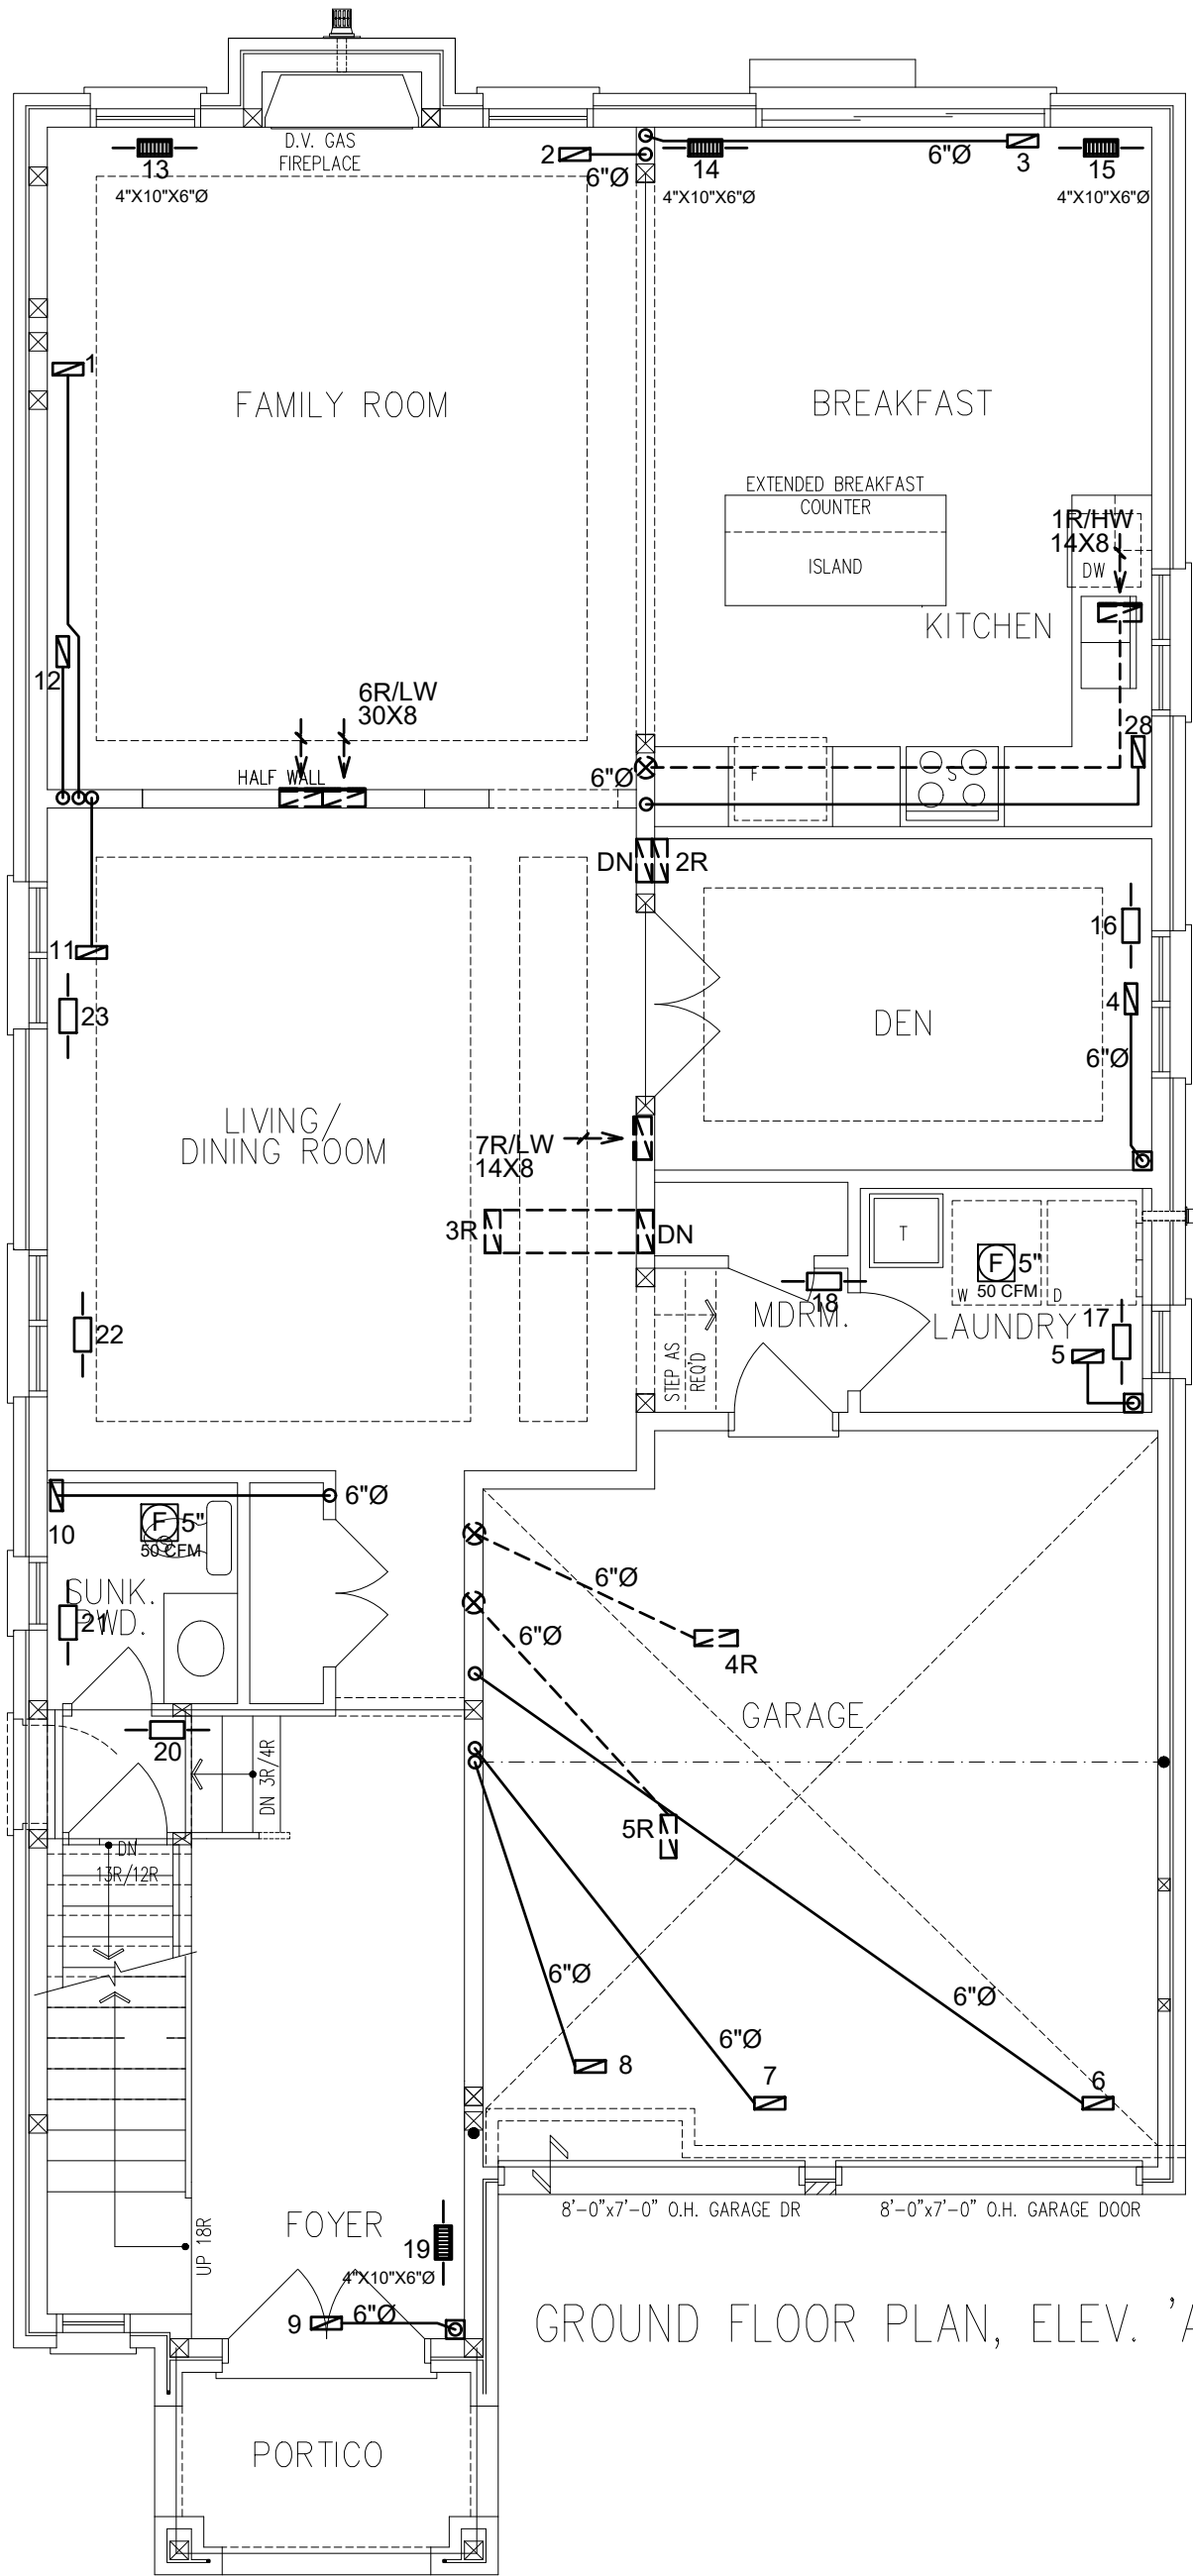

GROUND FLOOR PLAN, ELEV. 'A'

3RD			# S/A	# R/A	# FANS	- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. - COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. - PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. - ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED - INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS - ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PROPOSED 1ST FLOOR							
2ND			13	5	3		DATE: JUN/2023	SCALE: 3/16"=1'-0"	DRAWN BY: MMA/MP					
1ST			11	2	2		SB-12 PERFORMANCE							
B			4	1	-		CSA F280-12							
TOTAL			28	8	5									
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY						TOTAL LOSS	54,055 BTUH		MODEL:	Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed				
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum NAME SIGNATURE BCIN / BCDN 102614						TOTAL GAIN	33,396 BTUH		PROJECT #:	RP23050 SQFT: 3348 W%: 11.77				
						HEATING UNIT	LENNOX				SITE:	Forestside Estates		
						MODEL #	EL296UH070XE36B		3 TON	FOR:	Forestside Estates			
						OUTPUT	64,000 BTUH		1145 CFM	BUILDER:	Royal Pine Homes			
						M MCCALLUM HVAC DESIGN INC Brampton, Ontario, 905-840-8166, info@mccallumhvac.com M2								

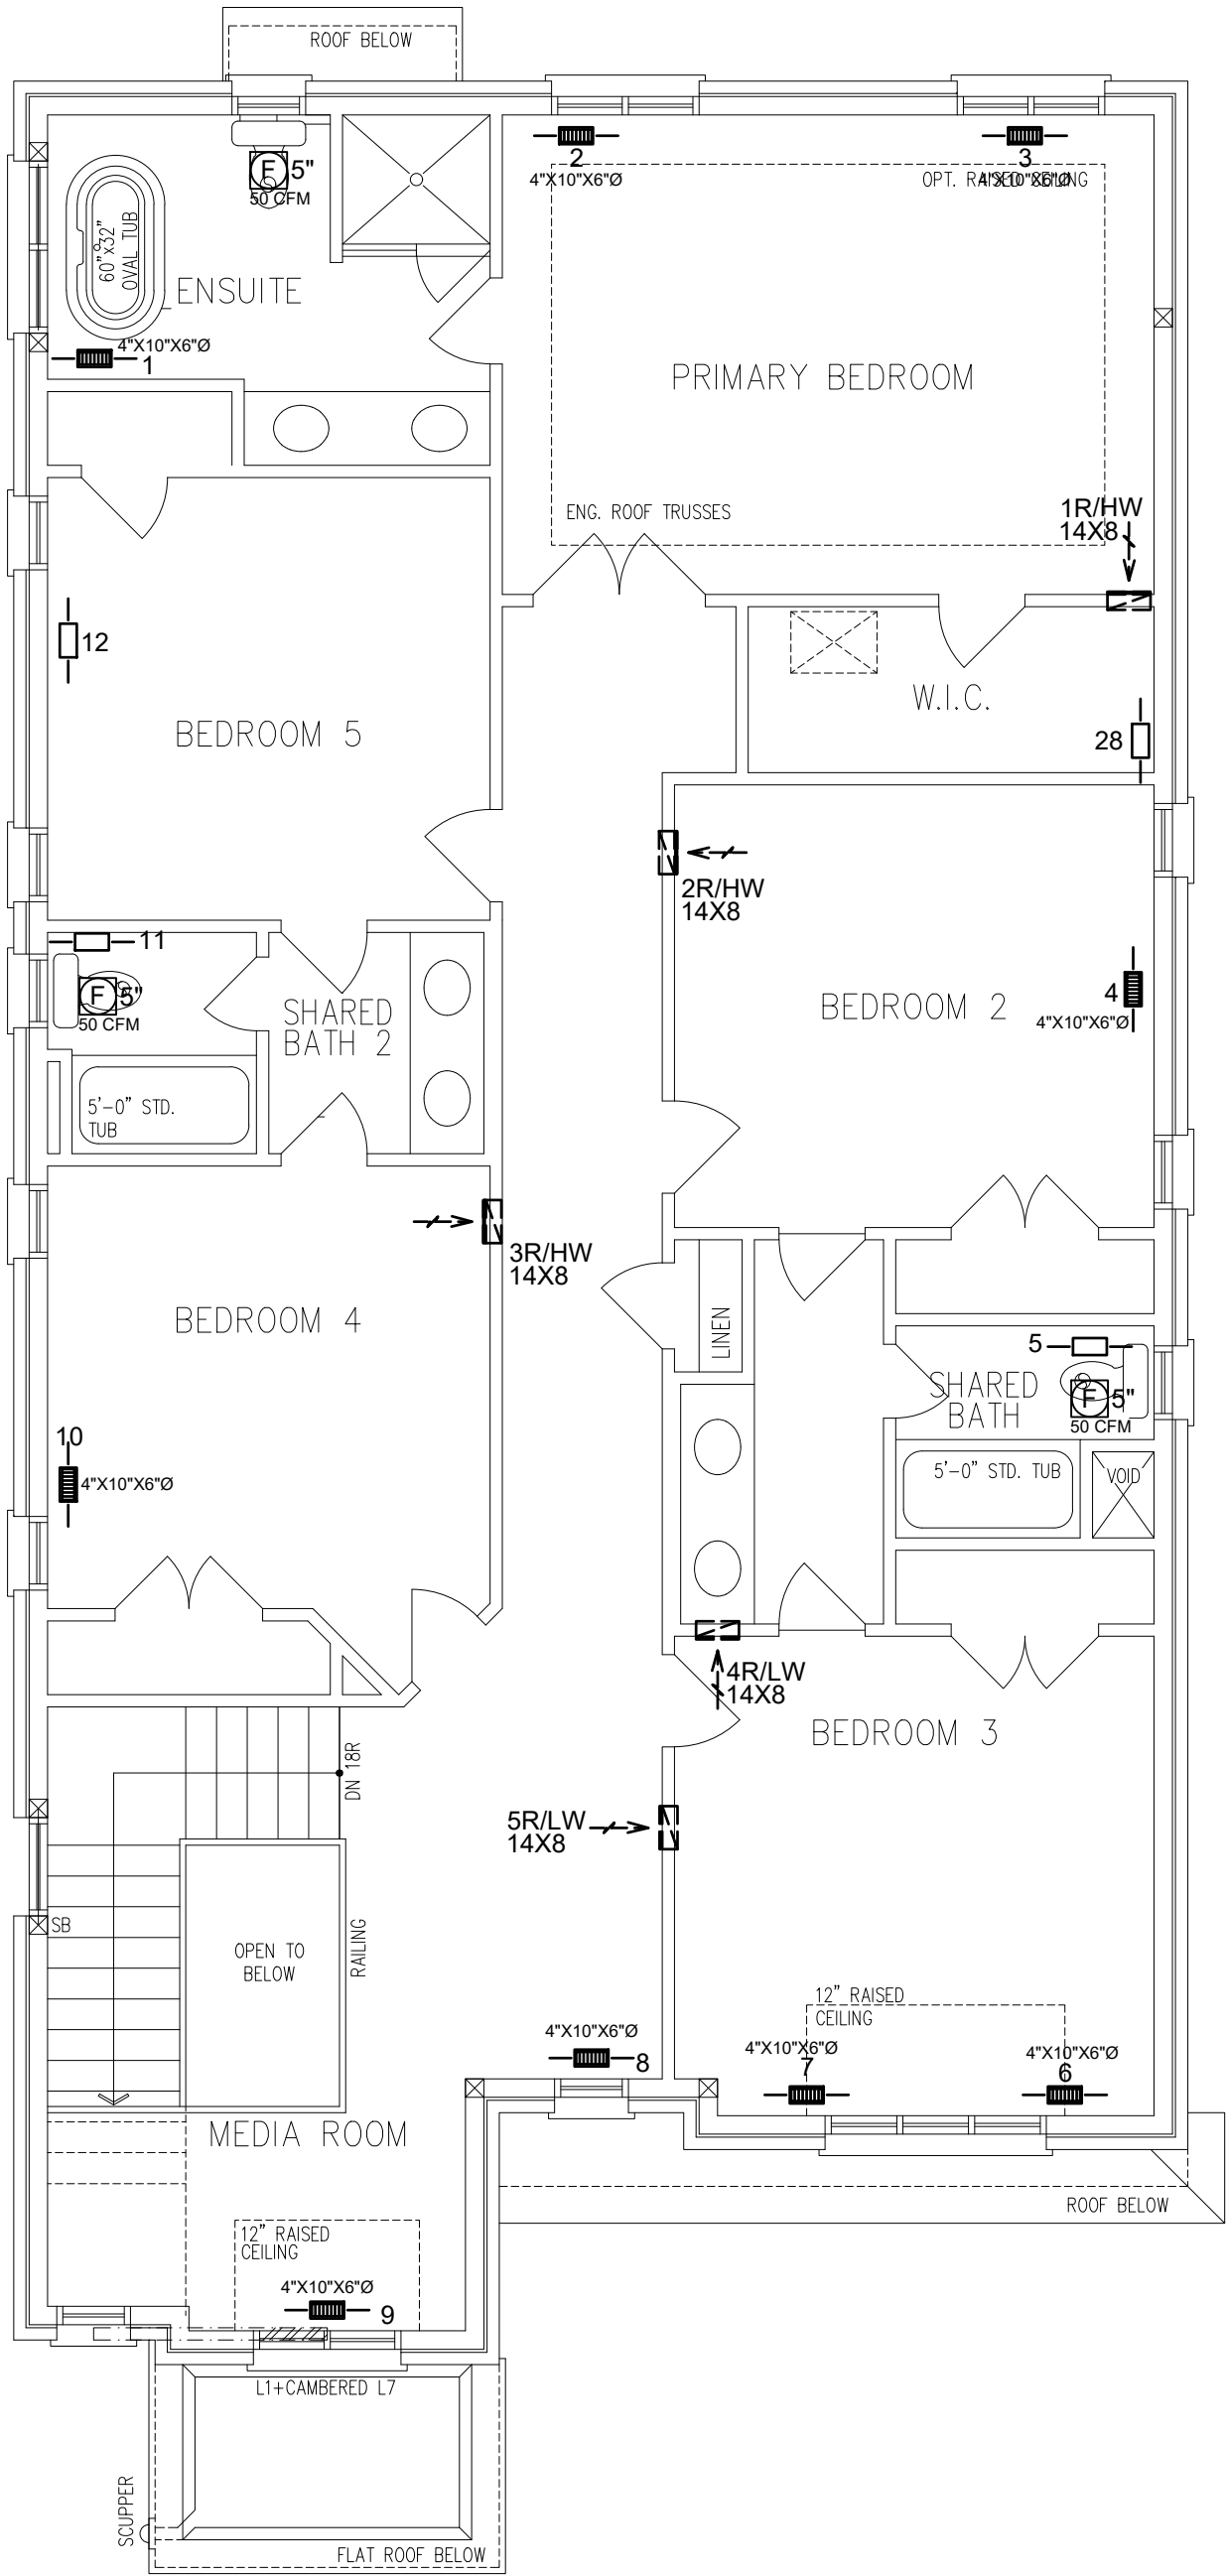

3RD	# S/A	# R/A	# FANS
2ND	13	5	3
1ST	11	2	2
B	4	1	-
TOTAL	28	8	5

CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

Doug McCallum
NAME

[Signature]
SIGNATURE

102614
BCIN / BCDN

- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS.
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
- COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION.
- PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS.
- ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED
- INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS
- ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.

TOTAL LOSS	54,055 BTUH
TOTAL GAIN	33,396 BTUH
HEATING UNIT	LENNOX
MODEL #	EL296UH070XE36B
OUTPUT	64,000 BTUH
	3 TON
	1145 CFM

MODEL:	Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed
PROJECT #:	RP23050
SQFT:	3348
W%:	11.77
SITE:	Forestside Estates
FOR:	Forestside Estates
BUILDER:	Royal Pine Homes

PROPOSED 2ND FLOOR


DATE: JUN/2023 SCALE: 3/16"=1'-0" DRAWN BY: MMA/ME

SB-12 PERFORMANCE
CSA F280-12


MCCALLUM
HVAC DESIGN INC

Brampton, Ontario, 905-840-8166, info@mccallumhvac.com


M3

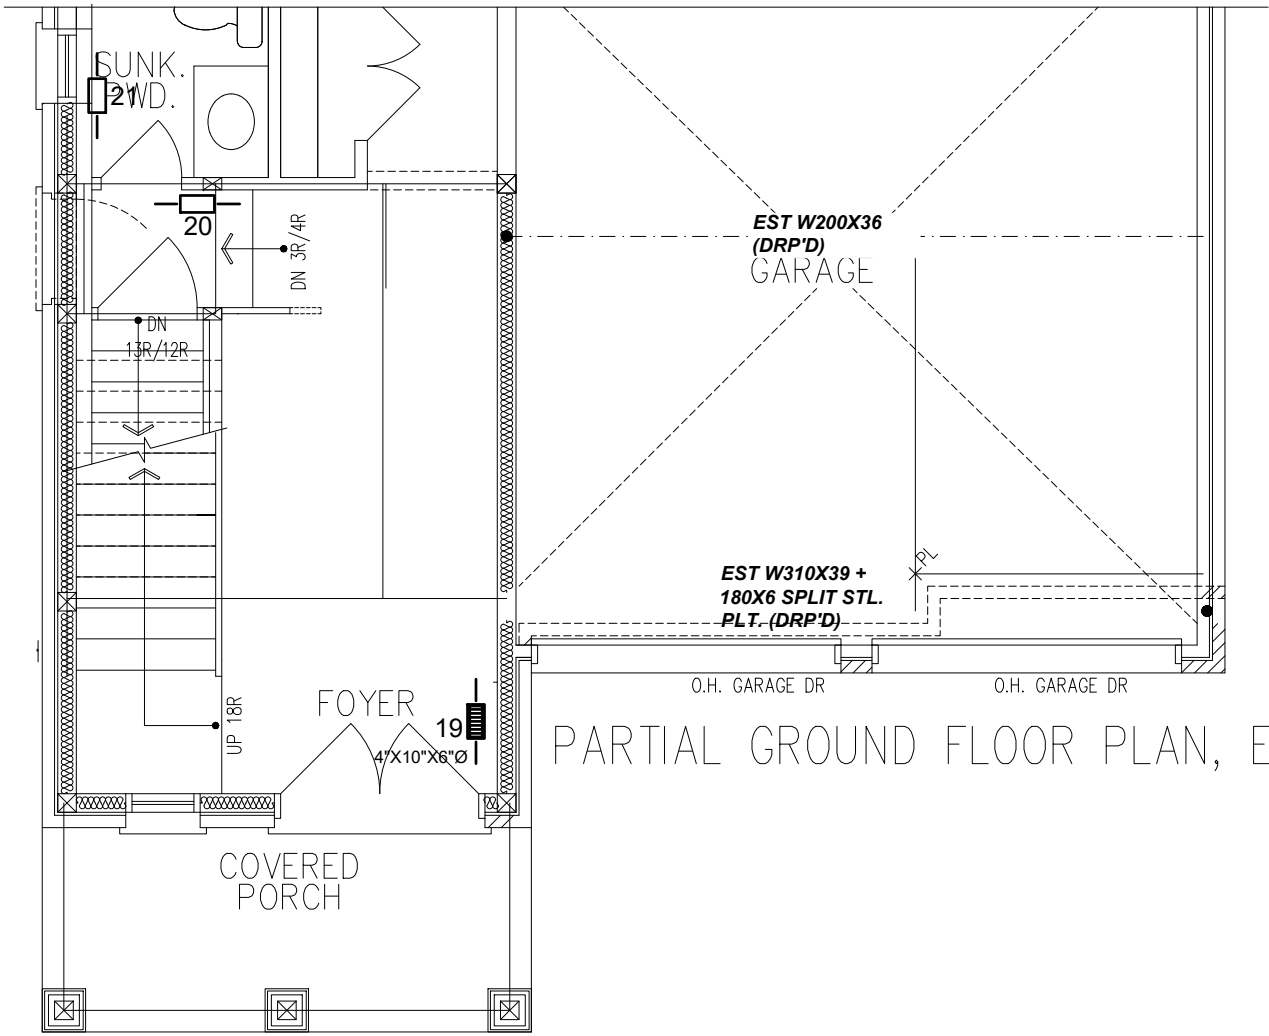

PARTIAL GROUND FLOOR PLAN, ELEV. 'B'

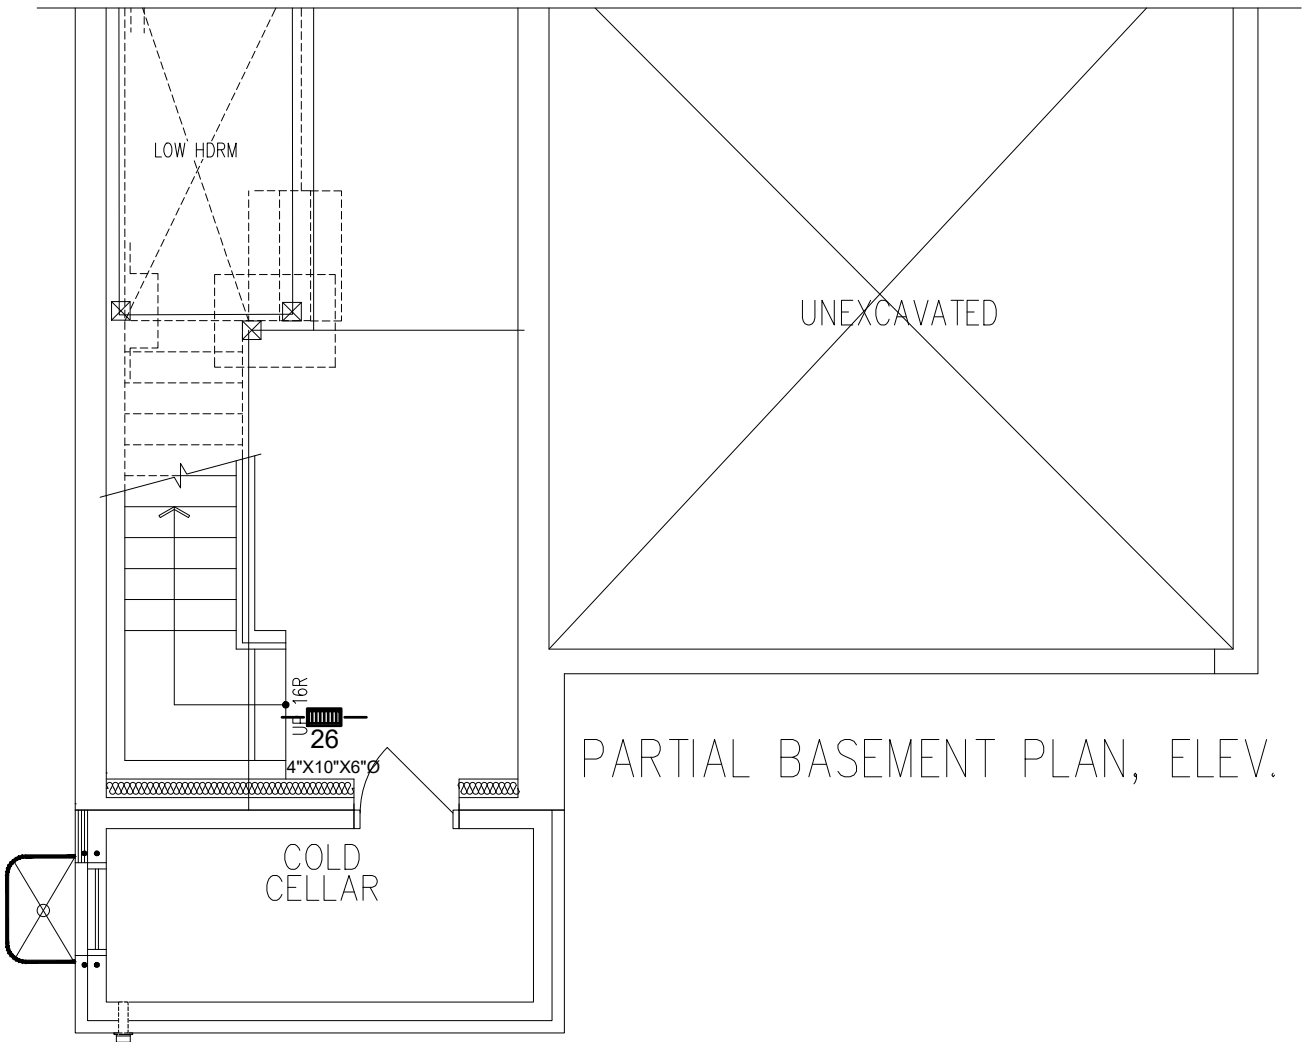


PARTIAL BASEMENT PLAN, ELEV. 'B'

<table><tr><td>3RD</td><td># S/A</td><td># R/A</td><td># FANS</td></tr><tr><td>2ND</td><td>13</td><td>5</td><td>3</td></tr><tr><td>1ST</td><td>11</td><td>2</td><td>2</td></tr><tr><td>B</td><td>4</td><td>1</td><td>-</td></tr><tr><td>TOTAL</td><td>28</td><td>8</td><td>5</td></tr></table>				3RD	# S/A	# R/A	# FANS	2ND	13	5	3	1ST	11	2	2	B	4	1	-	TOTAL	28	8	5	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.				PARTIAL PLANS DATE: JUN/2023 SCALE: 3/16"=1'-0" DRAWN BY: MMA/MP SB-12 PERFORMANCE CSA F280-12			
3RD	# S/A	# R/A	# FANS																												
2ND	13	5	3																												
1ST	11	2	2																												
B	4	1	-																												
TOTAL	28	8	5																												
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS		54,055 BTUH		MODEL:		Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed																					
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum  102614 NAME SIGNATURE BCIN / BCDN				TOTAL GAIN		33,396 BTUH		PROJECT #:		RP23050 SQFT: 3348 W%: 11.77																					
				HEATING UNIT		LENNOX		SITE:		Forestside Estates																					
				MODEL #		EL296UH070XE36B		FOR:		Forestside Estates																					
				OUTPUT		64,000 BTUH		BUILDER:		Royal Pine Homes																					
						3 TON																									


MCCALLUM
HVAC DESIGN INC

Brampton, Ontario, 905-840-8166, info@mccallumhvac.com

M4

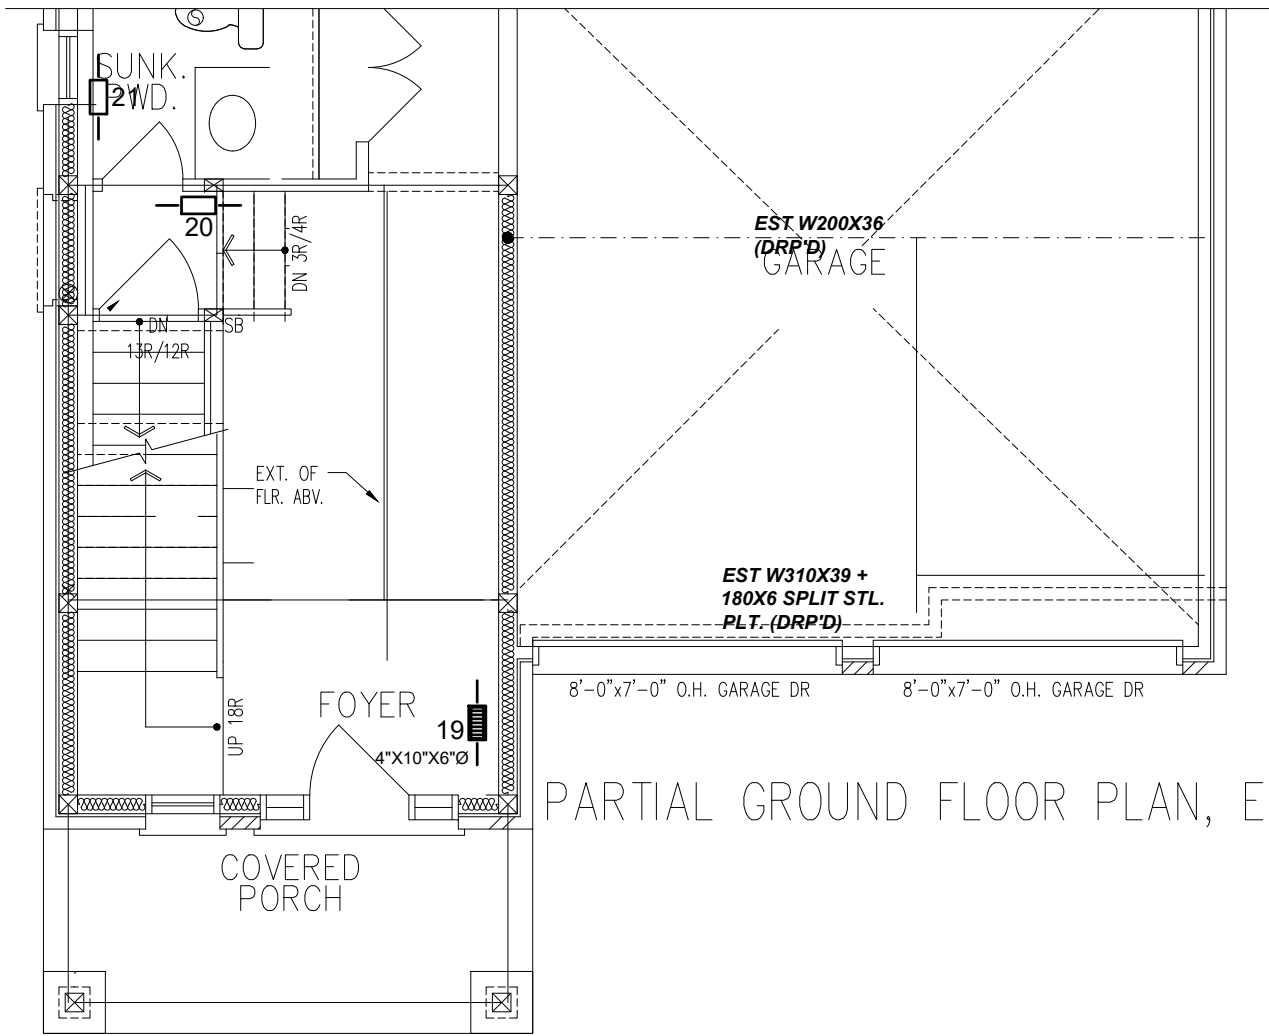


PARTIAL GROUND FLOOR PLAN, ELEV. 'C'

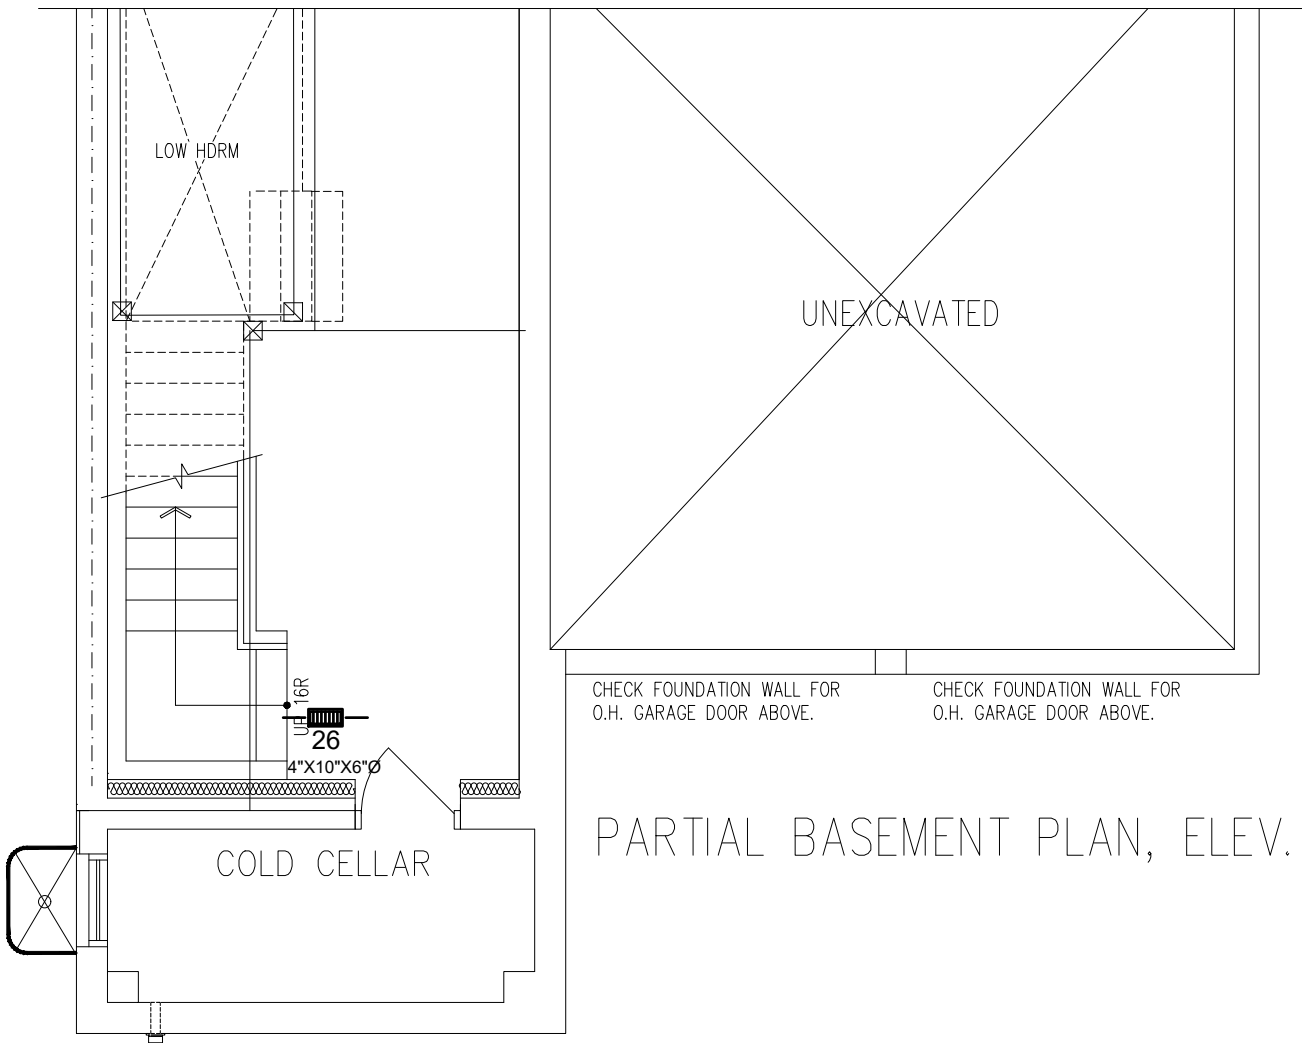


PARTIAL BASEMENT PLAN, ELEV. 'C'

<table><tr><td>3RD</td><td># S/A</td><td># R/A</td><td># FANS</td></tr><tr><td>2ND</td><td>13</td><td>5</td><td>3</td></tr><tr><td>1ST</td><td>11</td><td>2</td><td>2</td></tr><tr><td>B</td><td>4</td><td>1</td><td>-</td></tr><tr><td>TOTAL</td><td>28</td><td>8</td><td>5</td></tr></table>				3RD	# S/A	# R/A	# FANS	2ND	13	5	3	1ST	11	2	2	B	4	1	-	TOTAL	28	8	5	• DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. • COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. • PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. • ALL S/A RUNS TO BE 4"X10"X5" ROUND UNLESS OTHERWISE NOTED • INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS • ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PARTIAL PLANS <table><tr><td>DATE:</td><td>JUN/2023</td><td>SCALE:</td><td>3/16"=1'-0"</td><td>DRAWN BY:</td><td>MMA/MP</td></tr><tr><td colspan="6">SB-12 PERFORMANCE</td></tr><tr><td colspan="6">CSA F280-12</td></tr></table>			DATE:	JUN/2023	SCALE:	3/16"=1'-0"	DRAWN BY:	MMA/MP	SB-12 PERFORMANCE						CSA F280-12					
3RD	# S/A	# R/A	# FANS																																										
2ND	13	5	3																																										
1ST	11	2	2																																										
B	4	1	-																																										
TOTAL	28	8	5																																										
DATE:	JUN/2023	SCALE:	3/16"=1'-0"	DRAWN BY:	MMA/MP																																								
SB-12 PERFORMANCE																																													
CSA F280-12																																													
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS		54,055 BTUH		MODEL:		Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed																																			
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum102614 NAMESIGNATUREBCIN / BCDN				TOTAL GAIN		33,396 BTUH		PROJECT #:		RP23050 SQFT: 3348 W%: 11.77																																			
				HEATING UNIT		LENNOX		SITE:		Forestside Estates																																			
				MODEL #		EL296UH070XE36B		3 TON		FOR:		Forestside Estates																																	
				OUTPUT		64,000 BTUH		1145 CFM		BUILDER:		Royal Pine Homes																																	
				M C MCCALLUM HVAC DESIGN INC Brampton, Ontario, 905-840-8166, info@mccallumhvac.com M5																																									

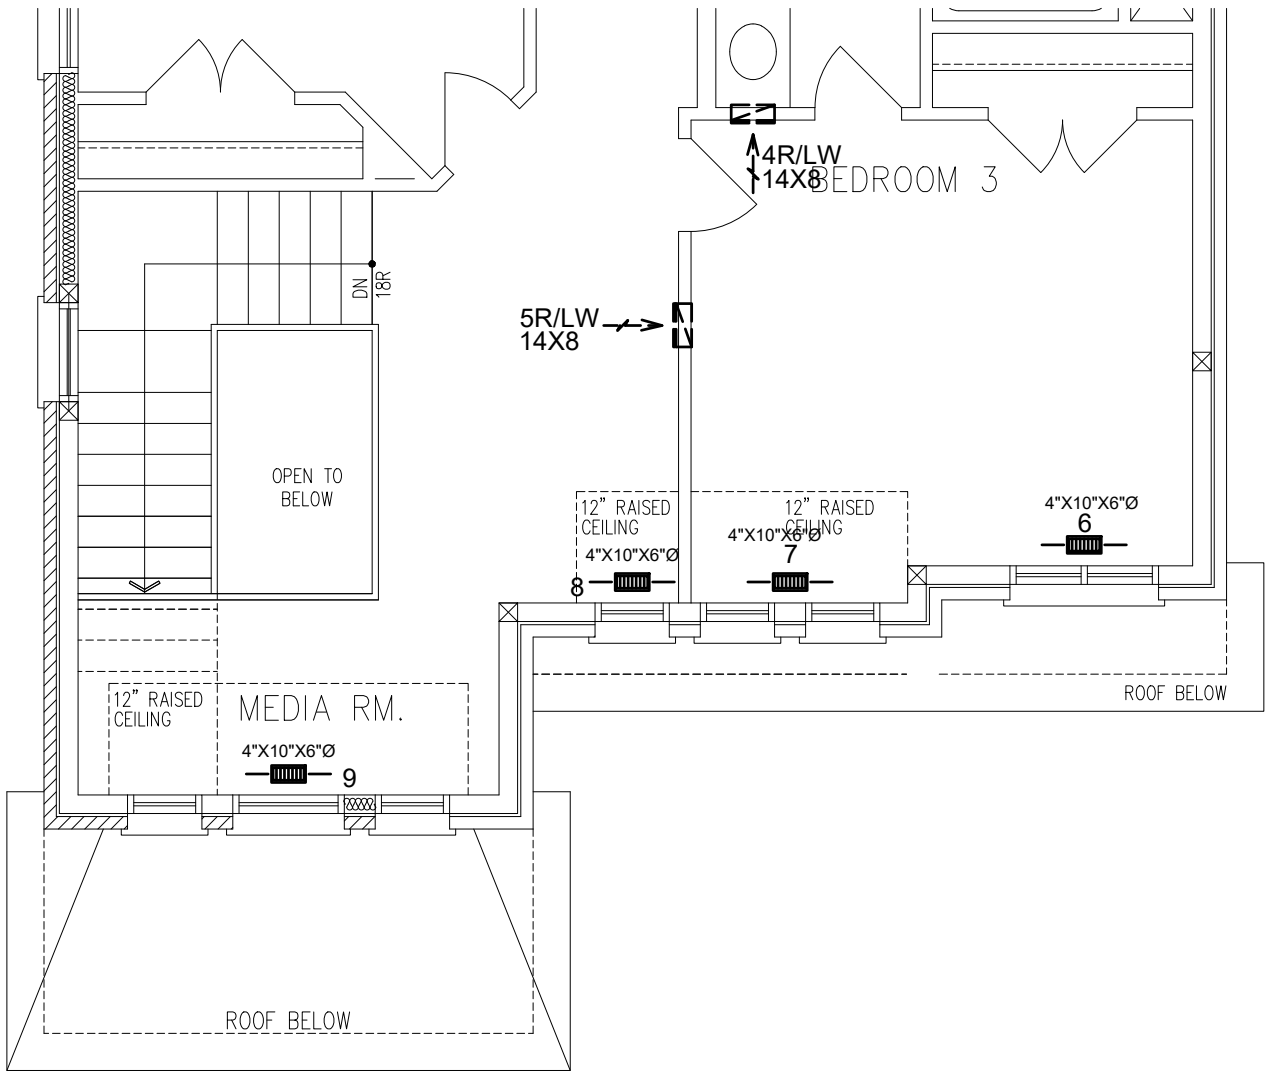

PART. OPT. SECOND FLOOR PLAN, W/ 5 BEDROOM ELEV. 'B'

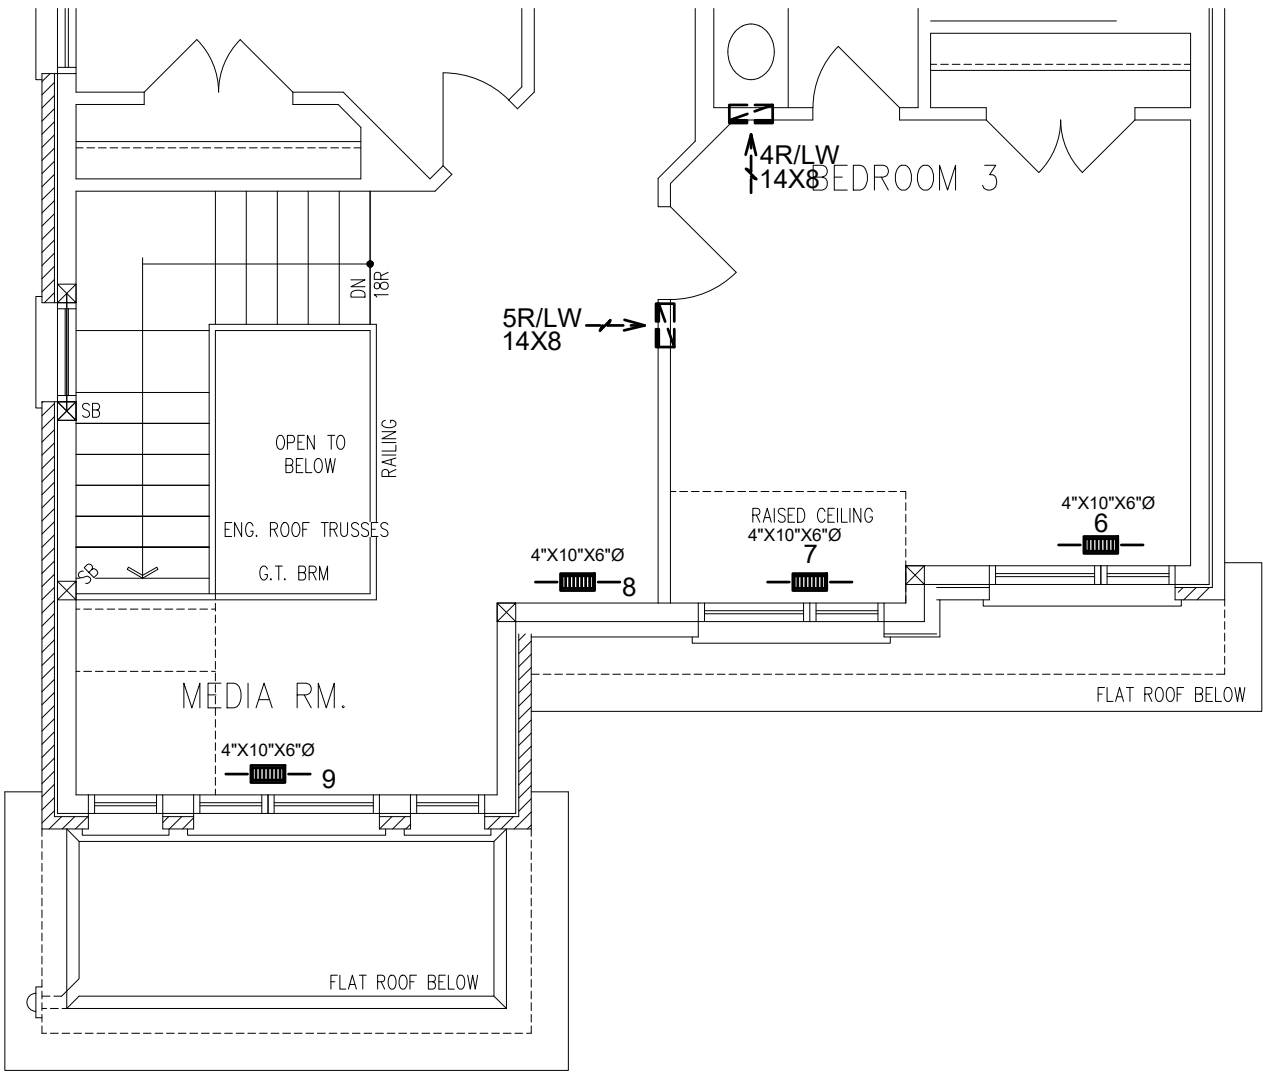

PART. OPT. SECOND FLOOR PLAN W/ 5 BEDROOMS, ELEV. 'C'

3RD	# S/A	# R/A	# FANS	- DESIGNER TO BE NOTIFIED OF ALL & ANY CHANGES TO THE STRUCTURE AND/OR SYSTEM DESIGN BEFORE INSTALLATION BEGINS. INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. - COORDINATE EXACT LOCATION OF GRILLES AND REGISTERS WITH OTHER TRADES, SITE CONDITIONS, OWNER BUILDER, AND/OR ARCHITECT BEFORE INSTALLATION. - PROVIDE MANUAL BALANCING DAMPERS AS REQUIRED TO S/A BRANCH OUTLETS, MAIN TAKE OFF'S & "Y" FITTINGS. - ALL S/A RUNS TO BE 4"x10"x5" ROUND UNLESS OTHERWISE NOTED - INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL DUCTS - ALL DUCTWORK LOCATED IN UNHEATED SPACES SHALL BE MIN R-12. UNDERCUT ALL DOORS IN ROOMS WITHOUT RETURN AIR, KEEP JOINTS TIGHT AND AIR LEAKAGE TO A MINIMUM.	PARTIAL PLANS DATE: JUN/2023SCALE: 3/16"=1'-0"DRAWN BY: MMA/MP SB-12 PERFORMANCE CSA F280-12					
2ND	13	5	3							
1ST	11	2	2							
B	4	1	-							
TOTAL	28	8	5							
CONTRACTOR TO WORK FROM MUNICIPAL APPROVED DRAWINGS ONLY				TOTAL LOSS	54,055 BTUH		MODEL:	Unit 4001 - Elev. A,B and C - Opt. 2nd floor - 5 bed		
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. Doug McCallum102614 NAMESIGNATUREBCIN / BCDN				TOTAL GAIN	33,396 BTUH		PROJECT #:	RP23050	SQFT: 3348	W%: 11.77
				HEATING UNIT	LENNOX		SITE:	Forestside Estates		
				MODEL #	EL296UH070XE36B	3 TON	FOR:	Forestside Estates		
				OUTPUT	64,000 BTUH	1145 CFM	BUILDER:	Royal Pine Homes		
							M MCCALLUMHVAC DESIGN INC Brampton, Ontario, 905-840-8166, info@mccallumhvac.com M6			