


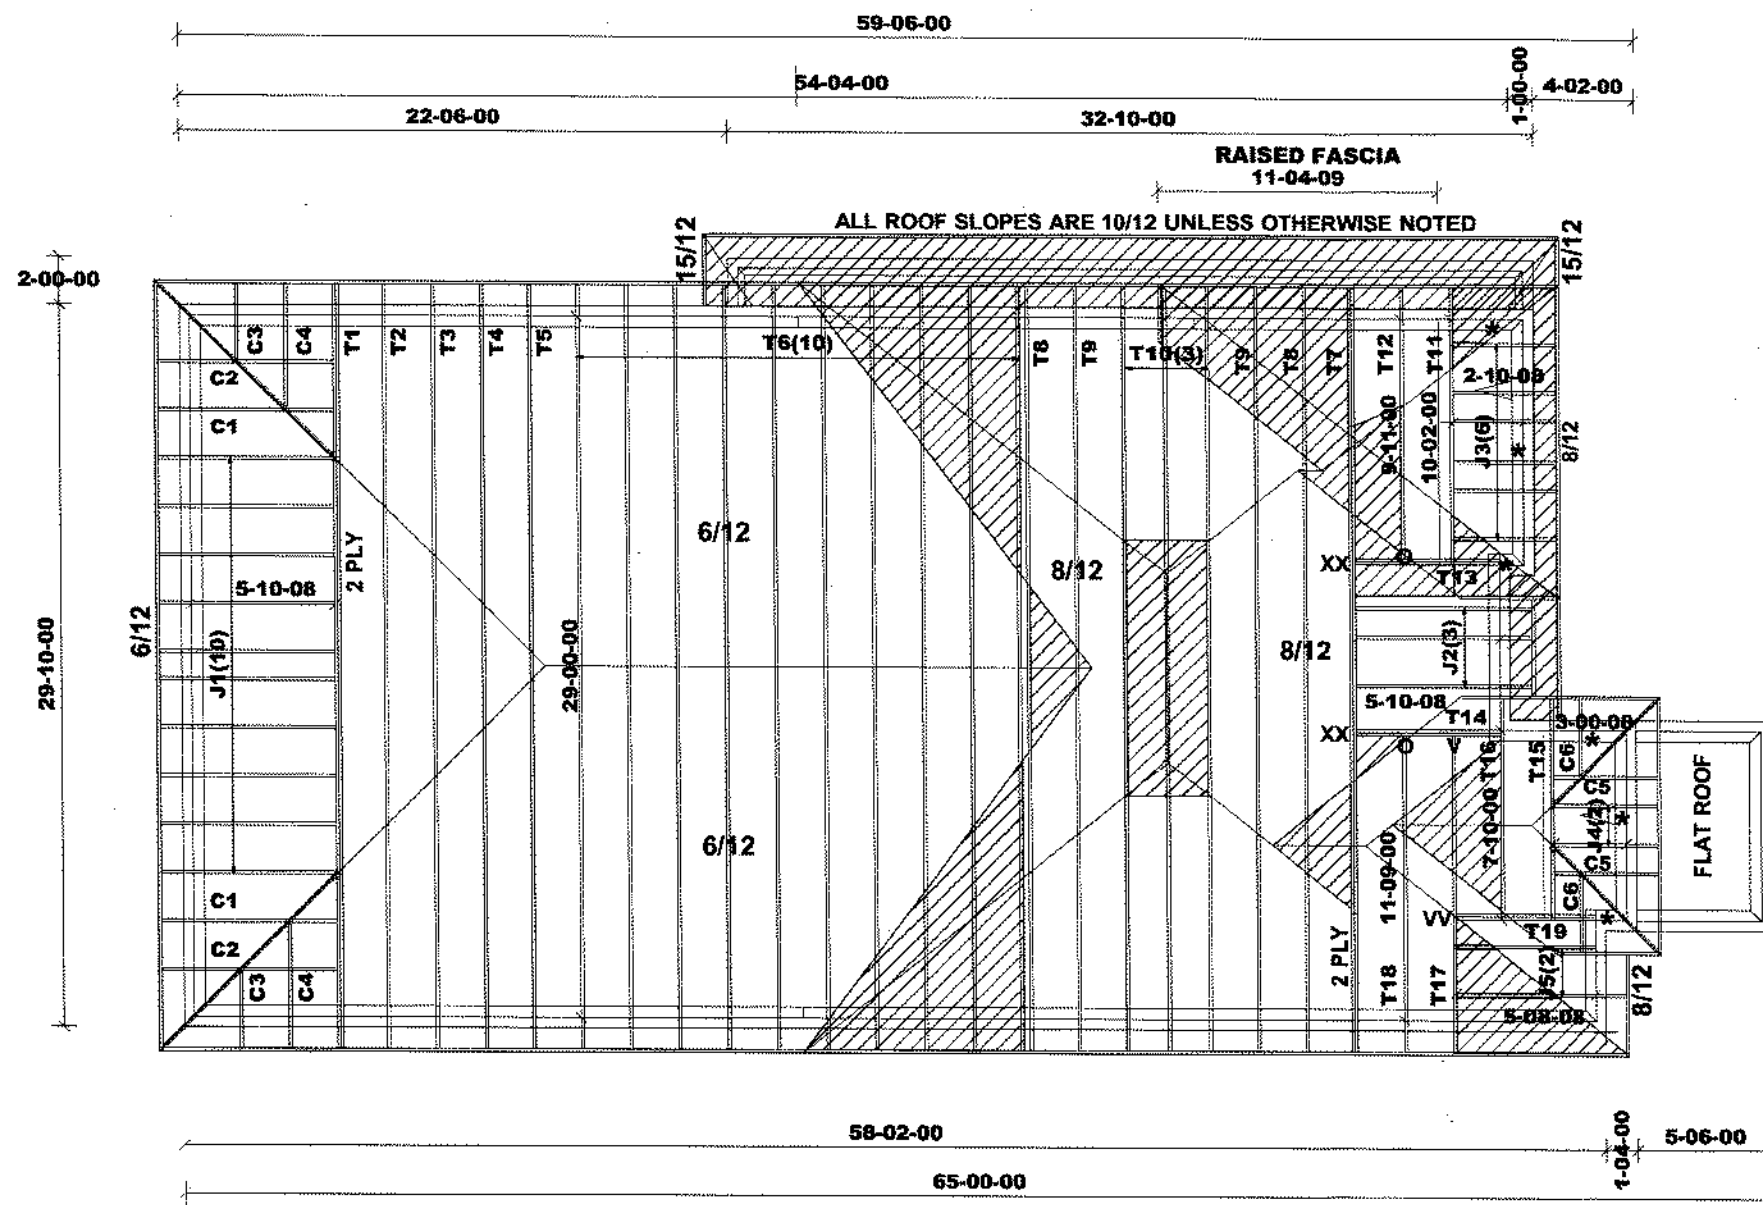

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf


HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 (XX)

DENOTES:
* : 24" RAISED TOP OF THE PLATE

 DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with Part 9 of O.B.C. 2012. Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070099

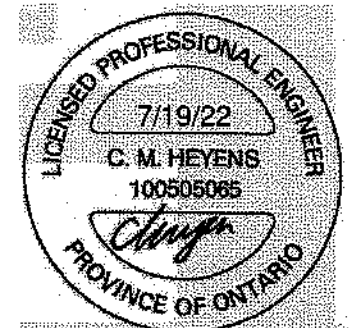

STRUCTURAL COMPONENTS ONLY
DWG# TR22070139

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424156**
Plan Log: **205701**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/18/22
Designer:

Model / Elevation: **38-02 / A STD**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

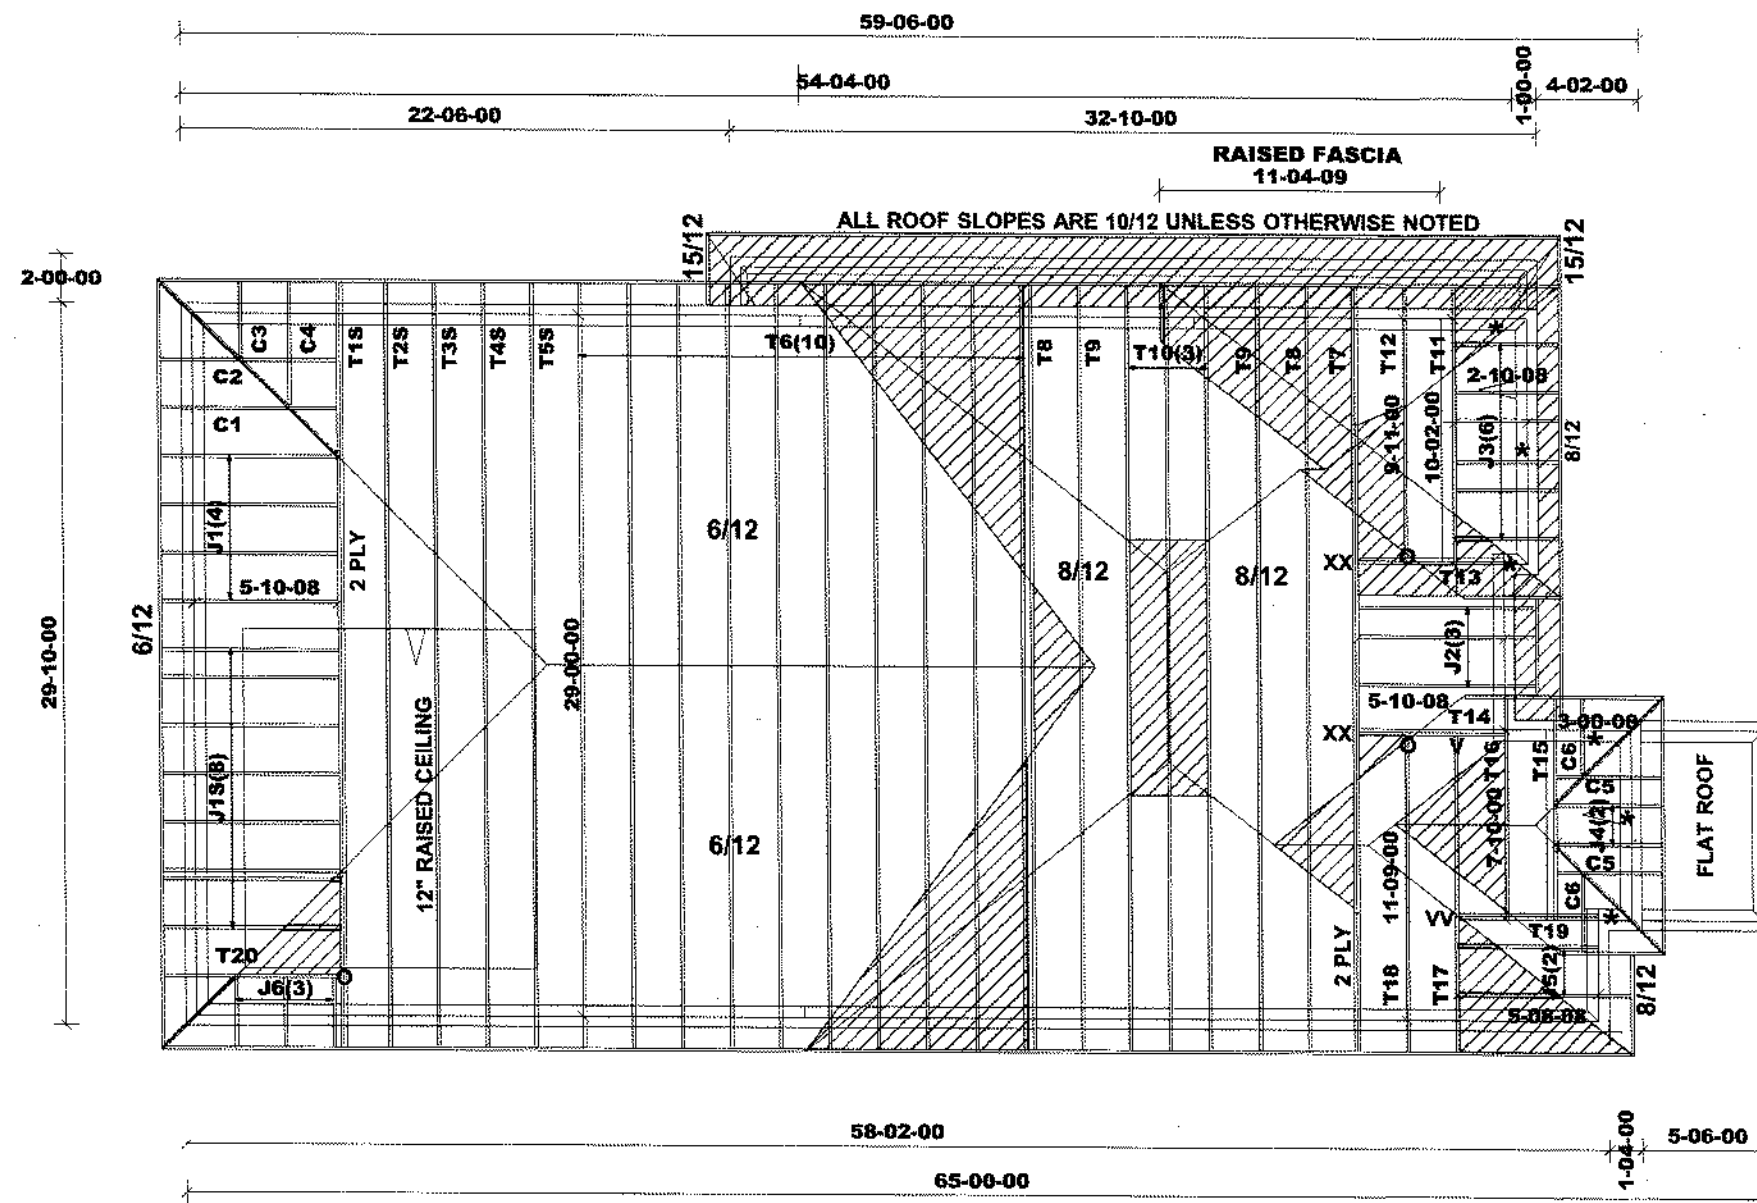

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf


HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 (XX)

DENOTES:
* : 24" RAISED TOP OF THE PLATE

 DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070080
DWG# TR22070086 TO TR22070107

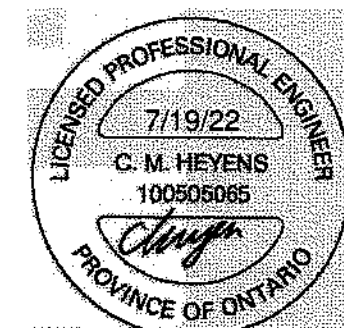

STRUCTURAL COMPONENTS ONLY
DWG# TR22070140

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424157**
Plan Log: **205701**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/18/22
Designer:

Model / Elevation: **38-02 / A OPT. RAISED CEILING**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

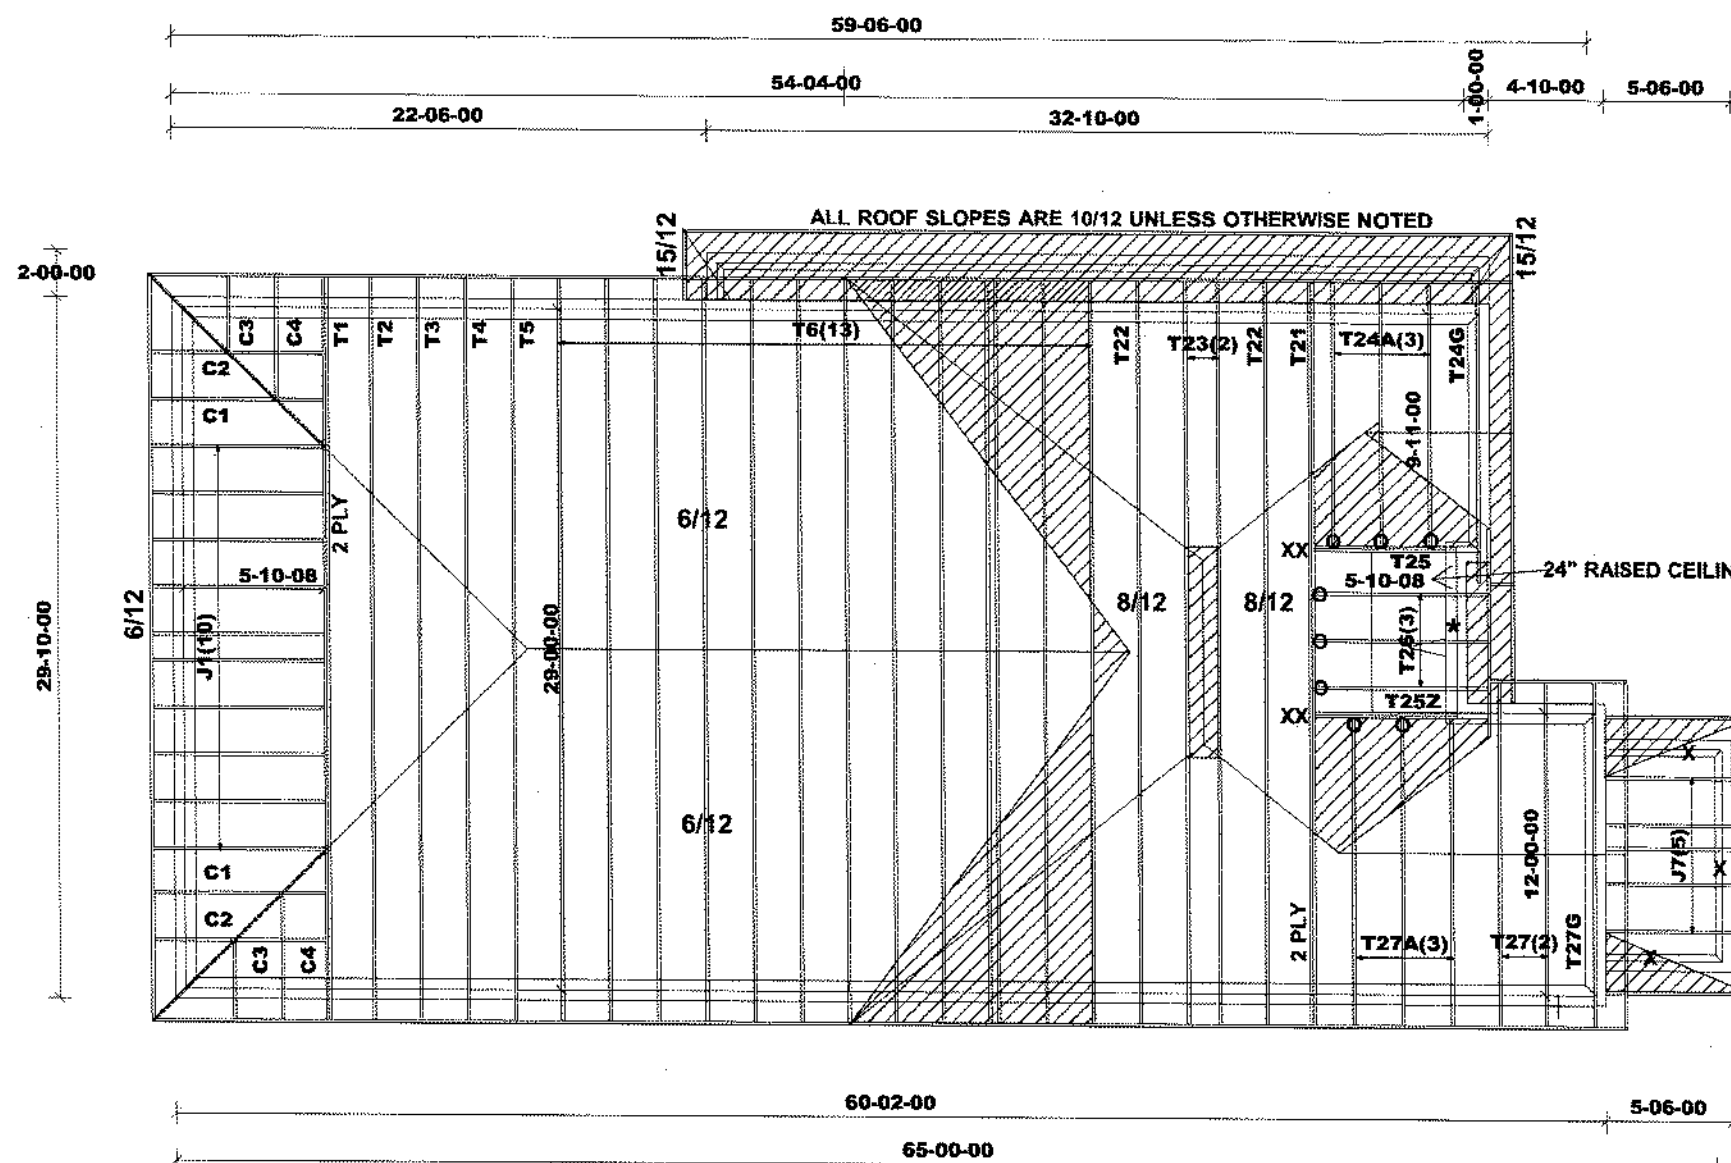

ASPHALT SHINGLES
 FINISHED OVERHANG: 12"
 2x6 EXTERIOR WALLS
 2x6 FASCIA BOARD
 HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
 2012(2019 AMENDMENT)
 OCCUPANCY: RESIDENTIAL | PART: 9
 Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
 TCSL = 23.3 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf


HARDWARE:
 LUS24 - (O)
 HGUS26-2 - (XX)

DENOTES:
 * : 24" RAISED TOP OF THE PLATE
 X: DROPPED BEAM BY OTHERS

 DENOTES:
 CONVENTIONAL
 FRAMING

All conventional framing to conform with Part 9 of O.B.C. 2012. Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070073
 DWG# TR22070076
 DWG# TR22070080 TO TR22070086
 DWG# TR22070108 TO TR22070119

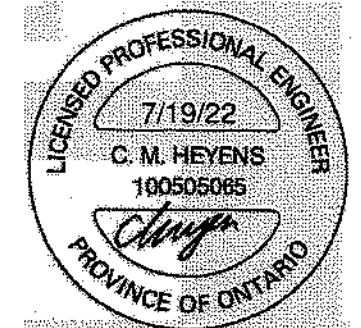

STRUCTURAL COMPONENTS ONLY
 DWG# TR22070141


TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: 52647	Builder / Location: ROYAL PINE HOMES / BRAMPTON	Model / Elevation: 38-02 / B STD	Mitek ver 6.5.3.233
Layout ID: 424158	Project: FORESTSIDE ESTATES	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE	
Plan Log: 205701	Date: 7/18/22	Designer:	

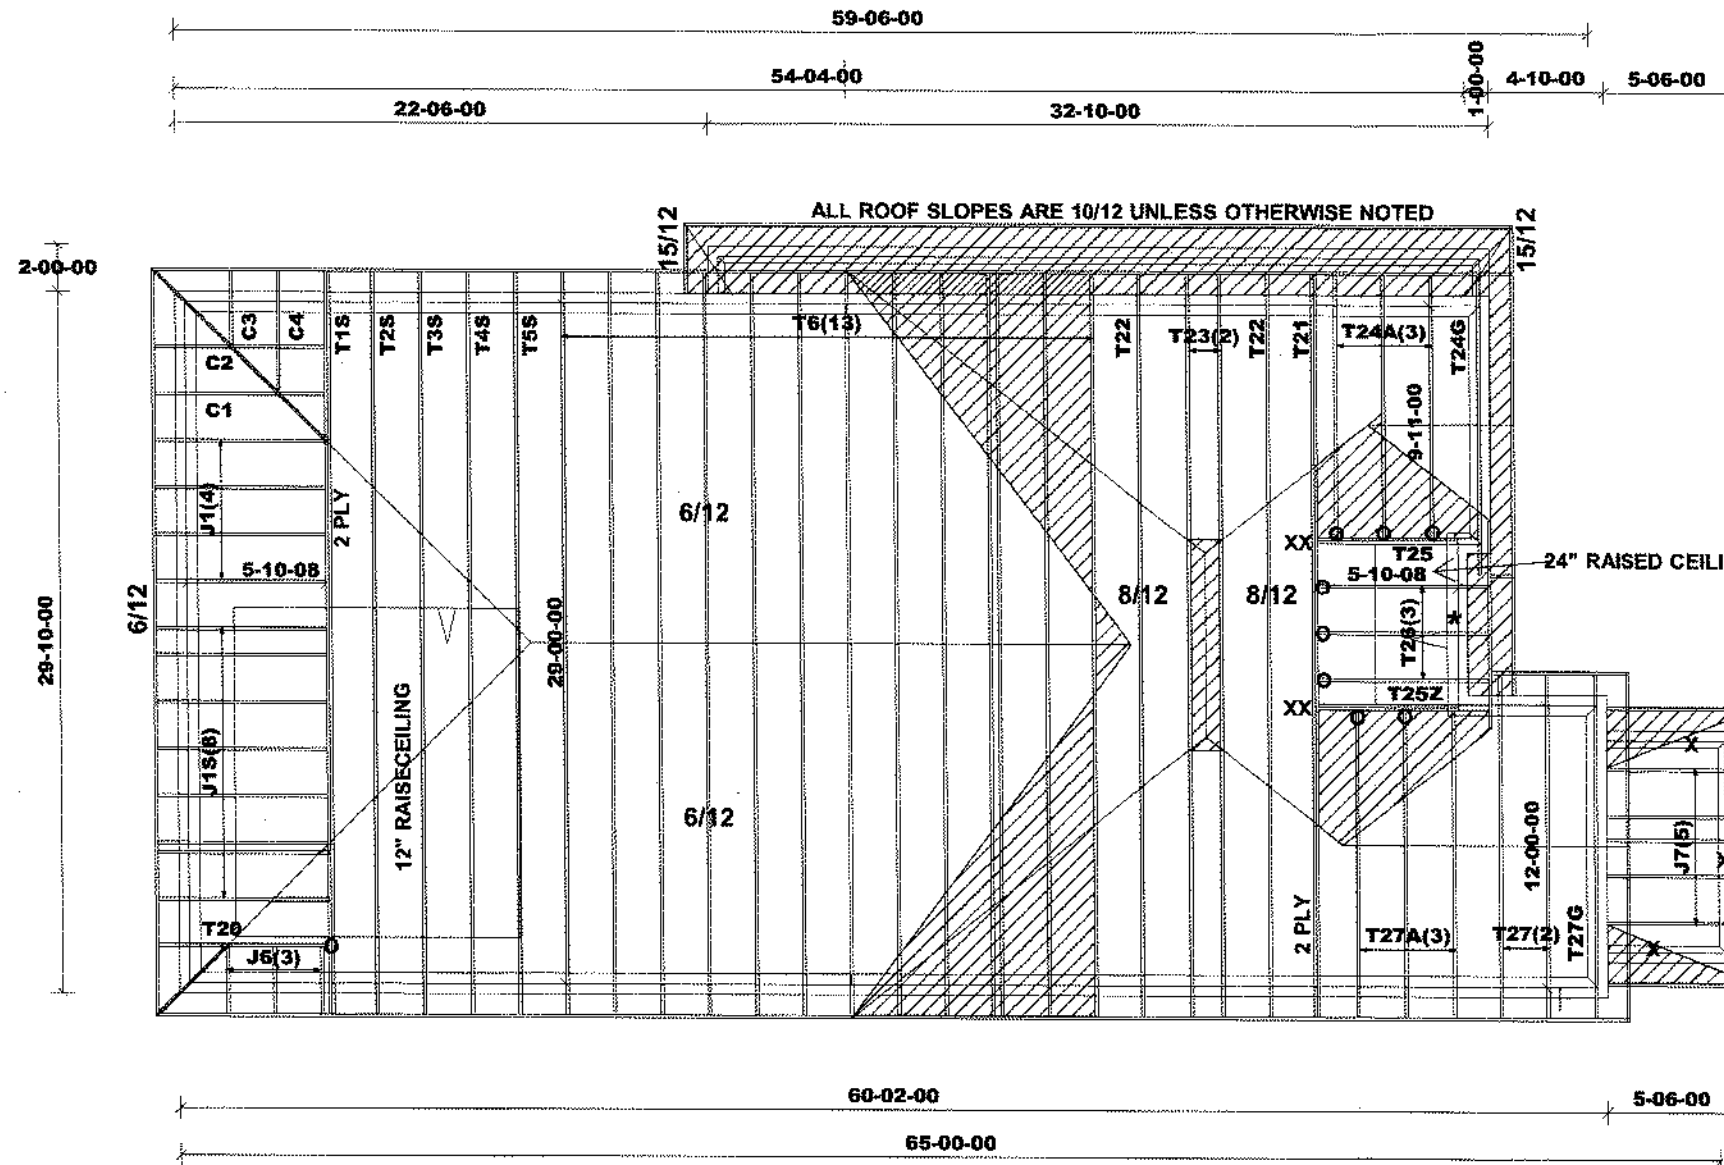

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf


DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
HGUS26-2 - (XX)

DENOTES:


* : 24" RAISED TOP OF THE PLATE

X: DROPPED BEAM BY OTHERS

 DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070073
DWG# TR22070076
DWG# TR22070086
DWG# TR22070100 TO TR22070119

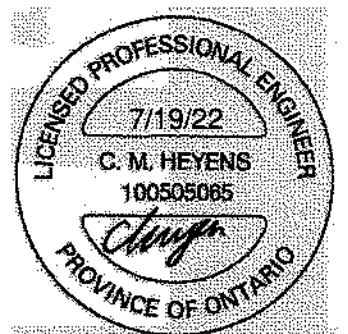

STRUCTURAL COMPONENTS ONLY
DWG# TR22070142

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.


Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424159**
Plan Log: **205701**

Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/18/22 Designer:

Model / Elevation: **38-02 / B OPT. RAISED CEILING**
Milek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

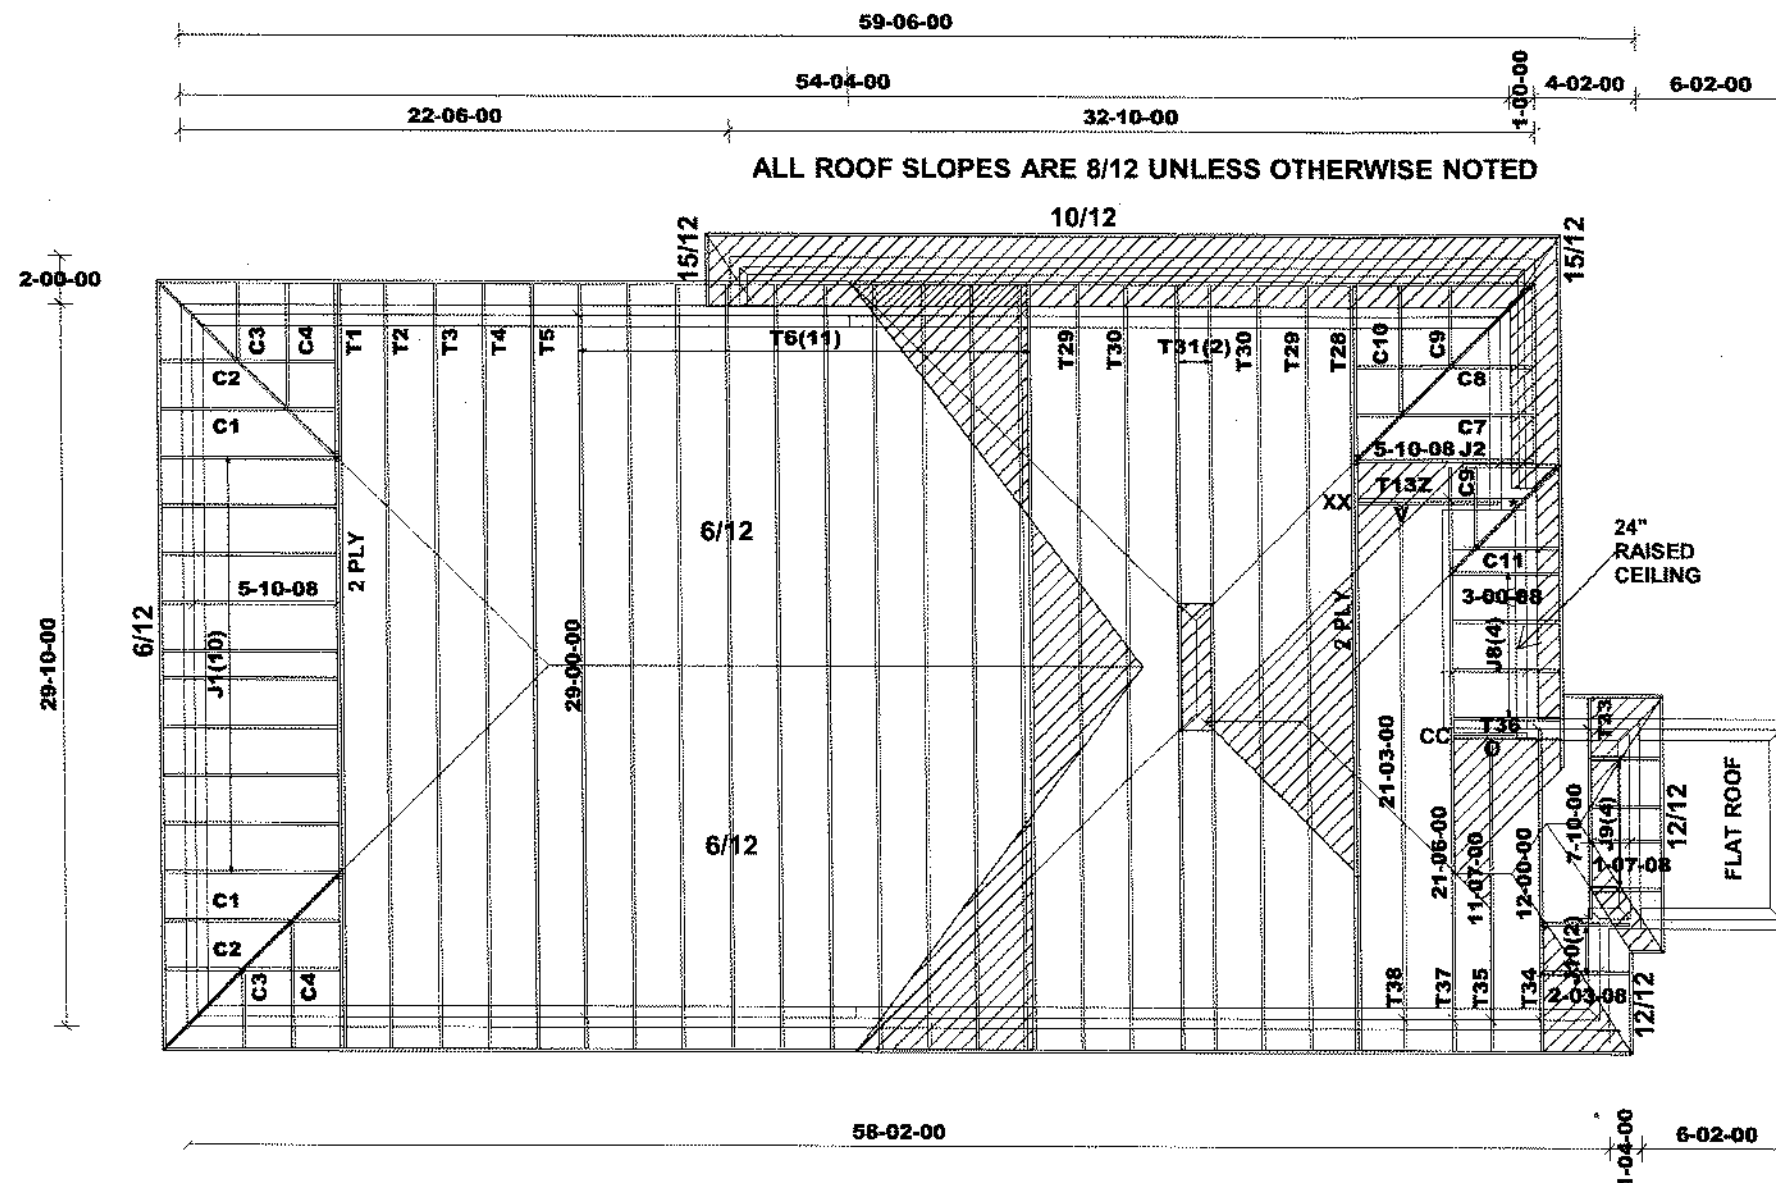

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
HUC26-2 - (CC)


DENOTES:

* : 24" RAISED TOP OF THE PLATE

 DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with Part 9 of O.B.C. 2012. Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070073
DWG# TR22070076 TO TR22070077
DWG# TR22070081 TO TR22070086
DWG# TR22070120 TO TR22070138

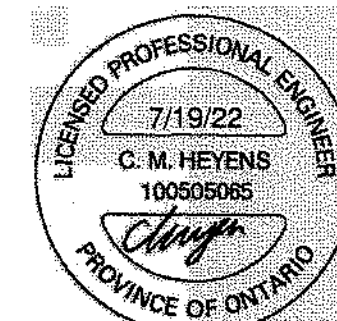

STRUCTURAL COMPONENTS ONLY
DWG# TR22070143

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.


Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424160**
Plan Log: **205701**

Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/18/22 Designer:

Model / Elevation: **38-02 / C STD**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

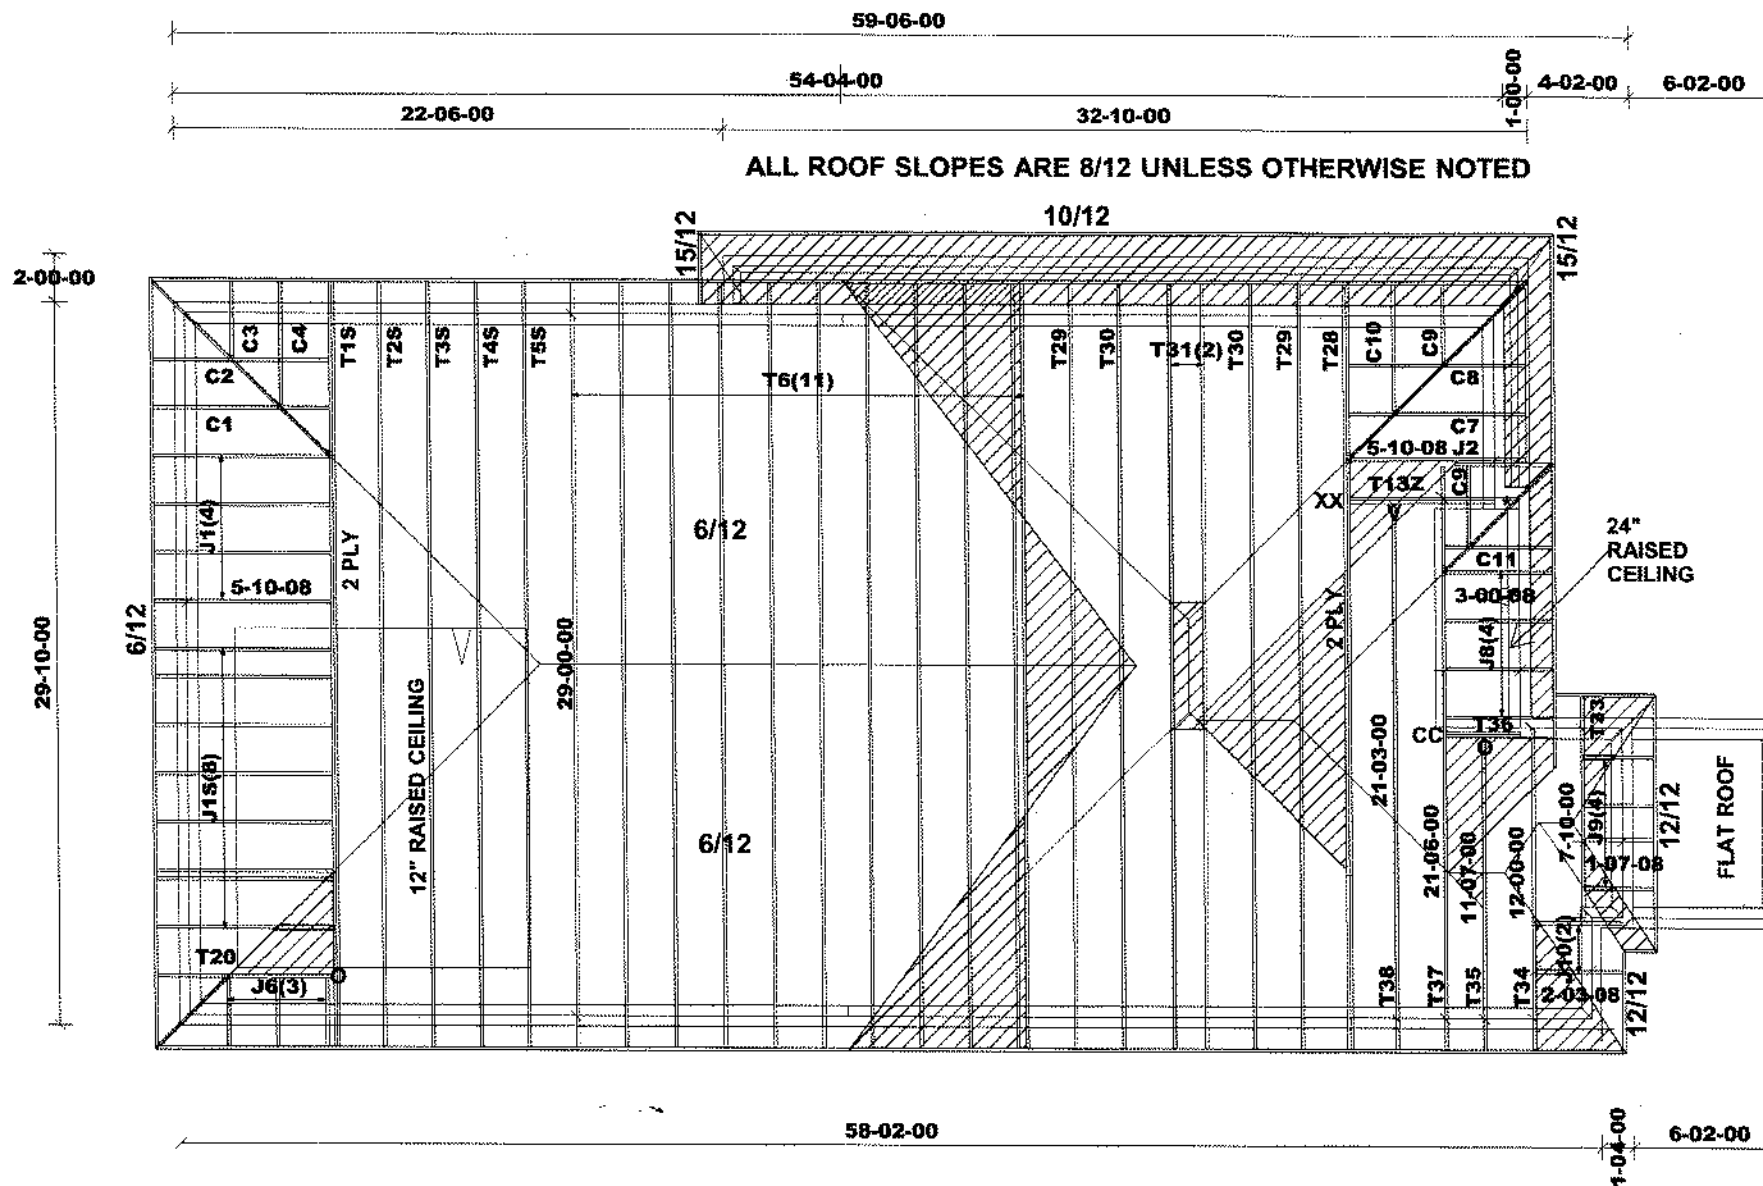

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf


HARDWARE:
LJS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
HUC26-2 - (CC)

DENOTES:
* : 24" RAISED TOP OF THE PLATE

 DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with Part 9 of O.B.C. 2012. Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DWG# TR22070070 TO TR22070073
DWG# TR22070076 TO TR22070077
DWG# TR22070086
DWG# TR22070100 TO TR22070107
DWG# TR22070120 TO TR22070138

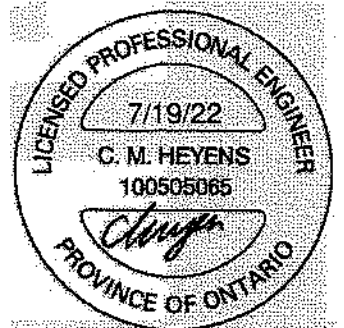

STRUCTURAL COMPONENTS ONLY
DWG# TR22070144

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.


Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: 52647
Layout ID: 424161
Plan Log: 205701
Builder / Location: ROYAL PINE HOMES / BRAMPTON
Project: FORESTSIDE ESTATES
Date: 7/18/22
Designer:

Model / Elevation: 38-02 / C OPT. RAISED CEILING
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

DELIVERY SHIPLIST

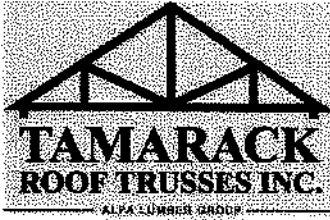


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: A STD

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424156
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	264.22 168.00		
	1	T2 Hip	6 /12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	111.73 70.83		
	1	T3 Hip	6 /12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.88 77.33		
	1	T4 Hip	6 /12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	117.98 73.83		
	1	T5 Hip	6 /12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.95 78.67		
	10	T6 Common	6 /12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1132.4 703.33		
	1 2-ply	T7 Hip Girder	10 /12	29-00-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	287.15 180.33		
	2	T8 Hip	10 /12	29-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	253.07 161.67		
	2	T9 Hip	10 /12	29-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	262.27 162.67		
	3	T10 Hip	10 /12	29-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	450.4 281.50		
	1	T11 Hip Girder	10 /12	10-02-00	3-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	55.43 37.83		
	1	T12 Hip	10 /12	9-11-00	6-07-13	2 x 4	1-03-08	3-07-11 3-10-03	57.8 37.50		
	1 2-ply	T13 Flat Girder	0 /12	5-10-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	51.42 33.33		
	1 2-ply	T14 Monopitch Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.45 41.33		

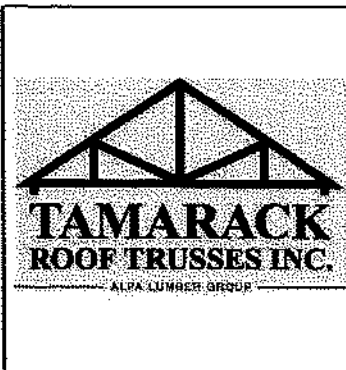

DELIVERY SHIPLIST


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: A STD

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424156
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. 8FT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T15 Hip Girder	10 / 12	7-10-00	4-02-02	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	46.9 30.33		
	1	T16 Common	10 / 12	7-10-00	4-10-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	37.23 25.17		
	1	T17 Hip Girder	10 / 12	11-09-00	5-02-08	2 x 4 2 x 6	1-03-08	1-07-11 3-10-03	70.24 45.50		
	1	T18 Hip	10 / 12	11-09-00	6-06-08	2 x 4	1-03-08	1-07-11 3-10-03	60.9 39.00		
	1 2-ply	T19 Flat Girder	0 / 12	5-08-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	50.2 33.33		
	1 2-ply	T32 Flat Girder	0 / 12	5-10-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	51.42 33.33		
	10	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J2 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	58.07 35.00		
	6	J3 Jack-Open	8 / 12	2-10-08	3-03-13	2 x 4	1-03-08	1-04-13 3-03-13	70.95 46.00		
	2	J4 Jack-Open	10 / 12	3-00-08	4-02-02	2 x 4	1-03-08	1-07-11 4-02-02	26.17 18.00		
	2	J5 Jack-Open	8 / 12	5-08-08	5-02-08	2 x 4	1-03-08	1-04-13 5-02-08	37.88 23.33		
	2	C1 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		

DELIVERY SHIPLIST

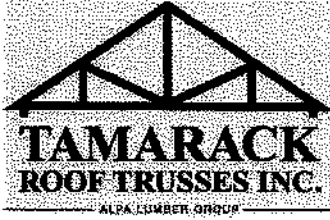

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: A STD

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424156
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C4 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	C5 Jack-Open	10 /12	1-09-07	3-01-09	2 x 4	1-03-08 1-03-01	1-07-11 3-01-09	22.53 16.67		
	2	C6 Jack-Open	10 /12	1-09-07	3-01-09	2 x 4	1-03-08 1-01	1-07-11 3-01-09	19.98 14.00		

TOTAL # TRUSS= 74

TOTAL BFT OF ALL TRUSSES= 2627.81


BFT.

TOTAL WEIGHT OF ALL TRSSES 4159.18 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
2	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 6

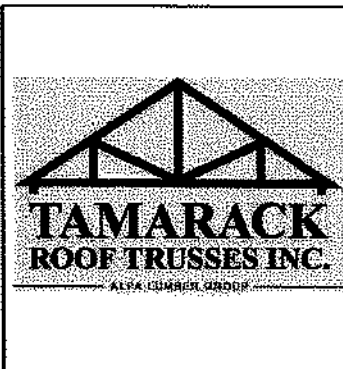

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: A OPT. COFF

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424157
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	278.62 177.67		
	1	T2S Hip	6 /12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	124.62 80.17		
	1	T3S Hip	6 /12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	125.64 80.00		
	1	T4S Hip	6 /12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.95 87.00		
	1	T5S Hip	6 /12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	141.93 90.83		
	10	T6 Common	6 /12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1132.4 703.33		
	1 2-ply	T7 Hip Girder	10 /12	29-00-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	287.15 180.33		
	2	T8 Hip	10 /12	29-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	253.07 161.67		
	2	T9 Hip	10 /12	29-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	262.27 162.67		
	3	T10 Hip	10 /12	29-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	450.4 281.50		
	1	T11 Hip Girder	10 /12	10-02-00	3-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	55.43 37.83		
	1	T12 Hip	10 /12	9-11-00	6-07-13	2 x 4	1-03-08	3-07-11 3-10-03	57.8 37.50		
	1 2-ply	T13 Flat Girder	0 /12	5-10-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	51.42 33.33		
	1 2-ply	T14 Monopitch Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.45 41.33		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: A OPT. COFF


Job Track: 52647
 PlanLog: 205701
 Layout ID: 424157
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T15 Hip Girder	10 / 12	7-10-00	4-02-02	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	46.9 30.33		
	1	T16 Common	10 / 12	7-10-00	4-10-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	37.23 25.17		
	1	T17 Hip Girder	10 / 12	11-09-00	5-02-08	2 x 4 2 x 6	1-03-08	1-07-11 3-10-03	70.24 45.50		
	1	T18 Hip	10 / 12	11-09-00	6-06-08	2 x 4	1-03-08	1-07-11 3-10-03	60.9 39.00		
	1 2-ply	T19 Flat Girder	0 / 12	5-08-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	50.2 33.33		
	1	T20 Half Hip Girder	6 / 12	5-10-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	23.33 16.50		
	4	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	167.06 109.33		
	3	J2 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	58.07 35.00		
	6	J3 Jack-Open	8 / 12	2-10-08	3-03-13	2 x 4	1-03-08	1-04-13 3-03-13	70.95 46.00		
	2	J4 Jack-Open	10 / 12	3-00-08	4-02-02	2 x 4	1-03-08	1-07-11 4-02-02	26.17 18.00		
	2	J5 Jack-Open	8 / 12	5-08-08	5-02-08	2 x 4	1-03-08	1-04-13 5-02-08	37.88 23.33		
	3	J6 Jack-Open	6 / 12	1-06-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	18.99 14.00		
	1	C1 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		

DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER	Job Track:	52647
	Builder:	ROYAL PINE HOMES	PlanLog:	205701
	Project:	FORESTSIDE ESTATES	Layout ID:	424157
	Location:	BRAMPTON	Ref #	
	Model:	38-02	Page:	3 of 3
	Lot #:		Date:	07-21-2022
	Elevation:	A OPT. COFF	Designer:	
		Sales Rep:	Rick DiCiano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C4 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	2	C5 Jack-Open	10 /12	1-09-07	3-01-09	2 x 4	1-03-08 1-03-01	1-07-11 3-01-09	22.53 16.67		
	2	C6 Jack-Open	10 /12	1-09-07	3-01-09	2 x 4	1-03-08 1-01	1-07-11 3-01-09	19.98 14.00		

TOTAL # TRUSS= 74

TOTAL BFT OF ALL TRUSSES= 2690.66


BFT.

TOTAL WEIGHT OF ALL TRSSES 4244.08 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 7

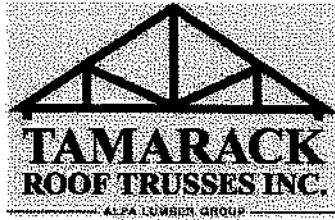


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: B STD




Job Track: 52647
 PlanLog: 205701
 Layout ID: 424158
 Ref #
 Page: 1 of 2
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 / 12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	264.22 168.00		
	1	T2 Hip	6 / 12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	111.73 70.83		
	1	T3 Hip	6 / 12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.88 77.33		
	1	T4 Hip	6 / 12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	117.98 73.83		
	1	T5 Hip	6 / 12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.95 78.67		
	13	T6 Common	6 / 12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1472.12 914.33		
	1 2-ply	T21 Hip Girder	10 / 12	29-00-00	7-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	327.94 205.67		
	2	T22 Hip	10 / 12	29-00-00	8-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	265.33 168.33		
	2	T23 Hip	10 / 12	29-00-00	9-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	309.72 194.67		
	3	T24A Common	10 / 12	9-11-00	5-08-05	2 x 4	1-03-08 1-03-08	1-05-03 1-07-11	133.99 88.50		
	1	T24G GABLE	10 / 12	10-02-00	5-10-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	49.48 33.00		
	1 2-ply	T25 Monopitch Girder	8 / 12	5-10-08	7-03-13	2 x 4 2 x 6		3-04-13 7-03-13	81.07 51.00		
	1 2-ply	T25Z Monopitch Girder	8 / 12	5-10-08	7-03-13	2 x 4 2 x 6		3-04-13 7-03-13	81.07 51.00		
	3	T26 Monopitch	8 / 12	5-10-08	7-03-13	2 x 4	1-03-08	1-04-13 7-03-13	118.59 76.50		

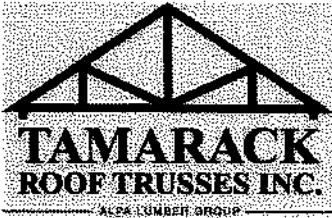		DELIVERY SHIPLIST	
TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: FORESTSIDE ESTATES Location: BRAMPTON Model: 38-02 Lot #: Elevation: B STD	Job Track: 52647 PlanLog: 205701 Layout ID: 424158 Ref # Page: 2 of 2 Date: 07-21-2022 Designer: Sales Rep: Rick DiCiano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T27 Common	10 / 12	12-00-00	6-07-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	105.7 66.00		
	3	T27A Common	10 / 12	11-09-00	6-05-08	2 x 4	1-03-08	1-05-03 1-07-11	148.91 95.00		
	1	T27G GABLE	10 / 12	12-00-00	6-07-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	58.37 38.00		
	10	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 108.67		
	5	J7 Jack-Open	4 / 12	5-11-00	2-08-08	2 x 4	1-03-08	3-15 2-00-04	77.61 46.67		
	2	C1 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	C4 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		

TOTAL # TRUSS= 65

TOTAL BFT OF ALL TRUSSES= 2655.33


BFT.

TOTAL WEIGHT OF ALL TRSSES 4221.22 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
8	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 10

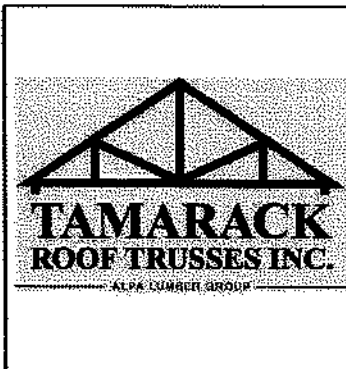


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: B OPT. COFF


Job Track: 52647
 PlanLog: 205701
 Layout ID: 424159
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	278.62 177.67		
	1	T2S Hip	6 /12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	124.62 80.17		
	1	T3S Hip	6 /12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	125.64 80.00		
	1	T4S Hip	6 /12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.95 87.00		
	1	T5S Hip	6 /12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	141.93 90.83		
	13	T6 Common	6 /12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1472.12 914.33		
	1	T20 Half Hip Girder	6 /12	5-10-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	23.33 16.50		
	1 2-ply	T21 Hip Girder	10 /12	29-00-00	7-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	327.94 205.67		
	2	T22 Hip	10 /12	29-00-00	8-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	265.33 168.33		
	2	T23 Hip	10 /12	29-00-00	9-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	309.72 194.67		
	3	T24A Common	10 /12	9-11-00	5-08-05	2 x 4	1-03-08 1-03-08	1-05-03 1-07-11	133.99 86.50		
	1	T24G GABLE	10 /12	10-02-00	5-10-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	49.48 33.00		
	1 2-ply	T25 Monopitch Girder	8 /12	5-10-08	7-03-13	2 x 4 2 x 6		3-04-13 7-03-13	81.07 51.00		
	1 2-ply	T25Z Monopitch Girder	8 /12	5-10-08	7-03-13	2 x 4 2 x 6		3-04-13 7-03-13	81.07 51.00		

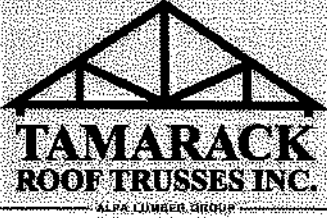 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: FORESTSIDE ESTATES Location: BRAMPTON Model: 38-02 Lot #: Elevation: B OPT. COFF		Job Track: 52647 PlanLog: 205701 Layout ID: 424159 Ref # Page: 2 of 3 Date: 07-21-2022 Designer: Sales Rep: Rick DiCiano	
---	--------------------------	--	--	--	--	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	T26 Monopitch	8 /12	5-10-08	7-03-13	2 x 4	1-03-08	1-04-13 7-03-13	118.59 76.50		
	2	T27 Common	10 /12	12-00-00	6-07-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	105.7 66.00		
	3	T27A Common	10 /12	11-09-00	6-05-08	2 x 4	1-03-08	1-05-03 1-07-11	148.91 95.00		
	1	T27G GABLE	10 /12	12-00-00	6-07-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	58.37 38.00		
	4	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	167.06 109.33		
	3	J6 Jack-Open	6 /12	1-06-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	18.99 14.00		
	5	J7 Jack-Open	4 /12	5-11-00	2-08-08	2 x 4	1-03-08	3-15 2-00-04	77.61 46.67		
	1	C1 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		
	1	C2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C4 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		

TOTAL # TRUSS= 67

TOTAL BFT OF ALL TRUSSES= 2751.51

BFT.

TOTAL WEIGHT OF ALL TRSSES 4357.53 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
9	Hardware	LUS24	

		DELIVERY SHIPLIST	
 TAMARACK ROOF TRUSSES INC. WISA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track: 52647
	Builder:	ROYAL PINE HOMES	PlanLog: 205701
	Project:	FORESTSIDE ESTATES	Layout ID: 424159
	Location:	BRAMPTON	Ref #
	Model:	38-02	Page: 3 of 3
	Lot #:		Date: 07-21-2022
	Elevation:	B OPT. COFF	Designer:
		Sales Rep:	Rick DiCiano

HARDWARE

QTY	TYPE	MODEL	LENGTH
-----	------	-------	--------

TOTAL NUMBER OF ITEMS= 11



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: C STD

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424160
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 / 12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	264.22 168.00		
	1	T2 Hip	6 / 12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	111.73 70.83		
	1	T3 Hip	6 / 12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.88 77.33		
	1	T4 Hip	6 / 12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	117.98 73.83		
	1	T5 Hip	6 / 12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.95 78.67		
	11	T6 Common	6 / 12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1245.64 773.67		
	1 2-ply	T13Z Flat Girder	0 / 12	5-10-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	51.42 33.33		
	1 2-ply	T28 Hip Girder	8 / 12	29-00-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	305.12 190.00		
	2	T29 Hip	8 / 12	29-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	241.09 152.33		
	2	T30 Hip	8 / 12	29-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	267.44 169.33		
	2	T31 Hip	8 / 12	29-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	259.18 162.00		
	1	T33 Hip Girder	8 / 12	7-10-00	3-06-00	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	43.13 28.83		
	1	T34 Hip Girder	8 / 12	12-00-00	4-02-00	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	59.91 36.50		
	1	T35 Common	8 / 12	11-07-00	5-02-09	2 x 4	1-03-08	1-01-08 1-04-13	45.7 28.50		




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: C STD

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424160
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T36 Jack-Closed Girder	8 /12	3-00-08	5-05-02	2 x 4 2 x 6		3-04-13 5-05-02	42.63 28.00		
	1	T37 Hip Girder	8 /12	21-06-00	5-05-02	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	116.32 73.17		
	1	T38 Hip	8 /12	21-03-00	6-09-02	2 x 4	1-03-08	1-04-13 3-06-13	100.04 64.50		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.84 106.67		
	1	J2 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	19.36 11.67		
	4	J8 Jack-Open	8 /12	3-00-08	3-05-02	2 x 4	1-03-08	1-04-13 3-05-02	48.98 33.33		
	4	J9 Jack-Open	12 /12	1-07-08	3-06-00	2 x 4	1-03-08	1-10-08 3-06-00	40.69 28.00		
	2	J10 Jack-Open	12 /12	2-03-08	4-02-00	2 x 4	1-03-08	1-10-08 4-02-00	23.84 16.67		
	2	C1 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	C4 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	1	C7 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.67 10.33		
	1	C8 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.93 9.00		

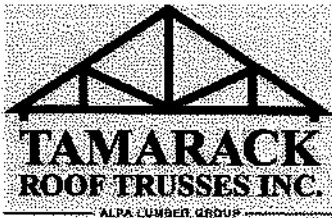 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: FORESTSIDE ESTATES Location: BRAMPTON Model: 38-02 Lot #: Elevation: C STD	Job Track: 52647 PlanLog: 205701 Layout ID: 424160 Ref # Page: 3 of 3 Date: 07-21-2022 Designer: Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. 8FT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C9 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	19.15 12.67		
	1	C10 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C11 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01-09	1-04-13 2-08-02	10.7 7.67		


TOTAL # TRUSS= 69 TOTAL BFT OF ALL TRUSSES= 2503.83 BFT. TOTAL WEIGHT OF ALL TRSSES 3974.54 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1		HUC26-2	
1	Hardware	LJS26DS	
1	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 4

DELIVERY SHIPLIST

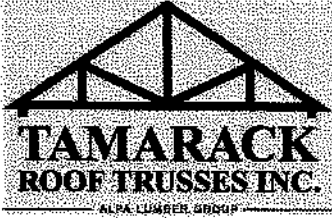


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: C OPT. COFF

Job Track: 52647
 PlanLog: 205701
 Layout ID: 424161
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	29-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	278.62 177.67		
	1	T2S Hip	6 /12	29-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	124.62 80.17		
	1	T3S Hip	6 /12	29-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	125.64 80.00		
	1	T4S Hip	6 /12	29-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.85 87.00		
	1	T5S Hip	6 /12	29-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	141.93 90.83		
	11	T6 Common	6 /12	29-00-00	8-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1245.64 773.67		
	1 2-ply	T13Z Flat Girder	0 /12	5-10-08	2-00-00	2 x 4 2 x 6		2-00-00 2-00-00	51.42 33.33		
	1	T20 Half Hip Girder	6 /12	5-10-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	23.33 16.50		
	1 2-ply	T28 Hip Girder	8 /12	29-00-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	305.12 190.00		
	2	T29 Hip	8 /12	29-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	241.09 152.33		
	2	T30 Hip	8 /12	29-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	267.44 169.33		
	2	T31 Hip	8 /12	29-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	259.18 162.00		
	1	T33 Hip Girder	8 /12	7-10-00	3-06-00	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	43.13 26.83		
	1	T34 Hip Girder	8 /12	12-00-00	4-02-00	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	59.91 36.50		

DELIVERY SHIPLIST

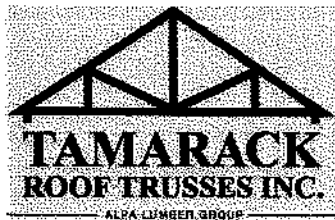


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: 38-02
 Lot #:
 Elevation: C OPT. COFF


Job Track: 52647
 PlanLog: 205701
 Layout ID: 424161
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T35 Common	8 / 12	11-07-00	5-02-09	2 x 4	1-03-08	1-01-08 1-04-13	45.7 28.50		
	1 2-ply	T36 Jack-Closed Girder	8 / 12	3-00-08	5-05-02	2 x 4 2 x 6		3-04-13 5-05-02	42.63 28.00		
	1	T37 Hip Girder	8 / 12	21-06-00	5-05-02	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	116.32 73.17		
	1	T38 Hip	8 / 12	21-03-00	6-09-02	2 x 4	1-03-08	1-04-13 3-06-13	100.04 64.50		
	4	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	167.06 109.33		
	1	J2 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	19.36 11.67		
	3	J6 Jack-Open	6 / 12	1-06-08	1-11-04	2 x 4	1-03-08	1-02-00 1-11-04	18.99 14.00		
	4	J8 Jack-Open	8 / 12	3-00-08	3-05-02	2 x 4	1-03-08	1-04-13 3-05-02	48.98 33.33		
	4	J9 Jack-Open	12 / 12	1-07-08	3-06-00	2 x 4	1-03-08	1-10-08 3-06-00	40.69 28.00		
	2	J10 Jack-Open	12 / 12	2-03-08	4-02-00	2 x 4	1-03-08	1-10-08 4-02-00	23.84 16.67		
	1	C1 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		
	1	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		

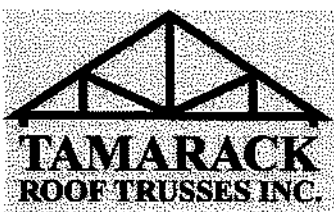DELIVERY SHIPLIST				
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track:	52647
	Builder:	ROYAL PINE HOMES	PlanLog:	205701
	Project:	FORESTSIDE ESTATES	Layout ID:	424161
	Location:	BRAMPTON	Ref #	
	Model:	38-02	Page:	3 of 3
	Lot #:		Date:	07-21-2022
	Elevation:	C OPT. COFF	Designer:	
		Sales Rep:	Rick DiCiano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C4 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C7 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	16.67 10.33		
	1	C8 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.93 9.00		
	2	C9 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	19.15 12.67		
	1	C10 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.31 7.67		
	1	C11 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01-09	1-04-13 2-08-02	10.7 7.67		

TOTAL # TRUSS= 71 TOTAL BFT OF ALL TRUSSES= 2600.01 BFT. TOTAL WEIGHT OF ALL TRSSES 4110.86 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1		HUC26-2	
1	Hardware	LJS26DS	
2	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 5


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Mon Jul 18 14:43:53 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-sGqlqGdIHuQH4LdV6Y4KGYWQFZ9vAxkHGRvnywvpUK

1-3-8 0-0 5-10-8 5-10-8 2-0-12 7-17-4 10-2-14 14-5-0 4-3-2 4-3-2 18-8-2 2-3-10 21-0-12 2-0-12 23-1-8 5-10-8 29-0-0 1-3-8

Scale = 1:52 d



TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DWG # TR22070081 PG 1/2

S-AB	0/0	-18.5	-18.5	0.07 (4)	10.00
AB-AC	0/0	-18.5	-18.5	0.07 (4)	10.00
AC-AC	0/0	-18.5	-18.5	0.07 (4)	10.00
R-AD	0/3460	-18.5	-18.5	0.25 (1)	10.00
AD-AE	0/3480	-18.5	-18.5	0.25 (1)	10.00
AE-Q	0/3460	-18.5	-18.5	0.25 (1)	10.00
Q-P	0/4795	-18.5	-18.5	0.36 (1)	10.00
P-AF	0/4795	-18.5	-18.5	0.36 (1)	10.00
AF-Q	0/4795	-18.5	-18.5	0.36 (1)	10.00
Q-AG	0/4795	-18.5	-18.5	0.36 (1)	10.00
AG-N	0/4795	-18.5	-18.5	0.36 (1)	10.00
N-M	0/4795	-18.5	-18.5	0.36 (1)	10.00
M-AH	0/3460	-18.5	-18.5	0.25 (1)	10.00
AH-AL	0/3460	-18.5	-18.5	0.25 (1)	10.00
AL-L	0/3480	-18.5	-18.5	0.25 (1)	10.00
L-LJ	0/0	-18.5	-18.5	0.07 (4)	10.00
AJ-AK	0/0	-18.5	-18.5	0.07 (4)	10.00
AK-K	0/0	-18.5	-18.5	0.07 (4)	10.00

JSI GRIP= 0.86 (H) (INPUT = 0.90)
JSI METAL= 0.46 (P) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:43:54 2022 Page 2
ID:MG2m827sUOS8Z5oGNm1 zpZL9-KTO7u2HFWJPI2RfXBCandYoiGobCuMQ4zy? RDvwpJJ

PLATES (Table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	2.00	3.00
C ITWW-m	MT20	5.0	6.0	2.25	1.75
D TMWW-t	MT20	4.0	4.0		
E TMW-w	MT20	2.0	4.0		
F TS-t	MT20	3.0	8.0		
G TMWW-t	MT20	4.0	4.0		
H ITWW-m	MT20	5.0	6.0	2.25	1.75
I TMVW-p	MT20	5.0	6.0	2.00	3.00
K BMV1+p	MT20	3.0	6.0		
L, M, Q, R					
L BMWW-t	MT20	5.0	6.0		
N BS-t	MT20	5.0	6.0		
O BMWWW-t	MT20	5.0	8.0		
P BS-t	MT20	5.0	6.0		
S BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
G	19-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
H	23-1-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
L	23-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
M	19-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
N	17-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
X	15-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
Y	17-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AA	21-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AF	13-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AG	15-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	21-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	25-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
	27-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

STRUCTURAL COMPONENT ONLY



DWG # TR22070081 PG 2/2



CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T1S	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 5 Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:51:05 2022 Page 2

ID:MG2m827sjUOS1Z5cGNm1 zpZL9-CNw3LPVc0libFg6NxDbssbQ9KuzdTNBaw4Vvi3kywpNa

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	1.75
D	TMWW-t	MT20	5.0	6.0		
E	TMV+p	MT20	3.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.25	3.00
I	TMVW+p	MT20	4.0	4.0	1.50	2.00
J	TMVW-t	MT20	5.0	8.0		
L	BMVW-t	MT20	5.0	6.0		
M	BMV+p	MT20	3.0	8.0		
N	BMVW-t	MT20	6.0	10.0	3.00	8.25
O	BMVW-t	MT20	4.0	6.0		
P	BMVW-t	MT20	6.0	8.0		
Q	BMVWW-t	MT20	10.0	12.0	Edge	4.50
R	BMV+p	MT20	3.0	8.0		
S	BMVW-t	MT20	6.0	7.0	2.75	1.75
T	BMVW-t	MT20	5.0	6.0		
U	BMV+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
AN-AC	0 / 7175	-18.5	-18.5 0.52 (1)	10.00			
AD-N	0 / 7175	-18.5	-18.5 0.52 (1)	10.00			
M-N	0 / 19	0.0	0.0 0.44 (1)	10.00			
N-I	0 / 816	0.0	0.0 0.51 (1)	10.00			
M-L	0 / 590	-18.5	-18.5 0.04 (1)	10.00			


SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1 MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-295	-295	---	FRONT	VERT	TOTAL	C1
H	23-1-8	-145	-145	---	FRONT	VERT	TOTAL	C1
N	27-2-4	-195	-195	---	FRONT	VERT	TOTAL	C1
O	23-0-12	-68	-68	---	FRONT	VERT	TOTAL	C1
T	5-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
V	7-11-4	-71	-71	---	FRONT	VERT	TOTAL	C1
W	9-11-4	-71	-71	---	FRONT	VERT	TOTAL	C1
X	11-11-4	-71	-71	---	FRONT	VERT	TOTAL	C1
Y	13-11-4	-67	-67	---	FRONT	VERT	TOTAL	C1
Z	15-0-12	-67	-67	---	FRONT	VERT	TOTAL	C1
AA	17-0-12	-67	-67	---	FRONT	VERT	TOTAL	C1
AB	19-0-12	-67	-67	---	FRONT	VERT	TOTAL	C1
AC	21-0-12	-67	-67	---	FRONT	VERT	TOTAL	C1
AD	1-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
AE	3-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
AF	7-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
AG	9-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
AH	11-11-4	-21	-21	---	FRONT	VERT	TOTAL	C1
AI	13-11-4	-68	-68	---	FRONT	VERT	TOTAL	C1
AJ	15-0-12	-68	-68	---	FRONT	VERT	TOTAL	C1
AK	17-0-12	-68	-68	---	FRONT	VERT	TOTAL	C1
AL	19-0-12	-68	-68	---	FRONT	VERT	TOTAL	C1
AM	21-0-12	-68	-68	---	FRONT	VERT	TOTAL	C1
AN	23-4-12	-68	-68	---	FRONT	VERT	TOTAL	C1
AO	25-4-12	-68	-68	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

STRUCTURAL COMPONENT ONLY

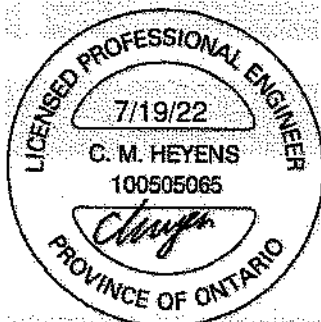


DWG # TR22070102 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:54 2022 Page 1

ID:MG2m827sjUOSRZ5oGNm1 zpZL9-KT07u2HFWJP2RfXBcndYogcqa uio4zv? RDywpUJ

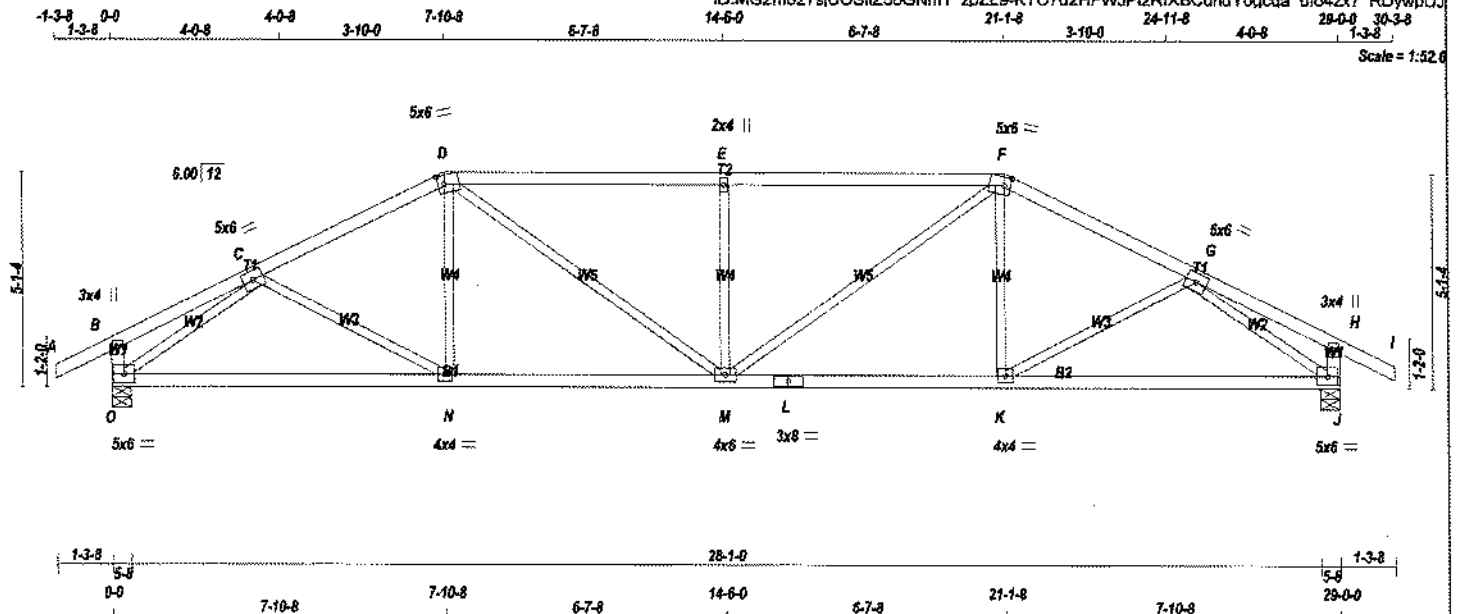

TOTAL WEIGHT = 112 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-l	MT20	5.0	6.0		
D TMWW-m	MT20	5.0	6.0	2.50	1.75
E TMWW-w	MT20	2.0	4.0		
F TMWW-m	MT20	5.0	6.0	2.50	1.75
G TMWW-l	MT20	5.0	6.0		
H TMV+p	MT20	3.0	4.0		
J BMVW1-t	MT20	5.0	6.0		
K BMVW-l	MT20	4.0	6.0		
L BS-l	MT20	3.0	8.0		
M BMVWV-l	MT20	4.0	6.0		
N BMVW-l	MT20	4.0	4.0		
O BMVW1-l	MT20	5.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
O	1614	0	1614	0
J	1614	0	1614	0

UNFACTORED REACTIONS

	1ST CASE	MAX	MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE	PERM.LIVE
O	1143	739 / 0	0 / 0	0 / 0
J	1143	739 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.06 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.9	-84.9 0.11 (1)	C-N	0 / 79	0.03 (4)	
B-C	0 / 19	-84.9	-84.9 0.20 (1)	N-D	0 / 140	0.05 (4)	
C-D	-2040 / 0	-84.9	-84.9 0.25 (1)	D-M	0 / 671	0.15 (1)	
D-E	-2356 / 0	-84.9	-84.9 0.58 (1)	M-E	-691 / 0	0.27 (1)	
E-F	-2356 / 0	-84.9	-84.9 0.58 (1)	M-F	0 / 671	0.15 (1)	
F-G	-2040 / 0	-84.9	-84.9 0.25 (1)	K-F	0 / 140	0.05 (4)	
G-H	0 / 19	-84.9	-84.9 0.20 (1)	K-G	0 / 79	0.03 (4)	
H-I	0 / 26	-84.9	-84.9 0.11 (1)	O-C	-2222 / 0	0.68 (1)	
O-B	-218 / 0	0.0	0.0 0.02 (1)	G-J	-2222 / 0	0.68 (1)	
J-H	-218 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1776	-18.5	-18.5 0.43 (1)				
N-M	0 / 1814	-18.5	-18.5 0.44 (1)				
M-L	0 / 1814	-18.5	-18.5 0.44 (1)				
L-K	0 / 1814	-18.5	-18.5 0.44 (1)				
K-J	0 / 1776	-18.5	-18.5 0.43 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CS1: TC=0.58/1.00 (D-E:1), BC=0.44/1.00 (K-M:1), WB=0.66/1.00 (G-J:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 660 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.57 (L) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

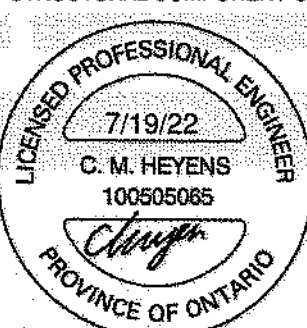


DWG # TR22070082

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:51:05 2022 Page 1

ID:MG2m827siUOSfZ5oGNm1 zpZL9-CHw3LPVc0libFg6NxDssbQ9OKZfeNE5W4Vvi3kywoNa

Scale = 1:53.6

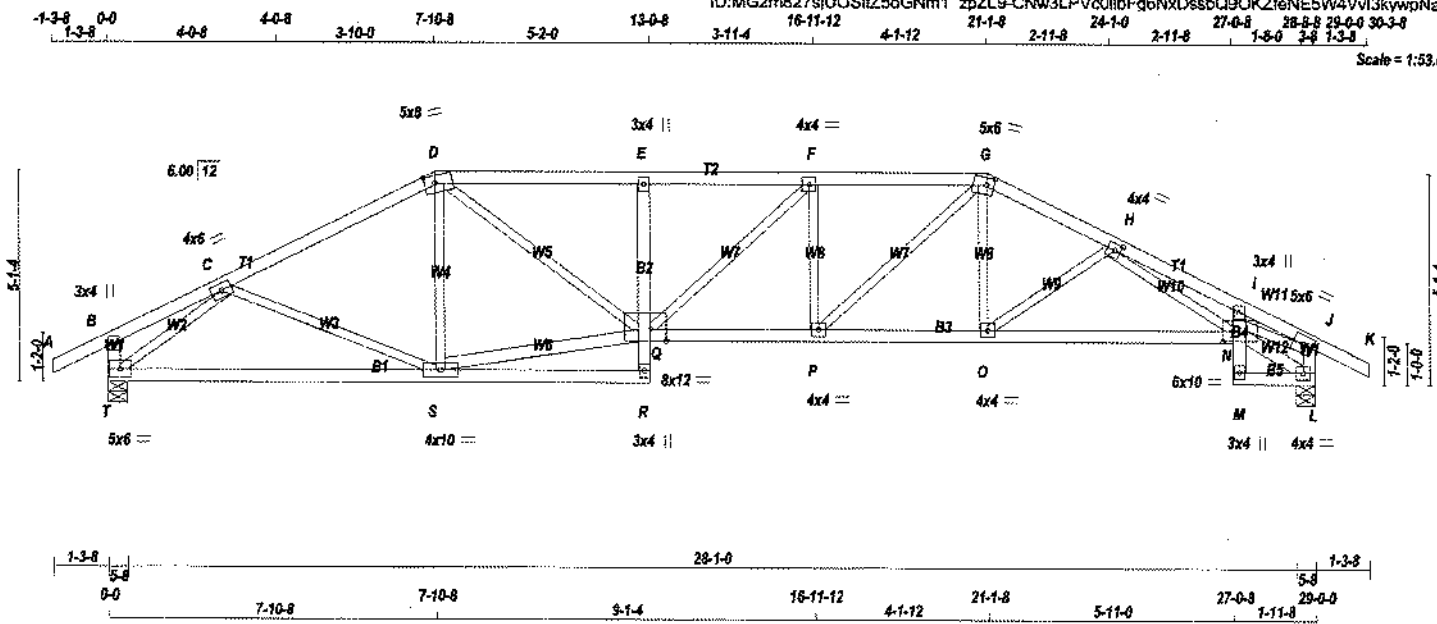

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - E	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
M - I	2x4	DRY	No.2
M - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - Q	2x4	DRY	No.2
N - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B, E, I				
B	TMV+P	MT20	3.0	4.0
C	TMVW+I	MT20	4.0	6.0
D	TTVW+M	MT20	5.0	8.0
F	TMVW+I	MT20	4.0	4.0
G	TTVW+M	MT20	5.0	6.0
H	TMVW+I	MT20	4.0	4.0
J	TMVW+I	MT20	5.0	6.0
L	BMVW+I	MT20	4.0	4.0
M	BMV+P	MT20	3.0	4.0
N	BMVW+I	MT20	6.0	10.0
O	BMVW+I	MT20	4.0	4.0
P	BMVW+I	MT20	4.0	4.0
Q	BMVW+I	MT20	4.0	12.0
R	BMV+P	MT20	3.0	4.0
S	BMVW+I	MT20	4.0	10.0
T	BMVW+I	MT20	5.0	6.0

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
T	1611	0	1611	0	0	5-8	5-8	5-8	5-8
L	1617	0	1617	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	VERT.	SNOW	VERT.	SNOW	VERT.	SNOW	VERT.	SNOW	VERT.	SNOW	VERT.	SNOW	VERT.
T	1142	737 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
L	1145	740 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.61 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE		FACTORED VERT. LOAD		MAX. FACTORED FORCE		MAX. FACTORED FORCE		MAX. FACTORED FORCE		MAX. FACTORED FORCE		MAX. FACTORED FORCE	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1	MAX	MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1	MAX	MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)
FR-TO						FR-TO						FR-TO			
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00	C-S	0 / 110	0.04 (4)				C-S	0 / 110	0.04 (4)	
B-C	0 / 29	-84.9	-84.9	0.25 (1)	10.00	S-D	-235 / 0	0.09 (1)				S-D	-235 / 0	0.09 (1)	
C-D	-2037 / 0	-84.9	-84.9	0.33 (1)	4.44	S-Q	0 / 1768	0.28 (1)				S-Q	0 / 1768	0.28 (1)	
D-E	-2632 / 0	-84.9	-84.9	0.36 (1)	3.83	D-Q	0 / 1285	0.29 (1)				D-Q	0 / 1285	0.29 (1)	
E-F	-2852 / 0	-84.9	-84.9	0.28 (1)	3.89	O-G	0 / 401	0.09 (1)				O-G	0 / 401	0.09 (1)	
F-G	-2767 / 0	-84.9	-84.9	0.26 (1)	3.96	T-C	-2197 / 0	0.50 (1)				T-C	-2197 / 0	0.50 (1)	
G-H	-2534 / 0	-84.9	-84.9	0.19 (1)	4.20	N-L	-252 / 0	0.03 (1)				N-L	-252 / 0	0.03 (1)	
H-I	-3367 / 0	-84.9	-84.9	0.34 (1)	3.54	N-J	0 / 2781	0.63 (1)				N-J	0 / 2781	0.63 (1)	
I-J	-3154 / 0	-84.9	-84.9	0.24 (1)	3.75	P-G	0 / 715	0.16 (1)				P-G	0 / 715	0.16 (1)	
J-K	0 / 26	-84.9	-84.9	0.11 (1)	10.00	Q-F	0 / 88	0.02 (1)				Q-F	0 / 88	0.02 (1)	
T-B	-167 / 0	0.0	0.0	0.02 (1)	7.81	P-F	-417 / 0	0.11 (1)				P-F	-417 / 0	0.11 (1)	
L-J	-1478 / 0	0.0	0.0	0.15 (1)	6.74	H-N	0 / 518	0.12 (1)				H-N	0 / 518	0.12 (1)	
						O-H	-490 / 0	0.13 (1)				O-H	-490 / 0	0.13 (1)	
T-S	0 / 1706	-18.5	-18.5	0.41 (1)	10.00										
S-R	0 / 74	-18.5	-18.5	0.26 (4)	10.00										
R-Q	0 / 29	0.0	0.0	0.10 (1)	10.00										
Q-E	-430 / 0	0.0	0.0	0.10 (1)	7.81										
Q-P	0 / 2787	-18.5	-18.5	0.50 (1)	10.00										
P-O	0 / 2261	-18.5	-18.5	0.44 (1)	10.00										
O-N	0 / 2647	-18.5	-18.5	0.51 (1)	10.00										
M-N	0 / 19	0.0	0.0	0.30 (1)	10.00										
N-I	-124 / 0	0.0	0.0	0.23 (1)	7.81										
M-L	0 / 220	-18.5	-18.5	0.05 (1)	10.00										

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.36/1.00 (D-E-1), BC=0.51/1.00 (N-O-1), WB=0.83/1.00 (J-N-1), SS=0.23/1.00 (I-N-1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES					
PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1587

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (U) (INPUT = 0.90)
JSI METAL= 0.74 (U) (INPUT = 1.00)

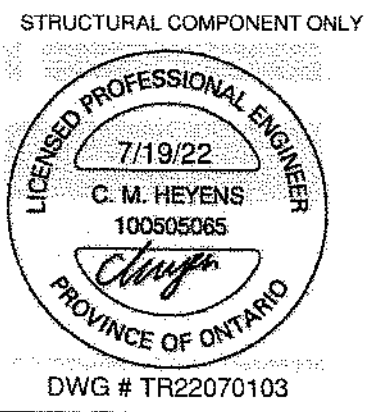

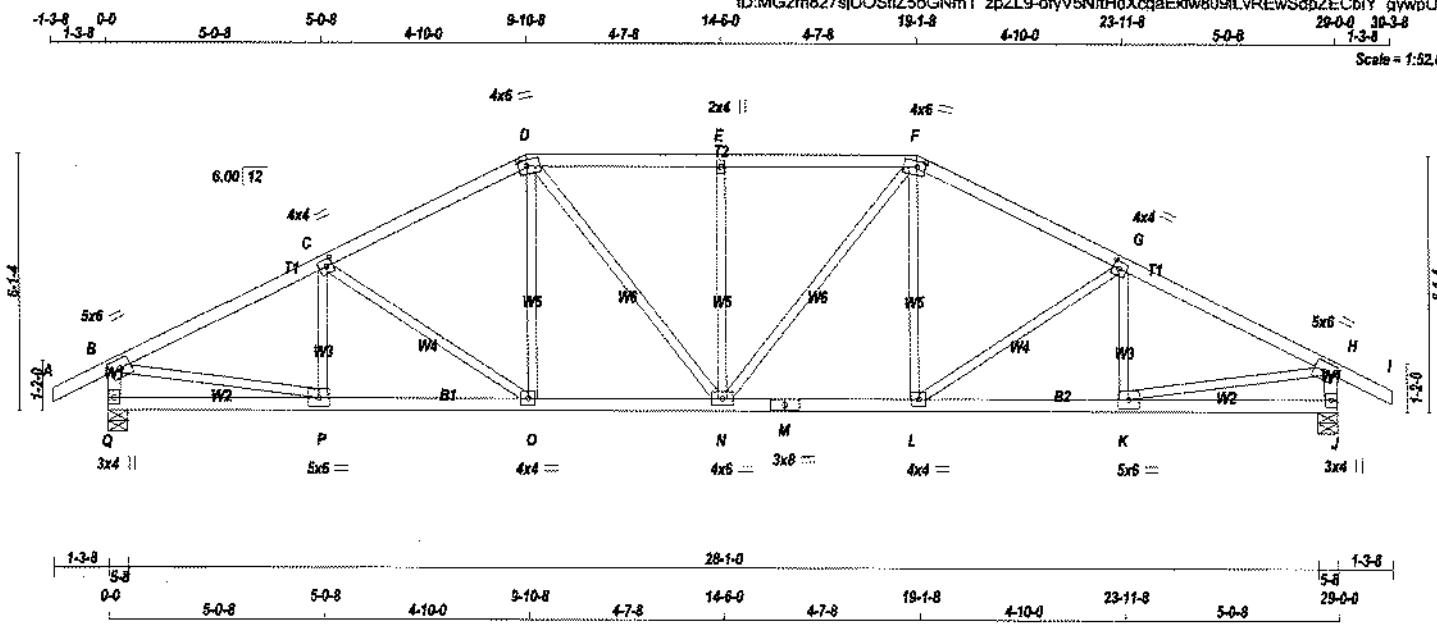

TOTAL WEIGHT = 121 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
Q - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
Q - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	4.0	6.0	1.75 2.25
E	TMVW-w	MT20	2.0	4.0	
F	TTWV-m	MT20	4.0	6.0	1.75 2.25
G	TMVW-1	MT20	4.0	4.0	2.00 1.75
H	TMVW-1	MT20	5.0	6.0	
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	
L	BMVW-1	MT20	4.0	4.0	
M	BS-1	MT20	3.0	6.0	
N	BMVWVW-t	MT20	4.0	6.0	
O	BMVW-1	MT20	4.0	4.0	
P	BMVW-1	MT20	5.0	6.0	
Q	BMV1+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REGRD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1614	0	1614	0	5-8	5-8
J	1614	0	1614	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	LIVE				
Q	1143	739 / 0	0 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0
J	1143	739 / 0	0 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.37 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS		MEMB.	CHORDS		MEMB.
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	
FR-TO					FR-TO			
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00	P-C	-233 / 0	0.05 (1)
B-C	-2131 / 0	-84.9	-84.9	0.32 (1)	4.37	C-O	-291 / 0	0.18 (1)
C-D	-1906 / 0	-84.9	-84.9	0.30 (1)	4.59	O-D	0 / 258	0.06 (1)
D-E	-1809 / 0	-84.9	-84.9	0.27 (1)	4.62	D-H	0 / 354	0.08 (1)
E-F	-1909 / 0	-84.9	-84.9	0.27 (1)	4.62	N-E	-477 / 0	0.28 (1)
F-G	-1906 / 0	-84.9	-84.9	0.30 (1)	4.59	N-F	0 / 354	0.08 (1)
G-H	-2131 / 0	-84.9	-84.9	0.32 (1)	4.37	L-F	0 / 258	0.06 (1)
H-I	0 / 26	-84.9	-84.9	0.11 (1)	10.00	L-G	-291 / 0	0.18 (1)
Q-B	-1572 / 0	0.0	0.0	0.16 (1)	6.58	K-G	-233 / 0	0.05 (1)
J-H	-1572 / 0	0.0	0.0	0.16 (1)	6.58	B-P	0 / 1952	0.44 (1)
						K-H	0 / 1952	0.44 (1)
Q-P	0 / 0	-18.5	-18.5	0.10 (4)	10.00			
P-O	0 / 1924	-18.5	-18.5	0.36 (1)	10.00			
O-N	0 / 1689	-18.5	-18.5	0.32 (1)	10.00			
N-M	0 / 1689	-18.5	-18.5	0.32 (1)	10.00			
M-L	0 / 1689	-18.5	-18.5	0.32 (1)	10.00			
L-K	0 / 1924	-18.5	-18.5	0.36 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.97")

CALCULATED VERT. DEFL. (LL) = 1/999 (0.09")

ALLOWABLE DEFL. (TL) = L/360 (0.97")

CALCULATED VERT. DEFL. (TL) = 1/999 (0.17")

CSI: TC=0.32/1.00 (G-H:1), BC=0.36/1.00 (O-P:1)

WB=0.44/1.00 (B-P:1), SS=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (K) (INPUT = 0.90)

JSI METAL= 0.52 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

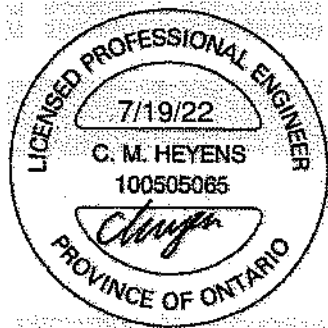


DWG # TR22070083

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T3S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:51:06 2022 Page 1
ID:MG2m827sjUOSnZ5oGNm1 zpZL9-haURYIWEn2qStphZVxN57ehXFz 56hDqJ9frcBywpNZ

Scale = 1:53.6

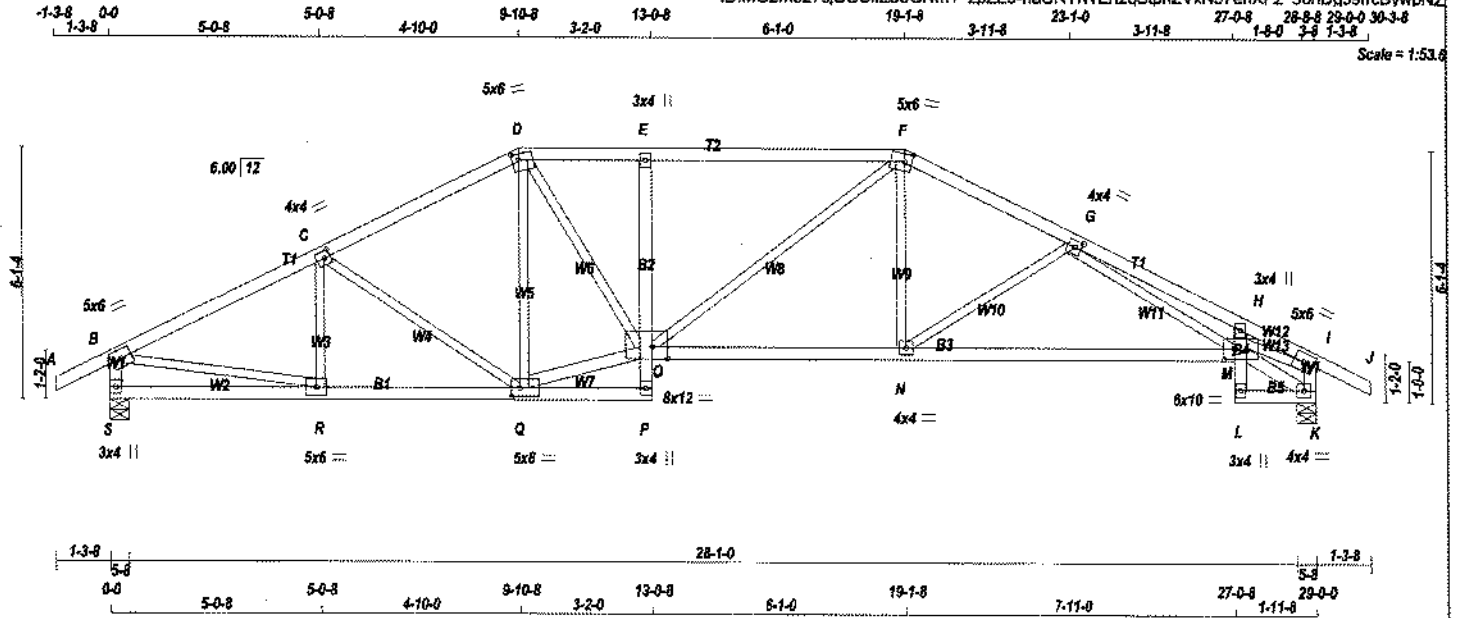

TOTAL WEIGHT = 126 lb

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF			
D - F	2x4	DRY	No.2	SPF			
F - J	2x4	DRY	No.2	SPF			
S - B	2x4	DRY	No.2	SPF			
K - I	2x4	DRY	No.2	SPF			
S - P	2x4	DRY	No.2	SPF			
P - E	2x4	DRY	No.2	SPF			
O - M	2x4	DRY	No.2	SPF			
L - H	2x4	DRY	No.2	SPF			
L - K	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
Q - O	2x4	DRY	No.2	SPF			
M - K	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	1.75	2.00
E	TMVW-p	MT20	3.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	3.0	4.0		
I	TMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	4.0	4.0		
L	BMVW-p	MT20	3.0	4.0		
M	BMVWVWV-t	MT20	6.0	10.0	3.00	3.00
N	BMVW-t	MT20	4.0	4.0		
O	BMVWVWV-t	MT20	8.0	12.0	3.50	4.50
P	BMVW-p	MT20	3.0	4.0		
Q	BMVWVWV-t	MT20	5.0	8.0	2.50	2.50
R	BMVW-t	MT20	5.0	6.0		
S	BMVW-t	MT20	3.0	4.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

STRUCTURAL COMPONENT ONLY



DWG # TR22070104

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION			
JT	VERT	HORZ	DOWN	HORZ	BRG	BRG
S	1611	0	1611	0	5-8	5-8
K	1617	0	1617	0	5-8	5-8

UNFACTORED REACTIONS

	1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW							
JT	1142	737 / 0	0 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0	0 / 0
K	1145	740 / 0	0 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.51 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FACTORED	
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00	R-C	-234 / 0	0.05 (1)
B-C	-2126 / 0	-84.9	-84.9 0.32 (1)	4.38	C-Q	-289 / 0	0.18 (1)
C-D	-1905 / 0	-84.9	-84.9 0.30 (1)	4.59	Q-D	-291 / 0	0.17 (1)
D-E	-2274 / 0	-84.9	-84.9 0.36 (1)	4.18	Q-O	0 / 1729	0.28 (1)
E-F	-2282 / 0	-84.9	-84.9 0.47 (1)	4.06	D-O	0 / 1110	0.25 (1)
F-G	-2298 / 0	-84.9	-84.9 0.26 (1)	4.30	O-F	0 / 298	0.07 (1)
G-H	-3427 / 0	-84.9	-84.9 0.37 (1)	3.51	N-F	0 / 492	0.11 (1)
H-I	-3186 / 0	-84.9	-84.9 0.21 (1)	3.77	N-G	-590 / 0	0.26 (1)
I-J	0 / 26	-84.9	-84.9 0.11 (1)	10.00	G-M	0 / 689	0.16 (1)
S-B	-1589 / 0	0.0	0.0 0.16 (1)	6.58	B-R	0 / 1948	0.44 (1)
K-I	-1477 / 0	0.0	0.0 0.15 (1)	6.74	M-K	-254 / 0	0.03 (1)
					M-I	0 / 2817	0.63 (1)
S-R	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
R-Q	0 / 1920	-18.5	-18.5 0.36 (1)	10.00			
Q-P	0 / 41	-18.5	-18.5 0.07 (4)	10.00			
P-O	0 / 20	0.0	0.0 0.06 (1)	10.00			
O-E	-523 / 0	0.0	0.0 0.12 (1)	7.81			
O-N	0 / 2046	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 / 2526	-18.5	-18.5 0.56 (1)	10.00			
L-M	0 / 19	0.0	0.0 0.31 (1)	10.00			
M-H	-189 / 0	0.0	0.0 0.23 (1)	7.81			
L-K	0 / 222	-18.5	-18.5 0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CSI: YC=0.47/1.00 (E-F:1), BC=0.66/1.00 (M-N:1), WB=0.83/1.00 (I-M:1), SS=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.90 (1) (INPUT = 0.90)
JSI METAL = 0.74 (1) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T4	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:43:56 2022 Page 1

ID:MG2m827sJuoStZ5oGNm1 zpZL9-GrVilJv2xTHkpwJdtFiyu2meGjMFMNQFUSW6wypUH

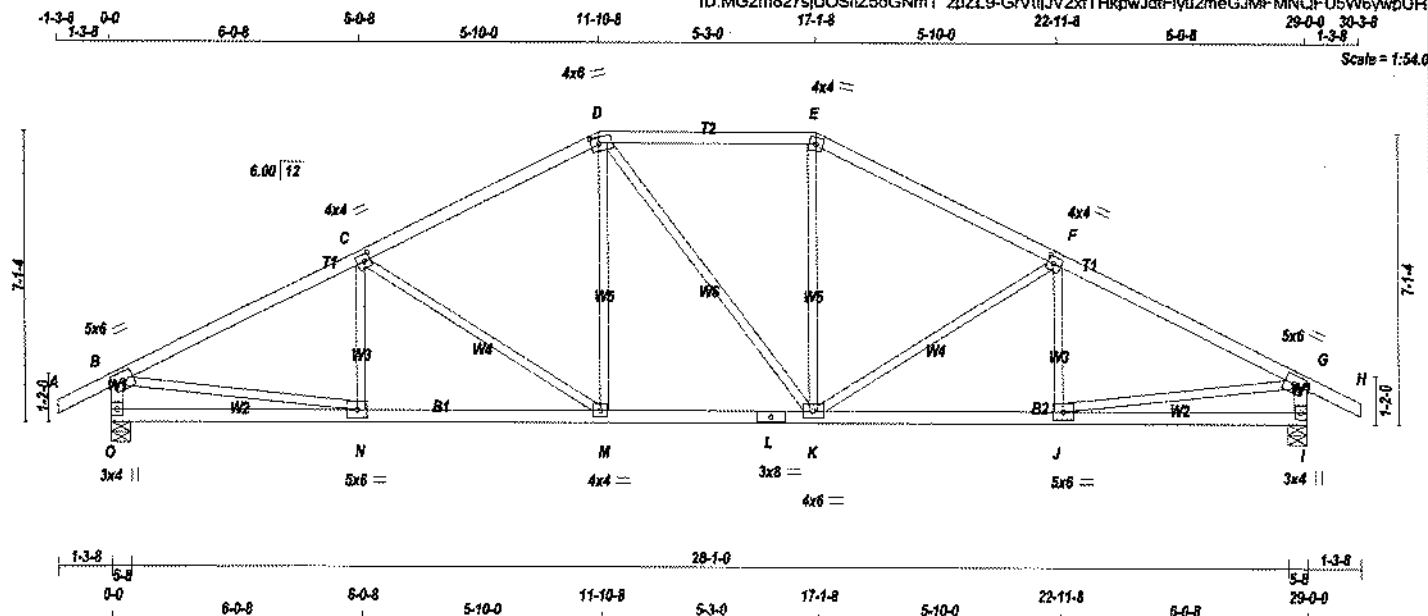

TOTAL WEIGHT = 118 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-t	MT20	5.0	6.0		
C TMWW-t	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	4.0	6.0	1.75	2.25
E TTW-m	MT20	4.0	4.0		
F TMVW-t	MT20	4.0	4.0	2.00	1.75
G TMVW-t	MT20	5.0	6.0		
I BMV1+p	MT20	3.0	4.0		
J BMVW-t	MT20	5.0	6.0		
K BMVW-t	MT20	4.0	6.0		
L BS-t	MT20	3.0	8.0		
M BMVW-t	MT20	4.0	4.0		
N BMVW-t	MT20	5.0	6.0		
O BMV1+p	MT20	3.0	4.0		

NOTES-

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
O	1614	0	1614	0	5-8	5-8	
I	1614	0	1614	0	5-8	5-8	

UNFACTORED REACTIONS

1ST CASE		MAX/MIN		COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1143	739/0	0/0	0/0	0/0	405/0	0/0
I	1143	739/0	0/0	0/0	0/0	405/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	FACTORED	MAX
	FORCE	VERT. LOAD	LC1		FORCE	MAX	
	(LBS)	(PLF)	(LC)		(LBS)	(LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/26	-84.9	-84.9	0.11 (1)	10.00	N-C	-157/40
B-C	-2156/0	-84.9	-84.9	0.47 (1)	4.17	C-M	-485/0
C-D	-1756/0	-84.9	-84.9	0.43 (1)	4.65	M-D	0/366
D-E	-1552/0	-84.9	-84.9	0.33 (1)	4.93	D-K	0/0
E-F	-1757/0	-84.9	-84.9	0.43 (1)	4.58	K-E	0/366
F-G	-2156/0	-84.9	-84.9	0.47 (1)	4.17	K-F	-484/0
G-H	0/26	-84.9	-84.9	0.11 (1)	10.00	J-F	-158/40
C-B	-1566/0	0.0	0.0	0.16 (1)	6.58	B-N	0/1972
I-G	-1566/0	0.0	0.0	0.16 (1)	6.59	J-G	0/1971
O-N	0/0	-18.5	-18.5	0.15 (4)	10.00		
N-M	0/1952	-18.5	-18.5	0.38 (1)	10.00		
M-L	0/1551	-18.5	-18.5	0.31 (1)	10.00		
L-K	0/1551	-18.5	-18.5	0.31 (1)	10.00		
K-J	0/1952	-18.5	-18.5	0.38 (1)	10.00		
J-I	0/0	-18.5	-18.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.97")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (0.97")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.17")

CSI: TC=0.47/1.00 (B-C:1), BC=0.36/1.00 (M-N:1),
WB=0.47/1.00 (C-M:1), SSI=0.22/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	660 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.53 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

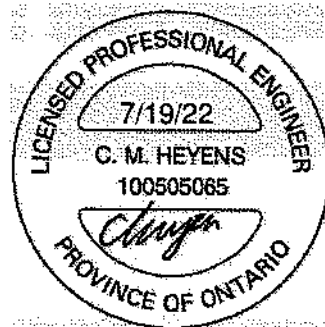


DWG # TR22070084

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T4S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Budington

Version 8.530 S Feb 23 2022 MITEX Industries, Inc. Mon Jul 18 14:51:07 2022 Page 1

ID:MG2m827sjUOSRZ5oGNm1 zpZL9-9m2pm5W5YMyJuzGi3euKqEahNJ5r77pXpOP8dvwpyNY

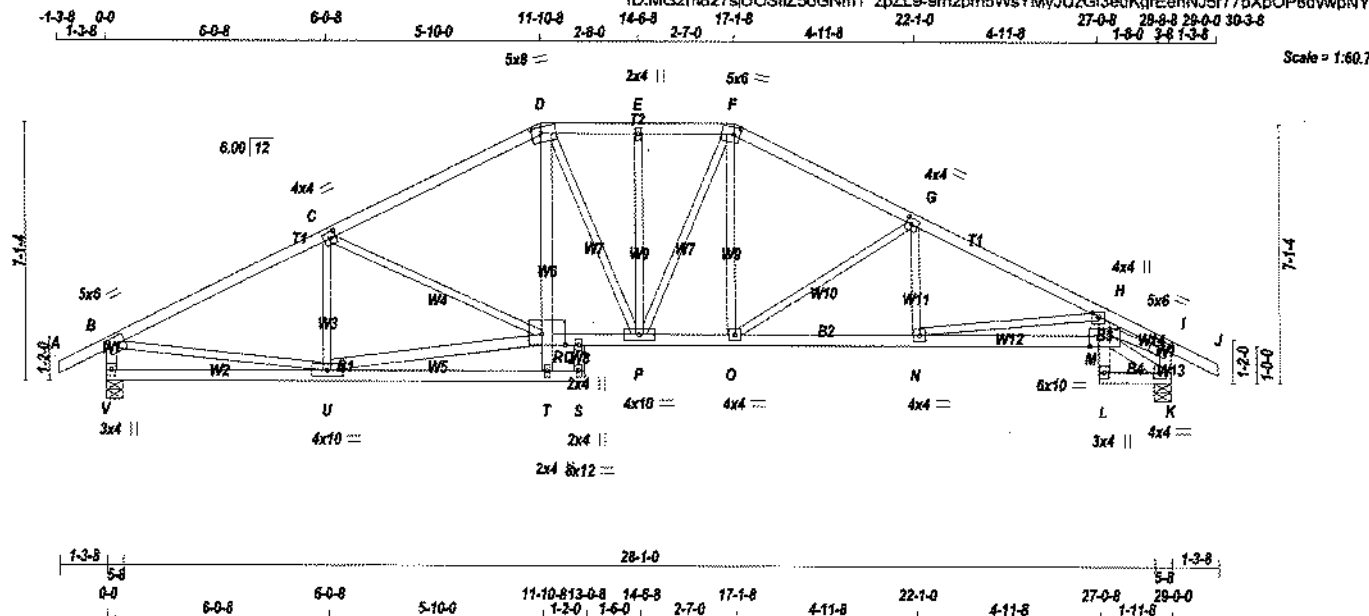

TOTAL WEIGHT = 138 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS										SPECIFIED LOADS:			
CHORDS SIZE				LUMBER		DESCR.		FACTORED		MAXIMUM FACTORED		INPUT		REQD		TOP CH. LL = 23.3 PSF	
A - D 2x4 DRY No.2 SPF								GROSS REACTION		GROSS REACTION		BRG		BRG		DL = 6.0 PSF	
D - F 2x4 DRY No.2 SPF								JT VERT HORZ		DOWN HORZ		UPLIFT IN-SX		IN-SX		BOT CH. LL = 0.0 PSF	
F - J 2x4 DRY No.2 SPF								V 1611 0		1611 0		5-8		5-8		DL = 7.4 PSF	
V - B 2x4 DRY No.2 SPF								K 1617 0		1617 0		0		5-8		TOTAL LOAD = 36.7 PSF	
K - I 2x4 DRY No.2 SPF																	
V - S 2x4 DRY No.2 SPF																	
R - M 2x4 DRY No.2 SPF																	
L - H 2x4 DRY No.2 SPF																	
L - K 2x4 DRY No.2 SPF																	
								UNFACTORED REACTIONS								SPACING = 24.0 IN./C	
								1ST CASE		MAX./MIN. COMPONENT REACTIONS							
								JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL								LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12	
								V 1142 737/0 0/0 0/0 0/0 405/0 0/0								THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2015	
								K 1145 740/0 0/0 0/0 0/0 405/0 0/0									
ALL WEBS EXCEPT				2x3 DRY No.2 SPF													
T - D 2x4 DRY No.2 SPF																	
S - Q 2x4 DRY No.2 SPF																	
U - R 2x4 DRY No.2 SPF																	
M - K 2x4 DRY No.2 SPF																	
								BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, K									
								BRACING									

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-4	MT20	5.0	6.0	
C	TMVW-4	MT20	4.0	4.0	2.00 1.75
D	TTVW-m	MT20	5.0	8.0	2.00 3.00
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-l	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	4.0	4.0	1.50 2.00
I	TMVW-l	MT20	5.0	6.0	2.25 3.00
K	BMVW-l	MT20	4.0	4.0	
L	BMVW-p	MT20	3.0	4.0	
M	BMVW-w	MT20	6.0	10.0	3.75 6.50
N	BMVW-l	MT20	4.0	4.0	
O	BMVW-l	MT20	4.0	4.0	
P	BMVW-w	MT20	4.0	10.0	
Q, S, T					
Q	BMVW-w	MT20	2.0	4.0	
R	BMVW-w	MT20	8.0	12.0	Edge 7.75
U	BMVW-l	MT20	4.0	10.0	
V	BMVW-l	MT20	3.0	4.0	

MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT


ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MEMB.	FORCE (LBS)	MAX. FACTORED (LBS)	MAX. FACTORED (LC)
FR-TO				FR-TO			
A-B	0/26	-84.9	-84.9 0.11 (1)	U-C	-476/0	0.13 (1)	
B-C	-2154/0	-84.9	-84.9 0.89 (1)	T-R	0/109	0.08 (1)	
C-D	-2037/0	-84.9	-84.9 0.66 (1)	R-D	0/499	0.14 (1)	
D-E	-1871/0	-84.9	-84.9 0.11 (1)	O-F	0/508	0.11 (1)	
E-F	-1871/0	-84.9	-84.9 0.11 (1)	Q-G	-777/0	0.50 (1)	
F-G	-2036/0	-84.9	-84.9 0.46 (1)	N-G	0/215	0.06 (4)	
G-H	-2714/0	-84.9	-84.9 0.54 (1)	H-H	-785/0	0.34 (1)	
H-I	-3272/0	-84.9	-84.9 0.22 (1)	B-U	0/1969	0.44 (1)	
I-J	0/26	-84.9	-84.9 0.11 (1)	S-Q	-35/0	0.01 (4)	
V-B	-1565/0	0.0	0.0 0.16 (1)	D-P	0/129	0.03 (1)	
K-I	-1472/0	0.0	0.0 0.15 (1)	P-E	-253/0	0.15 (1)	
				P-F	0/155	0.03 (1)	
V-U	0/0	-18.5	-18.5 0.16 (4)	U-R	0/1933	0.31 (1)	
U-T	0/44	-18.5	-18.5 0.16 (4)	C-R	-169/0	0.14 (1)	
T-S	0/0	-18.5	-18.5 0.08 (4)	M-K	-264/0	0.03 (1)	
R-Q	0/1817	0.0	0.0 0.33 (1)	M-I	0/2913	0.86 (1)	
Q-P	0/1817	-18.5	-18.5 0.33 (1)				
P-O	0/1808	-18.5	-18.5 0.33 (1)				
O-N	0/2449	-18.5	-18.5 0.44 (1)				
N-M	0/3206	-18.5	-18.5 0.58 (1)				
L-M	0/19	0.0	0.0 0.32 (1)				
M-H	0/158	0.0	0.0 0.34 (1)				
L-K	0/231	-18.5	-18.5 0.05 (1)				

STRUCTURAL COMPONENT ONLY

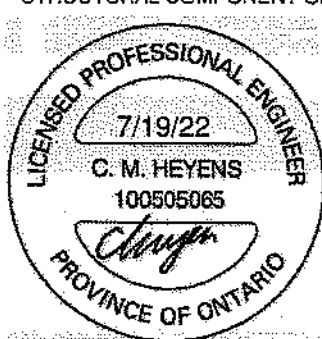

DWG # TR22070105 PG 1/2

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (U) (INPUT = 0.90)
JSI METAL = 0.76 (I) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T4S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version B.530 S Feb 23 2022 Mitak Industries, Inc. Mon Jul 18 14:51:07 2022 Page 2

ID:MG2m827sjUCSfZ5oGNm1 zpZL9-9m2pm5WsYMyJUzGi3euKorEehNJ5r77pXpOP8dywpNY


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY



DWG # TR22070105 PG 2/2

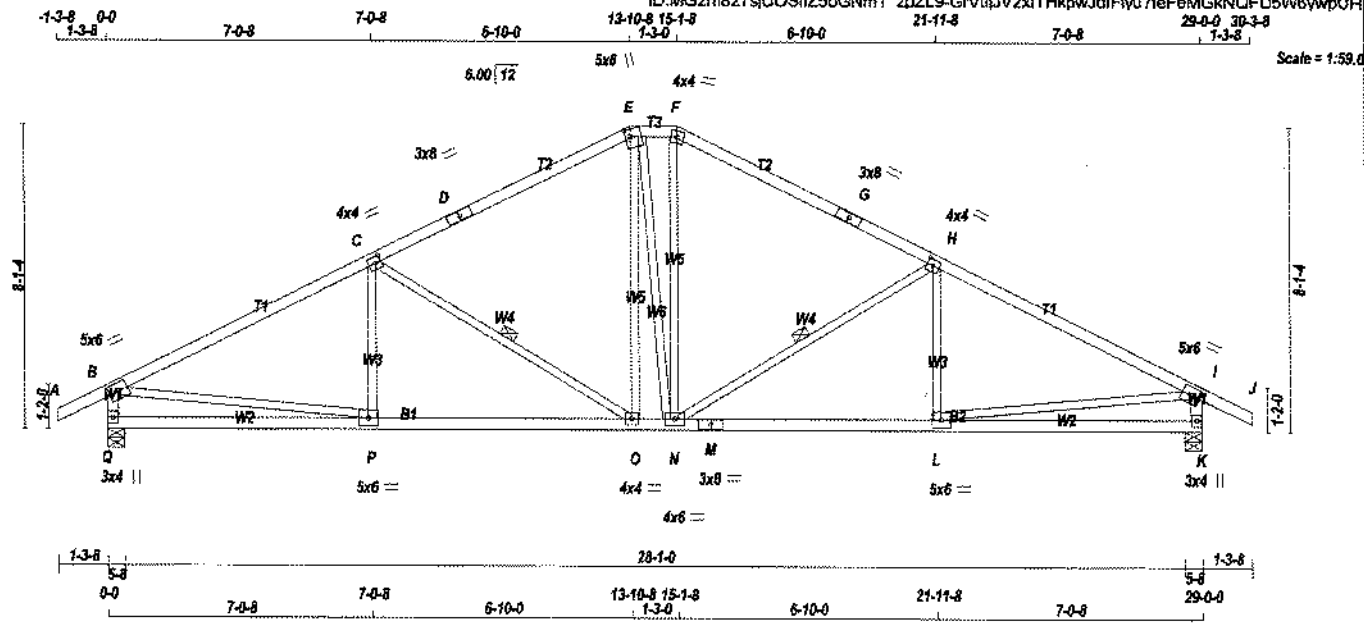

TOTAL WEIGHT = 124 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
Q - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
Q - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	3.0		
E	TTWW+m	MT20	5.0	6.0	2.50	1.50
F	TTW-m	MT20	4.0	4.0		
G	TS-1	MT20	3.0	3.0		
H	TMVW-1	MT20	4.0	4.0	2.00	1.75
I	TMVW-1	MT20	5.0	6.0		
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-1	MT20	5.0	6.0		
M	BS-1	MT20	3.0	3.0		
N	BMVW-1	MT20	4.0	6.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1614	0	1614	0	5-8	5-8
K	1614	0	1614	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
Q	1143	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0
K	1143	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSF (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSF (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 26	-84.9 -84.9	0.11 (1)	10.00	P-C	-92 / 81	0.03 (1)		
B-C	-2156 / 0	-84.9 -84.9	0.67 (1)	3.91	C-Q	-869 / 0	0.31 (1)		
C-D	-1587 / 0	-84.9 -84.9	0.59 (1)	4.51	O-E	0 / 402	0.09 (1)		
D-E	-1587 / 0	-84.9 -84.9	0.59 (1)	4.51	E-N	0 / 25	0.01 (1)		
E-F	-1398 / 0	-84.9 -84.9	0.04 (1)	5.49	N-P	0 / 427	0.10 (1)		
F-G	-1590 / 0	-84.9 -84.9	0.59 (1)	4.50	H-H	-864 / 0	0.30 (1)		
G-H	-1590 / 0	-84.9 -84.9	0.59 (1)	4.50	L-H	-97 / 79	0.03 (1)		
H-I	-2154 / 0	-84.9 -84.9	0.67 (1)	3.91	B-P	0 / 1970	0.44 (1)		
I-J	0 / 26	-84.9 -84.9	0.11 (1)	10.00	L-I	0 / 1989	0.44 (1)		
Q-B	-1560 / 0	0.0 0.0	0.16 (1)	6.58					
K-I	-1559 / 0	0.0 0.0	0.16 (1)	6.60					
Q-P	0 / 0	-18.5 -18.5	0.22 (4)	10.00					
P-O	0 / 1956	-18.5 -18.5	0.42 (1)	10.00					
O-N	0 / 1395	-18.5 -18.5	0.32 (1)	10.00					
N-M	0 / 1955	-18.5 -18.5	0.42 (1)	10.00					
M-L	0 / 1955	-18.5 -18.5	0.42 (1)	10.00					
L-K	0 / 0	-18.5 -18.5	0.21 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2019, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 096-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.97")
CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (0.97")
CALCULATED VERT. DEFL. (TL) = L/999 (0.20")

CSI: TC=0.67/1.00 (B-C:1), BC=0.42/1.00 (O-P:1), WB=0.44/1.00 (B-P:1), SSI=0.26/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.59 (M) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070085

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T5S	1	1	TRUSS DESC.		


Temarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:51:08 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-dycBzRXUJq4A67rycMPZC3nrSntgaa7zmT8yq3ywpNX

1-3-8 0-0 6-7-8 6-7-8 8-5-0 13-0-8 13-10-8 15-1-8 18-0-10 2-11-2 3-0-6 21-1-0 5-11-8 27-0-8 29-0-0 30-3-8 1-11-8 1-3-8

Scale = 1:59.0

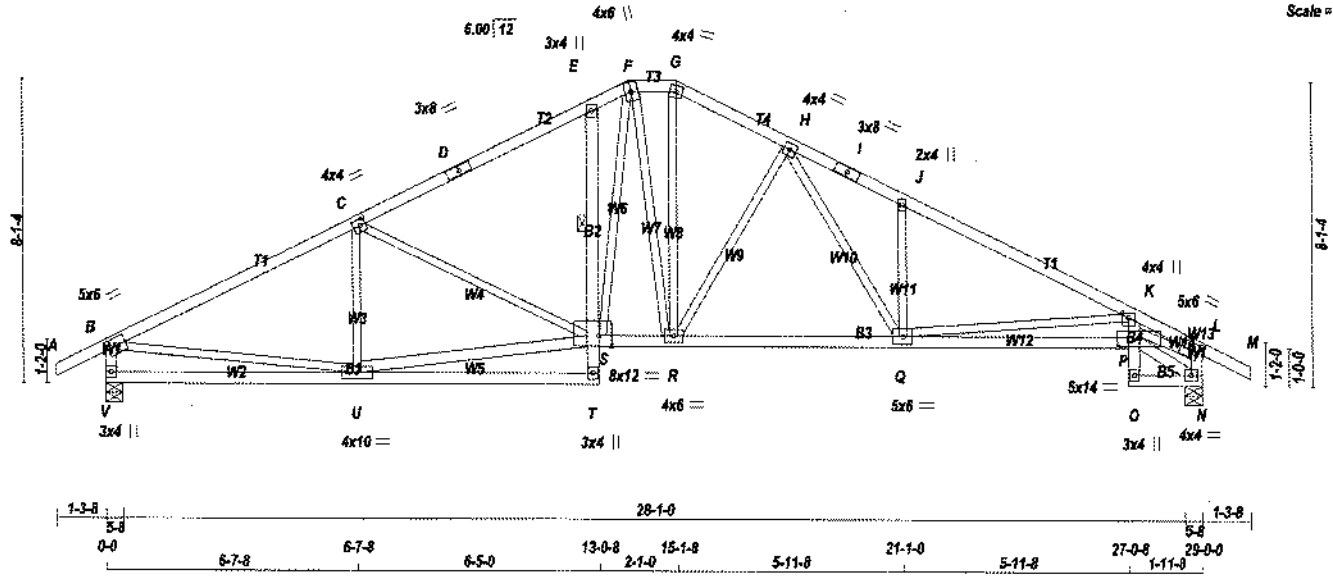

TOTAL WEIGHT = 142 lb


LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - M	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
V - T	2x4	DRY	No.2	SPF
T - E	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
O - K	2x4	DRY	No.2	SPF
O - N	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
U - S	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	6.0		
C	TMVW-I	MT20	4.0	4.0	2.00	1.75
D	TS-I	MT20	3.0	8.0		
E	TMVW-p	MT20	3.0	4.0		
F	TTVW+m	MT20	4.0	6.0		
G	TTW-m	MT20	4.0	4.0		
H	TMVW-I	MT20	4.0	4.0		
I	TS-I	MT20	3.0	8.0		
J	TMVW-w	MT20	2.0	4.0		
K	TMVW-p	MT20	4.0	4.0	1.50	2.00
L	TMVW-I	MT20	5.0	6.0	2.25	2.75
N	BMVW-I	MT20	4.0	4.0		
O	BMVW-p	MT20	3.0	4.0		
P	BMVW-I	MT20	5.0	14.0	3.25	7.00
Q	BMVW-I	MT20	5.0	6.0		
R	BMVW-I	MT20	4.0	6.0		
S	BMVW-I	MT20	8.0	12.0	3.50	4.25
T	BMVW-p	MT20	3.0	4.0		
U	BMVW-I	MT20	4.0	10.0		

STRUCTURAL COMPONENT ONLY

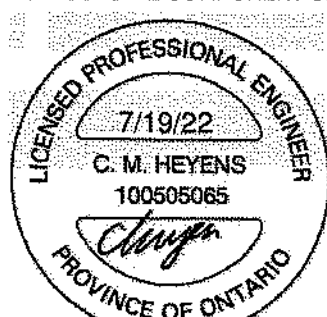

DWG # TR22070106

PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
V	1611	0	1611	0
N	1617	0	1617	0

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SCHL
V	1142	737 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0
N	1145	740 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.9 -84.9	0.11 (1)	10.00	U-C	-412 / 0	0.12 (1)
B-C	-2147 / 0	-84.9 -84.9	0.56 (1)	4.08	U-S	0 / 1926	0.31 (1)
C-D	-1936 / 0	-84.9 -84.9	0.49 (1)	4.34	C-S	-254 / 0	0.24 (1)
D-E	-1936 / 0	-84.9 -84.9	0.49 (1)	4.34	R-G	0 / 617	0.14 (1)
E-F	-1984 / 0	-84.9 -84.9	0.20 (1)	4.62	Q-J	-478 / 0	0.12 (1)
F-G	-1596 / 0	-84.9 -84.9	0.04 (1)	5.21	Q-K	-1003 / 0	0.68 (1)
G-H	-1780 / 0	-84.9 -84.9	0.14 (1)	4.90	B-U	0 / 1959	0.44 (1)
H-I	-2614 / 0	-84.9 -84.9	0.33 (1)	3.97	F-R	0 / 42	0.01 (4)
I-J	-2514 / 0	-84.9 -84.9	0.33 (1)	3.97	P-N	-272 / 0	0.03 (1)
J-K	-2587 / 0	-84.9 -84.9	0.47 (1)	3.90	P-L	0 / 3018	0.58 (1)
K-L	-3367 / 0	-84.9 -84.9	0.20 (1)	3.69	S-F	0 / 881	0.20 (1)
L-M	0 / 26	-84.9 -84.9	0.11 (1)	10.00	R-H	-648 / 0	0.43 (1)
V-B	-1561 / 0	0.0 0.0	0.16 (1)	6.59	H-Q	0 / 824	0.19 (1)
N-L	-1468 / 0	0.0 0.0	0.15 (1)	6.75			
V-U	0 / 0	-18.5 -18.5	0.21 (4)	10.00			
U-T	0 / 42	-18.5 -18.5	0.21 (4)	10.00			
T-S	0 / 49	0.0 0.0	0.06 (1)	10.00			
S-E	-412 / 0	0.0 0.0	0.06 (1)	6.25			
S-R	0 / 1589	-18.5 -18.5	0.32 (1)	10.00			
R-Q	0 / 1914	-18.5 -18.5	0.38 (1)	10.00			
Q-P	0 / 3321	-18.5 -18.5	0.62 (1)	10.00			
O-P	0 / 19	0.0 0.0	0.33 (1)	10.00			
P-K	0 / 169	0.0 0.0	0.35 (1)	10.00			
O-N	0 / 238	-18.5 -18.5	0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-14
- TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.56/1.00 (B-C:1), BC=0.62/1.00 (P-Q:1)
WB=0.68/1.00 (L-P:1), SS=0.24/1.00 (K-P:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (Q) (INPUT = 0.90)

JSI METAL= 0.79 (L) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	T5S	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:51:08 2022 Page 2

ID:MG2m827slUOSfZ5oGNm1 zpZL9-dycBzRXUJq4A67rycMPZC3nrSnfqaa7zmT8vg3ywpNX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMV1+p	MT20	3.0	4.0		

NOTES (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY




DWG # TR22070106 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T6	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 14:43:57 2022 Page 1
ID:MG2m827sUOSfIZ5oGNm1 zpZL9-k23FW3J8pEnKvuO6sLBUFAQ9J2br5j7WVfE2YywpUG

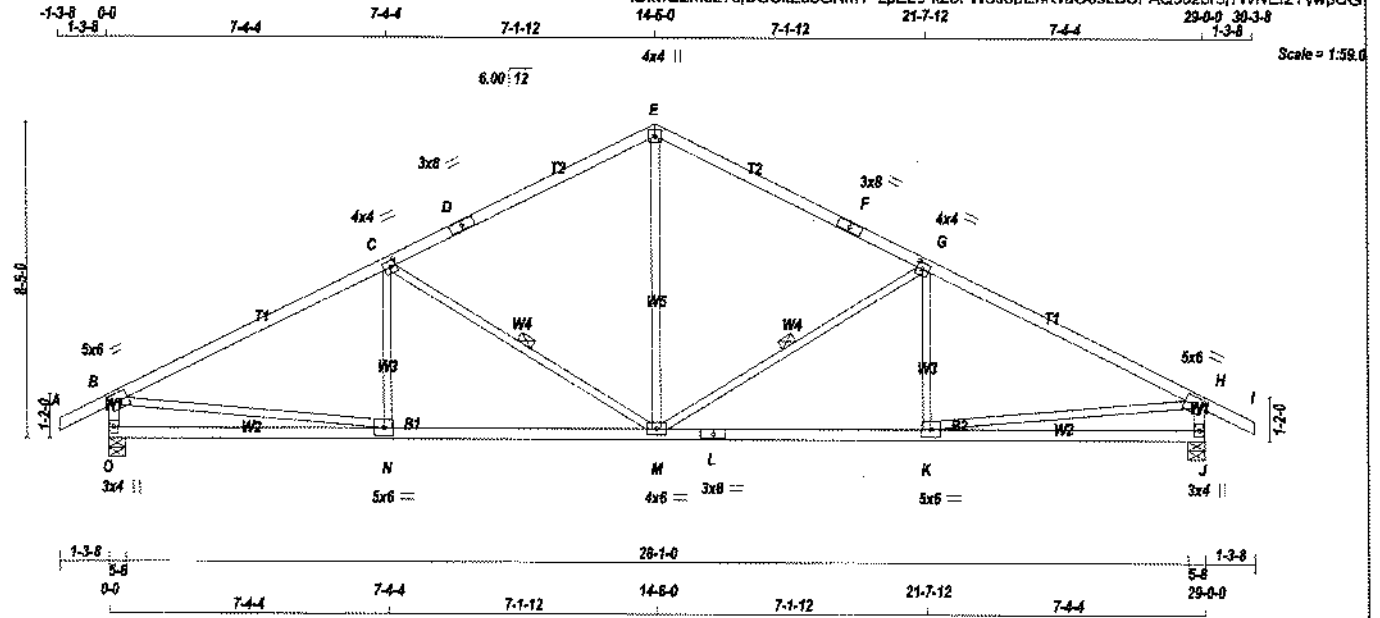

TOTAL WEIGHT = 10 X 113 = 1132 lb
(MIF)

LUMBER				N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.					
A - D	2x4	DRY	No.2	SPF				
D - E	2x4	DRY	No.2	SPF				
E - F	2x4	DRY	No.2	SPF				
F - I	2x4	DRY	No.2	SPF				
O - B	2x4	DRY	No.2	SPF				
J - H	2x4	DRY	No.2	SPF				
O - L	2x4	DRY	No.2	SPF				
L - J	2x4	DRY	No.2	SPF				
ALL WEBS	2x3	DRY	No.2	SPF				
EXCEPT								

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	6.0	
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	8.0	
E	TTW+p	MT20	4.0	4.0	
F	TS-t	MT20	3.0	8.0	
G	TMVW-t	MT20	4.0	4.0	2.00 1.75
H	TMVW-t	MT20	5.0	8.0	
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	6.0	
L	BS-t	MT20	3.0	8.0	
M	BMVW-t	MT20	4.0	6.0	
N	BMVW-t	MT20	5.0	6.0	
O	BMV1+p	MT20	3.0	4.0	

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY

DWG # TR22070086

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	GROSS REACTION		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
O	1614	0		1614	0	0		5-8	5-8
J	1614	0		1614	0	0		5-8	5-8
UNFACTORED REACTIONS									
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
O	1143	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0		
J	1143	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-M, C-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.9 -84.9 0.11 (1)	10.00	M-E	0 / 893	0.20 (1)	
B-C	-2149 / 0	-84.0 -84.0 0.74 (1)	3.80	M-G	-713 / 0	0.35 (1)	
C-D	-1542 / 0	-84.9 -84.9 0.65 (1)	4.46	K-G	-61 / 88	0.03 (4)	
D-E	-1542 / 0	-84.9 -84.9 0.65 (1)	4.46	C-M	-713 / 0	0.35 (1)	
E-F	-1542 / 0	-84.9 -84.9 0.65 (1)	4.46	N-C	-61 / 88	0.03 (4)	
F-G	-1542 / 0	-84.9 -84.9 0.65 (1)	4.46	B-N	0 / 1964	0.44 (1)	
G-H	-2149 / 0	-84.9 -84.9 0.74 (1)	3.80	K-H	0 / 1964	0.44 (1)	
H-I	0 / 26	-84.9 -84.9 0.11 (1)	10.00				
O-B	-1557 / 0	0.0 0.0 0.16 (1)	6.60				
J-H	-1557 / 0	0.0 0.0 0.16 (1)	6.60				
O-N	0 / 0	-18.5 -18.5 0.23 (4)	10.00				
N-M	0 / 1951	-18.5 -18.5 0.43 (1)	10.00				
M-L	0 / 1951	-18.5 -18.5 0.43 (1)	10.00				
L-K	0 / 1951	-18.5 -18.5 0.43 (1)	10.00				
K-J	0 / 0	-18.5 -18.5 0.23 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.19")

CSI: TC=0.74/1.00 (G-H:1) , BC=0.43/1.00 (K-M:1)
WB=0.44/1.00 (H-K:1) , SSI=0.27/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1673

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (H) (INPUT = 0.90)
JSI METAL= 0.55 (L) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

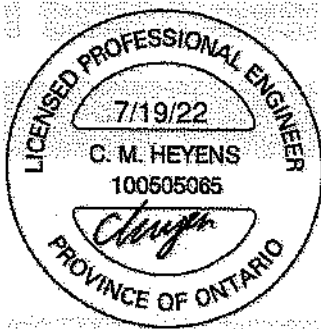

DWG # TR22070086


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T7	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M&T Industries, Inc. Mon Jul 18 14:43:58 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-DEdejPKmaYvBXZzJQ2linNzPuRu9qBjguZzCa vwpUF

Scale = 1:52.9

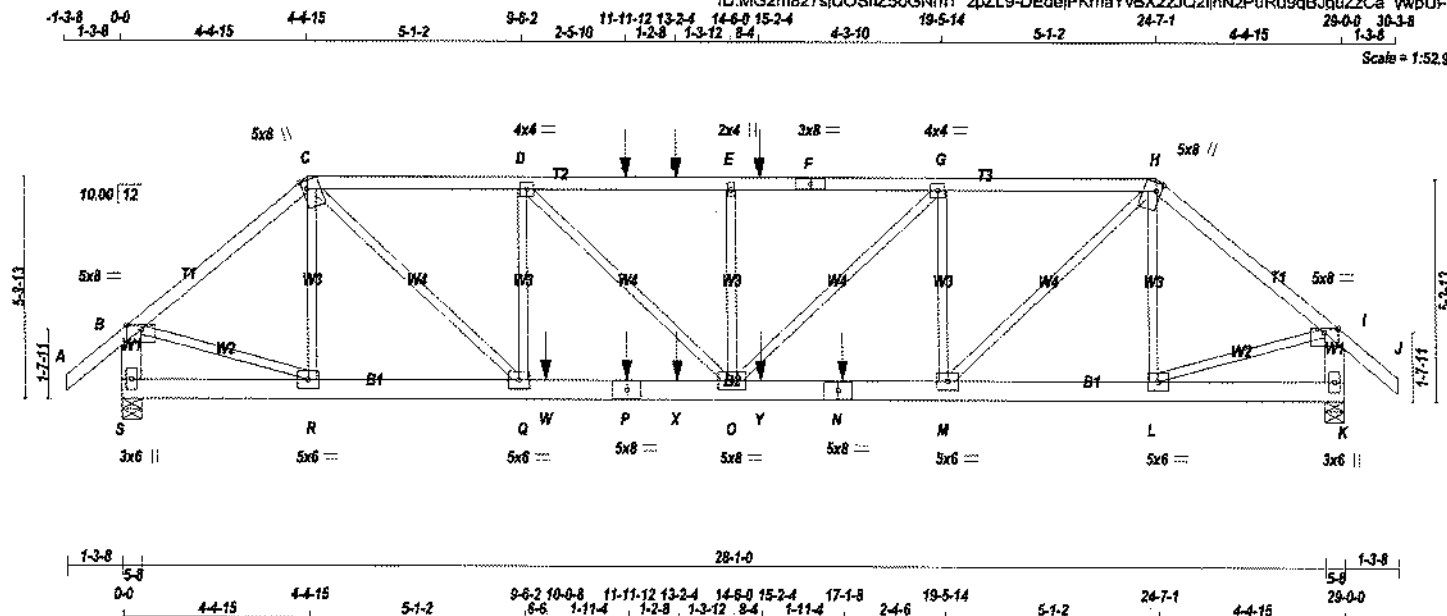

TOTAL WEIGHT = 2 X 144 = 287 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - F 1	12	SIDE(0.0)
F - H 1	12	TOP
H - J 1	12	TOP
S - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2	12	SIDE(0.0)
P - N 2	12	SIDE(0.0)
N - K 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRO BRG
JT	VERT 2897	DOWN 2897	0	0
K	HORZ 2762	HORZ 2762	0	0

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	2051	1334 / 0	0 / 0	0 / 0	0 / 0	717 / 0	0 / 0
K	1955	1271 / 0	0 / 0	0 / 0	0 / 0	684 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.94 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO	A-B	0 / 38	-84.9	-84.9	0.08 (1)	10.00	R-C	-534 / 0	0.11 (1)
	B-C	-3012 / 0	-84.9	-84.9	0.21 (1)	5.12	C-Q	0 / 3029	0.37 (1)
	C-D	-4475 / 0	-84.9	-84.9	0.34 (1)	4.25	Q-D	-1283 / 0	0.26 (1)
	D-T	-5172 / 0	-84.9	-84.9	0.37 (1)	3.94	D-Q	0 / 980	0.12 (1)
	T-U	-5172 / 0	-84.9	-84.9	0.37 (1)	3.94	Q-E	-789 / 0	0.16 (1)
	U-E	-5172 / 0	-84.9	-84.9	0.37 (1)	3.94	Q-G	0 / 1297	0.16 (1)
	E-V	-5172 / 0	-84.9	-84.9	0.37 (1)	3.95	M-H	-1365 / 0	0.28 (1)
	V-F	-5172 / 0	-84.9	-84.9	0.37 (1)	3.95	M-H	0 / 2907	0.38 (1)
	F-G	-5172 / 0	-84.9	-84.9	0.37 (1)	3.95	L-H	-582 / 0	0.12 (1)
	G-H	-4251 / 0	-84.9	-84.9	0.25 (1)	4.43	B-R	0 / 2391	0.30 (1)
	H-I	-2834 / 0	-84.9	-84.9	0.21 (1)	5.25	L-I	0 / 2250	0.28 (1)
	I-J	0 / 38	-84.9	-84.9	0.08 (1)	10.00			
	S-B	-2864 / 0	0.0	0.0	0.11 (1)	7.81			
	K-I	-2713 / 0	0.0	0.0	0.10 (1)	7.81			
	S-R	0 / 0	-18.5	-18.5	0.02 (4)	10.00			
	R-Q	0 / 2297	-18.5	-18.5	0.17 (1)	10.00			
	Q-W	0 / 4476	-18.5	-18.5	0.44 (1)	10.00			
	W-P	0 / 4476	-18.5	-18.5	0.44 (1)	10.00			
	P-X	0 / 4476	-18.5	-18.5	0.44 (1)	10.00			
	X-O	0 / 4476	-18.5	-18.5	0.44 (1)	10.00			
	O-Y	0 / 4251	-18.5	-18.5	0.61 (1)	10.00			
	Y-N	0 / 4251	-18.5	-18.5	0.61 (1)	10.00			
	N-M	0 / 4251	-18.5	-18.5	0.61 (1)	10.00			
	M-L	0 / 2159	-18.5	-18.5	0.27 (1)	10.00			
	L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	17-1-8	-689	-689	---	BACK	VERT	TOTAL	---	C1
P	11-11-12	-29	-29	---	BACK	VERT	TOTAL	---	C1
T	11-11-12	-113	-113	---	BACK	VERT	TOTAL	---	C1
U	13-2-4	-113	-113	---	BACK	VERT	TOTAL	---	C1
V	15-2-4	-113	-113	---	BACK	VERT	TOTAL	---	C1
W	10-0-8	-601	-601	---	BACK	VERT	TOTAL	---	C1
X	13-2-4	-29	-29	---	BACK	VERT	TOTAL	---	C1
Y	15-2-4	-29	-29	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN.CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.37/1.00 (D-E-1), BC=0.61/1.00 (M-O-1)
WB=0.37/1.00 (C-Q-1), SI=0.25/1.00 (O-Q-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.80 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2

STRUCTURAL COMPONENT ONLY



DWG # TR22070087

PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T7	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTak Industries, Inc. Mon Jul 18 14:43:58 2022 Page 2

ID:MG2m827sjUOSRZ5oGNm1 zpZL9-DEdeIPKmaYrBX2zJC2inNzPuRu9gBJguZzCa ywpUF

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	Edge	1.25
D	TMWW-t	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	YS-t	MT20	3.0	8.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	5.0	8.0	Edge	1.25
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1+p	MT20	3.0	6.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	8.0		
O	BMWWWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

STRUCTURAL COMPONENT ONLY



DWG # TR22070087 PG 2/2

JOB NAME 424156	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

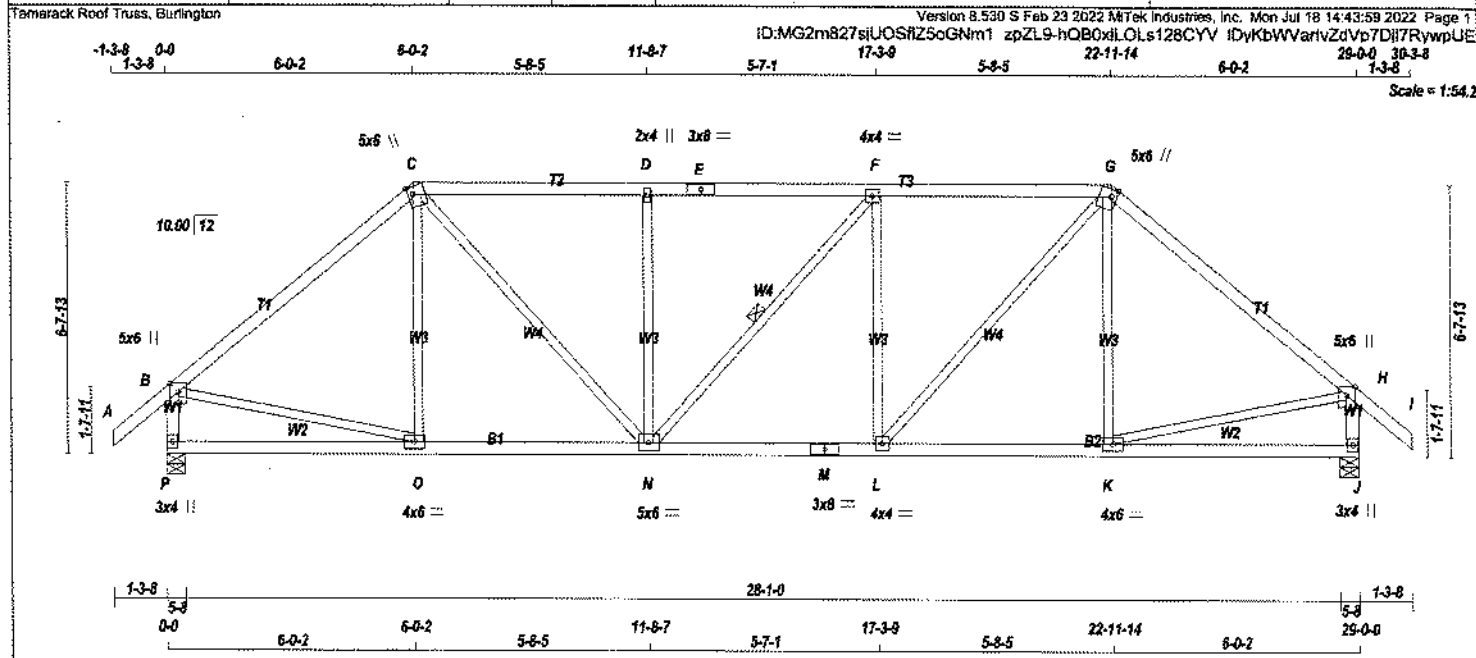

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
P - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TS-I	MT20	3.0	8.0		
F	TMVW-l	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.25	1.50
H	TMVW+p	MT20	5.0	6.0	Edge	
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-l	MT20	4.0	6.0		
L	BMVW-l	MT20	4.0	4.0		
M	BS-I	MT20	3.0	8.0		
N	BMVWVW-l	MT20	5.0	6.0		
O	BMVW-l	MT20	4.0	6.0		
P	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
P	1616	0	1616	0
J	1616	0	1616	0

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
P	1145	740 / 0	0 / 0
J	1145	740 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF P-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 38	-84.9	0.12 (1)	0-0	-118 / 49	0.09 (1)	
B-C	-1487 / 0	-84.9	0.69 (1)	C-N	0 / 827	0.19 (1)	
C-D	-1691 / 0	-84.9	0.44 (1)	N-F	-517 / 0	0.38 (1)	
D-E	-1691 / 0	-84.9	0.44 (1)	F-G	-2 / 0	0.00 (1)	
E-F	-1691 / 0	-84.9	0.44 (1)	L-F	-518 / 0	0.38 (1)	
F-G	-1692 / 0	-84.9	0.45 (1)	L-G	0 / 828	0.19 (1)	
G-H	-1487 / 0	-84.9	0.69 (1)	K-G	-119 / 49	0.09 (1)	
H-I	0 / 38	-84.9	0.12 (1)	B-O	0 / 1186	0.26 (1)	
P-B	-1571 / 0	0.0	0.17 (1)	K-H	0 / 1186	0.26 (1)	
J-H	-1570 / 0	0.0	0.17 (1)				
P-O	0 / 0	-18.5	0.16 (4)				
O-N	0 / 1139	-18.5	0.27 (1)				
N-M	0 / 1693	-18.5	0.32 (1)				
M-L	0 / 1693	-18.5	0.32 (1)				
L-K	0 / 1138	-18.5	0.27 (1)				
K-J	0 / 0	-18.5	0.16 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.7 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.97")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.97")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.13")

CSI: TC=0.69/1.00 (B-C:1), BC=0.32/1.00 (L-N:1)
WB=0.38/1.00 (F-L:1), SS=0.22/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.81 (L) (INPUT = 0.90)
JSI METAL= 0.57 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070088

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T9	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 6.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:44:00 2022 Page 1

ID:MG2m827sjUOSfZ5oGNmt zpZL9-9dIO85M0699vmM7hYTKBso2iNfeci0x2LiSJtywpLD

-1-3-8 0-0 3-10-15 3-10-15 3-8-7 7-7-6 6-10-10 14-6-0 6-10-10 21-4-10 3-8-7 25-1-1 3-10-15 29-0-0 30-3-8

Scale = 1:56.3

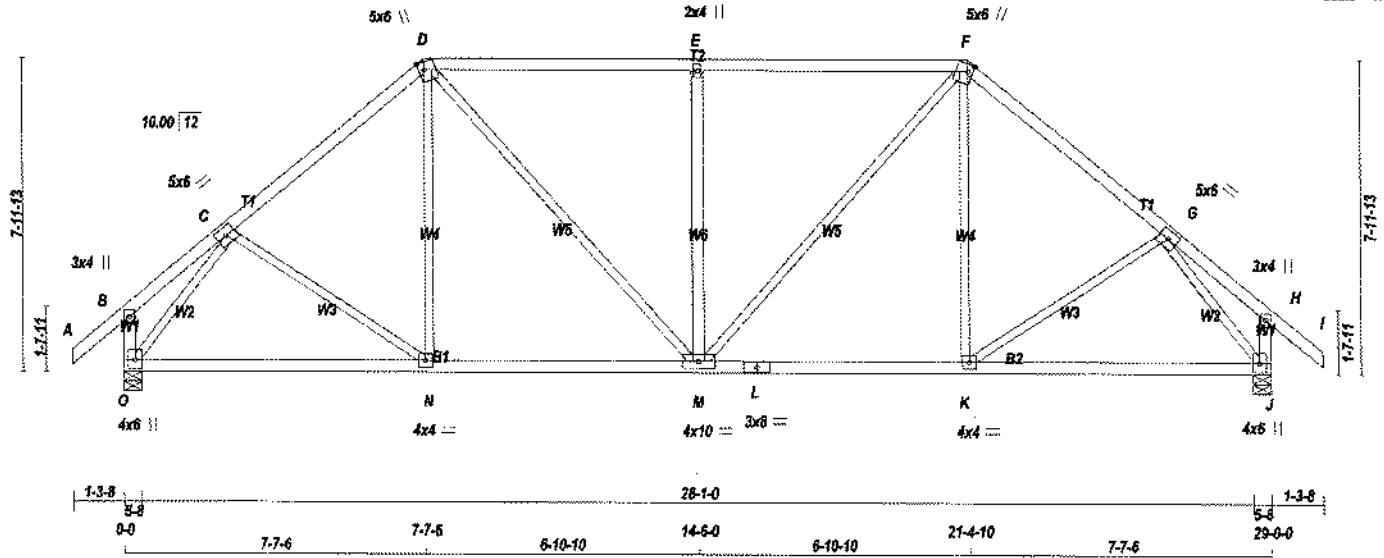

TOTAL WEIGHT = 2 X 131 = 262 lb

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA				
N. L. G. A. RULES																			
CHORDS		SIZE	LUMBER		DESCR.	BEARINGS										SPECIFIED LOADS:			
A - D	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION		MAXIMUM FACTORED		INPUT	REQD	TOP CH. LL = 23.3 PSF							
D - F	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	BRG	DL = 6.0 PSF					
F - I	2x4	DRY	No.2	SPF	O	1616	0	1616	0	0	5-8	5-8	5-8	BOT CH. LL = 0.0 PSF					
O - B	2x4	DRY	No.2	SPF	J	1616	0	1616	0	0	5-8	5-8	5-8	DL = 7.4 PSF					
J - H	2x4	DRY	No.2	SPF										TOTAL LOAD = 36.7 PSF					
O - L	2x4	DRY	No.2	SPF															
L - J	2x4	DRY	No.2	SPF															

DRY: SEASONED LUMBER.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO				FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	G-N	0 / 75	0.03 (4)	
B-C	0 / 45	-84.9	-84.9 0.26 (1)	N-O	0 / 135	0.05 (4)	
C-D	-1472 / 0	-84.9	-84.9 0.30 (1)	D-M	0 / 554	0.12 (1)	
D-E	-1462 / 0	-84.9	-84.9 0.56 (1)	M-E	-718 / 0	0.62 (1)	
E-F	-1482 / 0	-84.9	-84.9 0.56 (1)	M-F	0 / 564	0.12 (1)	
F-G	-1472 / 0	-84.9	-84.9 0.30 (1)	K-F	0 / 135	0.05 (4)	
G-H	0 / 45	-84.9	-84.9 0.26 (1)	K-G	0 / 75	0.03 (4)	
H-I	0 / 38	-84.9	-84.9 0.12 (1)	O-C	-1750 / 0	0.53 (1)	
O-B	-157 / 0	0.0	0.0 0.02 (1)	G-J	-1750 / 0	0.53 (1)	
J-H	-157 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1048	-18.5	-18.5 0.34 (4)				
N-M	0 / 1112	-18.5	-18.5 0.36 (4)				
M-L	0 / 1112	-18.5	-18.5 0.36 (4)				
L-K	0 / 1112	-18.5	-18.5 0.36 (4)				
K-J	0 / 1048	-18.5	-18.5 0.34 (4)				

ALLOWABLE DEFL. (LL) = L/360 (0.97")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.97")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")
CSI: TC=0.56/1.00 (D-E:1), BC=0.36/1.00 (K-M:4)
WB=0.52/1.00 (E-M:1), SS=0.28/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (O) (INPUT= 0.90)
JSI METAL= 0.47 (O) (INPUT= 1.00)

STRUCTURAL COMPONENT ONLY

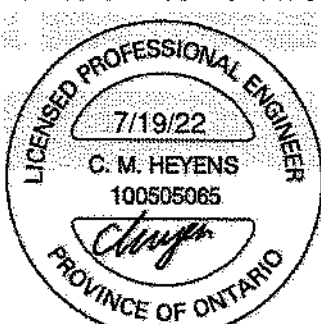


DWG # TR22070089

JOB NAME 424156	TRUSS NAME T10	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mittek Industries, Inc. Mon Jul 18 14:44:01 2022 Page 1

ID:MG2m827sUOSIZ5oGNm1 zpZL9-dpJmMRMeTHmOVit5AFQP0bwwf0m1Y26aXCsBjywpUC

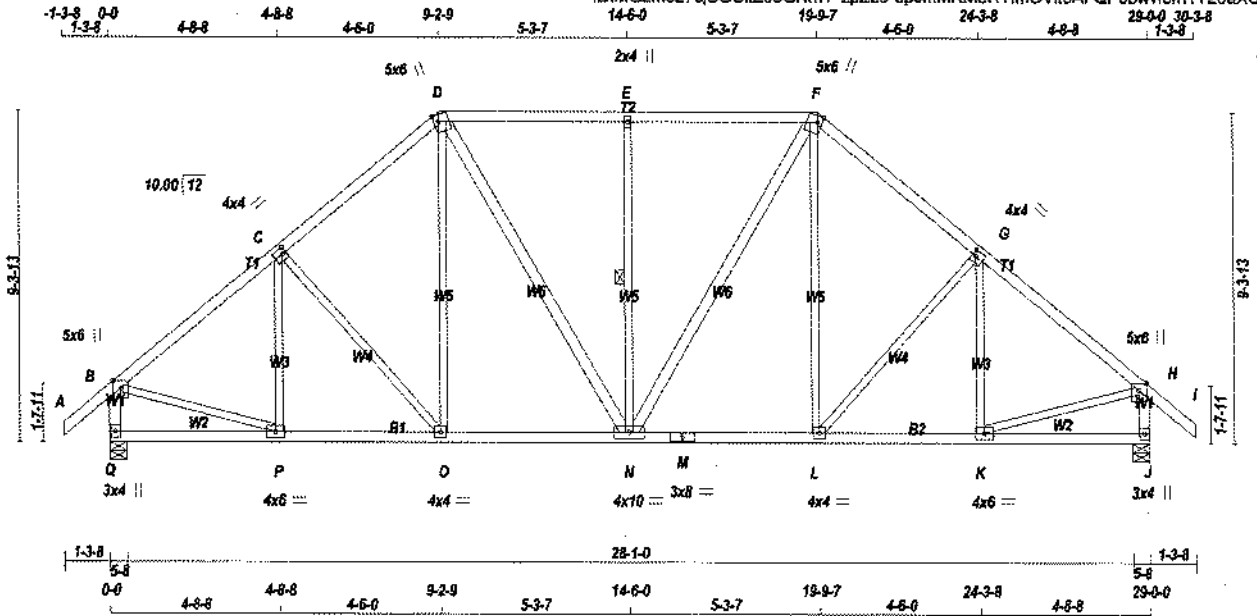

Scale = 1:62.2

LUMBER N. L. G. A. RULES CHORDS SIZE A - D 2x4 DRY No.2 SPF D - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF Q - B 2x4 DRY No.2 SPF J - H 2x4 DRY No.2 SPF Q - M 2x4 DRY No.2 SPF M - J 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT D - N 2x4 DRY No.2 SPF N - F 2x4 DRY No.2 SPF DRY: SEASONED LUMBER.			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 36.7 PSF BRACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 886-14 - TPIC 2014 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL (LL) = L/360 (0.97") CALCULATED VERT. DEFL (LL) = L/999 (0.04") ALLOWABLE DEFL (TL) = L/360 (0.97") CALCULATED VERT. DEFL (TL) = L/999 (0.09") CSI: TC=0.32/1.00 (D-E:1), BC=0.24/1.00 (O-P:1), WB=0.31/1.00 (E-N:1), SS=0.22/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (K) (INPUT = 0.90) JSI METAL= 0.57 (B) (INPUT = 1.00)			BEARINGS FACTORED GROSS REACTION JT VERT 1616 0 Q 1616 0 J 1616 0 MAXIMUM FACTORED GROSS REACTION DOWN 1616 0 UP 1616 0 INPUT BRG IN-SX 5-8 5-8 REQRD BRG IN-SX 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL Q 1145 740 / 0 0 / 0 0 / 0 0 / 0 405 / 0 0 / 0 J 1145 740 / 0 0 / 0 0 / 0 0 / 0 405 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.10 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. CS (LC) UNBRACED LENGTH FR-TO FR-TO A-B 0 / 38 -84.9 -84.9 0.12 (1) 10.00 P-C -235 / 0 0.11 (1) B-C -1503 / 0 -84.9 -84.9 0.27 (1) 5.10 C-O -196 / 0 0.18 (1) C-D -1398 / 0 -84.9 -84.9 0.26 (1) 5.24 O-D 0 / 237 0.05 (1) D-E -1240 / 0 -84.9 -84.9 0.32 (1) 5.39 D-N 0 / 374 0.06 (1) E-F -1240 / 0 -84.9 -84.9 0.32 (1) 5.39 N-E -546 / 0 0.31 (1) F-G -1398 / 0 -84.9 -84.9 0.26 (1) 5.24 N-F 0 / 374 0.06 (1) G-H -1503 / 0 -84.9 -84.9 0.27 (1) 5.10 L-F 0 / 237 0.05 (1) H-I 0 / 38 -84.9 -84.9 0.12 (1) 10.00 L-G -196 / 0 0.18 (1) I-J -1579 / 0 0.0 0.0 0.17 (1) 6.56 K-G -235 / 0 0.11 (1) J-H -1579 / 0 0.0 0.0 0.17 (1) 6.56 B-P 0 / 1222 0.27 (1) K-H 0 / 1222 0.27 (1) Q-P 0 / 0 -18.5 -18.5 0.09 (4) 10.00 P-O 0 / 1177 -18.5 -18.5 0.24 (1) 10.00 O-N 0 / 1051 -18.5 -18.5 0.22 (1) 10.00 N-M 0 / 1051 -18.5 -18.5 0.22 (1) 10.00 M-L 0 / 1051 -18.5 -18.5 0.22 (1) 10.00 L-K 0 / 1177 -18.5 -18.5 0.24 (1) 10.00 K-J 0 / 0 -18.5 -18.5 0.09 (4) 10.00		
---	--	--	---	--	--	---	--	--

TOTAL WEIGHT = 3 X 150 = 450 lb

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	Edge	
C TMVW+1	MT20	4.0	4.0	2.00	1.25
D TTMVW+m	MT20	5.0	6.0	2.25	1.50
E TMVW+w	MT20	2.0	4.0		
F TTMVW+m	MT20	5.0	6.0	2.25	1.50
G TMVW+1	MT20	4.0	4.0	2.00	1.25
H TMVW+p	MT20	5.0	6.0	Edge	
J BMV1+p	MT20	3.0	4.0		
K BMVW+1	MT20	4.0	6.0		
L BMVW+1	MT20	4.0	4.0		
M BS-1	MT20	3.0	8.0		
N BAWW+1	MT20	4.0	10.0		
O BAWW+1	MT20	4.0	4.0		
P BMVW+1	MT20	4.0	6.0		
Q BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY




DWG # TR22070090

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T11	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M&T Industries, Inc. Mon Jul 18 14:44:01 2022 Page 1

ID:MG2m827slUOSfZ5oGNm1 zbZL9-dpJmMRMeTHmOVh5AFQP0bzyt291b56aXCsBJypUC

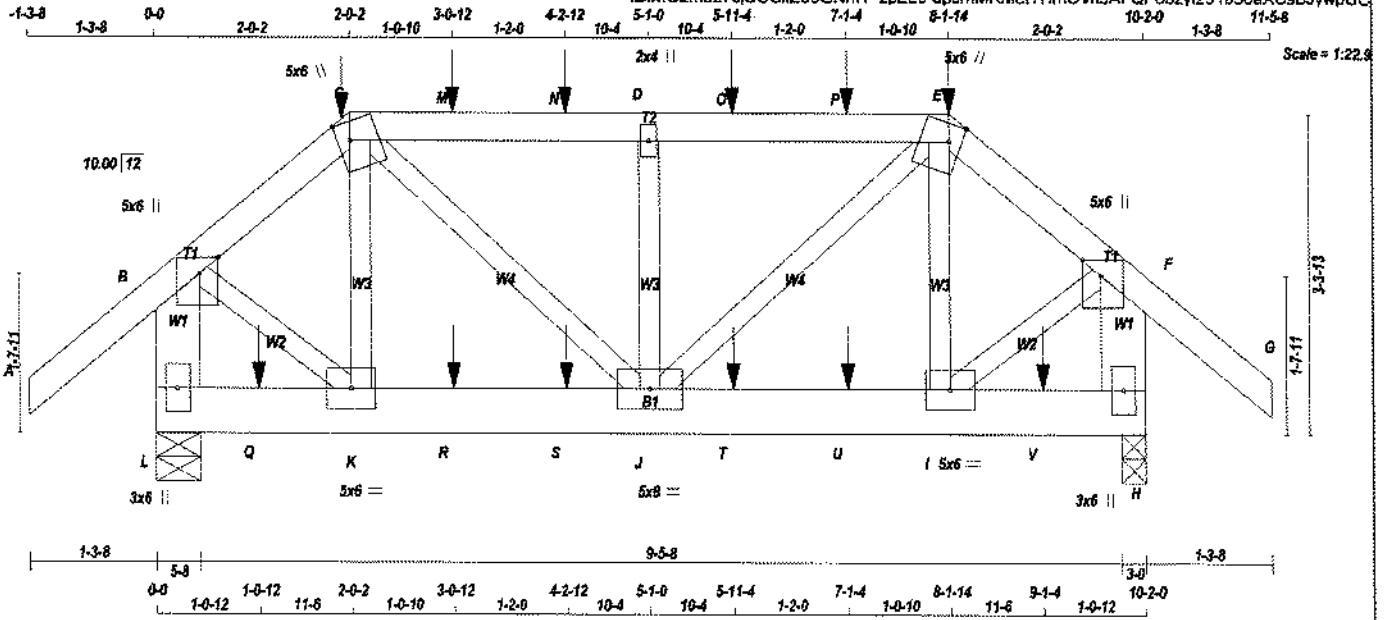

TOTAL WEIGHT = 55 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
L - B	2x6	DRY	No.2	SPF	
H - F	2x6	DRY	No.2	SPF	
L - H	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW+p	MT20	5.0	6.0	2.00	2.25
H	BMV1+p	MT20	3.0	6.0		
I	BMVW-t	MT20	5.0	6.0		
J	BMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMV1+p	MT20	3.0	6.0		

NOTES-

(1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	796	0	796	0
H	796	0	796	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
L	563	372 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0
H	563	372 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FORCE	FACTORED	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX	CS1 (LC)
FR-TO															
A-B		0 / 38		-84.9	-84.9	0.13 (1)	10.00			K-C		-147 / 0		0.03 (1)	
B-C		-535 / 0		-84.9	-84.9	0.07 (1)	6.25			C-J		0 / 322		0.08 (1)	
C-M		-638 / 0		-84.9	-84.9	0.19 (1)	6.25			J-D		-410 / 0		0.08 (1)	
M-N		-638 / 0		-84.9	-84.9	0.19 (1)	6.25			E-J		0 / 322		0.08 (1)	
N-D		-638 / 0		-84.9	-84.9	0.19 (1)	6.25			I-E		-147 / 0		0.03 (1)	
D-O		-638 / 0		-84.9	-84.9	0.19 (1)	6.25			B-K		0 / 472		0.12 (1)	
O-P		-638 / 0		-84.9	-84.9	0.19 (1)	6.25			F-F		0 / 472		0.12 (1)	
P-E		-638 / 0		-84.9	-84.9	0.19 (1)	6.25								
E-F		-535 / 0		-84.9	-84.9	0.07 (1)	6.25								
F-G		0 / 38		-84.9	-84.9	0.13 (1)	10.00								
L-B		-784 / 0		0.0	0.0	0.06 (1)	7.81								
H-F		-784 / 0		0.0	0.0	0.06 (1)	7.81								
L-Q		0 / 0		-18.5	-18.5	0.02 (4)	10.00								
Q-K		0 / 0		-18.5	-18.5	0.02 (4)	10.00								
K-R		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
R-S		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
S-J		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
J-T		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
T-U		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
U-I		0 / 404		-18.5	-18.5	0.08 (1)	10.00								
I-V		0 / 0		-18.5	-18.5	0.02 (4)	10.00								
V-H		0 / 0		-18.5	-18.5	0.02 (4)	10.00								

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-0-2	-8	-8	-	FRONT	VERT	DEAD	-	C1
C	2-0-2	-30	-30	-	FRONT	VERT	SNOW	-	C1
E	8-1-14	-8	-8	-	FRONT	VERT	DEAD	-	C1
E	8-1-14	-30	-30	-	FRONT	VERT	SNOW	-	C1
M	3-0-12	-26	-26	-	BACK	VERT	TOTAL	-	C1
N	4-2-12	-26	-26	-	BACK	VERT	TOTAL	-	C1
O	5-11-4	-26	-26	-	BACK	VERT	TOTAL	-	C1
P	7-1-4	-26	-26	-	BACK	VERT	TOTAL	-	C1
Q	1-0-12	-6	-6	-	BACK	VERT	TOTAL	-	C1
R	3-0-12	-6	-6	-	BACK	VERT	TOTAL	-	C1
S	4-2-12	-6	-6	-	BACK	VERT	TOTAL	-	C1
T	5-11-4	-6	-6	-	BACK	VERT	TOTAL	-	C1
U	7-1-4	-6	-6	-	BACK	VERT	TOTAL	-	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 35.7 PSF

SPACING = 24.0 IN/GC

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F.
RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED
ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = U/360 (0.34")
CALCULATED VERT. DEFL.(LL) = U/999 (0.01")
ALLOWABLE DEFL.(TL) = U/360 (0.34")
CALCULATED VERT. DEFL.(TL) = U/999 (0.01")

CS1: TC=0.19/1.00 (C-D:1), BC=0.08/1.00 (L-J:1),
WB=0.12/1.00 (B-K:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 789 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2

STRUCTURAL COMPONENT ONLY



DWG # TR22070091 PG 1/2

JOB NAME 424156	TRUSS NAME T11	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 Mitak Industries, Inc. Mon Jul 18 14:44:02 2022 Page 2
ID:MG2m827sjUOSfZ5oGNm1_zpZl9-57f8ZnNGenPd7fG4furfxD883Ncm2KGpBxPimwvUB

SPECIFIED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	9-1-4	-6	-6	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JSI GRIP= 0.31 (E) (INPUT = 0.90)
JSI METAL= 0.12 (F) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

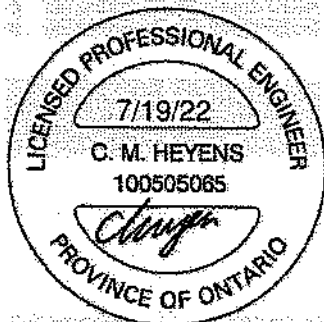


DWG # TR22070091 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T12	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:44:02 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-5718ZnNGenPd7fG4fumfxD88S3Nfm2sGpBxPjmywpUB

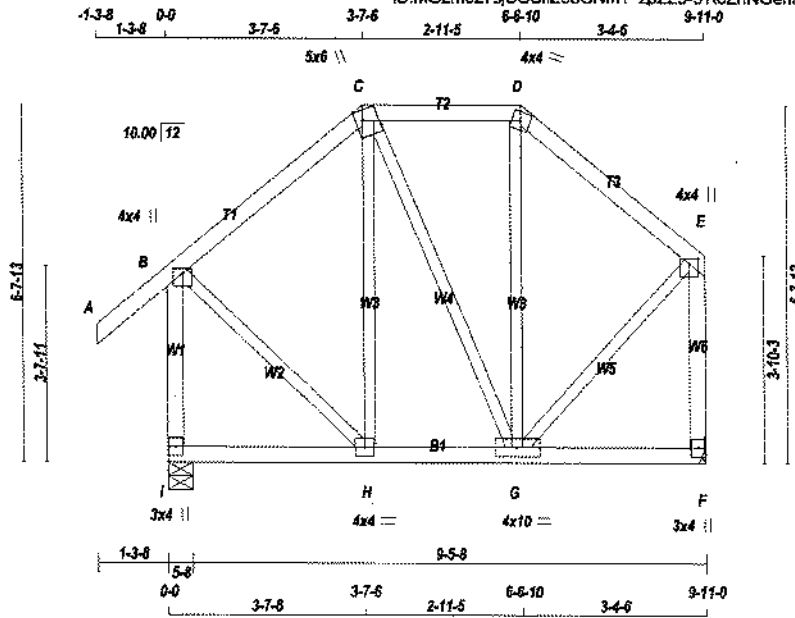

Scale = 1:41.1

TOTAL WEIGHT = 56 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	10.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX
I	630	0	630	0	5-8
F	512	0	512	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	445	295 / 0	0 / 0	0 / 0	0 / 0	150 / 0	0 / 0
F	364	231 / 0	0 / 0	0 / 0	0 / 0	133 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 38	A-B	-103 / 11
B-C	-249 / 0	B-C	-16 / 0
C-D	-183 / 0	C-D	-113 / 5
D-E	-241 / 0	D-E	0 / 256
E-F	-601 / 0	E-F	0 / 253
F-G	-485 / 0	F-G	
G-H	0 / 0	G-H	
H-I	0 / 189	H-I	
I-J	0 / 0	I-J	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2019, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.14/1.00 (B-C:1), BC=0.07/1.00 (G-H:4), WB=0.08/1.00 (D-G:1), SS=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.40 (B) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

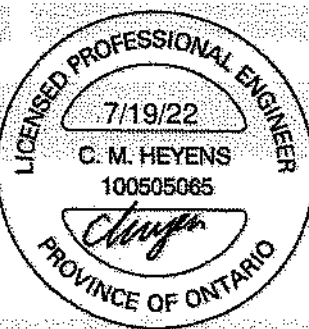


DWG # TR22070092

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T13	1	2	TRUSS DESC.		

Tamaseck Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitak Industries, Inc. Mon Jul 18 14:44:03 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-ZBRXm6CuP4YUdprGDbluURgHhSipVUwP1rhzGCYwpUA

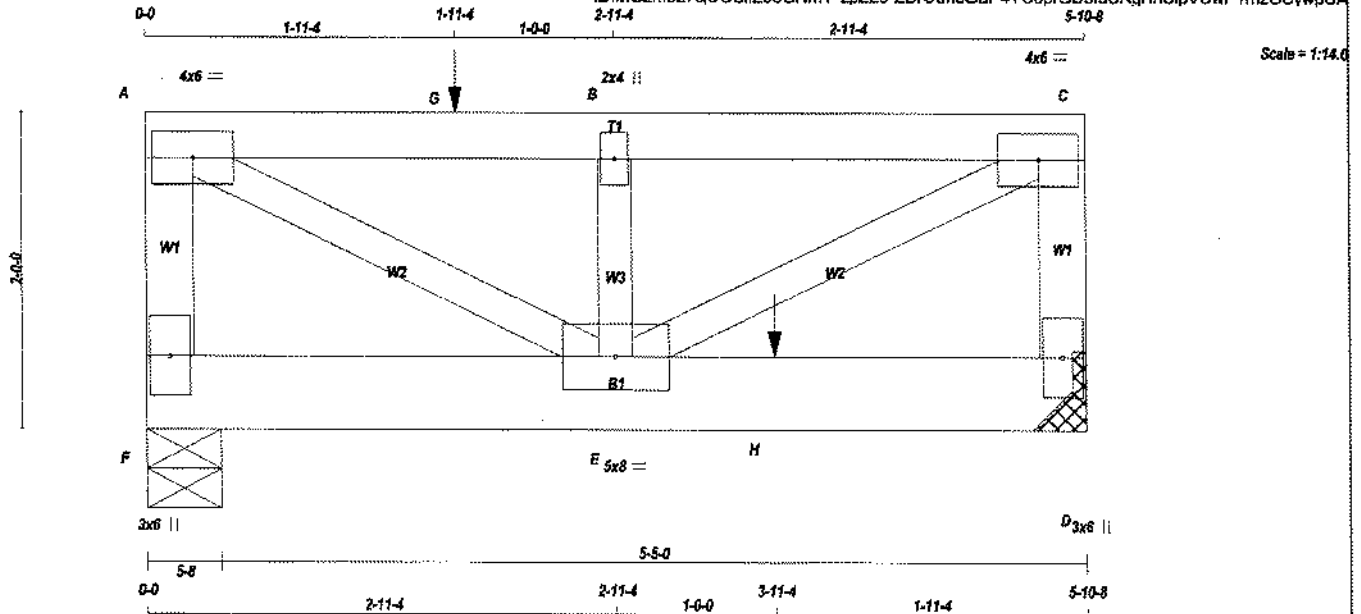

Scale = 1:14.0

TOTAL WEIGHT = 2 X 26 = 51 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	6.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-t	MT20	4.0	6.0		

STRUCTURAL COMPONENT ONLY



DWG # TR22070093 PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	943	0	943	0	5-8
D	869	0	869	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	668	431 / 0	0 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0
D	816	399 / 0	0 / 0	0 / 0	0 / 0	0 / 0	217 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
MEMB.	FR-TO						MEMB.		
F-A	-905 / 0	0.0	0.0	0.05 (1)	7.81		A-E	9 / 1278	0.16 (1)
A-C	-1118 / 0	-84.9	-84.9	0.30 (1)	6.25		E-B	-880 / 0	0.07 (1)
G-B	-1118 / 0	-84.9	-84.9	0.30 (1)	6.25		E-C	9 / 1278	0.16 (1)
B-C	-1118 / 0	-84.9	-84.9	0.18 (1)	6.25				
D-C	-663 / 0	0.0	0.0	0.04 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.01 (1)	10.00				
E-H	0 / 0	-18.5	-18.5	0.13 (1)	10.00				
H-D	0 / 0	-18.5	-18.5	0.13 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	-304	-504	--	TOP	VERT	TOTAL	--	C1
H	3-11-4	-348	-348	--	FRONT	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/998 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/998 (0.02")

CSI: TC=0.30/1.00 (A-B:1), BC=0.13/1.00 (D-E:1), WB=0.16/1.00 (A-E:1), SSI=0.29/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.36 (E) (INPUT = 0.90)
JSI METAL= 0.14 (A) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T13	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitex Industries, Inc. Mon Jul 18 14:44:03 2022 Page 2

ID:MG2m827slUOSnZ5oGNm1 zpZL9-ZBRXm6CuP4YUdprGDbluURqHhSipVUwP1rhzGCwpUA

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	6.0		
E	BMVWW-L	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	6.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T13Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M/Tek Industries, Inc. Mon Jul 18 15:06:47 2022 Page 1

ID:MG2m827sjUOS8Z5oGNm1 zpZL9-dcrA2WuUAAOxGR7Q73mmmm4AISI5CM5M5Ah25878ypwBs

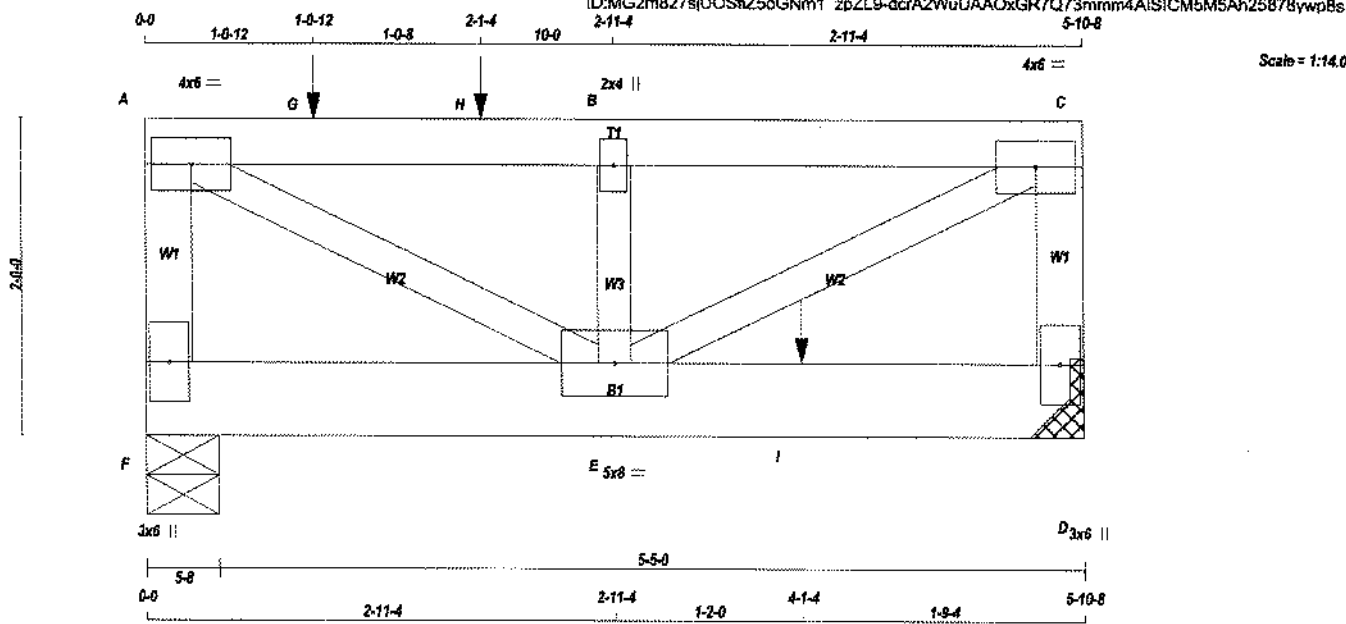

TOTAL WEIGHT = 2 X 26 = 51 lb

LUMBER				DESCR.	
CHORDS	SIZE	LUMBER			
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	6.0	
B	TMVW-w	MT20	2.0	4.0	
C	TMVW-1	MT20	4.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	1849	0	1849	0	5-8
D	1689	0	1689	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1308	850 / 0	0 / 0	0 / 0	0 / 0	459 / 0	0 / 0
D	1197	772 / 0	0 / 0	0 / 0	0 / 0	424 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.86 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
F-A	-1804 / 0	0.0	0.0 0.11 (1)	7.81	A-E	0 / 2575	0.32 (1)
A-G	-2254 / 0	-84.9	-84.9 0.62 (1)	4.86	E-B	-1824 / 0	0.14 (1)
G-H	-2254 / 0	-84.9	-84.9 0.62 (1)	4.86	E-C	0 / 2575	0.32 (1)
H-B	-2254 / 0	-84.9	-84.9 0.62 (1)	4.86			
B-C	-2254 / 0	-84.9	-84.9 0.37 (1)	5.43			
D-C	-1215 / 0	0.0	0.0 0.07 (1)	7.81			
F-E	0 / 0	-18.5	-18.5 0.02 (1)	10.00			
E-I	0 / 0	-18.5	-18.5 0.30 (1)	10.00			
I-D	0 / 0	-18.5	-18.5 0.30 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-126	-126	---	TOP	VERT	TOTAL	---	C1
H	2-1-4	-1184	-1184	---	TOP	VERT	TOTAL	---	C1
I	4-1-4	-765	-765	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 35.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.62/1.00 (A-B:1), BC=0.30/1.00 (D-E:1), WB=0.32/1.00 (A-E:1), SSI=0.66/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX
MT20	850	371	1747
		788	1937

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.72 (E) (INPUT = 0.90)
JSI METAL= 0.28 (A) (INPUT = 1.00)

CONTINUED ON PAGE 2

STRUCTURAL COMPONENT ONLY



DWG # TR22070128 PG 1/2

JOB NAME 424160	TRUSS NAME T13Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:47 2022 Page 2
ID:MG2m827sjUOSI25oGNm1 zpZL9-dcrA2WuUAAOxGR7Q73mmm4AISIcM5M5Ah25878wp8s

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	6.0		
E	BMWWW-t	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY




DWG # TR22070128 PG 2/2

JOB NAME 424156	TRUSS NAME T14	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Metek Industries, Inc. Mon Jul 18 14:44:04 2022 Page 1
ID:MG2m827sJUSfZ5oGNm1 zpZl 9-10 v SPXAOgKFzQSNjp71eDWDs2cExFYGVQWoeypU9

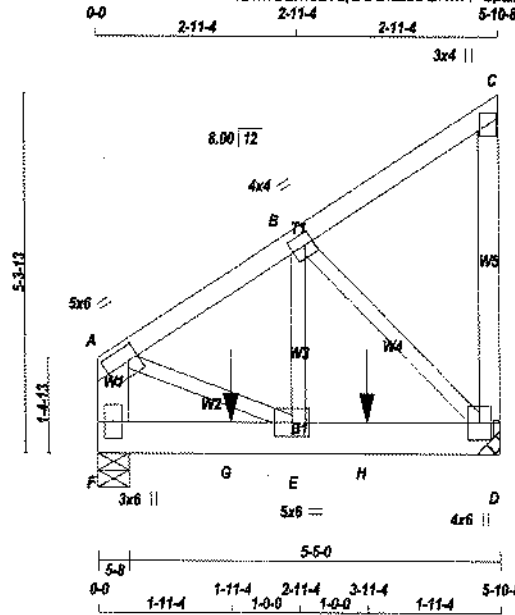

Scale = 1:32.7

TOTAL WEIGHT = 2 X 33 = 66 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No. 2	SPF		
D - C	2x4 DRY	No. 2	SPF		
F - A	2x6 DRY	No. 2	SPF		
F - D	2x6 DRY	No. 2	SPF		
ALL WEBS	2x3 DRY	No. 2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1 12	TOP	
C-D 1 12	TOP	
F-A 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2 12	SIDE (0.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.


TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-4	MT20	5.0	6.0	2.50	1.75

STRUCTURAL COMPONENT ONLY

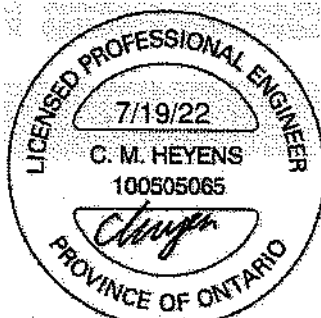

DWG # TR22070094 PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 993	DOWN 993	0	0
F	HORZ 1097	HORZ 1097	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	0/0	0/0	0/0	0/0
D	703	456/0	0/0	0/0	248/0	0/0
F	777	503/0	0/0	0/0	274/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-907/0	-84.9 -84.9 0.06 (1)	6.25	E-B	0/980	0.12 (1)	
B-C	-15/0	-84.9 -84.9 0.06 (1)	6.25	B-D	-1087/0	0.15 (1)	
D-C	-98/0	0.0 0.0 0.02 (1)	7.81	A-E	0/809	0.10 (1)	
F-A	-869/0	0.0 0.0 0.03 (1)	7.81				
F-G	0/0	-18.5 -18.5 0.15 (1)	10.00				
G-E	0/0	-18.5 -18.5 0.15 (1)	10.00				
E-H	0/706	-18.5 -18.5 0.16 (1)	10.00				
H-D	0/766	-18.5 -18.5 0.16 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	-633	-633	---	BACK	VERT	TOTAL	---	C1
H	3-11-4	-416	-416	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF OBC 2012 (2015 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/998$ (0.01")

CS1: TC=0.06/1.00 (A-B:1), BC=0.16/1.00 (D-E:1), WB=0.15/1.00 (B-D:1), SS1=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (B) (INPUT = 0.90)
JSI METAL= 0.17 (D) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T14	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 14:44:04 2022 Page 2

ID:MG2m827sjUOS1Z5oGNm1 zpZL9-1O y SPXAQgKFzQSnJp71eDWDs2cExFYGVQWoeypwU9

PLATES (Table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-t	MT20	4.0	4.0	2.00	1.50
C TMV+p	MT20	3.0	4.0		
D BMWW-t+p	MT20	4.0	6.0		
E BMWW-t	MT20	5.0	6.0		
F BMV1+p	MT20	3.0	6.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.


STRUCTURAL COMPONENT ONLY



DWG # TR22070094 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T15	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

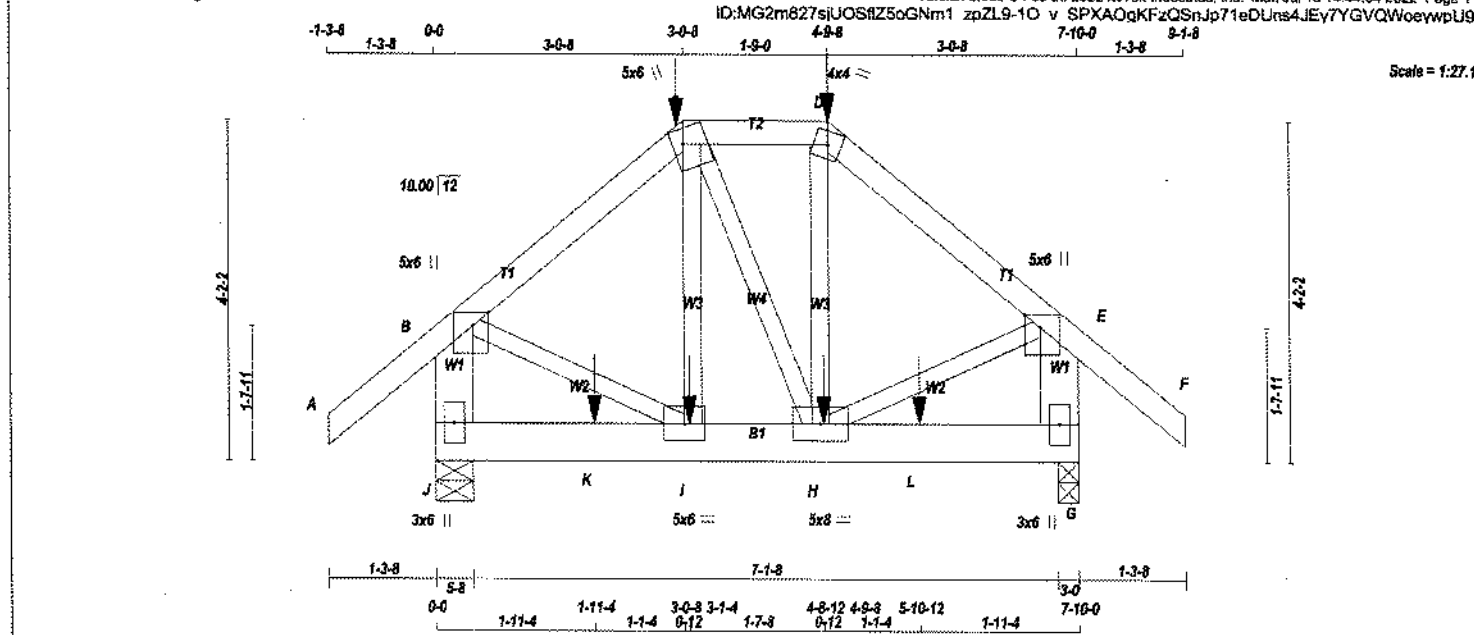

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x6	DRY	No.2
J - E	2x6	DRY	No.2
J - G	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	6.0	2.00 2.25
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMVW+p	MT20	5.0	6.0	2.00 2.25
G	BMV1+p	MT20	3.0	6.0	
H	BMVWV-l	MT20	5.0	6.0	
I	BMVWV-l	MT20	5.0	6.0	
J	BMV1+p	MT20	3.0	6.0	

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
J 728	0	728	0	0	5-8	5-8	
G 728	0	728	0	0	3-0	3-0	

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
JT	513	345 / 0	0 / 0	0 / 0	0 / 0	168 / 0
G	513	345 / 0	0 / 0	0 / 0	0 / 0	168 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9 -84.9	0.13 (1)	10.00	I-C	-75 / 20	0.02 (1)
B-C	-477 / 0	-84.9 -84.9	0.15 (1)	6.25	C-H	-7 / 1	0.00 (1)
C-D	-360 / 0	-84.9 -84.9	0.05 (1)	6.25	H-D	-84 / 22	0.02 (1)
D-E	-474 / 0	-84.9 -84.9	0.15 (1)	6.25	B-I	0 / 389	0.10 (1)
E-F	0 / 38	-84.9 -84.9	0.13 (1)	10.00	H-E	0 / 389	0.10 (1)
J-B	-696 / 0	0.0 0.0	0.05 (1)	7.81			
G-E	-692 / 0	0.0 0.0	0.05 (1)	7.81			
J-K	0 / 0	-18.5 -18.5	0.03 (4)	10.00			
K-I	0 / 0	-18.5 -18.5	0.03 (4)	10.00			
I-H	0 / 363	-18.5 -18.5	0.05 (1)	10.00			
H-L	0 / 0	-18.5 -18.5	0.03 (4)	10.00			
L-G	0 / 0	-18.5 -18.5	0.03 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-0-8	-129	-129		BACK	VERT	TOTAL		C1
D	4-9-8	-129	-129		BACK	VERT	TOTAL		C1
H	4-8-12	-8	-8		BACK	VERT	TOTAL		C1
I	3-1-4	-8	-8		BACK	VERT	TOTAL		C1
K	1-11-4	-8	-8		BACK	VERT	TOTAL		C1
L	5-10-12	-8	-8		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.15/1.00 (B-C:1), BC=0.05/1.00 (H-I:1), WB=0.10/1.00 (B-I:1), SS=0.08/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (B) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

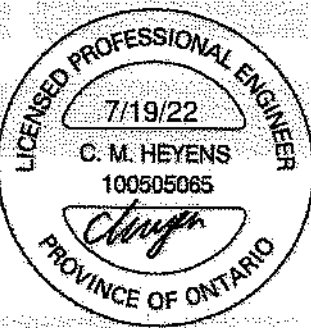


DWG # TR22070095

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T16	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Mon Jul 18 14:44:05 2022 Page 1

ID:MG2m827sjUOSRZSoGNm1 zpZL9-VaYHBoQ9x0Bs7?K0K0MZsmfJGP8zQEIV9AAK4ywpU8

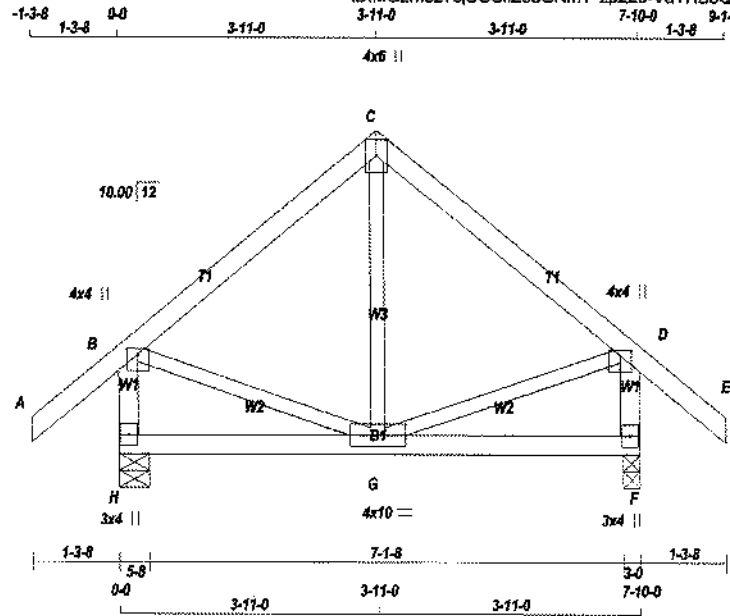

Scale = 1/32

TOTAL WEIGHT = 37 lb

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	=	23.3 PSF
A - C	2x4	DRY	No.2	DL	=	6.0 PSF	
C - E	2x4	DRY	No.2	BOT CH.	LL	=	0.0 PSF
H - B	2x4	DRY	No.2	DL	=	7.4 PSF	
F - D	2x4	DRY	No.2	TOTAL LOAD	=	36.7 PSF	
H - F	2x4	DRY	No.2				

ALL WEBS. 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	8.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	10.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	522	0	522	0
F	522	0	522	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	369 247 / 0 0 / 0 0 / 0 0 / 0 122 / 0 0 / 0
F	369 247 / 0 0 / 0 0 / 0 0 / 0 122 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9 -84.9	0.12 (1)	10.00	G-C	-32 / 53	0.02 (4)
B-C	-235 / 0	-84.9 -84.9	0.17 (1)	6.25	B-G	0 / 190	0.04 (1)
C-D	-235 / 0	-84.9 -84.9	0.17 (1)	6.25	G-D	0 / 190	0.04 (1)
D-E	0 / 38	-84.9 -84.9	0.12 (1)	10.00			
H-B	-494 / 0	0.0 0.0	0.05 (1)	7.81			
F-D	-494 / 0	0.0 0.0	0.05 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.08 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.17/1.00 (B-C:1), BC=0.08/1.00 (F-G:4), WB=0.04/1.00 (D-G:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 786	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.39 (D) (INPUT = 0.90)
JSI METAL= 0.11 (D) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070096

JOB NAME 424156	TRUSS NAME T17	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:44:06 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9- m6P8Qm7w2UHanukrb63InWgdiqxrkvdtXywpU7

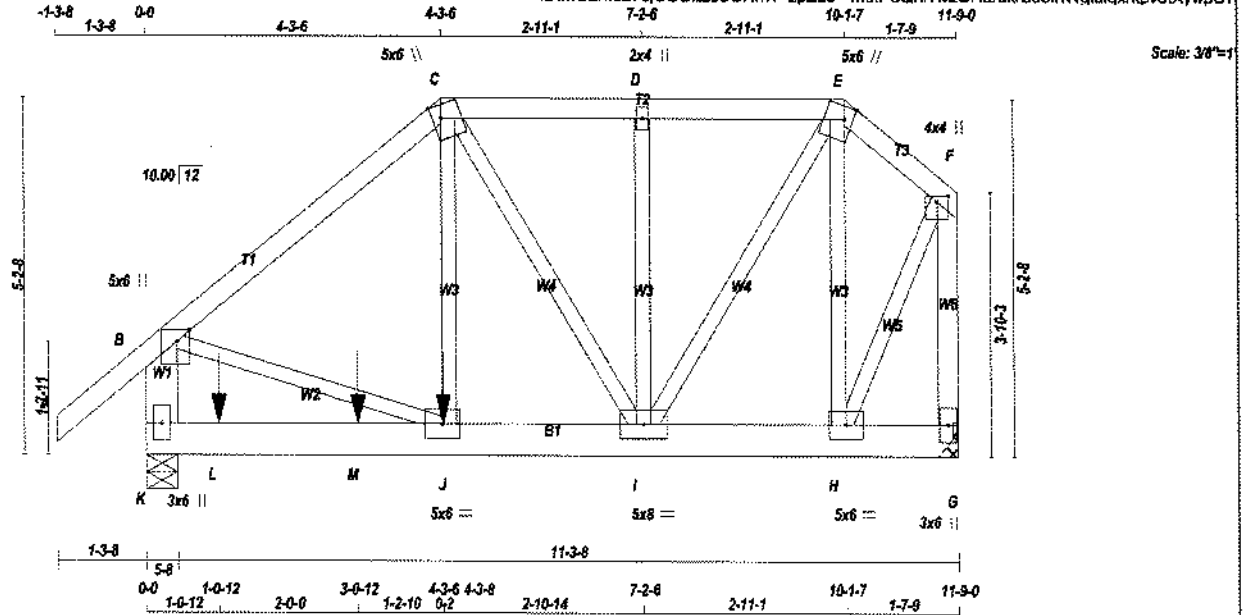

TOTAL WEIGHT = 70 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
E - F	2x4 DRY	No.2	SPF
K - B	2x6 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
K - G	2x6 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	5.0	6.0	2.90 2.25
C	TTWV+m	MT20	5.0	6.0	2.25 1.50
D	TMVW+m	MT20	2.0	4.0	
E	TTWV+m	MT20	5.0	6.0	2.25 1.50
F	TMVW+p	MT20	4.0	4.0	1.00 2.00
G	BMVt+p	MT20	3.0	6.0	
H	BMVW-t	MT20	5.0	6.0	
I	BMVW-t	MT20	5.0	6.0	
J	BMVW-t	MT20	5.0	6.0	
K	BMVt+p	MT20	3.0	6.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQRD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG IN-SX	BRG IN-SX
K	1274	0	1274	0	0	5-8	5-8
G	913	0	913	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN.	COMPONENT REACTIONS	DEAD	SOIL
K	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
K	906	569 / 0	0 / 0	0 / 0	0 / 0
G	648	411 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 38	-84.9	-84.9 0.13 (1)	10.00	J-C	0 / 658	0.16 (1)
B-C	-1046 / 0	-84.9	-84.9 0.33 (1)	5.69	C-I	-315 / 0	0.16 (1)
C-D	-652 / 0	-84.9	-84.9 0.12 (1)	6.25	I-D	-292 / 0	0.11 (1)
D-E	-652 / 0	-84.9	-84.9 0.12 (1)	6.25	E-H	0 / 704	0.17 (1)
E-F	-390 / 0	-84.9	-84.9 0.04 (1)	6.25	H-E	-521 / 0	0.20 (1)
K-B	-1195 / 0	0.0	0.0 0.09 (1)	7.81	B-J	0 / 832	0.21 (1)
G-F	-911 / 0	0.0	0.0 0.22 (1)	7.81	H-F	0 / 680	0.16 (1)
K-L	0 / 0	-18.5	-18.5 0.09 (4)	10.00			
L-M	0 / 0	-18.5	-18.5 0.09 (4)	10.00			
M-J	0 / 0	-18.5	-18.5 0.09 (4)	10.00			
J-I	0 / 816	-18.5	-18.5 0.13 (1)	10.00			
I-H	0 / 287	-18.5	-18.5 0.06 (1)	10.00			
H-G	0 / 0	-18.5	-18.5 0.02 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	4-3-8	-555	-555	---	FRONT	VERT	TOTAL	---	C1
L	1-0-12	-27	-27	---	FRONT	VERT	TOTAL	---	C1
M	3-0-12	-27	-27	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 36.7 PSF				

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2013
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.33/1.00 (B-C:1), BC=0.13/1.00 (I-H:1), WB=0.21/1.00 (B-J:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (B) (INPUT = 0.90)
JSI METAL= 0.20 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DRWG # TR22070097

JOB NAME 424156	TRUSS NAME T18	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWS NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 9 Feb 23 2022 MITek Industries, Inc. Mon Jul 18 14:44:07 2022 Page 1

ID:MG2m827siUOSfZ5oGNm1 zpZL9-Szq1cURPSJ2v6Q91SRMqHryV44FRID?yTIAPzywpU6

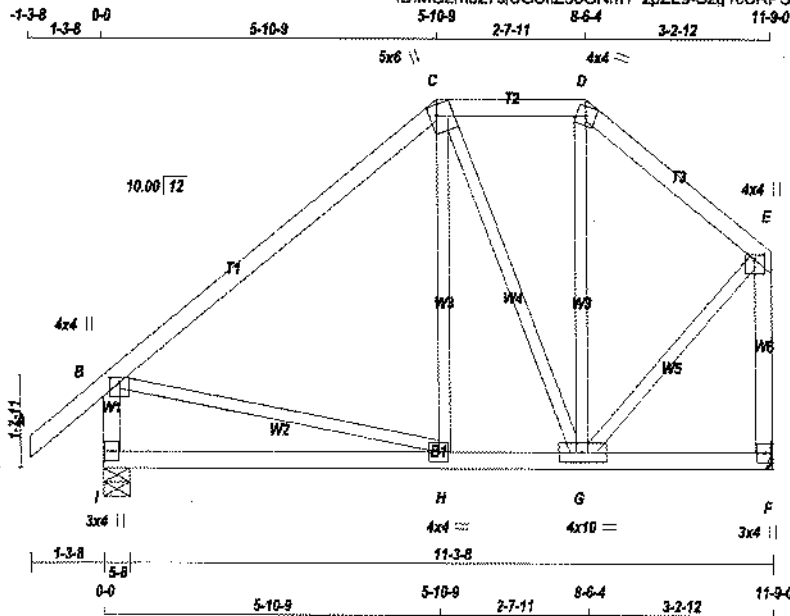

Scale = 1:39.2

TOTAL WEIGHT = 61 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	SPF	JT	VERT	GROSS REACTION	DOWN	BRG	TOP CH. LL = 23.3 PSF	
C - D	2x4	DRY	No.2	SPF	I	HORIZ	725	0	5-8	DL = 6.0 PSF	
D - E	2x4	DRY	No.2	SPF	F	HORIZ	607	0	0	BOT CH. LL = 9.0 PSF	
E - F	2x4	DRY	No.2	SPF						DL = 7.4 PSF	
F - G	2x4	DRY	No.2	SPF						TOTAL LOAD = 36.7 PSF	
G - H	2x4	DRY	No.2	SPF							
H - I	2x4	DRY	No.2	SPF							
I - J	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.					SPACING = 24.0 IN. C/C	
EXCEPT											

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMVW+p	MT20	4.0	4.0	1.00 2.00
F	BMV+p	MT20	3.0	4.0	
G	BMVW+m	MT20	4.0	10.0	
H	BMVW+m	MT20	4.0	4.0	
I	BMV+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
I	512	338 / 0	0 / 0	0 / 0	0 / 0	174 / 0	0 / 0
F	431	274 / 0	0 / 0	0 / 0	0 / 0	157 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S):

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	10.00	H-C	0 / 96	0.03 (4)
B-C	-385 / 0	-84.9	-84.9 0.38 (1)	6.25	C-G	-170 / 0	0.14 (1)
C-D	-232 / 0	-84.9	-84.9 0.08 (1)	6.25	G-D	-53 / 22	0.04 (1)
D-E	-304 / 0	-84.9	-84.9 0.11 (1)	6.25	B-H	0 / 302	0.07 (1)
I-B	-679 / 0	0.0	0.0 0.07 (1)	7.81	G-E	0 / 339	0.08 (1)
F-E	-578 / 0	0.0	0.0 0.14 (1)	7.81			
I-H	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
H-G	0 / 296	-18.5	-18.5 0.17 (4)	10.00			
G-F	0 / 0	-18.5	-18.5 0.05 (4)	10.00			

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.38")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = 1/360 (0.38")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.04")

CSI: TC=0.38/1.00 (B-C:1), BC=0.17/1.00 (G-H:4), WB=0.14/1.00 (C-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.57 (B) (INPUT = 0.90)

JSI METAL= 0.16 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070098

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	T19	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M&T Industries, Inc. Mon Jul 18 14:44:07 2022 Page 1

ID:MG2m827sjUOSfZSoGNm1 zpZL9-Szg1cURPSJ2v6QB1SRMqHr Z460RIJ7yTAPzywpU6

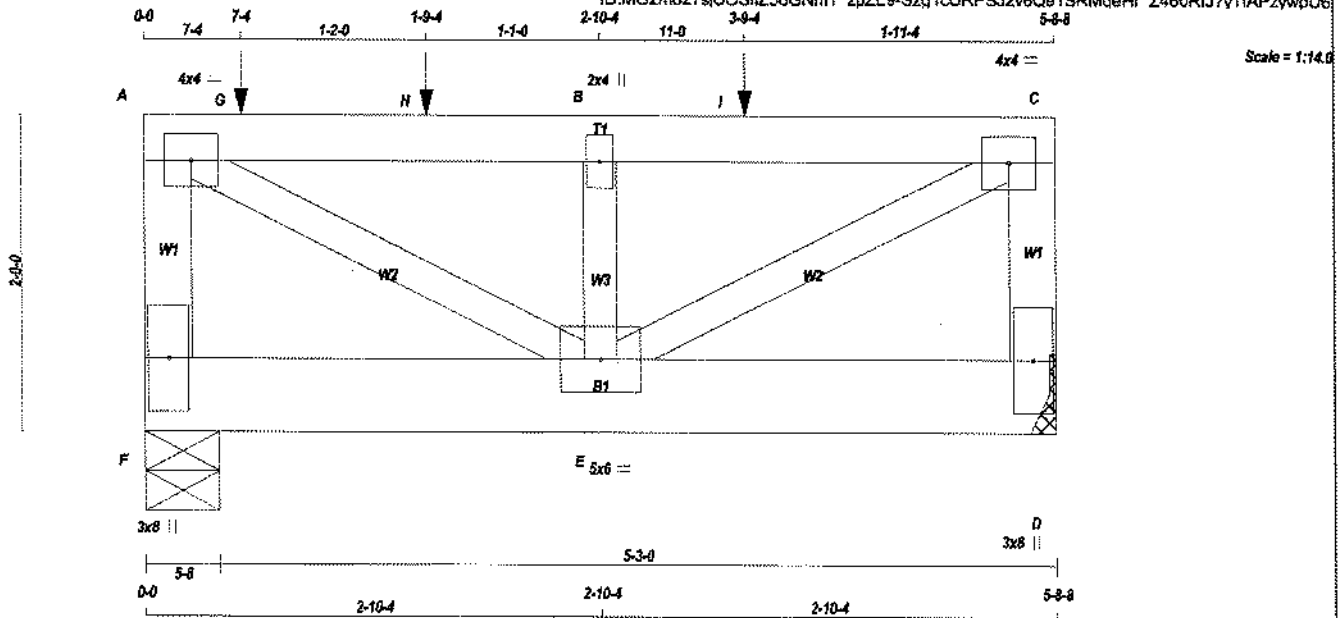

Scale = 1:14.0

TOTAL WEIGHT = 2 X 25 = 50 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
D - C	2x4 DRY	No.2	SPF		
F - D	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A 1	12	TOP
A - C 1	12	TOP
C - D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-t	MT20	4.0	4.0		
D	BMV1+p	MT20	3.0	8.0		
E	BMVWW-t	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	3.0		

NOTES:

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	1087	0	1087	0
D	805	0	805	0
			UPLIFT	IN-SX
			5-8	5-8
			MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2-0.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	754	498 / 0	0 / 0	0 / 0	0 / 0	256 / 0	0 / 0
D	570	369 / 0	0 / 0	0 / 0	0 / 0	201 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
F-A	-985 / 0	0.0	0.0 0.05 (1)	A-E	0 / 1183
A-G	-1028 / 0	-84.9	-84.9 0.25 (1)	E-B	-1230 / 0
G-H	-1028 / 0	-84.9	-84.9 0.25 (1)	B-C	0 / 1183
H-B	-1028 / 0	-84.9	-84.9 0.25 (1)		
B-I	-1028 / 0	-84.9	-84.9 0.25 (1)		
I-C	-1028 / 0	-84.9	-84.9 0.25 (1)		
D-C	-723 / 0	0.0	0.0 0.04 (1)		
F-E	0 / 0	-18.5	-18.5 0.05 (1)		
E-D	0 / 0	-18.5	-18.5 0.05 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	7-4	-141	-141	---	TOP	VERT	TOTAL	---	C1
H	1-9-4	-454	-454	---	TOP	VERT	TOTAL	---	C1
I	3-9-4	-310	-310	---	TOP	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSL: TC=0.25/1.00 (A-B:1), BC=0.05/1.00 (E-F:1)
WB=0.13/1.00 (A-E:1), SS=0.27/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 768
	1987	1973

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.75 (E) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070099



TOTAL WEIGHT = 23 lb

JSI GRIP= 0.35 (B) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:51 2022 Page 1

ID:MaxLojPKsNhr HAghID6zpVD7-4yrsyheX2IVmrZ1Cu37cOUZr2knSIESeKjcDhywpIA

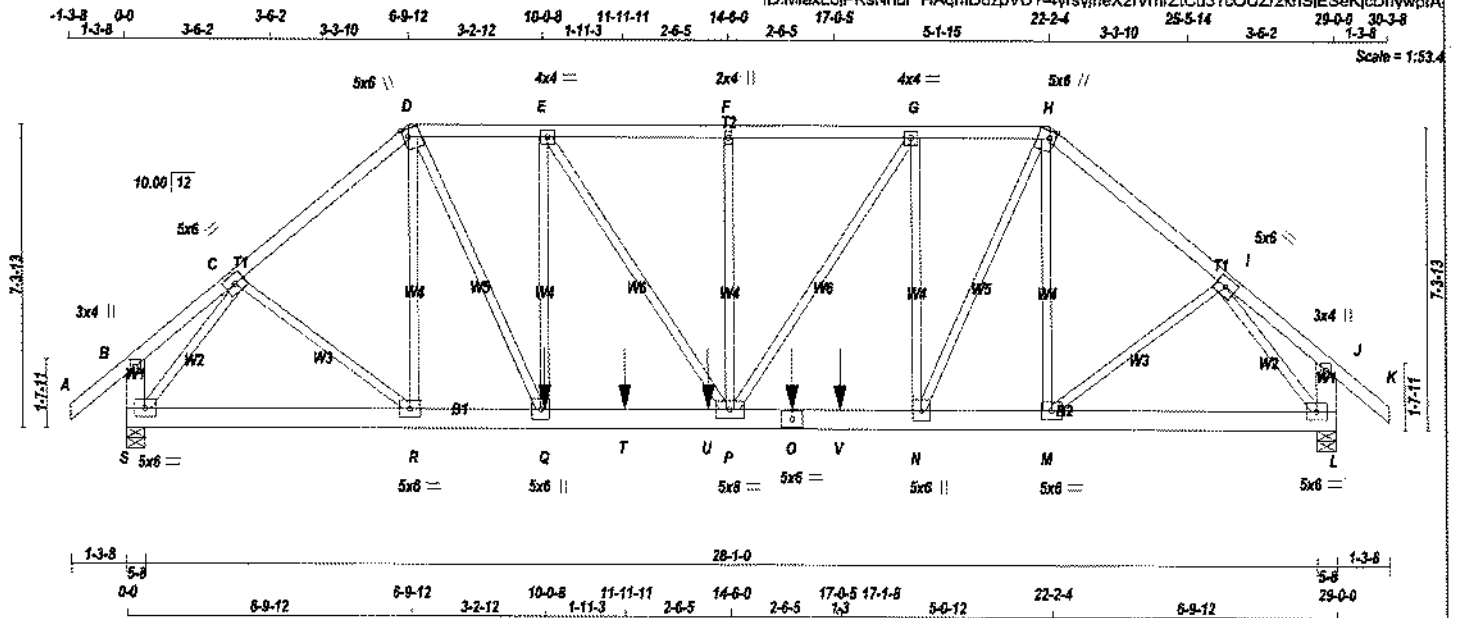

TOTAL WEIGHT = 2 X 164 = 328 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	
S - O	2x8	DRY	No.2	SPF	
O - L	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D	12	TOP
D-H	12	TOP
H-K	12	TOP
S-B	2	TOP
L-J	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
O-S	2	SIDE(183.1)
O-L	2	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
E-Q	1	SIDE(137.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
S	3298	0	3298	0
L	3081	0	3081	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
S	2329
L	2176

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0/38	-84.9	0.06 (1)	10.00	C-R	0/576	0.07 (1)	10.00
B-C	0/27	-84.9	0.08 (1)	10.00	R-D	-208/8	0.09 (1)	10.00
C-D	-3673/0	-84.9	0.18 (1)	4.78	D-Q	0/2506	0.31 (1)	10.00
D-E	-3858/0	-84.9	0.13 (1)	4.72	Q-E	-935/0	0.42 (1)	10.00
E-F	-4252/0	-84.9	0.18 (1)	4.49	N-G	-1315/0	0.59 (1)	10.00
F-G	-4252/0	-84.9	0.18 (1)	4.49	N-H	0/2468	0.31 (1)	10.00
G-H	-3816/0	-84.9	0.12 (1)	4.85	M-H	-358/0	0.16 (1)	10.00
H-I	-3382/0	-84.9	0.16 (1)	4.95	M-I	0/512	0.08 (1)	10.00
I-J	0/27	-84.9	0.09 (1)	10.00	S-C	-3858/0	0.56 (1)	10.00
J-K	0/38	-84.9	0.08 (1)	10.00	L-L	-3674/0	0.52 (1)	10.00
S-B	-186/0	0.0	0.01 (1)	7.81	E-P	0/728	0.09 (1)	10.00
L-J	-185/0	0.0	0.01 (1)	7.81	P-F	-393/0	0.18 (1)	10.00
					P-G	0/1176	0.15 (1)	10.00
S-R	0/2348	-18.5	-18.5 0.19 (1)	10.00				
R-Q	0/2799	-18.5	-18.5 0.22 (1)	10.00				
Q-T	0/3858	-18.5	-18.5 0.43 (1)	10.00				
T-U	0/3858	-18.5	-18.5 0.43 (1)	10.00				
U-P	0/3858	-18.5	-18.5 0.43 (1)	10.00				
P-O	0/3616	-18.5	-18.5 0.56 (1)	10.00				
O-V	0/3616	-18.5	-18.5 0.56 (1)	10.00				
V-N	0/3616	-18.5	-18.5 0.56 (1)	10.00				
N-M	0/2573	-18.5	-18.5 0.34 (1)	10.00				
M-L	0/2176	-18.5	-18.5 0.18 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
O	15-11-12	-201	-201	---	BACK	VERT	TOTAL	---	C1
Q	10-0-8	-866	-866	---	BACK	VERT	TOTAL	---	C1
T	11-11-12	-201	-201	---	BACK	VERT	TOTAL	---	C1
U	13-11-12	-201	-201	---	BACK	VERT	TOTAL	---	C1
V	17-1-8	-747	-747	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.97")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.97")
CALCULATED VERT. DEFL. (TL) = L/988 (0.16")

CSI: TC=0.16/1.00 (C-D-1), BC=0.56/1.00 (N-P-1),
WB=0.59/1.00 (G-N-1), SS=0.25/1.00 (N-P-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL = 0.54 (O) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

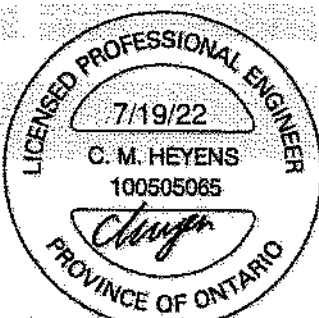

DWG # TR22070109

PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M&T Industries, Inc. Mon Jul 18 14:58:51 2022 Page 2
 ID:MiadLqPKsNhur HAchiD6zpVD?4yrsyheX2lvmrZtCu3?cOUZr2knSiESeKjcDhywpiA


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMWW-t	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	5.0	6.0	2.25	1.50
I	TMWW-t	MT20	5.0	6.0		
J	TMV+p	MT20	3.0	4.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	6.0		
O	BS-t	MT20	5.0	6.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0		
S	BMWW-t	MT20	5.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY

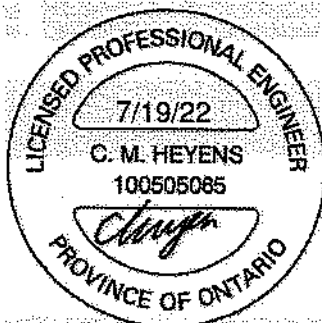


DWG # TR22070109 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T22	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTak Industries, Inc. Mon Jul 18 14:56:51 2022 Page 1

ID: MxaxLoiPKsNhur HAqhtD6zpVD?4yrsyheX2IVmrZtCu3?cOUVs2mNSIGSeKicDhywplA

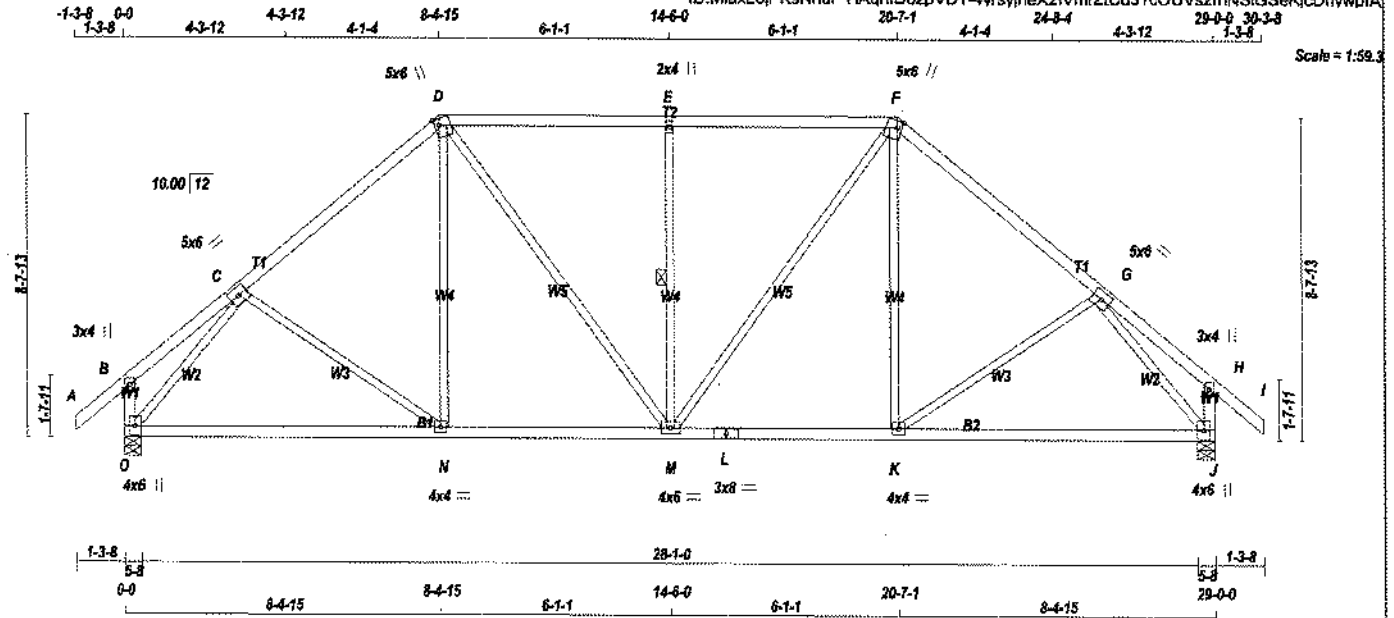

TOTAL WEIGHT = 2 X 133 = 266 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-l	MT20	5.0	6.0		
D TTWW+m	MT20	5.0	6.0	2.25	1.50
E TMV+p	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	6.0	2.25	1.50
G TMWW-l	MT20	5.0	6.0		
H TMV+p	MT20	3.0	4.0		
J BAVW+p	MT20	4.0	6.0		
K RMWW-l	MT20	4.0	4.0		
L BS-l	MT20	3.0	8.0		
M BMWWW-l	MT20	4.0	6.0		
N BMWW-l	MT20	4.0	4.0		
O BMVW+p	MT20	4.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
O	1616	0	1616	0
J	1616	0	1616	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1145	740 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0
J	1145	740 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.06 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	C-N	0 / 52	0.02 (4)	
B-C	0 / 47	-84.9	-84.9 0.30 (1)	N-D	0 / 187	0.05 (4)	
C-D	-1444 / 0	-84.9	-84.9 0.34 (1)	D-M	0 / 437	0.10 (1)	
D-E	-1347 / 0	-84.9	-84.9 0.43 (1)	M-E	-632 / 0	0.30 (1)	
E-F	-1347 / 0	-84.9	-84.9 0.43 (1)	M-F	0 / 437	0.10 (1)	
F-G	-1444 / 0	-84.9	-84.9 0.34 (1)	K-F	0 / 187	0.05 (4)	
G-H	0 / 47	-84.9	-84.9 0.30 (1)	K-G	0 / 52	0.02 (4)	
H-I	0 / 38	-84.9	-84.9 0.12 (1)	O-C	-1757 / 0	0.66 (1)	
O-B	-172 / 0	0.0	0.0 0.02 (1)	G-J	-1757 / 0	0.66 (1)	
J-H	-172 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1087	-18.5	-18.5 0.39 (4)	10.00			
N-M	0 / 1089	-18.5	-18.5 0.40 (4)	10.00			
M-L	0 / 1089	-18.5	-18.5 0.40 (4)	10.00			
L-K	0 / 1089	-18.5	-18.5 0.40 (4)	10.00			
K-J	0 / 1087	-18.5	-18.5 0.39 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 36.7	PSF

SPACING = 24.0 IN. GIG

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.97")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.97")
CALCULATED VERT. DEFL. (TL) = L/999 (0.17")

CSF: TC=0.43/1.00 (D-E:1), BC=0.40/1.00 (K-M:4), WB=0.66/1.00 (O-C:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.49 (J) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070110

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T23	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:52 2022 Page 1

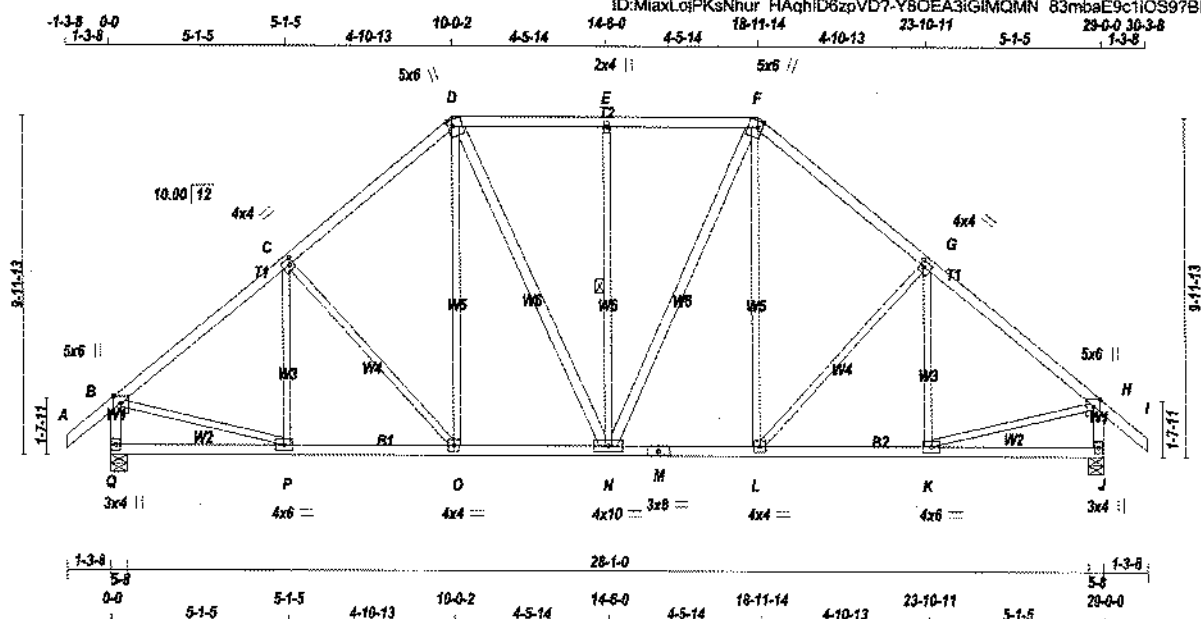

Scale = 1:65.2

TOTAL WEIGHT = 2 X 155 = 310 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 23.3 PSF	
D - F	2x4	DRY	No.2	SPF	HORZ	DOWN	HORZ	UPLIFT	IN-SX	DL = 6.0 PSF	
F - I	2x4	DRY	No.2	SPF		1616	0	0	5-8	BOT CH. LL = 0.0 PSF	
Q - B	2x4	DRY	No.2	SPF		1616	0	0	5-8	DL = 7.4 PSF	
J - H	2x4	DRY	No.2	SPF						TOTAL LOAD = 36.7 PSF	
Q - M	2x4	DRY	No.2	SPF							
M - J	2x4	DRY	No.2	SPF							

ALL WEBS	EXCEPT	SIZE	DRY	No.2	SPF
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV+p	MT20	5.0	6.0	Edge	
C TMWV-t	MT20	4.0	4.0	2.00	1.25
D TTWW+m	MT20	5.0	6.0	2.25	1.50
E TMW+w	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	6.0	2.25	1.50
G TMWV-t	MT20	4.0	4.0	2.00	1.25
H TMWV+p	MT20	5.0	6.0	Edge	
J BMV1+p	MT20	3.0	4.0		
K BMWV-t	MT20	4.0	6.0		
L BMWV-t	MT20	4.0	4.0		
M BS-t	MT20	3.0	8.0		
N BMWV-t	MT20	4.0	10.0		
O BMWV-t	MT20	4.0	4.0		
P BMWV-t	MT20	4.0	6.0		
Q BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1616	0	1616	0	0	5-8	5-8
J	1616	0	1616	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1145	740/0	0/0	0/0	0/0	405/0	0/0
J	1145	740/0	0/0	0/0	0/0	405/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/38	-84.9 -84.9	0.12 (1)	P-C	-200/9	0.11 (1)	
B-C	-1513/0	-84.9 -84.9	0.32 (1)	Q-O	-255/0	0.28 (1)	
C-D	-1360/0	-84.9 -84.9	0.30 (1)	O-D	0/275	0.08 (1)	
D-E	-1144/0	-84.9 -84.9	0.23 (1)	D-N	0/287	0.05 (1)	
E-F	-1144/0	-84.9 -84.9	0.23 (1)	N-E	-459/0	0.31 (1)	
F-G	-1360/0	-84.9 -84.9	0.30 (1)	N-F	0/297	0.05 (1)	
G-H	-1513/0	-84.9 -84.9	0.32 (1)	L-F	0/275	0.08 (1)	
H-I	0/38	-84.9 -84.9	0.12 (1)	L-G	-255/0	0.28 (1)	
Q-B	-1577/0	0.0 0.0	0.17 (1)	K-G	-200/9	0.11 (1)	
J-H	-1577/0	0.0 0.0	0.17 (1)	B-P	0/1225	0.28 (1)	
				K-H	0/1225	0.28 (1)	
Q-P	0/0	-18.5 -18.5	0.11 (4)				
P-O	0/1187	-18.5 -18.5	0.24 (1)				
O-N	0/1020	-18.5 -18.5	0.21 (1)				
N-M	0/1020	-18.5 -18.5	0.21 (1)				
M-L	0/1020	-18.5 -18.5	0.21 (1)				
L-K	0/1187	-18.5 -18.5	0.24 (1)				
K-J	0/0	-18.5 -18.5	0.11 (4)				

STRUCTURAL COMPONENT ONLY



DWG # TR22070111

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 23.3 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS1: TC=0.32/1.00 (G-H-1), BC=0.24/1.00 (K-L-1), WB=0.31/1.00 (E-N-1), SSF=0.18/1.00 (E-F-1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (P) (INPUT = 0.90)
JSI METAL= 0.57 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T24A	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITEX Industries, Inc. Mon Jul 18 14:56:53 2022 Page 1
ID: MiazLojPKsNhr HAqhiD6zpVD7-0KycNPiu3gYD78jFKJ6ThpZtrVfwm7i5eCjHaywpt8

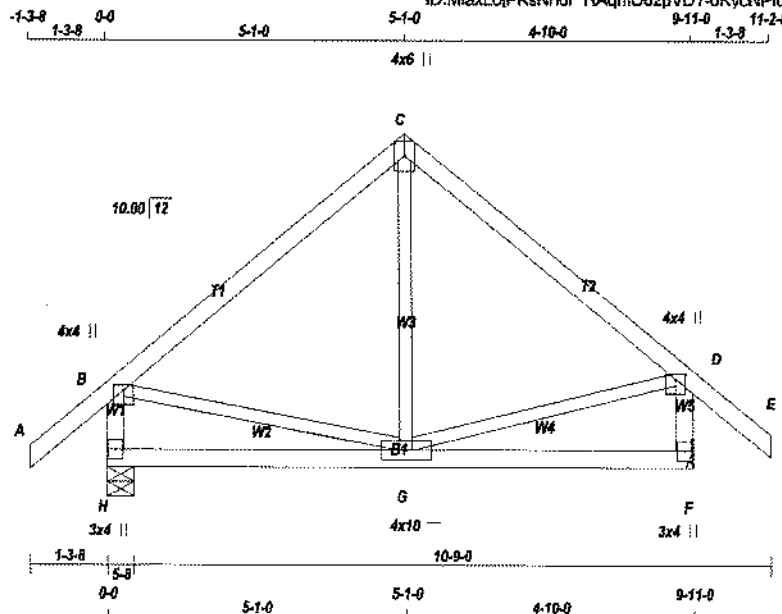

Scale = 1:37.6

TOTAL WEIGHT = 3 X 45 = 134 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY No.2	SPF	
C - E	2x4	DRY No.2	SPF	
H - B	2x4	DRY No.2	SPF	
F - D	2x4	DRY No.2	SPF	
H - F	2x4	DRY No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TTW+p	MT20	4.0	6.0	Edge	
D TMVW+p	MT20	4.0	4.0	1.00	2.00
F BMV1+p	MT20	3.0	4.0		
G BMVW+l	MT20	4.0	10.0		
H BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	630	0	630	0	0
F	630	0	630	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	445	295 / 0	0 / 0	0 / 0	0 / 0	0 / 0	150 / 0	0 / 0
F	445	295 / 0	0 / 0	0 / 0	0 / 0	0 / 0	150 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX. (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX. (PLF)	UNBRACED LENGTH
FR-TO				FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	G-C	-7 / 80	0.03 (4)	10.00
B-C	-323 / 0	-84.9	-84.9 0.28 (1)	B-G	0 / 254	0.06 (1)	6.25
C-D	-323 / 0	-84.9	-84.9 0.25 (1)	G-D	0 / 257	0.06 (1)	6.25
D-E	0 / 38	-84.9	-84.9 0.12 (1)				10.00
H-B	-593 / 0	0.0	0.0 0.08 (1)				7.81
F-D	-598 / 0	0.0	0.0 0.08 (1)				7.81
H-G	0 / 0	-18.5	-18.5 0.13 (4)				10.00
G-F	0 / 0	-18.5	-18.5 0.13 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF CBC 2012 (2015 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.28/1.00 (B-C:1), BC=0.13/1.00 (G-H:4)
WB=0.06/1.00 (D-G:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 786	1987 1873	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (B) (INPUT = 0.90)
JSI METAL= 0.14 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070112

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T24G	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 14:56:53 2022 Page 1
ID: M1axL0jPKsNhr HAqhiD6zpVD7-0KycNPiu3gYD78jFKJ6ThpZw+HxowlxISeCjHaywplE

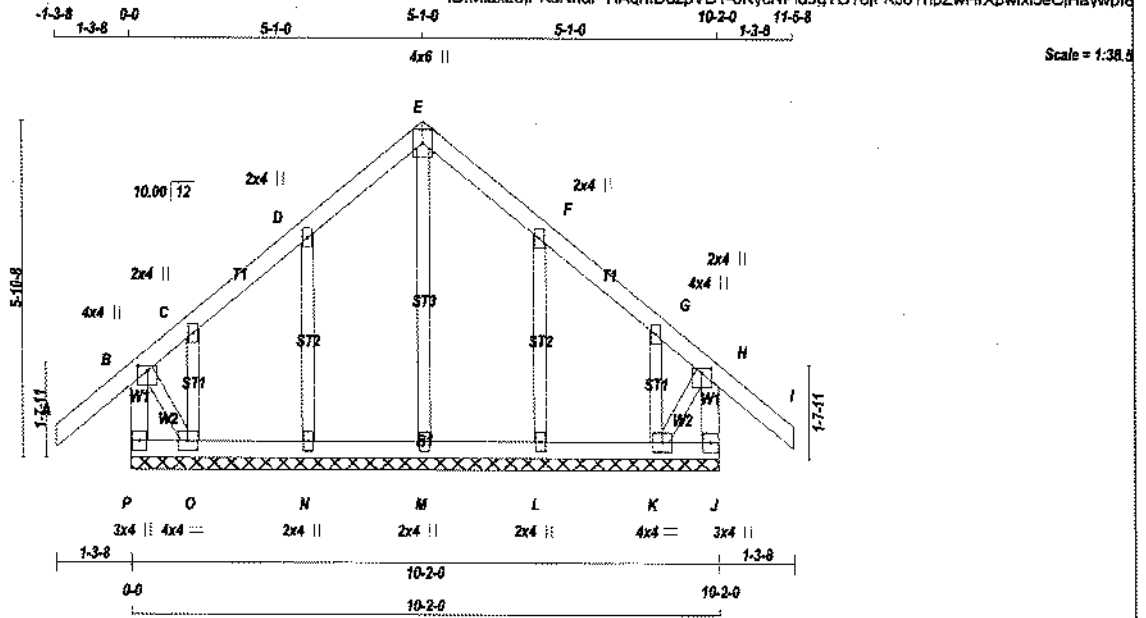

TOTAL WEIGHT = 49 lb

NUMBER				TOTAL WEIGHT = 436			
N. L. G. A. RULES				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
CHORDS SIZE LUMBER DESCR.				DESIGN CRITERIA			
P - B 2x4 DRY No.2 SPF				SPECIFIED LOADS:			
A - E 2x4 DRY No.2 SPF				TOP CH. LL = 23.3 PSF			
E - I 2x4 DRY No.2 SPF				DL = 6.0 PSF			
J - H 2x4 DRY No.2 SPF				BOT CH. LL = 0.0 PSF			
P - J 2x4 DRY No.2 SPF				DL = 7.4 PSF			
ALL WEBS 2x3 DRY No.2 SPF				TOTAL LOAD = 36.7 PSF			
ALL GABLE WEBS 2x3 DRY No.2 SPF				SPACING = 24.0 IN. C/C			
DRY: SEASONED LUMBER.				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015			
GABLE STUDS SPACED AT 24-0 OC.				THIS DESIGN COMPLIES WITH:			
				- PART 9 OF BCBC 2016, ABC 2019			
				- PART 9 OF CBC 2012 (2019 AMENDMENT)			
				- CSA 086-14			
				- TPIC 2014			
PLATES (table is in inches)				DESIGN ASSUMPTIONS			
JT TYPE PLATES W LEN Y X				OVERHANG NOT TO BE ALTERED OR CUT OFF.			
B TMVW+p MT20 4.0 4.0 1.00 2.00				(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
C, D, F, G				CSI: TC=0.12/1.00 (H-I), BC=0.02/1.00 (N-O), WB=0.07/1.00 (E-M), SSI=0.07/1.00 (H-I)			
C TMVW+w MT20 2.0 4.0				DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10			
E TTW+p MT20 4.0 6.0 Edge				COMPANION LIVE LOAD FACTOR = 1.00			
H TMVW+p MT20 4.0 4.0 1.00 2.00				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN			
J BMV1+p MT20 3.0 4.0							
K BMVW1-t MT20 4.0 4.0							
L, M, N							
L BMV1+w MT20 2.0 4.0							
O BMVW1-t MT20 4.0 4.0							
P BMV1+p MT20 3.0 4.0							
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.							
NOTES: (1)							
1) Lateral braces to be a minimum of 2x4 SPF #2.							

CHORDS				WEBS			
MAX. FACTORED FORCE (LBS)				MAX. FACTORED UNBRACED LENGTH (FT)			
MEMB. FORCE (LBS)				MEMB. FORCE (LBS)			
FR-TO FROM TO				FR-TO FROM TO			
P-B -250 / 0 0.0 0.0 0.03 (1) 7.81				M-E -136 / 0 0.07 (1)			
A-B 0 / 38 -84.9 -84.9 0.12 (1) 10.00				N-D -205 / 0 0.05 (1)			
B-C -58 / 0 -84.9 -84.9 0.11 (1) 6.25				O-C -36 / 0 0.01 (1)			
C-D 0 / 1 -84.9 -84.9 0.08 (1) 10.00				L-F -205 / 0 0.05 (1)			
D-E -15 / 0 -84.9 -84.9 0.05 (1) 6.25				K-G -36 / 0 0.01 (1)			
E-F -15 / 0 -84.9 -84.9 0.05 (1) 6.25				B-O 0 / 13 0.00 (1)			
F-G 0 / 1 -84.9 -84.9 0.06 (1) 10.00				K-H 0 / 13 0.00 (1)			
G-H -58 / 0 -84.9 -84.9 0.11 (1) 6.25							
H-I 0 / 38 -84.9 -84.9 0.12 (1) 10.00							
J-H -250 / 0 0.0 0.0 0.03 (1) 7.81							
P-O 0 / 0 -18.5 -18.5 0.01 (4) 10.00							
O-N 0 / 7 -18.5 -18.5 0.02 (4) 10.00							
N-M 0 / 2 -18.5 -18.5 0.02 (4) 10.00							
M-L 0 / 2 -18.5 -18.5 0.02 (4) 10.00							
L-K 0 / 7 -18.5 -18.5 0.02 (4) 10.00							
K-J 0 / 0 -18.5 -18.5 0.01 (4) 10.00							

STRUCTURAL COMPONENT ONLY




DWG # TR22070113

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T25	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:54 2022 Page 1
ID: MxLojPKsNhur HAqhiD6zpVD7-UWW7bWqzq4dISu0diE165cFrytAduKlyGq0ywpI7

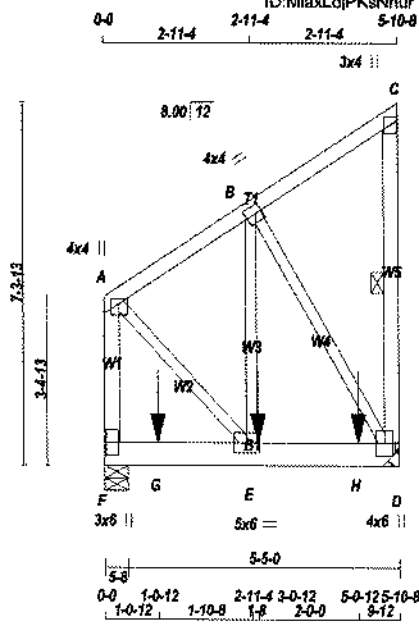

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 2 X 41 = 81 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY No.2	SPF	
D - C	2x4	DRY No.2	SPF	
F - A	2x4	DRY No.2	SPF	
F - D	2x6	DRY No.2	SPF	
ALL WEBS	2x3	DRY No.2	SPF	
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	12	TOP
F - A 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW*P	MT20	4.0	4.0	1.25 2.00

STRUCTURAL COMPONENT ONLY



DWG # TR22070114

PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	1249	0	1249	0	0
F	1195	0	1195	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
D	880	593 / 0	0 / 0	0 / 0	0 / 0	288 / 0	0 / 0
F	843	567 / 0	0 / 0	0 / 0	0 / 0	275 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-D.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED	WEBS	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. MAX. UNBRAC	MEMB. FORCE (LBS)
FR-TO		FROM TO	LENGTH	FR-TO
A-B	-511 / 0	-84.9 -84.9 0.06 (1)	6.25	E-B 0 / 725
B-C	-16 / 0	-84.9 -84.9 0.06 (1)	6.25	B-D -859 / 0
D-C	-96 / 0	0.0 0.0 0.01 (1)	6.25	A-E 0 / 626
F-A	-835 / 0	0.0 0.0 0.08 (1)	7.81	
F-G	0 / 0	-18.5 -18.5 0.14 (1)	10.00	
G-E	0 / 0	-18.5 -18.5 0.14 (1)	10.00	
E-H	0 / 438	-18.5 -18.5 0.15 (1)	10.00	
H-D	0 / 438	-18.5 -18.5 0.15 (1)	10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-12	-430	-430	---	FRONT	VERT	TOTAL	---	C1
G	1-0-12	-430	-430	---	FRONT	VERT	TOTAL	---	C1
H	5-0-12	-432	-432	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.08/1.00 (A-F:1) , BC=0.15/1.00 (D-E:1)
WB=0.23/1.00 (B-D:1) , SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747
	786	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.43 (B) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T25	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Mon Jul 18 14:56:54 2022 Page 2
ID: MlaxLoPKsNhr HAghID6zpVD?UWW7biWqzg4dlISu0diE165cFryAduKlyGq0ywp17


PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW-t	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

NOTES: (1)


1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY

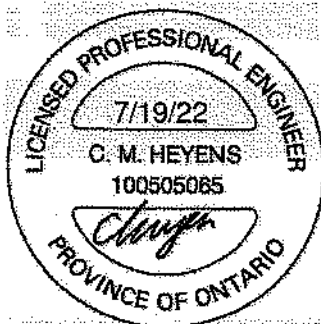

DWG # TR22070114

PG 2/2



DWG # TR22070115 PG 1/2

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

```
JSI GRIP= 0.36 (B) (INPUT = 0.90 )
JSI METAL= 0.09 (D) (INPUT = 1.00 )
```

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T25Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 14:56:55 2022 Page 2

ID:MiaxLqPKsNhr HAghID6zpVD7-zj4No5k8bHoxESseRk8xnefGVbK0dK1ZyhcMSywp16


PLATES (Table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW-l	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY

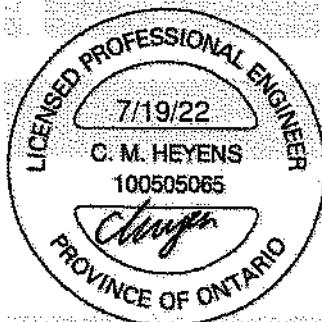


DWG # TR22070115 PG 2/2

JOB NAME 424158	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:58:56 2022 Page 1
ID: MxLojPKsNhr HAqhiD6zpVD?Rvel0RimMbwoscRq7RfAJSBMA3Xn76qBocRNuuywp15

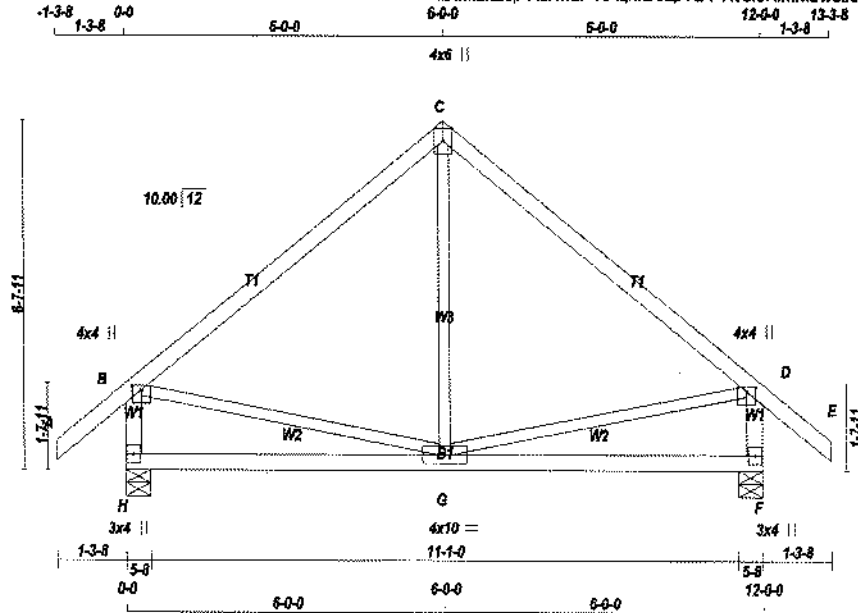

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 2 X 53 = 106 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW+p	MT20	4.0	6.0	Edge
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVWW+4	MT20	4.0	10.0	
H	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ
H	738	0	738	0
F	738	0	738	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
H	521	344 / 0	0 / 0	0 / 0	0 / 0	177 / 0
F	521	344 / 0	0 / 0	0 / 0	0 / 0	177 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE	VERT. LOAD	MAX	MEMB.	FORCE	MAX	FACTORED
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9 -84.9	0.12 (1)	10.00	G-C	0 / 102	0.04 (4)
B-C	-400 / 0	-84.9 -84.9	0.39 (1)	6.25	B-G	0 / 315	0.07 (1)
C-D	-400 / 0	-84.9 -84.9	0.39 (1)	6.25	G-D	0 / 315	0.07 (1)
D-E	0 / 38	-84.9 -84.9	0.12 (1)	10.00			
H-B	-695 / 0	0.0 0.0	0.07 (1)	7.81			
F-D	-695 / 0	0.0 0.0	0.07 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.19 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.19/1.00 (G-H:4)
WB=0.07/1.00 (B-G:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)

JSI METAL= 0.16 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070117

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424158	T27A	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:57 2022 Page 1

ID: MlxLdLqPKsNhr HAqhlD6zpVD7-v5C7DnmP7u3Um00Z9APsfkWWt8sZvK0GAWQlYwpl4

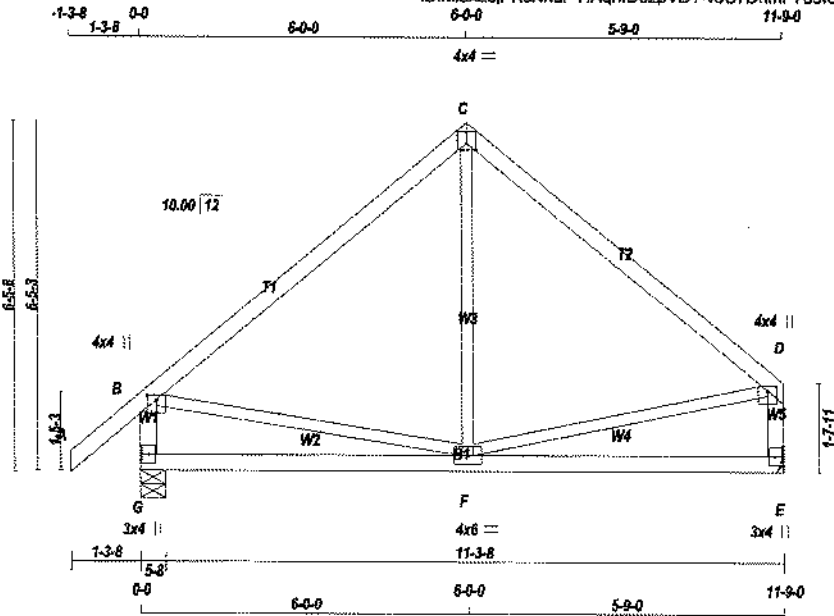

Scale = 1:40.0

TOTAL WEIGHT = 3 X 50 = 149 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW-p	MT20	4.0	4.0	1.50 2.00
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVt+p	MT20	3.0	4.0	
F	BMVW+W-t	MT20	4.0	6.0	
G	BMVt+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
G	725	0	725	0	5-8
E	607	0	607	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	512	338 / 0	0 / 0	0 / 0	0 / 0	174 / 0	0 / 0
E	431	274 / 0	0 / 0	0 / 0	0 / 0	157 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 38	F-C	0 / 102
B-C	-397 / 0	B-F	0 / 310
C-D	-397 / 0	F-D	0 / 313
G-B	-682 / 0		
E-D	-567 / 0		
G-F	0 / 0		
F-E	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (E-F:4)
WB=0.07/1.00 (D-F:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070118

JOB NAME 424158	TRUSS NAME T27G	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:58 2022 Page 1

ID: MlxLoiPKsNhr HAqhiD6zpVD?NrmVQ8m1uCBW6wbD7sheOtGm0sFwb0vUfwwUzynywpt3

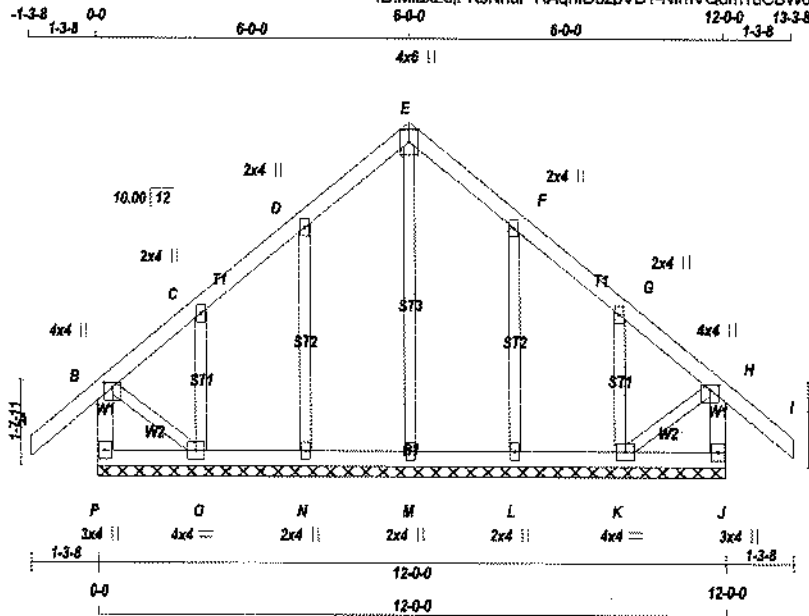

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 58 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	6.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW14	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW14	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRAC LENGTH FR-TO	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
P-B	-261 / 0	0.0	0.03 (1)	7.81	M-E	-123 / 0	0.09 (1)
A-B	0 / 38	-84.9	-84.9 0.12 (1)	10.00	N-D	-203 / 0	0.07 (1)
B-C	-46 / 0	-84.9	-84.9 0.11 (1)	6.25	O-C	-113 / 0	0.02 (1)
C-D	-10 / 0	-84.9	-84.9 0.05 (1)	10.00	L-F	-203 / 0	0.07 (1)
D-E	-25 / 0	-84.9	-84.9 0.05 (1)	6.25	K-G	-113 / 0	0.02 (1)
E-F	-10 / 0	-84.9	-84.9 0.05 (1)	10.00	B-O	0 / 21	0.00 (1)
F-G	-10 / 0	-84.9	-84.9 0.05 (1)	10.00	K-H	0 / 21	0.00 (1)
G-H	-46 / 0	-84.9	-84.9 0.11 (1)	6.25			
H-I	0 / 38	-84.9	-84.9 0.12 (1)	10.00			
J-H	-261 / 0	0.0	0.03 (1)	7.81			
P-O	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
O-N	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
N-M	0 / 10	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 10	-18.5	-18.5 0.02 (4)	10.00			
L-K	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (K-L:4), WB=0.09/1.00 (E-M:1), SS=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.11 (D) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

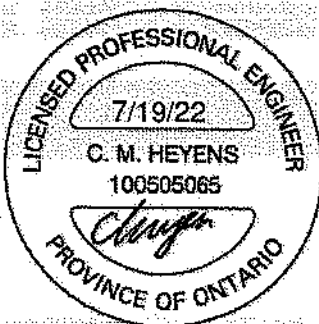

DWG # TR22070119

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T28	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTX Industries, Inc. Mon Jul 18 15:06:48 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-5oPYFsv6xUWouaichmH7JHlVniX7qmQKwifaywp8

1-3-8 0-0 5-10-8 7-7-8 4-7-0 12-2-8 2-3-8 14-6-0 2-3-8 15-9-8 4-7-0 21-4-8 23-1-8 5-10-8 29-0-0 1-3-8

Scale = 1:52.6

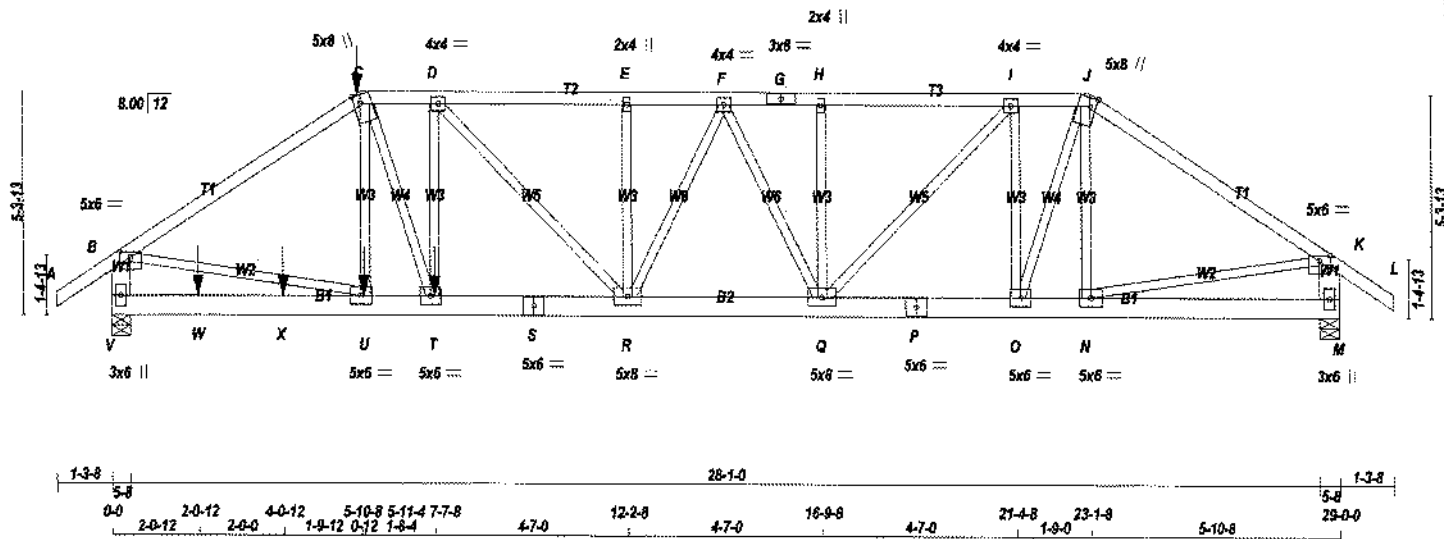

TOTAL WEIGHT = 2 X 153 = 306 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
V - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
V - S	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - M	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	TOP
J-L	12	TOP
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	12	SIDE(183.1)
S-P	12	TOP
P-M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
U-C	6	SIDE(22.1)
T-D	6	SIDE(252.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REORD
JT	VERT 3370	DOWN 3370	BRG	BRG
M	HORZ 0	HORZ 0	IN-SX	IN-SX
			5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED SNOW	LIVE			
V	2394	1547 / 0	0 / 0	0 / 0	847 / 0
M	1544	1003 / 0	0 / 0	0 / 0	541 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.26 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 32	-84.9	-84.9	0.06 (1)	10.00	U-C	-272 / 65	0.06 (1)	0.06 (1)
B-C	-4231 / 0	-84.9	-84.9	0.46 (1)	4.26	N-J	-230 / 0	0.05 (1)	0.05 (1)
C-D	-4137 / 0	-84.9	-84.9	0.12 (1)	4.58	B-U	0 / 3564	0.44 (1)	0.44 (1)
D-E	-4091 / 0	-84.9	-84.9	0.17 (1)	4.58	N-K	0 / 2147	0.27 (1)	0.27 (1)
E-F	-4091 / 0	-84.9	-84.9	0.14 (1)	4.59	C-T	0 / 1873	0.23 (1)	0.23 (1)
F-G	-3558 / 0	-84.9	-84.9	0.13 (1)	4.87	T-D	-230 / 0	0.05 (1)	0.05 (1)
G-H	-3558 / 0	-84.9	-84.9	0.13 (1)	4.87	O-I	-1336 / 0	0.27 (1)	0.27 (1)
H-I	-3558 / 0	-84.9	-84.9	0.15 (1)	4.86	Q-J	0 / 1441	0.18 (1)	0.18 (1)
I-J	-2598 / 0	-84.9	-84.9	0.10 (1)	5.55	Q-I	0 / 1413	0.17 (1)	0.17 (1)
J-K	-2548 / 0	-84.9	-84.9	0.35 (1)	5.29	D-R	-67 / 0	0.03 (1)	0.03 (1)
K-L	0 / 32	-84.9	-84.9	0.06 (1)	10.00	Q-H	-343 / 0	0.07 (1)	0.07 (1)
V-B	-3305 / 0	0.0	0.0	0.12 (1)	7.64	R-E	-345 / 0	0.07 (1)	0.07 (1)
M-K	-2136 / 0	0.0	0.0	0.08 (1)	7.81	R-F	0 / 584	0.07 (1)	0.07 (1)
						F-Q	-890 / 0	0.17 (1)	0.17 (1)
V-W	0 / 0	-18.5	-18.5	0.07 (4)	10.00				
W-X	0 / 0	-18.5	-18.5	0.07 (4)	10.00				
X-U	0 / 0	-18.5	-18.5	0.07 (4)	10.00				
U-T	0 / 3510	-18.5	-18.5	0.29 (1)	10.00				
T-S	0 / 4137	-18.5	-18.5	0.33 (1)	10.00				
S-R	0 / 4137	-18.5	-18.5	0.33 (1)	10.00				
R-Q	0 / 3846	-18.5	-18.5	0.27 (1)	10.00				
Q-P	0 / 2595	-18.5	-18.5	0.20 (1)	10.00				
P-O	0 / 2595	-18.5	-18.5	0.20 (1)	10.00				
O-N	0 / 2113	-18.5	-18.5	0.16 (1)	10.00				
N-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIRL	TYPE	HEEL	CONN.
C	5-10-8	-382	-382	-	BACK	VERT	TOTAL	-	C1
T	7-7-8	-1182	-1182	-	BACK	VERT	TOTAL	-	C1
U	5-11-4	-29	-29	-	BACK	VERT	TOTAL	-	C1
W	2-0-12	-29	-29	-	BACK	VERT	TOTAL	-	C1
X	4-0-12	-29	-29	-	BACK	VERT	TOTAL	-	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/998 (0.15")

CSI: YC=0.46/1.00 (B-C:1), BC=0.33/1.00 (R-T:1)
WB=0.44/1.00 (B-U:1), SS=0.09/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (I) (INPUT = 0.90)
JSI METAL= 0.40 (S) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

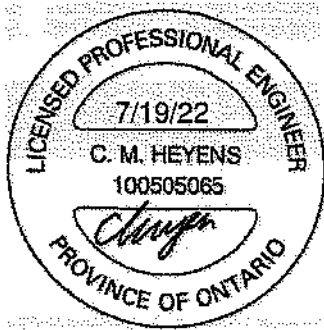

DWG # TR22070129 PG 1/2

CONTINUED ON PAGE 2

JOB NAME 424160	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:48 2022 Page 2
ID:MG2m827siUOSiZ5oGNm1 zpZL9-5oPYFsv6xJWouaichmH7JHlVniX7qmQKwifaywp8r

PLATES Table is in inches

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.50	3.00
C TTWW+tm	MT20	5.0	8.0	Edge	1.75
D, F, I					
D TMWW-t	MT20	4.0	4.0		
E TMW+w	MT20	2.0	4.0		
G TS-t	MT20	3.0	8.0		
H TMW+w	MT20	2.0	4.0		
J TTWW+tm	MT20	5.0	8.0	Edge	1.75
K TMVW-p	MT20	5.0	6.0	1.50	3.00
M BMV1+p	MT20	3.0	6.0		
N, O, T, U					
N BMWW-t	MT20	5.0	6.0		
P BS-t	MT20	5.0	6.0		
Q BMWWW-t	MT20	5.0	8.0		
R BMWWW-t	MT20	5.0	8.0		
S BS-t	MT20	5.0	6.0		
V BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

STRUCTURAL COMPONENT ONLY

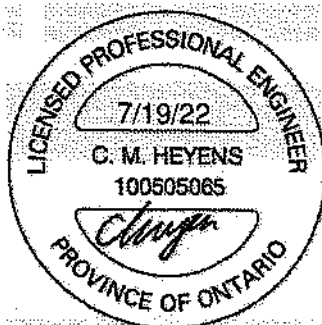


DWG # TR22070129 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T29	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 15:06:49 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZ19-Z zwTCwkineVkhHoEUeErVfR5sLZAXT9MaFC1ywpBq

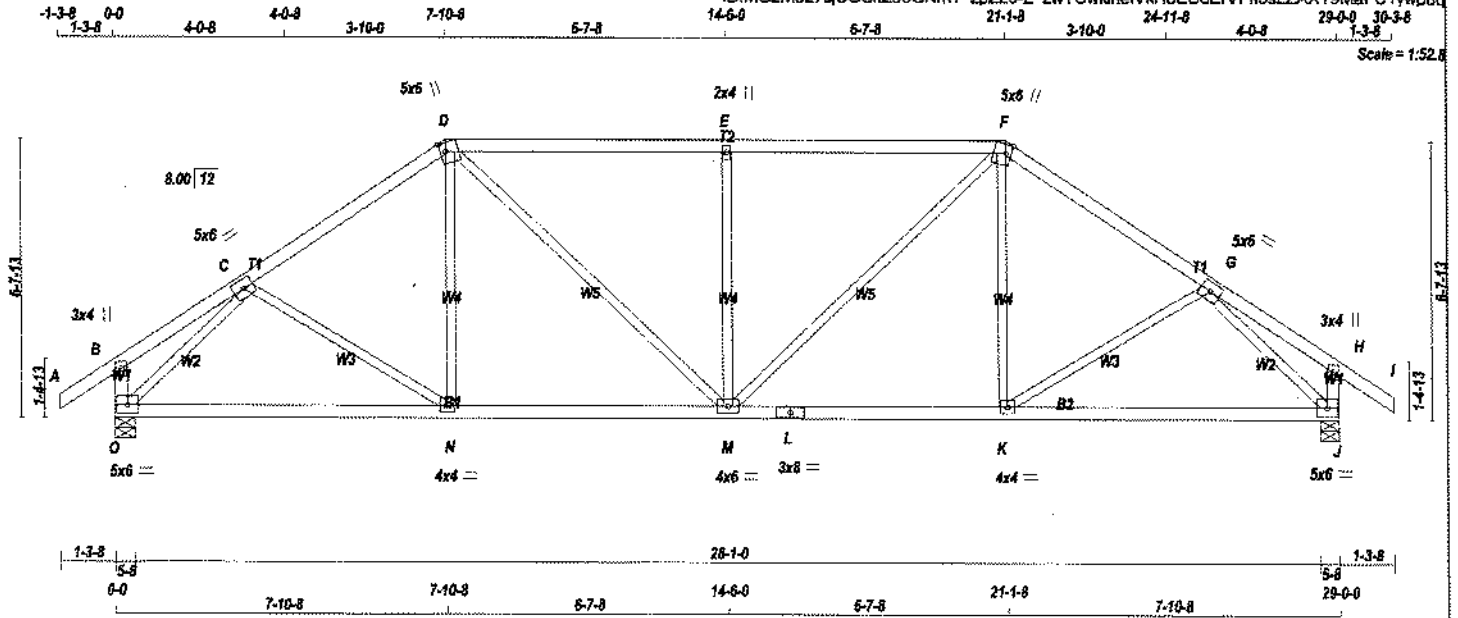

TOTAL WEIGHT = 2 X 121 = 241 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
O - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-t	MT20	5.0	6.0		
O TMVW+m	MT20	5.0	6.0	2.50	1.50
E TMVW+w	MT20	2.0	4.0		
F TMVW+m	MT20	5.0	6.0	2.50	1.50
G TMVW-t	MT20	5.0	6.0		
H TMV+p	MT20	3.0	4.0		
J BMVW-t	MT20	5.0	6.0		
K BMVW-t	MT20	4.0	4.0		
L BS-t	MT20	3.0	8.0		
M BMVWW-t	MT20	4.0	6.0		
N BMVW-t	MT20	4.0	4.0		
O BMVW-t	MT20	5.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
O	1615	0	1615	0	0	5-8	5-8		
J	1615	0	1615	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1144	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0
J	1144	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 32	-84.9 -84.9	0.11 (1)	10.00	C-N	0 / 71	0.02 (4)
B-C	0 / 31	-84.9 -84.9	0.24 (1)	10.00	N-D	0 / 142	0.05 (4)
C-D	-1670 / 0	-84.9 -84.9	0.28 (1)	4.37	D-M	0 / 569	0.13 (1)
D-E	-1785 / 0	-84.9 -84.9	0.54 (1)	4.38	M-E	-691 / 0	0.51 (1)
E-F	-1785 / 0	-84.9 -84.9	0.54 (1)	4.38	M-F	0 / 569	0.13 (1)
F-G	-1670 / 0	-84.9 -84.9	0.28 (1)	4.87	K-F	0 / 142	0.05 (4)
G-H	0 / 31	-84.9 -84.9	0.24 (1)	10.00	K-G	0 / 71	0.02 (4)
H-I	0 / 32	-84.9 -84.9	0.11 (1)	10.00	O-C	-1910 / 0	0.58 (1)
O-B	-188 / 0	0.0 0.0	0.02 (1)	7.81	G-J	-1910 / 0	0.58 (1)
J-H	-188 / 0	0.0 0.0	0.02 (1)	7.81			
O-N	0 / 1334	-18.5 -18.5	0.38 (4)	10.00			
N-M	0 / 1374	-18.5 -18.5	0.39 (4)	10.00			
M-L	0 / 1374	-18.5 -18.5	0.39 (4)	10.00			
L-K	0 / 1374	-18.5 -18.5	0.39 (4)	10.00			
K-J	0 / 1334	-18.5 -18.5	0.38 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.54/1.00 (D-E:1), BC=0.39/1.00 (K-M:4), WB=0.58/1.00 (G-J:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 768 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (J) (INPUT = 0.90)
JSI METAL= 0.43 (L) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

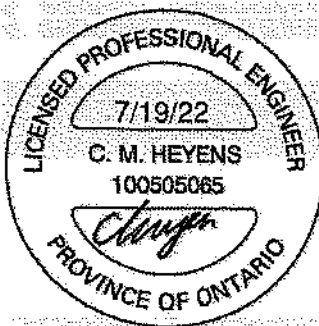


DWG # TR22070130

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T30	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:50 2022 Page 1

ID:MG2m827sIUOS1Z5oGNm1 zpZl.9-2BXJqYxNT5mWYus7oBJTOiucvEKIdpcN0KpkTywp8p

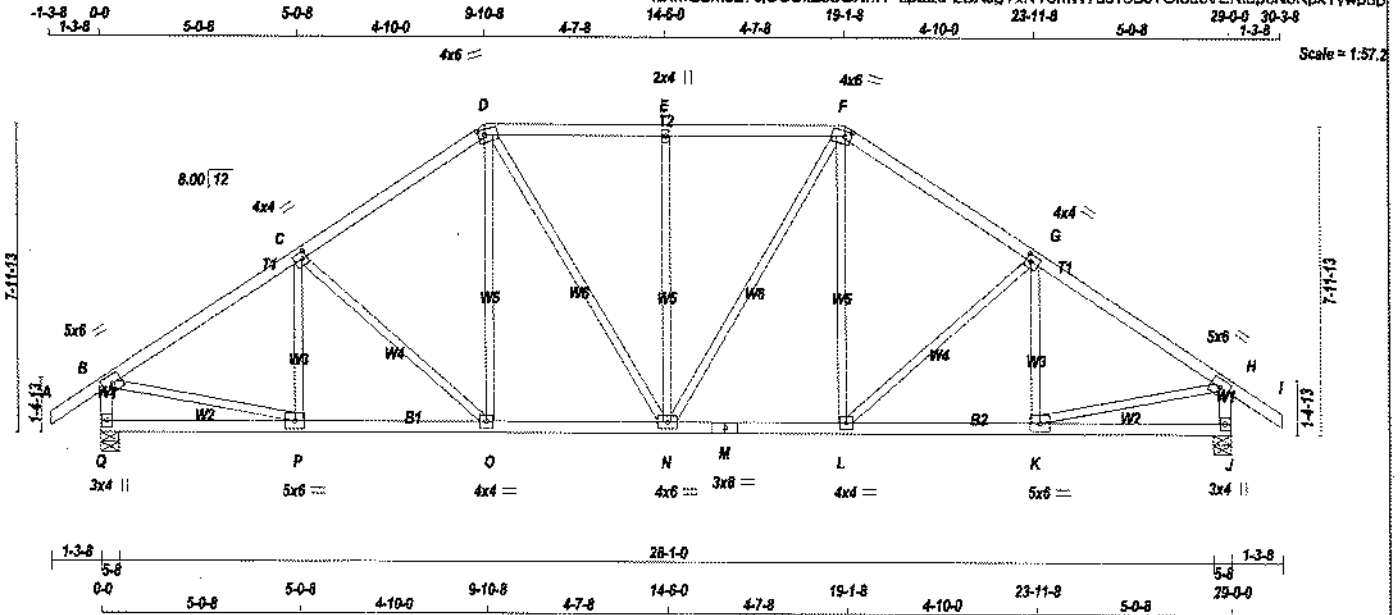

TOTAL WEIGHT = 2 X 134 = 267 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
Q - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
Q - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-L	MT20	5.0	6.0		
C	TMVW-L	MT20	4.0	4.0	2.00	1.50
D	TMVW-m	MT20	4.0	6.0	1.75	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-m	MT20	4.0	6.0	1.75	2.00
G	TMVW-L	MT20	4.0	4.0	2.00	1.50
H	TMVW-L	MT20	5.0	6.0		
J	BMVW-L	MT20	3.0	4.0		
K	BMVW-L	MT20	5.0	6.0		
L	BMVW-L	MT20	4.0	4.0		
M	BS-L	MT20	3.0	8.0		
N	BMVW-L	MT20	4.0	6.0		
O	BMVW-L	MT20	4.0	4.0		
P	BMVW-L	MT20	5.0	6.0		
Q	BMVW-L	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1615	0	1615	0
J	1615	0	1615	0

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1144	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0
J	1144	739 / 0	0 / 0	0 / 0	0 / 0	405 / 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		MAX. FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM			FR-TO				
A-B	0 / 32	-84.9	-84.9	0.11 (1)	10.00	P-C	-216 / 2 0.07 (1)		
B-C	-1738 / 0	-84.9	-84.9	0.31 (1)	4.76	C-D	-263 / 0 0.21 (1)		
C-D	-1560 / 0	-84.9	-84.9	0.30 (1)	4.98	D-E	0 / 265 0.06 (1)		
D-E	-1443 / 0	-84.9	-84.9	0.25 (1)	5.18	E-F	0 / 324 0.07 (1)		
E-F	-1443 / 0	-84.9	-84.9	0.25 (1)	5.18	N-E	-475 / 0 0.58 (1)		
F-G	-1560 / 0	-84.9	-84.9	0.30 (1)	4.98	N-F	0 / 324 0.07 (1)		
G-H	-1738 / 0	-84.9	-84.9	0.31 (1)	4.76	L-F	0 / 265 0.06 (1)		
H-I	0 / 32	-84.9	-84.9	0.11 (1)	10.00	L-G	-263 / 0 0.21 (1)		
Q-B	-1575 / 0	0.0	0.0	0.16 (1)	6.58	K-G	-216 / 2 0.07 (1)		
J-H	-1575 / 0	0.0	0.0	0.16 (1)	6.58	B-P	0 / 1501 0.34 (1)		
						K-H	0 / 1501 0.34 (1)		
Q-P	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
P-O	0 / 1488	-18.5	-18.5	0.28 (1)	10.00				
O-N	0 / 1276	-18.5	-18.5	0.25 (1)	10.00				
N-M	0 / 1276	-18.5	-18.5	0.25 (1)	10.00				
M-L	0 / 1276	-18.5	-18.5	0.25 (1)	10.00				
L-K	0 / 1488	-18.5	-18.5	0.28 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.97")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.97")
CALCULATED VERT. DEFL. (TL) = L/999 (0.11")

CS1: TC=0.31/1.00 (G-H-1), BC=0.28/1.00 (K-L-1), WB=0.58/1.00 (E-N-1), SSI=0.19/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.82 (D) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

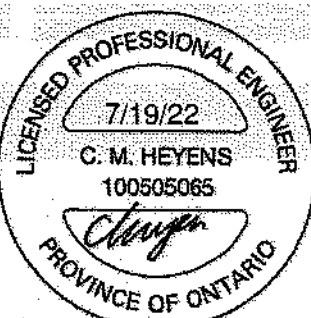

DWG # TR22070131



TOTAL WEIGHT = 43 lb

DRY: SEASONED LUMBER.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J. G

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0/32	-84.9	-84.9	0.13 (1)	10.00	I-C	-30/20 0.01 (4)
B-C	-298/0	-84.9	-84.9	0.16 (1)	6.25	C-H	-3/3 0.00 (4)
C-D	-245/0	-84.9	-84.9	0.04 (1)	6.25	H-D	-33/23 0.01 (4)
D-E	-298/0	-84.9	-84.9	0.16 (1)	6.25	B-I	0/259 0.06 (1)
E-F	0/32	-84.9	-84.9	0.13 (1)	10.00	H-E	0/258 0.06 (1)
J-B	-492/0	0.0	0.0	0.04 (1)	7.81		
G-E	-490/0	0.0	0.0	0.04 (1)	7.81		
J-K	0/0	-18.5	-18.5	0.03 (4)	10.00		
K-I	0/0	-18.5	-18.5	0.03 (4)	10.00		
I-H	0/246	-18.5	-18.5	0.03 (1)	10.00		
H-L	0/0	-18.5	-18.5	0.02 (4)	10.00		
L-G	0/0	-18.5	-18.5	0.02 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LCI	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-1-12	1	1	74	BACK	VERT	TOTAL	—	C1
D	4-8-3	1	1	74	BACK	VERT	TOTAL	—	C1
H	4-7-8	1	1	—	BACK	VERT	TOTAL	—	C1
I	3-2-8	1	1	—	BACK	VERT	TOTAL	—	C1
K	1-2-8	1	1	—	BACK	VERT	TOTAL	—	C1
L	6-7-8	1	1	—	BACK	VERT	TOTAL	—	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TBC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.26")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.26")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.16/1.00 (B-C:1), BC=0.03/1.00 (H-I:1),
WB=0.06/1.00 (B-I:1), SS=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

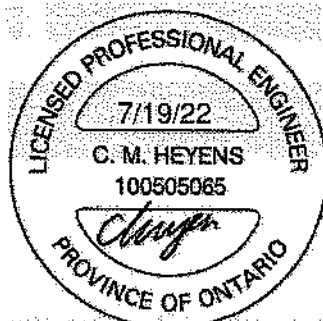

DWG # TR22070133

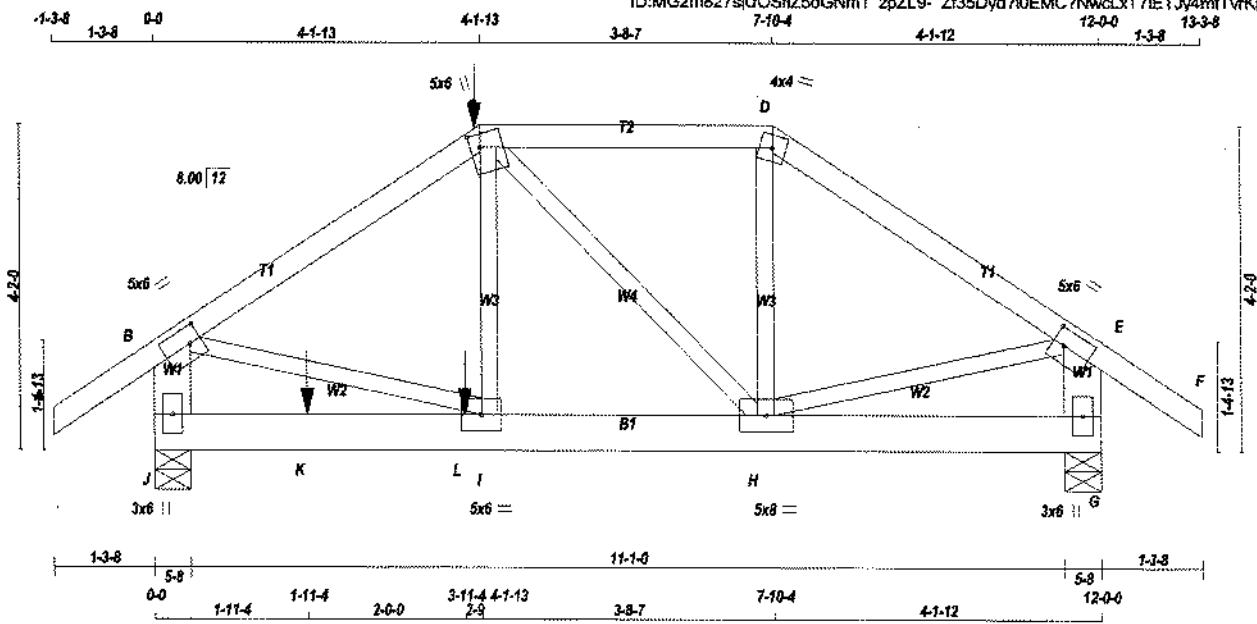

Scale = 1:28.3

TOTAL WEIGHT = 60 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
J - B	2x6	DRY No.2	SPF
G - E	2x6	DRY No.2	SPF
J - G	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.50	1.75
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-t	MT20	5.0	6.0	2.50	1.75
G	BMV1+p	MT20	3.0	6.0		
H	BMVWV-t	MT20	5.0	8.0		
I	BMVWV-t	MT20	5.0	6.0		
J	BMV1+p	MT20	3.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
J	763	0	763	0
G	744	0	744	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	533	348 / 0	0 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0
G	526	346 / 0	0 / 0	0 / 0	0 / 0	0 / 0	181 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 32	-84.9	-84.9 0.13 (1)	I-C	-31 / 48	0.02 (4)	0.02 (4)
B-C	-582 / 0	-84.9	-84.9 0.29 (1)	C-H	-11 / 0	0.00 (1)	0.00 (1)
C-D	-459 / 0	-84.9	-84.9 0.22 (1)	H-D	-25 / 60	0.02 (4)	0.02 (4)
D-E	-554 / 0	-84.9	-84.9 0.29 (1)	B-I	0 / 479	0.12 (1)	0.12 (1)
E-F	0 / 32	-84.9	-84.9 0.13 (1)	H-E	0 / 472	0.12 (1)	0.12 (1)
J-B	-715 / 0	0.0	0.0 0.05 (1)				
G-E	-707 / 0	0.0	0.0 0.05 (1)				
J-K	0 / 0	-18.5	-18.5 0.04 (4)				
K-L	0 / 0	-18.5	-18.5 0.04 (4)				
L-I	0 / 0	-18.5	-18.5 0.04 (4)				
I-H	0 / 466	-18.5	-18.5 0.07 (1)				
H-G	0 / 0	-18.5	-18.5 0.04 (4)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-1-13	-13	-13	-	FRONT	VERT	TOTAL	-	C1
K	1-11-4	-2	-2	-	FRONT	VERT	TOTAL	-	C1
L	3-11-4	-2	-2	-	FRONT	VERT	TOTAL	-	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TO=0.29/1.00 (B-C:1), BC=0.07/1.00 (H-I:1), WB=0.12/1.00 (B-I:1), SSI=0.13/1.00 (C-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MIN	MIN
MT20	650	371
	1747	789
	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.37 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

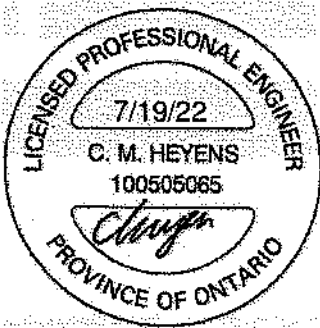


DWG # TR22070134

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T35	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitak Industries, Inc. Mon Jul 18 15:06:53 2022 Page 1
ID:MG2m827slUOSfZ5oGNm1 zpZL9-SmDRJZzFm085 MaZTKA0LQNWjHv6C33 YTLoywp8m

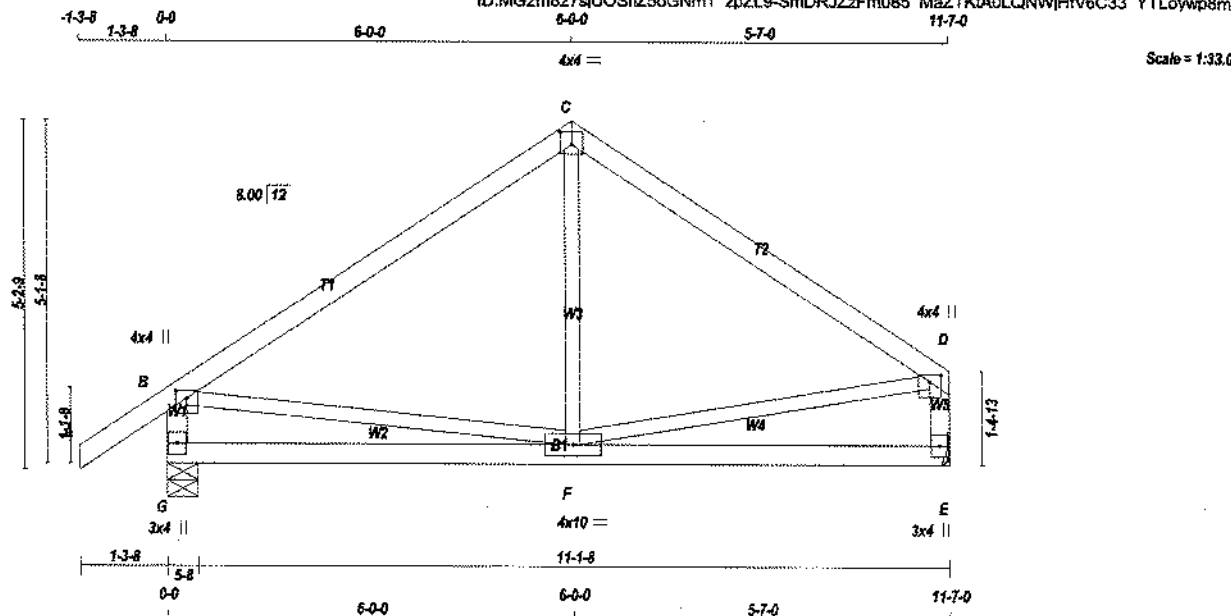

TOTAL WEIGHT = 46 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH.	LL	23.3	PSF
A - C	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	DL	8.0	PSF	
C - D	2x4	DRY	No.2	JT VERT	HORZ	DOWN	HORZ	BOT CH.	LL	0.0	PSF
G - B	2x4	DRY	No.2	SPF	715	0	715	DL	7.4	PSF	
E - D	2x4	DRY	No.2	SPF	599	0	599	TOTAL LOAD	35.7	PSF	
G - E	2x4	DRY	No.2	SPF							

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.
DRY: SEASONED LUMBER.

PLATES (table is in inches)						UNFACTORED REACTIONS					
JT	TYPE	PLATES	W	LEN	Y	X	1ST CASE	SNOW	LIVE	PERM LIVE	WIND
B	TMVW+p	MT20	4.0	4.0	1.25	2.00	G	505	334 / 0	0 / 0	0 / 0
C	TTW+p	MT20	4.0	4.0	2.25	2.00	E	425	270 / 0	0 / 0	0 / 0
D	TMVW+p	MT20	4.0	4.0	1.25	2.00					
E	BMV1+p	MT20	3.0	4.0							
F	BMVWW+1	MT20	4.0	10.0							
G	BMV1+p	MT20	3.0	4.0							

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 32	-84.9	-84.9 0.11 (1)	10.00	F-C	0 / 101	0.03 (4)
B-C	-451 / 0	-84.9	-84.9 0.39 (1)	6.25	B-F	0 / 379	0.09 (1)
C-D	-451 / 0	-84.9	-84.9 0.34 (1)	6.25	F-D	0 / 383	0.09 (1)
G-B	-672 / 0	0.0	0.0 0.07 (1)	7.81			
E-D	-560 / 0	0.0	0.0 0.06 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.18 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.18 (4)	10.00			

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1) , BC=0.18/1.00 (E-F:4)
WB=0.09/1.00 (D-F:1) , SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (B) (INPUT = 0.90)
JSI METAL= 0.15 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070135

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T36	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Mon Jul 18 15:06:53 2022 Page 1
ID:MG2m827sjUOSmZ5oGNm1 zpZL9-SmDRJZzFm085 MaZTKiA0LQSQXjHmV7Y33 YTLowp8m

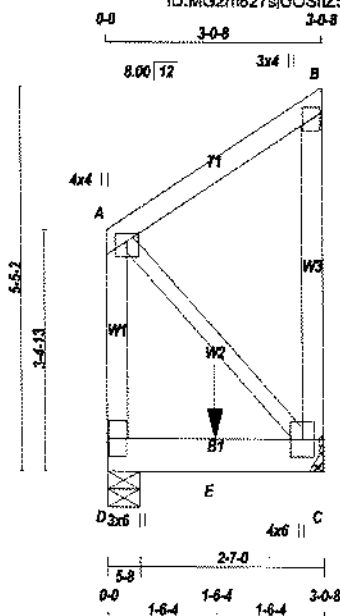

Scale = 1:31.2

TOTAL WEIGHT = 2 X 21 = 43 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
D - A	2x4	DRY No 2	SPF	
A - B	2x4	DRY No.2	SPF	
C - B	2x4	DRY No.2	SPF	
D - C	2x6	DRY No.2	SPF	
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D-A 1	12	TOP
A-B 1	12	TOP
B-C 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.


TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMV+p	MT20	3.0	4.0		
C	BMVW1+p	MT20	4.0	6.0		

STRUCTURAL COMPONENT ONLY

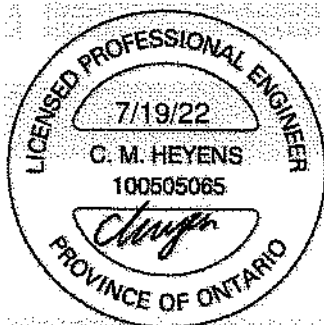

DWG # TR22070136 PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ
D	447	0	447	0
C	447	0	447	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 2-8.

UNFACTORED REACTIONS

	1ST CASE	MAX MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
D	317	206 / 0	0 / 0
C	317	206 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX
FR-TO				FR-TO			
D-A	-129 / 0	0.0	0.0 0.01 (1)	A-C	0 / 0	0.00 (1)	
A-B	0 / 0	-84.9	-84.9 0.07 (1)				
C-B	-129 / 0	0.0	0.0 0.03 (1)				
D-E	0 / 0	-18.5	-18.5 0.17 (1)				
E-C	0 / 0	-18.5	-18.5 0.17 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-6-4	-410	-410		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= 1/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= 1/999 (0.01")

CSI: TC=0.07/1.00 (A-B:1) , BC=0.17/1.00 (C-D:1)
WB=0.00/1.00 (A-C:1) , SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.04 (A) (INPUT = 0.90)
JSI METAL= 0.02 (B) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T36	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 15:06:53 2022 Page 2
ID:MG2m827siUOSfZ5oGNm1_zpZL9-SmDRJZzFm085_MaZTKtA0LQ5XjHrnV7Y33_YTLowwp8m

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
0	BMV1+p	MT20	3.0	6.0		

NOTES (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY




DWG # TR22070136 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 15:06:54 2022 Page 1

ID:MG2m827sIUOSfZ5oGNm1 zpZL9-wympWw IXKGycV9m11OPYYtT6atEPQCis0tEywp8

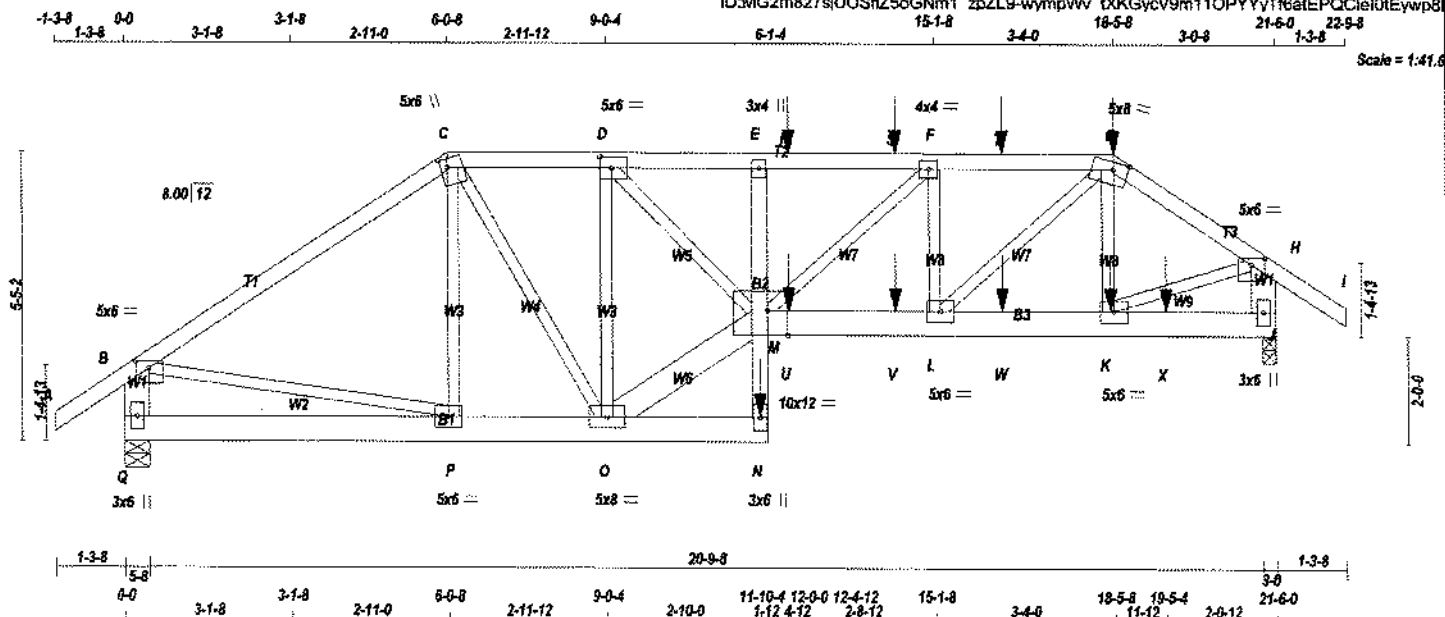

TOTAL WEIGHT = 116 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
Q - B	2x6	DRY No.2	SPF
J - H	2x6	DRY No.2	SPF
Q - N	2x6	DRY No.2	SPF
N - E	2x4	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
O - M	2x6	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TTWW+m	MT20	5.0	6.0	2.00 1.50
D	TMVW-t	MT20	5.0	6.0	2.50 2.50
E	TMV-p	MT20	3.0	4.0	
F	TMVW-t	MT20	4.0	4.0	
G	TTWW-m	MT20	5.0	8.0	1.75 3.25
H	TMVW-p	MT20	5.0	6.0	1.50 3.00
J	BMV1-p	MT20	3.0	6.0	
K, L, P					
K	BMVW-t	MT20	5.0	6.0	
M	BMVWVW-l	MT20	10.0	12.0	Edge 4.50
N	BMV-p	MT20	3.0	6.0	
O	BMVWVW-t	MT20	5.0	8.0	
Q	BMV1-p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral bracing to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1507	0	1507	0
J	1756	0	1756	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
Q	1067	695 / 0	0 / 0
J	1242	811 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

	CHORDS	WEBS
	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE	FORCE
	(LBS)	(LBS)
	FR-TO	FR-TO
A-B	0 / 32	-84.9 -84.9 0.13 (1)
B-C	-1568 / 0	-84.9 -84.9 0.75 (1)
C-D	-1568 / 0	-84.9 -84.9 0.14 (1)
D-E	-3008 / 0	-84.9 -84.9 0.21 (1)
E-F	-3029 / 0	-84.9 -84.9 0.31 (1)
F-G	-3029 / 0	-84.9 -84.9 0.31 (1)
G-H	-2508 / 0	-84.9 -84.9 0.27 (1)
H-I	-1808 / 0	-84.9 -84.9 0.20 (1)
I-J	-1456 / 0	-84.9 -84.9 0.13 (1)
J-K	-1730 / 0	0.0 0.0 0.10 (1)
K-L	0 / 0	-18.5 -18.5 0.08 (4)
L-M	0 / 1301	-18.5 -18.5 0.19 (1)
M-N	0 / 32	-18.5 -18.5 0.03 (1)
N-O	0 / 1462	0.0 0.0 0.18 (1)
O-P	-284 / 0	0.0 0.0 0.10 (1)
P-Q	0 / 2508	-18.5 -18.5 0.37 (1)
Q-R	0 / 2508	-18.5 -18.5 0.37 (1)
R-S	0 / 2508	-18.5 -18.5 0.37 (1)
S-T	0 / 1489	-18.5 -18.5 0.23 (1)
T-U	0 / 1489	-18.5 -18.5 0.23 (1)
U-V	0 / 0	-18.5 -18.5 0.03 (4)
V-W	0 / 0	-18.5 -18.5 0.03 (4)
W-X	0 / 0	-18.5 -18.5 0.03 (4)
X-Y	0 / 0	-18.5 -18.5 0.03 (4)

SPECIFIED CONCENTRATED LOADS (LBS)

	JT	LOC.	LC1	MAX-	FACE	DIR.	TYPE	HEEL	CONN.
G	18-5-8	-129	-129	---	FRONT	VERT	TOTAL	---	C1
K	18-4-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
N	11-10-4	-308	-308	---	FRONT	VERT	TOTAL	---	C1
R	12-4-12	-31	-31	---	FRONT	VERT	TOTAL	---	C1
S	14-4-12	-31	-31	---	FRONT	VERT	TOTAL	---	C1
T	16-4-12	-31	-31	---	FRONT	VERT	TOTAL	---	C1
U	12-4-12	-11	-11	---	FRONT	VERT	TOTAL	---	C1
V	14-4-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
W	16-4-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
X	19-5-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.72")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.10")
ALLOWABLE DEFL. (TL) = $L/360$ (0.72")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.18")

CSI: TC=0.75/1.00 (B-C-1), BC=0.37/1.00 (L-M-1)
WS=0.73/1.00 (D-O-1), SS=0.19/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	850 371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (O) (INPUT = 0.90)
JSI METAL= 0.42 (O) (INPUT = 1.00)

CONTINUED ON PAGE 2

STRUCTURAL COMPONENT ONLY

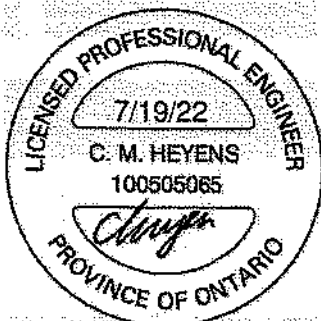

DWG # TR22070137 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:54 2022 Page 2

ID:MG2m827sjUOS1Z5oGNm1 zpZL9-wympWv DXKGycV9m11OPYYyTf6atEPQCleI0tEywp8

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.


STRUCTURAL COMPONENT ONLY



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	T38	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mittek Industries, Inc. Mon Jul 18 15:06:55 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-C8KCJF7VIdOpDfkybke5mV18WyrzvtMX1aPgwp8k

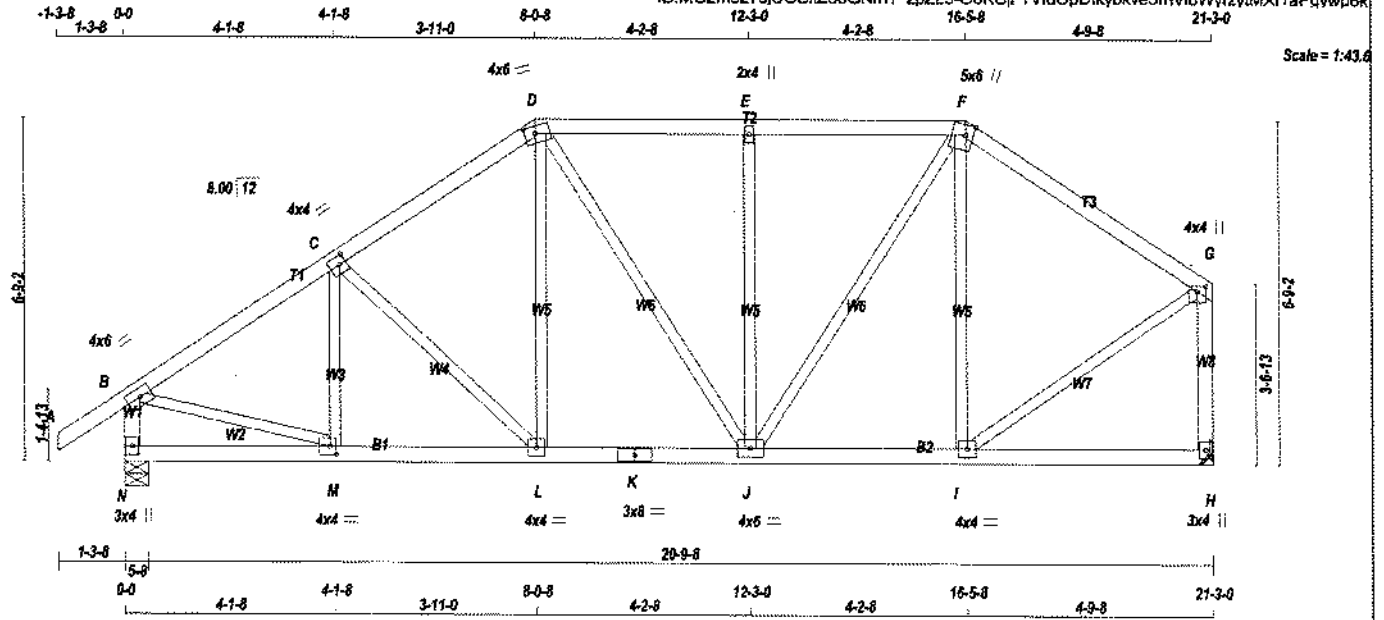

Scale = 1:43.6

TOTAL WEIGHT = 100 lb

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					DESIGN CRITERIA				
N. L. G. A. RULES														
CHORDS		SIZE	LUMBER	DESCR.	BEARINGS					SPECIFIED LOADS:				
A - D	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT	REQD		TOP CH. LL = 23.3 PSF		
D - F	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG	BRG		DL = 6.0 PSF		
F - G	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BOT CH. LL = 0.0 PSF	
N - B	2x4	DRY	No.2	SPF	N	1215	0	1215	0	0	5-8	5-8	DL = 7.4 PSF	
H - G	2x4	DRY	No.2	SPF	H	1098	0	1098	0	0	MECHANICAL		TOTAL LOAD = 36.7 PSF	
N - K	2x4	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-6.									
K - H	2x4	DRY	No.2	SPF										
ALL WEBS	2x3	DRY	No.2	SPF										
										SPACING = 24.0 IN. C/C				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWV-m	MT20	4.0	8.0	1.75	2.50
E	TMVW-t	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	6.0	Edge	1.75
G	TMVW-p	MT20	4.0	4.0	1.25	2.00
H	BMV1-p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	6.0		
K	BS-t	MT20	3.0	8.0		
L	BMVW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	4.0	4.0	2.00	1.50
N	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
N	860	559 / 0	0 / 0	0 / 0	0 / 0	301 / 0
H	780	495 / 0	0 / 0	0 / 0	0 / 0	285 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	MAX. FACTORED
	FORCE (LBS)	VERT. (PLF)	CS (LC)	UNBRAC		FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 32	-84.9	-84.9	0.11 (1)	10.00	M-C	-183 / 0
B-C	-1180 / 0	-84.9	-84.9	0.19 (1)	5.68	C-L	-205 / 0
C-D	-1048 / 0	-84.9	-84.9	0.18 (1)	5.94	L-D	0 / 221
D-E	-910 / 0	-84.9	-84.9	0.19 (1)	6.24	D-J	0 / 100
E-F	-810 / 0	-84.9	-84.9	0.19 (1)	6.24	J-E	-434 / 0
F-G	-775 / 0	-84.9	-84.9	0.26 (1)	6.25	J-F	0 / 496
N-B	-1181 / 0	0.0	0.0	0.12 (1)	7.34	I-F	-328 / 0
H-G	-1082 / 0	0.0	0.0	0.23 (1)	7.64	B-M	0 / 1034
					I-G	0 / 773	0.17 (1)
N-M	0 / 0	-18.5	-18.5	0.07 (4)	10.00		
M-L	0 / 1000	-18.5	-18.5	0.20 (1)	10.00		
L-K	0 / 855	-18.5	-18.5	0.17 (1)	10.00		
K-J	0 / 855	-18.5	-18.5	0.17 (1)	10.00		
J-I	0 / 839	-18.5	-18.5	0.16 (1)	10.00		
I-H	0 / 0	-18.5	-18.5	0.10 (4)	10.00		

STRUCTURAL COMPONENT ONLY



DWG # TR22070138

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (M) (INPUT = 0.90)
JSI METAL = 0.34 (M) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	J1	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:49 2022 Page 1
ID:MG2m827stUOSfZ5oGNm1 zpZL9-zVaEgKD6hntXmaOf1cwU5rApwDBwLpgIDm0ywpUO

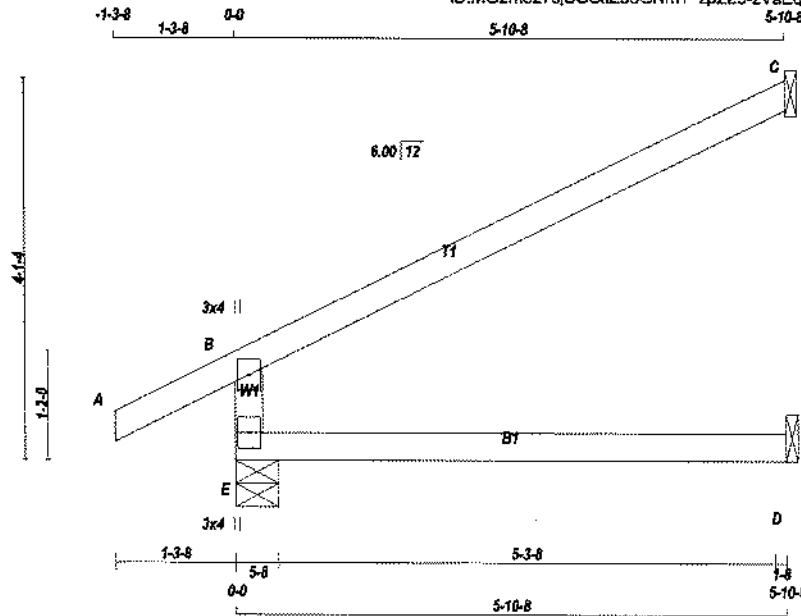

Scale: 1/2"=1'

TOTAL WEIGHT = 10 X 17 = 168 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	SPECIFIED LOADS:	
E - B	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	TOP CH.	LL = 23.3 PSF
A - C	2x4	DRY	No.2	SPF	E	490	0	490	0	DL = 6.0 PSF	
E - D	2x4	DRY	No.2	SPF	C	187	0	187	0	BOT CH.	LL = 0.0 PSF
					D	46	0	50	0	DL = 7.4 PSF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES: (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX	MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOL	
E	348	234 / 0	0 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0	
C	129	103 / 0	0 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0	
D	38	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	UNBRAC LENGTH FR-TO
FR-TO		FROM TO		FR-TO			
E-B	-427 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00			
B-C	-28 / 0	-84.9	-84.9 0.50 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TO=0.50/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.09/1.00 (na:0), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	850	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070076

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	J1S	8	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:51:02 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-ooFwjOTjkqK1OCNoG5J9zoXuZMdsA774OXheSQywpNc

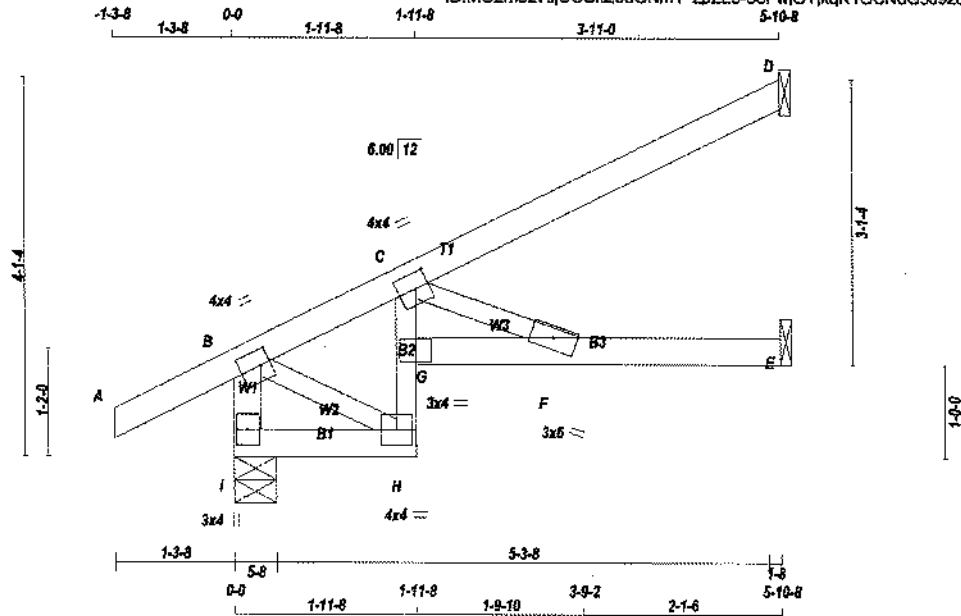

Scale: 1/2"=1'

TOTAL WEIGHT = 8 X 21 = 167 lb

LUMBER					N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.			
I - B	2x4	DRY	No.2	SPF		
A - D	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		
H - C	2x3	DRY	No.2	SPF		
G - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.25
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
F	BMVW-w	MT20	3.0	6.0	
G	BMVW-t	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	4.0	
I	BMV1-p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS	REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
I	432	0	432	0	0	5-8	5-8	5-8	5-8
D	181	0	181	0	0	1-8	1-8	1-8	1-8
E	109	0	109	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) D, E

UNFACTORED REACTIONS

1ST CASE		MAX MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL				
I	304	207 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0				
D	128	95 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0				
E	80	35 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	UNBRAC LENGTH
FR-TO				FR-TO			
I-B	-415 / 0	0.0	0.0 0.04 (1)	8-H	0 / 179	0.04 (1)	
A-B	0 / 26	-84.9	-84.9 0.11 (1)	C-F	-412 / 0	0.06 (1)	
B-C	-211 / 0	-84.9	-84.9 0.11 (1)				
C-D	0 / 5	-84.9	-84.9 0.26 (1)				
I-H	0 / 0	-18.5	-18.5 0.02 (4)				
H-G	-58 / 0	0.0	0.0 0.43 (1)				
G-C	0 / 89	0.0	0.0 0.45 (1)				
G-F	0 / 369	-18.5	-18.5 0.35 (1)				
F-E	0 / 0	-18.5	-18.5 0.29 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(56 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.06")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/632$ (0.11")

CS1: TC=0.26/1.00 (C-D:1), BC=0.45/1.00 (C-G:1), WB=0.06/1.00 (C-F:1), SS=0.23/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.26 (B) (INPUT = 0.90)
JSI METAL= 0.12 (G) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

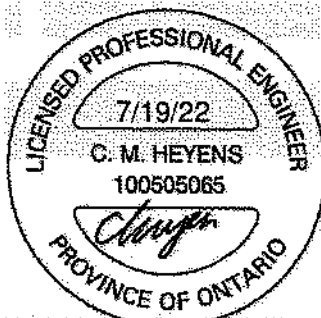


DWG # TR22070100

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	J2	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mittek Industries, Inc. Mon Jul 18 14:43:50 2022 Page 1
ID:MG2m827siUOSitZ5oGNm1 zpZL9-Sh8c2qEIT5vKZpMmyNZrSle0vDGxyeAU2J1nISywpUN

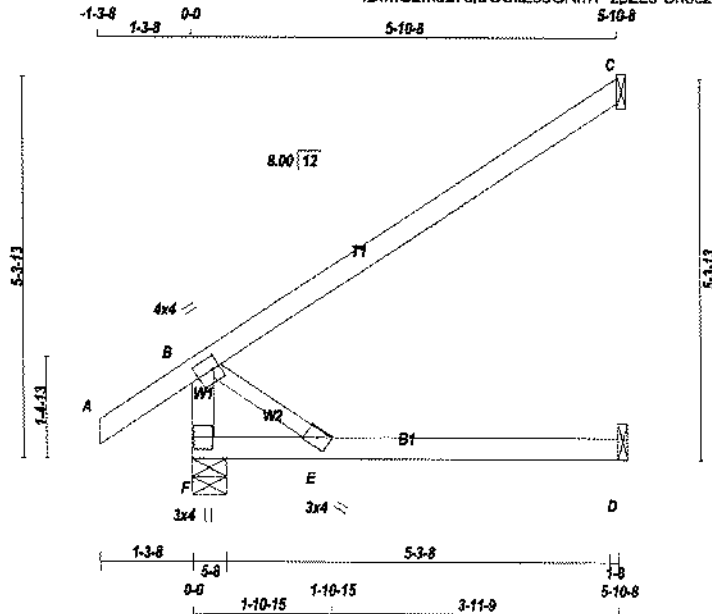

Scale = 1:30.8

TOTAL WEIGHT = 3 X 19 = 56 lb

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.00
E	BMW-w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
JT	420	0	420	0	5-8	5-8
F	420	0	420	0	5-8	5-8
C	249	0	249	0	1-8	1-8
D	54	0	54	0	1-8	1-8

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
JT	296	201/0	0/0	0/0	0/0	95/0	0/0
F	172	137/0	0/0	0/0	0/0	35/0	0/0
C	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (PLF)	CSH (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FORCE (LBS)	MAX. CSH (LC)
F-B	-365/0	0.0	0.0	0.04 (1)	7.81	0/0	0/0	0.00 (1)
A-B	0/32	-84.9	-84.9	0.11 (1)	10.00			
B-C	0/0	-84.9	-84.9	0.50 (1)	10.00			
F-E	0/0	-18.5	-18.5	0.16 (4)	10.00			
E-D	0/0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA D86-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.50/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	650	371	1747
			788
			1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.00)
JSI METAL= 0.07 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070077



TOTAL WEIGHT = 6 X 12 = 71 lb


JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	J4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:52 2022 Page 1

ID:MG2m827sjUOSIZ5oGNm1 zpZL9-O4GMTMG7791p7V94nbJY7JR61 YQYgnWdWuNLywpJL

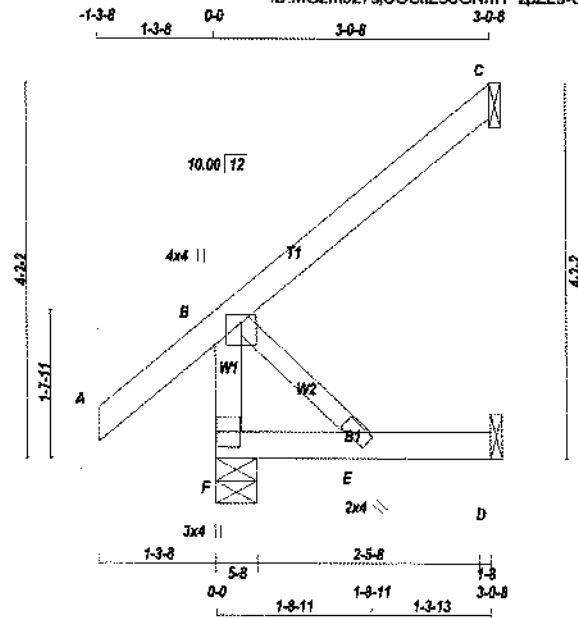

Scale = 1/24.0

TOTAL WEIGHT = 2 X 13 = 26 lb

LUMBER					
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
F	275	0	275	0	0	5-8	5-8		
C	129	0	129	0	0	1-8	1-8		
D	28	0	32	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		SNOW		LIVE		PERM.LIVE		WIND		DEAD		SOIL	
JT	COMBINED												
F	193	135/0	0/0	0/0	0/0	0/0	0/0	57/0	0/0				
C	89	71/0	0/0	0/0	0/0	0/0	0/0	18/0	0/0				
D	23	0/0	0/0	0/0	0/0	0/0	0/0	23/0	0/0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FORCE (LBS)	MAX. (LBS)	LC1 (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-247/0	0/0	0.03 (1)	B-E	0/0	0.03 (1)	
A-B	0/38	-84.9	-84.9 0.13 (5)				
B-C	0/0	-84.9	-84.9 0.13 (1)				
F-E	0/0	-18.5	-18.5 0.05 (4)				
E-D	0/0	-18.5	-18.5 0.05 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(65 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.05/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070079

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	J5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:52 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-O4GMTMG77i91p7V94nbJY7jMr1yaQYgnWdWuNLywpLJL

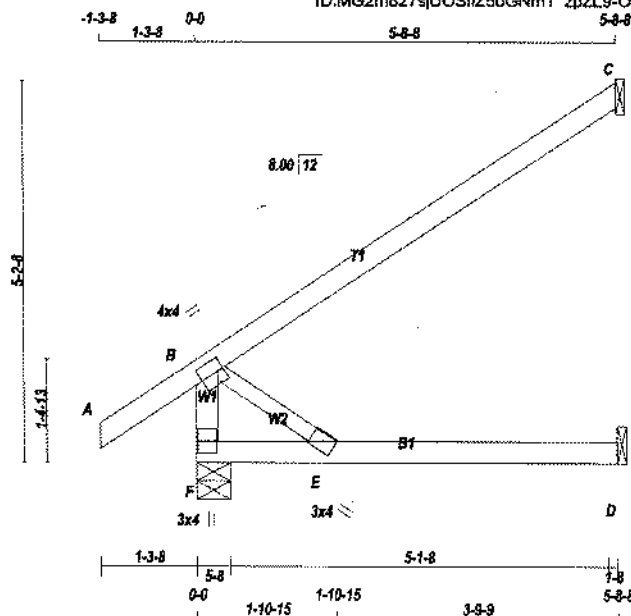

Scale = 1/32

TOTAL WEIGHT = 2 X 19 = 38 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	4.0 2.00 1.00
E	BMVW-1	MT20	3.0	4.0
F	BMV1+p	MT20	3.0	4.0

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
F	411	0	411	0	0	5-8	5-8	5-8	5-8
C	242	0	242	0	0	1-8	1-8	1-8	1-8
D	53	0	53	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2016-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX / MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
F	290	197 / 0	0 / 0	0 / 0	0 / 0	93 / 0	0 / 0	290	197 / 0	0 / 0	0 / 0
C	167	133 / 0	0 / 0	0 / 0	0 / 0	34 / 0	0 / 0	167	133 / 0	0 / 0	0 / 0
D	42	0 / 0	0 / 0	0 / 0	0 / 0	42 / 0	0 / 0	42	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
F-B	-369 / 0	0.0	0.0 0.04 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 32	-84.9	-84.9 0.11 (1)				
B-C	0 / 0	-84.9	-84.9 0.47 (1)				
F-E	0 / 0	-18.5	-18.5 0.15 (4)				
E-D	0 / 0	-18.5	-18.5 0.18 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.05")

CSI: TC=0.47/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI ORIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070080

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424157	J6	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version B.530 S Feb 23 2022 M/Tek Industries, Inc. Mon Jul 18 14:51:03 2022 Page 1

ID:MG2m827sIUOSfZ5oGNm1 zpZL9-G7plwkTLU7Su0My qpqOW736im4gvTNDdQB7sywpNc

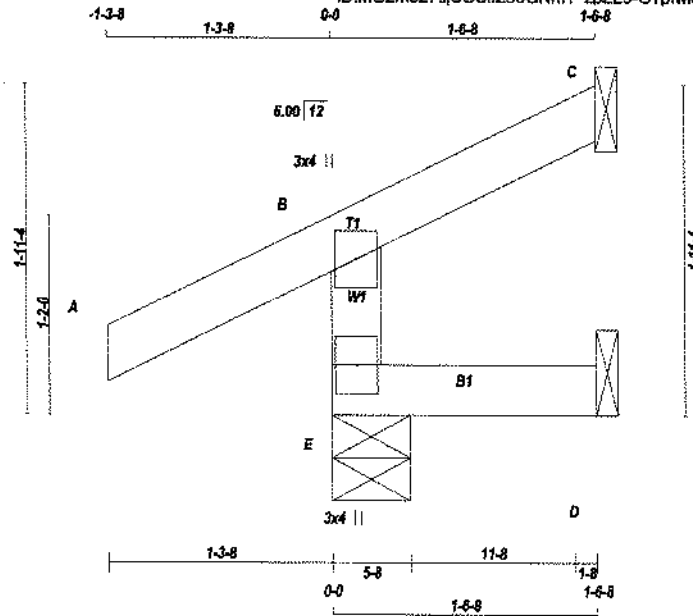

Scale = 1:13.0

TOTAL WEIGHT = 3 X 6 = 19 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES

(1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	245	0	245	0	5-8	5-8
C	26	0	26	0	1-8	1-8
D	3	0	13	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	171	127 / 0	0 / 0	0 / 0	0 / 0	44 / 0	0 / 0
C	18	14 / -19	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	3	0 / -8	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. UNBRAC	MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (PLF)	CS (LC)			MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO						FR-TO		
E-B	-220 / 0	0.0	0.0	0.03 (5)	7.81			
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00			
B-C	-18 / 0	-84.9	-84.9	0.08 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.03 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.11/1.00 (A-B:1), BC=0.03/1.00 (D-E:5)
WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLJ)	(PL)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.09 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)


STRUCTURAL COMPONENT ONLY



DWG # TR22070101

JOB NAME 424158	TRUSS NAME J7	QUANTITY 5	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:56:50 2022 Page 1
ID:MixLoiPKsNhur HAqhID6zpVD?clHUIHg0mlAe8h gfBYm4BxLveST7PHIPq 3hFywdJB

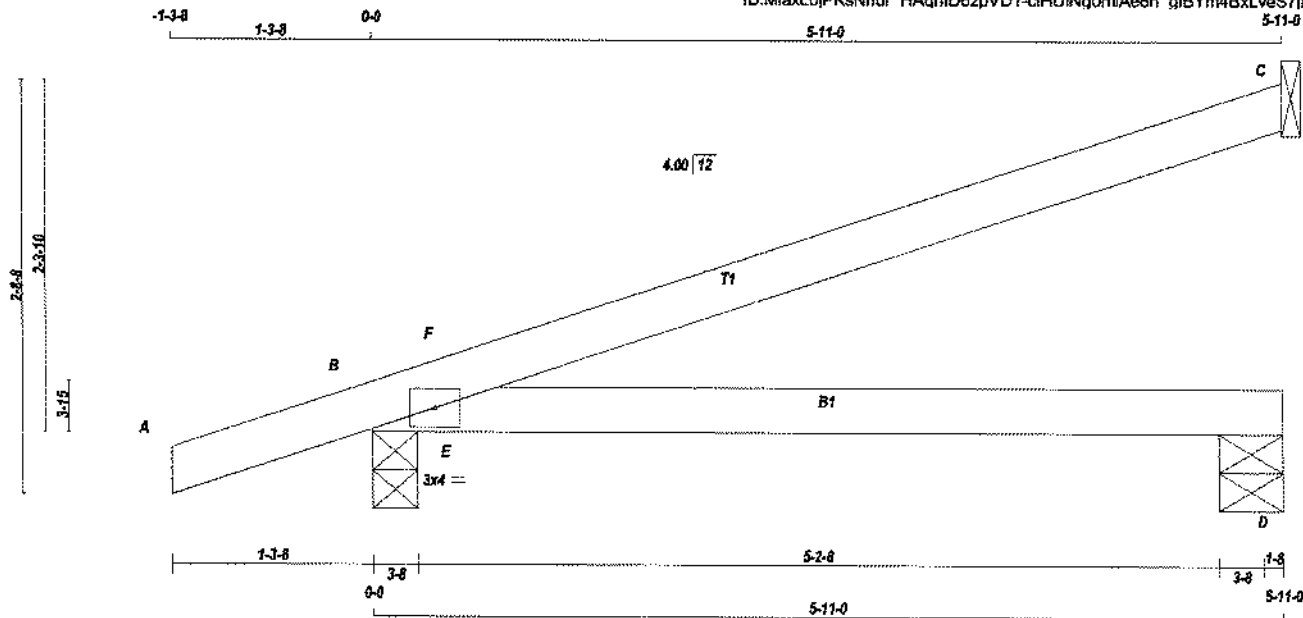

Scale = 1:14.5

TOTAL WEIGHT = 5 X 16 = 78 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B 1MB1-	MT20	3.0	4.0			

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
C	220	0	220	0	0	1-8
B	419	0	419	0	0	3-8
D	86	0	86	0	0	5-0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	153	116 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0
B	295	200 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
D	64	21 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 17	-84.9	-84.9	0.11 (1)	10.00	E-F	-302 / 13
B-F	-20 / 16	-84.9	-84.9	0.05 (4)	5.25		0.00 (1)
F-C	-2 / 2	-84.9	-84.9	0.38 (1)	10.00		
B-E	0 / 0	-18.5	-18.5	0.27 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.27 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/810 (0.14")

CSI: TC=0.38/1.00 (C-F:1), BC=0.27/1.00 (D-E:1)
WB=0.00/1.00 (E-F:1), SS=0.25/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 786	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

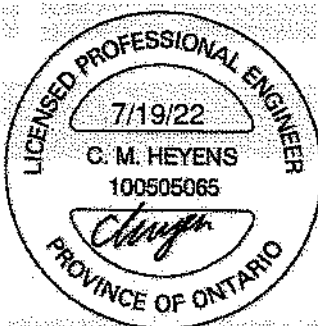


DWG # TR22070108

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	J8	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 15:06:45 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-hDkQdqEfZ8D17z17ejlh44cUbmDWatEic22Gywp8u

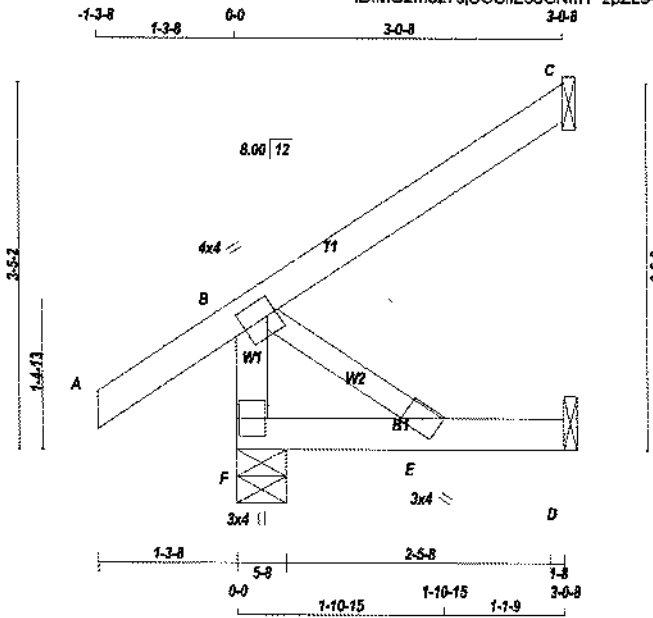

Scale = 1/20

TOTAL WEIGHT = 4 X 12 = 48 lb

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.00
E	BMVW-t	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	274	0	274	0
C	129	0	129	0
D	28	0	32	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED					
F	192	135 / 0	0 / 0	0 / 0	57 / 0	0 / 0
C	89	71 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	23	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
F-B	-246 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0
A-B	0 / 32	-84.9	-84.9	0.13 (5)	10.00		
B-C	0 / 0	-84.9	-84.9	0.13 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.05 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.05 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.05/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070125

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	J9	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Mon Jul 18 15:08:46 2022 Page 1
ID:MG2m827sjUOS8Z5oGNm1 zpZL9-9PHorAusPsG4eHYDZMPXEsdfauwaMzp1SOMBblywp8

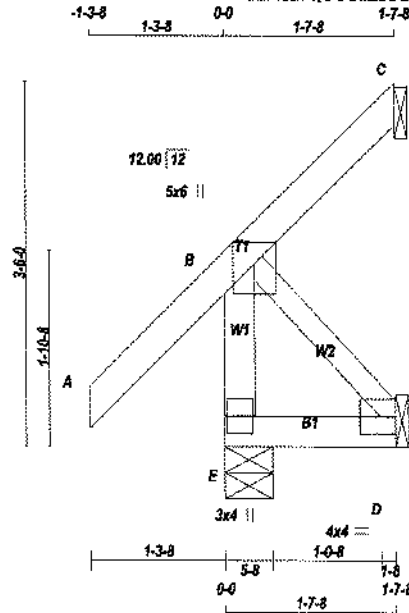

Scale = 1/21.3

TOTAL WEIGHT = 4 X 10 = 41 lb

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	Edge	2.50
D BMV1+t	MT20	4.0	4.0	Edge	
E BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	252	0	252	0	0	5-8	5-8
C	18	0	18	0	-42	1-8	1-8
D	14	0	16	0	0	1-8	1-8

SEE MTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SOIL
E	178	131/0	0/0	0/0	0/0	45/0	0/0		
C	13	10/-28	0/0	0/0	0/0	3/0	0/0		
D	12	0/0	0/0	0/0	0/0	12/0	0/0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO			
E-B	-238/0	0.0	0.0 0.03 (1)	B-D	0/0	0.00 (1)	
A-B	0/42	-84.9	-84.9 0.12 (1)				
B-C	-36/0	-84.9	-84.9 0.11 (1)				
E-D	0/0	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (TL) = L/360 (0.19")
CALCULATED VERT. DEF. (TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.01/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.07/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 708

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070126

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	J10	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:47 2022 Page 1

ID:MG2m827sjUOSfIZSoGNm1 zpZL9-dcrA2WuUAAOxGR7Q73mm4AQGIa5Q3Ah25878ywp8s

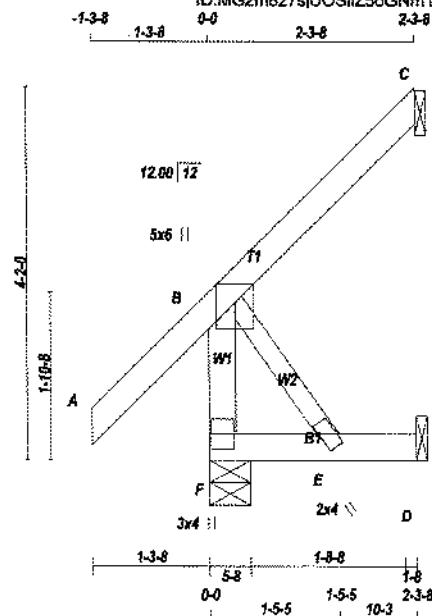

Scale = 1:24.7

TOTAL WEIGHT = 2 X 12 = 24 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge 2.50
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	237	0	237	0	0	5-8	5-8		
C	97	0	97	0	0	1-8	1-8		
D	21	0	24	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX / MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOL		
F	188	118 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0		
C	67	53 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0		
D	17	0 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
F-B	-216 / 0	0.0	0.0	0.02 (1)	7.81	B-E	3 / 0
A-B	0 / 42	-84.9	-84.9	0.12 (5)	10.00		
B-C	0 / 0	-84.9	-84.9	0.08 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.03 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.03 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, ABC 2018
- PART 9 OF CBC 2012 (2015 AMENDMENT)
- CSA 086-14
- TPIC 2014

(5% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:5), BC=0.03/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.07/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	850	371	1747
		788	1987
		1673	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

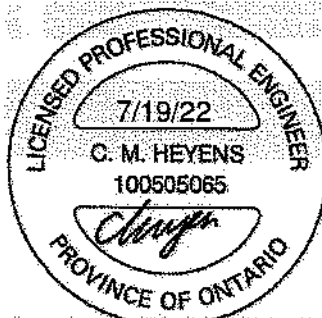


DWG # TR22070127

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	C1	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:48 2022 Page 1
ID:MG2m827sjUOSiZ5oGNm1 zpZL9-Zwy5CIBEPsOu4C27IXUvisTOUcuv0qBv7i3Z9hywpUR

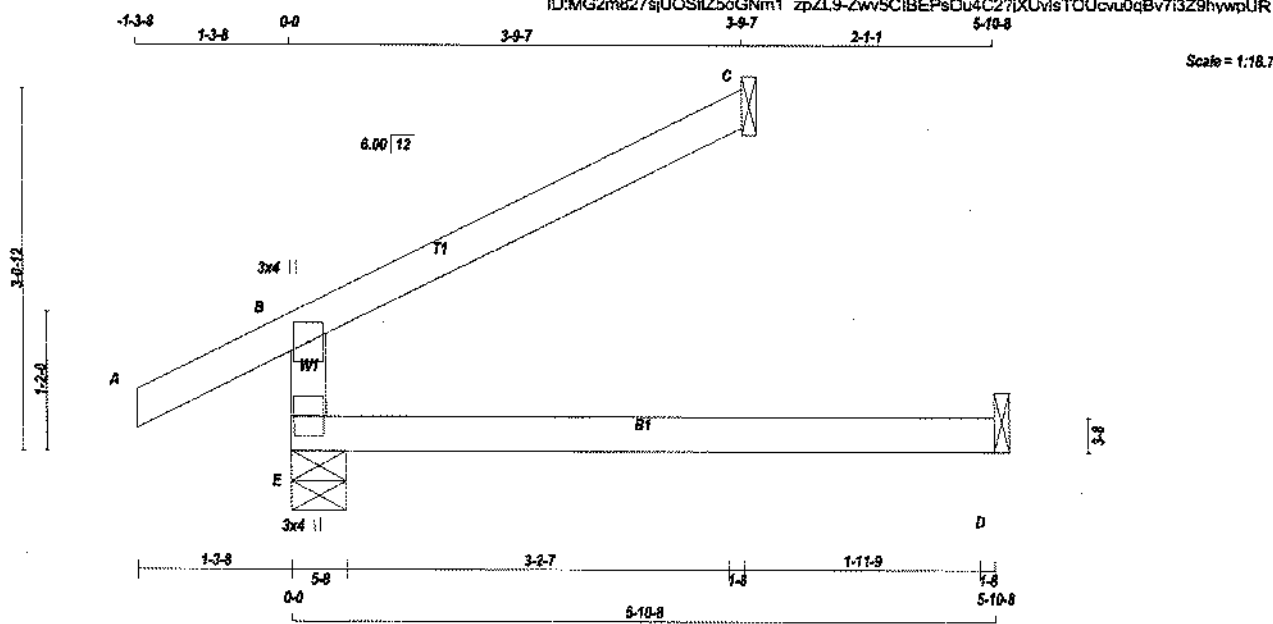

Scale = 1/18"

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH. LL =	23.3	PSF	
E - B	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	DL =	6.0	PSF	
A - C	2x4	DRY	No.2	JT VERT	JT HORZ	DOWN	HORZ	BOT CH. LL =	0.0	PSF	
E - D	2x4	DRY	No.2	E 380	0	380	0	DL =	7.4	PSF	
DRY: SEASONED LUMBER.				C 121	0	121	0	TOTAL LOAD =	36.7	PSF	
				D 45	0	50	0				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	289	173 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0
C	83	86 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC. (LC)	MAX. FACTORED UNBRAC. (LC)
FR-TO				FR-TO			
E-B	-316 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00			
B-C	-18 / 0	-84.9	-84.9 0.21 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.21/1.00 (B-C:1), BC=0.13/1.00 (D-E:4)
WB=0.00/1.00 (N/A:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)


STRUCTURAL COMPONENT ONLY



DWG # TR22070070



NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	C3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:47 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-16TUQeCsAAWIMdBE78r30bj0HdHR2MMp7i7ywpUQ

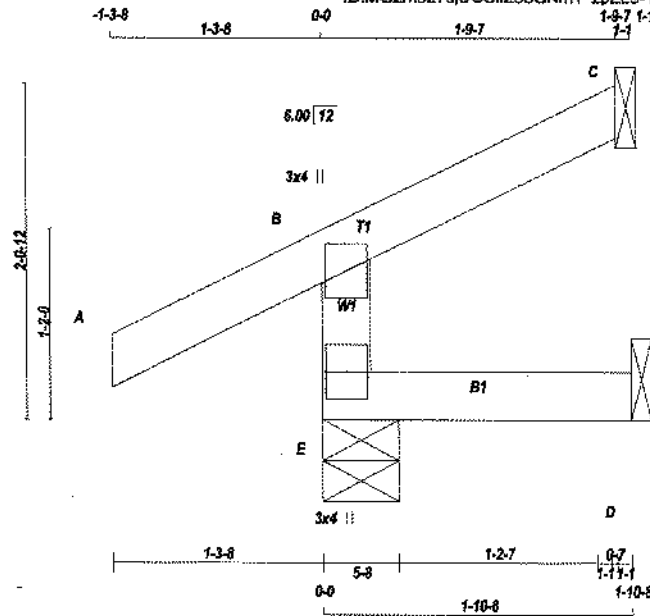

Scale = 1:13.6

TOTAL WEIGHT = 2 X 7 = 14 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	252	0	252	0	5-8	5-8
C	41	0	41	0	1-8	1-8
D	9	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	178	129 / 0	0 / 0	0 / 0	0 / 0	47 / 0
C	29	22 / -16	0 / 0	0 / 0	0 / 0	7 / 0
D	8	0 / -7	0 / 0	0 / 0	0 / 0	12 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. CS1 (LC)
		FROM	TO				
E-B	-225 / 0	0.0	0.0	0.03 (5)	7.81		
A-B	0 / 28	-84.9	-84.9	0.11 (5)	10.00		
B-C	-15 / 0	-84.9	-84.9	0.08 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.03 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CS1: TC=0.11/1.00 (A-B-5), BC=0.03/1.00 (D-E-5), WB=0.00/1.00 (n/a:0), SS1=0.08/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.09 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070072

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	C4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Mon Jul 18 14:43:48 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-VJfisd CuxTfckWCOryWNNHYk Pd9UkhCb0YgEaywpUP

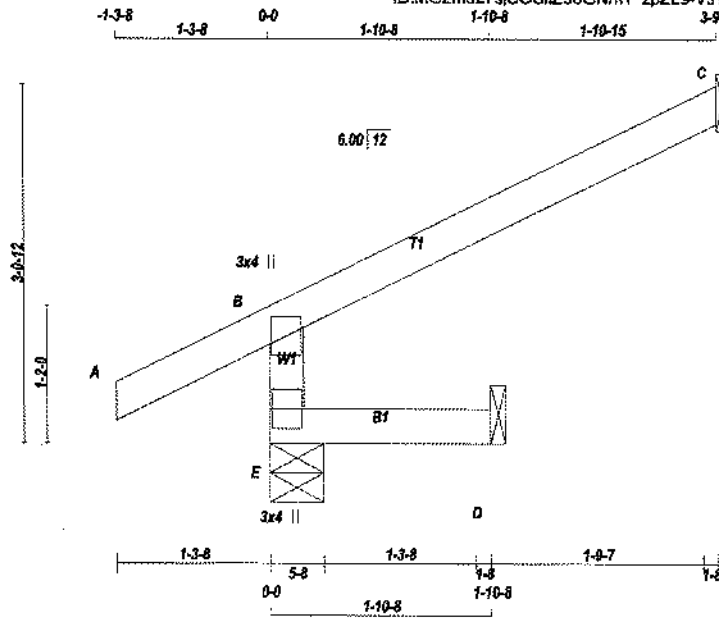

Scale = 1:18.9

TOTAL WEIGHT = 2 X 10 = 19 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	SPECIFIED LOADS:	TOP CH.	LL
E - B	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A - C	2x4	DRY	No.2	SPF	E	335	0	335	0	5-8	5-8
E - D	2x4	DRY	No.2	SPF	C	121	0	121	0	1-8	1-8
					D	16	0	17	0	1-8	1-8

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	COMBINED	173 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
C		83	86 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D		12	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. FACTORED UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO		FR-TO		
E-B	-316 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 26	-84.9	-84.9	0.12 (5)	10.00		
B-C	-18 / 0	-84.9	-84.9	0.21 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070073


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	C5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:48 2022 Page 1
ID:MG2m827sUOSfZ5oGNm1 zpZL9-VJ1sd CUXTfckWCOryWNNHY18PdcUkhCb0YgEaywpUP

1-3-8 1-3-8 0-0 1-9-7 1-9-7 1-3-1 3-0-8

Scale = 1:18.3

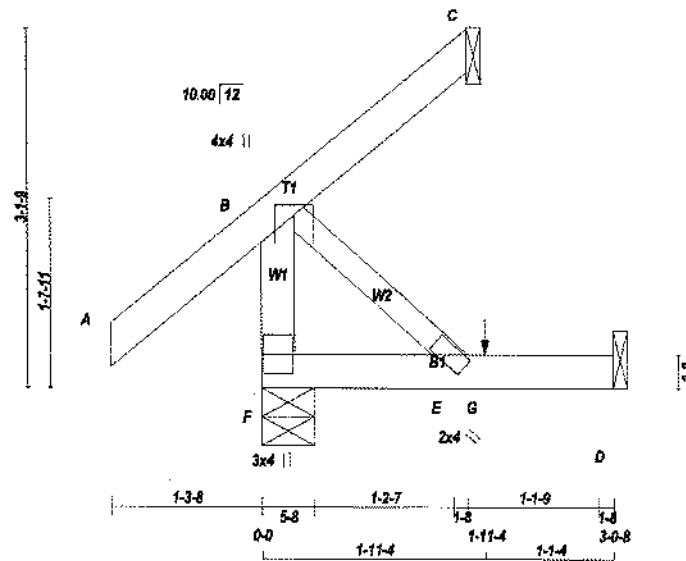

TOTAL WEIGHT = 2 X 11 = 23 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH. LL = 23.3 PSF			
F - B	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	DL = 6.0 PSF			
A - C	2x4	DRY	No.2	VERT	DOWN	UPLIFT	IN-SX	BOT CH. LL = 0.0 PSF			
F - D	2x4	DRY	No.2	F	267 0	0	5-8	DL = 7.4 PSF			
ALL WEBS	2x3	DRY	No.2	C	30 0	30 0	1-8	TOTAL LOAD = 36.7 PSF			
DRY: SEASONED LUMBER.				D	28 0	0	1-8				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM/W+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	187	131 / 0	0 / 0	0 / 0	0 / 0	56 / 0	0 / 0
C	21	17 / -25	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	23	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM	TO	FR-TO			
F-B	-239 / 0	0.0	0.0 0.03 (1)	8-E	0 / 0	0.00 (1)	
A-B	0 / 38	-84.9	-84.9 0.13 (5)				
B-C	-29 / 0	-84.9	-84.9 0.13 (5)				
F-E	0 / 0	-18.5	-18.5 0.05 (4)				
E-G	0 / 0	-18.5	-18.5 0.05 (4)				
G-D	0 / 0	-18.5	-18.5 0.05 (4)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	—	BACK	VERT	TOTAL	—	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

STRUCTURAL COMPONENT ONLY



DWG # TR22070074


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873
PLATE PLACEMENT TOL. = 0.260 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424156	C6	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 14:43:49 2022 Page 1

ID:MG2m827sIUOSfZ5oGNm1 zpZL9-zVaEqKD6innTxfnaOf1cwU5x8pyMDBwLpgfDm0ywpUO

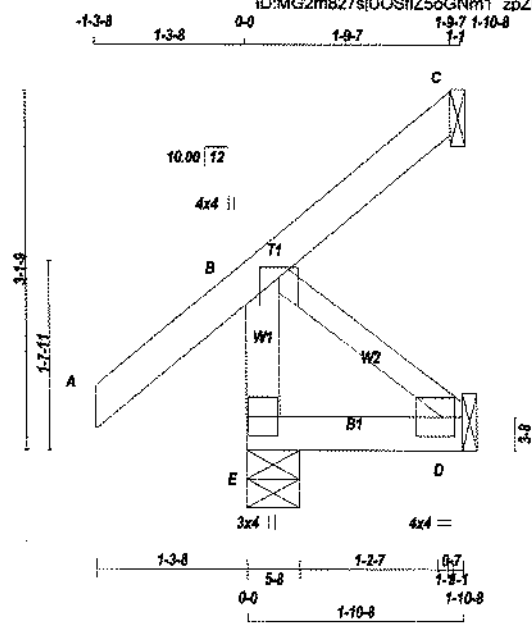

Scale = 1:19.3

TOTAL WEIGHT = 2 X 10 = 20 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMV1+L	MT20	4.0	4.0	2.00 1.25
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
E	255	0	255	0	0	5-8	5-8		
C	30	0	30	0	-36	1-8	1-8		
D	17	0	19	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-4 FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	178	131/0	0/0	0/0	0/0	47/0	0/0
C	21	17/-25	0/0	0/0	0/0	4/0	0/0
D	13	0/0	0/0	0/0	0/0	13/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
E-B	-238 / 0	0.0	0.0	0.03 (1)	7.81	B-D	0 / 0
A-B	0 / 38	-84.9	-84.9	0.12 (1)	10.00		0.00 (1)
B-C	-29 / 0	-84.9	-84.9	0.11 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 36.7 PSF				

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.07/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	768	1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

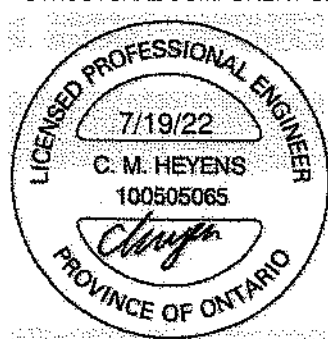

DWG # TR22070075

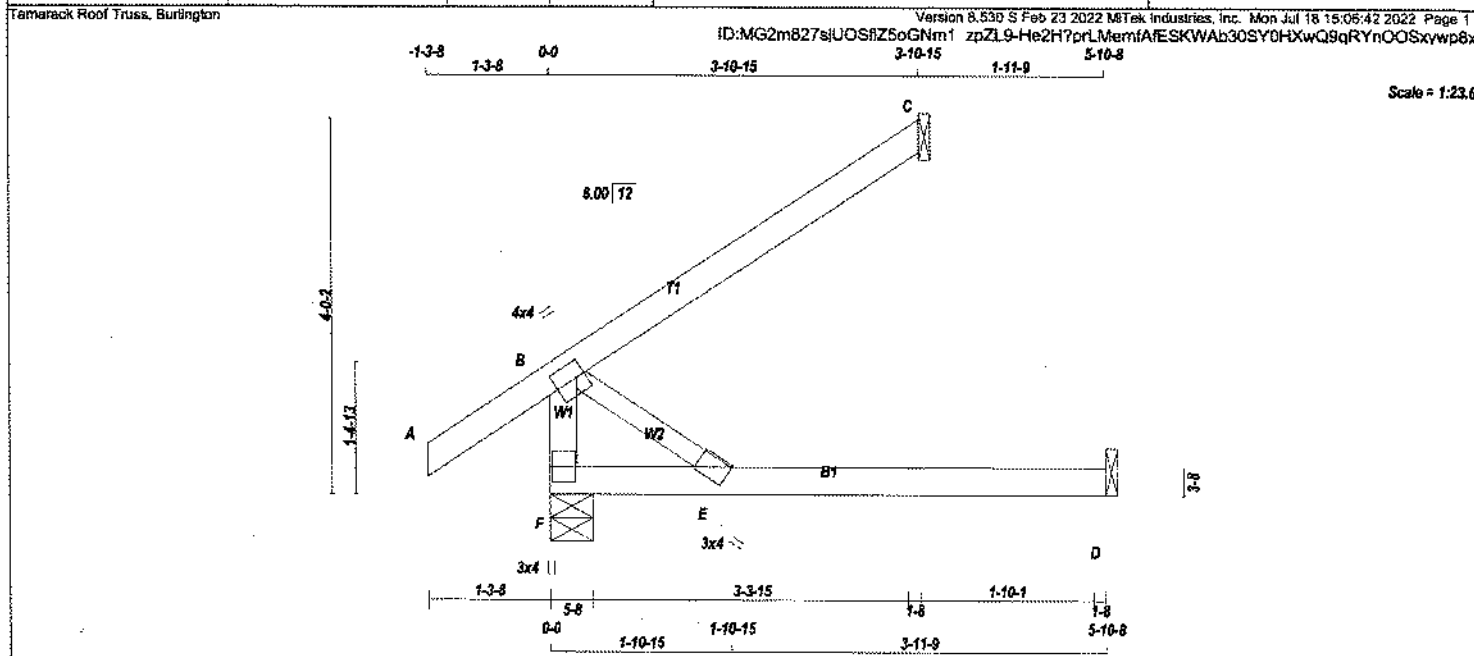

TOTAL WEIGHT = 17 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	4.0	2.00	1.00
E	BMVW-w	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	337	0	337	0	5-8	5-8
C	166	0	166	0	1-8	1-8
D	64	0	64	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	238	155/0	0/0	0/0	0/0	83/0	0/0
C	115	91/0	0/0	0/0	0/0	23/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO						
F-B	-282/0	0.0	0.0	0.03 (1)	7.81	0/0
A-B	0/32	-84.9	-84.9	0.11 (1)	10.00	
B-C	0/0	-84.9	-84.9	0.22 (1)	10.00	
F-E	0/0	-18.5	-18.5	0.16 (4)	10.00	
E-D	0/0	-18.5	-18.5	0.19 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/986$ (0.05")

CS1: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.09/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

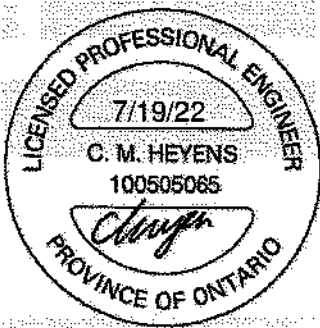


DWG # TR22070120

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	C8	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 B Feb 23 2022 MITek Industries, Inc. Mon Jul 18 15:06:43 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-irfC8r 7xuWnppeuOhocE?IMht99c4amR7x Nywp8w

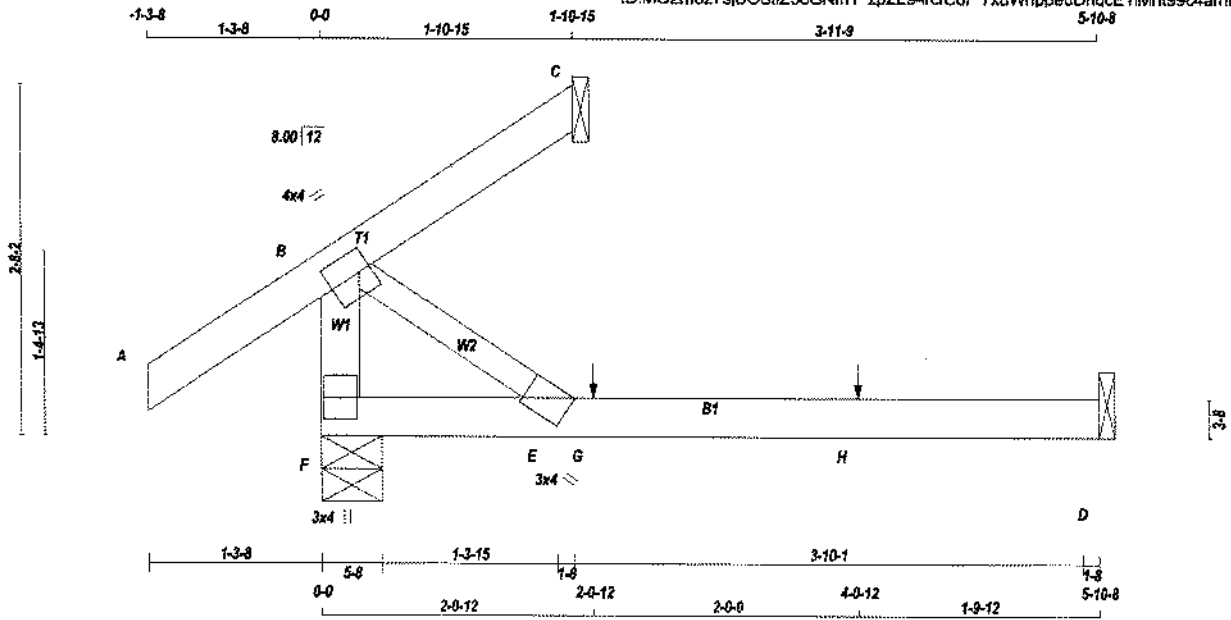

Scale = 1/16"

TOTAL WEIGHT = 14 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	4.0	2.00	1.00
E BMW-w	MT20	3.0	4.0	2.00	1.25
F BMV1+p	MT20	3.0	4.0		

NOTES-

- 1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
F	294	0	294	0	5-8	5-8
C	39	0	39	0	1-8	1-8
D	64	0	61	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX / MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	209	131 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	27	22 / 0	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	FORCE (LBS)	VERT. LOAD	LC1	MAX	MEMB.	FORCE (LBS)	MAX	LC1
FR-TO					FR-TO			
F-B	-239 / 0	0.0	0.0	0.03 (1)	B-E	0 / 0	0.00 (1)	
A-B	0 / 32	-84.9	-84.9	0.12 (1)				
B-C	-23 / 0	-84.9	-84.9	0.11 (1)				
F-E	0 / 0	-18.5	-18.5	0.16 (4)				
E-G	0 / 0	-18.5	-18.5	0.19 (4)				
G-H	0 / 0	-18.5	-18.5	0.19 (4)				
H-D	0 / 0	-18.5	-18.5	0.19 (4)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1		FRONT	VERT	TOTAL		C1
H	4-0-12	1	1		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.12/1.00 (A-B:1), BC=0.19/1.00 (D-E:4)
WB=0.00/1.00 (B-E:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=0.96 NAIL=0.96 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY

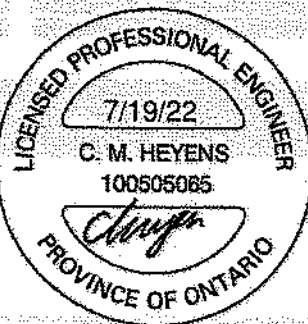

DWG # TR22070121

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	C9	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 15:06:44 2022 Page 1

ID:MG2m827sjUOSfZ5oGNm1 zpZL9-D1A2QUscuF0MPzOrSx38RYw94F0u3Kk75IUWpywp8v

-1-3-8 0-0 1-10-15 1-10-15 2-0-0 1-10-15 2-0-0

Scale = 1:16.0

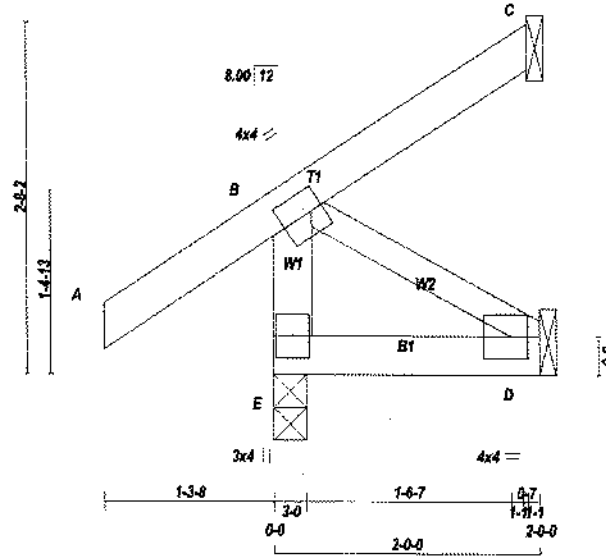

TOTAL WEIGHT = 2 X 10 = 19 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.00
D	BMW1-t	MT20	4.0	4.0	2.00 1.50
E	BMV1+p	MT20	3.0	4.0	

NOTES-

(1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	257	257	0	3-0
C	39	39	-31	1-8
D	18	20	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	MAX MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	179	131 / 0	0 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	27	22 / -23	0 / 0	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD LC1 (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
E-B	-238 / 0	0.0	0.0	0.02 (1)	7.81	B-D	0 / 0	0.00 (1)	
A-B	0 / 32	-84.9	-84.9	0.12 (5)	10.00				
B-C	-23 / 0	-84.9	-84.9	0.11 (5)	6.25				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 23.3	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")

CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B-5), BC=0.02/1.00 (D-E-4)
WB=0.00/1.00 (B-D-1), SSI=0.08/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.80)

JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070122

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	C10	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 15:06:44 2022 Page 1
ID:MG2m827sjUOS1Z5oGNm1 zpZL9-D1A2QUscuFOMPzOrSxC38RYuW4F0u3Kk75IUWpywp8v

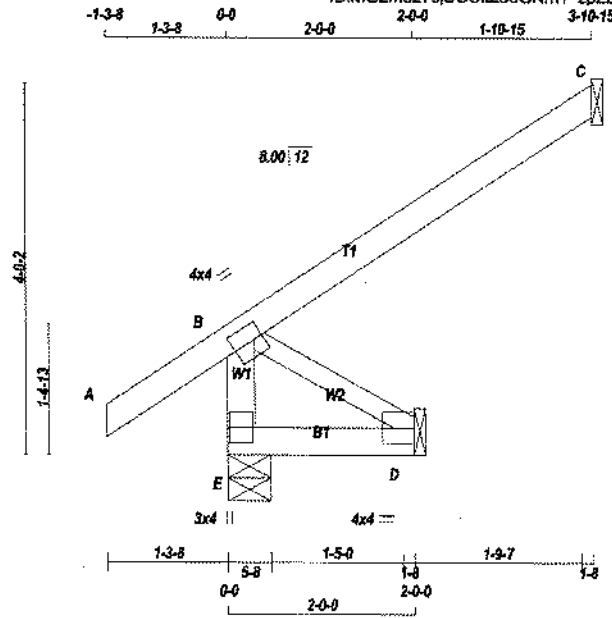

Scale: 1/2"=1'

TOTAL WEIGHT = 12 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+	MT20	4.0	4.0	2.00	1.00
D BMV1+	MT20	4.0	4.0	2.00	Edge
E BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	300	0	300	0
C	166	0	166	0
D	18	0	20	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	209	155 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
C	115	91 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

	CHORDS	WEBS
	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		
E-B	-282 / 0	0.0 0.0 0.03 (1) 7.01
A-B	0 / 32	-84.9 -84.9 0.12 (5) 10.00
B-C	0 / 0	-84.9 -84.9 0.22 (1) 10.00
E-D	0 / 0	-18.5 -18.5 0.02 (4) 10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4)
WB=0.00/1.00 (B-D:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY




DWG # TR22070123

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424160	C11	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Mon Jul 18 15:06:45 2022 Page 1
ID:MG2m827sjUOSfZ5oGNm1 zpZL9-hDkQdqtEIZ8D17z17ejihf44gUbmdWatEic22Gywp8u

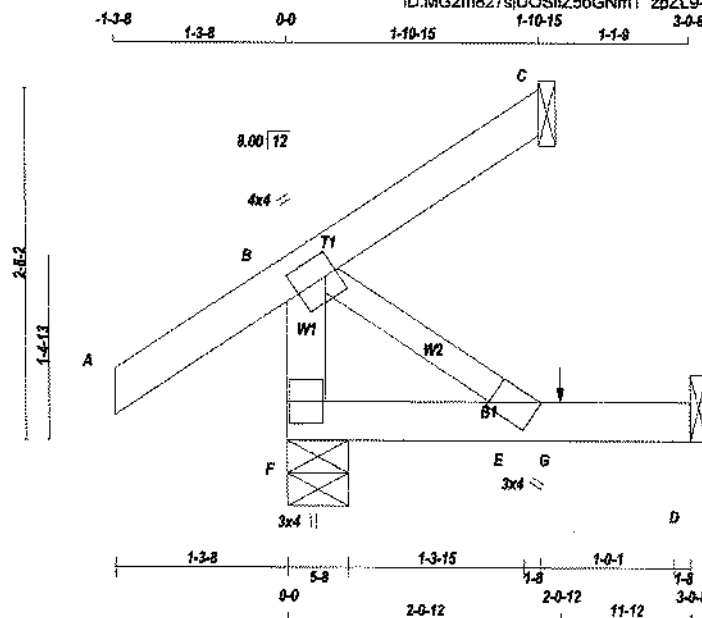

Scale = 1/16"

TOTAL WEIGHT = 11 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.00
E	BMW+w	MT20	3.0	4.0	2.00 1.25
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	268	0	288	0	5-8
C	39	0	39	0	1-8
D	28	0	32	0	1-8

SEE MITEK STANDARD DETAIL MSD2016-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
F	188	131/0	0/0	0/0	0/0	58/0
C	27	22/-23	0/0	0/0	0/0	6/0
D	23	0/0	0/0	0/0	0/0	23/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD LC1	MAX	MEMB.	FORCE (LBS)	MAX
FR-TO		FROM	TO	CS1 (LC)	UNBRAC	FR-TO	CS1 (LC)
F-B	-239/0	0.0	0.0	0.02 (1)	7.81	B-E	0/0
A-B	0/32	-84.9	-84.9	0.13 (5)	10.00		
B-C	-23/0	-84.9	-84.9	0.12 (5)	6.25		
F-E	0/0	-18.5	-18.5	0.05 (4)	10.00		
E-G	0/0	-18.5	-18.5	0.05 (4)	10.00		
G-D	0/0	-18.5	-18.5	0.05 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	Z-0-12	1	1	1	FRONT	VERT	TOTAL	1	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL	LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CS1: TC=0.13/1.00 (A-B:5), BC=0.05/1.00 (E-F:4)
WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY



DWG # TR22070124

EWP DESIGN INC.

(905) 832-2250

FAX (905) 832-0286

RESPONSIBILITIES AND SPECIFICATIONS

RESPONSIBILITIES

1. EWP DESIGN INC. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on each drawing meet or exceed the actual dead load imposed by the structure, the live load imposed by the intended use and the snow load imposed by local building code or authorities with jurisdictions.
3. All dimensions are to be verified by the owner, contractor, architect or other authorities with jurisdictions before truss fabrication.
4. EWP DESIGN INC. bears no responsibility for the erection of trusses. Persons erecting trusses are cautioned to seek professional advice regarding the temporary and permanent bracing for the system. Bracing shown on EWP DESIGN INC. drawing is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacturer's responsibility to ensure that trusses are manufactured in conformance with specifications of EWP DESIGN INC. as outlined below.

SPECIFICATIONS

1. Trusses designed by EWP DESIGN INC. conform to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type, as indicated on the EWP DESIGN INC. drawings, and conform to the design procedures established by the Truss Plate Institute of Canada. Unit stresses used for truss designs are as per the edition of CSA-O86 shown on EWP DESIGN INC. drawings.
2. Lumber is to be the size, species and grade as specified on EWP DESIGN INC. drawings.
3. Moisture content of lumber shall not exceed 19% in service unless specified otherwise.
4. Metal connector plates shall be applied to both faces of truss at each joint and shall be positioned as specified.
5. Top chords of trusses are assumed to be continuously braced laterally by roof sheathing or by purlins at intervals not exceeding 12.5 times the thickness of top chord member.
6. Bottom chords shall be laterally braced at intervals not exceeding 3M (10') o.c., where rigid ceiling is not applied directly to the underside of chords.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF EWP DESIGN INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY THE ALPA LUMBER GROUP, AND WILL BE RETRACTED BY EWP DESIGN INC. IF UTILIZED FOR ANY OTHER PURPOSE.

February 1, 2019

TOE-NAIL CAPACITY DETAILS

LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
2x4 SPF	2	2	3	3	3
2x6 SPF	4	4	4	5	5
2x4 D. FIR	2	2	2	2	2
2x6 D. FIR	3	3	3	4	4

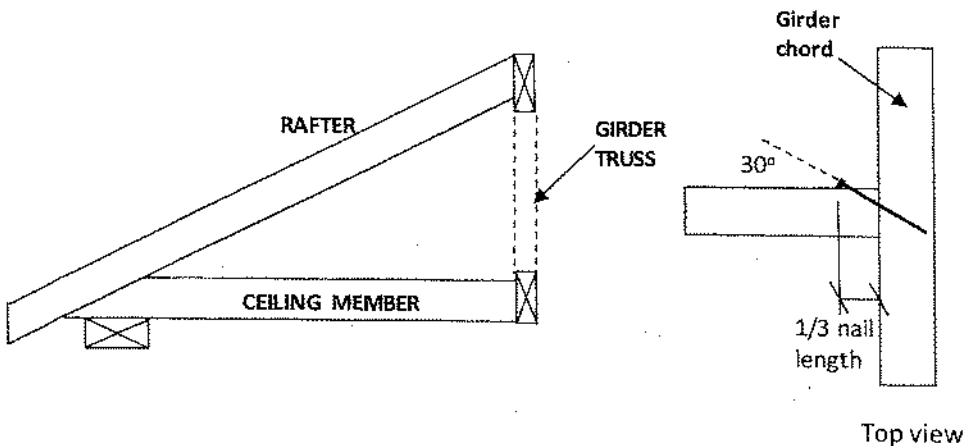


Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss


PEO
Certificate No. 10889485



December 21, 2020

TOE-NAIL CAPACITY DETAILS

Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

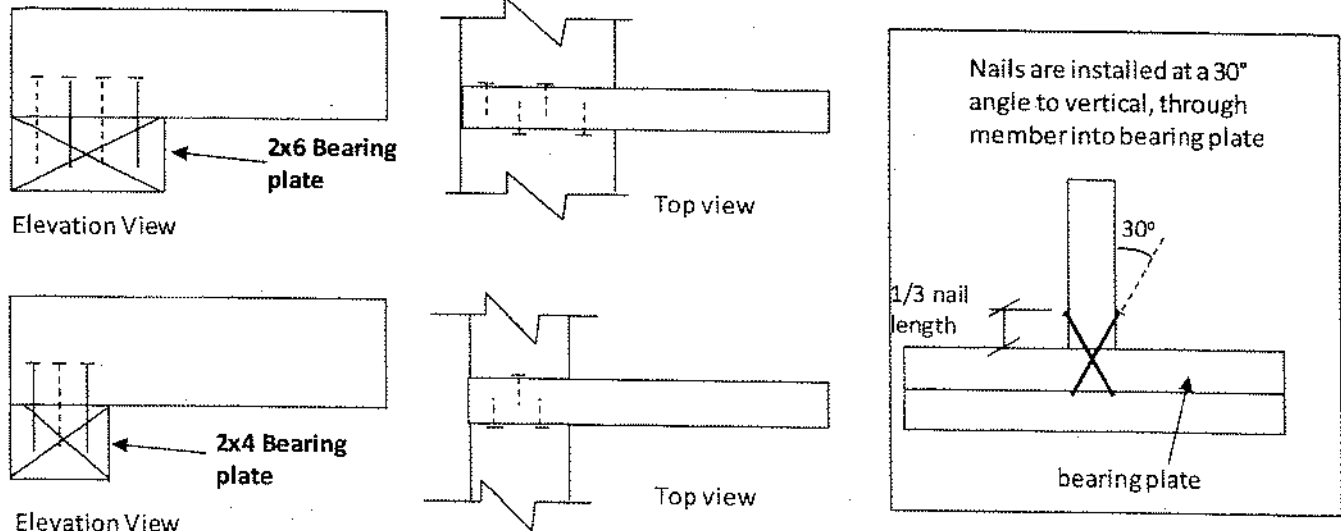

NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of $G = 0.42$ (SPF) and $G = 0.49$ (D. Fir).
5. Toe-nails shall be driven at approximately $1/3$ the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 (K_0 factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO
Certificate No. 10889485



LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 217–218.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on pp. 105–107.



Double-Shear
Nailing
Top View






Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing
Side View
(available on
some models)


Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

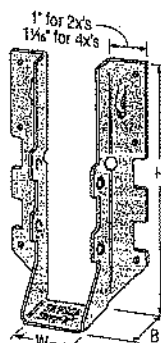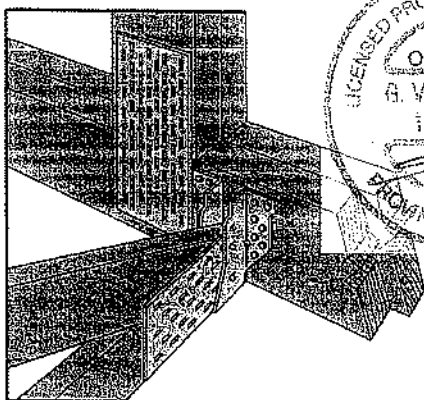


✓ LUS28




LU26L

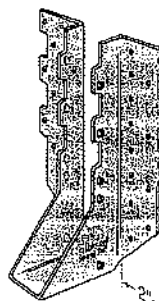


✓ HUS210
(HUS26, HUS28,
and HHUS similar)

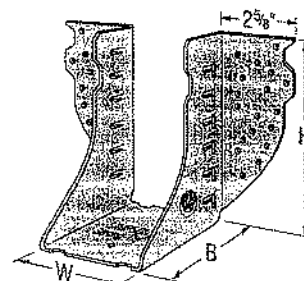

✓ HGUS28-2

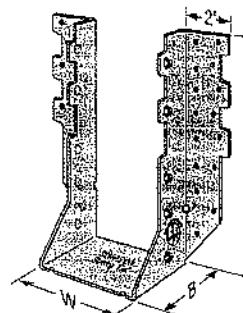

✓ HHUS210-2



LJS26DS

TECHNICAL BULLETIN

LUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA C86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire,
10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

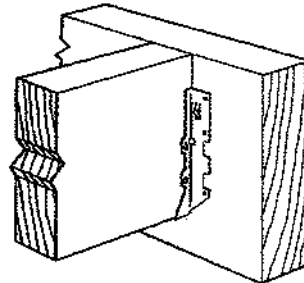


Typical LUS
installation

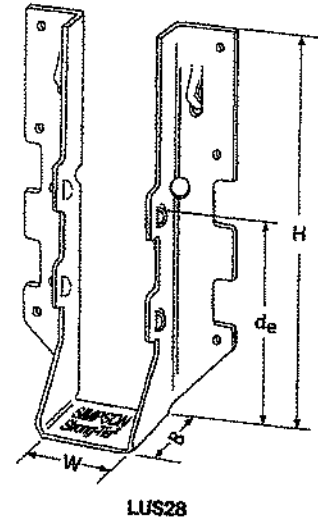


Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d _s ¹	Face	Joist		D-Fir-L		S-P-F	
									Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LUS24	18	1 1/8	3 1/8	1 3/4	1 1/8	(4) 10d	(2) 10d		710	1630	645	1155
LUS24-2	18	3 1/8	3 1/8	2	1 1/8	(4) 16d	(2) 16d		835	2020	590	1435
LUS26	18	1 1/8	4 1/8	1 3/4	3 3/8	(4) 10d	(4) 10d		1420	2170	1290	1630
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d		1720	2595	1545	1920
LUS26-3	18	4 1/8	4 1/8	2	3 1/4	(4) 16d	(4) 16d		1720	2595	1545	2340
LUS28	18	1 1/8	6 1/8	1 3/4	3 3/8	(6) 10d	(6) 10d		1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d		1720	3325	1545	2575
LUS28-3	18	4 1/8	6 1/8	2	3 1/4	(6) 16d	(4) 16d		1720	3325	1545	2375
LUS210	18	1 1/8	7 1/8	1 3/4	3 3/8	(8) 10d	(4) 10d		1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d		2580	4500	2320	3195
LUS210-3	18	4 1/8	8 1/8	2	5 1/4	(8) 16d	(6) 16d		2580	3345	2320	2375

1. d_s is the distance from the seat of the hanger to the highest joist nail.



Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580



Double
Shear
Nailing
Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPEC LUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HUS/LJS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation

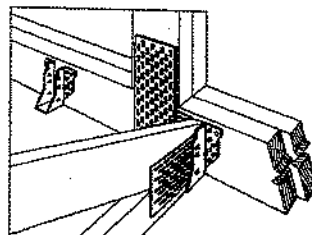


Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁ ¹	Face	Joist		D-Fir-L		S-P-F	
									Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)	Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)
LJS26DS	18	1 1/4	5	3 1/2	4 3/4	(16) 16d	(6) 16d		2055	4265	1460	4115
HUS26	18	1 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d		2705	4940	2065	3875
HUS28	18	1 1/4	7 1/2	3	6 1/2	(22) 16d	(8) 16d		3605	5365	2675	4345
HUS210	18	1 1/4	9 1/2	3	7 1/2	(30) 16d	(10) 16d		4505	5795	4010	4740
HUS1.81/10	16	1 1/4	9	3	8	(30) 16d	(10) 16d		4505	6450	4010	5200


1. d₁ is the distance from the seat of the hanger to the highest joist nail.



Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580



Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HGUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

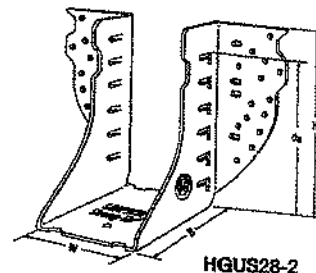

HGUS28-2

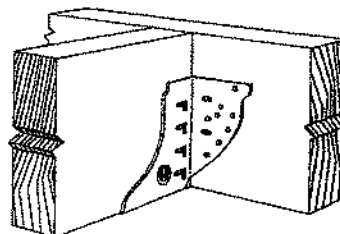


Typical HGUS
Installation

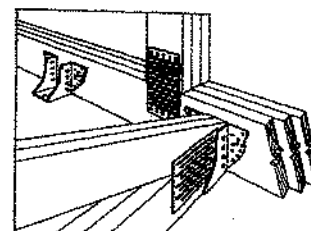

Typical HGUS Installation
(Truss Designer to
provide fastener quantity
for connecting multiple
members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁ ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _u =1.15)	(K _u =1.00)	(K _u =1.15)	(K _u =1.00)
HGUS26	12	1 1/4	5 3/8	5	4 1/2	(20) 16d	(8) 16d	2685	8625	2685	5700
HGUS26-2	12	3 1/8	5 1/8	4	4 1/2	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4 1/8	5 1/8	4	4 1/2	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6 1/8	5 1/8	4	4 1/2	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1 1/4	7 1/4	5	6 1/2	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3 1/8	7 1/8	4	6 1/2	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4 1/8	7 1/8	4	6 1/2	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6 1/8	7 1/8	4	6 1/2	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1 1/4	9 1/4	5	7 1/2	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3 1/8	9 1/8	4	8 1/2	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4 1/8	9 1/8	4	8 1/2	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6 1/8	9 1/8	4	8 1/2	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6 1/8	10 1/8	4	10 1/2	(56) 16d	(20) 16d	7640	14995	5425	10845
HGUS214-4	12	6 1/8	12 1/8	4	11 1/2	(66) 16d	(22) 16d	10130	16400	7195	11645

1. d₁ is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HHUS – Double Shear Joist Hangers



All HHUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 14 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:

- See current catalogue for options

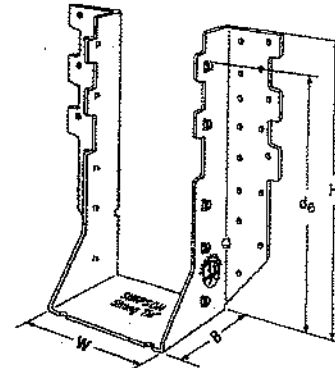


HHUS410

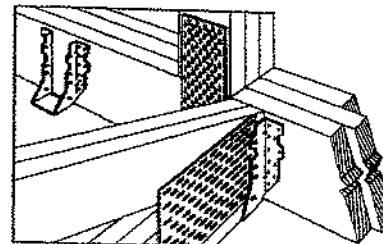

Typical HHUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _b ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(8) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/2	3	6 1/2	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS210-2	14	3 1/8	9 1/2	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
HHUS210-4	14	6 1/8	8 1/2	3	7 1/2	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS46	14	3 1/8	5 1/2	3	3 1/8	(14) 16d	(8) 16d	2540	7335	2065	5205
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
HHUS410	14	3 1/8	9	3	8	(30) 16d	(10) 16d	4670	9855	4235	7000
HHUS5.50/10	14	5 1/2	9	3	8	(30) 16d	(10) 16d	4670	10155	4235	7210
HHUS7.25/10	14	7 1/4	9	3 1/8	7 1/2	(30) 16d	(10) 16d	4670	10155	3370	7210

1. d_b is the distance from the seat of the hanger to the highest joist nail.




Double Double Shear Nailing prevents tabs breaking off (available on some models).


U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



Typical HHUS Installation



LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.


© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22


(800) 999-5099
strongtie.com

H/TSP


Seismic and Hurricane Ties (cont.)




1 H1 Installation




2 H2A Installation




3 TSP Installation




4 H2.5A Installation
(Nails into both top plates)




5 H2.5T Installation
(Nails into both top plates)




6 H2.5T Installation




7 H3 Installation
(Nails into upper top plate)




8 H6 Stud to Top Plate Installation

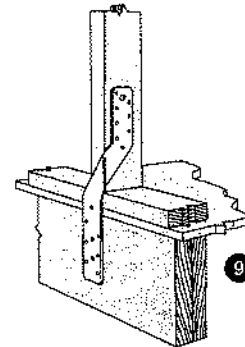


9 H6 Stud to Band Joist Installation

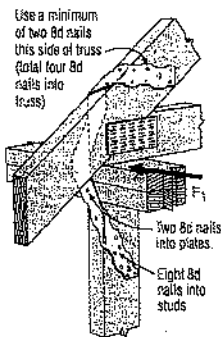


10 H7Z Installation




11 H8 Attaching Rafter to Double Top Plates




12 H8 attaching Stud to Sill
(4) 8d into plate, (5) 8d into stud)




13 H8 attaching I-Joist to Double Top Plates




14 H10A Field-Bent Installation



15 H10S Installation




16 H10S Installation with Stud Offset




17 H10A Installation

H10A optional positive angle nailing connects shear blocking to rafter. Use 8d common nails. Slot allows maximum field-bending up to a pitch of 6/12, use 75% of the table uplift value; bend one time only.




18 H14 Installation to Double Top Plates

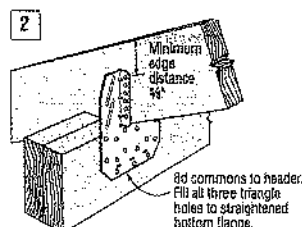

19 H14 Installation to Double 2x Header

Avoid a Misinstallation



Do not make new holes or overdrive nails.

H/TSP

Seismic and Hurricane Ties

Simpson Strong-Tie® hurricane ties provide a positive connection between truss/rafter and the wall of the structure to resist wind and seismic forces. New additions to the line provide even more options.


- H10AR — The heavy-duty design of the H10A available with a 2" wide throat to accommodate rough lumber
- H10A-2 — The H10A design with a 3" throat for double 2x members
- H2ASS, H2.5ASS and H10ASS — Popular ties now available in stainless steel

Material: See table




Finish: Galvanized, H7Z and H11Z — ZMAX® coating. Some models available in stainless steel or ZMAX; see Corrosion Information, pp. 20–24 or visit strongtie.com.

Installation:


- Use all specified fasteners; see General Notes.
- H1 can be installed with flanges facing inward (reverse of H1 installation drawing; number 1).
- H2.5T, H3 and H6 ties are shipped in equal quantities of right and left versions (right versions shown).
- Hurricane ties do not replace solid blocking.
- When installing ties on plated trusses (on the side opposite the truss plate) do not fasten through the truss plate from behind. This can force the truss plate off of the truss and compromise truss performance.
- H10A optional nailing to connect shear blocking, use 8d nails. Slots allow maximum field bending up to a pitch of 6:12, use H10A sloped loads for field bent installation.

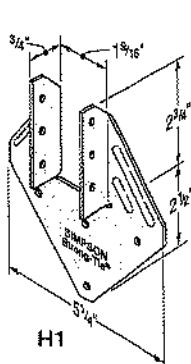


H1

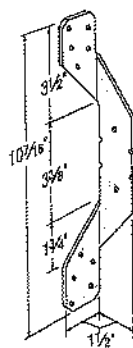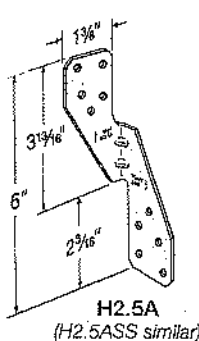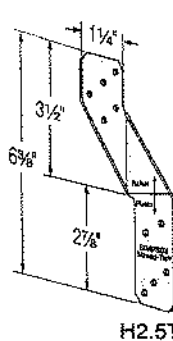H2A
(H2ASS similar)H2.5A
(H2.5ASS similar)


H2.5T

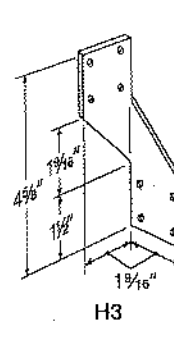


H3

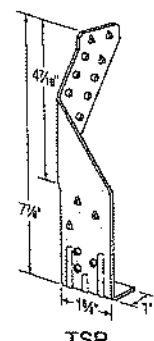


TSP

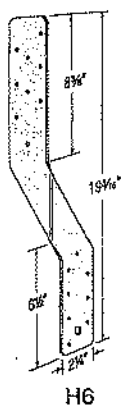


H6

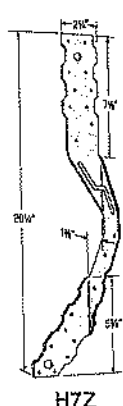



H7Z

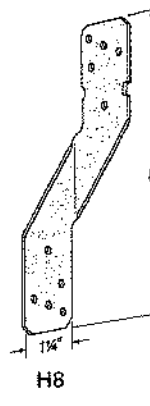


H8

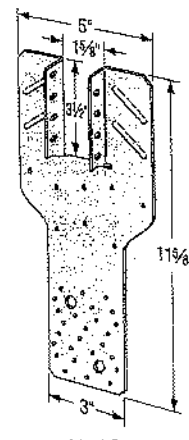


H10S

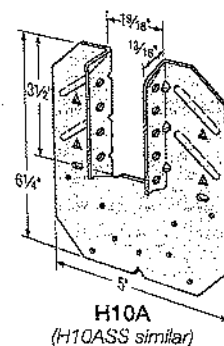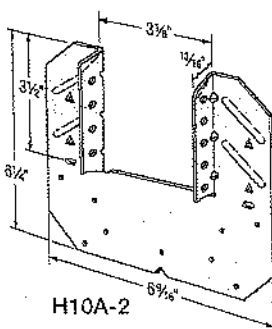H10A
(H10ASS similar)


H10A-2

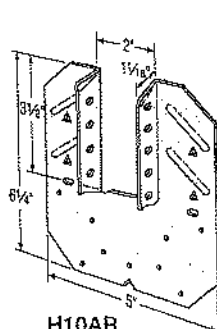


H10AR

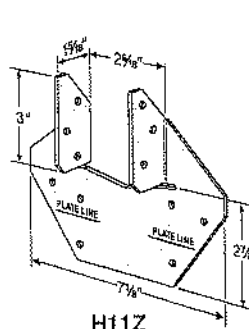

H11Z

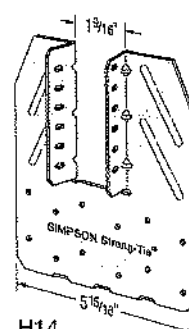

H14

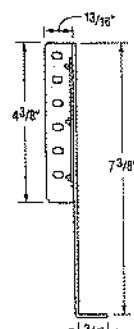H14
Profile

TECHNICAL BULLETIN

H – Seismic and Hurricane Ties

SIMPSON
Strong-Tie

The H connector series provides wind and seismic ties for trusses and rafters.

Material: 18 gauge **Finish:** G90 galvanized


Design: • Factored resistances are in accordance with CSA 086-14
• Factored resistances have been increased 15%. No further increase is permitted.

Installation: • Use all specified fasteners

- Nails: 8d = 0.131" dia. x 2½" long common wire, 8d x 1½" = 0.131" x 1½" long, 10d x 1½" = 0.146" x 1½" long
- H1 can be installed with flanges facing outwards
- Hurricane ties do not replace solid blocking


Factored resistances for more than one direction for a single connection cannot be added together. A factored load which can be divided into components in the directions given must be evaluated as follows: Factored Shear/Resisting Shear + Factored Tension/Resisting Tension ≤ 1.0.

Hurricane Tie Installations to Achieve Twice the Load (Top View)

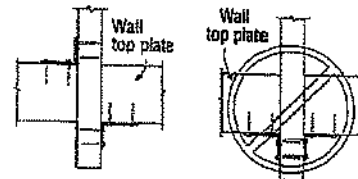


Install diagonally across from each other for minimum 2x truss.

Nailing into both sides of a single ply 2x truss may cause the wood to split.




H1




H1 Installation




H2A




H2A Installation




H2.5A




H2.5A Installation




H2.5T




H2.5T Installation
(Nails into both top plates)




H3



H3 Installation



H10A



H10A Installation

Model No.	Ga.	Fasteners			Factored Resistance (lb.)					
		To Rafter	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Normal		Uplift	Normal	
						F ₁	F ₂		F ₁	F ₂
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
H2.5T	18	(5) 8d	(5) 8d	—	835	175	240	740	160	210
H3	18	(4) 8d	(4) 8d	—	740	180	285	815	125	190
H10A	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.

2. Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on each side of the joist and on the same side of the plate.

3. When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.

4. Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a Continuous Load Path, connections must be on same side of the wall.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECH20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

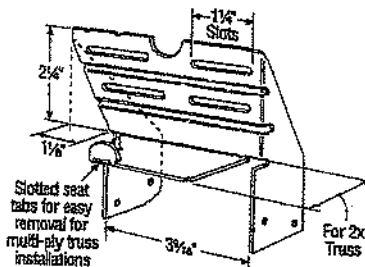


TC24
U.S. Patent 4,932,173

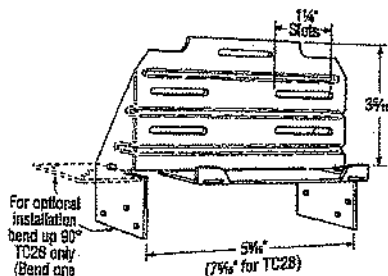


TC26
(TC28 Similar)

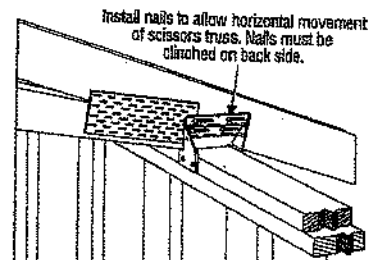

Typical TC24 Installation

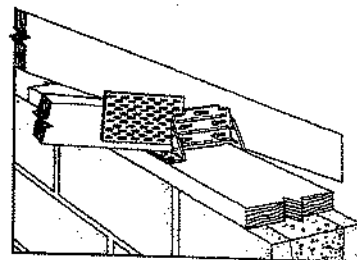

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

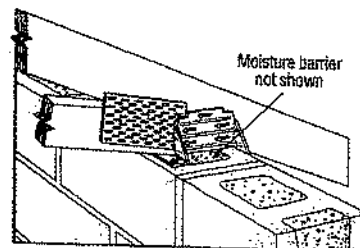

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC26	(5) 10d	(6) 10d x 1 1/4"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECTC20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HTU


Face-Mount Truss Hanger (cont.)

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Alternate Installation for (2) 2x4 and (2) 2x6 Headers

Model No.	Min. Heel Height (in.)	Minimum Header Size	Fasteners		Factored Resistance			
			Header	Joist	D.Fir-L		S-P-F	
					Uplift	Normal	Uplift	Normal
					(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
HTU26 (Min.)	3 3/4"	(2) 2x4	(10) 16d	(14) 10d x 1 1/2"	1740	3340	1235	2370
					7.74	14.86	5.49	10.54
HTU26 (Max.)	5 1/4"	(2) 2x4	(10) 16d	(20) 10d x 1 1/2"	2470	4015	1755	2950
					10.99	17.86	7.81	12.88
HTU28 (Max.)	3 3/4"	(2) 2x6	(20) 16d	(26) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19
HTU210 (Max.)	7 1/4"	(2) 2x6	(20) 16d	(32) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.45	13.10	20.19

See table footnotes on p. 280.




Hanger Options


See Hanger Options Information on pp. 125-127.

Skewed Seat

- Skewable up to 67 1/2°
- Available in single and 2-ply size
- No bevel cut required



Top View HTU Hanger Skewed Right < 51°



Top View HTU Hanger Skewed Right ≥ 51°

Factored Resistances for Skewed HTU Hangers

Model No.	Skew Angle (Degrees)	Fasteners		Factored Resistance			
		Header	Joist	D.Fir-L		S-P-F	
				Uplift	Normal	Uplift	Normal
				(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
				lb.	lb.	lb.	lb.
				kN	kN	kN	kN
HTU26	< 51	(20) 16d	(14) 10d x 1 1/2"	1835	4110	1300	2905
	51-57 1/2	(20) 16d	(12) 10d x 1 1/2"	8.16	18.28	5.78	12.92
HTU28	< 51	(26) 16d	(20) 10d x 1 1/2"	1350	3820	955	2580
	51-67 1/2	(26) 16d	(17) 10d x 1 1/2"	5.01	10.10	4.25	11.39
HTU210	< 51	(32) 16d	(26) 10d x 1 1/2"	2810	4270	1985	3030
	51-67 1/2	(32) 16d	(22) 10d x 1 1/2"	12.50	18.99	8.83	13.48
HTU26-2	< 51	(20) 16d	(14) 10d	2075	3930	1485	2780
	51-67 1/2	(20) 16d	(12) 10d	9.23	17.48	6.52	12.37
HTU28-2	< 51	(26) 16d	(20) 10d	3785	4430	2675	3135
	51-67 1/2	(26) 16d	(17) 10d	16.84	19.71	11.90	13.95
HTU210-2	< 51	(32) 16d	(26) 10d	2795	4240	1980	3000
	51-67 1/2	(32) 16d	(22) 10d	12.43	18.86	8.81	13.35
HTU26-2	< 51	(20) 16d	(14) 10d	2140	3715	1515	2625
	51-67 1/2	(20) 16d	(12) 10d	9.52	18.53	6.74	11.68
HTU28-2	< 51	(26) 16d	(20) 10d	1510	3920	1140	2785
	51-67 1/2	(26) 16d	(17) 10d	7.13	17.44	5.07	12.39
HTU210-2	< 51	(32) 16d	(26) 10d	3980	5425	2815	3855
	51-67 1/2	(32) 16d	(22) 10d	17.62	24.13	12.52	17.15
HTU26-2	< 51	(20) 16d	(14) 10d	2385	5425	1895	3855
	51-67 1/2	(20) 16d	(12) 10d	10.61	24.13	7.54	17.15
HTU28-2	< 51	(26) 16d	(20) 10d	5025	6890	3570	4890
	51-67 1/2	(26) 16d	(17) 10d	22.35	30.65	15.88	21.75
HTU210-2	< 51	(32) 16d	(26) 10d	3145	6880	2225	4745
	51-67 1/2	(32) 16d	(22) 10d	13.99	29.72	9.90	21.10

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Reduced heel heights are not permitted for skewed HTU's.
3. Nails: 16d = 0.162" dia. x 3 1/2" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 10d = 0.148" dia. x 3" long. See pp. 27-28 for other nail sizes and information.


Plated Truss Connectors

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

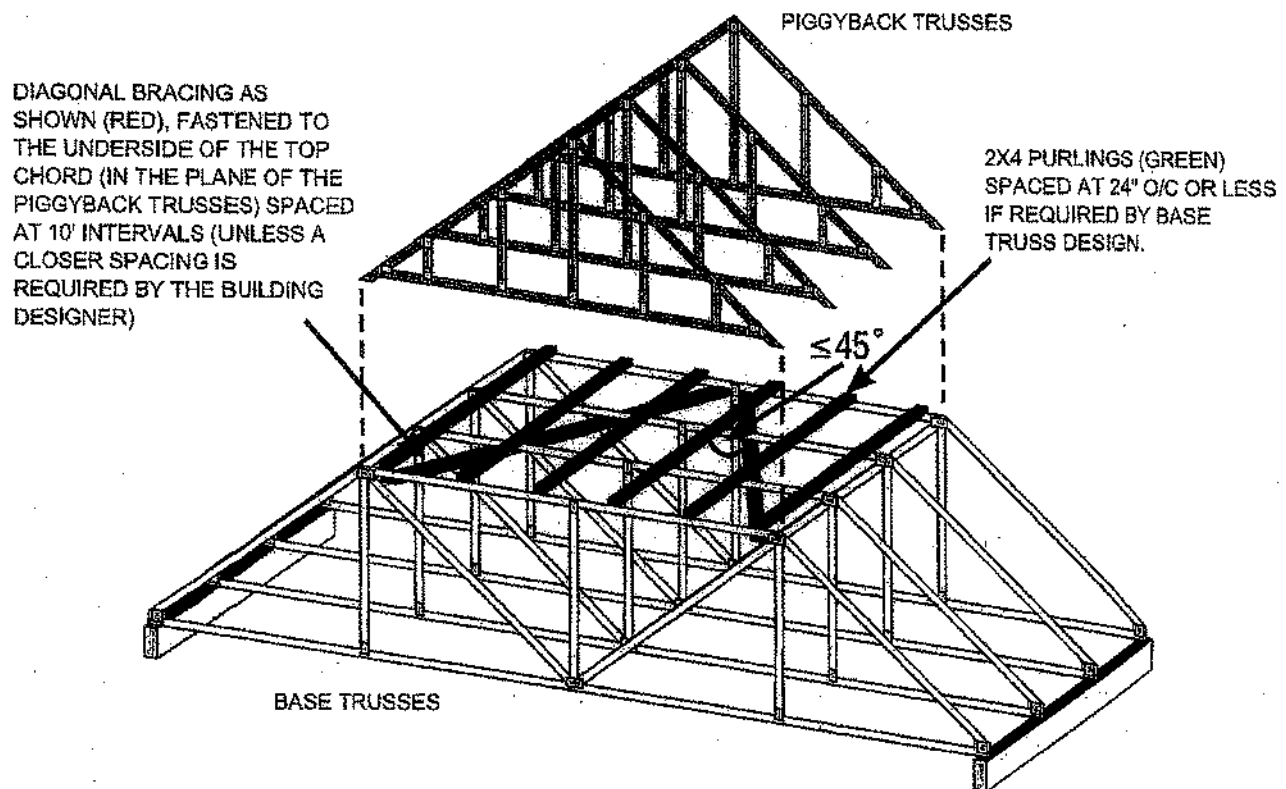

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties

Straps are designed to transfer tension loads in a wide variety of applications.

HRS — Heavy strap designed for installation on the edge of 2x members. The HRS416Z installs with Strong-Drive® SDS Heavy-Duty Connector screws.

LSTA and MSTA — Designed for use on the edge of 2x members, with a nailing pattern that reduces the potential for splitting.

LSTI and MSTI — Light and medium straps that are suitable where pneumatic-nailing is necessary through diaphragm decking and wood chord open-web trusses.



MST — High-capacity strap that can be installed with either nails or bolts. Suitable for double 2x member connections or greater.

MSTC — High-capacity strap that utilizes a staggered nail pattern to help minimize wood splitting. Nail slots have been countersunk to provide a lower nail head profile.


Finish: Galvanized. Some products are available in stainless steel, ZMAX® coating or black powder coat (add PC to sku); contact Simpson Strong-Tie. See Corrosion Information, pp. 18–20.

Installation: Use all specified fasteners; see General Notes


Options: Special sizes can be made to order; contact Simpson Strong-Tie for longer lengths

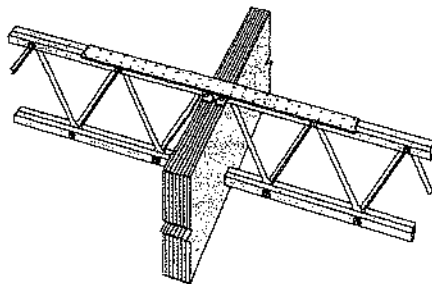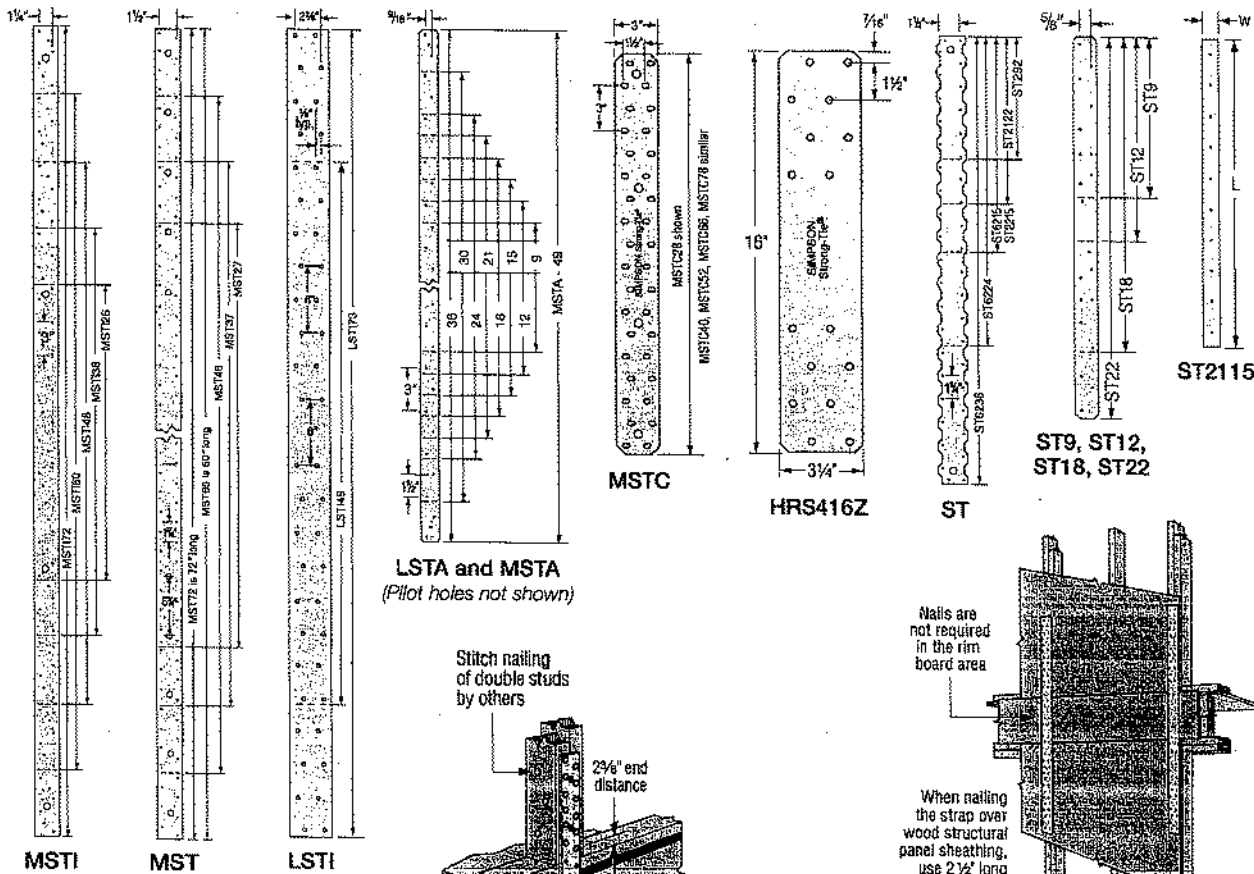


Typical LSTI Installation

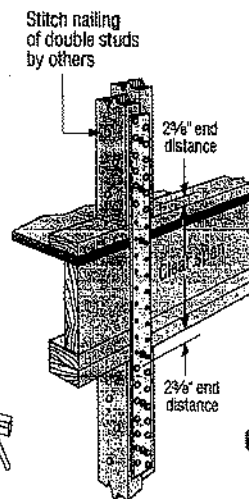

Floor-to-Floor Tie Installation Showing a Clear Span



Typical MSTI Installation (MIT hanger shown) LSTI similar

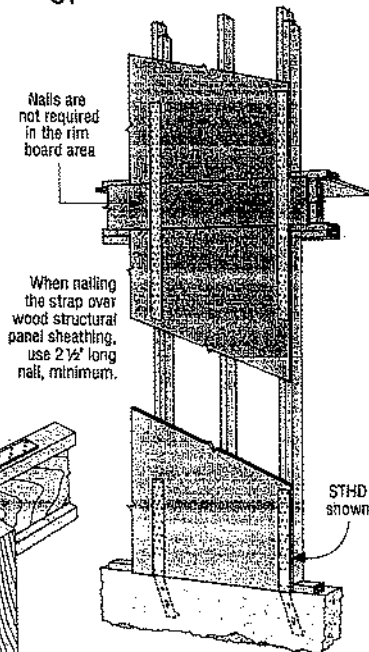

Typical Detail with Strap Installed over Wood Structural Panel Sheathing

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI


Strap Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 20.




Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366-370 for more information.

	Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
			W	L		D.Fir-L		S-P-F	
						(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
						lb.	lb.	lb.	lb.
					kN	kN	kN	kN	
	LSTA9	20	1¼	9	(6) 10d	800	690	555	635
	LSTA12		1¼	12	(8) 10d	2.67	3.07	2.47	2.82
	LSTA15		1¼	15	(10) 10d	800	920	735	845
	LSTA18		1¼	18	(12) 10d	3.56	4.09	3.27	3.76
	LSTA21		1¼	21	(14) 10d	1000	1150	920	1060
	LSTA24		1¼	24	(16) 10d	4.45	5.12	4.09	4.72
	ST292		2⅝	9⅝	(8) 8d	1200	1380	1105	1270
	ST2122		2⅝	12⅝	(12) 8d	5.34	6.14	4.92	5.65
	ST2115		¾	16⅝	(8) 8d	1400	1610	1290	1485
	ST2215		2⅝	16⅝	(16) 8d	6.23	7.18	5.74	6.61
	LSTA30	18	1¼	30	(20) 10d	1600	1840	1475	1695
	LSTA36		1¼	36	(24) 10d	7.12	8.19	6.56	7.54
	LSTI49		3¾	49	(32) 10d x 1½"	585	675	535	615
	LSTI73		3¾	73	(48) 10d x 1½"	2.60	3.00	2.38	2.74
	MSTA9		1¼	9	(6) 10d	940	1085	865	995
	MSTA12		1¼	12	(8) 10d	4.18	4.83	3.85	4.43
	MSTA15		1¼	15	(10) 10d	670	770	615	710
	MSTA18		1¼	18	(12) 10d	2.98	3.43	2.74	3.16
	MSTA21		1¼	21	(14) 10d	1335	1540	1235	1420
	MSTA24		1¼	24	(16) 10d	5.94	6.85	5.49	6.32
	MSTA30	16	1¼	30	(20) 10d	2235	2465	2075	2385
	MSTA36		1¼	36	(24) 10d	9.94	10.97	9.23	10.61
	MSTA49		1¼	49	(28) 8d	2465	2465	2465	2465
	ST6215		2⅝	16⅝	(16) 8d	10.97	10.97	10.97	10.97
	ST6224		2⅝	23⅝	(24) 8d	3115	3580	2852	3280
	ST9		1¼	9	(6) 8d	13.86	15.93	12.69	14.59
	ST12		1¼	11⅝	(8) 8d	4670	5370	4280	4920
	ST18		1¼	17¾	(12) 8d	20.77	23.89	19.04	21.89
	ST22		1¼	21⅝	(18) 8d	670	770	625	715
						2.98	3.43	2.78	3.18
		14	1¼	12	(8) 10d	895	1030	830	955
			1¼	15	(10) 10d	3.98	4.58	3.69	4.25
			1¼	18	(12) 10d	1120	1285	1040	1195
			1¼	21	(14) 10d	4.98	5.72	4.63	5.32
			1¼	24	(16) 10d	1340	1545	1245	1430
			1¼	27	(18) 10d	5.96	6.87	5.54	6.36
			1¼	30	(20) 10d	1565	1800	1455	1670
			1¼	33	(22) 10d	6.96	8.01	6.47	7.43
			1¼	36	(24) 10d	1790	2060	1660	1910
			1¼	39	(26) 10d	7.96	9.18	7.38	8.50
		12	1¼	12	(8) 10d	2470	2840	2260	2595
			1¼	15	(10) 10d	10.99	12.63	10.05	11.54
			1¼	18	(12) 10d	2965	3070	2710	3070
			1¼	21	(14) 10d	13.19	13.66	12.06	13.66
			1¼	24	(16) 10d	2725	2725	2545	2725
			1¼	27	(18) 10d	12.12	12.12	11.32	12.12
			1¼	30	(20) 10d	1405	1615	1300	1500
			1¼	33	(22) 10d	6.25	7.18	5.78	6.67
			1¼	36	(24) 10d	2305	2650	2155	2475
			1¼	39	(26) 10d	10.25	11.79	9.59	11.01

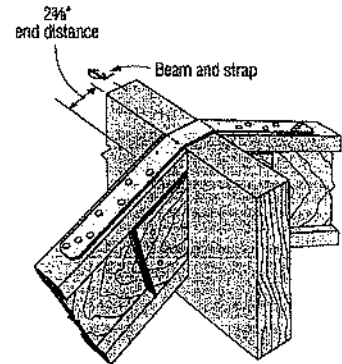

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

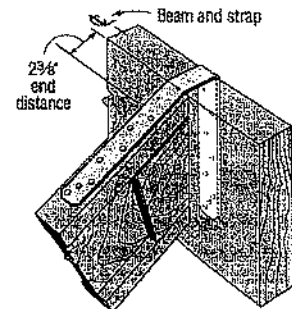

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

- Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
- Use half of the nails in each member being connected to achieve the listed resistances.
- Nails: 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long. See pp. 22-23 for other nail sizes and information.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI


Strap Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 20.


SD Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366-370 for more information.

Model No.	Ga.	Dimensions (In.)		Fasteners (Total)	Factored Tensile Resistance			
		W	L		D-Fir-L		S-P-F	
					(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
MSTC28	16	3	28¼	(32) 10d	3955	4545	3615	4155
					17.59	20.22	16.08	18.48
MSTC40		3	40¼	(48) 10d	5930	6820	5420	6235
					26.38	30.34	24.11	27.74
MSTC52	14	3	52¼	(54) 10d	6670	6940	6100	6940
					29.67	30.87	27.14	30.87
MSTC66		3	65¼	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
MSTC78	12	3	77¼	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.16	38.10
ST6236		2⅞	33⅞	(36) 8d	3735	4295	3270	3760
					16.61	19.11	14.55	16.73
MST126	12	2⅞	26	(22) 10d x 1 ½"	2825	3250	2475	2850
					12.57	14.46	11.01	12.68
MST136		2⅞	36	(32) 10d x 1 ½"	4110	4725	3600	4140
					18.28	21.02	16.01	18.42
MST148		2⅞	48	(44) 10d x 1 ½"	5650	6500	4955	5695
					25.13	28.91	22.04	25.33
MST160		2⅞	60	(56) 10d x 1 ½"	7195	7360	6305	7250
					32.01	32.74	28.05	32.25
MST172		2⅞	72	(68) 10d x 1 ½"	7360	7360	7240	7360
					32.74	32.74	32.21	32.74
MST27		2⅞	27	(26) 8d	2685	3090	2355	2710
					11.94	13.75	10.48	12.06
MST37	10	2⅞	37 ½	(38) 8d	3930	4515	3440	3960
					17.48	20.08	15.30	17.62
MST48		2⅞	48	(50) 8d	5170	5945	4530	5210
					23.00	26.45	20.15	23.18
HRS416Z	10	3¼	16	(16) ¼" x 1 ½" SDS	2400	2760	2120	2440
					10.68	12.28	9.43	10.85
MST60		2⅞	60	(64) 8d	6620	7610	5800	6670
					29.45	33.85	25.80	29.67
MST72	10	2⅞	72	(78) 8d	8065	9135	7065	8125
					35.88	40.64	31.43	36.14

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
2. Use half of the nails in each member being connected to achieve the listed resistances.
3. Nails: 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, Bd = 0.131" dia. x 2 1/2" long. See pp. 22-23 for other nail sizes and information.

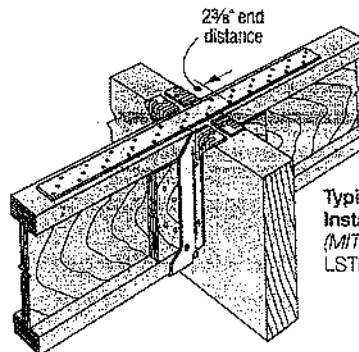



Typical MSTI
Installation
(MIT hanger shown)
LSTI similar

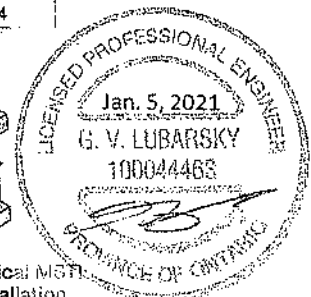

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in 1/16-in. increments or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.



*Plate location details available in Mitek software or upon request.

PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

4 X 4


LATERAL BRACING LOCATION

Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.



BEARING

Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.




Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in 1/16-in. increments or mm (Drawings not to scale)

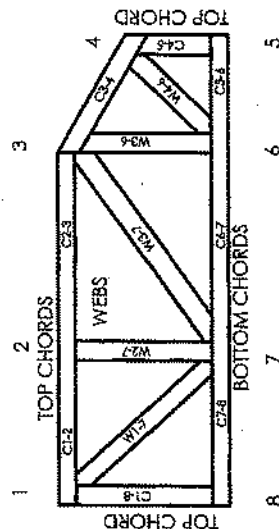

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

Mitek
POWER TO PERFORM.™

Mitek Engineering Reference Sheet: Mili-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g., diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braced members may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never slack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and warps at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing of 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.