


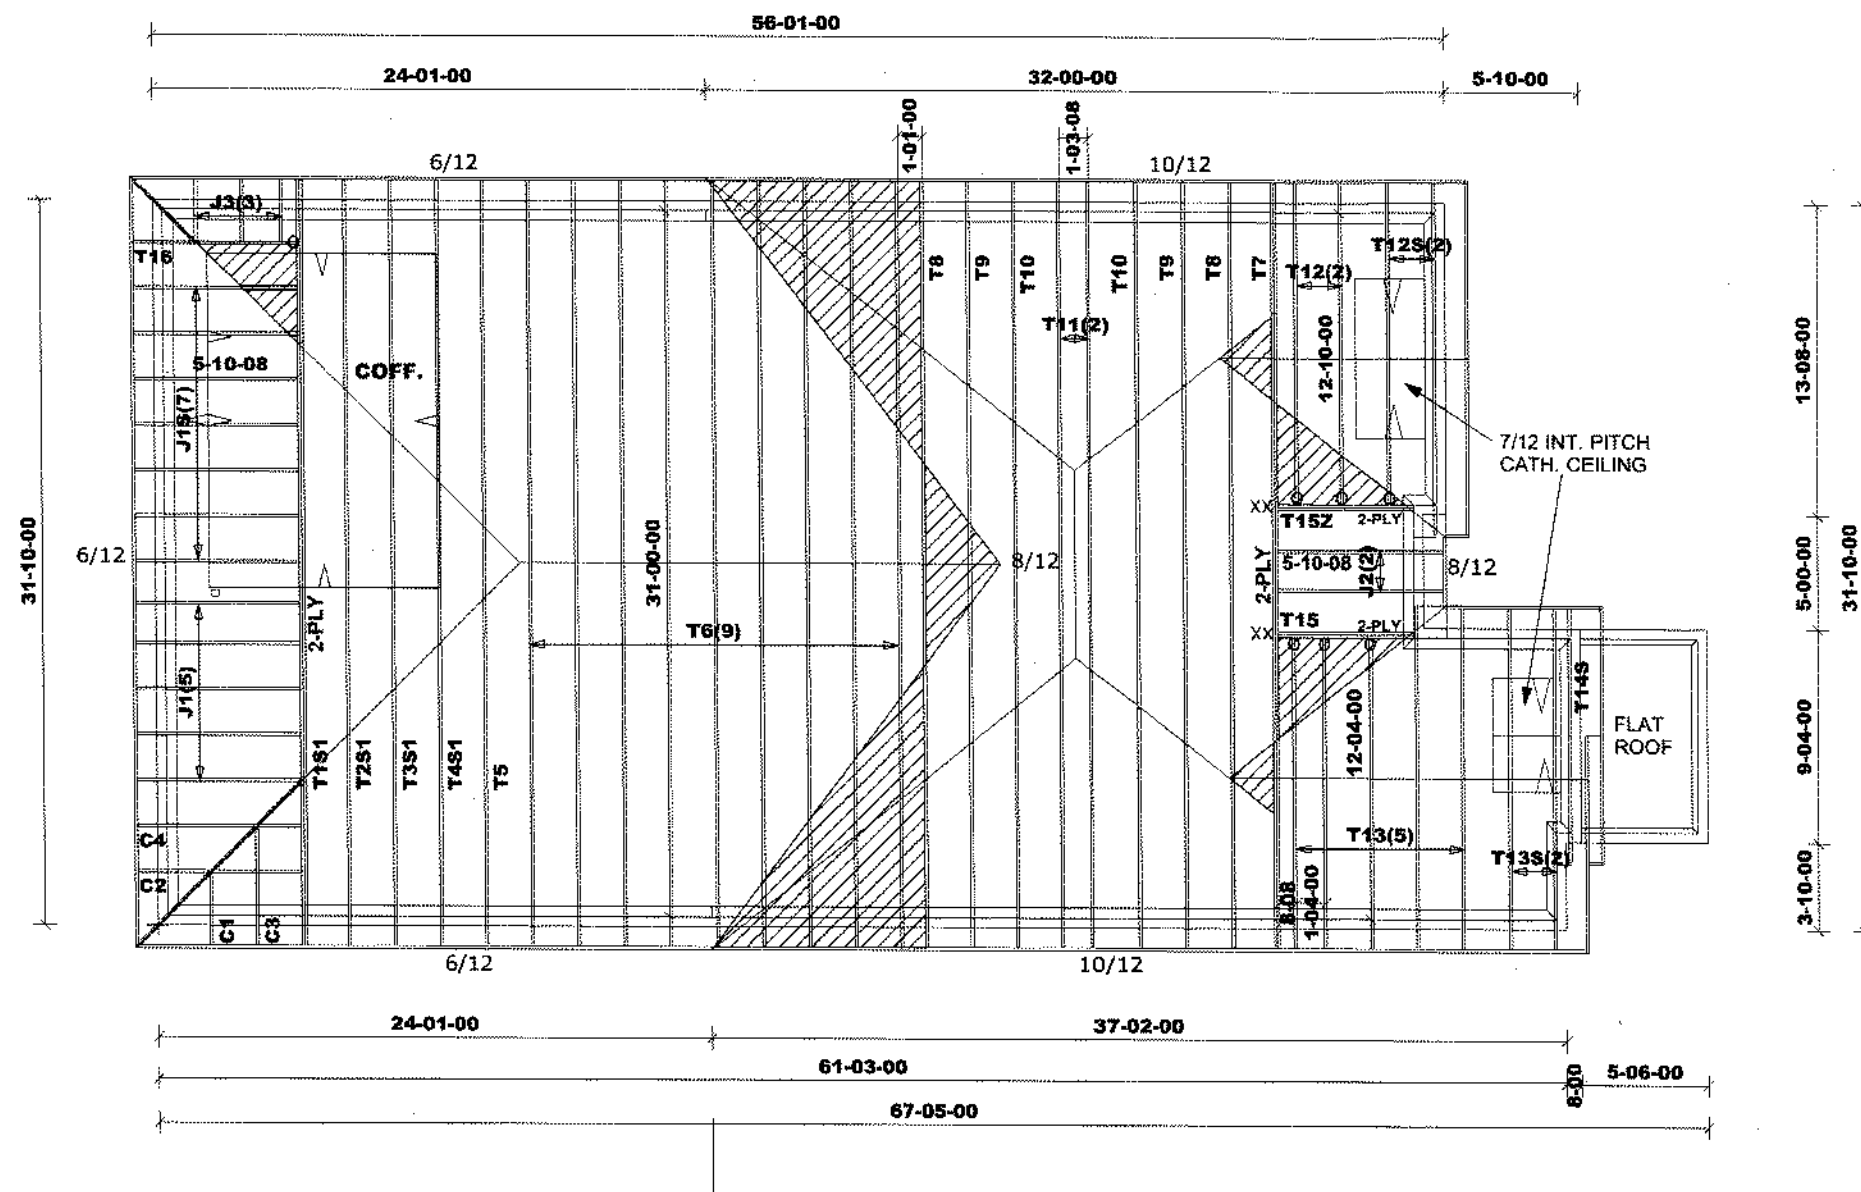

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

10/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.


 **DENOTES:**
CONVENTIONAL
FRAMING

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

DWG# TR22070325 TO TR22070347
DWG# TR22070352 TO TR22070355

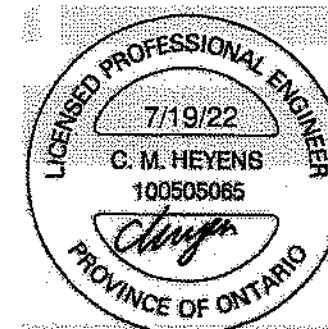

STRUCTURAL COMPONENTS ONLY
DWG# TR22070390

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424088**
Plan Log: **205681**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22
Designer:


Model / Elevation: **UNIT 4001 / A 5 BED OPT RAISED CEILING**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

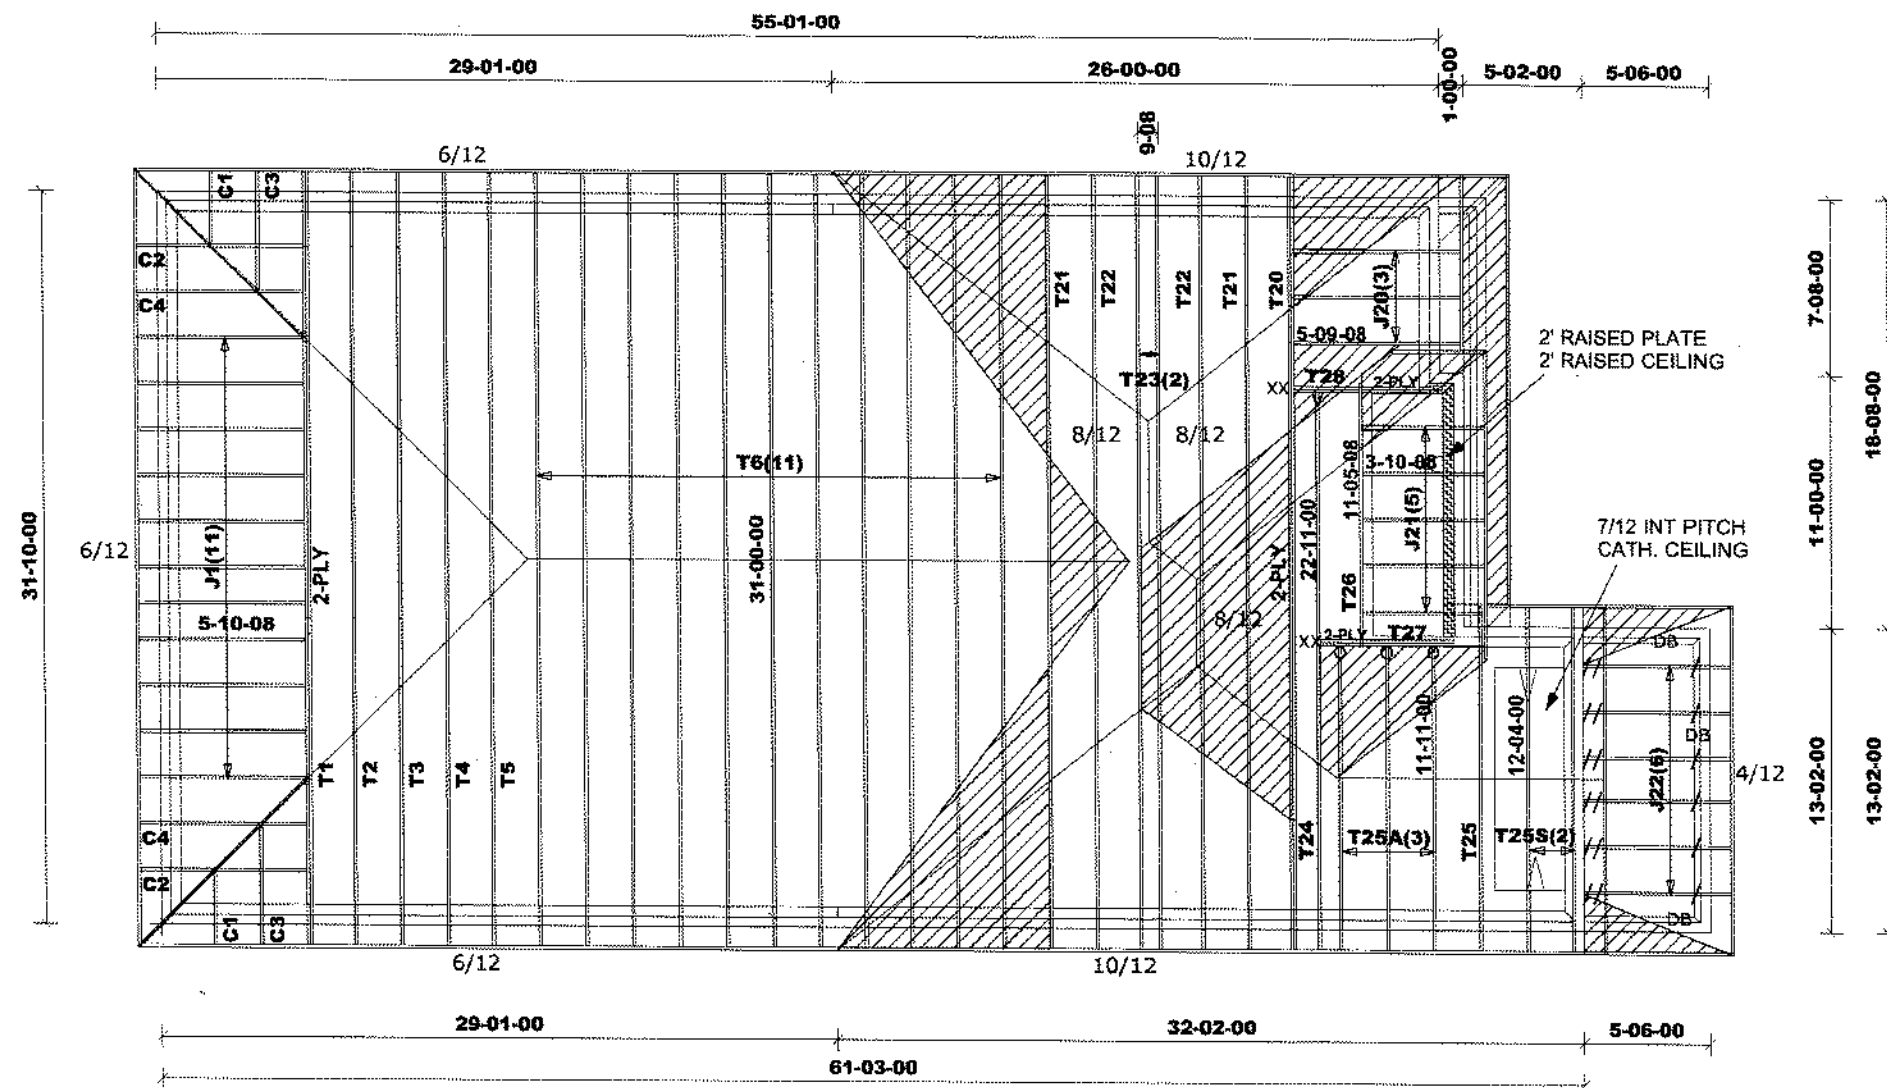

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

10/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

 **DENOTES:**
CONVENTIONAL
FRAMING


DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)
H2.5T - (I)

DB - DROPPED BEAMS BY OTHERS

DWG# TR22070321 TO TR22070331
DWG# TR22070356 TO TR22070369

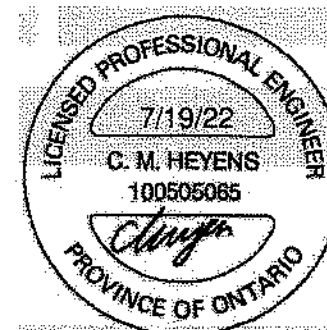

STRUCTURAL COMPONENTS ONLY
DWG# TR22070391

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424089**
Plan Log: **205681**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22
Designer:

Model / Elevation: **UNIT 4001 / B STD (4 OR 5 BED)**
Mitek ver 6.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

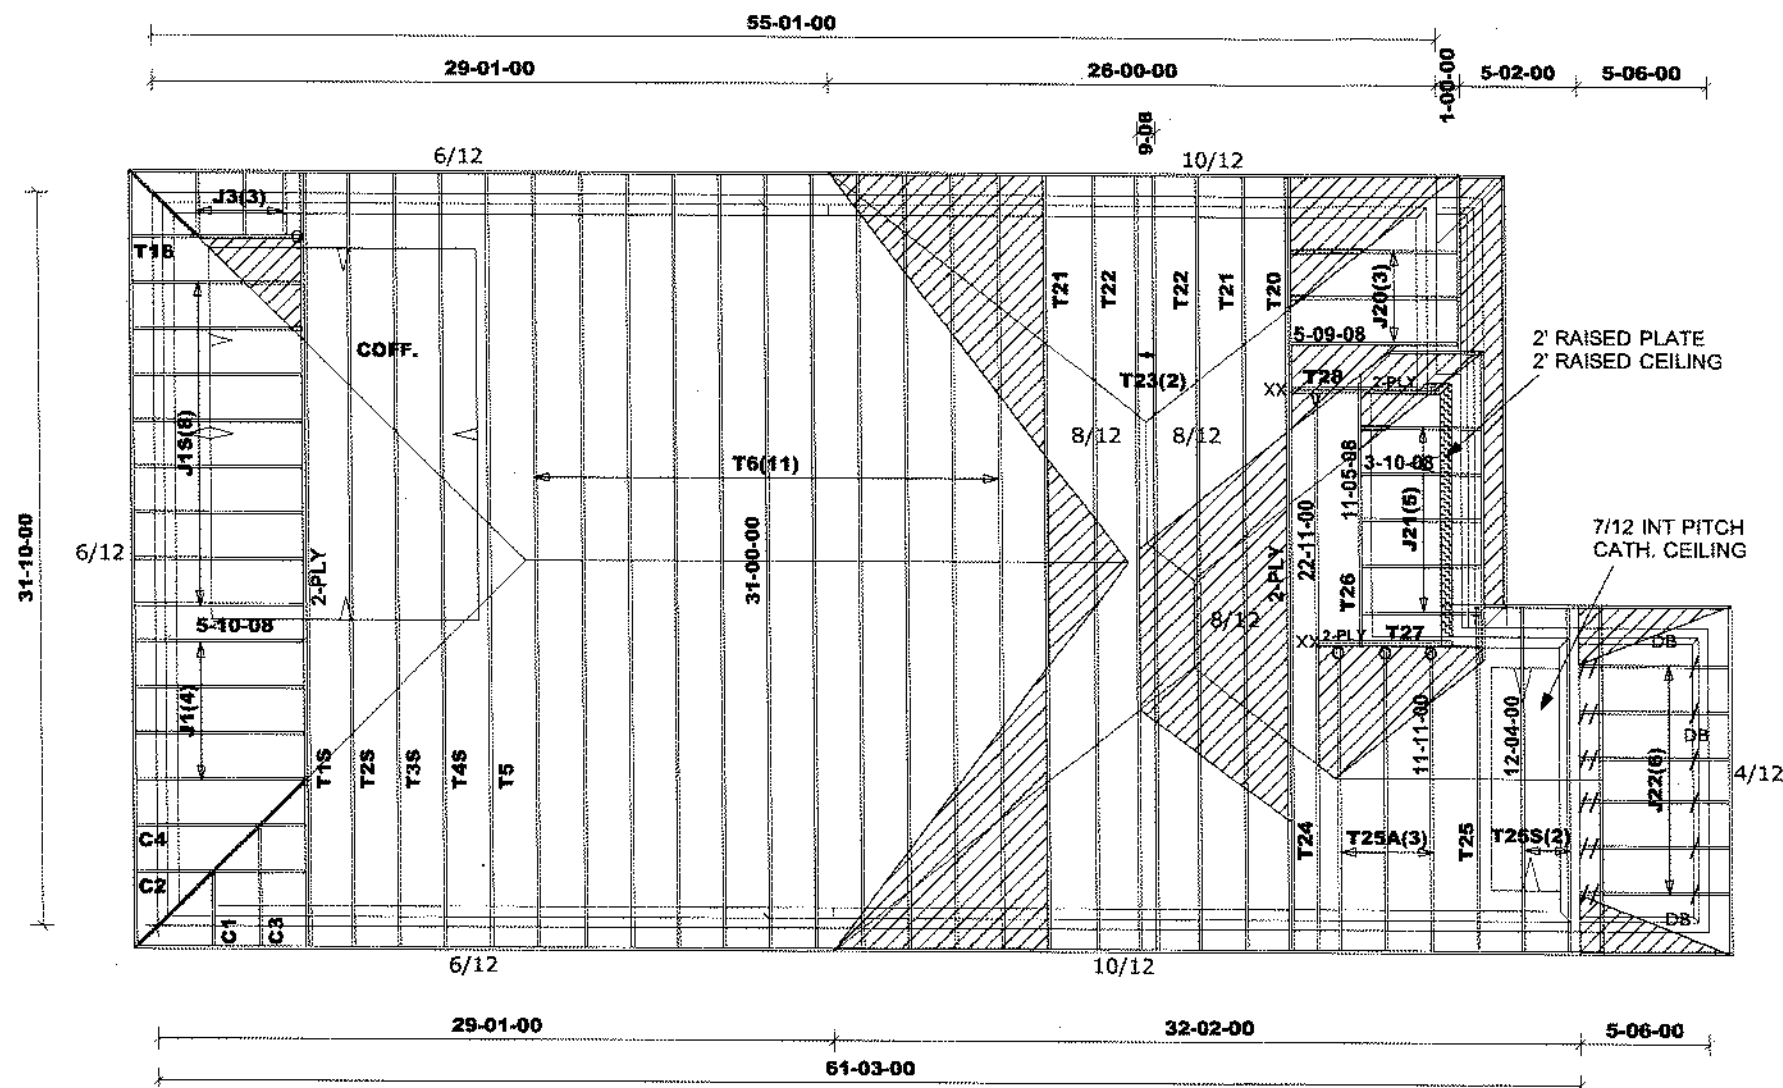

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

10/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

 **DENOTES:**
CONVENTIONAL
FRAMING


DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)
H2.5T - (I)

DB - DROPPED BEAMS BY OTHERS

DWG# TR22070325 TO TR22070331
DWG# TR22070345 TO TR22070351
DWG# TR22070356 TO TR22070369

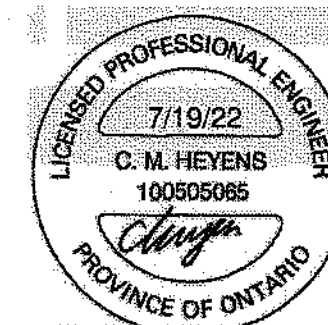

STRUCTURAL COMPONENTS ONLY
DWG# TR22070392

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.


Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424090**
Plan Log: **205681**

Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22 Designer:

Model / Elevation: **UNIT 4001 / B 4 BED OPT RAISED CEILING**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

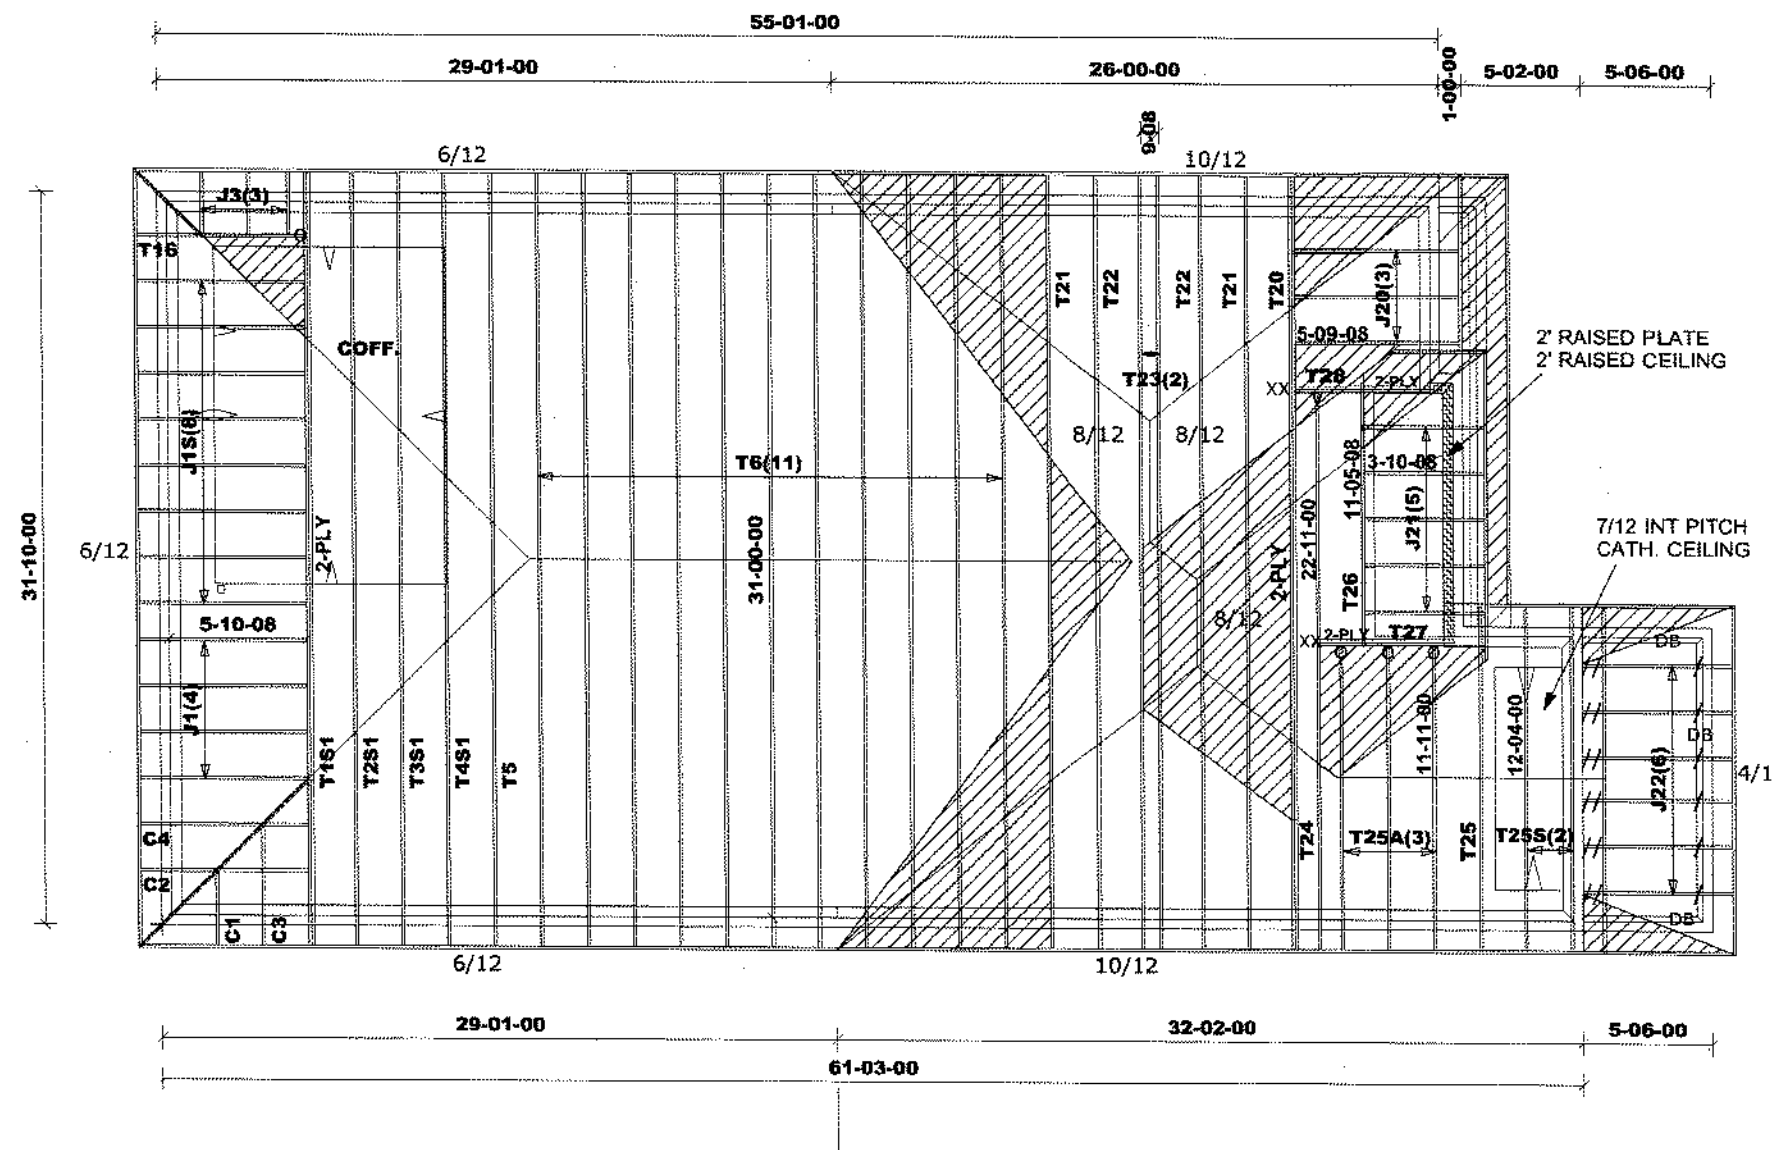

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

10/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

 **DENOTES:**
CONVENTIONAL
FRAMING

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)
H2.5T - (J)

DB - DROPPED BEAMS BY OTHERS

DWG# TR22070325 TO TR22070331
DWG# TR22070345 TO TR22070347
DWG# TR22070352 TO TR22070369



STRUCTURAL COMPONENTS ONLY
DWG# TR22070393

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.


Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424091**
Plan Log: **205681**

Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22 Designer:


Model / Elevation: **UNIT 4001 / B 5 BED OPT RAISED CEILING**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

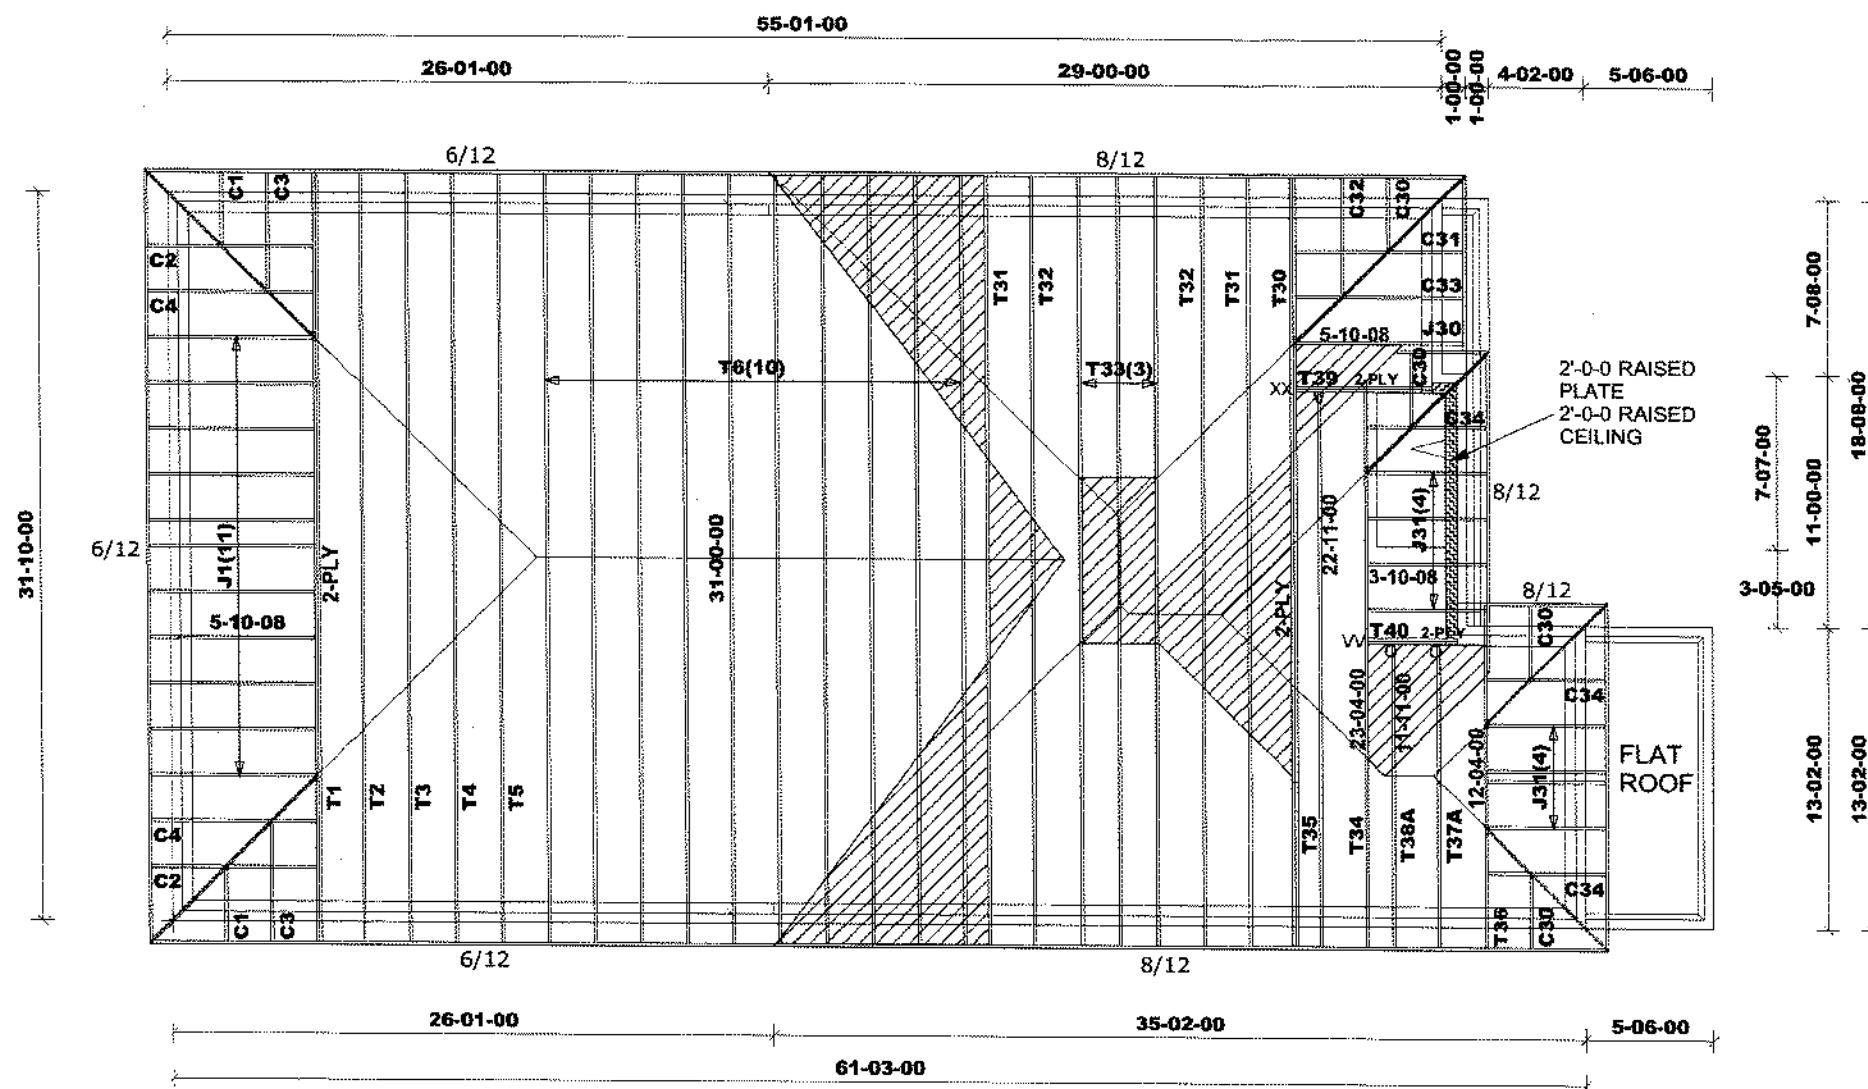

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

8/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.


 **DENOTES:**
CONVENTIONAL
FRAMING

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

DWG# TR22070321 TO TR22070331
DWG# TR22070370 TO TR22070387

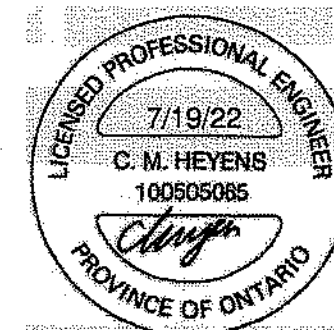

STRUCTURAL COMPONENTS ONLY
DWG# TR22070394

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424092**
Plan Log: **205681**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22
Designer:

Model / Elevation: **UNIT 4001 / C STD (4 OR 5 BED)**
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

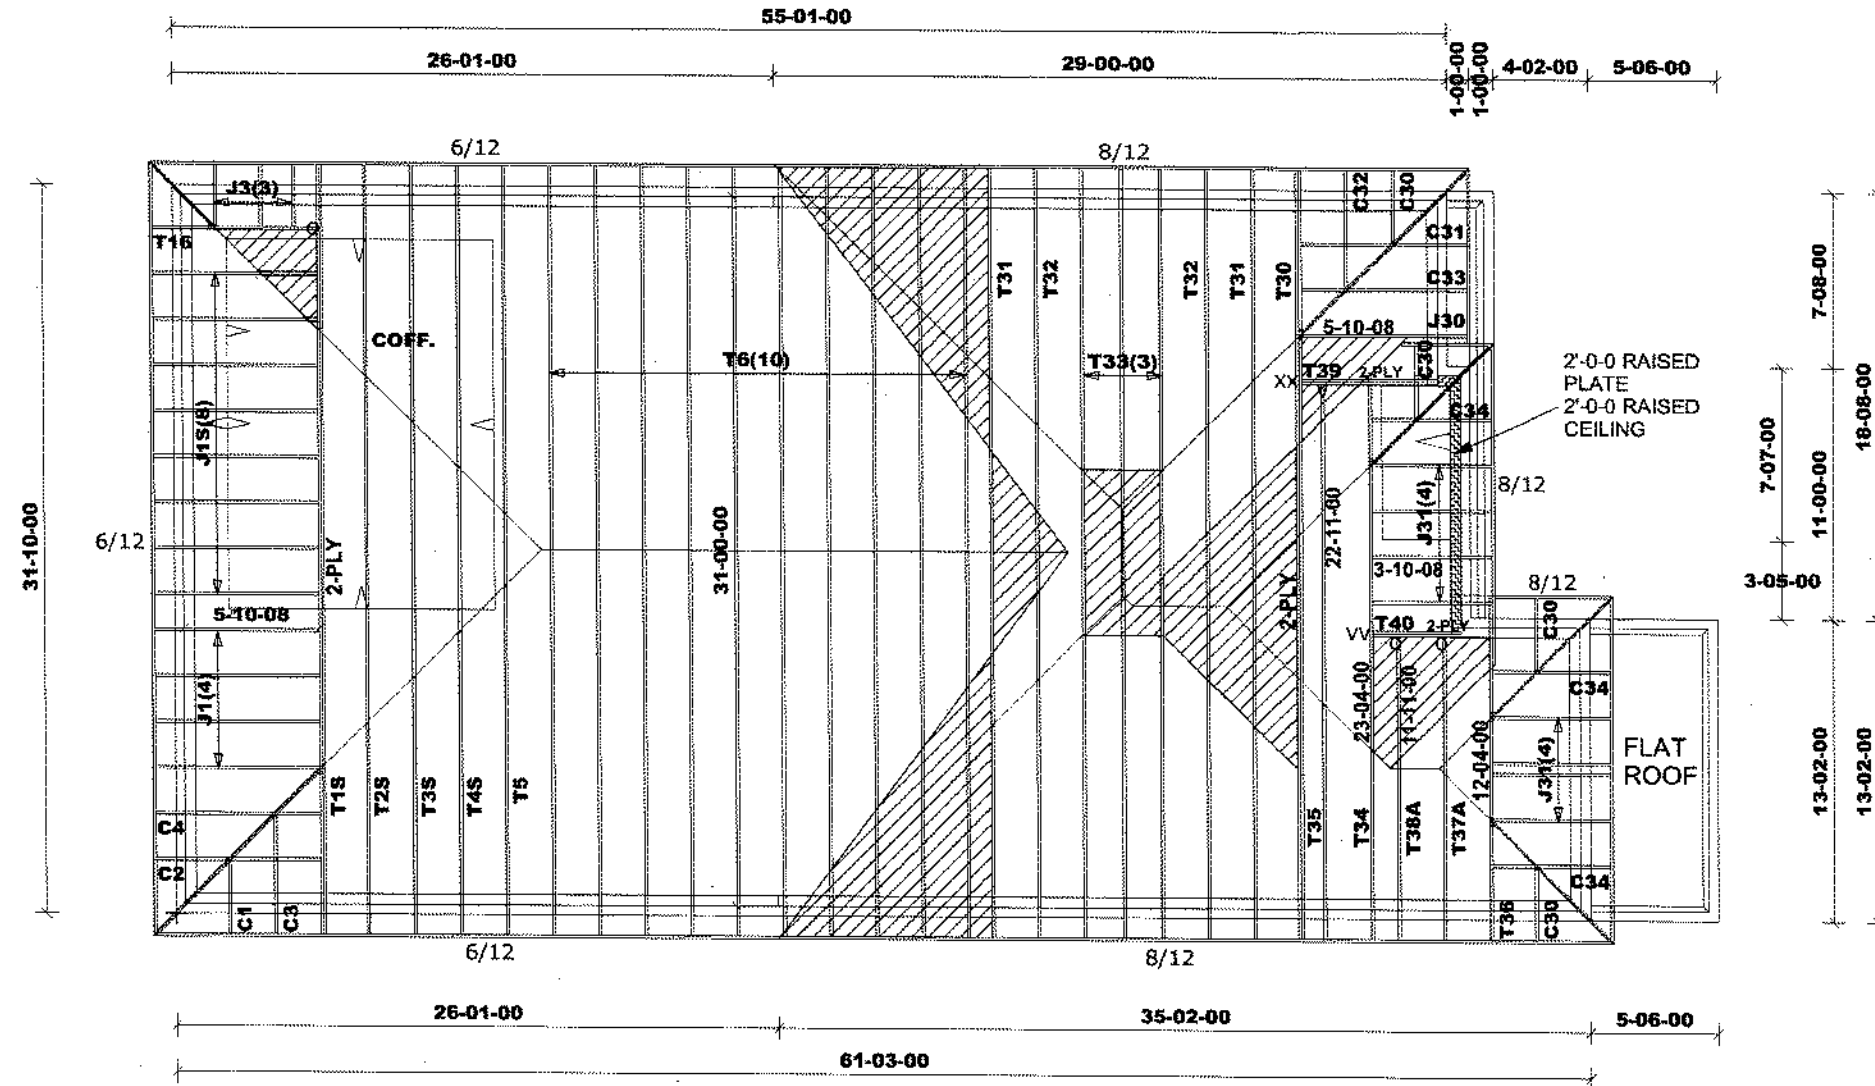

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

8/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.


 **DENOTES:**
CONVENTIONAL
FRAMING

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

DWG# TR22070325 TO TR22070331
DWG# TR22070345 TO TR22070351
DWG# TR22070370 TO TR22070387

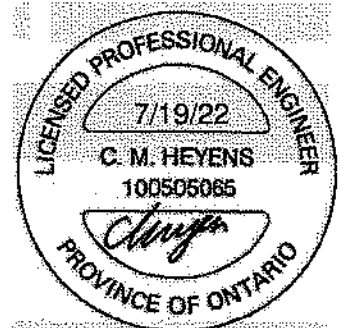

STRUCTURAL COMPONENTS ONLY
DWG# TR22070395

TRUSS PLACEMENT PLAN.


This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



Job Track: **52647**
Layout ID: **424093**
Plan Log: **205681**
Builder / Location: **ROYAL PINE HOMES / BRAMPTON**
Project: **FORESTSIDE ESTATES**
Date: 7/19/22 Designer:

Model / Elevation: **UNIT 4001 / C 4 BED OPT RAISED CEILING**
Mitek ver 6.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

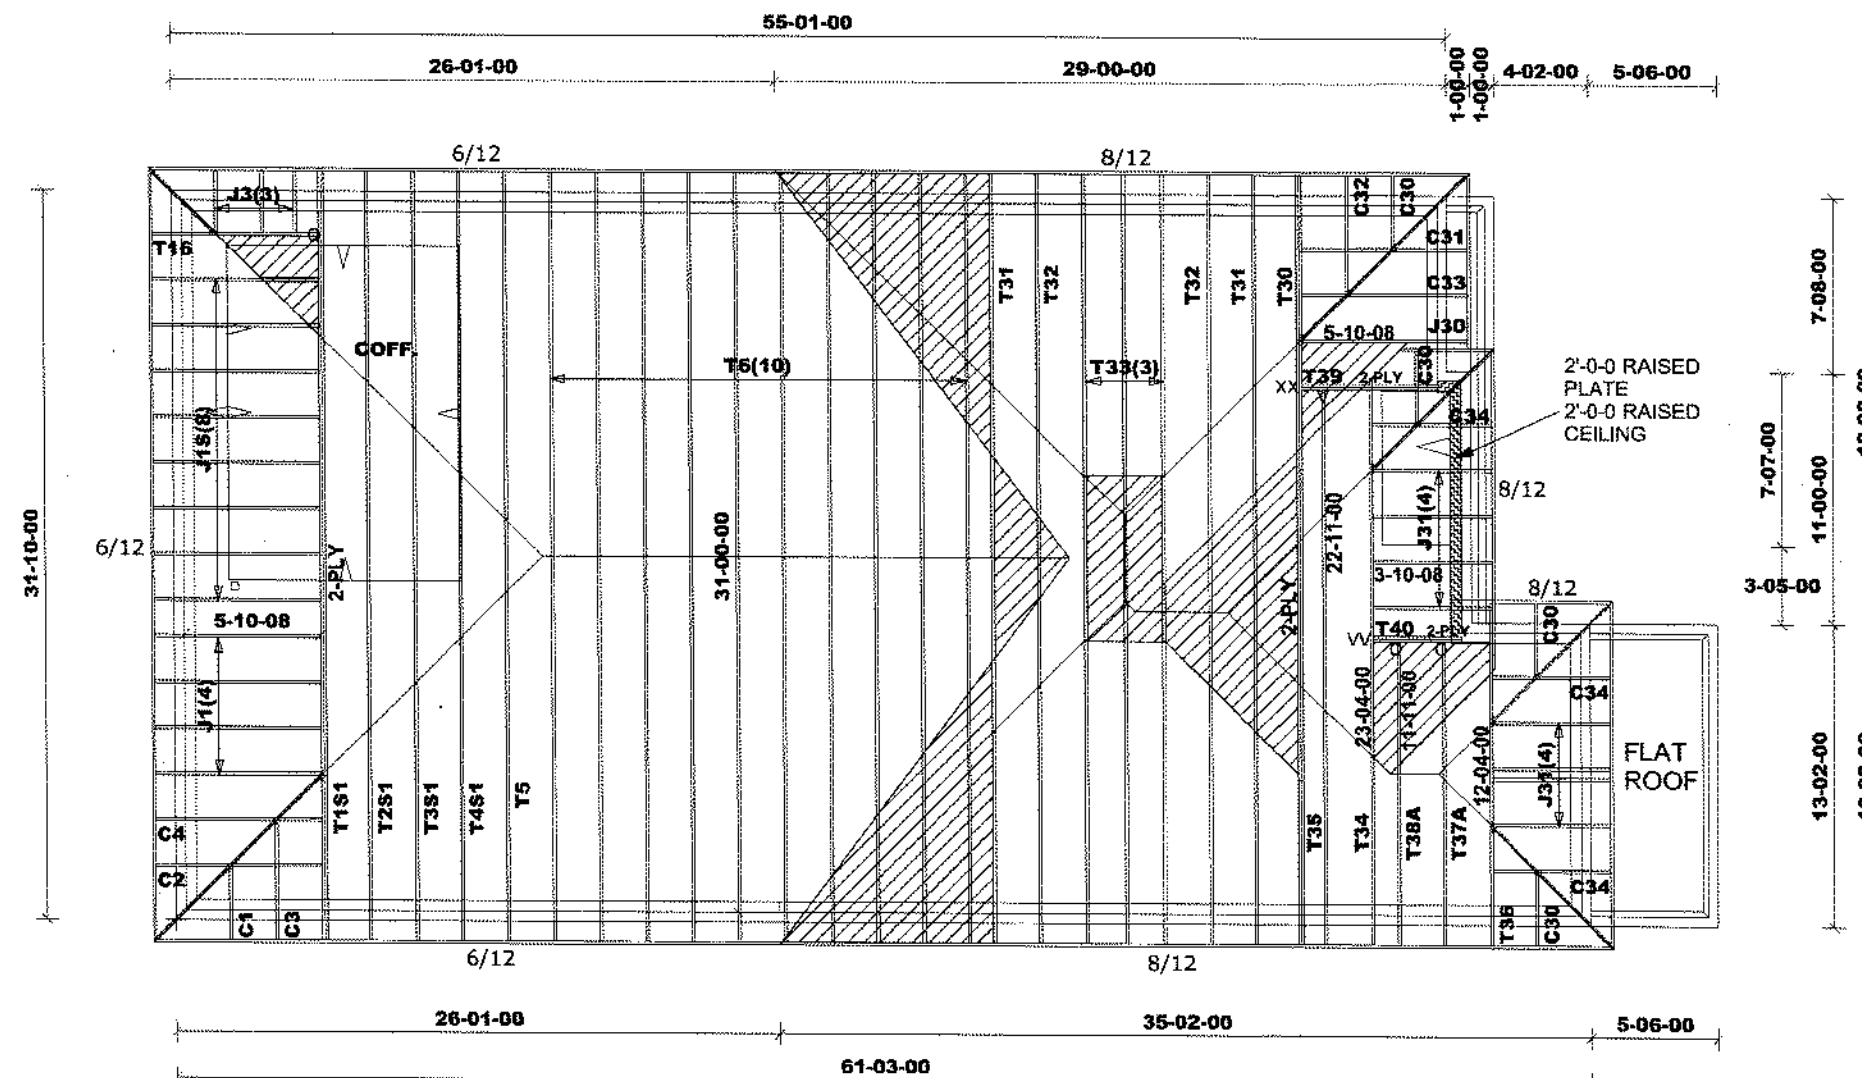

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

8/12 ROOF PITCHES UNLESS
OTHERWISE NOTED

All conventional framing to conform with
Part 9 of O.B.C. 2012. Roof rafters that
cross over or meet trusses to be min. 2x4
SPF #2 @ 24" o/c with a vertical post to the
truss at each cross point. Vertical posts
longer than 6' to have lateral bracing so that
the distance between the post end points
and lateral bracing does not exceed 6'.

 **DENOTES:**
CONVENTIONAL
FRAMING

DESIGN CONFORMS WITH OBC
2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)
HGUS26-2 - (XX)

DWG# TR22070325 TO TR22070331
DWG# TR22070345 TO TR22070347
DWG# TR22070352 TO TR22070355
DWG# TR22070370 TO TR22070387




STRUCTURAL COMPONENTS ONLY
DWG# TR22070396

TRUSS PLACEMENT PLAN.
This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.
Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.

	Job Track: 52647	Builder / Location: ROYAL PINE HOMES / BRAMPTON	Model / Elevation: UNIT 4001 / C 5 BED OPT RAISED CEILING	Mitak ver 8.5.3.293
	Layout ID: 424094	Project: FORESTSIDE ESTATES	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
	Plan Log: 205681	Date: 7/19/22	Designer:	

DELIVERY SHIPLIST

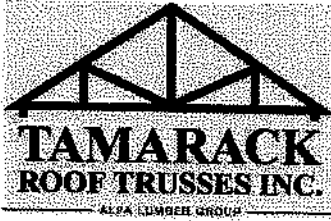


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A STD (4 OR 5 BED)

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424086
 Ref #
 Page: 1 of 2
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.61 178.67		
	1	T2 Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	127.75 80.83		
	1	T3 Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.08 77.67		
	1	T4 Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.88 80.67		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	9	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1159.81 718.50		
	1 2-ply	T7 Hip Girder	10 /12	31-00-00	5-04-04	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	409.18 246.67		
	2	T8 Hip	10 /12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	268.17 169.67		
	2	T9 Hip	10 /12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304.91 191.00		
	2	T10 Hip	10 /12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	315.59 195.67		
	2	T11 Hip	10 /12	31-00-00	10-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	353.58 222.67		
	2	T12 Common	10 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	122.84 79.00		
	2	T12S Roof Special	10 /12 7 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	123.61 83.00		
	5	T13 Common	10 /12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.11 190.83		

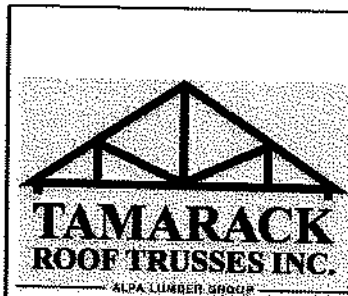

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A STD (4 OR 5 BED)

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424086
 Ref #
 Page: 2 of 2
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T13S Roof Special	10 / 12 7 / 12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	130.06 88.33		
	1	T14S Roof Special	10 / 12 7 / 12	8-06-00	5-02-03	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	44.18 31.33		
	1 2-ply	T15 Monopitch Girder	8 / 12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	1 2-ply	T15Z Monopitch Girder	8 / 12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	11	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	2	J2 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	38.39 23.33		
	2	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		

TOTAL # TRUSS= 62

TOTAL BFT OF ALL TRUSSES= 2997.33

BFT.


TOTAL WEIGHT OF ALL TRSSES 4770.35 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
6	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 8

DELIVERY SHIPLIST

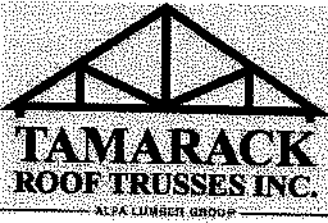

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424087
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	302.04 194.33		
	1	T2S Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	133 85.33		
	1	T3S Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	138.11 87.83		
	1	T4S Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	143.71 91.33		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	9	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1159.81 718.50		
	1 2-ply	T7 Hip Girder	10 /12	31-00-00	5-04-04	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	409.18 246.67		
	2	T8 Hip	10 /12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	268.17 169.67		
	2	T9 Hip	10 /12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304.91 191.00		
	2	T10 Hip	10 /12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	315.59 196.67		
	2	T11 Hip	10 /12	31-00-00	10-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	353.58 222.67		
	2	T12 Common	10 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	122.84 79.00		
	2	T12S Roof Special	10 /12 7 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	123.61 83.00		
	5	T13 Common	10 /12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	287.11 190.83		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424087
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T13S Roof Special	10 / 12 7 / 12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	130.06 88.33		
	1	T14S Roof Special	10 / 12 7 / 12	8-06-00	5-02-03	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	44.18 31.33		
	1 2-ply	T15 Monopitch Girder	8 / 12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	1 2-ply	T15Z Monopitch Girder	8 / 12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	1	T16 Half Hip Girder	6 / 12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	4	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	168.46 117.33		
	2	J2 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	38.39 23.33		
	3	J3 Jack-Open	6 / 12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	1	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		

TOTAL # TRUSS= 63

TOTAL BFT OF ALL TRUSSES= 3084.82

BFT. TOTAL WEIGHT OF ALL TRSSES 4871.73 LBS

DELIVERY SHIPLIST

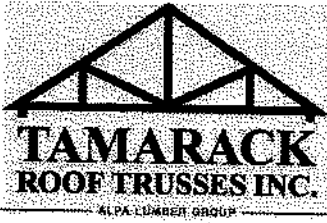

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 4 BED W/OPT COFF


Job Track: 52647
 Plan Log: 205681
 Layout ID: 424087
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 9

DELIVERY SHIPLIST

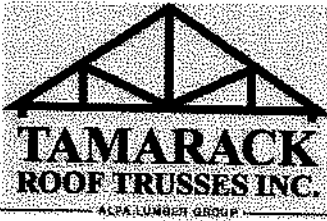

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424088
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S1 Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	299.04 192.33		
	1	T2S1 Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	134.68 86.17		
	1	T3S1 Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	139.7 89.67		
	1	T4S1 Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	145.42 92.67		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	9	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1159.81 718.50		
	1 2-ply	T7 Hip Girder	10 /12	31-00-00	5-04-04	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	409.18 246.67		
	2	T8 Hip	10 /12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	268.17 169.67		
	2	T9 Hip	10 /12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304.91 191.00		
	2	T10 Hip	10 /12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	315.59 195.67		
	2	T11 Hip	10 /12	31-00-00	10-07-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	353.58 222.67		
	2	T12 Common	10 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	122.84 79.00		
	2	T12S Roof Special	10 /12 7 /12	12-10-00	6-11-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	123.61 83.00		
	5	T13 Common	10 /12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	297.11 190.83		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424088
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T13S Roof Special	10/12 7/12	12-04-00	6-09-05	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	130.06 88.33		
	1	T14S Roof Special	10/12 7/12	8-06-00	5-02-03	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	44.18 31.33		
	1 2-ply	T15 Monopitch Girder	8/12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	1 2-ply	T15Z Monopitch Girder	8/12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.47 41.33		
	1	T16 Half Hip Girder	6/12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	5	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	83.97 53.33		
	7	J1S Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	147.4 102.67		
	2	J2 Jack-Open	8/12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	38.39 23.33		
	3	J3 Jack-Open	6/12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	1	C1 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6/12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6/12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		


TOTAL # TRUSS= 63

TOTAL BFT OF ALL TRUSSES= 3082.84

BFT.

TOTAL WEIGHT OF ALL TRSSES 4869.46 LBS

DELIVERY SHIPLIST

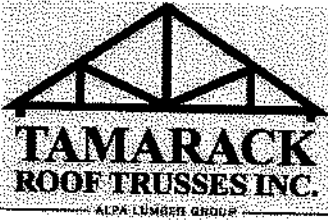

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: A 5 BED W/OPT COFF


Job Track: 52647
 PlanLog: 205681
 Layout ID: 424088
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 9

DELIVERY SHIPLIST

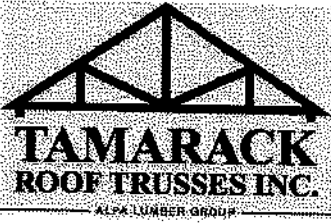


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B STD (4 OR 5 BED)

Job Track: 52647
 Plan Log: 205681
 Layout ID: 424089
 Ref #
 Page: 1 of 2
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.61 178.67		
	1	T2 Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	127.75 80.83		
	1	T3 Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.08 77.67		
	1	T4 Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.88 80.67		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	11	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1417.55 878.17		
	1 2-ply	T20 Hip Girder	10 /12	31-00-00	5-03-09	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	407.48 249.33		
	2	T21 Hip	10 /12	31-00-00	6-07-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	267.46 171.00		
	2	T22 Hip	10 /12	31-00-00	7-11-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304 191.00		
	2	T23 Hip	10 /12	31-00-00	9-01-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	313.39 195.67		
	1	T24 Hip Girder	10 /12	22-11-00	7-02-13	2 x 4 2 x 6	1-03-08	1-07-11 3-11-14	130.61 83.00		
	1	T25 Common	10 /12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	59.43 38.17		
	3	T25A Common	10 /12	11-11-00	6-09-06	2 x 4	1-03-08	1-07-11 1-11-14	169.85 108.50		
	2	T25S Roof Special	10 /12 7 /12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	115.84 77.33		

DELIVERY SHIPLIST

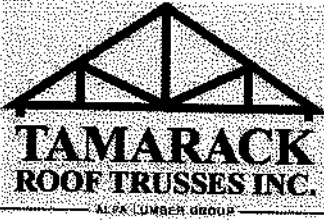

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B STD (4 OR 5 BED)

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424089
 Ref #
 Page: 2 of 2
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY	MARK	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG	HEEL HEIGHT	LBS.	BUNDLE #	LOAD BY
	PLY	TYPE					LEFT RIGHT	LEFT RIGHT	BFT.	STACK #	REMARKS
	1	T26 Half Hip Girder	10 / 12	11-05-08	3-11-13	2 x 4		1-07-11 3-11-13	49.94 32.83		
	1 2-ply	T27 Flat Girder	0 / 12	5-09-00	2-00-00	2 x 6		2-00-00 2-00-00	56.73 37.33		
	1 2-ply	T28 Flat Girder	0 / 12	5-09-08	2-00-00	2 x 6		2-00-00 2-00-00	57.1 37.33		
	11	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	3	J20 Jack-Open	8 / 12	5-09-08	5-03-02	2 x 4	1-03-08	1-04-13 5-03-02	56.94 35.00		
	5	J21 Jack-Open	8 / 12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	70.85 45.00		
	6	J22 Jack-Open	4 / 12	5-01-00	2-08-08	2 x 4	1-03-08	3-15 2-00-04	93.13 56.00		
	2	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		

TOTAL # TRUSS= 70

TOTAL BFT OF ALL TRUSSES= 2910.33

BFT.


TOTAL WEIGHT OF ALL TRSSES 4642.28 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LUS24	
1	Hardware	LJS26DS	
2	Hardware	HGUS26-2	
18	Hardware	H2.5T	

TOTAL NUMBER OF ITEMS= 24

DELIVERY SHIPLIST

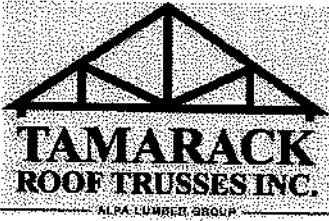

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424090
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	302.04 194.33		
	1	T2S Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	133 85.33		
	1	T3S Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	138.11 87.83		
	1	T4S Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	143.71 91.33		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	11	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1417.55 878.17		
	1	T16 Half Hip Girder	6 /12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	1 2-ply	T20 Hip Girder	10 /12	31-00-00	5-03-09	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	407.48 249.33		
	2	T21 Hip	10 /12	31-00-00	6-07-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	267.45 171.00		
	2	T22 Hip	10 /12	31-00-00	7-11-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304 191.00		
	2	T23 Hip	10 /12	31-00-00	9-01-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	313.39 195.67		
	1	T24 Hip Girder	10 /12	22-11-00	7-02-13	2 x 4 2 x 6	1-03-08	1-07-11 3-11-14	130.61 83.00		
	1	T25 Common	10 /12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	59.43 38.17		
	3	T25A Common	10 /12	11-11-00	6-09-06	2 x 4	1-03-08	1-07-11 1-11-14	169.85 108.50		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424090
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T25S Roof Special	10 / 12 7 / 12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	115.84 77.33		
	1	T26 Half Hip Girder	10 / 12	11-05-08	3-11-13	2 x 4		1-07-11 3-11-13	49.94 32.83		
	1 2-ply	T27 Flat Girder	0 / 12	5-09-00	2-00-00	2 x 6		2-00-00 2-00-00	56.73 37.33		
	1 2-ply	T28 Flat Girder	0 / 12	5-09-08	2-00-00	2 x 6		2-00-00 2-00-00	57.1 37.33		
	4	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	168.46 117.33		
	3	J3 Jack-Open	6 / 12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	3	J20 Jack-Open	8 / 12	5-09-08	5-03-02	2 x 4	1-03-08	1-04-13 5-03-02	56.94 35.00		
	5	J21 Jack-Open	8 / 12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	70.85 45.00		
	6	J22 Jack-Open	4 / 12	5-01-00	2-08-08	2 x 4	1-03-08	3-15 2-00-04	93.13 56.00		
	1	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424090
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
---------	------------	--------------	-------	------	--------	--------	---------------------------	------------------------------	--------------	---------------------	--------------------

TOTAL # TRUSS= 71

TOTAL BFT OF ALL TRUSSES= 2997.82


BFT.

TOTAL WEIGHT OF ALL TRSSES 4743.66 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	LUS24	
1	Hardware	LJS26DS	
2	Hardware	HGUS26-2	
18	Hardware	H2.5T	

TOTAL NUMBER OF ITEMS= 25

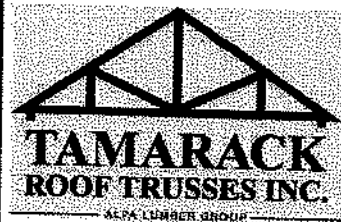

DELIVERY SHIPLIST


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424091
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S1 Hip Girder	6/12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	299.04 192.33		
	1	T2S1 Hip	6/12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	134.68 86.17		
	1	T3S1 Hip	6/12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	139.7 89.67		
	1	T4S1 Hip	6/12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	145.42 92.67		
	1	T5 Hip	6/12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 88.17		
	11	T6 Common	6/12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1417.55 878.17		
	1	T16 Half Hip Girder	6/12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	1 2-ply	T20 Hip Girder	10/12	31-00-00	5-03-09	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	407.48 249.33		
	2	T21 Hip	10/12	31-00-00	6-07-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	267.45 171.00		
	2	T22 Hip	10/12	31-00-00	7-11-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	304 191.00		
	2	T23 Hip	10/12	31-00-00	9-01-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	313.39 195.67		
	1	T24 Hip Girder	10/12	22-11-00	7-02-13	2 x 4 2 x 6	1-03-08	1-07-11 3-11-14	130.61 83.00		
	1	T25 Common	10/12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	59.43 38.17		
	3	T25A Common	10/12	11-11-00	6-09-06	2 x 4	1-03-08	1-07-11 1-11-14	169.85 108.50		

DELIVERY SHIPLIST

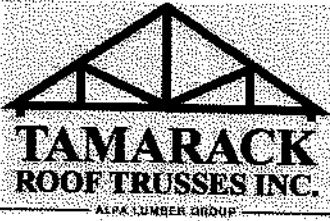


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: B 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424091
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T25S Roof Special	10 / 12 7 / 12	12-04-00	6-09-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	115.84 77.33		
	1	T26 Half Hip Girder	10 / 12	11-05-08	3-11-13	2 x 4		1-07-11 3-11-13	49.94 32.83		
	1 2-ply	T27 Flat Girder	0 / 12	5-09-00	2-00-00	2 x 6		2-00-00 2-00-00	56.73 37.33		
	1 2-ply	T28 Flat Girder	0 / 12	5-09-08	2-00-00	2 x 6		2-00-00 2-00-00	57.1 37.33		
	4	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	168.46 117.33		
	3	J3 Jack-Open	6 / 12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	3	J20 Jack-Open	8 / 12	5-09-08	5-03-02	2 x 4	1-03-08	1-04-13 5-03-02	56.94 35.00		
	5	J21 Jack-Open	8 / 12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	70.85 45.00		
	6	J22 Jack-Open	4 / 12	5-01-00	2-08-08	2 x 4	1-03-08	3-15 2-00-04	93.13 56.00		
	1	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		

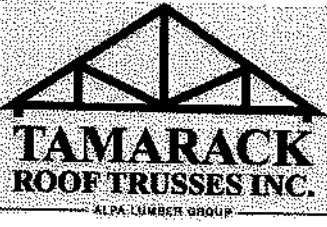		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: FORESTSIDE ESTATES Location: BRAMPTON Model: UNIT 4001 Lot #: Elevation: B 5 BED W/OPT COFF	Job Track: 52647 PlanLog: 205681 Layout ID: 424091 Ref # Page: 3 of 3 Date: 07-21-2022 Designer: Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
---------	------------	--------------	-------	------	--------	--------	---------------------------	------------------------------	--------------	---------------------	--------------------


TOTAL # TRUSS= 71 TOTAL BFT OF ALL TRUSSES= 2999.84 BFT. TOTAL WEIGHT OF ALL TRSSES 4745.65 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	LUS24	
1	Hardware	LJS26DS	
2	Hardware	HCUS26-2	
18	Hardware	H2.5T	

TOTAL NUMBER OF ITEMS= 25

DELIVERY SHIPLIST

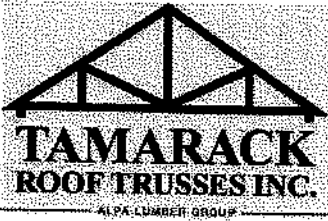


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C STD (4 OR 5 BED)

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424092
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.61 178.67		
	1	T2 Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	127.75 80.83		
	1	T3 Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	123.08 77.67		
	1	T4 Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.88 80.67		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	10	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1288.68 798.33		
	1 2-ply	T30 Hip Girder	8 /12	31-00-00	5-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	407.85 249.33		
	2	T31 Hip	8 /12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	264.09 170.33		
	2	T32 Hip	8 /12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	281.16 182.00		
	3	T33 Hip	8 /12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	449.28 287.50		
	1	T34 Hip Girder	8 /12	23-04-00	5-11-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	133.73 86.67		
	1	T35 Hip	8 /12	22-11-00	7-03-13	2 x 4	1-03-08	1-04-13 3-08-02	107.98 67.50		
	1	T36 Hip Girder	8 /12	12-04-00	3-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	52.03 33.67		
	1	T37A Hip	8 /12	11-11-00	5-03-13	2 x 4	1-03-08	1-04-13 1-08-02	47.58 29.83		

DELIVERY SHIPLIST

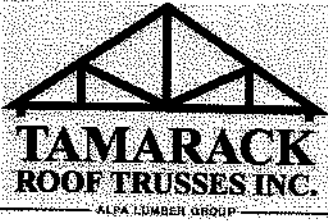


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C STD (4 OR 5 BED)

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424092
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T38A Common	8 / 12	11-11-00	5-06-02	2 x 4	1-03-08	1-04-13 1-08-02	47.83 30.50		
	1 2-ply	T39 Monopitch Girder	0 / 12	5-10-08	2-00-00	2 x 6		2-00-00 2-00-00	57.82 37.33		
	1 2-ply	T40 Monopitch Girder	8 / 12	3-10-08	5-11-13	2 x 4 2 x 6		3-04-13 5-11-13	50.14 31.67		
	11	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	1	J30 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	19.19 11.67		
	8	J31 Jack-Open	8 / 12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	113.35 72.00		
	2	C1 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	C2 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	C3 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	C4 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	4	C30 Jack-Open	8 / 12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	36.11 22.67		
	1	C31 Jack-Open	8 / 12	1-09-07	2-07-02	2 x 4	1-03-08 4-01-01	1-04-13 2-07-02	13.59 8.33		
	1	C32 Jack-Open	8 / 12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	11.77 7.67		
	1	C33 Jack-Open	8 / 12	3-09-07	3-11-02	2 x 4	1-03-08 2-01-01	1-04-13 3-11-02	16.33 10.33		

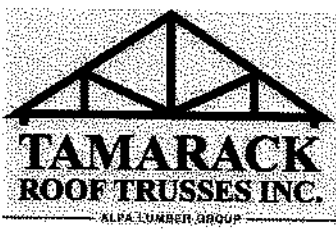		DELIVERY SHIPLIST	
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track: 52647
	Builder:	ROYAL PINE HOMES	PlanLog: 205681
	Project:	FORESTSIDE ESTATES	Layout ID: 424092
	Location:	BRAMPTON	Ref #
	Model:	UNIT 4001	Page: 3 of 3
	Lot #:		Date: 07-21-2022
Elevation:	C STD (4 OR 5 BED)	Designer:	
		Sales Rep:	Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	C34 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 2-01-01	1-04-13 2-07-02	33.92 21.00		

TOTAL # TRUSS= 72

TOTAL BFT OF ALL TRUSSES= 2833

BFT.


TOTAL WEIGHT OF ALL TRSSES 4504.38 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
2	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 5

DELIVERY SHIPLIST

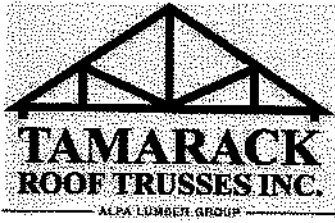

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424093
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S Hip Girder	6 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	302.04 194.33		
	1	T2S Hip	6 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	133 85.33		
	1	T3S Hip	6 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	138.11 87.83		
	1	T4S Hip	6 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	143.71 91.33		
	1	T5 Hip	6 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	10	T6 Common	6 /12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1288.68 798.33		
	1	T16 Half Hip Girder	6 /12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	1 2-ply	T30 Hip Girder	8 /12	31-00-00	5-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	407.85 249.33		
	2	T31 Hip	8 /12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	264.09 170.33		
	2	T32 Hip	8 /12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	281.16 182.00		
	3	T33 Hip	8 /12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	449.28 297.50		
	1	T34 Hip Girder	8 /12	23-04-00	5-11-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	133.73 86.67		
	1	T35 Hip	8 /12	22-11-00	7-03-13	2 x 4	1-03-08	1-04-13 3-08-02	107.98 67.50		
	1	T36 Hip Girder	8 /12	12-04-00	3-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	52.03 33.67		



DELIVERY SHIPLIST


Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424093
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T37A Hip	8 /12	11-11-00	5-03-13	2 x 4	1-03-08	1-04-13 1-08-02	47.58 29.83		
	1	T38A Common	8 /12	11-11-00	5-06-02	2 x 4	1-03-08	1-04-13 1-08-02	47.83 30.50		
	1 2-ply	T39 Monopitch Girder	0 /12	5-10-08	2-00-00	2 x 6		2-00-00 2-00-00	57.82 37.33		
	1 2-ply	T40 Monopitch Girder	8 /12	3-10-08	5-11-13	2 x 4 2 x 6		3-04-13 5-11-13	50.14 31.67		
	4	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	170.01 112.00		
	3	J3 Jack-Open	6 /12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	1	J30 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	19.19 11.67		
	8	J31 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	113.36 72.00		
	1	C1 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		
	4	C30 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	36.11 22.67		

DELIVERY SHIPLIST

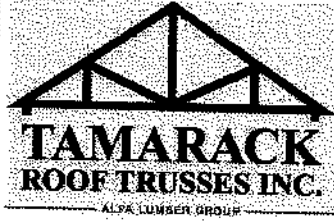

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 4 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424093
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C31 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 4-01-01	1-04-13 2-07-02	13.59 8.33		
	1	C32 Jack-Open	8 /12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	11.77 7.67		
	1	C33 Jack-Open	8 /12	3-09-07	3-11-02	2 x 4	1-03-08 2-01-01	1-04-13 3-11-02	16.33 10.33		
	3	C34 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 2-01-01	1-04-13 2-07-02	33.92 21.00		

TOTAL # TRUSS= 73

TOTAL BFT OF ALL TRUSSES= 2915.16

BFT.


TOTAL WEIGHT OF ALL TRSSES 4607.32 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 6

DELIVERY SHIPLIST

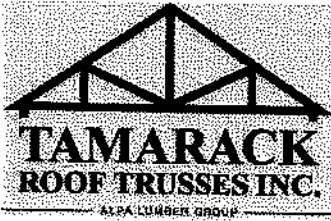

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424094
 Ref #
 Page: 1 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1S1 Hip Girder	6 / 12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	299.04 192.33		
	1	T2S1 Hip	6 / 12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	134.68 86.17		
	1	T3S1 Hip	6 / 12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	139.7 89.67		
	1	T4S1 Hip	6 / 12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	145.42 92.67		
	1	T5 Hip	6 / 12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.3 86.17		
	10	T6 Common	6 / 12	31-00-00	8-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1288.68 798.33		
	1	T16 Half Hip Girder	6 / 12	5-10-08	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	23.19 16.50		
	1 2-ply	T30 Hip Girder	8 / 12	31-00-00	5-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	407.85 249.33		
	2	T31 Hip	8 / 12	31-00-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	264.09 170.33		
	2	T32 Hip	8 / 12	31-00-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	281.16 182.00		
	3	T33 Hip	8 / 12	31-00-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	449.28 287.50		
	1	T34 Hip Girder	8 / 12	23-04-00	5-11-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	133.73 86.67		
	1	T35 Hip	8 / 12	22-11-00	7-03-13	2 x 4	1-03-08	1-04-13 3-08-02	107.98 67.50		
	1	T36 Hip Girder	8 / 12	12-04-00	3-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	52.03 33.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 5 BED W/OPT COFF

Job Track: 52647
 Plan Log: 205681
 Layout ID: 424094
 Ref #
 Page: 2 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T37A Hip	8 /12	11-11-00	5-03-13	2 x 4	1-03-08	1-04-13 1-08-02	47.58 29.83		
	1	T38A Common	8 /12	11-11-00	5-06-02	2 x 4	1-03-08	1-04-13 1-08-02	47.83 30.50		
	1 2-ply	T39 Monopitch Girder	0 /12	5-10-08	2-00-00	2 x 6		2-00-00 2-00-00	57.82 37.33		
	1 2-ply	T40 Monopitch Girder	8 /12	3-10-08	5-11-13	2 x 4 2 x 6		3-04-13 5-11-13	50.14 31.67		
	4	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	67.18 42.67		
	8	J1S Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 3-01-04	170.01 112.00		
	3	J3 Jack-Open	6 /12	1-05-00	1-10-08	2 x 4	1-03-08	1-02-00 1-10-08	18.08 14.00		
	1	J30 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	19.19 11.67		
	8	J31 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	113.35 72.00		
	1	C1 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	7.02 4.67		
	1	C2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	11.58 7.33		
	1	C3 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	9.57 6.00		
	1	C4 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	14.13 8.67		
	4	C30 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	36.11 22.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: FORESTSIDE ESTATES
 Location: BRAMPTON
 Model: UNIT 4001
 Lot #:
 Elevation: C 5 BED W/OPT COFF

Job Track: 52647
 PlanLog: 205681
 Layout ID: 424094
 Ref #
 Page: 3 of 3
 Date: 07-21-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C31 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 4-01-01	1-04-13 2-07-02	13.59 8.33		
	1	C32 Jack-Open	8 /12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	11.77 7.67		
	1	C33 Jack-Open	8 /12	3-09-07	3-11-02	2 x 4	1-03-08 2-01-01	1-04-13 3-11-02	16.33 10.33		
	3	C34 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 2-01-01	1-04-13 2-07-02	33.92 21.00		

TOTAL # TRUSS= 73

TOTAL BFT OF ALL TRUSSES= 2917.18


BFT.

TOTAL WEIGHT OF ALL TRSSES 4609.31 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 6

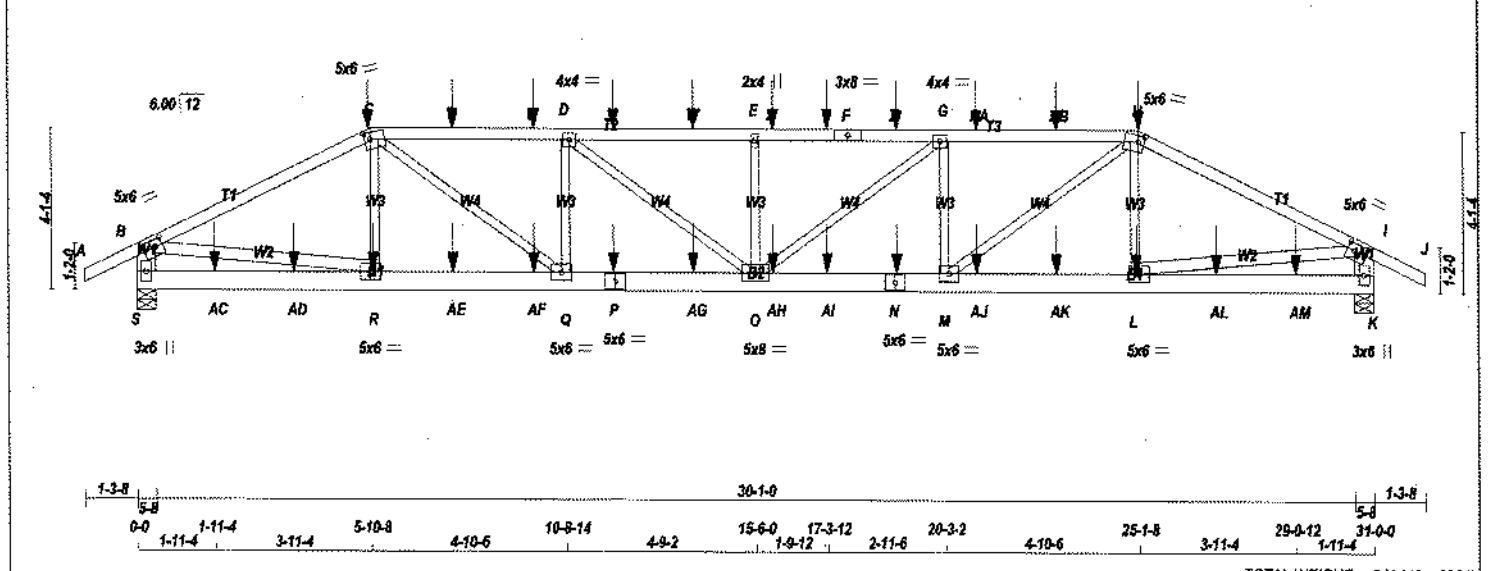


LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
B - R	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	1 12	SIDE(61.0)
C-F	1 12	SIDE(61.0)
F-H	1 12	SIDE(61.0)
H-J	1 12	SIDE(61.0)
S-B	2 12	TOP
K-I	2 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2 12	SIDE(183.1)
N-P	2 12	SIDE(0.0)
N-K	2 12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	
2x4	1 6	
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.		
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.		

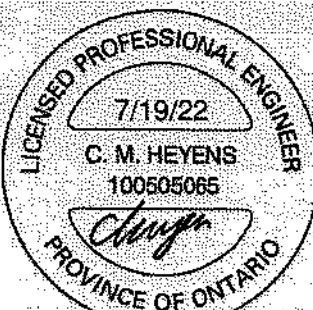

STRUCTURAL COMPONENT ONLY
DWG # TR22070321 PG 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2797	0	2797	0	0	5-8	5-8
K	2802	0	2802	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED		MAX/MIN COMPONENT REACTIONS				
	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
S	1985	1262 / 0	0 / 0	0 / 0	0 / 0	723 / 0	0 / 0
K	1989	1264 / 0	0 / 0	0 / 0	0 / 0	725 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			WEBS
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0 / 26	-84.9 -84.9	0.06 (1) 10.00
B-C	-4179 / 0	-84.9 -84.9	0.43 (1) 4.28
C-T	-5379 / 0	-84.9 -84.9	0.39 (1) 3.85
T-U	-5379 / 0	-84.9 -84.9	0.39 (1) 3.85
U-D	-5379 / 0	-84.9 -84.9	0.39 (1) 3.85
D-V	-5883 / 0	-84.9 -84.9	0.41 (1) 3.87
V-W	-5883 / 0	-84.9 -84.9	0.41 (1) 3.87
W-E	-5883 / 0	-84.9 -84.9	0.41 (1) 3.87
E-X	-5883 / 0	-84.9 -84.9	0.42 (1) 3.86
X-Y	-5883 / 0	-84.9 -84.9	0.42 (1) 3.66
Y-F	-5883 / 0	-84.9 -84.9	0.42 (1) 3.66
F-Z	-5883 / 0	-84.9 -84.9	0.42 (1) 3.66
Z-G	-5883 / 0	-84.9 -84.9	0.42 (1) 3.66
G-AA	-5400 / 0	-84.9 -84.9	0.40 (1) 3.83
AA-AB	-5400 / 0	-84.9 -84.9	0.40 (1) 3.83
AB-H	-5400 / 0	-84.9 -84.9	0.40 (1) 3.83
H-I	-4189 / 0	-84.9 -84.9	0.43 (1) 4.28
I-J	0 / 26	-84.9 -84.9	0.08 (1) 10.00
S-B	-2721 / 0	0.0 0.0	0.10 (1) 7.81
K-I	-2721 / 0	0.0 0.0	0.10 (1) 7.81
S-AC	0 / 0	-18.5 -18.5	0.06 (4) 10.00
AC-AD	0 / 0	-18.5 -18.5	0.06 (4) 10.00
AD-R	0 / 0	-18.5 -18.5	0.06 (4) 10.00
R-AE	0 / 3727	-18.5 -18.5	0.27 (1) 10.00
AE-AF	0 / 3727	-18.5 -18.5	0.27 (1) 10.00
AF-Q	0 / 3727	-18.5 -18.5	0.27 (1) 10.00
Q-P	0 / 5379	-18.5 -18.5	0.40 (1) 10.00
P-AG	0 / 5379	-18.5 -18.5	0.40 (1) 10.00
AG-Q	0 / 5379	-18.5 -18.5	0.40 (1) 10.00
Q-AH	0 / 5400	-18.5 -18.5	0.41 (1) 10.00
AH-AI	0 / 5400	-18.5 -18.5	0.41 (1) 10.00
AI-N	0 / 5400	-18.5 -18.5	0.41 (1) 10.00
N-M	0 / 5400	-18.5 -18.5	0.41 (1) 10.00
M-AJ	0 / 3736	-18.5 -18.5	0.27 (1) 10.00
AJ-AK	0 / 3736	-18.5 -18.5	0.27 (1) 10.00
AK-L	0 / 3736	-18.5 -18.5	0.27 (1) 10.00
L-AL	0 / 0	-18.5 -18.5	0.06 (4) 10.00
AL-AM	0 / 0	-18.5 -18.5	0.06 (4) 10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 35.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

(55 % OF 27.2 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI TC=0.43/1.00 (H-I), BC=0.41/1.00 (M-O), WB=0.33/1.00 (L-I), SS=0.17/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
JSI METAL= 0.51 (P) (INPUT = 1.00)

CONTINUED ON PAGE



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:17:04 2022 Page 2

ID: y2EX8eM7 uIQz85vBWJ49Zzqvl-igkESHp2M222CqgVldpM61Y2BHLKEcQPbNiQqvwUnT

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-4	MT20	5.0	6.0	2.25	2.25
C	TTWW-m	MT20	5.0	8.0	2.00	1.75
D	TMVW-4	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-4	MT20	3.0	8.0		
G	TMVW-4	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	1.75
I	TMVW-4	MT20	5.0	8.0	2.25	2.25
K	BMV1+p	MT20	3.0	6.0		
L, M, Q, R						
L	BMVW-4	MT20	5.0	6.0		
N	BS-4	MT20	5.0	6.0		
O	BMVWVW-4	MT20	5.0	8.0		
P	BS-4	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	FACTORED	MEMB.	FORCE (LBS)	FACTORED	MAX. FACTORED
FR-TO		FROM TO	CS1 (LC)	UNBRAC			
AM-K	0.0	-18.5	-18.5	0.06 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
H	25-1-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
L	25-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
N	19-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-71	-71	---	FRONT	VERT	TOTAL	---	C1
Y	17-3-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
Z	19-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AA	21-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AB	23-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AC	1-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AD	3-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AE	7-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AF	9-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AG	13-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	15-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	17-3-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	21-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	23-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	27-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	29-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



STRUCTURAL COMPONENT ONLY
DWG # TR22070321

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424087	T1S	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mtek Industries, Inc. Tue Jul 19 14:27:50 2022 Page 1

ID: y2EX8eM7 ulQz88vBWJ49ZzqM-cymStaEFDXRnu62f8IPrHGt7qbi3hJvYy5su5DyWUdN

1-3-8 0-0 1-11-8 3-11-8 5-5-12 5-10-8 10-0-12 4-1-0 14-1-12 3-11-12 18-1-8 3-6-8 21-8-0 3-5-8 25-1-8 2-10-0 27-11-8 3-0-8 31-0-8 32-3-8

Scale = 1:57.0

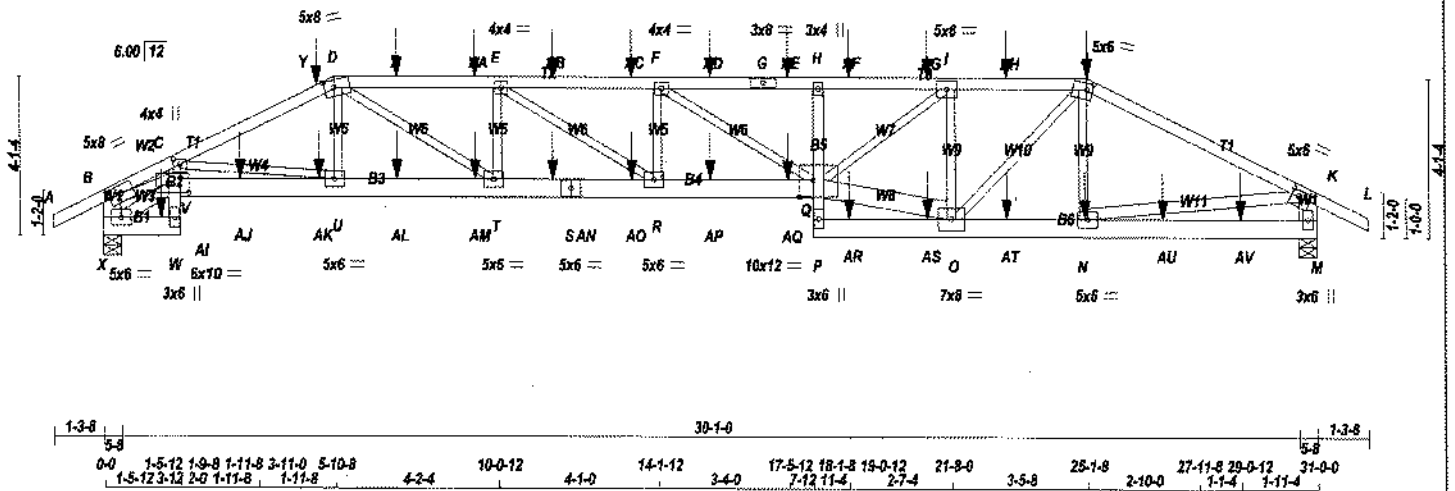

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
X - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
X - W	2x6	DRY	No.2	SPF	
W - C	2x4	DRY	No.2	SPF	
V - Q	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - H	2x4	DRY	No.2	SPF	
P - M	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
Q - O	2x6	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
X - V	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	SIDE(0.0)
D - G	12	SIDE(0.0)
G - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
X - B	2	TOP
M - K	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X - W	2	SIDE(122.0)
S - V	2	SIDE(0.0)
S - Q	2	SIDE(0.0)
P - M	2	SIDE(183.1)
W - C	1	TOP
H - P	1	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
M	2905	0	5-8	5-8
X	3120	0	5-8	5-8
UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM. LIVE
M	2062	1308 / 0	0 / 0	0 / 0
X	2214	1409 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, X

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (PLF)
FR-TO					FR-TO		
A-B	0 / 26	-84.9	-84.9	0.06 (1)	U-D	0 / 886	0.06 (1)
B-C	-7194 / 0	-84.9	-84.9	0.29 (1)	Q-O	0 / 5280	0.34 (1)
C-Y	-8667 / 0	-84.9	-84.9	0.37 (1)	Q-I	0 / 3714	0.46 (1)
Y-D	-8667 / 0	-84.9	-84.9	0.37 (1)	Q-I	-2834 / 0	0.36 (1)
D-Z	-7525 / 0	-84.9	-84.9	0.41 (1)	O-J	0 / 1995	0.25 (1)
Z-AA	-7525 / 0	-84.9	-84.9	0.41 (1)	N-J	-355 / 10	0.04 (1)
AA-E	-7525 / 0	-84.9	-84.9	0.41 (1)	N-K	0 / 3930	0.35 (1)
E-AB	-8484 / 0	-84.9	-84.9	0.44 (1)	B-V	-681 / 0	0.04 (1)
AB-AC	-8484 / 0	-84.9	-84.9	0.44 (1)	X-V	0 / 6430	0.80 (1)
AC-F	-8484 / 0	-84.9	-84.9	0.44 (1)	C-U	-2004 / 0	0.32 (1)
F-AD	-8258 / 0	-84.9	-84.9	0.41 (1)	D-T	0 / 2848	0.33 (1)
AD-G	-8258 / 0	-84.9	-84.9	0.41 (1)	R-F	-402 / 0	0.04 (1)
G-AE	-8258 / 0	-84.9	-84.9	0.41 (1)	T-E	-1226 / 0	0.12 (1)
AE-H	-8258 / 0	-84.9	-84.9	0.41 (1)	E-R	0 / 1153	0.14 (1)
H-AF	-8180 / 0	-84.9	-84.9	0.36 (1)	F-Q	-270 / 0	0.05 (1)
AF-AG	-8180 / 0	-84.9	-84.9	0.36 (1)			
AG-I	-8180 / 0	-84.9	-84.9	0.36 (1)			
I-AH	-5231 / 0	-84.9	-84.9	0.22 (1)			
AH-J	-5231 / 0	-84.9	-84.9	0.22 (1)			
J-K	-4360 / 0	-84.9	-84.9	0.44 (1)			
K-L	0 / 26	-84.9	-84.9	0.06 (1)			
X-B	-2724 / 0	0.0	0.0	0.10 (1)			
M-K	-2824 / 0	0.0	0.0	0.10 (1)			
X-AI	0 / 596	-18.5	-18.5	0.07 (1)			
AI-W	0 / 596	-18.5	-18.5	0.07 (1)			
W-V	0 / 237	0.0	0.0	0.47 (1)			
V-C	0 / 779	0.0	0.0	0.82 (1)			
V-AJ	0 / 7256	-18.5	-18.5	0.51 (1)			
AJ-AK	0 / 7256	-18.5	-18.5	0.51 (1)			
AK-U	0 / 7256	-18.5	-18.5	0.51 (1)			
U-AL	0 / 5305	-18.5	-18.5	0.40 (1)			
AL-AM	0 / 5305	-18.5	-18.5	0.40 (1)			
AM-T	0 / 5305	-18.5	-18.5	0.40 (1)			
T-AN	0 / 7525	-18.5	-18.5	0.57 (1)			
AN-S	0 / 7525	-18.5	-18.5	0.57 (1)			
S-AO	0 / 7525	-18.5	-18.5	0.57 (1)			
AO-R	0 / 7525	-18.5	-18.5	0.57 (1)			
R-AP	0 / 8484	-18.5	-18.5	0.63 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.26")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/758 (0.49")

CSI: TC=0.44/1.00 (E-F:1), BC=0.63/1.00 (Q-R:1)
WB=0.80/1.00 (B-V:1), SS=0.38/1.00 (C-V:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1673


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)

JSI METAL= 0.74 (S) (INPUT = 1.00)

CONTINUED ON PAGE 2

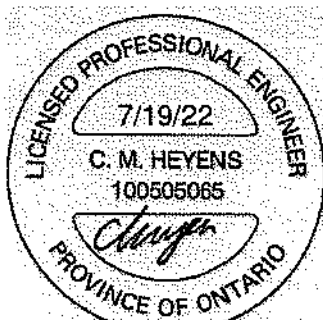

STRUCTURAL COMPONENT ONLY
DWG # TR22070348

JOB NAME

424087

TRUSS NAME

T1S

QUANTITY

1

PLY

2

JOB DESC.

ROYAL PINE HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.530 8 Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:27:50 2022 Page 2

ID:y2EX8eM7 uiQz86vBWJ49Zzgtvl-cymS1aEFDXRNU62f8IPrHGf7gbi3h1JWY5su5DyvwUdN

2x6

2

5

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TMVW+p	MT20	4.0	4.0	1.50	2.00
D	TTWVW-m	MT20	5.0	8.0	2.25	3.00
E	TMVW-t	MT20	4.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMV+p	MT20	3.0	4.0		
I	TMVW-t	MT20	5.0	8.0		
J	TTWVW-m	MT20	5.0	8.0	2.00	1.75
K	TMVW-t	MT20	5.0	8.0	2.00	2.25
M	BMV1+p	MT20	3.0	6.0		
N, R, T, U						
N	BMVW-t	MT20	5.0	6.0		
O	BMVWVW-t	MT20	7.0	8.0		
P	BMV+p	MT20	3.0	6.0		
Q	BVMVWVW-t	MT20	10.0	12.0	5.25	4.25
S	BS-t	MT20	5.0	8.0		
V	BVMVWVW-t	MT20	8.0	10.0	3.00	6.25
W	BMV+p	MT20	3.0	6.0		
X	BMVWVW-t	MT20	5.0	6.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC LENGTH
FR-TO		FROM TO			
AP-AQ	0 / 8484	-18.5	-18.5	0.63 (1)	10.00
AQ-Q	0 / 8484	-18.5	-18.5	0.63 (1)	10.00
P-Q	0 / 60	0.0	0.0	0.16 (1)	10.00
Q-H	-489 / 0	0.0	0.0	0.16 (1)	7.81
P-AR	0 / 212	-18.5	-18.5	0.03 (4)	10.00
AR-AS	0 / 212	-18.5	-18.5	0.03 (4)	10.00
AS-O	0 / 212	-18.5	-18.5	0.03 (4)	10.00
O-AT	0 / 3888	-18.5	-18.5	0.27 (1)	10.00
AT-N	0 / 3888	-18.5	-18.5	0.27 (1)	10.00
N-AU	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AU-AV	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AV-M	0 / 0	-18.5	-18.5	0.07 (4)	10.00

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC LENGTH
FR-TO		FROM TO			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	25-1-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
N	25-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
Y	5-5-12	-84	-84	---	FRONT	VERT	TOTAL	---	C1
Z	7-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AA	9-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AB	11-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AC	13-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AD	15-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AE	17-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AF	19-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AG	21-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AH	23-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AI	1-5-12	-191	-191	---	FRONT	VERT	TOTAL	---	C1
AJ	3-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AK	5-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AL	7-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AM	9-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AN	11-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AO	13-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AP	15-5-12	-66	-66	---	FRONT	VERT	TOTAL	---	C1
AQ	17-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AR	19-0-12	-23	-23	---	FRONT	VERT	TOTAL	---	C1
AS	21-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AT	23-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AU	27-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AV	29-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

LICENSED PROFESSIONAL ENGINEER

7/19/22

C. M. HEYENS

100505065

Provincial Seal

PROVINCE OF ONTARIO

STRUCTURAL COMPONENT ONLY

DWG # TR22070348

PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T1S1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.530 S Feb 23 2022 MTek Industries, Inc. Tue Jul 19 14:35:34 2022 Page 1

ID: v2EX8eM7 ulQz86vBWJ49Zzqvi-CDosPErJy5vYyQXqJkd56WKie38P7speHFRKyxwUwV7

1-3-8 0-0 1-11-8 3-11-0 5-5-12 5-10-8 6-1-0 11-4-4 5-3-4 16-7-8 17-3-12 20-11-0 4-2-8 25-1-8 27-11-8 31-0-0 32-3-8


1-3-8 1-11-8 1-11-8 1-6-12 4-12-2-8 5-3-4 11-4-4 5-3-4 16-7-8 17-3-12 20-11-0 4-2-8 25-1-8 27-11-8 31-0-0 32-3-8

Scale = 1:57.0

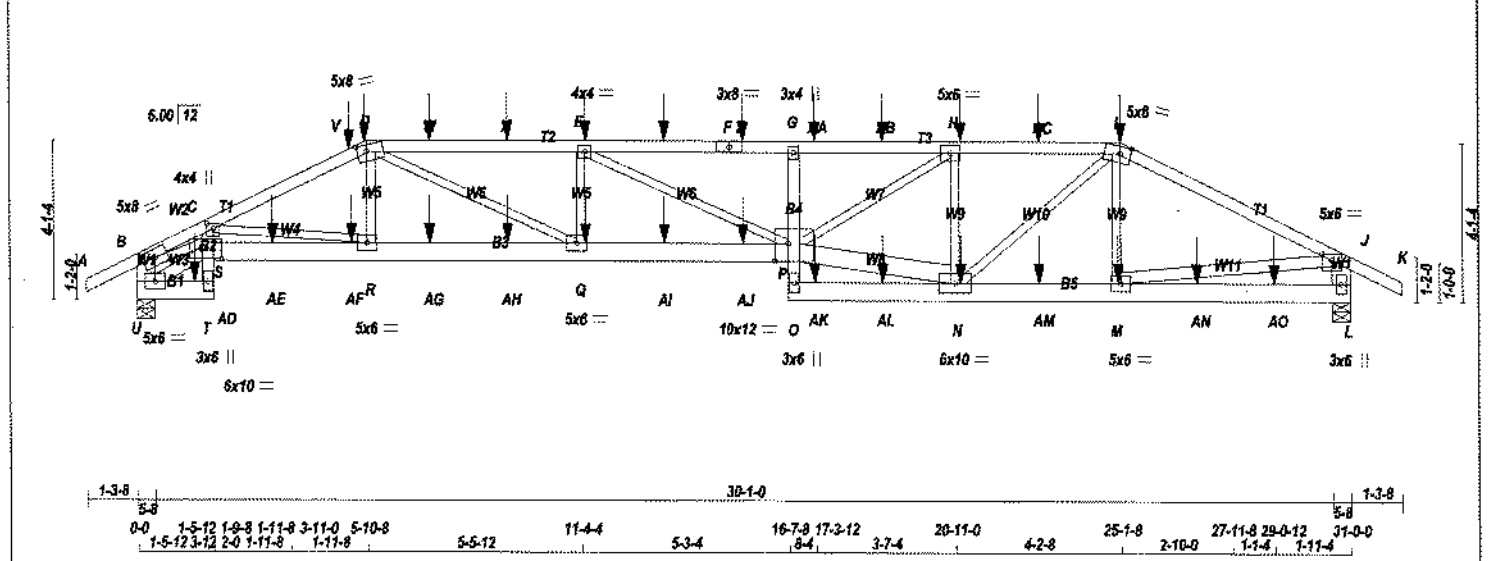

TOTAL WEIGHT = 2 X 150 = 299 lb

LUMBER N.L.G.A. RULES CHORDS A - D 2x4 DRY No.2 SPF D - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF I - K 2x4 DRY No.2 SPF U - B 2x6 DRY No.2 SPF L - J 2x6 DRY No.2 SPF U - T 2x6 DRY No.2 SPF T - C 2x4 DRY No.2 SPF S - P 2x6 DRY No.2 SPF O - G 2x4 DRY No.2 SPF O - L 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT P - N 2x6 DRY No.2 SPF M - J 2x4 DRY No.2 SPF U - S 2x4 DRY No.2 SPF DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-D 1 12 SIDE(61.0) D-F 1 12 SIDE(61.0) F-I 1 12 SIDE(61.0) I-K 1 12 SIDE(61.0) U-B 2 12 TOP L-J 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS U-T 2 12 SIDE(122.0) S-P 2 12 SIDE(183.1) O-L 2 12 SIDE(183.1) T-C 1 12 TOP G-O 1 12 TOP WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 2x4 1 6 2x6 2 6			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG DOWN HORZ UPLIFT IN-SX IN-SX JT 2947 0 2947 0 5-8 5-8 L 3426 0 3426 0 5-8 5-8 U 3426 0 3426 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL L 2091 1334 / 0 0 / 0 0 / 0 757 / 0 0 / 0 U 2425 1579 / 0 0 / 0 0 / 0 848 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, U BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.81 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD LC1 MAX. MAX. UNBRAC LENGTH FR-TO FROM TO MEMB. FORCE MAX. FACTORED FR-TO A-B 0 / 26 -84.9 -84.9 0.08 (1) 10.00 R-D 0 / 729 0.09 (1) B-C -7963 / 0 -84.9 -84.9 0.35 (1) 3.19 P-N 0 / 5652 0.38 (1) C-V -6622 / 0 -84.9 -84.9 0.43 (1) 3.45 P-H 0 / 3627 0.45 (1) V-D -6622 / 0 -84.9 -84.9 0.43 (1) 3.45 N-H -2623 / 0 0.33 (1) D-W -8495 / 0 -84.9 -84.9 0.71 (1) 2.87 N-I 0 / 2197 0.27 (1) W-X -8495 / 0 -84.9 -84.9 0.71 (1) 2.87 M-I -349 / 16 0.04 (1) X-E -8495 / 0 -84.9 -84.9 0.71 (1) 2.87 M-J 0 / 4000 0.35 (1) E-Y -8764 / 0 -84.9 -84.9 0.73 (1) 2.81 U-S -753 / 0 0.04 (1) Y-F -8764 / 0 -84.9 -84.9 0.73 (1) 2.81 B-S 0 / 7116 0.88 (1) F-Z -8764 / 0 -84.9 -84.9 0.73 (1) 2.81 C-R -2100 / 0 0.33 (1) Z-G -8764 / 0 -84.9 -84.9 0.73 (1) 2.81 E-P 0 / 301 0.04 (1) G-AA -8675 / 0 -84.9 -84.9 0.48 (1) 3.00 D-Q 0 / 2803 0.35 (1) AA-AB -8675 / 0 -84.9 -84.9 0.48 (1) 3.00 Q-E -956 / 0 0.09 (1) AB-H -8675 / 0 -84.9 -84.9 0.48 (1) 3.00 H-AC -5589 / 0 -84.9 -84.9 0.30 (1) 3.88 AC-I -5589 / 0 -84.9 -84.9 0.30 (1) 3.88 I-J -4438 / 0 -84.9 -84.9 0.45 (1) 4.16 J-K 0 / 26 -84.9 -84.9 0.06 (1) 10.00 U-B -2996 / 0 0.0 0.0 0.11 (1) 7.81 L-J -2868 / 0 0.0 0.0 0.10 (1) 7.81 U-AD 0 / 560 -18.5 -18.5 0.07 (1) 10.00 AD-T 0 / 560 -18.5 -18.5 0.07 (1) 10.00 T-S 0 / 237 0.0 0.0 0.51 (1) 10.00 S-C 0 / 818 0.0 0.0 0.57 (1) 10.00 S-AE 0 / 8030 -18.5 -18.5 0.58 (1) 10.00 AE-AF 0 / 8030 -18.5 -18.5 0.58 (1) 10.00 AF-R 0 / 8030 -18.5 -18.5 0.58 (1) 10.00 R-AG 0 / 5985 -18.5 -18.5 0.47 (1) 10.00 AG-AH 0 / 5985 -18.5 -18.5 0.47 (1) 10.00 AH-Q 0 / 5985 -18.5 -18.5 0.47 (1) 10.00 Q-AI 0 / 8496 -18.5 -18.5 0.66 (1) 10.00 AI-AJ 0 / 8496 -18.5 -18.5 0.66 (1) 10.00 AJ-P 0 / 8496 -18.5 -18.5 0.66 (1) 10.00 O-P 0 / 80 0.0 0.0 0.19 (1) 10.00 P-G -599 / 0 0.0 0.0 0.19 (1) 7.81 O-AK 0 / 243 -18.5 -18.5 0.05 (4) 10.00 AK-AL 0 / 243 -18.5 -18.5 0.05 (4) 10.00 AL-N 0 / 243 -18.5 -18.5 0.05 (4) 10.00			DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 36.7 PSF SPACING = 24.0 IN./C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA D86-14 - TPC 2014 DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.03") CALCULATED VERT. DEFL.(LL) = L/999 (0.28") ALLOWABLE DEFL.(TL) = L/360 (1.03") CALCULATED VERT. DEFL.(TL) = L/707 (0.53") CSI: TC=0.73/1.00 (E-G:1), BC=0.66/1.00 (P-Q:1), WB=0.88/1.00 (B-S:1), SS=0.42/1.00 (C-S:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873		
---	--	--	---	--	--	---	--	--

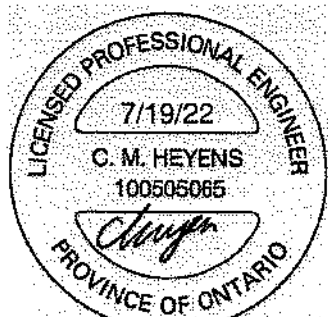

STRUCTURAL COMPONENT ONLY
 DWG # TR22070352
 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T1S1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.590 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:35:34 2022 Page 2

ID:v2EX8eM7 ulQz86vBWJ49Zzgtvl-CDosPErJy5vYYQXgJkkf56WKle38P7speHFR0KywUW7

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TMVW+p	MT20	4.0	4.0	1.50	2.00
D	TTWW-m	MT20	5.0	8.0	2.00	3.00
E	TMVW-t	MT20	4.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMV+p	MT20	3.0	4.0		
H	TMVW-t	MT20	5.0	6.0		
I	TTWW-m	MT20	5.0	8.0	2.25	3.25
J	TMVW-p	MT20	5.0	6.0	2.00	3.00
L	BMV1+p	MT20	3.0	6.0		
M, Q, R						
M	BMVW-t	MT20	5.0	6.0		
N	BMVWV-l	MT20	5.0	10.0		
O	BMV+p	MT20	3.0	6.0		
P	BVMVWV-l	MT20	10.0	12.0	5.25	4.00
S	BVMVWV-l	MT20	6.0	10.0	3.50	6.00
T	BMV+p	MT20	3.0	6.0		
U	BMVW1-l	MT20	5.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRACED LENGTH FR-TO	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
N-AM	0 / 3957	-18.5	-18.5 0.28 (1)	10.00			
AM-M	0 / 3957	-18.5	-18.5 0.28 (1)	10.00			
M-AN	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
AN-AO	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
AO-L	0 / 0	-18.5	-18.5 0.07 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-58	-58	---	FRONT	VERT	DEAD	---	C1
E	5-10-8	-223	-223	---	FRONT	VERT	SNOW	---	C1
E	11-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
H	21-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
I	25-1-8	-295	-295	---	FRONT	VERT	TOTAL	---	C1
M	25-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
N	21-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
Q	11-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
V	5-5-12	-84	-84	---	FRONT	VERT	TOTAL	---	C1
W	7-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
X	9-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
Y	13-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
Z	15-5-12	-67	-67	---	FRONT	VERT	TOTAL	---	C1
AA	17-3-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AB	19-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AC	23-0-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
AD	1-5-12	-191	-191	---	FRONT	VERT	TOTAL	---	C1
AE	3-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AF	5-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AG	7-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AH	9-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AI	13-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AJ	15-5-12	-68	-68	---	FRONT	VERT	TOTAL	---	C1
AK	17-3-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AL	19-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	23-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	27-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	29-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (S) (INPUT = 0.90)

JSI METAL= 0.77 (D) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070352 PG 2/2

[illegible]

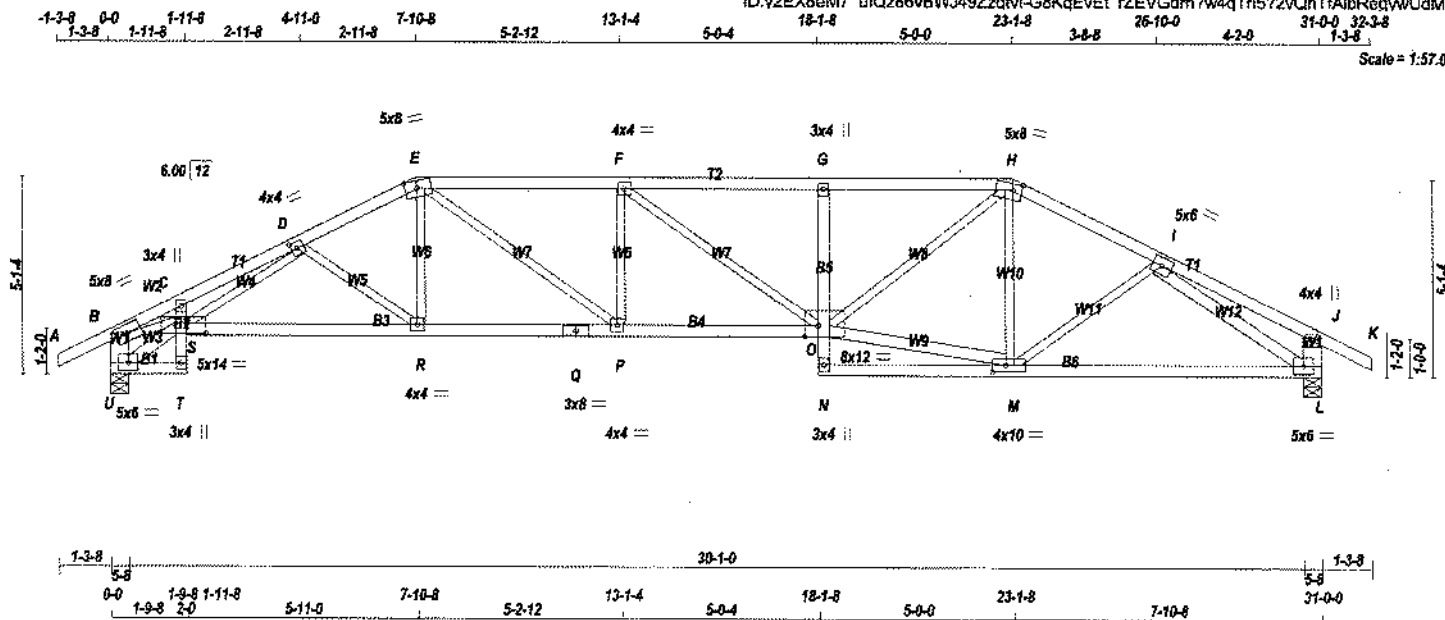

TOTAL WEIGHT = 133 lb
[M/F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
U - T	2x4	DRY	No.2
T - C	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
N - G	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2 SPF			
EXCEPT			
O - M	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - S	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	
C	TMV+p	MT20	3.0	4.0	
D	TMVW-t	MT20	4.0	4.0	2.00 1.75
E	TTVW-m	MT20	5.0	8.0	2.25 3.50
F	TMVW-t	MT20	4.0	4.0	
G	TMV+p	MT20	3.0	4.0	
H	TTVW-m	MT20	5.0	8.0	2.00 2.75
I	TMVW-t	MT20	5.0	8.0	
J	TMV+p	MT20	4.0	4.0	
L	BMVW1-t	MT20	5.0	8.0	
M	BMVW1-t	MT20	4.0	10.0	2.00 4.00
N	BMV+p	MT20	3.0	4.0	
O	BMVW1-t	MT20	8.0	12.0	3.50 4.00
P	BMVW1-t	MT20	4.0	4.0	
Q	BS-t	MT20	3.0	8.0	
R	BMVW1-t	MT20	4.0	4.0	
S	BMVW1-t	MT20	5.0	14.0	3.00 6.00
T	BMV+p	MT20	3.0	4.0	
U	BMVW1-t	MT20	5.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
JT VERT	1715	0	1715	0	0	5-8	5-8
U	1720	0	1720	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
JT	1215	784/0	0/0	0/0	0/0	431/0	0/0	431/0	0/0
U	1219	786/0	0/0	0/0	0/0	432/0	0/0	432/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, U

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0/28	-84.9	-84.9	0.11 (1)	10.00	R-E	0/411	0.08 (1)	
B-C	-3393/0	-84.9	-84.9	0.27 (1)	3.60	E-P	0/934	0.21 (1)	
C-D	-3843/0	-84.9	-84.9	0.37 (1)	3.38	P-F	-456/0	0.12 (1)	
D-E	-2774/0	-84.9	-84.9	0.20 (1)	4.02	F-O	-48/0	0.03 (1)	
E-F	-3230/0	-84.9	-84.9	0.41 (1)	3.58	O-M	0/1935	0.31 (1)	
F-G	-3192/0	-84.9	-84.9	0.38 (1)	3.63	O-H	0/1520	0.34 (1)	
G-H	-3171/0	-84.9	-84.9	0.36 (1)	3.66	M-H	-244/0	0.09 (1)	
H-I	-2227/0	-84.9	-84.9	0.21 (1)	4.41	M-I	0/64	0.02 (4)	
I-J	0/15	-84.9	-84.9	0.19 (1)	10.00	I-L	-2418/0	0.67 (1)	
J-K	0/26	-84.9	-84.9	0.11 (1)	10.00	U-S	-267/0	0.03 (1)	
U-B	-1574/0	0.0	0.0	0.10 (1)	7.81	S-B	0/2994	0.67 (1)	
L-J	-255/0	0.0	0.0	0.02 (1)	7.81	D-R	-497/0	0.13 (1)	
U-T	0/234	-18.5	-18.5	0.05 (1)	10.00	S-D	0/530	0.12 (1)	
T-S	0/19	0.0	0.0	0.32 (1)	10.00				
S-C	-122/0	0.0	0.0	0.24 (1)	7.81				
S-R	0/2887	-18.5	-18.5	0.65 (1)	10.00				
R-Q	0/2475	-18.5	-18.5	0.48 (1)	10.00				
Q-P	0/2475	-18.5	-18.5	0.48 (1)	10.00				
P-O	0/3231	-18.5	-18.5	0.59 (1)	10.00				
N-O	0/26	0.0	0.0	0.11 (1)	10.00				
O-G	-451/0	0.0	0.0	0.11 (1)	7.81				
N-M	0/80	-18.5	-18.5	0.26 (4)	10.00				
M-L	0/1971	-18.5	-18.5	0.45 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.19")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/979 (0.38")

CS: TC=0.41/1.00 (E-F-1), BC=0.50/1.00 (O-P-1), WB=0.67/1.00 (B-S-1), SSI=0.25/1.00 (C-S-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (P) (INPUT = 0.90)
JSI METAL=0.72 (Q) (INPUT = 1.00)

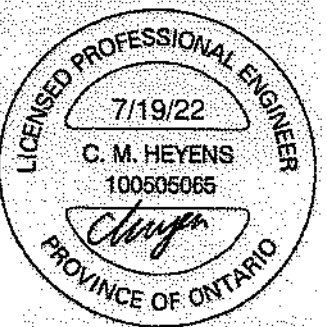

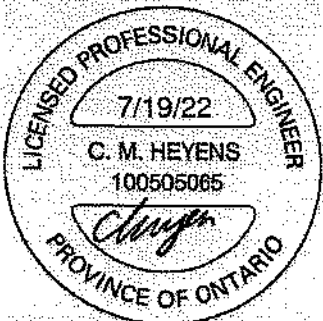JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424087	T2S	1	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington						
Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:27:51 2022 Page 2 ID:y2EX8eM7 utQz86vBWJ49Zzqlv-G8KqEvEt rZEVGdm?w4gTrn572vQnT1AjbRegwUdM						
NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.						
 STRUCTURAL COMPONENT ONLY DWG # TR22070349 PG 2/2						

JOB NAME 424088	TRUSS NAME T2S1	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Jul 19 14:35:35 2022 Page 2 ID: y2EX8eM7 ulQz88vBWJ49Zzqlvi-gPMFdasxP1PAa60tSFudK3Xo2Qu8dLyb??wmywUW6	
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.					
 STRUCTURAL COMPONENT ONLY DWG # TR22070353 PG 2/2					


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:17:05 2022 Page 1

ID: y2EX8eM7 ulQz86vBWJ49ZzqM-Asldf1Qg7MAV? FhrKKbeF5uNbbG3eSadF6Fy6ywUnS

Scale = 1:56.0

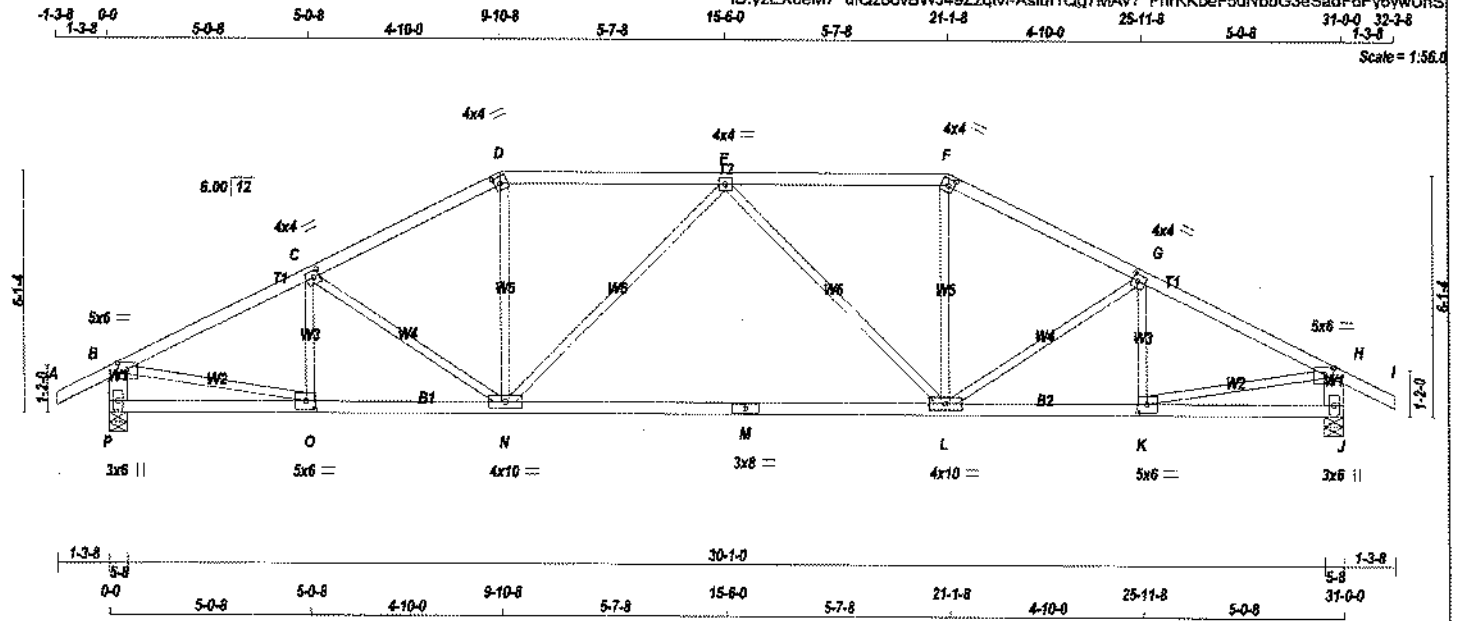

TOTAL WEIGHT = 123 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.	BEARINGS			
A - D	2x4	DRY	No.2	FACTORED	MAXIMUM FACTORED	INPUT	REQD
D - F	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG
F - I	2x4	DRY	No.2	JT VERT	DOWN	HORZ	UPLIFT
P - B	2x6	DRY	No.2	P 1717	0	0	5-8
J - H	2x6	DRY	No.2	J 1717	0	0	5-8
M - M	2x4	DRY	No.2				
M - J	2x4	DRY	No.2				
ALL WEBS	2x3	DRY	No.2	UNFACTORED REACTIONS			
EXCEPT			SPF	1ST CASE	MAX. MIN. COMPONENT REACTIONS		
				JT COMBINED	SNOW	LIVE	PERM. LIVE
				P 1217	786 / 0	0 / 0	0 / 0
				J 1217	786 / 0	0 / 0	0 / 0

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	2.75
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TFW-h	MT20	4.0	4.0	2.00	1.75
E	TMWW-t	MT20	4.0	4.0		
F	TFW-h	MT20	4.0	4.0	2.00	1.75
G	TMWW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	6.0	2.00	2.75
J	BMV1+p	MT20	3.0	6.0		
K	BMWW-t	MT20	5.0	6.0	2.50	2.75
L	BMWW-t	MT20	4.0	10.0		
M	BS-t	MT20	3.0	8.0		
N	BMWW-t	MT20	4.0	10.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.75
P	BMV1+p	MT20	3.0	6.0		

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00	O-C	-293 / 0	0.06 (1)
B-C	-2293 / 0	-84.9	-84.9 0.33 (1)	4.24	C-N	-229 / 0	0.14 (1)
C-D	-2125 / 0	-84.9	-84.9 0.31 (1)	4.38	N-D	0 / 602	0.14 (1)
D-E	-1891 / 0	-84.9	-84.9 0.39 (1)	4.49	L-F	0 / 602	0.14 (1)
E-F	-1891 / 0	-84.9	-84.9 0.39 (1)	4.49	L-G	-229 / 0	0.14 (1)
F-G	-2125 / 0	-84.9	-84.9 0.31 (1)	4.38	K-G	-293 / 0	0.06 (1)
G-H	-2293 / 0	-84.9	-84.9 0.33 (1)	4.24	B-O	0 / 2069	0.47 (1)
H-I	0 / 26	-84.9	-84.9 0.11 (1)	10.00	K-H	0 / 2069	0.47 (1)
P-B	-1669 / 0	0.0	0.0 0.11 (1)	7.64	N-E	-404 / 0	0.55 (1)
J-H	-1669 / 0	0.0	0.0 0.11 (1)	7.64	E-L	-404 / 0	0.55 (1)
P-O	0 / 0	-18.5	-18.5 0.13 (4)	10.00			
O-N	0 / 2069	-18.5	-18.5 0.55 (4)	10.00			
N-M	0 / 2169	-18.5	-18.5 0.56 (1)	10.00			
M-L	0 / 2169	-18.5	-18.5 0.56 (1)	10.00			
L-K	0 / 2069	-18.5	-18.5 0.55 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10")
ALLOWABLE DEFL.(TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(TL) = $L/885$ (0.42")

CSI: $TC=0.39/1.00$ (D-E:1), $BC=0.56/1.00$ (L-N:1), $WB=0.55/1.00$ (E-N:1), $SSI=0.23/1.00$ (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 768 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (B) (INPUT = 0.90)
JSI METAL= 0.95 (M) (INPUT = 1.00)

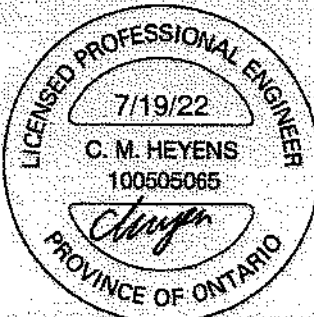

STRUCTURAL COMPONENT ONLY
DWG # TR22070323


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424087	T3S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 5 Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:27:51 2022 Page 1

ID: y2EX8eM7 utQz86v8WJ49Zzqtvi-G8KqEvEt rZEVGdhr7w4qTtID72uQnMfAibRegywUdM

Scale = 1:57.0

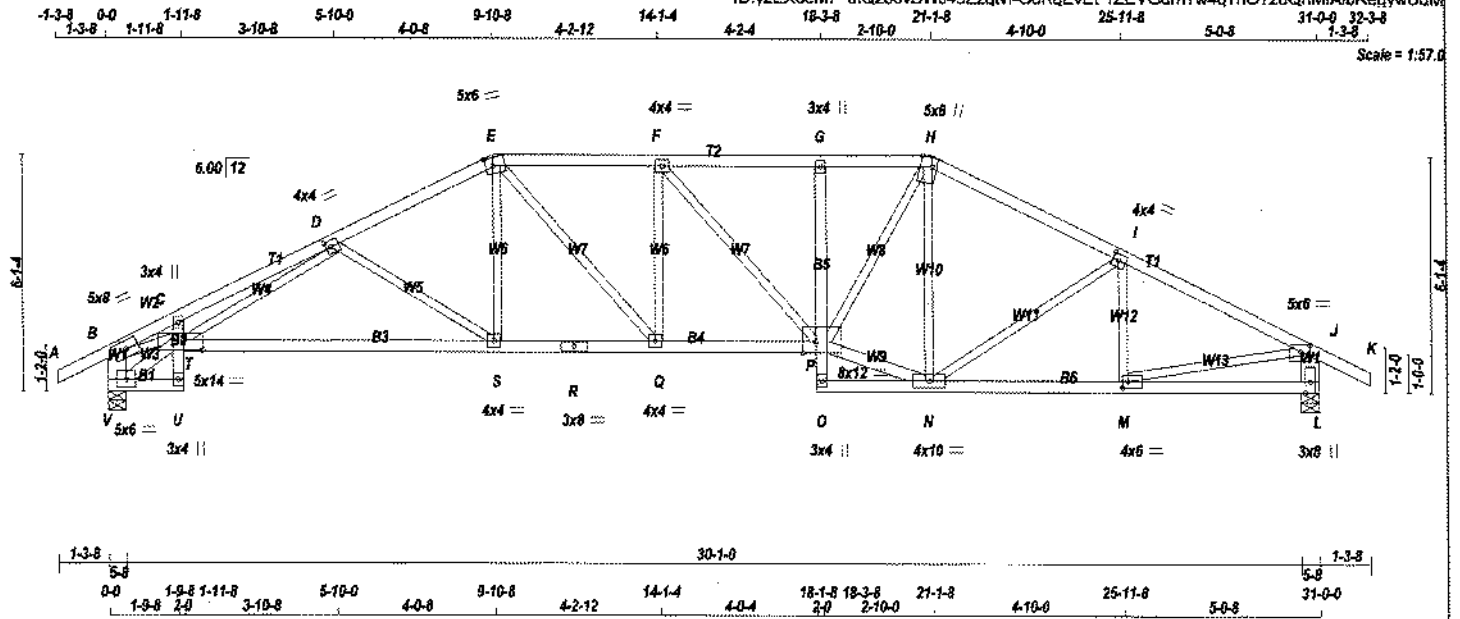

TOTAL WEIGHT = 138 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
V - B	2x6	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	
V - U	2x4	DRY	No.2	SPF	
U - C	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
O - G	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
P - N	2x4	DRY	No.2	SPF	
V - T	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TMVW-p	MT20	3.0	4.0		
D	TMVW-t	MT20	4.0	4.0	2.00	1.50
E	TTWW-m	MT20	5.0	6.0	2.50	2.25
F	TMVW-t	MT20	4.0	4.0		
G	TMVW-p	MT20	3.0	4.0		
H	TTWW-m	MT20	5.0	8.0	Edge	3.50
I	TMVW-t	MT20	4.0	4.0	2.00	1.75
J	TMVW-p	MT20	5.0	6.0	2.00	2.75
L	BMV1-t	MT20	3.0	6.0	Edge	
M	BMVW-t	MT20	4.0	6.0	2.00	1.50
N	BMVW-t	MT20	4.0	10.0		
O	BMVW-p	MT20	3.0	4.0		
P	BMVW-t	MT20	8.0	12.0	Edge	4.25
Q	BMVW-t	MT20	4.0	4.0		
R	BS-1	MT20	3.0	8.0		
S	BMVW-t	MT20	4.0	4.0		
T	BMVW-t	MT20	5.0	14.0	3.00	6.00
U	BMVW-p	MT20	3.0	4.0		
V	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1715	0	1715	0
V	1720	0	1720	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	1215	784 / 0	0 / 0	0 / 0	0 / 0	431 / 0	0 / 0
V	1219	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, V

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	WEBS	MAX. FACTORED
		(LBS)	(PLF)		(LC)	UNBRAC			(LBS)
FR-TO						LENGTH	FR-TO		
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00	S-E	0 / 478	0.11 (1)	
B-C	-3420 / 0	-84.9	-84.9	0.24 (1)	3.61	E-Q	0 / 494	0.11 (1)	
C-D	-3675 / 0	-84.9	-84.9	0.39 (1)	3.38	Q-F	-318 / 0	0.12 (1)	
D-E	-2533 / 0	-84.9	-84.9	0.28 (1)	4.11	F-P	-116 / 0	0.08 (1)	
E-F	-2582 / 0	-84.9	-84.9	0.24 (1)	4.11	P-N	0 / 1918	0.31 (1)	
F-G	-2506 / 0	-84.9	-84.9	0.24 (1)	4.17	P-H	0 / 1268	0.29 (1)	
G-H	-2497 / 0	-84.9	-84.9	0.14 (1)	4.28	N-H	-417 / 0	0.24 (1)	
H-I	-2099 / 0	-84.9	-84.9	0.31 (1)	4.40	N-I	-264 / 0	0.16 (1)	
I-J	-2298 / 0	-84.9	-84.9	0.33 (1)	4.23	M-I	-260 / 0	0.06 (1)	
J-K	0 / 26	-84.9	-84.9	0.11 (1)	10.00	M-J	0 / 2104	0.47 (1)	
V-B	-1573 / 0	0.0	0.0	0.10 (1)	7.81	V-T	-289 / 0	0.03 (1)	
L-J	-1672 / 0	0.0	0.0	0.11 (1)	7.64	B-T	0 / 3023	0.68 (1)	
V-U	0 / 236	-18.5	-18.5	0.05 (1)	10.00	D-S	-603 / 0	0.25 (1)	
U-T	0 / 19	0.0	0.0	0.32 (1)	10.00	T-D	0 / 688	0.15 (1)	
T-C	-179 / 0	0.0	0.0	0.25 (1)	7.81				
T-S	0 / 2753	-18.5	-18.5	0.53 (1)	10.00				
S-R	0 / 2256	-18.5	-18.5	0.50 (1)	10.00				
R-Q	0 / 2256	-18.5	-18.5	0.50 (1)	10.00				
Q-P	0 / 2582	-18.5	-18.5	0.47 (1)	10.00				
O-P	0 / 16	0.0	0.0	0.06 (1)	10.00				
P-G	-298 / 0	0.0	0.0	0.08 (1)	7.81				
O-N	0 / 46	-18.5	-18.5	0.08 (1)	10.00				
N-M	0 / 2074	-18.5	-18.5	0.38 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")

CALCULATED VERT. DEFL.(LL) = $L/999$ (0.15")

ALLOWABLE DEFL.(TL) = $L/360$ (1.03")

CALCULATED VERT. DEFL.(TL) = $L/999$ (0.35")

CSI: TC=0.39/1.00 (C-D-1), BC=0.59/1.00 (S-T-1)

, WB=0.68/1.00 (B-T-1), SS=0.25/1.00 (C-T-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE REELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (E) (INPUT = 0.90)

JSI METAL= 0.67 (R) (INPUT = 1.00)

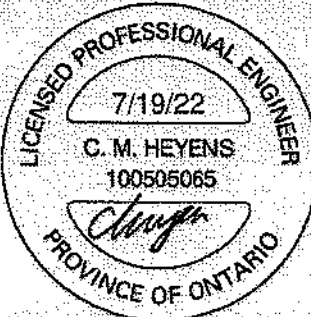

STRUCTURAL COMPONENT ONLY
DWG # TR22070350 PG 1/2

CONTINUED ON PAGE 2

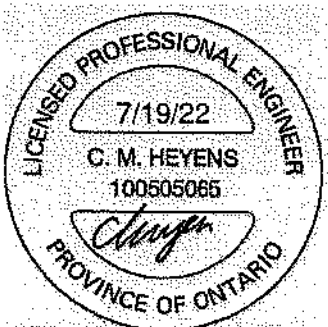JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424087	T3S	1	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington						
Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:27:52 2022 Page 2						
ID:Y2EX8eM7 uiQz86vBWJ49Zzqvi-kKuDSFFW8h57QC1FIRJmHOS8PO79DcpPPL A6yvwUdL						
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.						
 STRUCTURAL COMPONENT ONLY DWG # TR22070350 PG 2/2						

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T3S1	1	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 5 Feb 23 2022 M&T Industries, Inc. Tue Jul 19 14:35:36 2022 Page 1

ID: y2EX8eM7 ulQz86vBWJ49Zzqtvl-9bwdqvZUj9GqigDR9m7AXd1Slt4T66bkYSDywUW5

1-3-8 0-0 1-11-8 3-10-8 5-10-0 4-0-8 9-10-8 3-5-12 13-4-4 4-11-4 18-3-8 2-10-0 21-1-8 4-10-0 25-11-8 5-0-8 31-0-0 32-3-8

Scale = 1:57.0

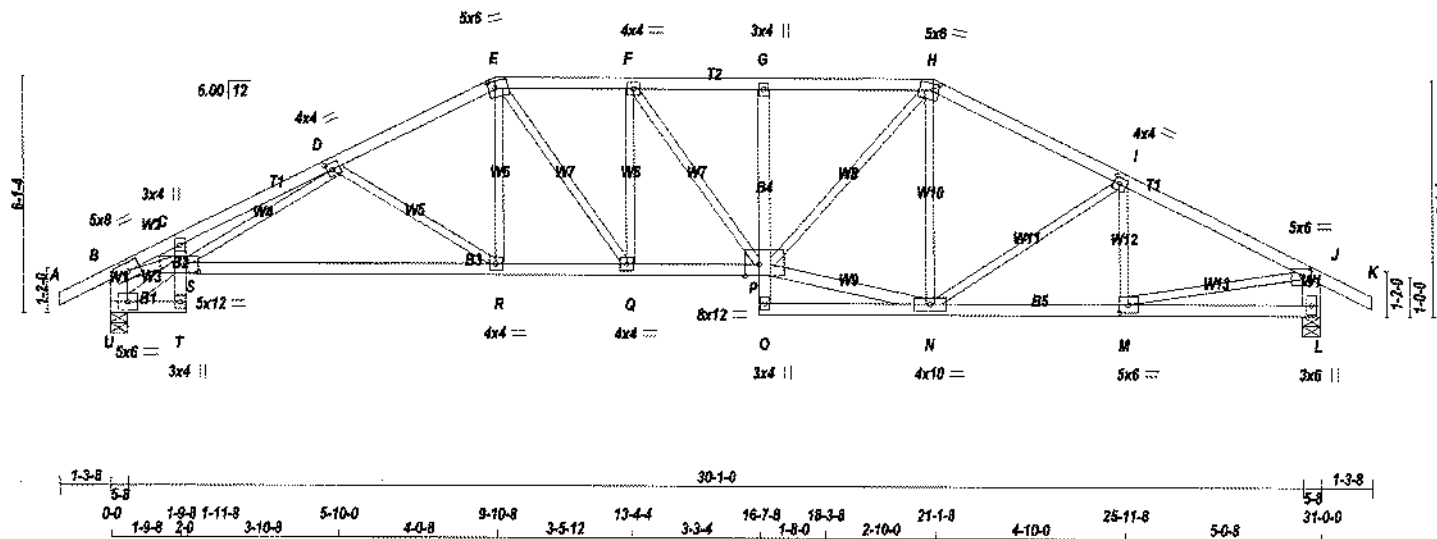

TOTAL WEIGHT = 140 lb (MEF)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
U - T	2x4	DRY	No.2
T - C	2x4	DRY	No.2
S - P	2x4	DRY	No.2
O - G	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
P - N	2x4	DRY	No.2
U - S	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	
C	TMV+p	MT20	3.0	4.0	
D	TMVW-t	MT20	4.0	4.0	2.00 1.50
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-t	MT20	4.0	4.0	
G	TMV+p	MT20	3.0	4.0	
H	TTWW-m	MT20	5.0	6.0	2.00 1.75
I	TMVW-t	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	6.0	2.00 2.75
L	BMV1+p	MT20	3.0	6.0	
M	BMVW-t	MT20	5.0	6.0	2.50 2.75
N	BMVWV-t	MT20	4.0	10.0	
O	BMV+p	MT20	3.0	4.0	
P	BMVWVW-t	MT20	8.0	12.0	Edge 4.25
Q	BMVW-t	MT20	4.0	4.0	
R	BMVW-t	MT20	4.0	4.0	
S	BMVWVW-t	MT20	5.0	12.0	3.00 4.00
T	BMV+p	MT20	3.0	4.0	
U	BMVW1-t	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	1715	0	1715	0	0	5-8	5-8
U	1720	0	1720	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE	MAX. MIN.	COMPONENT	REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	1215	784 / 0	0 / 0	0 / 0	0 / 0	431 / 0	0 / 0
U	1219	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, U

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.9 -84.9 0.11 (1)	10.00	R-E	0 / 480	0.11 (1)	
B-C	-3420 / 0	-84.9 -84.9 0.24 (1)	3.61	E-Q	0 / 476	0.11 (1)	
C-D	-3675 / 0	-84.9 -84.9 0.39 (1)	3.38	Q-F	-360 / 0	0.14 (1)	
D-E	-2533 / 0	-84.9 -84.9 0.28 (1)	4.11	F-P	0 / 79	0.02 (1)	
E-F	-2536 / 0	-84.9 -84.9 0.19 (1)	4.19	P-N	0 / 1853	0.30 (1)	
F-G	-2582 / 0	-84.9 -84.9 0.21 (1)	4.14	P-H	0 / 1068	0.24 (1)	
G-H	-2571 / 0	-84.9 -84.9 0.27 (1)	4.10	N-H	-178 / 0	0.10 (1)	
H-I	-2100 / 0	-84.9 -84.9 0.31 (1)	4.40	N-I	-263 / 0	0.16 (1)	
I-J	-2298 / 0	-84.9 -84.9 0.33 (1)	4.23	M-I	-261 / 0	0.06 (1)	
J-K	0 / 26	-84.9 -84.9 0.11 (1)	10.00	M-J	0 / 2104	0.47 (1)	
U-B	-1573 / 0	0.0 0.0 0.10 (1)	7.81	U-S	-269 / 0	0.03 (1)	
L-J	-1672 / 0	0.0 0.0 0.11 (1)	7.84	B-S	0 / 3023	0.68 (1)	
				D-R	-803 / 0	0.26 (1)	
				S-D	0 / 688	0.15 (1)	
U-T	0 / 238	-18.5 -18.5 0.05 (1)	10.00				
T-S	0 / 19	0.0 0.0 0.32 (1)	10.00				
S-C	-179 / 0	0.0 0.0 0.25 (1)	7.81				
S-R	0 / 2753	-18.5 -18.5 0.59 (1)	10.00				
R-Q	0 / 2256	-18.5 -18.5 0.51 (1)	10.00				
Q-P	0 / 2536	-18.5 -18.5 0.45 (1)	10.00				
Q-P	0 / 34	0.0 0.0 0.07 (1)	10.00				
P-G	-368 / 0	0.0 0.0 0.10 (1)	7.81				
O-N	0 / 50	-18.5 -18.5 0.09 (1)	10.00				
N-M	0 / 2074	-18.5 -18.5 0.39 (1)	10.00				
M-L	0 / 0	-18.5 -18.5 0.10 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (1.03")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.15")
ALLOWABLE DEFL.(TL) = 1/360 (1.03")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.34")

CSI: TC=0.39/1.00 (C-D:1), BC=0.59/1.00 (R-S:1), WB=0.68/1.00 (B-S:1), SS=0.25/1.00 (C-S:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.66 (S) (INPUT = 1.00)

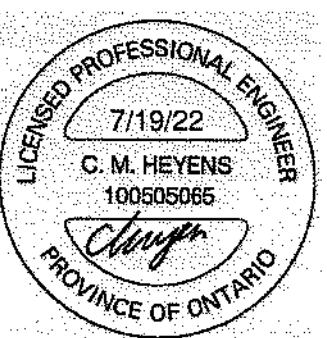


STRUCTURAL COMPONENT ONLY
DWG # TR22070354 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T3S1	1	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington						
Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:35:36 2022 Page 2						
ID:v2EX8eM7 uiQz86vBWJ49Zzqvi-9bwdqvtZUi9GoiqDR9m7AXd1Slt4T66bkYSDywlJWS						
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD. NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.						
 STRUCTURAL COMPONENT ONLY DWG # TR22070354 PG 2/2						

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T4	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MtTek Industries, Inc. Tue Jul 19 14:17:08 2022 Page 1
ID: y2EX8eM7 ulQz86vBWJ49Zzqtlv12r7sMRbfld8qtP2sqB5d2c7yUo6qsvspVYvUwUnR

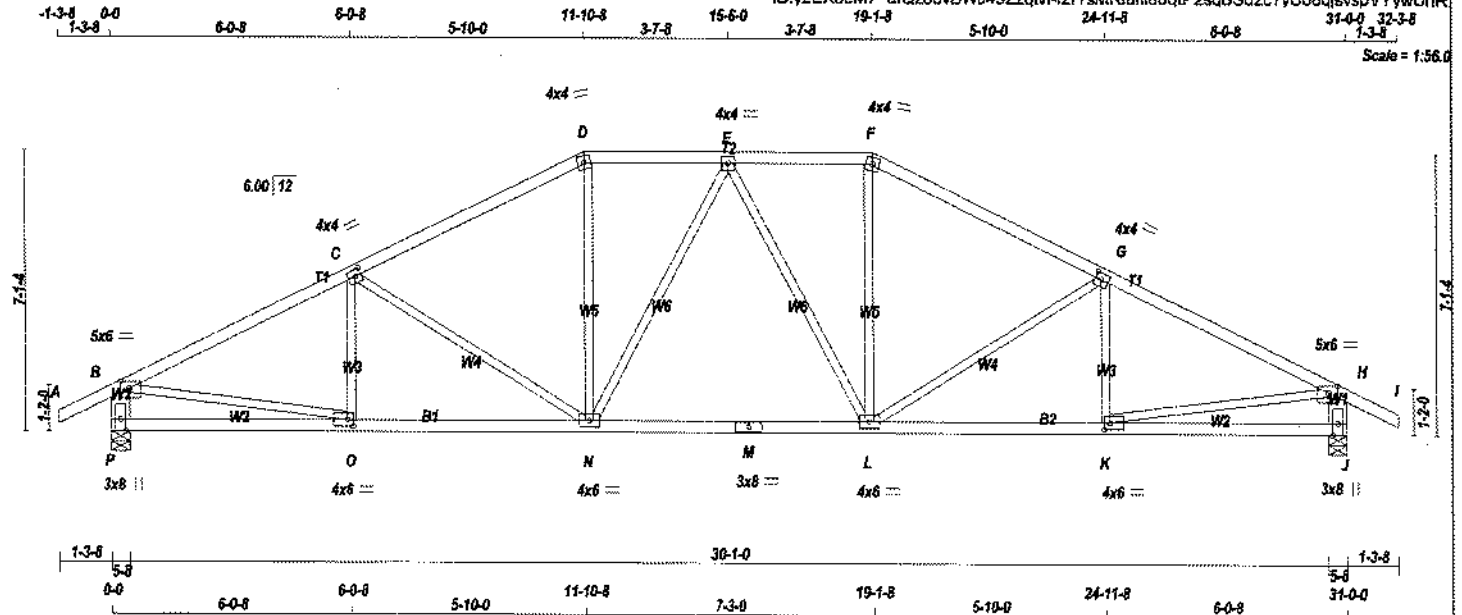

TOTAL WEIGHT = 129 lb

LUMBER	SIZE	DRY	DESCR.
N. L. G. A. RULES			
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
P - B	2x6	DRY	No.2
J - H	2x6	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	2.00	2.75
C TMVW-l	MT20	4.0	4.0	2.00	1.75
D TTW-m	MT20	4.0	4.0		
E TMVW-l	MT20	4.0	4.0		
F TTW-m	MT20	4.0	4.0		
G TMVW-l	MT20	4.0	4.0	2.00	1.75
H TMVW-p	MT20	5.0	6.0	2.00	2.75
J BMV1+p	MT20	3.0	8.0	Edge	
K BMVW-l	MT20	4.0	6.0	2.00	1.75
L BMVW-l	MT20	4.0	6.0		
M BS-l	MT20	3.0	8.0		
N BMVW-l	MT20	4.0	6.0		
O BMVW-l	MT20	4.0	6.0	2.00	1.75
P BMV1+p	MT20	3.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX	IN-SX
P	1717	0	1717	0	0	5-8	5-8		
J	1717	0	1717	0	0	5-8	5-8		

UNFACTORED REACTIONS							
1ST LOASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SC
P	1217	785 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0
J	1217	785 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00	O-C	-188 / 25	0.05 (1)
B-C	-2334 / 0	-84.9	-84.9 0.49 (1)	4.03	C-N	-454 / 0	0.44 (1)
C-D	-1962 / 0	-84.9	-84.9 0.44 (1)	4.37	N-D	0 / 556	0.13 (1)
D-E	-1738 / 0	-84.9	-84.9 0.16 (1)	4.92	L-F	0 / 556	0.13 (1)
E-F	-1738 / 0	-84.9	-84.9 0.16 (1)	4.92	L-G	-454 / 0	0.44 (1)
F-G	-1962 / 0	-84.9	-84.9 0.44 (1)	4.37	K-G	-186 / 25	0.05 (1)
G-H	-2334 / 0	-84.9	-84.9 0.49 (1)	4.03	B-O	0 / 2132	0.48 (1)
H-I	0 / 26	-84.9	-84.9 0.11 (1)	10.00	K-H	0 / 2132	0.48 (1)
P-B	-1668 / 0	0.0	0.0 0.11 (1)	7.64	N-E	-206 / 0	0.25 (1)
J-H	-1668 / 0	0.0	0.0 0.11 (1)	7.64	E-L	-206 / 0	0.25 (1)
P-O	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
O-N	0 / 2111	-18.5	-18.5 0.43 (1)	10.00			
N-M	0 / 1833	-18.5	-18.5 0.38 (1)	10.00			
M-L	0 / 1833	-18.5	-18.5 0.38 (1)	10.00			
L-K	0 / 2111	-18.5	-18.5 0.43 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2016, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.49/1.00 (B-C:1), BC=0.43/1.00 (N-C:1), WB=0.48/1.00 (B-O:1), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.64 (M) (INPUT = 1.00)

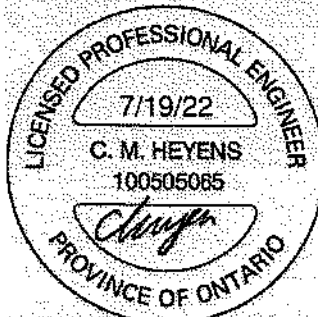


STRUCTURAL COMPONENT ONLY
DWG # TR22070324

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424087	T4S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:27:53 2022 Page 1

ID: y2EX8eM7 ulQz86vBWJ49Zzqtl-CXRbfG8WSpylanEpQyYvuwclpiHueye34YIYwUdk

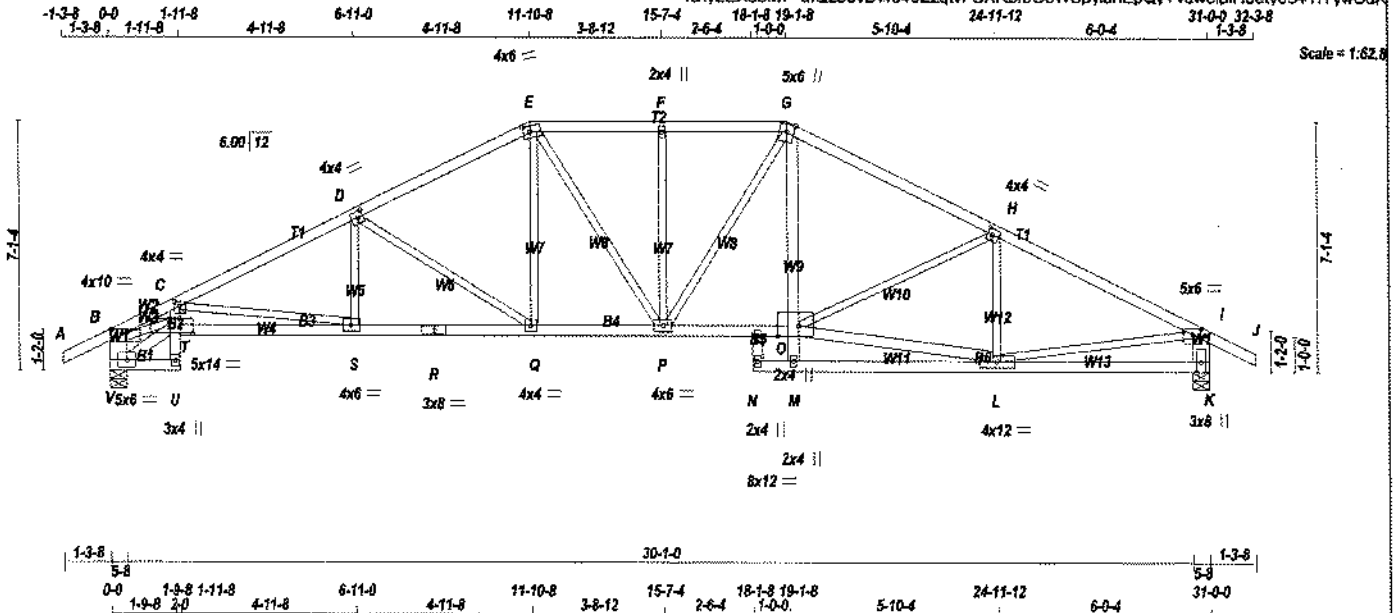

TOTAL WEIGHT = 144 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
V - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
U - C	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
M - G	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
V - T	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	4.0	10.0	1.00	5.25
C TMVW-p	MT20	4.0	4.0	1.50	2.00
D TMVW-t	MT20	4.0	4.0	2.00	1.75
E TMVW-m	MT20	4.0	6.0	1.75	2.25
F TMVW-w	MT20	2.0	4.0		
G TMVW-m	MT20	5.0	6.0	Edge	
H TMVW-t	MT20	4.0	4.0	2.00	1.75
I TMVW-p	MT20	5.0	6.0	2.00	2.75
K BMV1-p	MT20	3.0	8.0	Edge	
L BMVWW-t	MT20	4.0	12.0		
M BMV-w	MT20	2.0	4.0		
N NP-w	MT20	2.0	4.0		
O BWVWW-t	MT20	8.0	12.0	Edge	7.00
P BMVWW-t	MT20	4.0	6.0		
Q BMVWW-t	MT20	4.0	4.0		
R BS-t	MT20	3.0	8.0		
S BMVWW-t	MT20	4.0	6.0		
T BVVWW-t	MT20	5.0	14.0	3.75	7.75
U BMV-p	MT20	3.0	4.0		
V BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
K	1728	0	1728	0	0
V	1728	0	1728	0	0
UNFACTORED REACTIONS					
JT	1ST CASE	MAX MIN	COMPONENT REACTIONS		
K	1226	784 / 0	0 / 0	0 / 0	442 / 0
V	1225	786 / 0	0 / 0	0 / 0	438 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, V					
BRACING					
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT.					
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.					
MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT					
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.					
LOADING					
TOTAL LOAD CASES: (4)					
CHORDS					
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX.
	(LBS)	(PLF)			UNBRAC
FR-TO					LENGTH
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00
B-C	-4013 / 0	-84.9	-84.9	0.29 (1)	3.31
C-D	-2972 / 0	-84.9	-84.9	0.46 (1)	3.64
D-E	-2293 / 0	-84.9	-84.9	0.38 (1)	4.17
E-F	-2175 / 0	-84.9	-84.9	0.18 (1)	4.47
F-G	-2175 / 0	-84.9	-84.9	0.18 (1)	4.47
G-H	-2325 / 0	-84.9	-84.9	0.48 (1)	4.04
H-I	-2357 / 0	-84.9	-84.9	0.49 (1)	4.00
I-J	0 / 26	-84.9	-84.9	0.11 (1)	10.00
V-B	-1518 / 0	0.0	0.0	0.10 (1)	7.81
K-I	-1682 / 0	0.0	0.0	0.11 (1)	7.62
WEBS					
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX.
	(LBS)	(LBS)			CSI (LC)
Q-E	0 / 516	0.12 (1)			
L-H	-548 / 0	0.14 (1)			
L-I	0 / 2153	0.48 (1)			
M-O	0 / 69	0.08 (1)			
O-G	0 / 515	0.15 (1)			
O-L	0 / 2117	0.34 (1)			
O-H	-87 / 0	0.06 (1)			
V-T	-383 / 0	0.04 (1)			
B-T	0 / 3689	0.81 (1)			
E-P	0 / 258	0.06 (1)			
P-F	-365 / 0	0.21 (1)			
P-G	0 / 242	0.05 (1)			
C-S	-1436 / 0	0.64 (1)			
S-D	0 / 200	0.05 (4)			
D-Q	-793 / 0	0.51 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 23.3 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 36.7 PSF		

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.49/1.00 (H-I:1), BC=0.72/1.00 (S-T:1), WB=0.81/1.00 (B-T:1), CSI=0.44/1.00 (C-T:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PL)	
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (I) (INPUT = 0.90)
JSI METAL= 0.83 (R) (INPUT = 1.00)

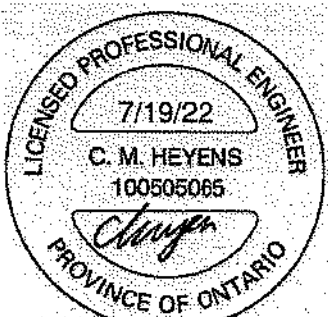

STRUCTURAL COMPONENT ONLY
DWG # TR22070351 PG 1/2

CONTINUED ON PAGE 2

JOB NAME 424087	TRUSS NAME T4S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:27:53 2022 Page 2
ID: y2EX8eM7 uIQz86vBWJ49Zzqyl-CXRbfG8WSpylanEpQyYvuwcipiHuetve34YIYvwUdk


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
W	NP+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)


1) Lateral braces to be a minimum of 2X4 SPF #2.

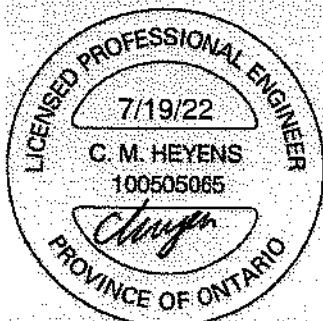


STRUCTURAL COMPONENT ONLY
DWG # TR22070351 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T4S1	1	1	TRUSS DESC.		

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:35:37 2022 Page 1
ID: y2EX8eM7 uIQz86vBWJ49Zzqtvl-dou72FIBF0H7PFP7IHM#8v8r3mcV6FKFU57iywUW4

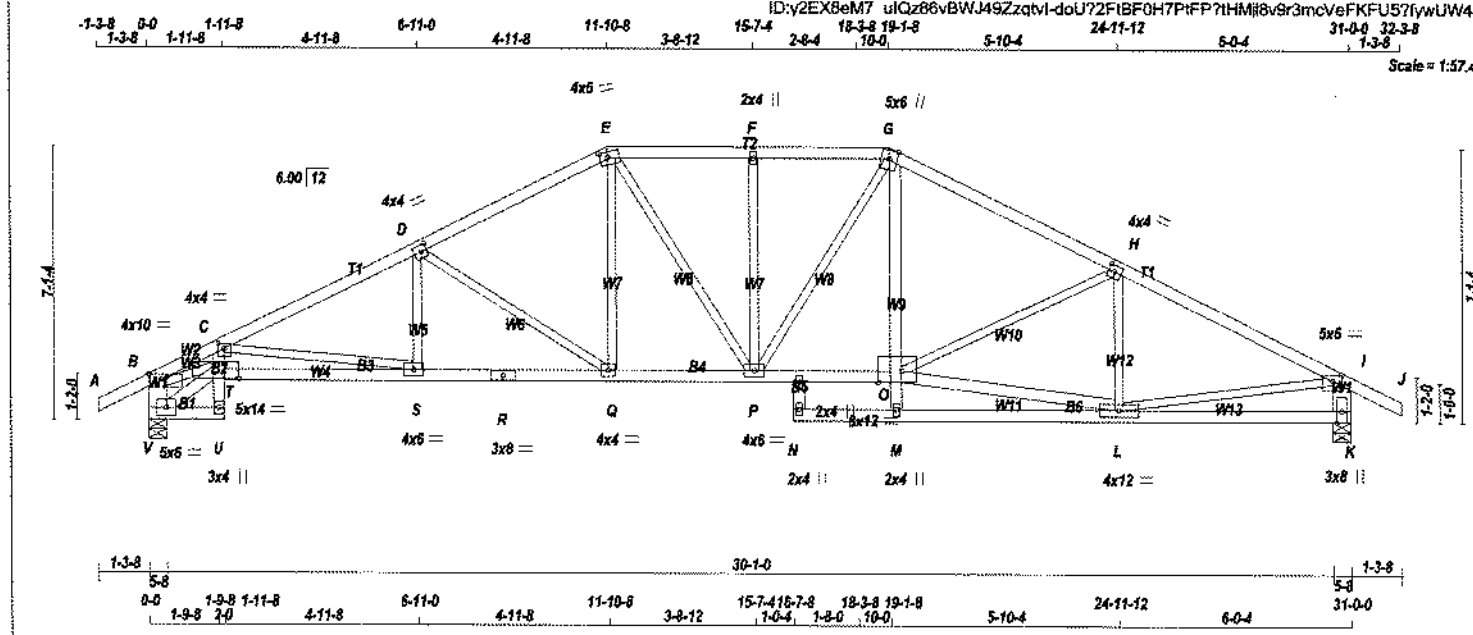

LUMBER N. L. G. A. RULES CHORDS SIZE A - E 2x4 DRY No.2 SPF E - D 2x4 DRY No.2 SPF G - J 2x4 DRY No.2 SPF V - B 2x6 DRY No.2 SPF K - I 2x6 DRY No.2 SPF V - U 2x4 DRY No.2 SPF U - C 2x4 DRY No.2 SPF T - R 2x4 DRY No.2 SPF R - O 2x4 DRY No.2 SPF N - K 2x4 DRY No.2 SPF ALL WEBS EXCEPT M - G 2x4 DRY No.2 SPF O - L 2x4 DRY No.2 SPF V - T 2x4 DRY No.2 SPF DRY: SEASONED LUMBER				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 36.7 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2015, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (1.03") CALCULATED VERT. DEFL. (LL) = L/899 (0.16") ALLOWABLE DEFL. (TL) = L/360 (1.03") CALCULATED VERT. DEFL. (TL) = L/999 (0.32") CSI: TC=0.49/1.00 (H=1), BC=0.73/1.00 (S=T), WB=0.81/1.00 (B=T), SS=0.44/1.00 (C=T) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.06 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (I) (INPUT = 0.90) JSI METAL= 0.83 (R) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW-p MT20 4.0 10.0 1.00 5.25 C TMVW-p MT20 4.0 4.0 1.50 2.00 D TMVW-t MT20 4.0 4.0 2.00 1.75 E ITWW-m MT20 4.0 6.0 1.75 2.25 F TMVW-w MT20 2.0 4.0 G TTWW+m MT20 5.0 6.0 Edge H TMVW-t MT20 4.0 4.0 2.00 1.75 I TMVW-p MT20 5.0 6.0 2.00 2.75 K BMV1-p MT20 3.0 8.0 Edge L BMVWW-t MT20 4.0 12.0 M BMVW-w MT20 2.0 4.0 N NP+w MT20 2.0 4.0 O BWVWW-t MT20 8.0 12.0 3.50 7.25 P BMVWW-t MT20 4.0 6.0 Q BMVWW-t MT20 4.0 4.0 R BS-t MT20 3.0 8.0 S BMVWW-t MT20 4.0 6.0 T BVVWW-t MT20 5.0 14.0 3.75 7.75 U BMVW-p MT20 3.0 4.0 V BMVW-t MT20 5.0 6.0				BEARINGS FACTORED GROSS REACTION JT VERT 1745 0 K 1738 0 V 1738 0 MAXIMUM FACTORED GROSS REACTION DOWN 1745 0 HORZ 1738 0 UPLIFT 0 0 INPUT BRG IN-SX 5-8 5-8 REQD BRG IN-SX 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL K 1239 784 / 0 0 / 0 0 / 0 456 / 0 0 / 0 V 1233 786 / 0 0 / 0 0 / 0 447 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, V BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.30 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX. MAX. UNBRAC LENGTH FR-TO FROM TO FR-TO FROM TO A-B 0 / 26 -84.9 -84.9 0.11 (1) 10.00 Q-E 0 / 516 0.12 (1) B-C -4041 / 0 -84.9 -84.9 0.30 (1) 3.30 L-H -557 / 0 0.15 (1) C-D -2996 / 0 -84.9 -84.9 0.47 (1) 3.63 L-I 0 / 2180 0.49 (1) D-E -2317 / 0 -84.9 -84.9 0.38 (1) 4.15 M-O 0 / 100 0.08 (1) E-F -2203 / 0 -84.9 -84.9 0.18 (1) 4.45 O-G 0 / 544 0.15 (1) F-G -2203 / 0 -84.9 -84.9 0.18 (1) 4.45 O-L 0 / 2144 0.34 (1) G-H -2365 / 0 -84.9 -84.9 0.48 (1) 4.01 O-H -77 / 0 0.06 (1) H-I -2387 / 0 -84.9 -84.9 0.49 (1) 3.99 V-T -365 / 0 0.04 (1) I-J 0 / 26 -84.9 -84.9 0.11 (1) 10.00 B-T 0 / 3613 0.81 (1) V-B -1527 / 0 0.0 0.0 0.10 (1) 7.81 E-P 0 / 270 0.06 (1) K-I -1699 / 0 0.0 0.0 0.11 (1) 7.59 P-F -365 / 0 0.21 (1) P-G 0 / 229 0.05 (1) V-U 0 / 309 -18.5 -18.5 0.08 (1) 10.00 C-S -1442 / 0 0.85 (1) U-T 0 / 19 0.0 0.0 0.48 (1) 10.00 S-D 0 / 200 0.05 (4) T-C 0 / 539 0.0 0.0 0.57 (1) 10.00 D-Q -793 / 0 0.51 (1) T-S 0 / 4139 -18.5 -18.5 0.73 (1) 10.00 S-R 0 / 2711 -18.5 -18.5 0.48 (1) 10.00 R-Q 0 / 2711 -18.5 -18.5 0.48 (1) 10.00 Q-P 0 / 2057 -18.5 -18.5 0.37 (1) 10.00 P-O 0 / 2084 -18.5 -18.5 0.37 (1) 10.00 N-M 0 / 0 -18.5 -18.5 0.15 (4) 10.00 M-L 0 / 48 -18.5 -18.5 0.17 (4) 10.00 L-K 0 / 0 -18.5 -18.5 0.17 (4) 10.00			

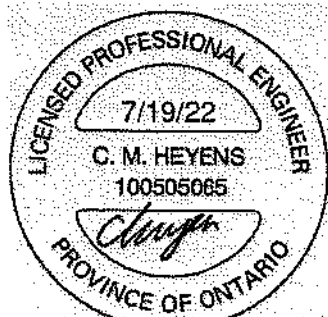

STRUCTURAL COMPONENT ONLY
DWG # TR22070355 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424088	T4S1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:35:37 2022 Page 2
ID: y2EX8em7 ulQz86v8WJ49Zzotvl-dou72FIBF0H7PtFP7tHMI8v9r3mcVeFKFU57fwUW4

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
W NP+W	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.



STRUCTURAL COMPONENT ONLY
DWG # TR22070355 PG 2/2

STRUCTURAL COMPONENT ONLY
DWG # TR22070330

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T6	9	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:14 2022 Page 1

ID: v2EX8eM7 uIQz86vBWJ49Zzqtvi-R8y8dGytZt6nb0yOK4mxoSiCP9skmrkVUKPtywUmn

1-3-8 0-0 4-6-0 4-8-0 5-10-13 10-4-13 5-1-3 15-6-0 5-1-3 20-7-3 5-10-13 28-6-0 4-6-0 31-0-0 32-3-8 1-3-8

4x6 ||

Scale = 1:59.3

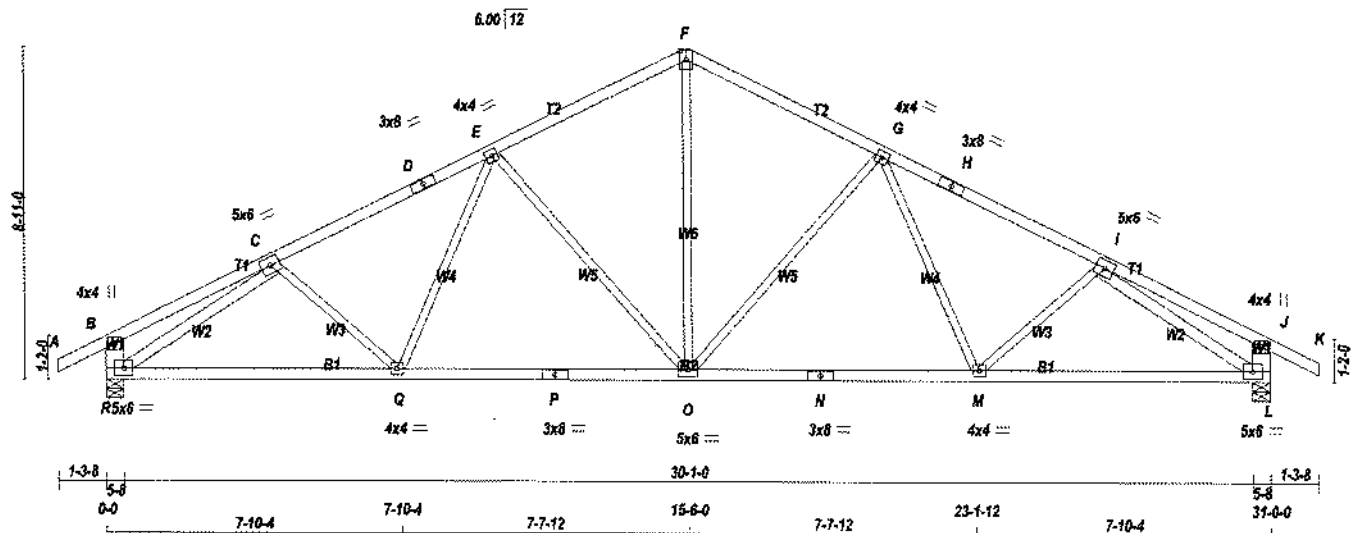


LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - P	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
R - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	4.0	4.0	
C TMWW-t	MT20	5.0	6.0	
D TS-t	MT20	3.0	8.0	
E TMWW-t	MT20	4.0	4.0	
F TTW+p	MT20	4.0	6.0	Edge
G TMWW-t	MT20	4.0	4.0	
H TS-t	MT20	3.0	8.0	
I TMWW-t	MT20	5.0	6.0	
J TMV+p	MT20	4.0	4.0	
L BMWW-t	MT20	5.0	6.0	
M BMWW-t	MT20	4.0	4.0	
N BS-t	MT20	3.0	8.0	
O BMWW-t	MT20	4.0	6.0	
P BS-t	MT20	3.0	8.0	
Q BMWW-t	MT20	4.0	4.0	
R BMWW-t	MT20	5.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

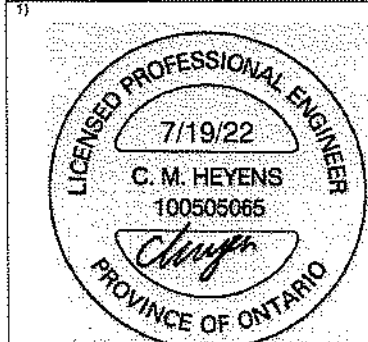

STRUCTURAL COMPONENT ONLY
DWG # TR22070331

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG
R	1717	0	1717	0	0	0	5-8	5-8	5-8
L	1717	0	1717	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1217	785 / 0	0 / 0	0 / 0	0 / 0
L	1217	785 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 26	-84.9	-84.9 0.11 (1)	0-F	0 / 1112
B-C	0 / 20	-84.9	-84.9 0.27 (1)	0-G	-644 / 0
C-D	-2188 / 0	-84.9	-84.9 0.38 (1)	0-H	0 / 227
D-E	-2188 / 0	-84.9	-84.9 0.38 (1)	M-I	-76 / 43
E-F	-1646 / 0	-84.9	-84.9 0.32 (1)	E-O	-644 / 0
F-G	-1646 / 0	-84.9	-84.9 0.32 (1)	Q-E	0 / 227
G-H	-2188 / 0	-84.9	-84.9 0.38 (1)	C-Q	-76 / 43
H-I	-2188 / 0	-84.9	-84.9 0.38 (1)	R-C	-2458 / 0
I-J	0 / 20	-84.9	-84.9 0.27 (1)	I-L	-2458 / 0
J-K	0 / 26	-84.9	-84.9 0.11 (1)		
R-B	-257 / 0	0.0	0.0 0.02 (1)		
L-J	-257 / 0	0.0	0.0 0.02 (1)		
R-Q	0 / 2017	-18.5	-18.5 0.46 (1)		
Q-P	0 / 1873	-18.5	-18.5 0.44 (1)		
P-O	0 / 1873	-18.5	-18.5 0.44 (1)		
O-N	0 / 1873	-18.5	-18.5 0.44 (1)		
N-M	0 / 1873	-18.5	-18.5 0.44 (1)		
M-L	0 / 2017	-18.5	-18.5 0.46 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.38/1.00 (G-I), BC=0.46/1.00 (L-M), WB=0.85/1.00 (G-O), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (R) (INPUT = 0.90)
JSI METAL= 0.65 (P) (INPUT = 1.00)

LATERAL BRACES TO BE A MINIMUM OF 2X4 SPF #2

JOB NAME 424086	TRUSS NAME T7	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Jul 19 16:49:08 2022 Page 2
ID: y2EX8eM7 uIQz86vBWJ49ZzqtV-Zz1UNVqCeOaS77A3ncVzu6R08Dy6kKPS6YVfqwSYv

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.25	3.00
C	TTWW+m	MT20	6.0	10.0	4.00	1.25
D, F, I						
D	TMWW-t	MT20	4.0	6.0		
E	TMW+w	MT20	3.0	8.0		
G	TS-t	MT20	5.0	6.0		
H	TMW+w	MT20	3.0	8.0		
J	TTWW+m	MT20	6.0	10.0	4.00	1.25
K	TMVW-p	MT20	5.0	6.0	1.25	3.00
M	BMV1+p	MT20	3.0	8.0		
N, O, T, U						
N	BMWW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	8.0		
Q	BMWWW-t	MT20	5.0	8.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
V	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

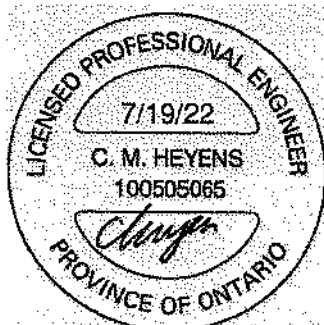

STRUCTURAL COMPONENT ONLY
DWG # TR22070333 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T8	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:50 2022 Page 1

ID:V2EX8eM7 uiQz86vBWJ49Zzotvi-c38JhwhXOcP767mtVuiDPOxmowTaA9Q1n42JBWwUlp

31-00 32-3-8 1-3-8

Scale = 1:56.4

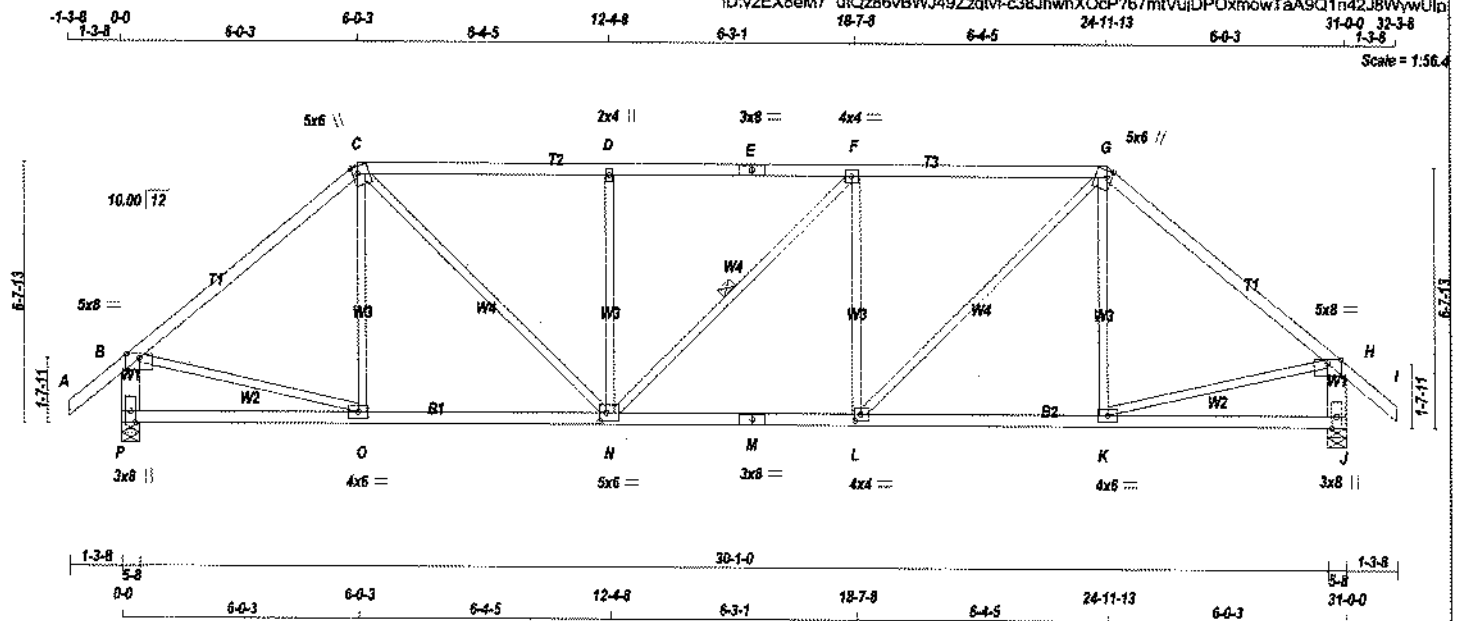

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
P - B	2x6	DRY	No.2	SPF
J - H	2x6	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW-w	MT20	2.0	4.0		
E	TS-t	MT20	3.0	8.0		
F	TMVW-t	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.25	1.50
H	TMVW-p	MT20	5.0	8.0	Edge	
J	BMV1+p	MT20	3.0	8.0	Edge	
K	BMVW-t	MT20	4.0	6.0		
L	BMVW-t	MT20	4.0	4.0	2.00	1.75
M	BS-t	MT20	3.0	8.0		
N	BMVW-w-t	MT20	5.0	6.0	2.50	2.00
O	BMVW-t	MT20	4.0	6.0		
P	BMV1+p	MT20	3.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
P	1720	0	1720	0	0	5-8	5-8	5-8	5-8
J	1720	0	1720	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	DEAD	SOIL
P	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0	432 / 0	0 / 0
J	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	O-C	-134 / 47	0.10 (1)	0.10 (1)
B-C	-1617 / 0	-84.9	-84.9 0.72 (1)	C-N	0 / 979	0.22 (1)	0.22 (1)
C-D	-1931 / 0	-84.9	-84.9 0.59 (1)	N-D	-579 / 0	0.42 (1)	0.42 (1)
D-E	-1931 / 0	-84.9	-84.9 0.60 (1)	N-F	-2 / 0	0.00 (1)	0.00 (1)
E-F	-1931 / 0	-84.9	-84.9 0.60 (1)	L-F	-580 / 0	0.42 (1)	0.42 (1)
F-G	-1932 / 0	-84.9	-84.9 0.60 (1)	L-G	0 / 981	0.22 (1)	0.22 (1)
G-H	-1617 / 0	-84.9	-84.9 0.72 (1)	K-G	-135 / 47	0.10 (1)	0.10 (1)
H-I	0 / 38	-84.9	-84.9 0.12 (1)	B-O	0 / 1268	0.29 (1)	0.29 (1)
P-B	-1675 / 0	0.0	0.0 0.12 (1)	K-H	0 / 1268	0.29 (1)	0.29 (1)
J-H	-1675 / 0	0.0	0.0 0.12 (1)				
P-O	0 / 0	-18.5	-18.5 0.17 (4)				
O-N	0 / 1238	-18.5	-18.5 0.30 (1)				
N-M	0 / 1932	-18.5	-18.5 0.38 (1)				
M-L	0 / 1932	-18.5	-18.5 0.38 (1)				
L-K	0 / 1238	-18.5	-18.5 0.30 (1)				
K-J	0 / 0	-18.5	-18.5 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CS1: TC=0.72/1.00 (B-C:1), BC=0.38/1.00 (L-N:1), WB=0.42/1.00 (F-L:1), SSI=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)

JSI METAL= 0.64 (M) (INPUT = 1.00)

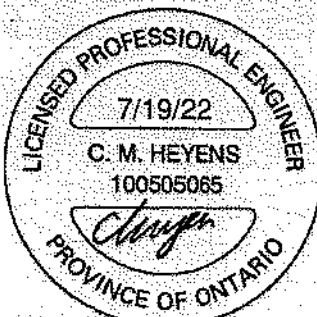

STRUCTURAL COMPONENT ONLY
DWG # TR22070334

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T9	2	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 18 14:18:51 2022 Page 1

ID: y2EX8eM7 uIQz86vBWJ49Zzqtvi-4FhhvG199wXsH33bESxbU00kPLvXVA7knsqzywJlo

1-3-8 0-0 3-10-15 3-10-15 3-8-7 7-7-6 5-3-8 12-10-14 5-2-4 18-1-2 5-3-8 23-4-10 3-8-7 27-1-1 3-10-15 31-0-0 1-3-8

Scale = 1:56.7

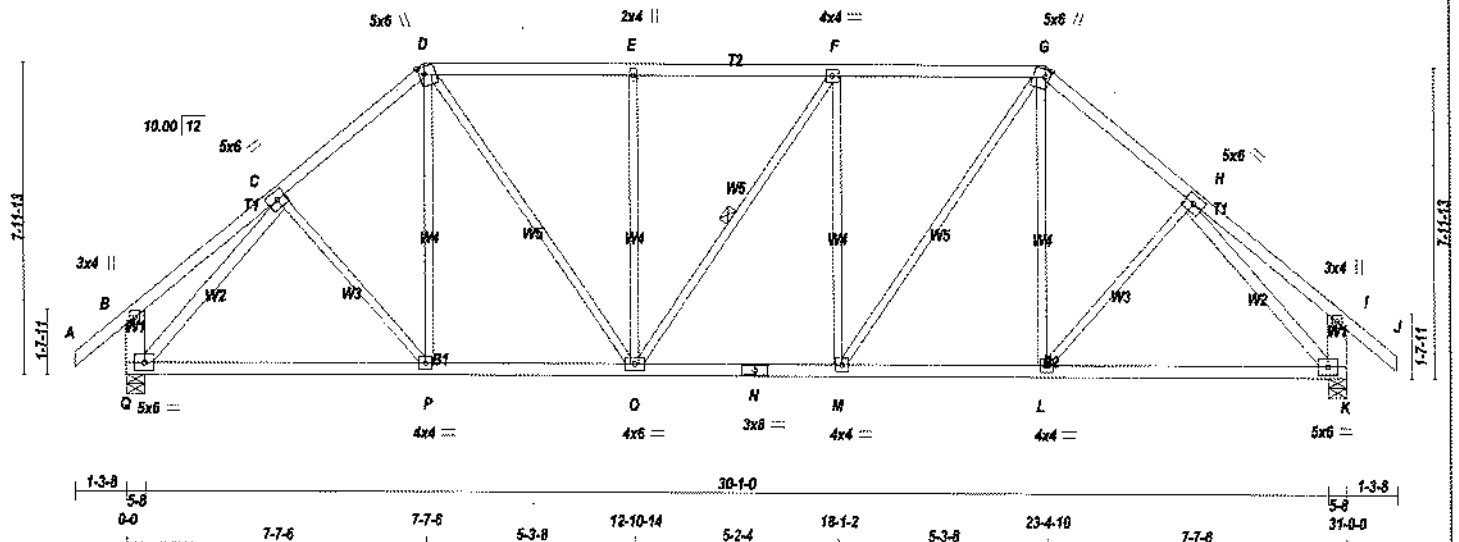

TOTAL WEIGHT = 2 X 152 = 305 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - N	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
Q - C	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-l	MT20	5.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.25	1.50
H	TMWW-t	MT20	5.0	6.0		
I	TMV+p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	6.0		
L, M, P						
L	BMWW-l	MT20	4.0	4.0		
N	BS-l	MT20	3.0	6.0		
O	BMWWW-l	MT20	4.0	6.0		
Q	BMVW-l	MT20	5.0	6.0		

NOTES (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERY	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
Q	1720	0	1720	0	0	5-8	5-8	5-8	5-8
K	1720	0	1720	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0
K	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 38	-84.9 -84.9	0.12 (1)	10.00	C-P	0 / 49 0.02 (4)	
B-C	0 / 23	-84.9 -84.9	0.19 (1)	10.00	P-D	0 / 139 0.04 (4)	
C-D	-1604 / 0	-84.9 -84.9	0.24 (1)	4.98	D-O	0 / 682 0.15 (1)	
D-E	-1600 / 0	-84.9 -84.9	0.37 (1)	4.81	O-E	-479 / 0 0.58 (1)	
E-F	-1600 / 0	-84.9 -84.9	0.37 (1)	4.80	C-F	-3 / 0 0.30 (1)	
F-G	-1601 / 0	-84.9 -84.9	0.38 (1)	4.80	M-F	-480 / 0 0.58 (1)	
G-H	-1604 / 0	-84.9 -84.9	0.24 (1)	4.98	M-G	0 / 684 0.15 (1)	
H-I	0 / 23	-84.9 -84.9	0.19 (1)	10.00	L-G	0 / 138 0.04 (4)	
I-J	0 / 38	-84.9 -84.9	0.12 (1)	10.00	L-H	0 / 49 0.02 (4)	
Q-B	-241 / 0	0.0 0.0	0.02 (1)	7.81	Q-C	-1882 / 0 0.73 (1)	
K-I	-241 / 0	0.0 0.0	0.02 (1)	7.81	H-K	-1862 / 0 0.73 (1)	
Q-P	0 / 1205	-18.5 -18.5	0.34 (4)	10.00			
P-O	0 / 1213	-18.5 -18.5	0.35 (4)	10.00			
O-N	0 / 1602	-18.5 -18.5	0.31 (1)	10.00			
N-M	0 / 1602	-18.5 -18.5	0.31 (1)	10.00			
M-L	0 / 1213	-18.5 -18.5	0.34 (4)	10.00			
L-K	0 / 1204	-18.5 -18.5	0.34 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/399 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/985 (0.13")

CSI: TC=0.38/1.00 (F-G:1), BC=0.35/1.00 (O-P:4), WB=0.73/1.00 (C-Q:1), SI=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (C) (INPUT = 0.90)

JSI METAL= 0.54 (N) (INPUT = 1.00)

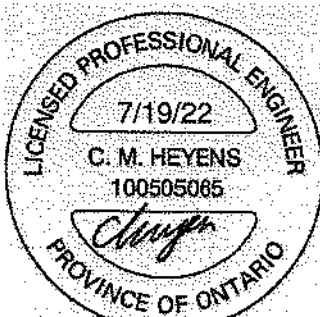

STRUCTURAL COMPONENT ONLY
DWG # TR22070335

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:51 2022 Page 1
ID:y2EX8eM7 ulQz86vBWJ49Zzztvt-4FhhvG99wXslML33bESxbU VKqYvdUA?knsqzywUlo

Scale = 1:64.7

LUMBER

N. L. G. A. RULES

CHORDS SIZE LUMBER DESCR.

A - D 2x4 DRY No.2 SPF

D - F 2x4 DRY No.2 SPF

F - I 2x4 DRY No.2 SPF

R - B 2x6 DRY No.2 SPF

J - H 2x6 DRY No.2 SPF

R - O 2x4 DRY No.2 SPF

O - M 2x4 DRY No.2 SPF

M - J 2x4 DRY No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

D - N 2x4 DRY No.2 SPF

N - F 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE PLATES W LEN Y X

B TMVW-p MT20 5.0 8.0 Edge

C TMWW-t MT20 4.0 4.0 2.00 1.25

D TTWW+m MT20 5.0 6.0 2.25 1.50

E TMW+w MT20 2.0 4.0

F T'WW+m MT20 5.0 6.0 2.25 1.50

G TMWW-t MT20 4.0 4.0 2.00 1.25

H TMVW-p MT20 5.0 8.0 Edge

J BMV1+p MT20 3.0 8.0 Edge

K BMWW-l MT20 5.0 6.0

L BMWW-l MT20 4.0 4.0

M BS-t MT20 3.0 8.0

N BMWW-w MT20 4.0 10.0

O BS-t MT20 3.0 8.0

P BMWW-l MT20 4.0 4.0

Q BMWW-l MT20 5.0 6.0

R BMV1+p MT20 3.0 8.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD BRG BRG

JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX

R 1720 0 1720 0 0 5-8 5-8

J 1720 0 1720 0 0 5-8 5-8

UNFACTORED REACTIONS

1ST LCASE MAX/MIN COMPONENT REACTIONS

JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL

R 1218 788 / 0 0 / 0 0 / 0 0 / 0 432 / 0 0 / 0

J 1218 788 / 0 0 / 0 0 / 0 0 / 0 432 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.90 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNI. BRAC. CSF (LC)

FR-TO FROM TO LENGTH FR-TO

A-B 0 / 38 -84.9 -84.9 0.12 (1) 10.00 C-C -263 / 0 0.12 (1)

B-C -1624 / 0 -84.9 -84.9 0.27 (1) 4.94 C-P -174 / 0 0.16 (1)

C-D -1538 / 0 -84.9 -84.9 0.26 (1) 6.05 P-D 0 / 232 0.05 (4)

D-E -1427 / 0 -84.9 -84.9 0.46 (1) 4.90 D-N 0 / 471 0.08 (1)

E-F -1427 / 0 -84.9 -84.9 0.46 (1) 4.90 N-E -853 / 0 0.37 (1)

F-G -1538 / 0 -84.9 -84.9 0.26 (1) 5.05 N-F 0 / 471 0.08 (1)

G-H -1624 / 0 -84.9 -84.9 0.27 (1) 4.94 L-F 0 / 232 0.05 (4)

H-I 0 / 38 -84.9 -84.9 0.12 (1) 10.00 L-G -174 / 0 0.16 (1)

R-B -1682 / 0 0.0 0.0 0.12 (1) 7.62 K-G -283 / 0 0.12 (1)

J-H -1682 / 0 0.0 0.0 0.12 (1) 7.62 B-Q 0 / 1318 0.30 (1)

K-H 0 / 1318 0.30 (1)

R-Q 0 / 0 -18.5 -18.5 0.08 (4) 10.00

Q-P 0 / 1270 -18.5 -18.5 0.26 (1) 10.00

P-O 0 / 1158 -18.5 -18.5 0.27 (1) 10.00

O-N 0 / 1158 -18.5 -18.5 0.27 (1) 10.00

N-M 0 / 1158 -18.5 -18.5 0.27 (1) 10.00

M-L 0 / 1158 -18.5 -18.5 0.27 (1) 10.00

L-K 0 / 1270 -18.5 -18.5 0.26 (1) 10.00

K-J 0 / 0 -18.5 -18.5 0.08 (4) 10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

-PART 9 OF CBC 2015, ABC 2019

-PART 9 OF CBC 2012 (2019 AMENDMENT)

-CSA 086-14

-TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.46/1.00 (D-E), BC=0.27/1.00 (L-N), WB=0.37/1.00 (E-N), SS=0.26/1.00 (D-E)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (C) (INPUT = 0.90)
JSI METAL= 0.38 (O) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY
DWG # TR22070336

PROFESSIONAL ENGINEER
7/19/22
C. M. HEYENS
100505065
PROVINCE OF ONTARIO


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T11	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:52 2022 Page 2
ID: y2EX8eM7 ulQz88vBWJ49Zzgtvl-YRF36cinwEflRwFdlihUp0ASKAie3PKEOXQCPywUtn

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

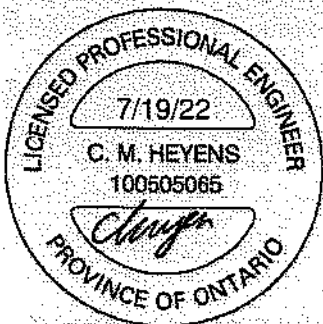


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T12	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID: 2EX8eM7 ulQz86vBWJ49Zzqtvl-0epSKykPhXnazbVRA0Gw00ZP67XHNYTT2GzirywUln

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Tue Jul 19 14:18:53 2022 Page 1

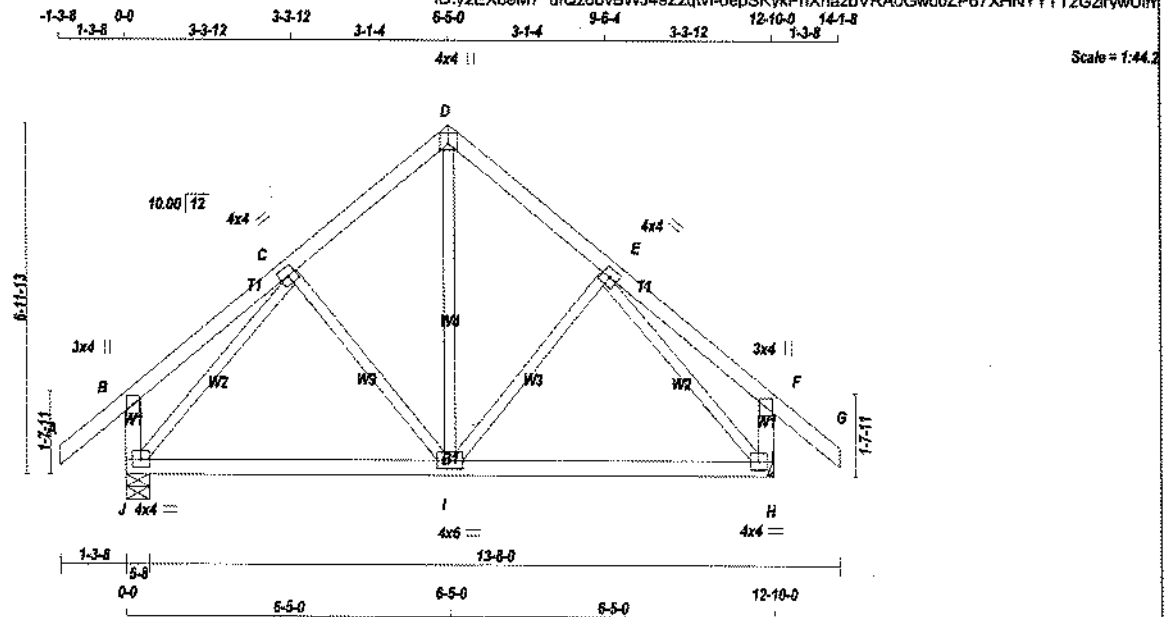

TOTAL WEIGHT = 2 X 61 = 123 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
CHORDS	SIZE	DRY	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 23.3 PSF	
D - G	2x4	DRY	No.2	SPF	JT	VERT	DOWN	IN-SX	IN-SX	DL = 6.0 PSF	
J - B	2x4	DRY	No.2	SPF	H	781	0	0	5-8	BOT CH. LL = 0.0 PSF	
H - F	2x4	DRY	No.2	SPF	H	781	0	0	MECHANICAL	DL = 7.4 PSF	
J - H	2x4	DRY	No.2	SPF						TOTAL LOAD = 38.7 PSF	
ALL WEBS	2x3	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.						
EXCEPT										SPACING = 24.0 IN. C/C	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-l	MT20	4.0	4.0		
D	TTW+p	MT20	4.0	4.0	1.50	2.00
E	TMWW-l	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-l	MT20	4.0	4.0		
I	BMVWW-l	MT20	4.0	6.0		
J	BMVW1-l	MT20	4.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	552	363 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0
H	552	363 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 38	-84.9	-84.9 0.12 (1)	10.00	I-D	0 / 342	0.08 (1)
B-C	0 / 20	-84.9	-84.9 0.14 (1)	10.00	I-E	-126 / 0	0.05 (1)
C-D	-453 / 0	-84.9	-84.9 0.11 (1)	6.25	C-I	-126 / 0	0.05 (1)
D-E	-453 / 0	-84.9	-84.9 0.11 (1)	6.25	J-C	-659 / 0	0.27 (1)
E-F	0 / 20	-84.9	-84.9 0.14 (1)	10.00	E-H	-859 / 0	0.27 (1)
F-G	0 / 38	-84.9	-84.9 0.12 (1)	10.00			
J-B	-221 / 0	0.0	0.0 0.02 (1)	7.81			
H-F	-221 / 0	0.0	0.0 0.02 (1)	7.81			
J-I	0 / 413	-18.5	-18.5 0.25 (4)	10.00			
I-H	0 / 413	-18.5	-18.5 0.25 (4)	10.00			

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.14/1.00 (E-F:1), BC=0.25/1.00 (H-I:4), WB=0.27/1.00 (C-I:1), SS1=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.90)

JSI METAL= 0.22 (E) (INPUT = 1.00)

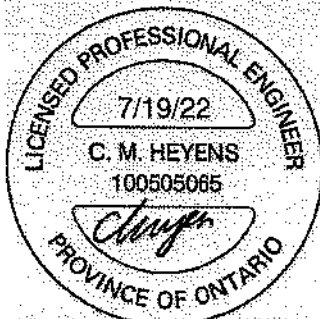


STRUCTURAL COMPONENT ONLY
DWG # TR22070338

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T12S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:54 2022 Page 1
ID:y2EX8eM7 ulCz86vBWJ49Zzqvl-UqNqXlI2SrvRak4ekjo9ZE6b4Xvc62CdhIOWHlywUll

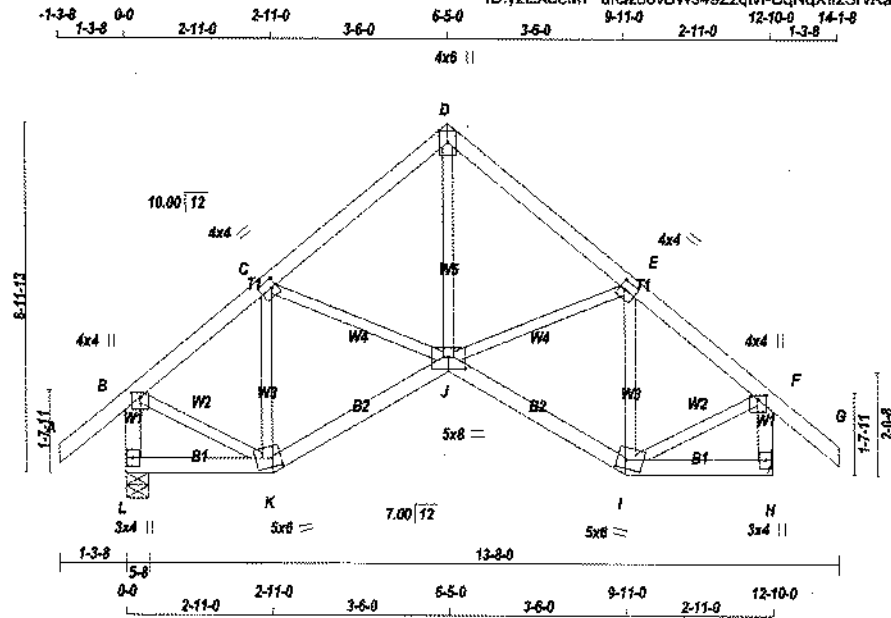

Scale = 1:44.2

TOTAL WEIGHT = 2 X 62 = 124 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
L - B	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		
L - K	2x4 DRY	No.2	SPF		
K - J	2x4 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
I - H	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMVW-t	MT20	4.0	4.0	2.00	1.25
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BBVW-m	MT20	5.0	6.0	2.00	2.00
J	BBVW-p	MT20	5.0	8.0	2.75	4.00
K	BBVW-m	MT20	5.0	6.0	2.00	2.00
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
L	781	0	781	0
H	781	0	781	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	552	363 / 0	0 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0
H	552	363 / 0	0 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9 -84.9	0.12 (1)	10.00	J-D	0 / 526	0.12 (1)
B-C	-541 / 0	-84.9 -84.9	0.11 (1)	6.25	J-E	0 / 44	0.01 (1)
C-D	-623 / 0	-84.9 -84.9	0.12 (1)	6.25	I-E	-382 / 0	0.09 (1)
D-E	-623 / 0	-84.9 -84.9	0.12 (1)	6.25	C-J	0 / 44	0.01 (1)
E-F	-541 / 0	-84.9 -84.9	0.11 (1)	6.25	K-C	-382 / 0	0.09 (1)
F-G	0 / 38	-84.9 -84.9	0.12 (1)	10.00	B-K	0 / 475	0.11 (1)
L-B	-754 / 0	0.0 0.0	0.08 (1)	7.81	I-F	0 / 475	0.11 (1)
M-F	-754 / 0	0.0 0.0	0.08 (1)	7.81			
L-K	0 / 0	-18.5 -18.5	0.05 (4)	10.00			
K-J	0 / 491	-18.5 -18.5	0.12 (1)	10.00			
J-I	0 / 491	-18.5 -18.5	0.12 (1)	10.00			
I-H	0 / 0	-18.5 -18.5	0.05 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.12/1.00 (D-E:1), BC=0.12/1.00 (J-I:1), WB=0.12/1.00 (D-J:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747
	788	1987	1573

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (B) (INPUT = 0.90)
JSI METAL= 0.18 (B) (INPUT = 1.00)

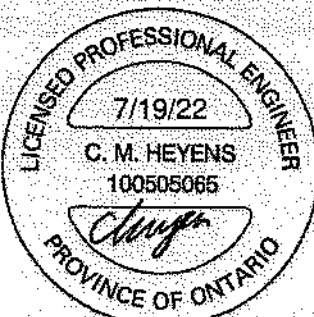


STRUCTURAL COMPONENT ONLY
DWG # TR22070339

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T13	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID: y2EX8eM7 utQz86vBWJ49Zzqtl-v0xCleqD91ICufqRJO6RemoxC2rTVmwM4pkywUlk

Version 8.530 5 Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:53 2022 Page 1

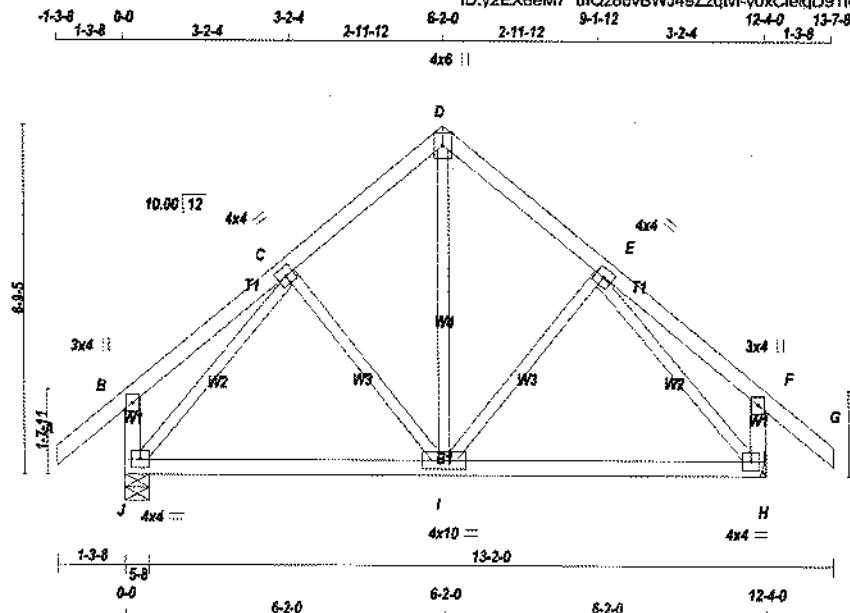

Scale = 1:42.5

TOTAL WEIGHT = 5 X 59 = 297 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED
A - D	2x4	DRY	No.2	SPF	SPF	GROSS REACTION	GROSS REACTION
D - G	2x4	DRY	No.2	SPF	JT	VERT	DOWN
J - B	2x4	DRY	No.2	SPF	H	HORZ	UPLIFT
H - F	2x4	DRY	No.2	SPF			
J - H	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.		
EXCEPT							

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	4.0	4.0		
D TTW+p	MT20	4.0	6.0	Edge	
E TMWW-t	MT20	4.0	4.0		
F TMV+p	MT20	3.0	4.0		
H BMVW1-t	MT20	4.0	4.0		
I BMWWW-t	MT20	4.0	10.0		
J BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
J	534 352 / 0 0 / 0 0 / 0 182 / 0 0 / 0
H	534 352 / 0 0 / 0 0 / 0 182 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 38	-84.9 -84.9	0.12 (1)	10.00	I-D	0 / 323	0.07 (1)
B-C	0 / 19	-84.9 -84.9	0.13 (1)	10.00	I-E	-118 / 0	0.05 (1)
C-D	-432 / 0	-84.9 -84.9	0.10 (1)	6.25	C-I	-118 / 0	0.05 (1)
D-E	-432 / 0	-84.9 -84.9	0.10 (1)	6.25	J-C	-630 / 0	0.24 (1)
E-F	0 / 19	-84.9 -84.9	0.13 (1)	10.00	E-H	-630 / 0	0.24 (1)
F-G	0 / 38	-84.9 -84.9	0.12 (1)	10.00			
J-B	-218 / 0	0.0 0.0	0.02 (1)	7.81			
H-F	-218 / 0	0.0 0.0	0.02 (1)	7.81			
J-I	0 / 392	-18.5 -18.5	0.23 (4)	10.00			
I-H	0 / 392	-18.5 -18.5	0.23 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.41")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.01")
ALLOWABLE DEFL. (TL) = 1/360 (0.41")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.04")

CSI: TC=0.13/1.00 (E-F:1), BC=0.23/1.00 (I-J:4), WB=0.24/1.00 (E-H:1), SS=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (C) (INPUT = 0.90)
JSI METAL= 0.21 (C) (INPUT = 1.00)

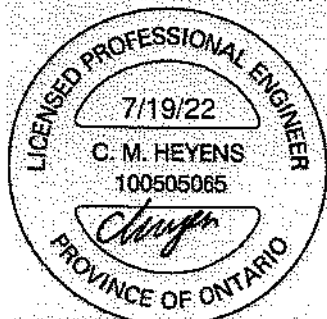

STRUCTURAL COMPONENT ONLY
DWG # TR22070340

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T13S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITEX Industries, Inc. Tue Jul 19 14:18:56 2022 Page 2
ID:y2EX8eM7 utQz86vBWJ49Zzqtl-QDVay mI S99c2E0s8gdefBw5LPhatrv90VdLAywUli


JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.32 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070341 PG 2/2

JOB NAME 424086	TRUSS NAME T14S	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Tue Jul 19 14:18:56 2022 Page 1
ID:y2EX8eM7 ulQz85vBWJ49Zzqtvi-QdVay ml S99q2E0s8qdefBxhLb1azfv90VdLAywuUj

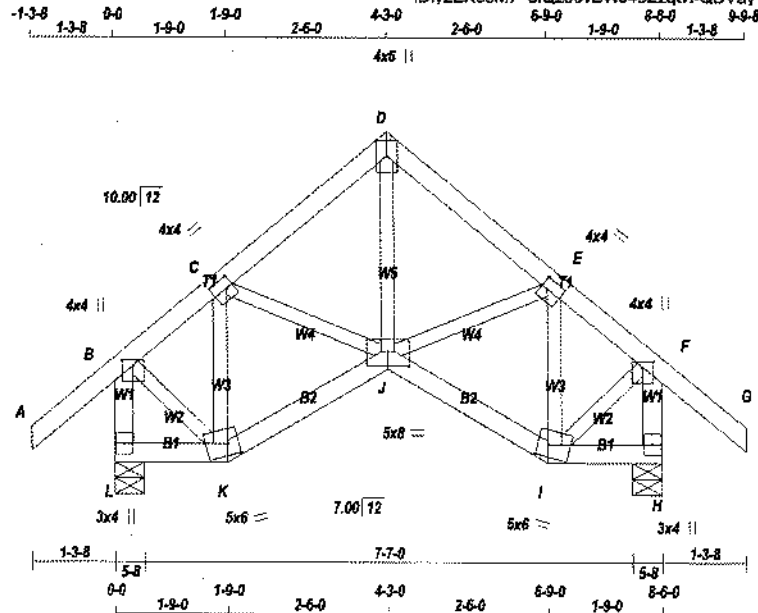

Scale = 1/32"

TOTAL WEIGHT = 44 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - K	2x4	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	4.0	1.00 2.00
C	TMWW-t	MT20	4.0	4.0	2.00 1.25
D	TTW+p	MT20	4.0	6.0	Edge
E	TMWW-t	MT20	4.0	4.0	2.00 1.25
F	TMWV+p	MT20	4.0	4.0	1.00 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BBWW-m	MT20	5.0	6.0	2.25 2.00
J	BBWWV-p	MT20	5.0	8.0	2.75 4.00
K	BBWW-m	MT20	5.0	6.0	2.25 2.00
L	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
L	557	0	557	0	0	5-8	5-8	5-8	5-8
H	557	0	557	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SO
L	393	262 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0
H	393	262 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CSI (LC)	LENGTH		(LBS)	CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 38	-84.9	-84.9 0.12 (1)	10.00	J-D	0 / 226	0.05 (1)
B-C	-267 / 0	-84.9	-84.9 0.09 (1)	6.25	J-E	0 / 62	0.01 (1)
C-D	-338 / 0	-84.9	-84.9 0.07 (1)	6.25	I-E	-229 / 0	0.04 (1)
D-E	-338 / 0	-84.9	-84.9 0.07 (1)	6.25	C-J	0 / 62	0.01 (1)
E-F	-287 / 0	-84.9	-84.9 0.09 (1)	6.25	K-C	-229 / 0	0.04 (1)
F-G	0 / 38	-84.9	-84.9 0.12 (1)	10.00	B-K	0 / 256	0.06 (1)
L-B	-541 / 0	0.0	0.0 0.06 (1)	7.81	I-F	0 / 256	0.06 (1)
H-F	-541 / 0	0.0	0.0 0.06 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 229	-18.5	-18.5 0.06 (1)	10.00			
J-I	0 / 229	-18.5	-18.5 0.06 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/996 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.12/1.00 (F-G:1), BC=0.08/1.00 (J-K:1), WS=0.06/1.00 (B-K:1), SS=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.37 (F) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)

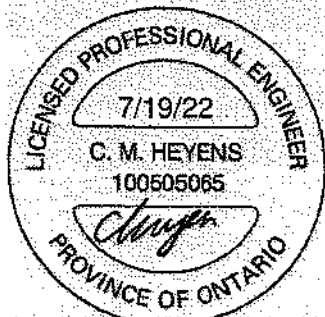


STRUCTURAL COMPONENT ONLY
DWG # TR22070342

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T15	1	2	TRUSS DESC.		

Temarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:57 2022 Page 1
ID: y2EX8eM7 uiQz86vBWJ49Zzqtvi-vP3y9KawlmH7RCpDPsLsBsk7JufjOZ3OqEAucywUli

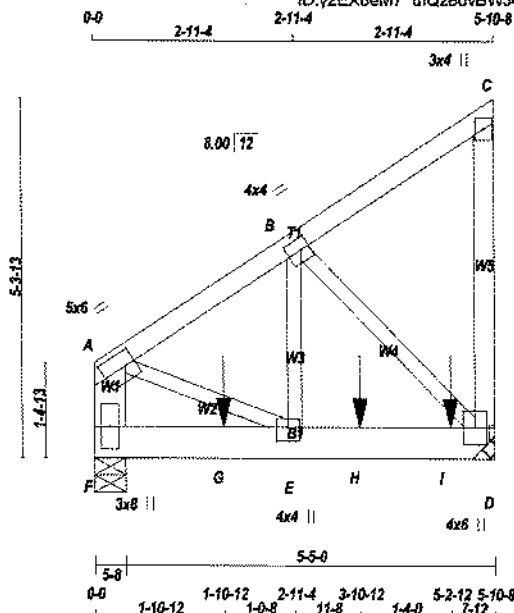

Scale = 1:32.7

TOTAL WEIGHT = 2 X 33 = 66 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - A	2x6	DRY No.2	SPF
F - D	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1 12		TOP
C - D 1 12		TOP
F - A 2 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2 12		SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.6	6.0	2.50 1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
D	1688	0	1688	0
F	1132	0	1132	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1181	797 / 0	0 / 0	0 / 0	0 / 0	394 / 0	0 / 0
F	799	532 / 0	0 / 0	0 / 0	0 / 0	267 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	MAX. UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	-1036 / 0	-84.9	-84.9	0.06 (1)	6.25	E-B	0 / 1162	0.14 (1)	
B-C	-14 / 0	-84.9	-84.9	0.06 (1)	6.25	B-D	-1240 / 0	0.18 (1)	
D-C	-99 / 0	0.0	0.0	0.02 (1)	7.81	A-E	0 / 923	0.11 (1)	
F-A	-978 / 0	0.0	0.0	0.04 (1)	7.81				
F-G	0 / 0	-18.5	-18.5	0.15 (1)	10.00				
G-E	0 / 0	-18.5	-18.5	0.15 (1)	10.00				
E-H	0 / 874	-18.5	-18.5	0.22 (1)	10.00				
H-I	0 / 874	-18.5	-18.5	0.22 (1)	10.00				
I-D	0 / 874	-18.5	-18.5	0.22 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
G	1-10-12	-519	-519	--	BACK	VERT	TOTAL	C1
H	3-10-12	-519	-519	--	BACK	VERT	TOTAL	C1
I	5-2-12	-521	-521	--	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 23.3	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 38.7	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.02")

CSI: TC=0.06/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WE=0.18/1.00 (B-D:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650 371 1747 788 1987 1873	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)

JSI METAL= 0.20 (D) (INPUT = 1.00)

CONTINUED ON PAGE 2

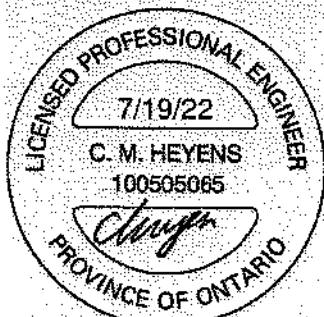

STRUCTURAL COMPONENT ONLY
DWG # TR22070343 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T15	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitak Industries, Inc. Tue Jul 19 14:18:57 2022 Page 2
ID: v2EX8eM7 ulQz86vBW.49Zzqvl-vP3y9KwimIH7RCpDPsLsBsk7JiufJO23CpEAucywUti

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW+t	MT20	4.0	4.0	2.50	2.00
F	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.




STRUCTURAL COMPONENT ONLY
DWG # TR22070343 PG 2/2

JOB NAME 424086	TRUSS NAME T15Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:58 2022 Page 1

ID: y2EX8eM7 uIQz86vBWJ49Zzqtvt-NbdLNfoYwW4Qs3MOPzZs5j4GI28E92rKCcK kQ3ywUth

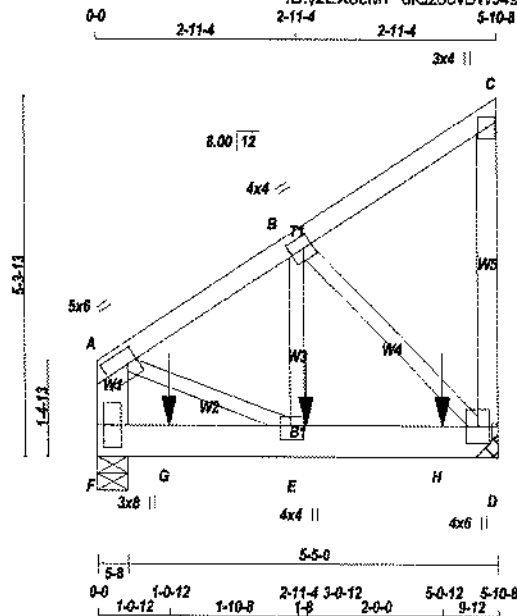

Scale = 1/32"

TOTAL WEIGHT = 2 X 33 = 66 lb

LUMBER				
N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x6	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	12	TOP
F - A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E 1	6	SIDE(15.8)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UOL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ
D	1481	0	1481	0
F	1415	0	1415	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	1045	697 / 0	0 / 0	0 / 0	0 / 0	348 / 0	0 / 0
F	999	666 / 0	0 / 0	0 / 0	0 / 0	332 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
FR-TO		FROM TO		FR-TO			
A-B	-1026 / 0	-84.9	-84.9 0.06 (1)	E-B	0 / 1147	0.14 (1)	
B-C	-14 / 0	-84.9	-84.9 0.06 (1)	B-D	-1227 / 0	0.17 (1)	
D-C	-99 / 0	0.0	0.0 0.02 (1)	A-E	0 / 914	0.11 (1)	
F-A	-970 / 0	0.0	0.0 0.03 (1)				
F-G	0 / 0	-18.5	-18.5 0.17 (1)				
G-E	0 / 0	-18.5	-18.5 0.17 (1)				
E-H	0 / 865	-18.5	-18.5 0.21 (1)				
H-D	0 / 865	-18.5	-18.5 0.21 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-12	-537	-537	---	FRONT	VERT	TOTAL	---	C1
G	1-0-12	-537	-537	---	FRONT	VERT	TOTAL	---	C1
H	5-0-12	-539	-539	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.06/1.00 (A-B:1), BC=0.21/1.00 (D-E:1), WB=0.17/1.00 (B-D:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (E) (INPUT = 0.90)

JSI METAL= 0.19 (D) (INPUT = 1.00)

CONTINUED ON PAGE 2

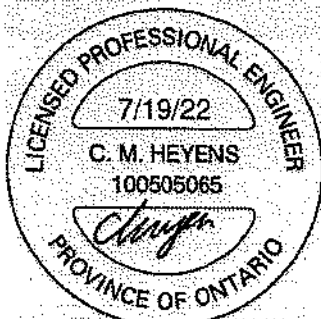

STRUCTURAL COMPONENT ONLY
DWG # TR22070344 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	T15Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:58 2022 Page 2
 ID:y2EX8eM7 uIQz86vBWJ49Zzqtvl-NbdL NioYW4Qs3MOPzZs5i4Gf28E92rKCck kQ3wUJh

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVVW-I	MT20	5.0	6.0	2.50	1.75
B	TMVVW-I	MT20	4.0	4.0	2.00	1.50
C	TMVV+p	MT20	3.0	4.0		
D	BMVVW1+p	MT20	4.0	6.0		
E	BMVVW+I	MT20	4.0	4.0	2.50	1.75
F	BMV1+p	MT20	3.0	8.0		

NOTES (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

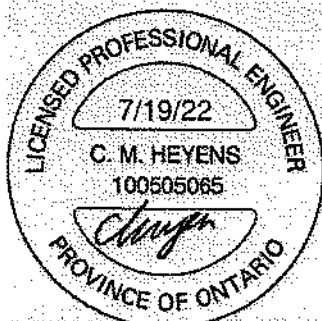

STRUCTURAL COMPONENT ONLY
 DWG # TR22070344 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T20	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:42:57 2022 Page 1

ID:eo87Gik0W0yNucQllyTZzqoVK-kR3LOiCBdChCVuzmHAYYXNBaDJvidPOW3OR9vwUPC

1-3-8 0-0 3-11-4 4-4-2 5-11-4 7-11-8 12-11-13 15-8-0 2-6-3 18-0-3 5-0-5 23-0-8 3-7-6 26-7-14 4-4-2 31-0-0 1-3-8

Scale = 1:56.0

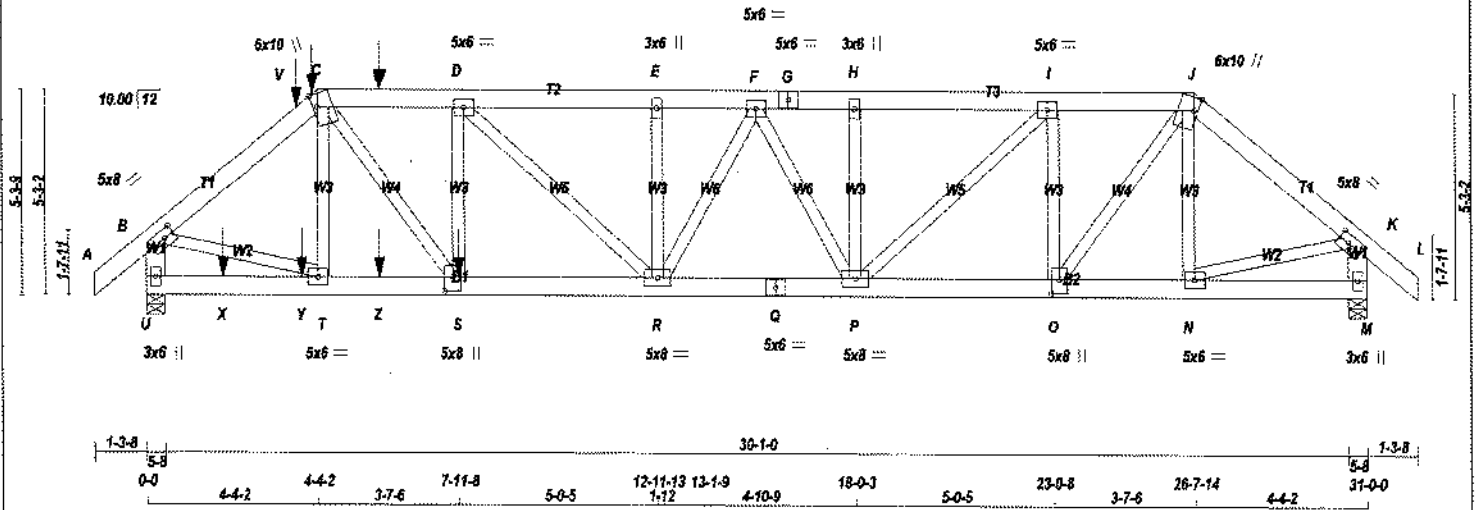

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x6	DRY	No.2
C - G	2x6	DRY	No.2
G - J	2x6	DRY	No.2
J - L	2x6	DRY	No.2
U - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
U - Q	2x6	DRY	No.2
Q - M	2x6	DRY	No.2

ALL WEBS 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2	12	SIDE(122.0)
C - G 2	12	SIDE(61.0)
G - J 2	12	TOP
J - L 2	12	TOP
U - B 2	12	TOP
M - K 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
U - Q 2	12	SIDE(183.1)
Q - M 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x4 1	5	SIDE(427.7)
D - S 1	5	
I - O 1	5	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REGRD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	IN-SX
U	4103	0	4103	0	5-8
M	2434	0	2434	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
U	2905	1885 / 0	0 / 0	0 / 0	0 / 0
M	1724	1117 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 39	T-C	-638 / 0
B-V	-84.9	O-I	-1595 / 0
V-C	-84.9	O-J	0 / 2101
C-W	-3380 / 0	N-J	-389 / 0
W-D	-84.9	B-T	0 / 3529
O-E	-5203 / 0	N-K	0 / 1981
E-F	-84.9	B-D	-250 / 0
F-G	-4450 / 0	C-S	0 / 3268
G-H	-4450 / 0	P-I	0 / 1757
H-I	-4450 / 0	D-R	-245 / 0
I-J	-3179 / 0	P-H	-350 / 0
J-K	-2512 / 0	R-E	-356 / 0
K-L	0 / 39	R-F	0 / 736
U-B	-4055 / 0	F-P	-888 / 0
M-K	-2400 / 0		

U-X	0 / 0	-18.5	-18.5	0.04 (4)	10.00
X-Y	0 / 0	-18.5	-18.5	0.04 (4)	10.00
Y-T	0 / 0	-18.5	-18.5	0.04 (4)	10.00
T-Z	0 / 3406	-18.5	-18.5	0.26 (1)	10.00
Z-S	0 / 3406	-18.5	-18.5	0.26 (1)	10.00
S-R	0 / 5380	-18.5	-18.5	0.39 (1)	10.00
R-Q	0 / 4861	-18.5	-18.5	0.34 (1)	10.00
Q-P	0 / 4861	-18.5	-18.5	0.34 (1)	10.00
P-O	0 / 3179	-18.5	-18.5	0.23 (1)	10.00
O-N	0 / 1911	-18.5	-18.5	0.14 (1)	10.00
N-M	0 / 0	-18.5	-18.5	0.02 (4)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-4-2	-42	-42	---	FRONT	VERT	DEAD	---	C1
C	4-4-2	-162	-162	---	FRONT	VERT	SNOW	---	C1
S	7-11-8	-1659	-1659	---	BACK	VERT	TOTAL	---	C1
V	3-11-4	-128	-128	---	BACK	VERT	TOTAL	---	C1
W	5-11-4	-111	-111	---	BACK	VERT	TOTAL	---	C1
X	1-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
Y	3-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
Z	5-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. - G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.15/1.00 (B-U-1), BC=0.39/1.00 (R-S-1)
WB=0.31/1.00 (B-T-1), SS=0.09/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2

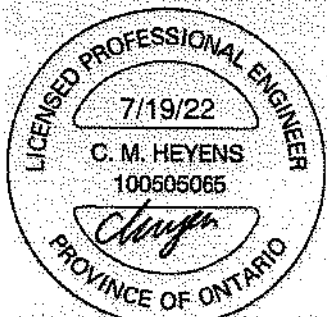

STRUCTURAL COMPONENT ONLY
DWG # TR22070359 PG 1/2

JOB NAME 424089	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.630 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:42:57 2022 Page 2
ID:eo87GikOWdykNugQijYtZtzoVK-kR3LOiCBdGhCVuzmHAYYXNBaDJvidP0W63QR9ywUPC

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	5.0	8.0	2.50	3.25
C TTWW+m	MT20	6.0	10.0	4.00	1.25
D, F, J					
D TMVW-1	MT20	5.0	6.0		
E TMVW+w	MT20	3.0	6.0		
G TS-1	MT20	5.0	6.0		
H TMVW+w	MT20	3.0	6.0		
J TTWW+m	MT20	6.0	10.0	4.00	1.25
K TMVW-1	MT20	5.0	8.0	2.50	3.25
M BMV1+p	MT20	3.0	6.0		
N BMVW-1	MT20	5.0	6.0		
O BMVW+1	MT20	5.0	8.0	4.25	2.50
P BMVWVW-1	MT20	5.0	8.0		
Q BS-1	MT20	3.0	6.0		
R BMVWVW-1	MT20	3.0	8.0		
S BMVWVW+1	MT20	5.0	8.0	4.25	2.50
T BMVW-1	MT20	5.0	6.0		
U BMV1+p	MT20	3.0	6.0		


NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.


JSI GRIP= 0.83 (N) (INPUT = 0.90)
JSI METAL= 0.44 (Q) (INPUT = 1.00)

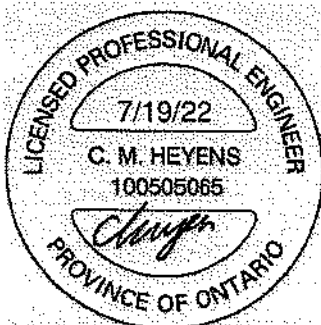

STRUCTURAL COMPONENT ONLY
DWG # TR22070359 PG 2/2

JOB NAME 424089	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:42:58 2022 Page 1
ID:ec87Gik0W0ykNugQlYtZtzoVK-Cddjb2DpOWYqfT9K in5ivEhdqHR279kMpxzywUPB

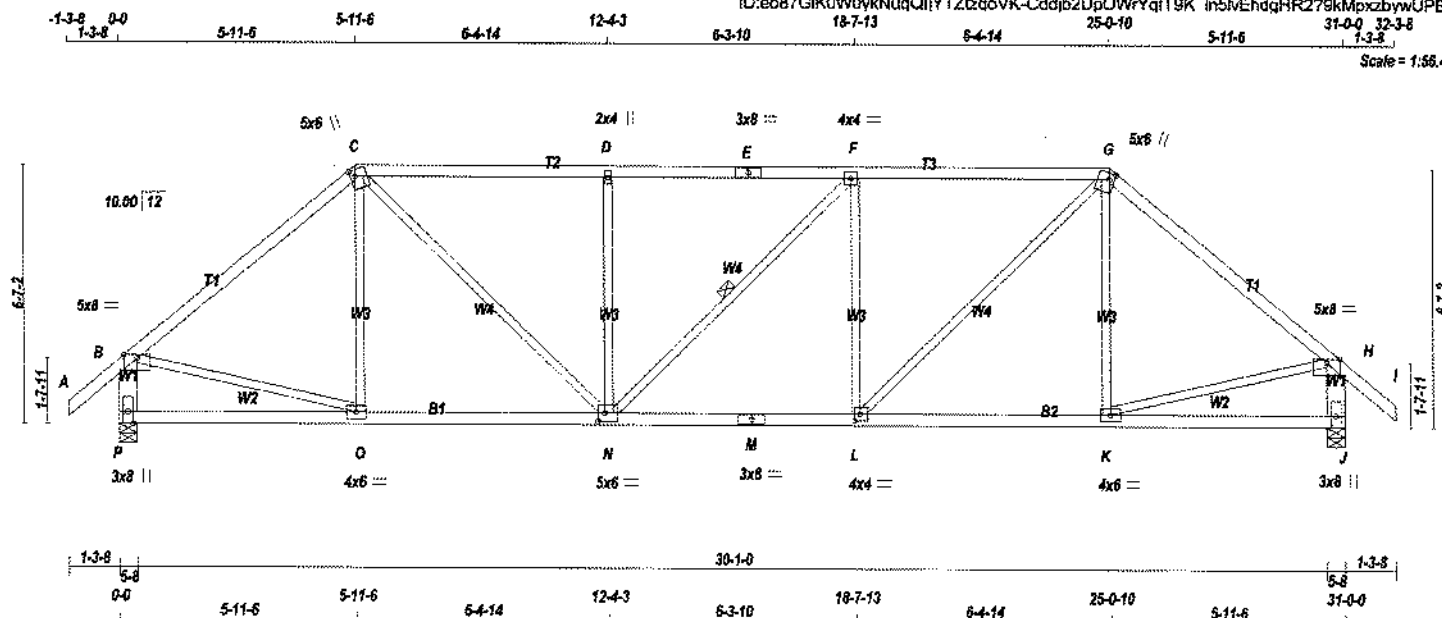

TOTAL WEIGHT = 2 X 134 = 267 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
P - B	2x6	DRY	No.2	SPF
J - H	2x6	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TMVW+m	MT20	2.0	4.0		
E	TS-l	MT20	3.0	8.0		
F	TMVW-l	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	8.0	2.00	1.50
H	TMVW-p	MT20	5.0	8.0	Edge	
J	BMVl+p	MT20	3.0	8.0	Edge	
K	BMVW-l	MT20	4.0	6.0		
L	BMVW-l	MT20	4.0	4.0	2.00	1.75
M	BS-l	MT20	3.0	8.0		
N	BMVW-l	MT20	5.0	6.0	2.50	2.00
O	BMVW-l	MT20	4.0	6.0		
P	BMVl+p	MT20	3.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
P	1720	0	1720	0
J	1720	0	1720	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0
J	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	O-C	-138 / 45	0.10 (1)	
B-C	-1617 / 0	-84.9	-84.9 0.70 (1)	C-N	0 / 895	0.22 (1)	
C-D	-1948 / 0	-84.9	-84.9 0.61 (1)	N-D	-583 / 0	0.42 (1)	
D-E	-1948 / 0	-84.9	-84.9 0.61 (1)	N-F	-2 / 0	0.00 (1)	
E-F	-1948 / 0	-84.9	-84.9 0.61 (1)	L-F	-584 / 0	0.42 (1)	
F-G	-1948 / 0	-84.9	-84.9 0.61 (1)	L-G	0 / 907	0.22 (1)	
G-H	-1617 / 0	-84.9	-84.9 0.70 (1)	K-G	-139 / 45	0.10 (1)	
H-I	0 / 38	-84.9	-84.9 0.12 (1)	B-O	0 / 1269	0.29 (1)	
P-B	-1675 / 0	0.0	0.0 0.12 (1)	K-H	0 / 1269	0.29 (1)	
J-H	-1675 / 0	0.0	0.0 0.12 (1)				
P-O	0 / 0	-18.5	-18.5 0.17 (4)				
O-N	0 / 1238	-18.5	-18.5 0.30 (1)				
N-M	0 / 1950	-18.5	-18.5 0.38 (1)				
M-L	0 / 1950	-18.5	-18.5 0.38 (1)				
L-K	0 / 1238	-18.5	-18.5 0.29 (1)				
K-J	0 / 0	-18.5	-18.5 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.70/1.00 (B-C:1), BC=0.38/1.00 (L-N:1), WB=0.42/1.00 (F-L:1), SSI=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (O) (INPUT = 0.90)
JSI METAL= 0.65 (M) (INPUT = 1.00)

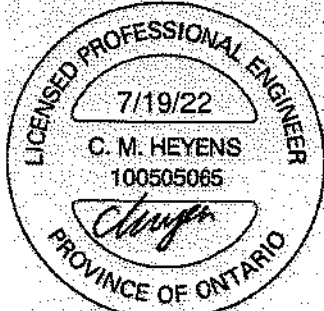

STRUCTURAL COMPONENT ONLY
DWG # TR22070360

JOB NAME 424089	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

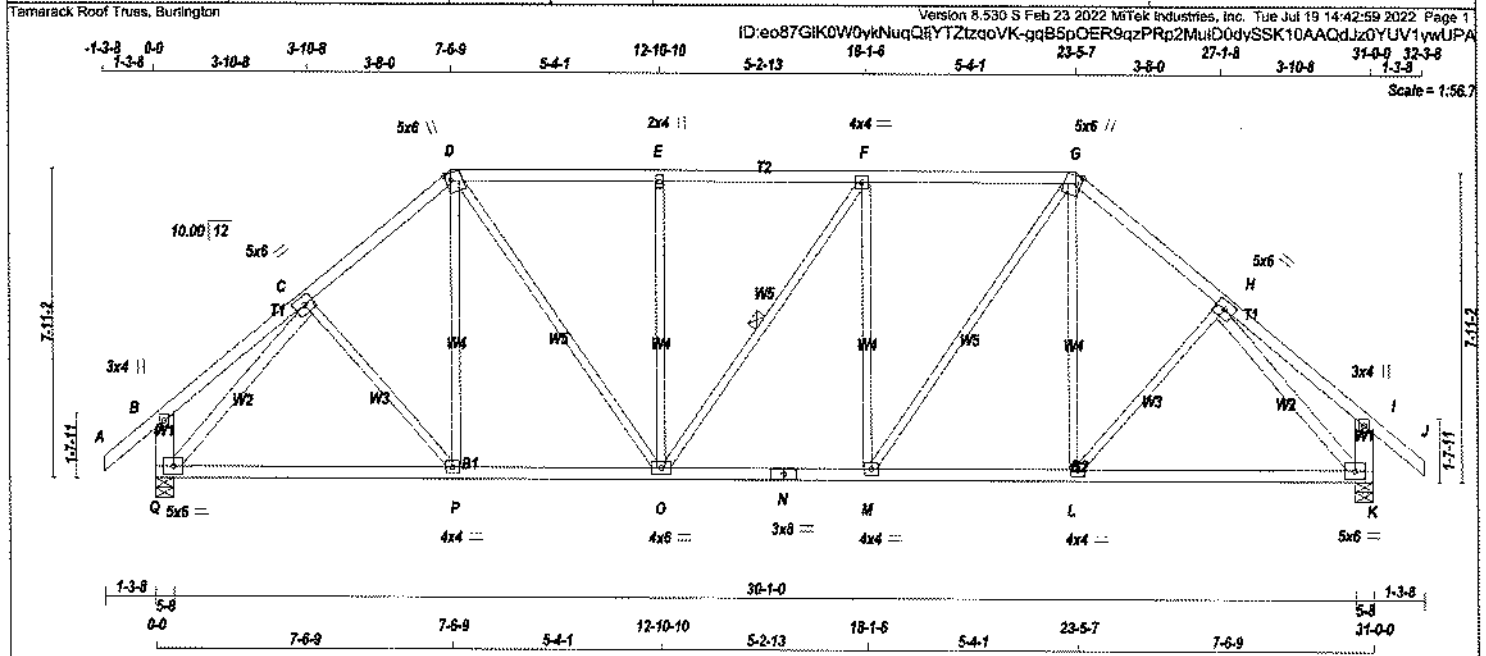

TOTAL WEIGHT = 2 X 152 = 304 lb

[04]

LUMBER				BUILDING DESIGNER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.			
A - D	2x4	DRY	No.2	SPF			
D - G	2x4	DRY	No.2	SPF			
G - J	2x4	DRY	No.2	SPF			
Q - B	2x6	DRY	No.2	SPF			
K - I	2x6	DRY	No.2	SPF			
Q - N	2x4	DRY	No.2	SPF			
N - K	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
Q - C	2x4	DRY	No.2	SPF			
H - K	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	
D	TTWW+m	MT20	5.0	6.0	2.25 1.50
E	TMV+w	MT20	2.0	4.0	
F	TMVW-1	MT20	4.0	4.0	
G	TTWW+m	MT20	5.0	6.0	2.25 1.50
H	TMVW-1	MT20	5.0	6.0	
I	TMV+p	MT20	3.0	4.0	
K	BMVW-1	MT20	5.0	6.0	
L, M, P					
L	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	6.0	
Q	BMVW-1	MT20	5.0	6.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

STRUCTURAL COMPONENT ONLY
DWG # TR22070361


SIZES, SUPPORTS, LOADS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
Q	1720	0		1720	0	0	5-8	5-8	
K	1720	0		1720	0	0	5-8	5-8	
UNFACTORED REACTIONS									
JT	1ST CASE	MAX/MIN COMPONENT REACTIONS							
Q	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
Q	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0		
K	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-O.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 39	-84.9	-84.9	0.12 (1)	10.00	C-P	0 / 51	0.02 (4)	
B-C	0 / 23	-84.9	-84.9	0.19 (1)	10.00	P-D	0 / 134	0.04 (4)	
C-D	-1606 / 0	-84.9	-84.9	0.23 (1)	4.98	D-O	0 / 692	0.16 (1)	
D-E	-1612 / 0	-84.9	-84.9	0.38 (1)	4.79	O-E	-483 / 0	0.57 (1)	
E-F	-1612 / 0	-84.9	-84.9	0.36 (1)	4.77	O-F	-3 / 0	0.00 (1)	
F-G	-1613 / 0	-84.9	-84.9	0.36 (1)	4.77	M-F	-484 / 0	0.58 (1)	
G-H	-1606 / 0	-84.9	-84.9	0.23 (1)	4.98	M-G	0 / 695	0.16 (1)	
H-I	0 / 23	-84.9	-84.9	0.19 (1)	10.00	L-G	0 / 132	0.04 (4)	
I-J	0 / 38	-84.9	-84.9	0.12 (1)	10.00	L-H	0 / 51	0.02 (4)	
Q-B	-246 / 0	0.0	0.0	0.02 (1)	7.81	Q-C	-1862 / 0	0.71 (1)	
K-I	-240 / 0	0.0	0.0	0.02 (1)	7.81	H-K	-1861 / 0	0.71 (1)	
Q-P	0 / 1202	-18.5	-18.5	0.33 (4)	10.00				
P-O	0 / 1215	-18.5	-18.5	0.34 (4)	10.00				
O-N	0 / 1613	-18.5	-18.5	0.31 (1)	10.00				
N-M	0 / 1613	-18.5	-18.5	0.31 (1)	10.00				
M-L	0 / 1214	-18.5	-18.5	0.34 (4)	10.00				
L-K	0 / 1202	-18.5	-18.5	0.33 (4)	10.00				

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")
CS1: TC=0.38/1.00 (F-G:1), BC=0.34/1.00 (O-P:4), WB=0.71/1.00 (C-Q:1), SS=0.21/1.00 (F-G:1)
DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.83 (O) (INPUT = 0.80)
JSI METAL= 0.55 (N) (INPUT = 1.00)



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 8.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/ 38	-84.9	-84.9	0.12 (1)	10.00	C-Q	-274 / 0 0.12 (1)
B-C	-1620 / 0	-84.8	-84.9	0.26 (1)	4.96	C-P	-158 / 0 0.14 (1)
C-D	-1546 / 0	-84.9	-84.9	0.25 (1)	5.05	P-D	0 / 221 0.05 (4)
D-E	-1458 / 0	-84.0	-84.9	0.50 (1)	4.80	D-N	0 / 495 0.08 (1)
E-F	-1458 / 0	-84.9	-84.9	0.50 (1)	4.80	N-E	-675 / 0 0.09 (1)
F-G	-1546 / 0	-84.9	-84.9	0.25 (1)	5.05	N-F	0 / 495 0.08 (1)
G-H	-1620 / 0	-84.9	-84.9	0.26 (1)	4.96	L-F	0 / 221 0.05 (4)
H-I	0 / 39	-84.9	-84.9	0.12 (1)	10.00	I-G	-158 / 0 0.14 (1)
R-B	-1662 / 0	0.0	0.0	0.12 (1)	7.62	K-G	-274 / 0 0.12 (1)
J-H	-1662 / 0	0.0	0.0	0.12 (1)	7.62	B-Q	0 / 1316 0.30 (1)
						K-H	0 / 1316 0.30 (1)
R-Q	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
Q-P	0 / 1266	-18.6	-18.5	0.27 (1)	10.00		
P-O	0 / 1165	-18.5	-18.5	0.26 (1)	10.00		
O-N	0 / 1165	-18.5	-18.5	0.29 (1)	10.00		
N-M	0 / 1165	-18.5	-18.5	0.28 (1)	10.00		
M-L	0 / 1165	-18.5	-18.5	0.28 (1)	10.00		
L-K	0 / 1266	-18.5	-18.5	0.27 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.05")
ALLOWABLE DEFL.(TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI: TC=0.50/1.00 (D-E:1), SC=0.28/1.00 (N-P:1)
WB=0.37/1.00 (E-N:1), SSI=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
	PLATE GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	850	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (K) (INPUT = 0.00)
JSI METAL= 0.43 (O) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T24	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:43:00 2022 Page 1

ID: eo87GikOWoYkNuqQhYTzizqoVK-90T0Kf3w75G3ydYRPkFAA7biQNCvMcSCq122UvwUP9

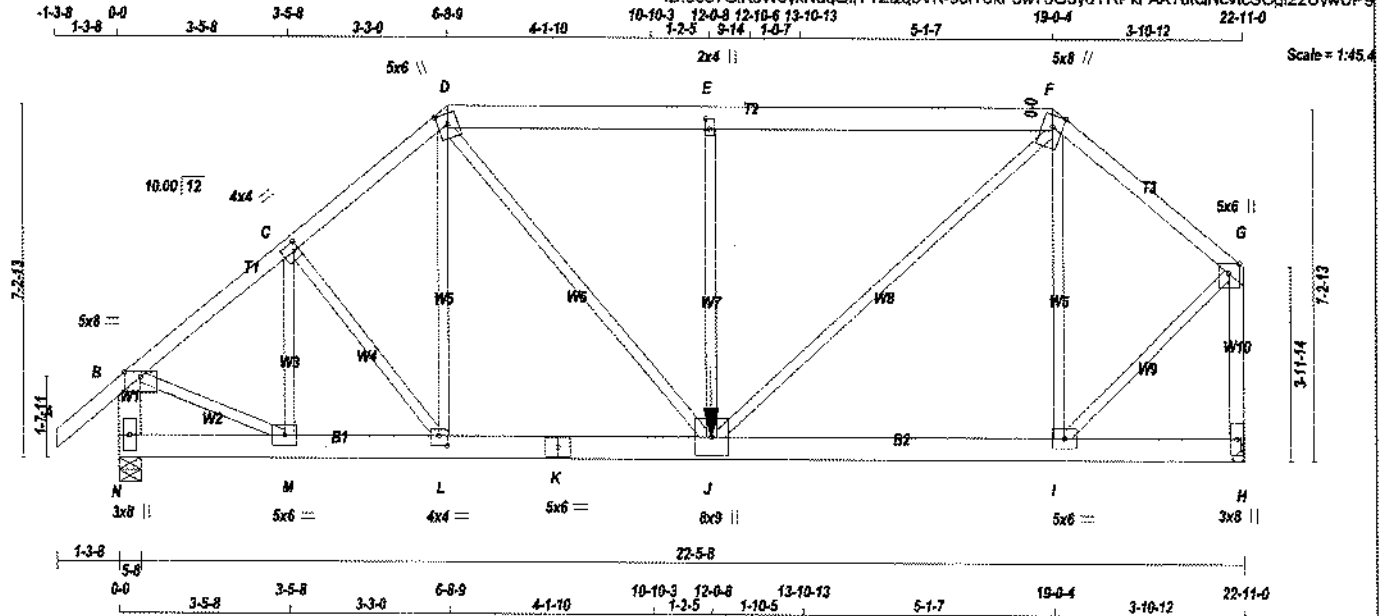

TOTAL WEIGHT = 131 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x6	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x6	DRY	No.2
H - G	2x4	DRY	No.2
N - K	2x6	DRY	No.2
K - H	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TMVW-l	MT20	4.0	4.0	2.00	1.25
D TTWW+m	MT20	5.0	6.0	2.50	2.50
E TMVW+w	MT20	2.0	4.0	2.50	1.00
F TTWW+m	MT20	5.0	8.0	Edge	
G TMVW+p	MT20	5.0	6.0	Edge	
H BMV1+p	MT20	3.0	8.0		
I BMVW-l	MT20	5.0	6.0		
J BMVW+l	MT20	8.0	9.0		
K BS-l	MT20	5.0	6.0		
L BMVW-l	MT20	4.0	4.0	2.50	2.00
M BMVW-l	MT20	5.0	6.0		
N BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
H	2073	0	2073	0
N	2104	0	2104	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX MIN SNOW	MAX MIN LIVE	MAX MIN PERM LIVE	MAX MIN WIND	MAX MIN DEAD	MAX MIN SOIL
H	1470	941 / 0	0 / 0	0 / 0	0 / 0	529 / 0	0 / 0
N	1490	966 / 0	0 / 0	0 / 0	0 / 0	524 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 38	-84.9	-84.9 0.13 (1)	10.00	M-C	-532 / 0	0.16 (1)
B-C	-1984 / 0	-84.9	-84.9 0.23 (1)	4.55	C-L	0 / 149	0.04 (1)
C-D	-2136 / 0	-84.9	-84.9 0.24 (1)	4.41	L-D	0 / 57	0.02 (4)
D-E	-2468 / 0	-84.9	-84.9 0.29 (1)	4.93	I-F	-862 / 0	0.73 (1)
E-F	-2468 / 0	-84.9	-84.9 0.33 (1)	4.90	B-M	0 / 1632	0.40 (1)
F-G	-1395 / 0	-84.9	-84.9 0.29 (1)	5.15	I-G	0 / 1476	0.37 (1)
N-B	-2060 / 0	0.0	0.0 0.15 (1)	7.02	J-E	-847 / 0	0.53 (1)
H-G	-2067 / 0	0.0	0.0 0.53 (1)	5.83	D-J	0 / 1358	0.34 (1)
N-M	0 / 0	-18.5	-18.5 0.04 (1)	10.00	J-F	0 / 1926	0.48 (1)
M-L	0 / 1539	-18.5	-18.5 0.25 (1)	10.00			
L-K	0 / 1629	-18.5	-18.5 0.26 (1)	10.00			
K-J	0 / 1629	-18.5	-18.5 0.26 (1)	10.00			
J-I	0 / 1087	-18.5	-18.5 0.22 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	12-0-8	-1198	-1198		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.78")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.78")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI TC=0.53/1.00 (G-H-1), BC=0.26/1.00 (J-L-1),
WB=0.73/1.00 (F-I-1), SH=0.23/1.00 (E-F-1)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (M) (INPUT = 0.80)
JSI METAL= 0.60 (G) (INPUT = 1.00)

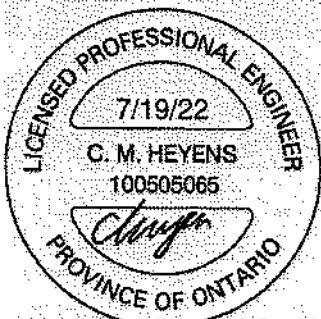

STRUCTURAL COMPONENT ONLY
DWG # TR22070363

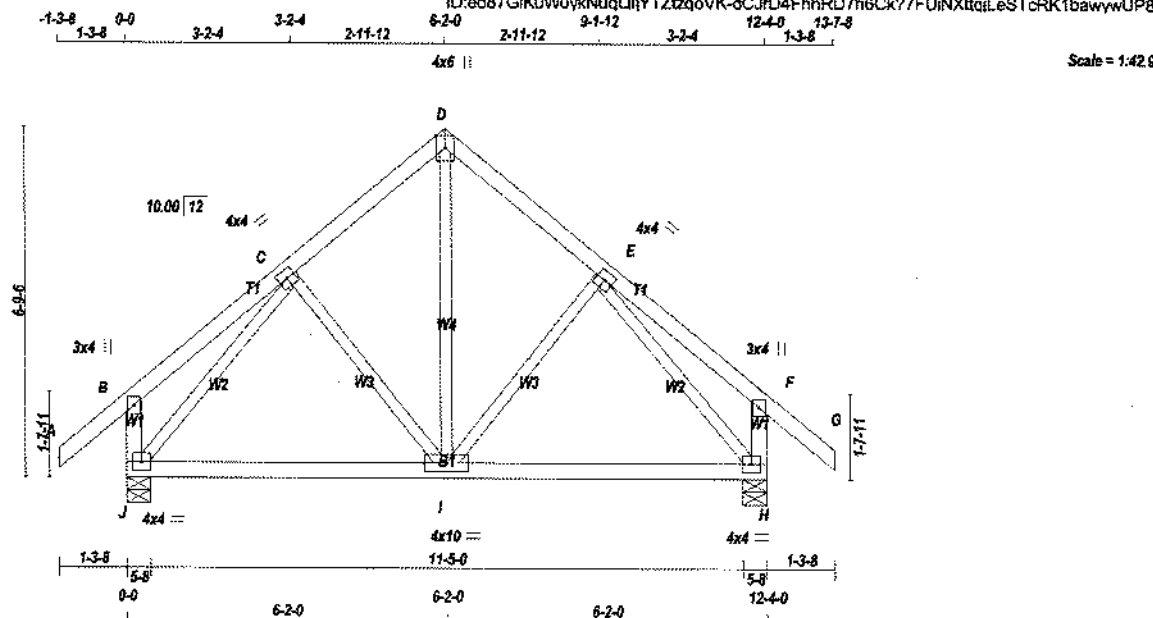

TOTAL WEIGHT = 59 lb
(M/F)

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	

EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWV-1	MT20	4.0	4.0	
D	TTW+p	MT20	4.0	8.0	Edge
E	TMWV-1	MT20	4.0	4.0	
F	TMV+p	MT20	3.0	4.0	
H	BMVW1-1	MT20	4.0	4.0	
I	BMVWV-1	MT20	4.0	10.0	
J	BMVW1-1	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
J	755	0	755	0	0	5-8	5-8	5-8	5-8
H	755	0	755	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	534	352 / 0	0 / 0	0 / 0	0 / 0	182 / 0	0 / 0
H	534	352 / 0	0 / 0	0 / 0	0 / 0	182 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 38	-84.9	-84.9 0.12 (1)	10.00	I-D	0 / 323	0.07 (1)
B-C	0 / 19	-84.9	-84.9 0.13 (1)	10.00	I-E	-117 / 0	0.05 (1)
C-D	-432 / 0	-84.9	-84.9 0.10 (1)	6.25	C-I	-117 / 0	0.05 (1)
D-E	-432 / 0	-84.9	-84.9 0.10 (1)	6.25	J-C	-630 / 0	0.24 (1)
E-F	0 / 19	-84.9	-84.9 0.13 (1)	10.00	E-H	-630 / 0	0.24 (1)
F-G	0 / 38	-84.9	-84.9 0.12 (1)	10.00			
J-B	-218 / 0	0.0	0.0 0.02 (1)	7.81			
H-F	-218 / 0	0.0	0.0 0.02 (1)	7.81			
J-I	0 / 391	-18.5	-18.5 0.23 (4)	10.00			
I-H	0 / 391	-18.5	-18.5 0.23 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.41")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.41")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.13/1.00 (B-C-1), BC=0.23/1.00 (H-I-4), WB=0.24/1.00 (C-J-1), SS=0.10/1.00 (C-D-1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (C) (INPUT = 0.90)
JSI METAL= 0.21 (E) (INPUT = 1.00)

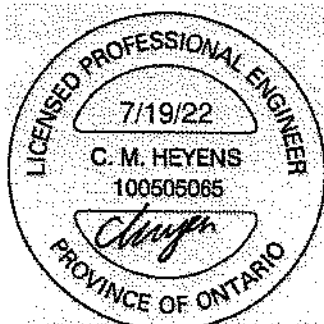


STRUCTURAL COMPONENT ONLY
DWG # TR22070364

JOB NAME 424089	TRUSS NAME T25A	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:43:02 2022 Page 1
ID:eo87GikOW0yknugQlYtZtzcqVK-5PteRQKSiL IGnxZqmFb42cE3oNvulf n86MywUP7

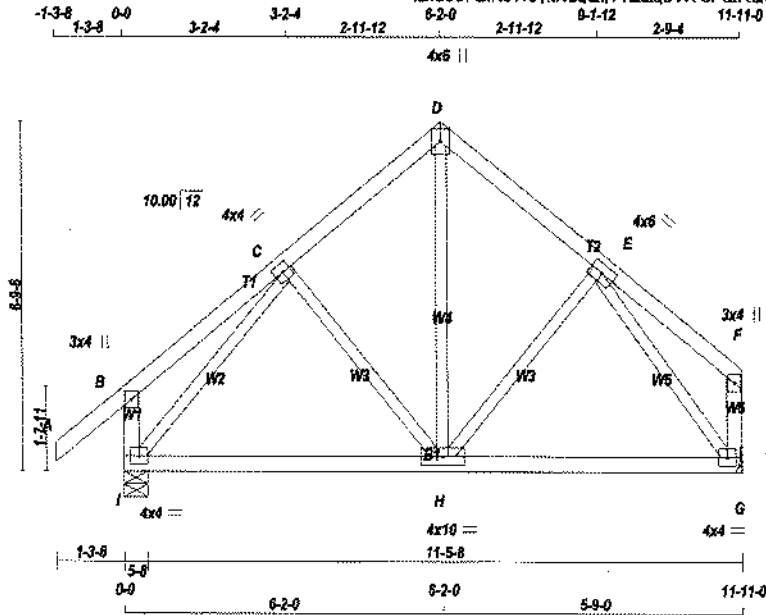

Scale = 1:42.9

TOTAL WEIGHT = 3 X 57 = 170 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x4 DRY	No.2	SPF	
D - F	2x4 DRY	No.2	SPF	
I - B	2x4 DRY	No.2	SPF	
G - F	2x4 DRY	No.2	SPF	
I - G	2x4 DRY	No.2	SPF	
ALL WEBS	2x3 DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	V X
B TMV+p	MT20	3.0	4.0	
C TMWV+4	MT20	4.0	4.0	
D TTW+p	MT20	4.0	6.0	Edge
E TMWV+4	MT20	4.0	6.0	
F TMV+p	MT20	3.0	4.0	
G BMVW1-1	MT20	4.0	4.0	
H BMWVW-1	MT20	4.0	10.0	
I BMVW1-1	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
I	733	0	733	0	5-8
G	616	0	616	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	518	342 / 0	0 / 0	0 / 0	0 / 0	176 / 0	0 / 0
G	437	276 / 0	0 / 0	0 / 0	0 / 0	160 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 38	-84.9	-84.9 0.12 (1)	C-H	-124 / 0	0.05 (1)	
B-C	0 / 19	-84.9	-84.9 0.13 (1)	H-D	0 / 284	0.06 (1)	
C-D	-404 / 0	-84.9	-84.9 0.10 (1)	H-E	-67 / 9	0.03 (1)	
D-E	-402 / 0	-84.9	-84.9 0.09 (1)	I-C	-602 / 0	0.23 (1)	
E-F	0 / 19	-84.9	-84.9 0.11 (1)	E-G	-599 / 0	0.21 (1)	
I-B	-217 / 0	0.0	0.0 0.02 (1)				
G-F	-82 / 0	0.0	0.0 0.01 (1)				
I-H	0 / 374	-18.5	-18.5 0.22 (4)				
H-G	0 / 338	-18.5	-18.5 0.22 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (0.40")
CALCULATED VERT. DEFL.(LL) = $L/998$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.40")
CALCULATED VERT. DEFL.(TL) = $L/998$ (0.04")

CSI: TC=0.13/1.00 (B-C:1), BC=0.22/1.00 (H-I:4), WB=0.23/1.00 (C-I:1), SS=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747
		768	1987
		1873	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (C) (INPUT = 0.90)
JSI METAL = 0.20 (C) (INPUT = 1.00)

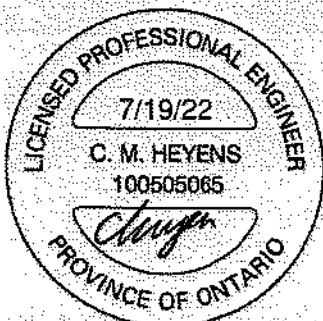

STRUCTURAL COMPONENT ONLY
DWG # TR22070365

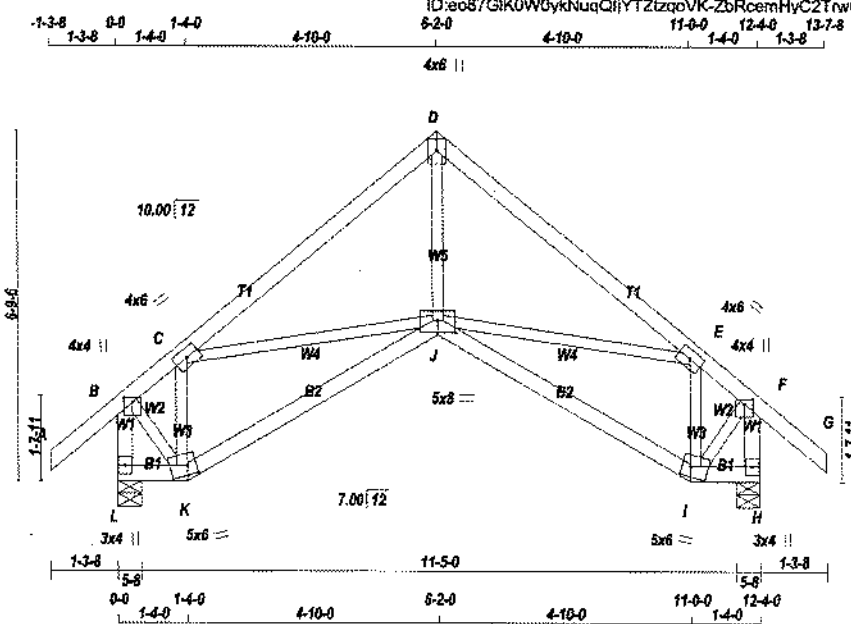

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 2 X 58 = 116 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	4.0	1.00	2.00
C	TMWV-i	MT20	4.0	8.0		
D	TTW+p	MT20	4.0	8.0	Edge	
E	TMWV-i	MT20	4.0	8.0		
F	TMWV+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BBWV-m	MT20	5.0	8.0	2.25	2.00
J	BBWV-p	MT20	5.0	8.0	2.75	4.00
K	BBWV-m	MT20	5.0	8.0	2.25	2.00
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
L	755	0	755
H	755	0	755

UNFACTORED REACTIONS							
1ST LOASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	534	352 / 0	0 / 0	0 / 0	0 / 0	182 / 0	0 / 0
H	534	352 / 0	0 / 0	0 / 0	0 / 0	182 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 38	-84.9	0.12 (1)	J-D	0 / 531	0.12 (1)	
B-C	-421 / 0	-84.9	0.20 (1)	J-E	0 / 179	0.04 (1)	
C-D	-708 / 0	-84.9	0.24 (1)	I-E	-502 / 0	0.08 (1)	
D-E	-706 / 0	-84.9	0.24 (1)	C-J	0 / 179	0.04 (1)	
E-F	-421 / 0	-84.9	0.20 (1)	K-C	-502 / 0	0.08 (1)	
F-G	0 / 38	-84.9	0.12 (1)	B-K	0 / 512	0.12 (1)	
L-B	-743 / 0	0.0	0.08 (1)	I-F	0 / 512	0.12 (1)	
H-F	-743 / 0	0.0	0.08 (1)				
L-K	0 / 0	-18.5	-18.5 0.01 (4)				
K-J	0 / 400	-18.5	-18.5 0.16 (4)				
J-I	0 / 400	-18.5	-18.5 0.16 (4)				
I-H	0 / 0	-18.5	-18.5 0.01 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.41")
CALCULATED VERT. DEFL. (LL) = L/998 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.41")
CALCULATED VERT. DEFL. (TL) = L/909 (0.05")

CSI: TC=0.24/1.00 (C-D:1), BC=0.16/1.00 (I-J:4), WB=0.12/1.00 (D-J:1), SI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	650	371	1747	788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (K) (INPUT = 0.90)
JSI METAL= 0.18 (K) (INPUT = 1.00)

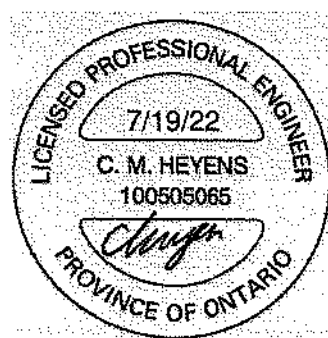


STRUCTURAL COMPONENT ONLY
DWG # TR22070366

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T26	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M Tek Industries, Inc. Tue Jul 19 14:43:03 2022 Page 1
ID: eo87GKOWDyKnuQIYtZtzoqVK-ZbRcmHyC2TnwQL77YHvncoc8SeQa8MCueWioywuUP6

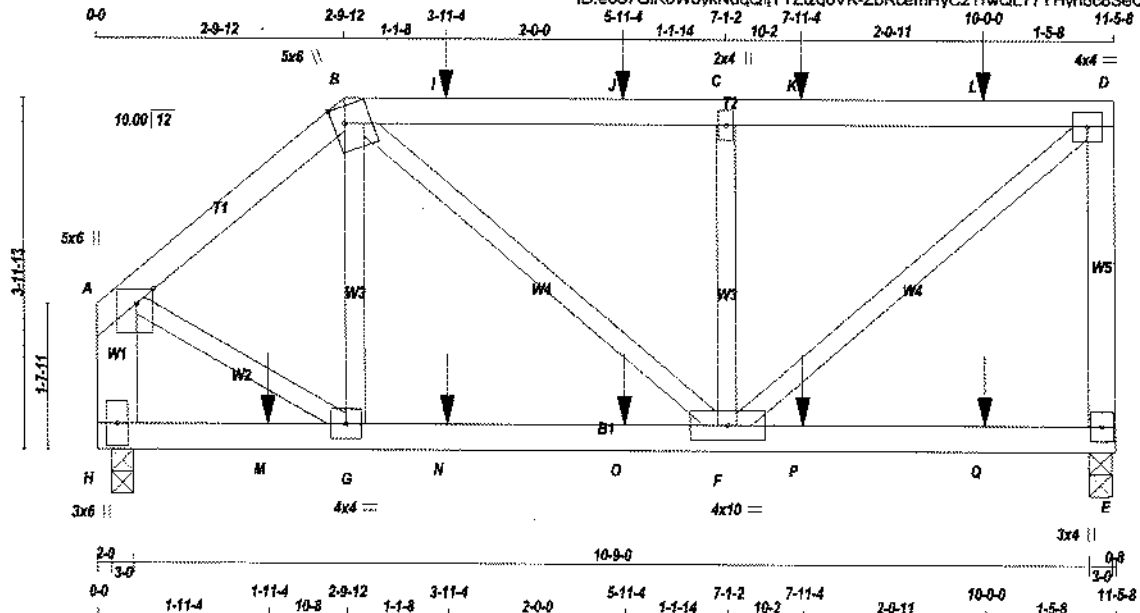

Scale = 1:25.1

TOTAL WEIGHT = 50 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF		
B - C	2x4 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
D - E	2x4 DRY	No.2	SPF		
H - M	2x6 DRY	No.2	SPF		
M - G	2x4 DRY	No.2	SPF		
G - N	2x4 DRY	No.2	SPF		
N - O	2x4 DRY	No.2	SPF		
O - F	2x4 DRY	No.2	SPF		
F - P	2x4 DRY	No.2	SPF		
P - Q	2x4 DRY	No.2	SPF		
Q - E	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0	2.00	2.25
B	TTWW+em	MT20	5.0	6.0	2.25	1.50
C	TMVW+w	MT20	2.0	4.0		
D	TMVW-t	MT20	4.0	4.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	10.0		
G	BMVWW-t	MT20	4.0	4.0		
H	BMV1+p	MT20	3.0	6.0		

NOTES (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
E	830	0	830	0	0	0	3-0	3-0	3-0
H	759	0	759	0	0	0	3-0	3-0	3-0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	590	373 / 0	0 / 0	0 / 0	0 / 0	217 / 0	0 / 0
H	540	335 / 0	0 / 0	0 / 0	0 / 0	205 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX (LBS)	CS1 (LBS)	UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX (LBS)	CS1 (LBS)
FR-TO		FROM	TO			FR-TO			
A-B	-827 / 0	-84.9	-84.9	0.13 (1)	6.25	G-B	-110 / 30	0.03 (1)	
B-C	-704 / 0	-84.9	-84.9	0.44 (1)	6.25	B-F	0 / 300	0.07 (1)	
C-D	-704 / 0	-84.9	-84.9	0.44 (1)	6.25	F-C	-664 / 0	0.17 (1)	
D-E	-704 / 0	-84.9	-84.9	0.44 (1)	6.25	F-D	0 / 922	0.23 (1)	
E-F	-704 / 0	-84.9	-84.9	0.44 (1)	6.25	A-G	0 / 525	0.13 (1)	
F-G	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
G-H	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
H-I	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
I-J	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
J-K	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
K-L	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
L-M	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
M-N	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
N-O	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
O-P	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
P-Q	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
Q-E	-704 / 0	-84.9	-84.9	0.44 (1)	6.25				
H-M	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
M-G	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
G-N	0 / 476	-18.5	-18.5	0.18 (4)	10.00				
N-O	0 / 476	-18.5	-18.5	0.18 (4)	10.00				
O-F	0 / 476	-18.5	-18.5	0.18 (4)	10.00				
F-P	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
P-Q	0 / 0	-18.5	-18.5	0.13 (4)	10.00				
Q-E	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
I	3-11-4	-55	-55	---	BACK	VERT	TOTAL	C1
J	5-11-4	-55	-55	---	BACK	VERT	TOTAL	C1
K	7-11-4	-55	-55	---	BACK	VERT	TOTAL	C1
L	10-0-0	-55	-55	---	BACK	VERT	TOTAL	C1
M	1-11-4	-14	-14	---	BACK	VERT	TOTAL	C1
N	3-11-4	-14	-14	---	BACK	VERT	TOTAL	C1
O	5-11-4	-14	-14	---	BACK	VERT	TOTAL	C1
P	7-11-4	-14	-14	---	BACK	VERT	TOTAL	C1
Q	10-0-0	-14	-14	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.44/1.00 (C-D:1), BC=0.18/1.00 (F-G:4), WB=0.23/1.00 (D-F:1), SS=0.29/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.80 (D) (INPUT = 0.90)

JSI METAL=0.25 (D) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070367



PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-4	MT20	5.0	6.0		
B	TMW-w	MT20	2.0	4.0	2.50	1.00
C	TMWV-4	MT20	5.0	6.0		

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
F-A	-988 / 0	0.0	0.0	0.06 (1)	7.81	A-E	0 / 1861	0.23 (1)
A-B	-1640 / 0	-84.9	-84.9	0.03 (1)	6.25	E-B	-742 / 0	0.06 (1)
B-G	-1640 / 0	-84.9	-84.9	0.21 (1)	6.25	E-C	0 / 1861	0.23 (1)
G-C	-1640 / 0	-84.9	-84.9	0.21 (1)	6.25			
D-C	-1263 / 0	0.0	0.0	0.07 (1)	7.81			
F-H	0 / 0	-18.5	-18.5	0.14 (1)	10.00			
H-E	0 / 0	-18.5	-18.5	0.14 (1)	10.00			
E-I	0 / 0	-18.5	-18.5	0.14 (1)	10.00			
I-D	0 / 0	-18.5	-18.5	0.14 (1)	10.00			

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

JSI GRIP= 0.55 (E) (INPUT = 0.90)
JSI METAL= 0.19 (A) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T27	1	2	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version B.530 5 Feb 23 2022 MITak Industries, Inc. Tue Jul 19 14:43:04 2022 Page 2


ID:eo87GiK0W0ykNugQijYTZtzoVK-1n s5iazMbhYawJqFoBK09Mq2mTrpP27IGFBFywUP5

PLATES Table is in inches

JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	8.0		
E	BMWW-t	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

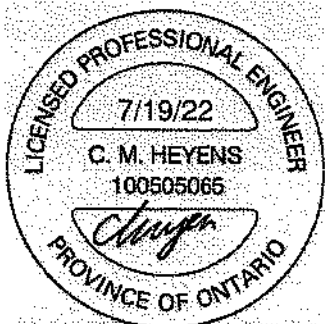


STRUCTURAL COMPONENT ONLY
DWG # TR22070368 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T28	1	2	TRUSS DESC.		

Tamarsack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Tue Jul 19 14:43:05 2022 Page 1
ID:eo87GIK0W0yKnuQ8YTzqoVK-V YM3RiCkgY9kVVEyKQIDiZIR1WafIBLy7pjhWUP4

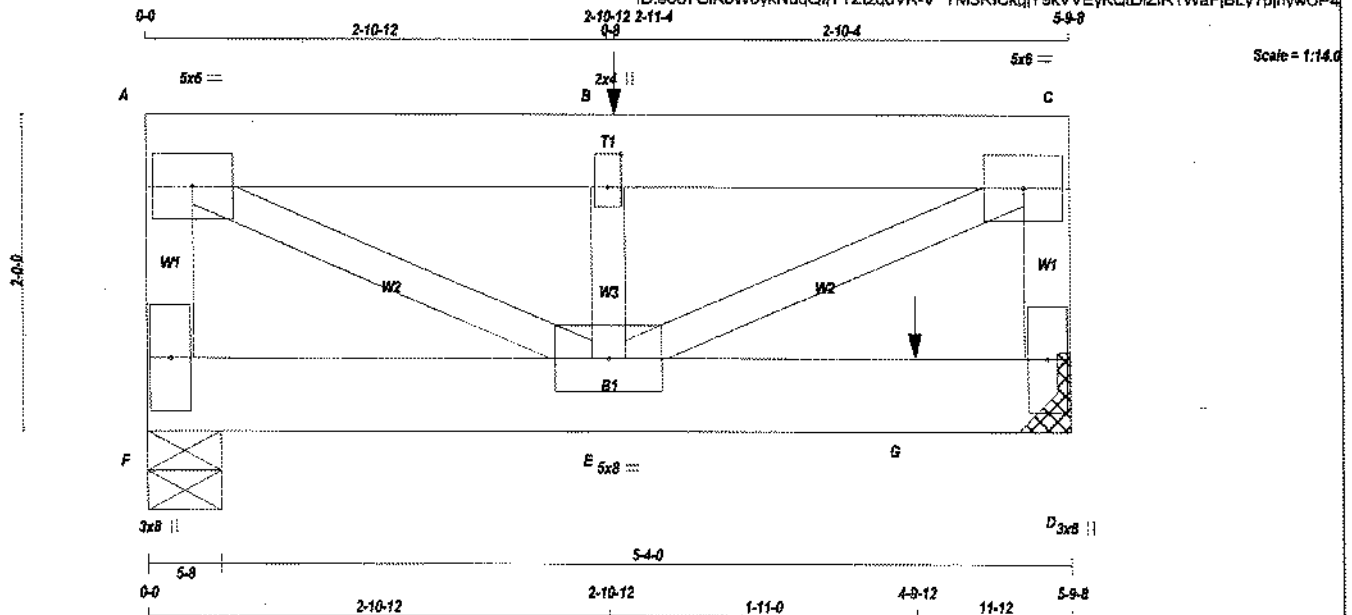

TOTAL WEIGHT = 2 X 29 = 57 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	F - A	2x4	DRY	No.2	SPF
	A - C	2x6	DRY	No.2	SPF
	D - C	2x4	DRY	No.2	SPF
	F - D	2x6	DRY	No.2	SPF
	ALL WEBS	2x3	DRY	No.2	SPF
			DRY: SEASONED LUMBER.		

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A 1	12	TOP
C - D 1	12	TOP
A - C 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0		
B	TMVW-1	MT20	2.0	4.0	2.50	1.00
C	TMVW-1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
F	987	0	0	5-8
D	2360	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	701	440/0	0/0	0/0	0/0	261/0	0/0
D	1674	1072/0	0/0	0/0	0/0	802/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM TO		LENGTH	FR-TO			
F - A	-1037/0	0.0	0.0	0.06 (1)	7.81	A - E	0/1828	0.23 (1)
A - B	-1614/0	-84.9	-84.9	0.07 (1)	6.25	E - B	-310/0	0.06 (1)
B - C	-1614/0	-84.9	-84.9	0.07 (1)	6.25	E - C	0/1828	0.23 (1)
D - C	-1037/0	0.0	0.0	0.06 (1)	7.81			
F - E	0/0	-18.5	-18.5	0.08 (1)	10.00			
E - G	0/0	-18.5	-18.5	0.47 (1)	10.00			
G - D	0/0	-18.5	-18.5	0.47 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-11-4	-481	-481	---	TOP	VERT	TOTAL	---	C1
G	4-9-12	-1469	-1469	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.07/1.00 (A-B:1), BC=0.47/1.00 (D-E:1), WB=0.23/1.00 (A-E:1), SS1=0.44/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.54 (E) (INPUT = 0.90)
JSI METAL= 0.18 (A) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070369

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424089	T28	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.530 S Feb 23 2022 MITak Industries, Inc. Tue Jul 19 14:43:05 2022 Page 2
ID:eo87GKOWdykNugQijYTZtzoVK-V YM3RICKqY9kVVEyKQdDIZR1WaFIBLy7ghwUP4

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	8.0		
E	BMWWW-t	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

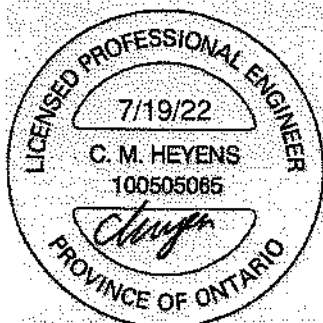

STRUCTURAL COMPONENT ONLY
DWG # TR22070369 PG 2/2

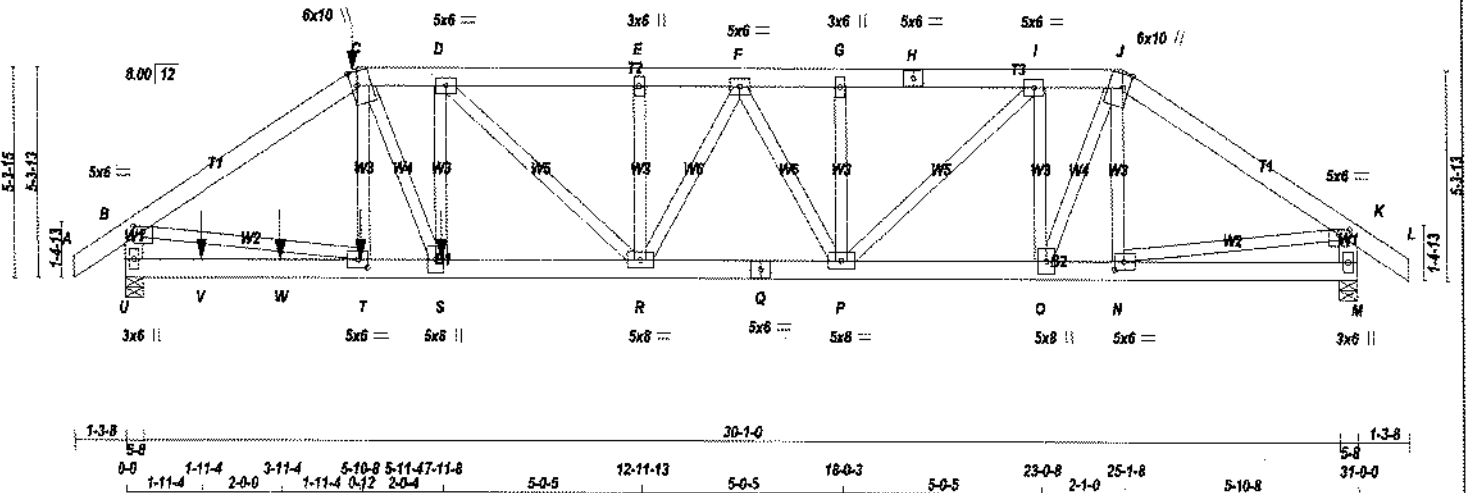

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY No.2	SPF
C - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
J - L	2x6	DRY No.2	SPF
U - B	2x6	DRY No.2	SPF
M - K	2x6	DRY No.2	SPF
U - Q	2x6	DRY No.2	SPF
Q - M	2x6	DRY No.2	SPF

ALL WEBS 2x4 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2 12		SIDE(122.0)
C-H 2 12		SIDE(61.0)
H-J 2 12		TOP
J-L 2 12		TOP
U-B 2 12		TOP
M-K 2 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
U-Q 2 12		SIDE(183.1)
Q-M 2 12		TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x4 1 6		SIDE(424.2)
D-S 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REORD BRG IN-SX
JT VERT	3987	3987	0	5-8
U	3987	3987	0	5-8
M	2437	2437	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
U	2825	1824 / 0	0 / 0	0 / 0	1001 / 0	0 / 0
M	1726	1119 / 0	0 / 0	0 / 0	606 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.96 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 33	-84.9	-84.9 0.03 (1)	10.00	T-C	-362 / 32	0.06 (1)
B-C	-5202 / 0	-84.9	-84.9 0.19 (1)	4.96	C-S	0 / 2537	0.22 (1)
C-D	-5313 / 0	-84.9	-84.9 0.06 (1)	5.06	S-D	-93 / 7	0.01 (1)
D-E	-5165 / 0	-84.9	-84.9 0.12 (1)	5.05	O-I	-1535 / 0	0.21 (1)
E-F	-5165 / 0	-84.9	-84.9 0.08 (1)	5.09	O-J	0 / 1721	0.15 (1)
F-G	-4413 / 0	-84.9	-84.9 0.07 (1)	5.43	N-J	-261 / 0	0.04 (1)
G-H	-4413 / 0	-84.9	-84.9 0.10 (1)	5.40	B-T	0 / 4368	0.39 (1)
H-I	-4413 / 0	-84.9	-84.9 0.10 (1)	5.40	N-K	0 / 2492	0.22 (1)
I-J	-3138 / 0	-84.9	-84.9 0.05 (1)	6.20	P-I	0 / 1773	0.16 (1)
J-K	-2968 / 0	-84.9	-84.9 0.15 (1)	6.19	D-R	-205 / 0	0.06 (1)
K-L	0 / 33	-84.9	-84.9 0.03 (1)	10.00	P-G	-372 / 0	0.05 (1)
U-B	-3910 / 0	0.0	0.0 0.14 (1)	7.17	R-E	-391 / 0	0.05 (1)
M-K	-2390 / 0	0.0	0.0 0.08 (1)	7.81	R-F	0 / 756	0.07 (1)
					F-P	-882 / 0	0.15 (1)
U-V	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
V-W	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
W-T	0 / 0	-18.5	-18.5 0.07 (4)	10.00			
T-S	0 / 4309	-18.5	-18.5 0.33 (1)	10.00			
S-R	0 / 5313	-18.5	-18.5 0.40 (1)	10.00			
R-Q	0 / 4818	-18.5	-18.5 0.33 (1)	10.00			
Q-P	0 / 4818	-18.5	-18.5 0.33 (1)	10.00			
P-O	0 / 3138	-18.5	-18.5 0.23 (1)	10.00			
O-N	0 / 2457	-18.5	-18.5 0.18 (1)	10.00			
N-M	0 / 0	-18.5	-18.5 0.04 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-376	-376	---	BACK	VERT	TOTAL	C1
S	7-11-8	-1648	-1648	---	BACK	VERT	TOTAL	C1
T	5-11-4	-29	-29	---	BACK	VERT	TOTAL	C1
V	1-11-4	-29	-29	---	BACK	VERT	TOTAL	C1
W	3-11-4	-29	-29	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/260 (1.03")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
 ALLOWABLE DEFL.(TL) = L/360 (1.03")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.19/1.00 (B-C:1), BC=0.40/1.00 (R-S:1)
 , WB=0.39/1.00 (B-T:1), SSI=0.08/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	650	371
	1747	786
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (K) (INPUT = 0.80)
 JSI METAL = 0.49 (T) (INPUT = 1.00)

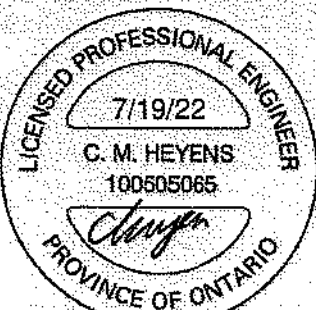

STRUCTURAL COMPONENT ONLY
 DWG # TR22070377 PG 1/2

JOB NAME 424092	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 15:06:06 2022 Page 2

ID:1NyalRgeq4gRecsZEgibRqzpuch-ZfVRv0SW_icLyaweVbGLROYL7Nnf06TvJ1Nh8ywU3V


PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.50	3.00
C TTWW+m	MT20	6.0	10.0	Edge	1.75
D, F, I					
D TMVW-t	MT20	5.0	6.0		
E TMVW+w	MT20	3.0	6.0		
G TMVW+w	MT20	3.0	6.0		
H TS-t	MT20	5.0	6.0		
J TTWW+m	MT20	6.0	10.0	Edge	1.75
K TMVW-p	MT20	5.0	6.0	1.50	3.00
M BMV1+p	MT20	3.0	6.0		
N BMVW-t	MT20	5.0	6.0	2.50	2.75
O BMVW-t	MT20	5.0	8.0		
P BMVW-t	MT20	5.0	8.0		
Q BS-t	MT20	5.0	6.0		
R BMVW-t	MT20	5.0	8.0		
S BMVW-t	MT20	5.0	8.0		
T BMVW-t	MT20	5.0	6.0	2.50	2.75
U BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

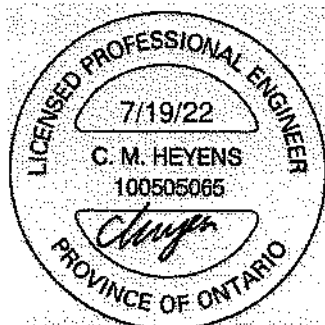


STRUCTURAL COMPONENT ONLY
DWG # TR22070377 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T31	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:07 2022 Page 1
ID:1NyaiRqec4gRecsZEqjbRozpuch-1s3p6714HrTy686CC8VtfxaEXigOB1c8znwDaywU3U

1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 7-7-8 15-6-0 7-7-8 23-1-8 3-10-0 26-11-8 4-0-8 31-0-0 1-3-8
Scale = 1:56.2

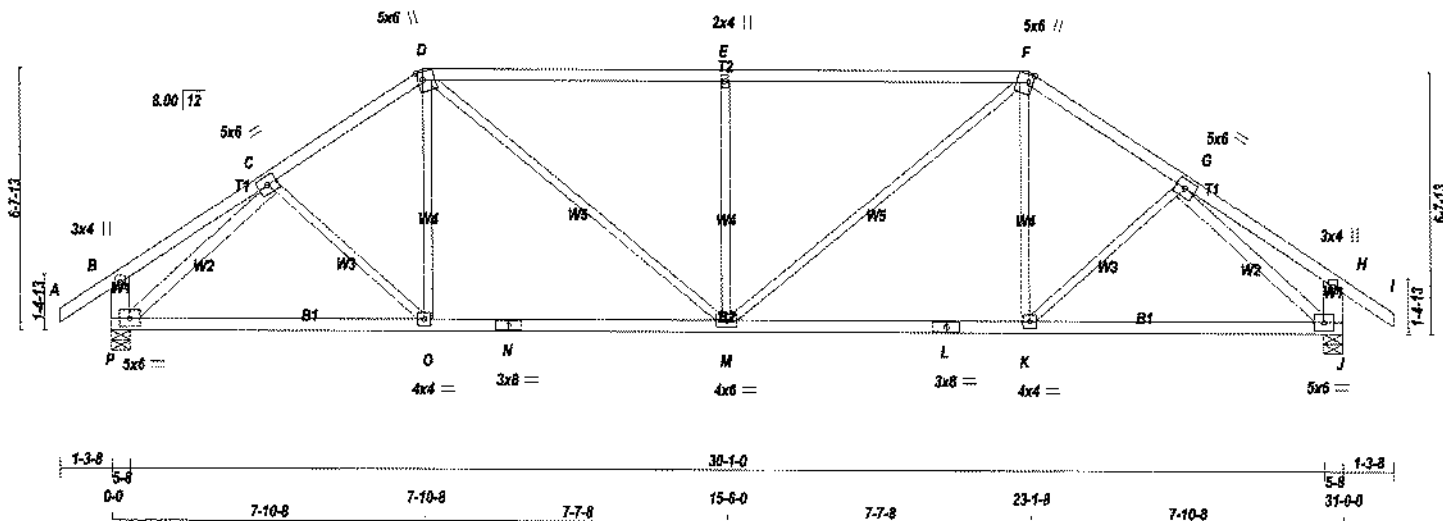

TOTAL WEIGHT = 2 X 132 = 264 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
P - B	2x6	DRY	No.2	SPF	
J - H	2x6	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
P - C	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	5.0	6.0		
D TTWW+m	MT20	5.0	6.0	2.50	1.50
E TMW+u	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	6.0	2.50	1.50
G TMWW-t	MT20	5.0	6.0		
H TMV+p	MT20	3.0	4.0		
J BMVW1-t	MT20	5.0	6.0		
K BMWW-t	MT20	4.0	4.0		
L BS-t	MT20	3.0	8.0		
M BMWWW-t	MT20	4.0	6.0		
N BS-t	MT20	3.0	8.0		
O BMWW-t	MT20	4.0	4.0		
P BMVW1-t	MT20	5.0	6.0		

NOTES-

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
	VERT	HORZ	DOWN	HORZ
JT	1719	0	1719	0
P	1719	0	1719	0
J	1719	0	1719	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0
J	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 32	-84.9	0.11 (1)	10.00	C-O	0 / 53	0.02 (4)
B-C	0 / 20	-84.9	0.20 (1)	10.00	O-D	0 / 166	0.05 (4)
C-D	-1827 / 0	-84.9	0.20 (1)	4.79	D-M	0 / 720	0.16 (1)
D-E	-2056 / 0	-84.9	0.76 (1)	3.75	M-E	-797 / 0	0.58 (1)
E-F	-2056 / 0	-84.9	0.76 (1)	3.75	M-F	0 / 720	0.16 (1)
F-G	-1827 / 0	-84.9	0.20 (1)	4.79	K-F	0 / 166	0.05 (4)
G-H	0 / 20	-84.9	0.20 (1)	10.00	K-G	0 / 53	0.02 (4)
H-I	0 / 32	-84.9	0.11 (1)	10.00	P-C	-2081 / 0	0.66 (1)
P-B	-248 / 0	0.0	0.02 (1)	7.81	G-J	-2081 / 0	0.66 (1)
J-H	-248 / 0	0.0	0.02 (1)	7.81			
P-O	0 / 1501	-18.5	-18.5 0.41 (4)	10.00			
O-N	0 / 1503	-18.5	-18.5 0.42 (4)	10.00			
N-M	0 / 1503	-18.5	-18.5 0.42 (4)	10.00			
M-L	0 / 1503	-18.5	-18.5 0.42 (4)	10.00			
L-K	0 / 1503	-18.5	-18.5 0.42 (4)	10.00			
K-J	0 / 1501	-18.5	-18.5 0.41 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	23.3	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.76/1.00 (D-E:1), BC=0.42/1.00 (M-O:4), WB=0.65/1.00 (C-P:1), SSI=0.31/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL = 0.46 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070378


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T32	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Tue Jul 19 16:06:08 2022 Page 1

ID:1NyajRpeq4gReesZEgibRqzpuh-W2cBKL2i2bzKaGkJlwekQsUrm5c7daNduU11ywU3T

Scale = 1:56.0

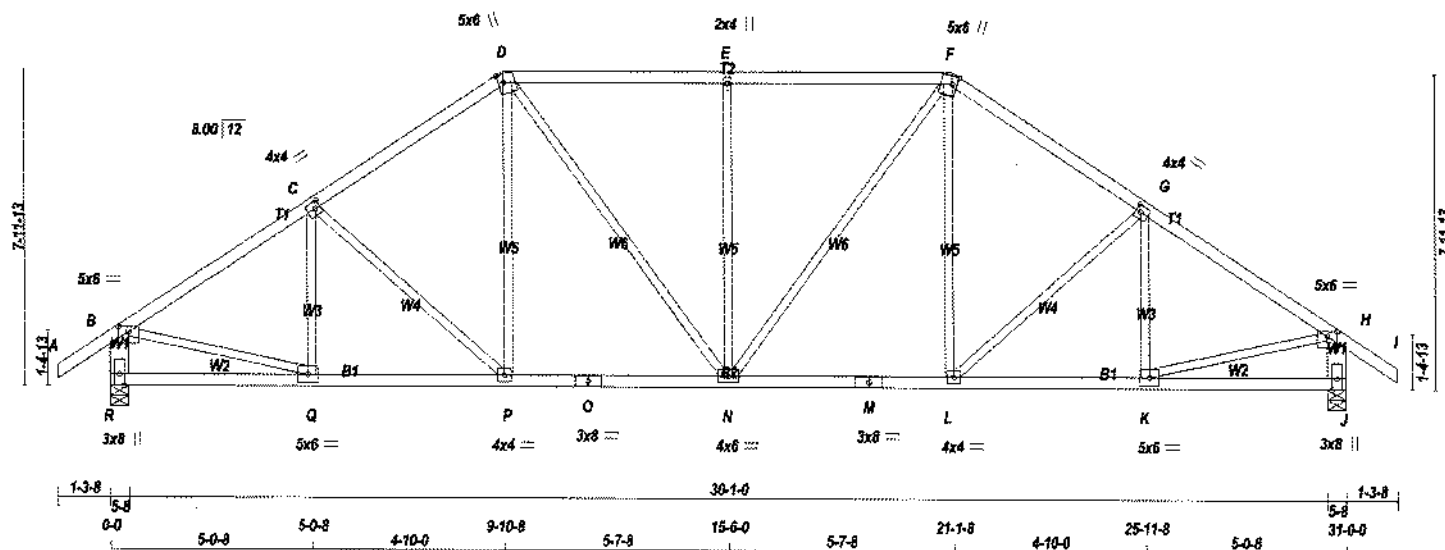

TOTAL WEIGHT = 2 X 141 = 281 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x6	DRY	No.2
J - H	2x6	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTWW+m	MT20	5.0	6.0	2.50 1.50
E	TMVW-w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	6.0	2.50 1.50
G	TMVW-t	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	1.50 3.00
J	BMVW-t+p	MT20	3.0	8.0	Edge
K	BMVW-t	MT20	5.0	6.0	
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	8.0	
N	BMVW-t	MT20	4.0	6.0	
O	BS-t	MT20	3.0	8.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	5.0	6.0	
R	BMVW-t+p	MT20	3.0	8.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	1719	0	1719	0	0
J	1719	0	1719	0	0

UNFACTORED REACTIONS					
	1ST CASE	MAX/MIN	COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R	1218	786 / 0	0 / 0	0 / 0	432 / 0
J	1218	786 / 0	0 / 0	0 / 0	432 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)
A-B	0 / 32	-84.9 -84.9 0.11 (1)	10.00	Q-C	-243 / 0
B-C	-1878 / 0	-84.9 -84.9 0.32 (1)	4.61	C-P	-239 / 0
C-D	-1721 / 0	-84.9 -84.9 0.30 (1)	4.78	P-D	0 / 259
D-E	-1661 / 0	-84.9 -84.9 0.38 (1)	4.74	D-N	0 / 425
E-F	-1661 / 0	-84.9 -84.9 0.38 (1)	4.74	N-E	-583 / 0
F-G	-1721 / 0	-84.9 -84.9 0.30 (1)	4.78	N-F	0 / 425
G-H	-1878 / 0	-84.9 -84.9 0.32 (1)	4.61	L-F	0 / 259
H-I	0 / 32	-84.9 -84.9 0.11 (1)	10.00	L-G	-239 / 0
R-B	-1678 / 0	0.0 0.0 0.11 (1)	7.63	K-G	-243 / 0
J-H	-1678 / 0	0.0 0.0 0.11 (1)	7.63	B-Q	0 / 1621
R-Q	0 / 0	-18.5 -18.5 0.10 (4)	10.00	K-H	0 / 1621
Q-P	0 / 1585	-18.5 -18.5 0.31 (1)	10.00		
P-O	0 / 1410	-18.5 -18.5 0.28 (1)	10.00		
O-N	0 / 1410	-18.5 -18.5 0.28 (1)	10.00		
N-M	0 / 1410	-18.5 -18.5 0.28 (1)	10.00		
M-L	0 / 1410	-18.5 -18.5 0.28 (1)	10.00		
L-K	0 / 1585	-18.5 -18.5 0.31 (1)	10.00		
K-J	0 / 0	-18.5 -18.5 0.10 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2015, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (1.03")
CALCULATED VERT. DEF. (LL) = L/999 (0.97")
ALLOWABLE DEF. (TL) = L/360 (1.03")
CALCULATED VERT. DEF. (TL) = L/999 (0.13")

CSI: TC=0.38/1.00 (D-E:1), BC=0.31/1.00 (P-Q:1), WB=0.71/1.00 (E-N:1), SSI=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (K) (INPUT = 0.90)
JSI METAL = 0.46 (O) (INPUT = 1.00)

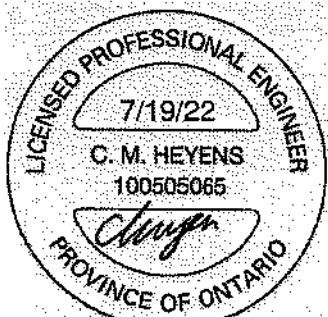


STRUCTURAL COMPONENT ONLY
DWG # TR22070379

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T33	3	1	TRUSS DESC.		

Tamarrack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:09 2022 Page 1

ID:1Nva1Rgeq4gRecsZEqibRqzpuch- EAaXh2Lpv5ACQJVJd9zz40 6LQRs8yvcHG1HTYwUJ3S

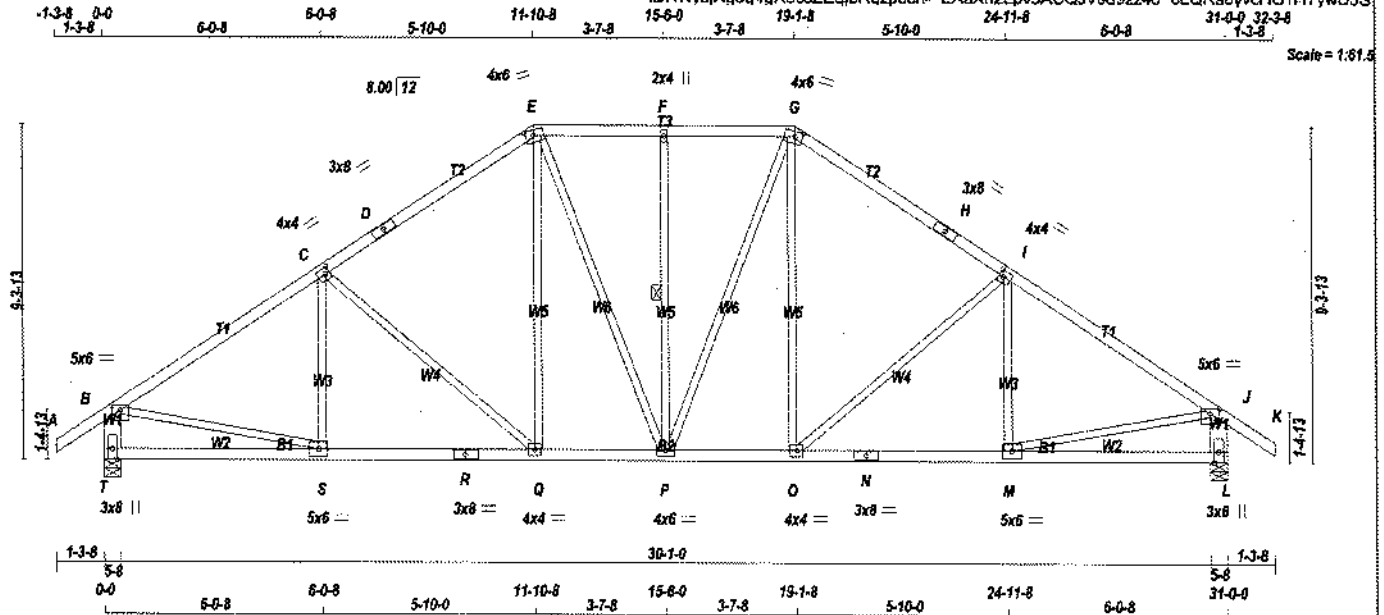

TOTAL WEIGHT = 3 X 150 = 450 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
T - B	2x8	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					


DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	8.0		
E	TTWW-m	MT20	4.0	6.0	1.75	2.50
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	4.0	6.0	1.75	2.50
H	TS-t	MT20	3.0	8.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.50	3.00
L	BMV1-p	MT20	3.0	8.0	Edge	
M	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	8.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	8.0		
S	BMVW-t	MT20	5.0	6.0		
T	BMV1-p	MT20	3.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

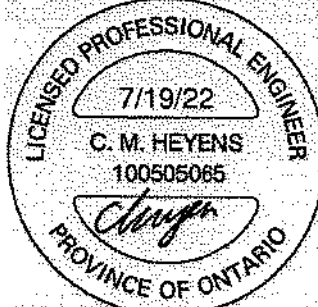

STRUCTURAL COMPONENT ONLY
DWG # TR22070380

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
T	1719	0	1719	0
L	1719	0	1719	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0
L	1218	786 / 0	0 / 0	0 / 0	0 / 0	432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.40 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 32	-84.9	-84.9 0.11 (1)	10.00	S-C	-163 / 39	0.07 (1)
B-C	-1899 / 0	-84.9	-84.9 0.48 (1)	4.40	C-Q	-402 / 0	0.51 (1)
C-D	-1602 / 0	-84.9	-84.9 0.44 (1)	4.74	Q-E	0 / 354	0.08 (1)
D-E	-1602 / 0	-84.9	-84.9 0.44 (1)	4.74	E-P	0 / 223	0.05 (1)
E-F	-1390 / 0	-84.9	-84.9 0.15 (1)	5.38	P-F	-364 / 0	0.21 (1)
F-G	-1390 / 0	-84.9	-84.9 0.15 (1)	5.38	P-G	0 / 223	0.05 (1)
G-H	-1602 / 0	-84.9	-84.9 0.44 (1)	4.74	Q-G	0 / 354	0.08 (1)
H-I	-1602 / 0	-84.9	-84.9 0.44 (1)	4.74	O-I	-402 / 0	0.51 (1)
I-J	-1899 / 0	-84.9	-84.9 0.48 (1)	4.40	M-I	-163 / 39	0.07 (1)
J-K	0 / 32	-84.9	-84.9 0.11 (1)	10.00	S-S	0 / 1634	0.37 (1)
T-B	-1672 / 0	0.0	0.0 0.11 (1)	7.64	M-J	0 / 1634	0.37 (1)
L-J	-1672 / 0	0.0	0.0 0.11 (1)	7.64			
T-S	0 / 0	-18.5	-18.5 0.16 (4)	10.00			
S-R	0 / 1608	-18.5	-18.5 0.34 (1)	10.00			
R-Q	0 / 1608	-18.5	-18.5 0.34 (1)	10.00			
Q-P	0 / 1307	-18.5	-18.5 0.26 (1)	10.00			
P-O	0 / 1307	-18.5	-18.5 0.26 (1)	10.00			
O-N	0 / 1608	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1608	-18.5	-18.5 0.34 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.16 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.03")
CALCULATED VERT. DEFL. (LL) = L/999 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (1.03")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CS: TC=0.46/1.00 (B-C:1), BC=0.34/1.00 (Q-S:1), WB=0.51/1.00 (C-Q:1), SI=0.21/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (E) (INPUT = 0.90)
JSI METAL= 0.53 (R) (INPUT = 1.00)

LATERAL BRACES TO BE A MINIMUM OF 2X4 SPF #2



DRY: SEASONED LUMBER.

BRACING


OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCG 2015

APPLIED.	- PART 8 OF BCBC 2018, ABC 2019 - PART 8 OF OBC 2012 (2019 AMENDMENT)
----------	--

NOTE: 151	A-B	07/32	-84.9	-84.9	0.13 (1)	10.00	R-C	-43770	0.10 (1)
	B-C	-1930/0	-84.9	-84.9	0.23 (1)	4.60	C-Q	0/65	0.02 (1)
	C-Q	1900/0	-84.9	-84.9	0.23 (1)	1.50			

AUTOSOLVE HEELS OFF

E-F	-358870	-84.9	-84.9	0.24 (1)	3.50	P-E	-219870	0.75 (1)	RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
F-T	-360710	-84.9	-84.9	0.44 (1)	3.27	P-N	072595	0.34 (1)	



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T34	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 M/Tek Industries, Inc. Tue Jul 19 15:06:10 2022 Page 2


ID:1NyalRgeq4gRecsZEgibRozpuch-SQkyI03zZCD1pauhIKgCVHZAVI1bXR2qx7aqywwU3R

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	19-5-8	-188	-188	---	FRONT	VERT	TOTAL	---	C1
L	19-4-12	-14	-14	---	FRONT	VERT	TOTAL	---	C1
T	13-4-12	-55	-55	---	FRONT	VERT	TOTAL	---	C1
U	15-4-12	-55	-55	---	FRONT	VERT	TOTAL	---	C1
V	17-4-12	-55	-55	---	FRONT	VERT	TOTAL	---	C1
W	12-0-8	-518	-518	---	FRONT	VERT	TOTAL	---	C1
X	13-4-12	-14	-14	---	FRONT	VERT	TOTAL	---	C1
Y	15-4-12	-14	-14	---	FRONT	VERT	TOTAL	---	C1
Z	17-4-12	-14	-14	---	FRONT	VERT	TOTAL	---	C1
AA	21-4-12	-14	-14	---	FRONT	VERT	TOTAL	---	C1

- CONNECTION REQUIREMENTS
- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



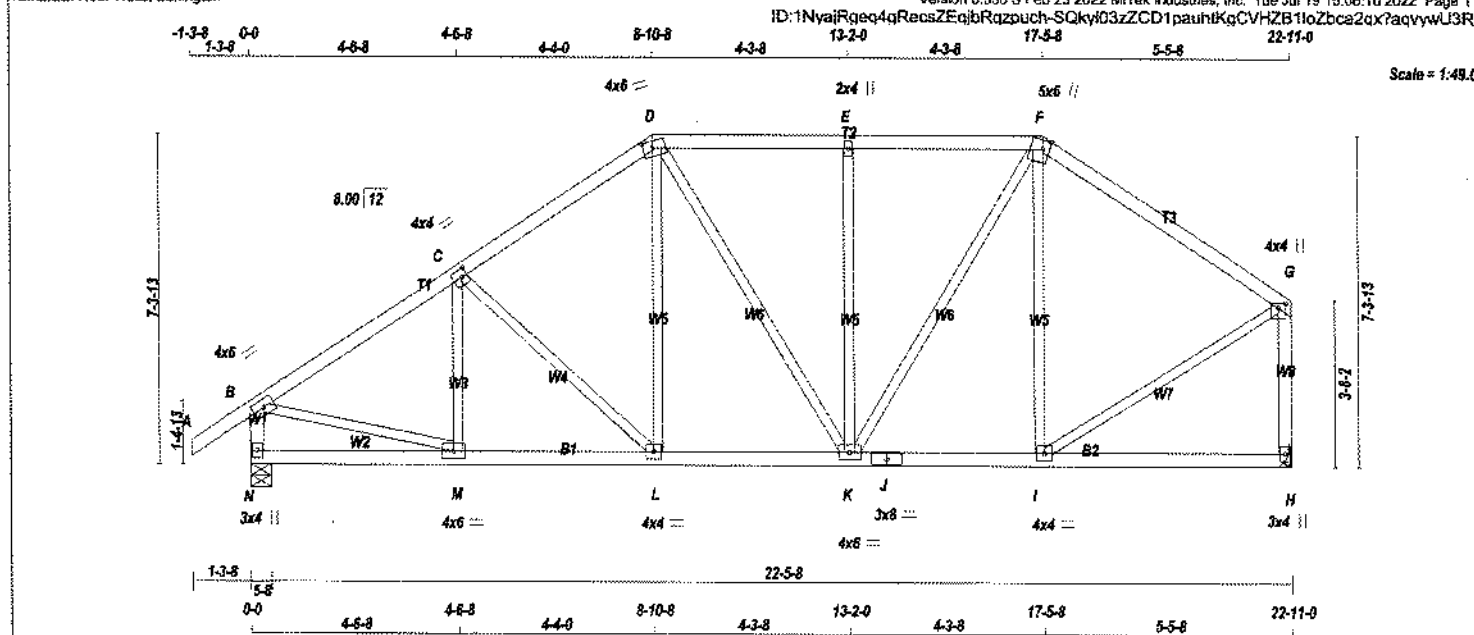

Scale = 1:48.0

TOTAL WEIGHT = 106 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
N - B	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0		
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	4.0	6.0	1.75	2.50
E	TMVW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	Edge	1.75
G	TMVW+p	MT20	4.0	4.0	1.25	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	4.0		
J	BS-t	MT20	3.0	8.0		
K	BMVWV-t	MT20	4.0	6.0		
L	BMVW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	4.0	6.0		
N	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT VERT	1301	1301	0	5-8
H HORIZ	1184	1184	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS
N	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	841	534 / 0 0 / 0 0 / 0 0 / 0 324 / 0 307 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC. LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO					FR-TO		
A-B	0 / 32	-84.9	-84.9 0.11 (1)	10.00	M-C	-174 / 8	0.05 (1)
B-C	-1303 / 0	-84.9	-84.9 0.23 (1)	5.41	C-L	-251 / 0	0.16 (1)
C-D	-1132 / 0	-84.9	-84.9 0.22 (1)	5.72	L-D	0 / 255	0.06 (1)
D-E	-972 / 0	-84.9	-84.9 0.20 (1)	6.08	D-K	0 / 93	0.02 (1)
E-F	-972 / 0	-84.9	-84.9 0.20 (1)	6.08	K-E	-443 / 0	0.42 (1)
F-G	-861 / 0	-84.9	-84.9 0.34 (1)	6.15	K-F	0 / 500	0.11 (1)
N-B	-1265 / 0	0.0	0.0 0.13 (1)	7.16	L-F	-322 / 0	0.31 (1)
H-G	-1143 / 0	0.0	0.0 0.26 (1)	7.43	B-M	0 / 1135	0.26 (1)
					L-G	0 / 836	0.19 (1)
N-M	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
M-L	0 / 1104	-18.5	-18.5 0.22 (1)	10.00			
L-K	0 / 923	-18.5	-18.5 0.19 (1)	10.00			
K-J	0 / 711	-18.5	-18.5 0.19 (4)	10.00			
J-I	0 / 711	-18.5	-18.5 0.19 (4)	10.00			
I-H	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIG 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.76")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.76")
CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.34/1.00 (F-G-1), BC=0.22/1.00 (L-M-1), WB=0.42/1.00 (E-K-1), SS=0.18/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (I) (INPUT = 0.90)
JSI METAL= 0.34 (B) (INPUT = 1.00)

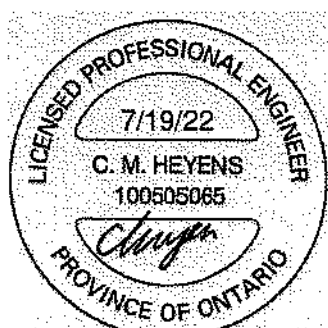


STRUCTURAL COMPONENT ONLY
DWG # TR22070382

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T36	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Tue Jul 19 15:06:11 2022 Page 1

ID: 1NyaiRgeq4qRecsZEqibRazpuch-wdIKyM4bKWLuRiTuR2BR2V6U87oK5oC3b8MMYwU3Q

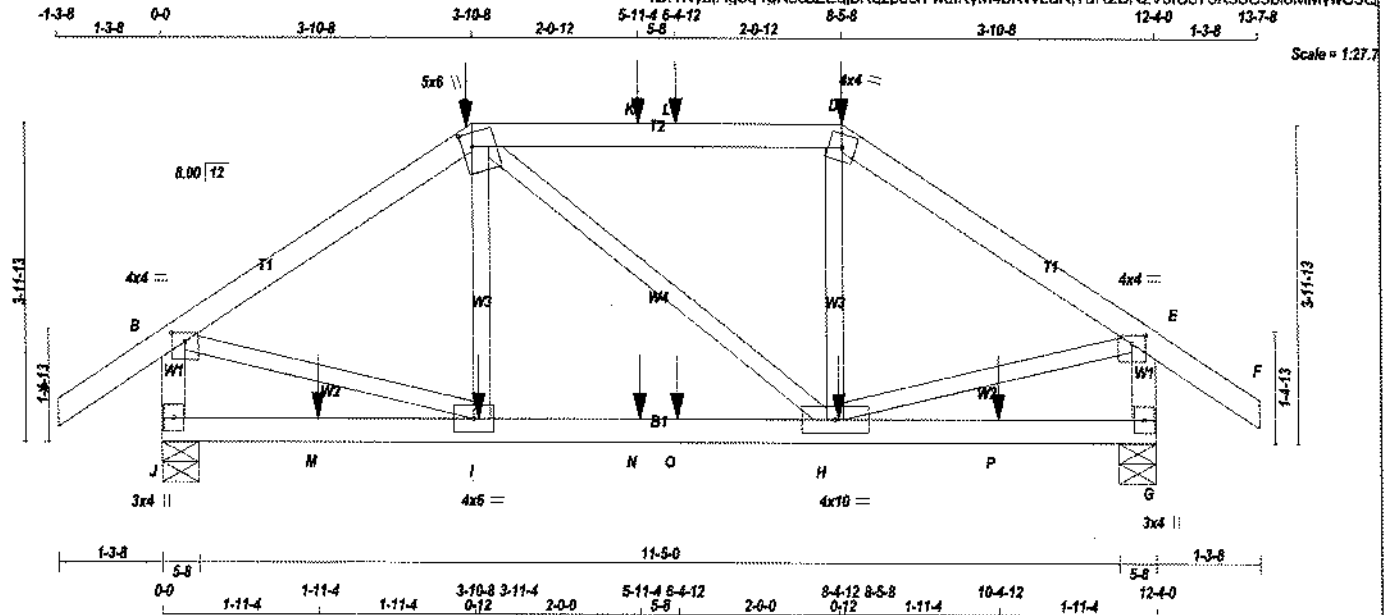

TOTAL WEIGHT = 52 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		
J - 8	2x4 DRY	No.2	SPF		
G - E	2x4 DRY	No.2	SPF		
J - G	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-I	MT20	4.0	10.0		
I	BMVWW-I	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	1157	0	1157	0
O	1157	0	1157	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	818	540 / 0	0 / 0	0 / 0	0 / 0	278 / 0	0 / 0
G	817	540 / 0	0 / 0	0 / 0	0 / 0	278 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 32	-84.9	-84.9 0.13 (1)	10.00	I-C	-113 / 61	0.03 (1)
B-C	-1074 / 0	-84.9	-84.9 0.27 (1)	5.72	C-H	0 / 3	0.06 (4)
C-K	-890 / 0	-84.9	-84.9 0.61 (1)	5.41	H-D	-109 / 63	0.03 (1)
K-L	-890 / 0	-84.9	-84.9 0.61 (1)	5.41	B-I	0 / 924	0.23 (1)
L-D	-890 / 0	-84.9	-84.9 0.61 (1)	5.41	H-E	0 / 927	0.23 (1)
D-E	-1079 / 0	-84.9	-84.9 0.27 (1)	5.71			
E-F	0 / 32	-84.9	-84.9 0.13 (1)	10.00			
J-B	-1121 / 0	0.0	0.0 0.13 (1)	7.46			
G-E	-1120 / 0	0.0	0.0 0.13 (1)	7.46			
J-M	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
M-I	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
I-N	0 / 889	-18.5	-18.5 0.22 (1)	10.00			
N-O	0 / 889	-18.5	-18.5 0.22 (1)	10.00			
O-H	0 / 889	-18.5	-18.5 0.22 (1)	10.00			
H-P	0 / 0	-18.5	-18.5 0.12 (4)	10.00			
P-G	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-188	-188		FRONT	VERT	TOTAL		C1
D	8-5-8	-188	-188		FRONT	VERT	TOTAL		C1
H	8-4-12	-14	-14		FRONT	VERT	TOTAL		C1
I	3-11-4	-14	-14		FRONT	VERT	TOTAL		C1
K	5-11-4	-55	-55		FRONT	VERT	TOTAL		C1
L	6-4-12	-55	-55		FRONT	VERT	TOTAL		C1
M	1-11-4	-14	-14		FRONT	VERT	TOTAL		C1
N	5-11-4	-14	-14		FRONT	VERT	TOTAL		C1
O	6-4-12	-14	-14		FRONT	VERT	TOTAL		C1
P	10-4-12	-14	-14		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	38.7	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.61/1.00 (C-D-1), BC=0.22/1.00 (H-I-1), WB=0.23/1.00 (E-H-1), SS1=0.24/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.91 (E) (INPUT = 1.00)

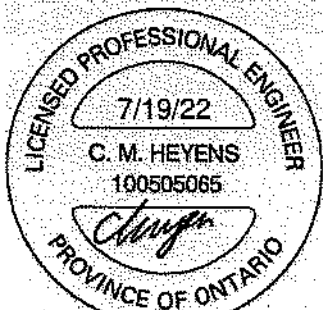

STRUCTURAL COMPONENT ONLY
DWG # TR22070383

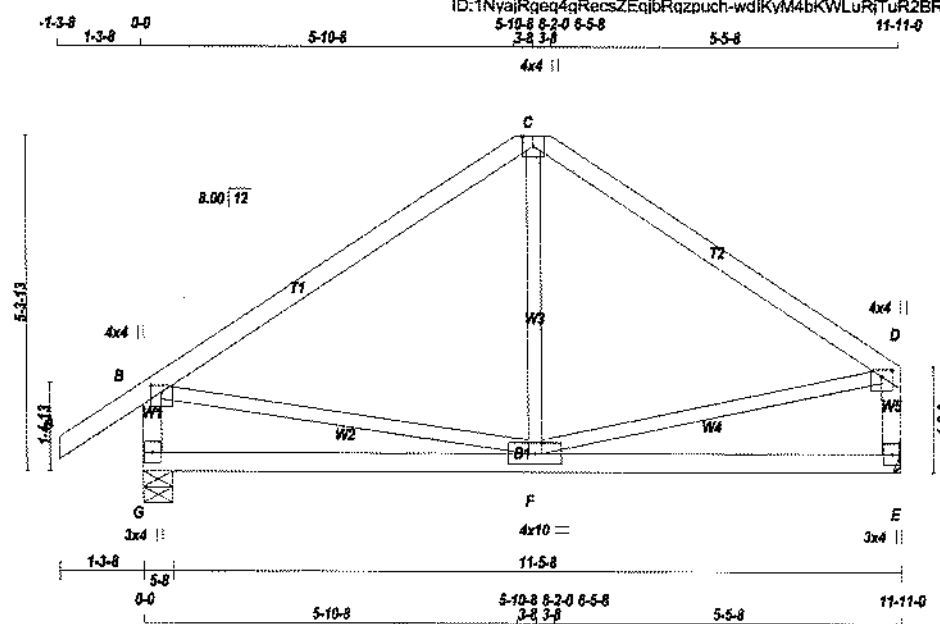

Scale = 1:35.1

TOTAL WEIGHT = 48 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TMTMW+p	MT20	4.0	4.0	Edge
D	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVt+p	MT20	3.0	4.0	
F	BMVWW-t	MT20	4.0	10.0	
G	BMVt+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
FACTORED			MAXIMUM FACTORED			INPUT	REQD	
GROSS REACTION			GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
G	732	0	732	0	0	5-8	5-8	
E	616	0	616	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	518	341/0	0/0	0/0	0/0	176/0	0/0
E	437	278/0	0/0	0/0	0/0	100/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. (LC)
A-B	0/32	-84.9	-84.9 0.11 (1)	10.00	B-F	0/373	0.08 (1)
B-C	-442/0	-84.9	-84.9 0.42 (1)	6.25	F-D	0/378	0.09 (1)
C-D	-442/0	-84.9	-84.9 0.36 (1)	6.25	F-C	-15/94	0.03 (4)
G-B	-688/0	0.0	0.0 0.07 (1)	7.81			
E-D	-576/0	0.0	0.0 0.06 (1)	7.81			
G-F	0/0	-18.5	-18.5 0.19 (4)	10.00			
F-E	0/0	-18.5	-18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.42/1.00 (B-C:1), BC=0.19/1.00 (E-F:4), WB=0.09/1.00 (D-F:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX	MIN
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (B) (INPUT = 0.00)
JSI METAL= 0.15 (B) (INPUT = 1.00)

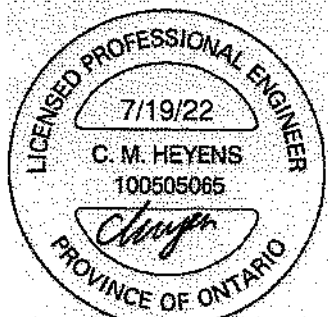


STRUCTURAL COMPONENT ONLY
DWG # TR22070384

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T38A	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.530 S Feb 23 2022 MitTek Industries, Inc. Tue Jul 19 15:06:12 2022 Page 1

ID:1NyajRgeq4gRecsZEqibRqzpuh-CpsiAiSD5gTt3t14 lIgaieWiiYUT3aiLiFuhoaywU3P

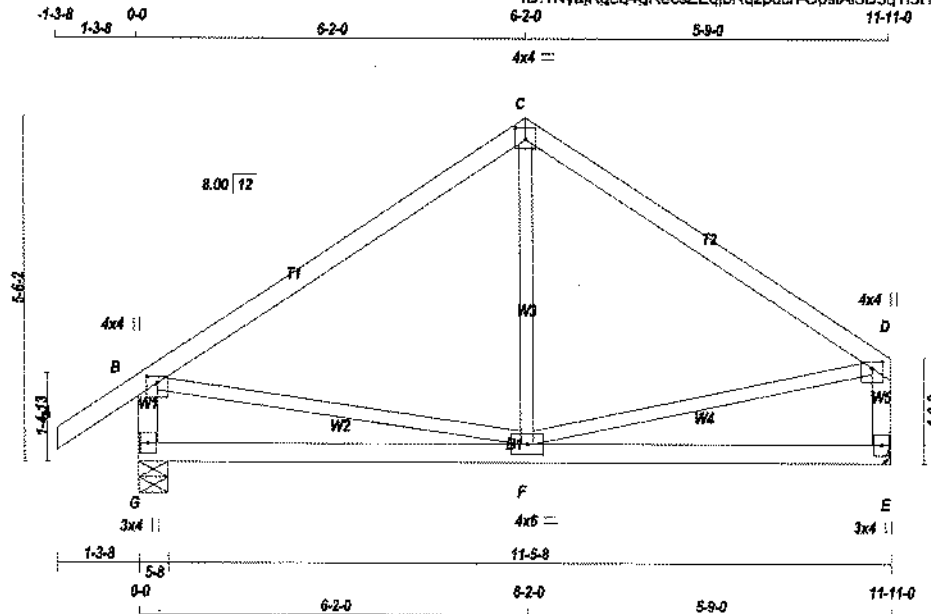

JOB NAME 424092	TRUSS NAME T39	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.530 S Feb 23 2022 MeTek Industries, Inc. Tue Jul 19 15:06:12 2022 Page 1
ID:1NyaiRgeq4qRecsZEqbRqzpuch-OpSiA5D5qT13114 l1gaiebfYSr3WJLlFUhuoywU3P
5-10-8

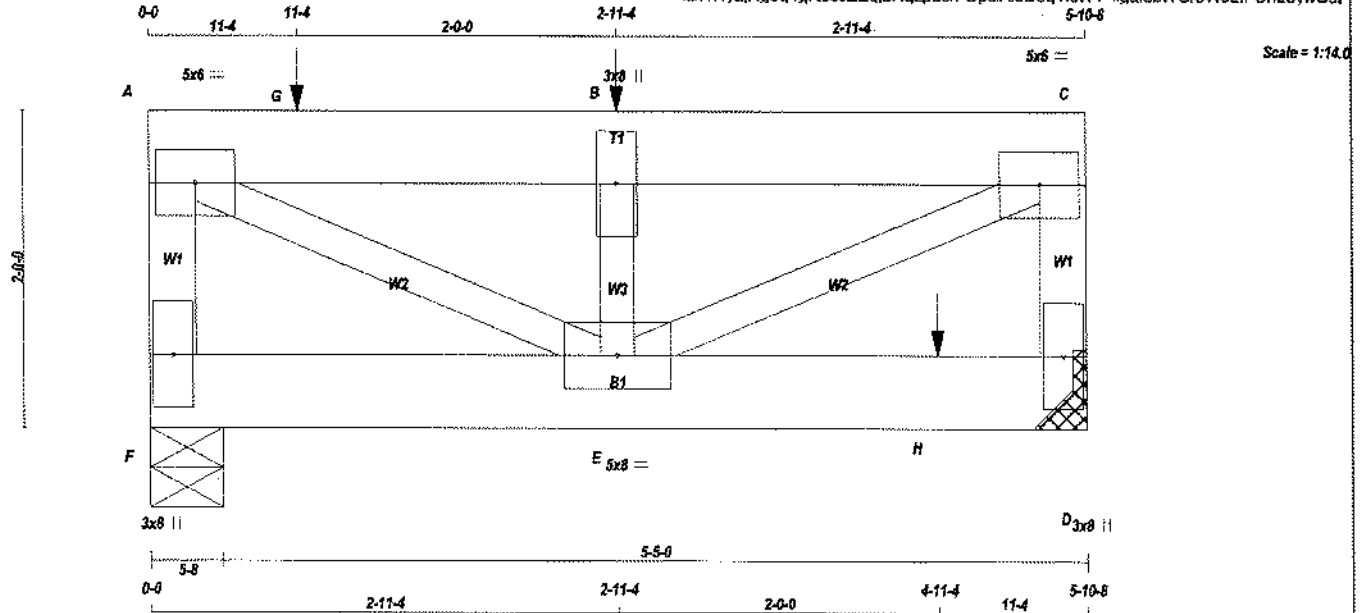

TOTAL WEIGHT = 2 X 29 = 58 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x6	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A	12	TOP
C-D	12	TOP
A-C	7	SIDE(366.2)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
B-E	2	SIDE(172.4)
2x3	1	5

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
A	TMVW-L	MT20	5.0	6.0
B	TMW+W	MT20	3.0	8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	1581	0	1581	0	0
D	2347	0	2347	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1190	774 / 0	0 / 0	0 / 0	0 / 0	416 / 0	0 / 0
D	1663	1073 / 0	0 / 0	0 / 0	0 / 0	589 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
F-A	-1619 / 0	0.0	0.0 0.09 (1)	A-E	0 / 2748
A-G	-2433 / 0	-84.9	-84.9 0.12 (1)	E-B	-2198 / 0
G-B	-2433 / 0	-84.9	-84.9 0.12 (1)	E-C	0 / 2748
B-C	-2433 / 0	-84.9	-84.9 0.11 (1)		
D-C	-1490 / 0	0.0	0.0 0.09 (1)		
F-E	0 / 0	-18.5	-18.5 0.04 (1)		
E-H	0 / 0	-18.5	-18.5 0.29 (1)		
H-D	0 / 0	-18.5	-18.5 0.29 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-11-4	-1463	-1463	--	BACK	VERT	TOTAL	--	C1
G	11-4	-133	-133	--	TOP	VERT	TOTAL	--	C1
H	4-11-4	-826	-826	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH.	LL = 23.3 PSF
DL	= 6.0 PSF
BOT CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (A-B:1), SC=0.29/1.00 (D-E:1), WB=0.34/1.00 (A-E:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 850 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (E) (INPUT = 0.90)
JSI METAL= 0.30 (B) (INPUT = 1.00)

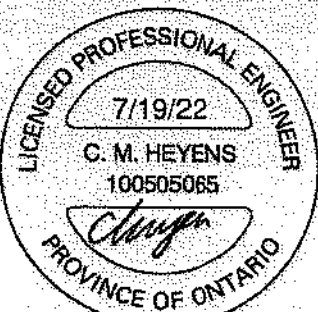

STRUCTURAL COMPONENT ONLY
DWG # TR22070386 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	T39	1	2	TRUSS DESC.		

Tamareck Roof Truss, Burlington


Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:12 2022 Page 2
ID:1NvaiRge04gRecsZEqibRqzpuh-OpstA5D5gTt3t14 lgaiebtYSr3WJLIFUhuoywU3P

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMVW-1	MT20	5.0	6.0		
D	BMV1+p	MT20	3.0	8.0		
E	BMWWVW-1	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

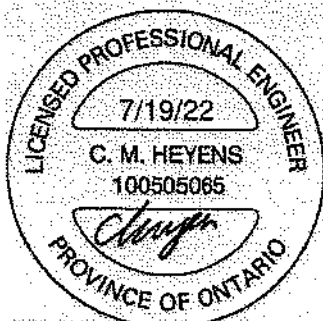


STRUCTURAL COMPONENT ONLY
DWG # TR22070386 PG 2/2

JOB NAME 424092	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:13 2022 Page 1

ID:1NyajRqeq4gRecsZEqjRqzpuh-s?Q4N25rs7bch1cGYTDv7wBmgyp0o2tVWvEFQEyU3O

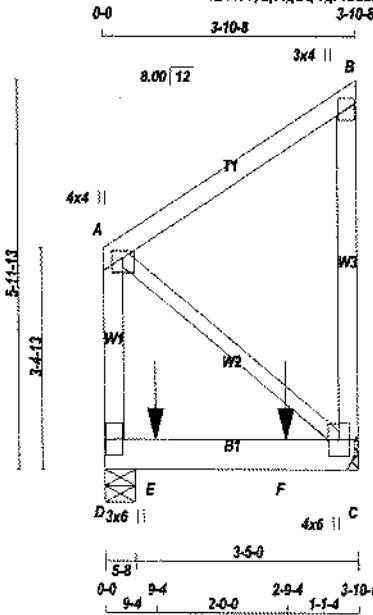

Scale = 1:34.0

TOTAL WEIGHT = 2 X 25 = 50 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - B	2x4	DRY	No.2	SPF
C - B	2x4	DRY	No.2	SPF
D - A	2x4	DRY	No.2	SPF
D - C	2x6	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1 12	TOP	
B-C 1 12	TOP	
D-A 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2 12	SIDE(0.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMV+p	MT20	3.0	4.0		
C	BMVW1+p	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT UP/LIFT IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	747	0	747	0	0	MECHANICAL
D	851	0	851	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 2-0.

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN LIVE		PERM.LIVE	WIND	DEAD	SOIL
	SNOW							
C	529	344 / 0	0 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0
D	602	392 / 0	0 / 0	0 / 0	0 / 0	0 / 0	211 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 0	-84.9 -84.9	0.12 (1)	10.00	A-C	0 / 0	0.00 (1)
C-B	-164 / 0	0.0 0.0	0.05 (1)	7.81			
D-A	-164 / 0	0.0 0.0	0.02 (1)	7.81			
D-E	0 / 0	-18.5 -18.5	0.23 (1)	10.00			
E-F	0 / 0	-18.5 -18.5	0.23 (1)	10.00			
F-C	0 / 0	-18.5 -18.5	0.23 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	9-4	-424	-424	--	BACK	VERT	TOTAL	--	C1
F	2-9-4	-422	-422	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIG 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (A-B:1), BC=0.23/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747
		788	1987
		1873	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.05 (A) (INPUT = 0.90)

JSI METAL= 0.03 (B) (INPUT = 1.00)

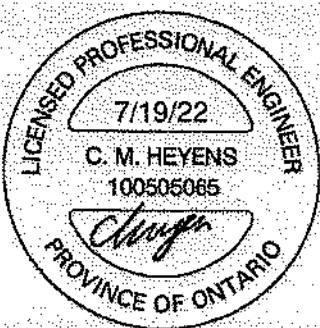

STRUCTURAL COMPONENT ONLY
DWG # TR22070387 PG 1/2

CONTINUED ON PAGE 2

JOB NAME 424092	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTek Industries, Inc. Tue Jul 19 15:06:13 2022 Page 2


ID:1NyaiRgec4gRecsZEgibRgzpuch-s?Q4N25rs7bch1cGYTDv7wBmuyvp0o2VWwEFQEYwU3O

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	6.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

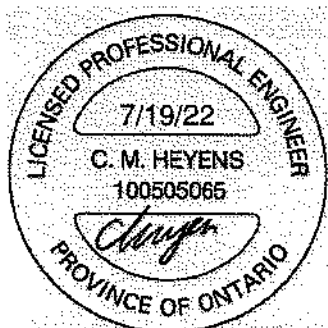


STRUCTURAL COMPONENT ONLY
DWG # TR22070387 PG 2/2

JOB NAME 424086	TRUSS NAME J1	QUANTITY 11	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	-------------------------	-----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:12 2022 Page 1
ID: y2EX6eM7 ulQz86vBWJ49Zzqtvl-jirpxEILxdOYH2Hv1IsNMKpcYaG3eR1AripiywUmp

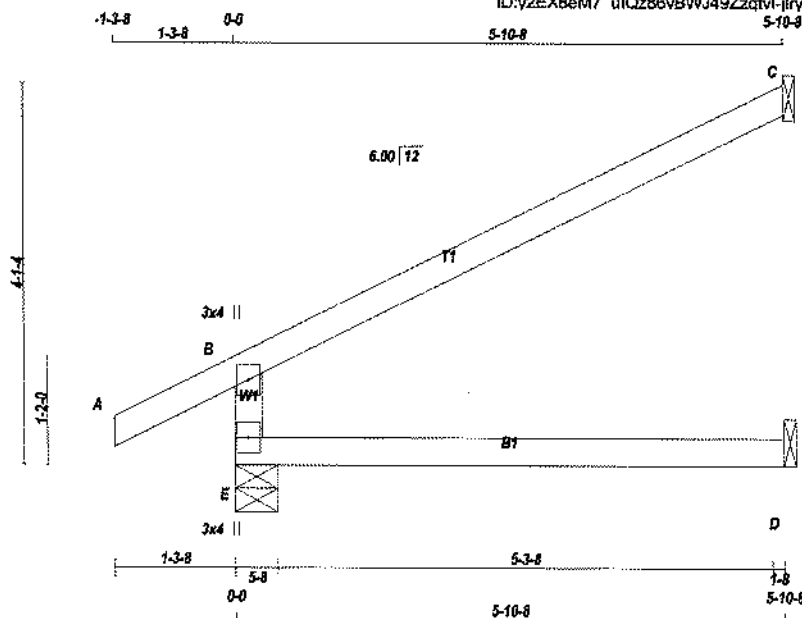

Scale: 1/2"=1'

TOTAL WEIGHT = 11 X 17 = 185 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVtp	MT20	3.0	4.0		
E	BMVtp	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
E	490	0	5-8	5-8
C	187	0	1-8	1-8
D	45	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	346	234 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	129	103 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO							
E-B		-427 / 0	0.0	0.0	0.13 (4)	7.81	10.00
A-B		0 / 26	-84.9	-84.9	0.11 (1)	10.00	6.25
B-C		-28 / 0	-84.9	-84.9	0.50 (1)	6.25	10.00
E-D		0 / 0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.50/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1087 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)

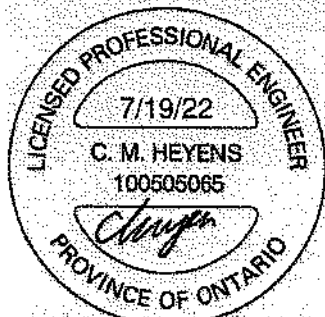

STRUCTURAL COMPONENT ONLY
DWG # TR22070329

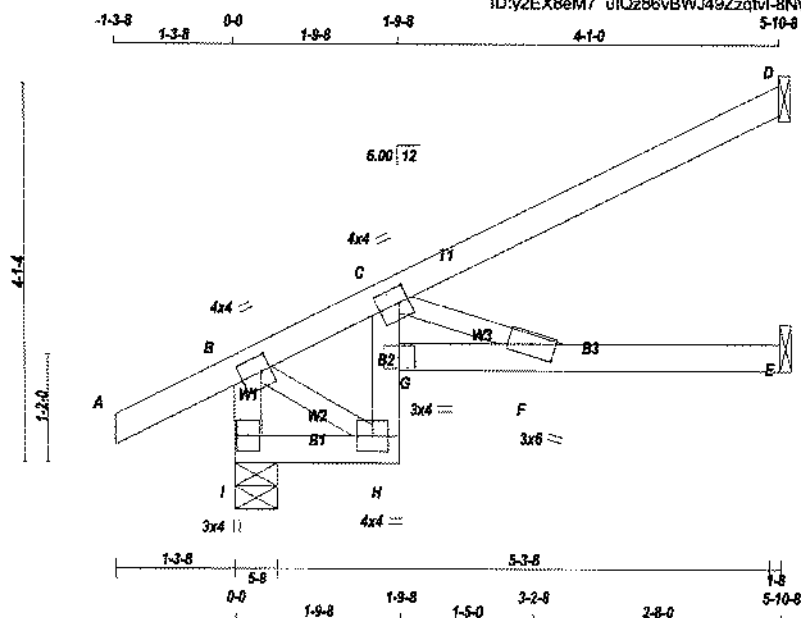

Scale: 1/2"=1'

TOTAL WEIGHT = $8 \times 21 = 168$ lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR	
I - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
H - C	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.25
C	TMVW-t	MT20	4.0	4.0	2.00 1.25
F	BMVW+w	MT20	3.0	6.0	
G	BVMH	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	4.0	
I	SMV1+o	MT20	3.0	4.0	

NOTES {1}

13 Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JOINT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
I	432	0	432	0	0	5-8
D	180	0	180	0	0	1-8
E	110	0	110	0	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) D, E

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D E	304	207 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
	125	95 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
	81	35 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S):

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
I-B	-417 / 0	0.0	0.0	0.04 (1)	7.81	B-H	0 / 202	0.05 (1)
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00	C-F	-482 / 0	0.08 (1)
B-C	-222 / 0	-84.9	-84.9	0.11 (1)	6.25			
C-D	0 / 3	-84.9	-84.9	0.26 (1)	10.00			
I-H	0 / 0	-18.5	-18.5	0.01 (4)	10.00			
H-G	-78 / 0	0.0	0.0	0.24 (1)	7.81			
G-C	0 / 82	0.0	0.0	0.26 (1)	10.00			
G-F	0 / 442	-18.5	-18.5	0.38 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.31 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		=	36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF SCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIG 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= 1/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= 1/ 632 (0.11")

CSI: TC=0.28/1.00 (C-D:1), BC=0.38/1.00 (F-G:1)
WB=0.08/1.00 (C-F:1), SSI=0.21/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAHL VALUES

	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.38 (C) (INPUT = 0.90)
JSI METAL= 0.15 (G) (INPUT = 1.00)

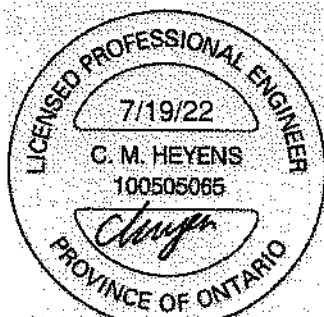


STRUCTURAL COMPONENT ONLY
DWG # TR22070345

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	J2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:48 2022 Page 1
ID: y2EX8eM7 uIQz86v8WJ49Zzqtvlfg0ZGFqHs79HspdUOThJzsUk6q6iLZkjmZC3eywUlr

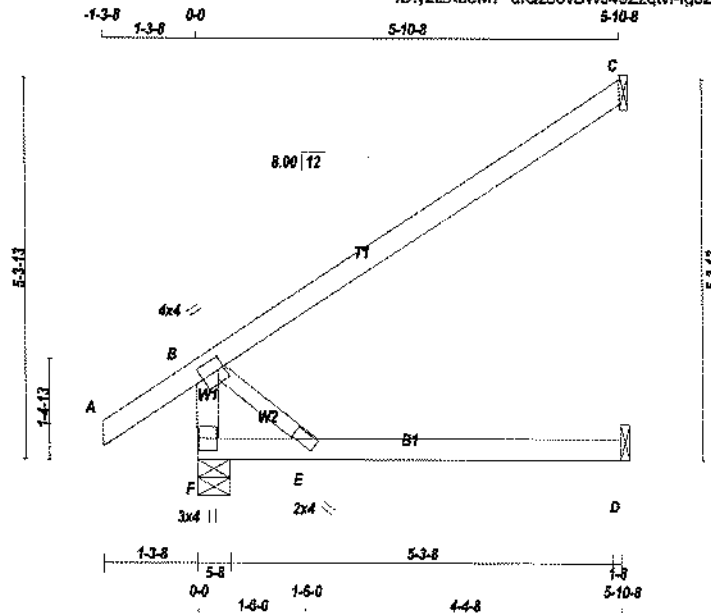

Scale = 1/32" = 1'-0"

TOTAL WEIGHT = 2 X 19 = 38 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	1M/VW-t	MT20	4.0	4.0	2.00	1.00	
E	BMW-w	MT20	2.0	4.0			
F	BMV1+p	MT20	3.0	4.0			

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	420	0	420	0
C	249	0	249	0
D	54	0	54	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	296	201 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
C	172	137 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX
FR-TO											
F-B	-366 / 0	0.0	0.0	0.04 (1)	7.81	8-E	0 / 0	0.00 (1)			
A-B	0 / 32	-84.9	-84.9	0.11 (1)	10.00						
B-C	0 / 0	-84.9	-84.9	0.50 (1)	10.00						
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00						
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	36.7	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 686-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.50/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	(PSI)	SECTION	(PL)	(PL)
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.80)

JSI METAL= 0.07 (B) (INPUT = 1.00)

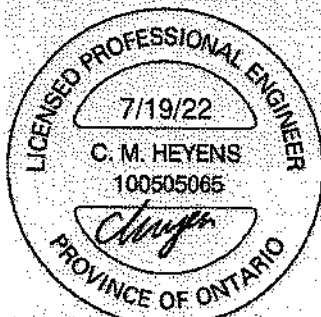

STRUCTURAL COMPONENT ONLY
DWG # TR22070332

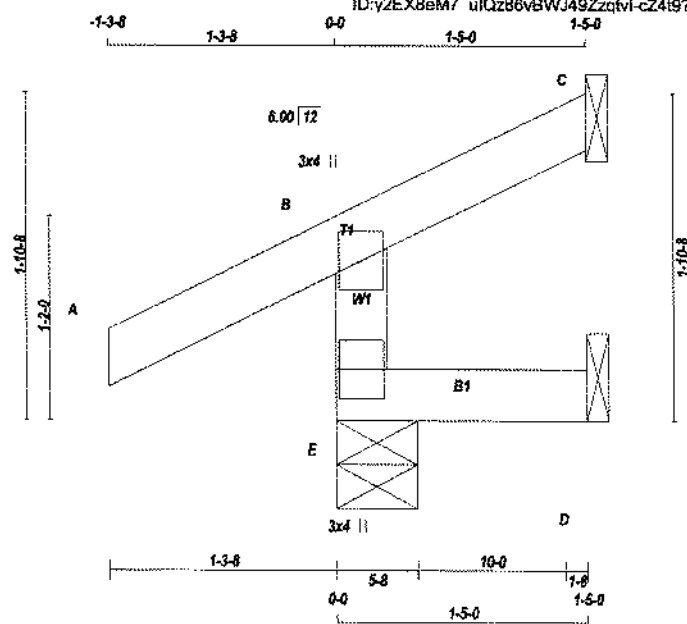

Scale = 1/12.6

TOTAL WEIGHT = 3 X 6 = 18 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
E	BMV+P	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	244	0	244	0	5-8	5-8
C	18	0	18	0	1-8	1-8
D	0	0	11	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-4 FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	170	126 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0
C	12	9 / -22	0 / 0	0 / 0	0 / 0	3 / 0	0 / 0
D	0	0 / -9	0 / 0	0 / 0	0 / 0	8 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						
E-B	-218 / 0	0.0	0.03 (5)	7.81		
A-B	0 / 26	-84.9	-84.9 0.11 (1)	10.00		
B-C	-19 / 0	-84.9	-84.9 0.08 (1)	6.25		
E-D	0 / 0	-18.5	-18.5 0.03 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.11/1.00 (A-B-1), BC=0.03/1.00 (D-E-5), WB=0.00/1.00 (n/a-0), SS=0.08/1.00 (A-B-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	850	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.09 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

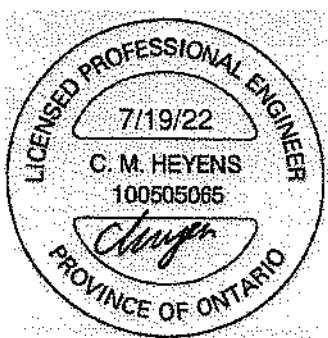


STRUCTURAL COMPONENT ONLY
DWG # TR22070346

JOB NAME 424089	TRUSS NAME J20	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITAK Industries, Inc. Tue Jul 19 14:42:54 2022 Page 1
ID:ec87Gik0W0ykNucQiiYTZlzoVK-KsOCihAIKHKSL19059dnwib10MVVKXaqirgqywUPF

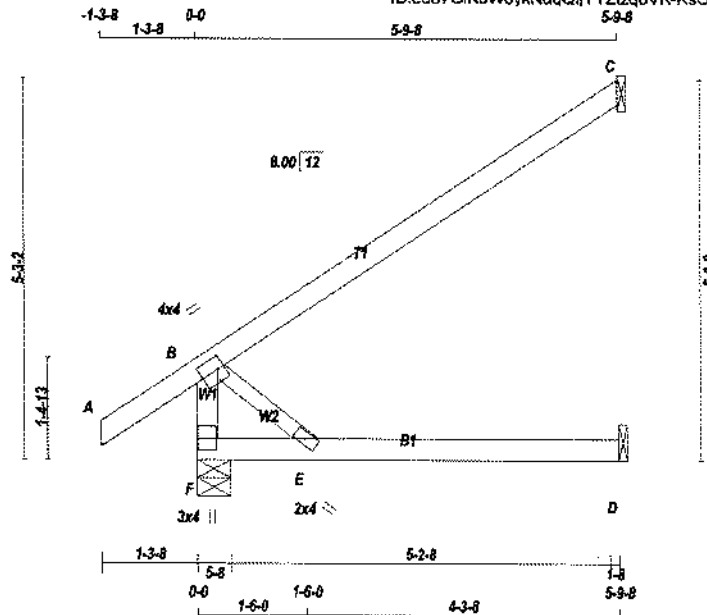

Scale = 1:30.5

TOTAL WEIGHT = 3 X 19 = 57 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMAVW+L	MT20	4.0	4.0	2.00	1.00	
E	BMVW+L	MT20	2.0	4.0			
F	BMV1+p	MT20	3.0	4.0			

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	416	0	416	0	0	5-8
C	246	0	246	0	0	1-8
D	54	0	60	0	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	293	199 / 0	0 / 0	0 / 0	0 / 0	0 / 0	84 / 0	0 / 0
C	170	135 / 0	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							FR-TO		
F-B	-382 / 0	0.0	0.0	0.04 (1)	7.81	10.00	B-E	0 / 0	0.00 (1)
A-B	0 / 32	-84.9	-84.9	0.11 (1)	10.00				
B-C	0 / 0	-84.9	-84.9	0.48 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.18 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	38.7	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2018
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.05")

CSI: TC=0.48/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS 8END=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)

JSI METAL= 0.07 (B) (INPUT = 1.00)

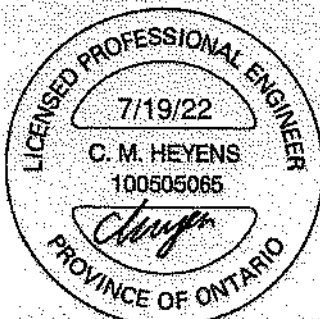


STRUCTURAL COMPONENT ONLY
DWG # TR22070356

JOB NAME 424089	TRUSS NAME J21	QUANTITY 5	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MTEK Industries, Inc. Tue Jul 19 14:42:55 2022 Page 1
ID:ec87GK0W0ykNuqQijYTZtzoVVK-c2yaz0Bx5bTzyBkafs84T8HqzPiiEnni2OahMGywUPE

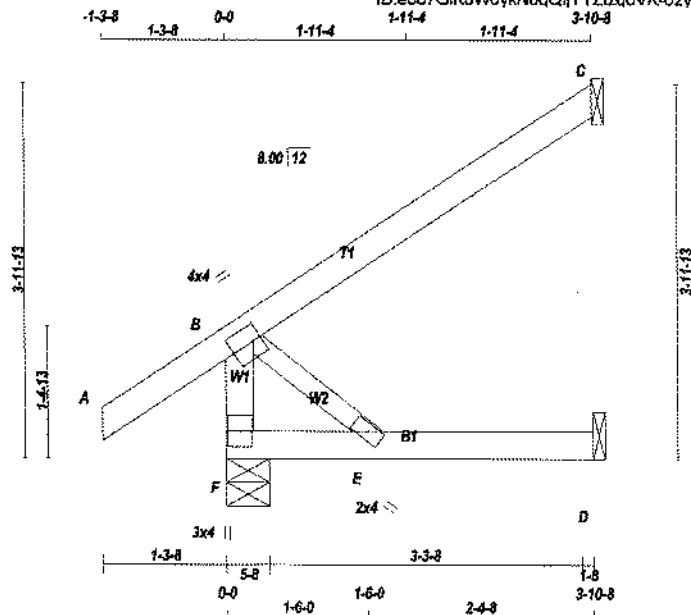

Scale = 1:23.5

TOTAL WEIGHT = 5 X 14 = 71 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	4.0	2.00	1.00	
E	BMVW-w	MT20	2.0	4.0			
F	BMV1+p	MT20	3.0	4.0			

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT	REQRD		
GROSS REACTION		GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	317	0	317	0	0	5-8	5-8
C	164	0	164	0	0	1-8	1-8
D	38	0	40	0	0	1-8	1-8

SEE MTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	223	154 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
C	113	90 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO							FR-TO		
F-B	-281 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 32	-84.9	-84.9	0.13 (5)	10.00				
B-C	0 / 0	-84.9	-84.9	0.22 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 23.3 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.22/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070357



TOTAL WEIGHT = $6 \times 16 = 96$ lb

DRY: SEASONED LUMBER.

JT TYPE	PLATES	W	LEN	Y	X
B	MB14	MT20	3.0	6.0	

1) Lateral braces to be a minimum of 2X4 SPF #2

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	220	0	220	0	-156	5-8	5-8
B	419	0	419	-141	-273	3-0	3-0
D	88	0	88	0	-110	6-8	6-8

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 156 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT B FOR 273 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

PROVIDE FOR 141 LBS FACTORED HORIZONTAL REACTION AT JOINT B

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	153	116.0	0.0	0.0	0.135	36.0	0.0
B	295	200.0	0.0	0.0	0.256	95.0	0.0
D	64	21.0	0.0	0.0	0.106	43.0	0.0

0	0	0/0	0/0	0/0	501/0	0/0	0/0
---	---	-----	-----	-----	-------	-----	-----

BEARING MATERIAL TO BE SFC NO.2 OR BETTER AT JOINT(S) C S F

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

TOTAL LOAD CASES: (12)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO					
A-B	0 17	-84.9	-84.9 0.11 (1)	10.00	E-F	-321 / 128	0.00 (1)
B-F	-104 / 19	-84.9	-84.9 0.07 (12)	6.25			
F-C	-58 / 2	-84.9	-84.9 0.39 (1)	6.25			
B-E	0 / 0	-18.5	-18.5 0.27 (1)	10.00			
E-D	0 / 0	-18.5	-18.5 0.27 (1)	10.00			

WIND LOAD APPLIED IS DERIVED FROM REFERENCE VELOCITY PRESSURE OF (9.2) PSF AT (20.0-0) FT-IN-XS REFERENCE HEIGHT ABOVE GRADE AND USING EXTERNAL PEAK COEFFICIENTS, C_{pe} , BASED ON THE (MAIN WIND FORCE RESISTING SYSTEM), INTERNAL WIND PRESSURE IS BASED ON DESIGN (CATEGORY 2). BUILDING MAY BE LOCATED ON (OPEN TERRAIN), AND TRUSS IS DESIGNED TO BE LOCATED AT LEAST (0-0) FT-IN-XS AWAY FROM EAVE TRUSS UPLIFT IS BASED ON TOP AND BOTTOM CHORD DEAD LOADS OF 8.0 PSF AND 7.4 PSF RESPECTIVELY.

SPECIFIED LOADS:

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/640 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/510 (0.14")

CSI: TC=0.39/1.00 (C-F:1), BC=0.27/1.00 (D-E:1)
WB=0.00/1.00 (F-F:1), SS=0.25/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
ME30	650	371	1747	788	1947	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



JOB NAME 424092	TRUSS NAME J30	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamersack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:05 2022 Page 1
ID: 1NyajRgeq4gRecsZEqibRqzpuh-5Tx3IJ7qgbj07k4n41oEslnk5wRuJhfp8iywUJ3W

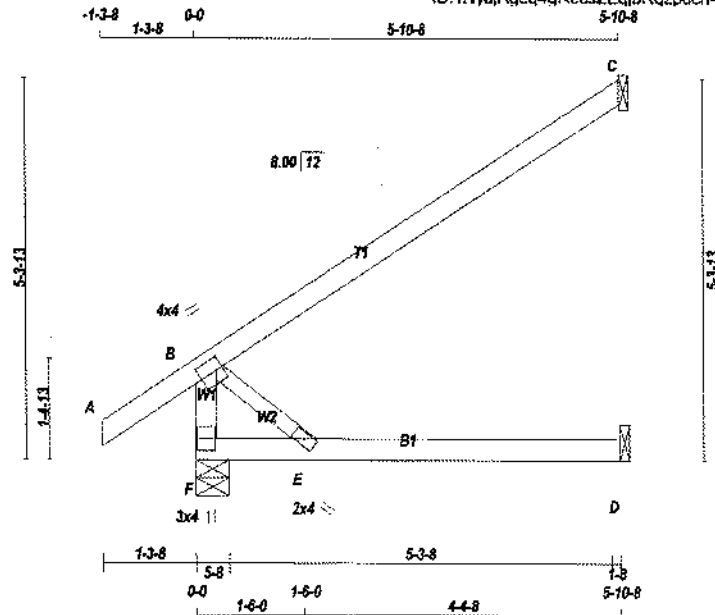

Scale = 1:30.6

TOTAL WEIGHT = 19 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+I	MT20	4.0	4.0	2.00	1.00
E	BMVW+I	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES-

(1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
F	420	420	0	5-8
C	249	249	0	1-8
D	54	51	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	286	201 / 0	0 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
C	172	137 / 0	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
F-B		-366 / 0	0.0	0.0	0.04 (1)	B-E		0 / 0	0.00 (1)
A-B		0 / 32	-84.9	-84.9	0.11 (1)				
B-C		0 / 0	-84.9	-84.9	0.50 (1)				
F-E		0 / 0	-18.5	-18.5	0.14 (4)				
E-D		0 / 0	-18.5	-18.5	0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING =

24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.50/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 OOMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	650	371	1747 786 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)


JSI METAL= 0.07 (B) (INPUT = 1.00)

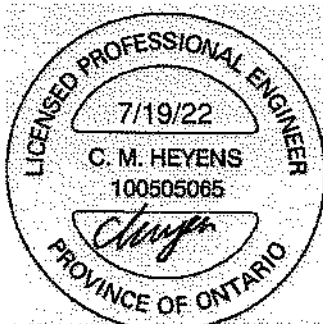

STRUCTURAL COMPONENT ONLY
DWG # TR22070375

JOB NAME 424092	TRUSS NAME J31	QUANTITY 8	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.530 5 Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:08:05 2022 Page 1
ID:1NyaiRoeq4gRecsZEibRazpuch-6Tx3iJ7ciqbljo7k4n41oEsMBk6VwRwJhfp8iywU3W

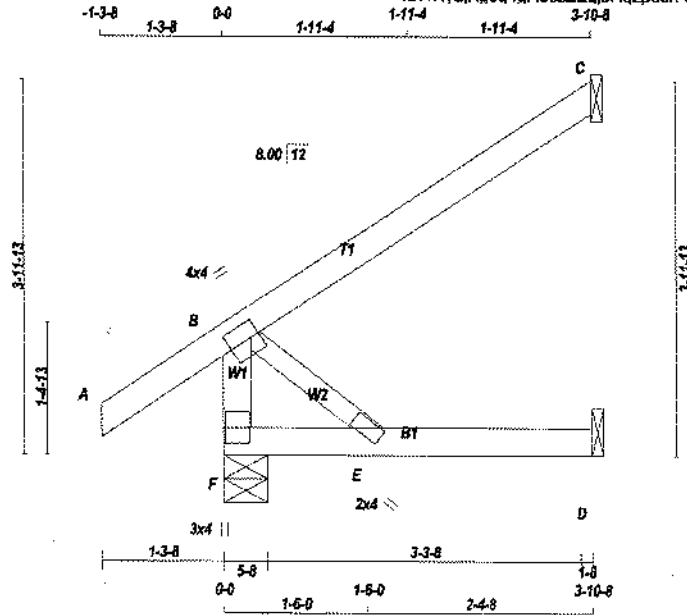

Scale = 1:23.5

TOTAL WEIGHT = 8 X 14 = 113 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.00
E	BMVW-w	MT20	2.0	4.0	
F	BMV1-p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REGRO BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
F	317	0	317	0	0	5-8	5-8		
C	164	0	164	0	0	1-8	1-8		
D	36	0	40	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	223	154 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
C	113	90 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)
FR-TO						FR-TO	
F-B	-281 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0
A-B	0 / 32	-84.9	-84.9	0.13 (5)	10.00		
B-C	0 / 0	-84.9	-84.9	0.22 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(56 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.22/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

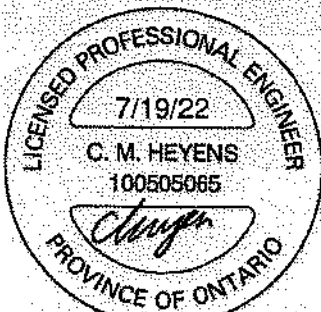

STRUCTURAL COMPONENT ONLY
DWG # TR22070376



TOTAL WEIGHT = $2 \times 7 = 14$ lb

DRY- SEASONED LUMBER

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BUILDING BEARINGS

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



DESIGN CRITERIA

SPECIFIED LOADS:

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF SCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 886-14
- TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.11/1.00 (A-B:5), BC=0.03/1.00 (D-E:5)
WB=0.06/1.00 (r/a:0), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAR. VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1997	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.09 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	C2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Jul 19 14:18:10 2022 Page 1
ID:y2EX8eM7 ulQz86v8WJ49ZzqtV4-nMjBfCRpKMqI jB9U7qnyH4Los1o998asMBkrywUmR

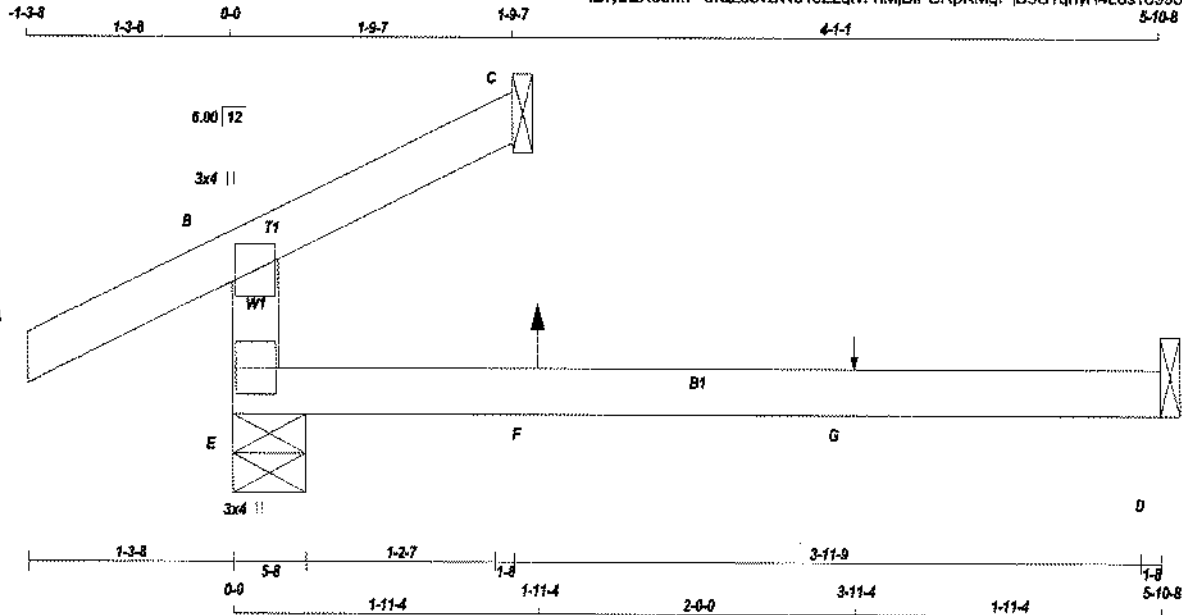

Scale = 1/4" = 1'-0"

TOTAL WEIGHT = 2 X 12 = 23 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:		
E - B	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL =	23.3	PSF
A - C	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	DL =	6.0	PSF
E - D	2x4	DRY	No.2	SPF	265	0	265	0	BOT CH. LL =	0.0	PSF
DRY: SEASONED LUMBER.					60	0	60	0	DL =	7.4	PSF
					44	0	52	0	TOTAL LOAD =	36.7	PSF

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	187	125 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	44	19 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 2	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO				FR-TO			
E-B	-208 / 0	0.0	0.0	0.11 (4)	7.81		
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00		
B-C	-8 / 9	-84.9	-84.9	0.08 (4)	10.00		
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00		
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00		
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	4	1	7	FRONT	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA D86-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = 1/360 (0.20")
CALCULATED VERT. DEFL (LL) = 1/998 (0.01")
ALLOWABLE DEFL (TL) = 1/360 (0.20")
CALCULATED VERT. DEFL (TL) = 1/989 (0.04")

CSI TC=0.11/1.00 (A-B:1), BC=0.14/1.00 (D-E:4)
WB=0.00/1.00 (na:0), SSI=0.06/1.00 (D-E:4)

DOL LUMBER=0.97 NAIL=0.97 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.09 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

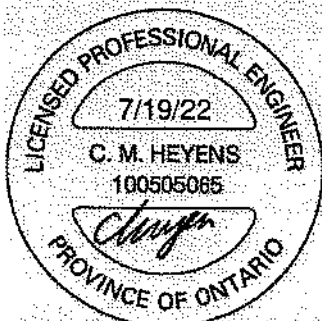


STRUCTURAL COMPONENT ONLY
DWG # TR22070326

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	C3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID: v2EX8eM7 uIQz86vBWJ49ZzqM-FZHvD3eeVXw7INIBW3JAQDdCE8XcPHpW5IHhywUmQ

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:11 2022 Page 1

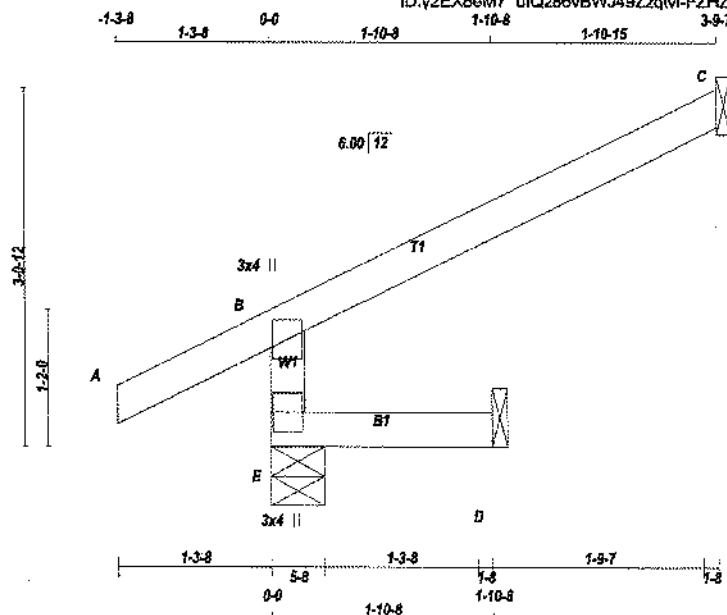

Scale = 1/16" = 1'-0"

TOTAL WEIGHT = 2 X 10 = 19 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	DESCR	SPF
E - B	2x4	DRY	No.2	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
E - D	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES: (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	335	0	335	0	5-8	5-8
C	121	0	121	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE COMBINED		MAX/MIN COMPONENT REACTIONS					
JT		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	233	173 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	83	66 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-316 / 0	0.0	0.0	0.01 (4)			7.81
A-B	0 / 26	-84.9	-84.9	0.12 (5)			10.00
B-C	-18 / 0	-84.9	-84.9	0.21 (1)			6.25
E-D	0 / 0	-18.5	-18.5	0.02 (4)			10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CS1: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:D), SSF=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.80)
JSI METAL= 0.09 (B) (INPUT = 1.00)

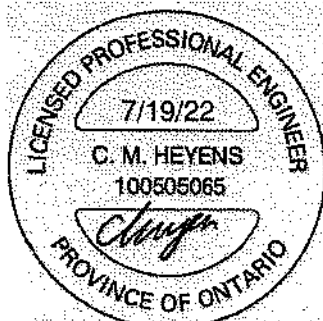


STRUCTURAL COMPONENT ONLY
DWG # TR22070327

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424086	C4	2	1	TRUSS DESC.		

Tamersack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 14:18:12 2022 Page 1
ID: y2EX8eM7 ulQz86vBWJ49ZzqlvI-jryxElxdOYHIZHV1IsNMONcYaG3eR1ArtpiywUmp

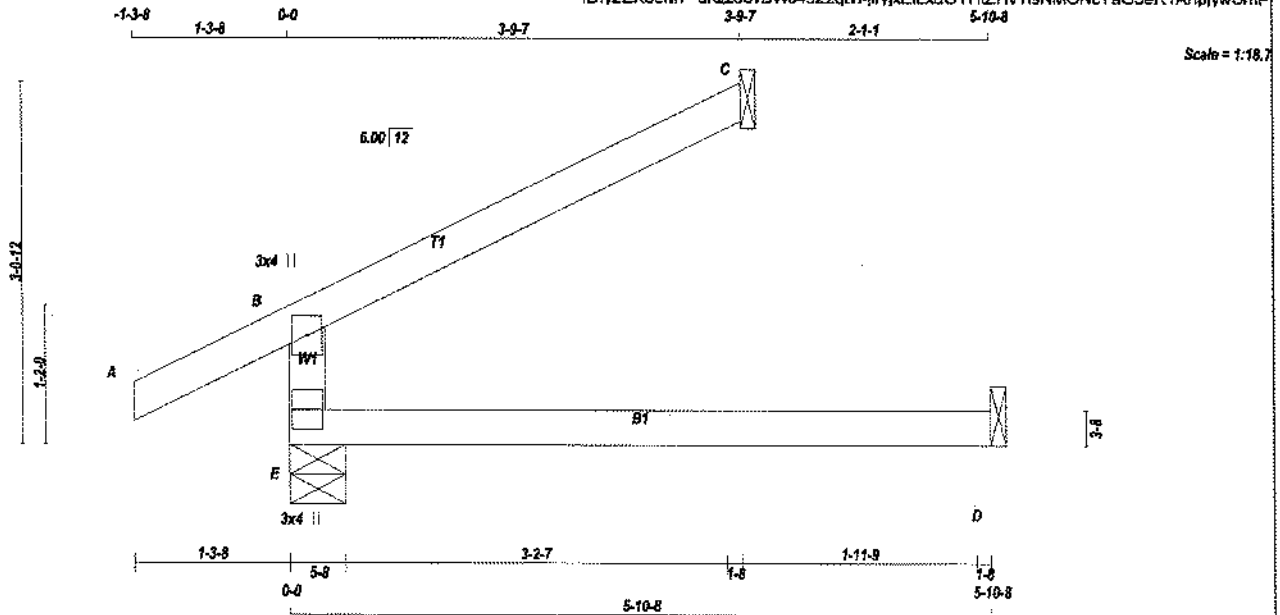

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF	SPF	SPECIFIED LOADS:	TOP CH.	LL	PSF
E - B	2x4	DRY	No.2					DL	23.3	6.0	PSF
A - C	2x4	DRY	No.2					BOT CH.	LL	0.0	PSF
E - D	2x4	DRY	No.2					DL	7.4	7.4	PSF
DRY: SEASONED LUMBER.								TOTAL LOAD	= 36.7 PSF		

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG			
E	380	380	0	5-8	5-8		
C	121	121	0	1-8	1-8		
D	45	50	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
E	289	173 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0
C	83	66 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
E-B	-316 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 26	-84.9	-84.9	0.11 (1)	10.00		
B-C	-18 / 0	-84.9	-84.9	0.21 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

SPACING = 24.0 IN. C/C

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(56 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.20")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = 1/360 (0.20")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.00")
CS1: TC=0.21/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1937 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (E) (INPUT = 0.90)

JSI METAL= 0.09 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22070328

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	C30	4	1	TRUSS DESC.		

Tamarsack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:02 2022 Page 1
ID:1NyaiRgeq4qRecsZEqjbRazpuch-huFw3HzzySICAsLGS9P7XKAbEuWW6mj48t h39YNywuJ3Z

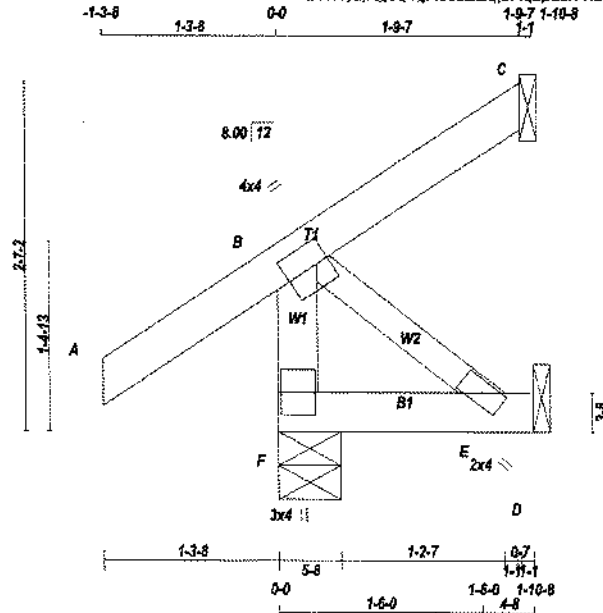

Scale = 1:16.4

TOTAL WEIGHT = 4 X 9 = 36 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.00
E	BMVW-1	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	254	0	254	0
C	31	0	31	0
D	17	0	17	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	177	130 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	21	17 / -25	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
F-B	-237 / 0	0.0 0.0	0.02 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 32	-84.9 -84.9	0.12 (5)	10.00			
B-C	-25 / 0	-84.9 -84.9	0.11 (5)	6.25			
F-E	0 / 0	-18.5 -18.5	0.02 (4)	10.00			
E-D	0 / 0	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/998 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/989 (0.00")

CSI: TC=0.12/1.00 (A-B-5), BC=0.02/1.00 (E-F-4), WB=0.00/1.00 (B-E-1), SS=0.00/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	660	371	1747	788	1987


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)

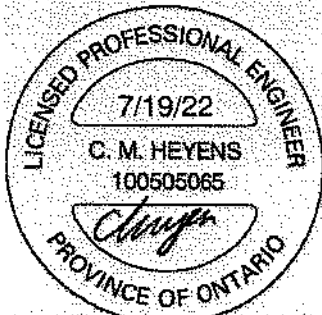

STRUCTURAL COMPONENT ONLY
DWG # TR22070370



TOTAL WEIGHT = 14 lb


```
JSI GRIP= 0.15 (B) (INPUT = 0.90 )
JSI METAL= 0.05 (B) (INPUT = 1.00 )
```



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	C32	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:08:03 2022 Page 1
ID:1NyajRgeq4gRecsZEqjbRozpuch-94ptHd aD3K1UVrLzM2Zpm0rws7SXO0DLpi4pywU3Y

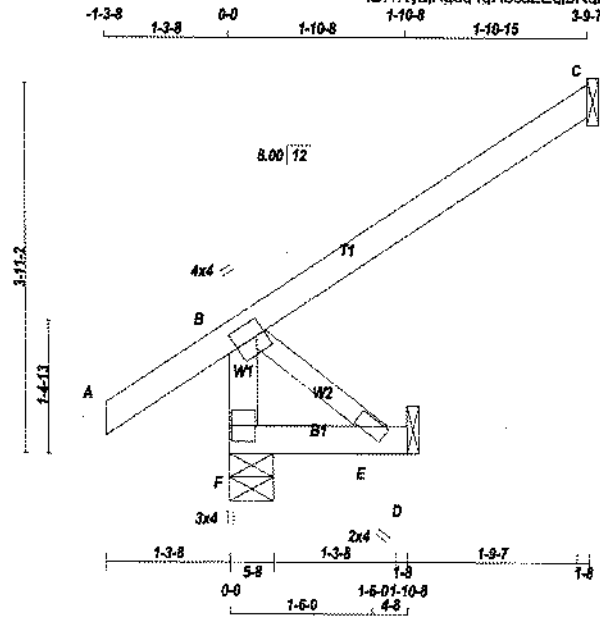

Scale = 1:23.5

TOTAL WEIGHT = 12 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
F - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM/VW-t	MT20	4.0	4.0	2.00	1.00
E	BMW-w	MT20	2.0	4.0		
F	BMV-t+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	294	0	204	0	5-8	5-8
C	161	0	161	0	1-8	1-8
D	17	0	19	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
F	205	152 / 0	0 / 0	0 / 0	53 / 0	0 / 0	0 / 0
C	111	88 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO	
F-B	-277 / 0	0.0 0.0 0.03 (1)	7.81	0 / 0
A-B	0 / 32	-84.9 -84.9 0.12 (5)	10.00	
B-C	0 / 0	-84.9 -84.9 0.21 (1)	10.00	
F-E	0 / 0	-18.5 -18.5 0.02 (4)	10.00	
E-D	0 / 0	-18.5 -18.5 0.01 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 36.7 PSF				

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.21/1.00 (B-C:1), BC=0.02/1.00 (E-F:4)
WB=0.00/1.00 (B-E:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 786	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.80)

JSI METAL= 0.05 (B) (INPUT = 1.00)

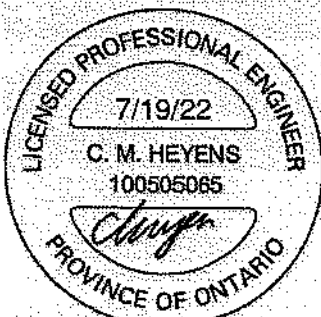


STRUCTURAL COMPONENT ONLY
DWG # TR22070372

JOB NAME 424092	TRUSS NAME C33	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Version 8.830 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:04 2022 Page 1					

Tamareck Roof Truss, Burlington

ID:1NyaiRgeq4gRecsZEqjbRqzpuh-dHNhUz C MSu5fQYW4ZoG0JBbKmcB eAS7YGcGyWU3X

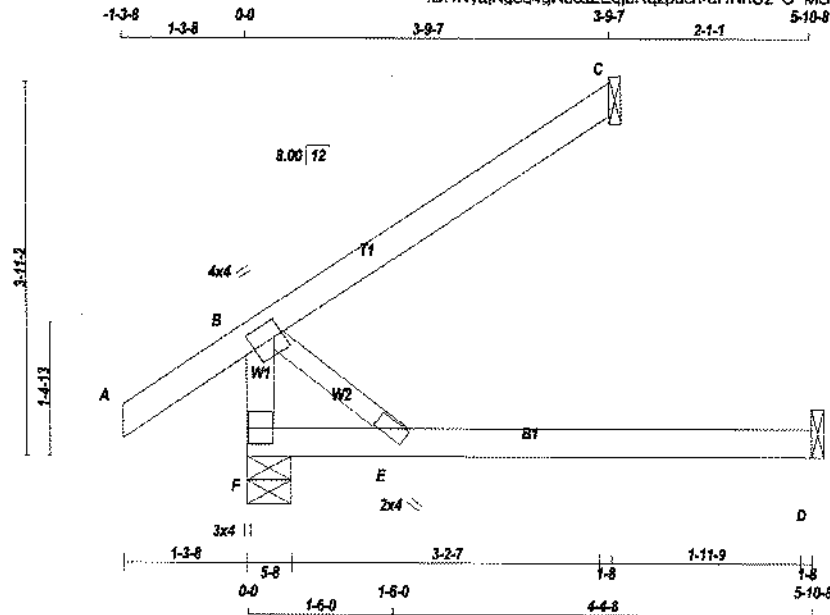

Scale = 1:23.2

TOTAL WEIGHT = 16 lb

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	No. 2	
F - B	2x4	DRY	No. 2	SPF	
A - C	2x4	DRY	No. 2	SPF	
F - D	2x4	DRY	No. 2	SPF	
ALL WEBS 2x3 DRY No. 2					SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMW+4	MT20	4.0	4.0	2.00 1.00
E	BMW+4	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
F	331	331	0	5-8
C	161	161	0	1-8
D	54	61	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX / MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	235	152 / 0	0 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0
C	111	88 / 0	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	CS (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO					FR-TO		
F-B	-277 / 0	0.0	0.0	0.03 (1)	B-E	0 / 0	0.00 (1)
A-B	0 / 32	-84.9	-84.9	0.11 (1)			
B-C	0 / 0	-84.9	-84.9	0.21 (1)			
F-E	0 / 0	-18.5	-18.5	0.14 (4)			
E-D	0 / 0	-18.5	-18.5	0.19 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
DL = 6.0 PSF	
BOY CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 36.7 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2015, ABC 2015
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.21/1.00 (B-C:1), BC=0.19/1.00 (D-E:4)
WB=0.00/1.00 (B-E:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	660	371	1747
		788	1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22070373

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
424092	C34	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.630 S Feb 23 2022 Mitek Industries, Inc. Tue Jul 19 15:06:04 2022 Page 1

ID:1NyajRqea4gRecsZEqibRqzpuh-dHNhUz C MSu5QYW4ZcGJCiknGB eAS7YGcGywU3X

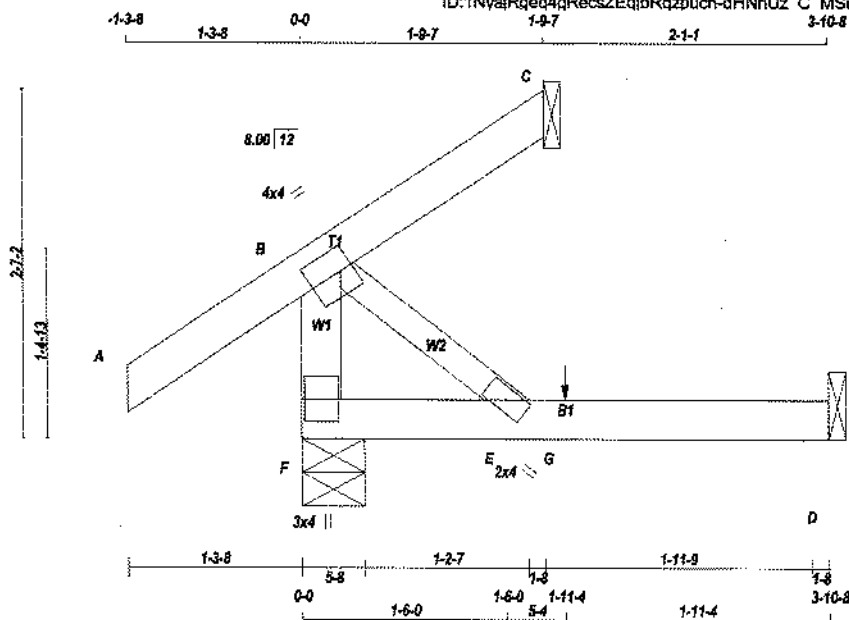

Scale = 1:16.4

TOTAL WEIGHT = 3 X 11 = 34 lb

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.00
E	BMVW-w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

NOTES:

- 1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F		273	0	273	0	0	5-8	5-8	
C		31	0	31	0	-35	1-8	1-8	
D		38	0	40	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	192	130 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	21	17 / -25	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
F-B	-237 / 0	0.0	0.0 0.02 (1)	B-E	0 / 0
A-B	0 / 32	-84.9	-84.9 0.13 (5)		
B-C	-25 / 0	-84.9	-84.9 0.13 (5)		
F-E	0 / 0	-18.5	-18.5 0.08 (4)		
E-G	0 / 0	-18.5	-18.5 0.08 (4)		
G-D	0 / 0	-18.5	-18.5 0.08 (4)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	36.7	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSF: TC=0.13/1.00 (A-B-5), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747
			788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22070374

EWP DESIGN INC.

(905) 832-2250

FAX (905) 832-0286

RESPONSIBILITIES AND SPECIFICATIONS

RESPONSIBILITIES

1. EWP DESIGN INC. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on each drawing meet or exceed the actual dead load imposed by the structure, the live load imposed by the intended use and the snow load imposed by local building code or authorities with jurisdictions.
3. All dimensions are to be verified by the owner, contractor, architect or other authorities with jurisdictions before truss fabrication.
4. EWP DESIGN INC. bears no responsibility for the erection of trusses. Persons erecting trusses are cautioned to seek professional advice regarding the temporary and permanent bracing for the system. Bracing shown on EWP DESIGN INC. drawing is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacturer's responsibility to ensure that trusses are manufactured in conformance with specifications of EWP DESIGN INC. as outlined below.

SPECIFICATIONS

1. Trusses designed by EWP DESIGN INC. conform to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type, as indicated on the EWP DESIGN INC. drawings, and conform to the design procedures established by the Truss Plate Institute of Canada. Unit stresses used for truss designs are as per the edition of CSA-O86 shown on EWP DESIGN INC. drawings.
2. Lumber is to be the size, species and grade as specified on EWP DESIGN INC. drawings.
3. Moisture content of lumber shall not exceed 19% in service unless specified otherwise.
4. Metal connector plates shall be applied to both faces of truss at each joint and shall be positioned as specified.
5. Top chords of trusses are assumed to be continuously braced laterally by roof sheathing or by purlins at intervals not exceeding 12.5 times the thickness of top chord member.
6. Bottom chords shall be laterally braced at intervals not exceeding 3M (10') o.c., where rigid ceiling is not applied directly to the underside of chords.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF EWP DESIGN INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY THE ALPA LUMBER GROUP, AND WILL BE RETRACTED BY EWP DESIGN INC. IF UTILIZED FOR ANY OTHER PURPOSE.

February 1, 2019

TOE-NAIL CAPACITY DETAILS

LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
2x4 SPF	2	2	3	3	3
2x6 SPF	4	4	4	5	5
2x4 D. FIR	2	2	2	2	2
2x6 D. FIR	3	3	3	4	4

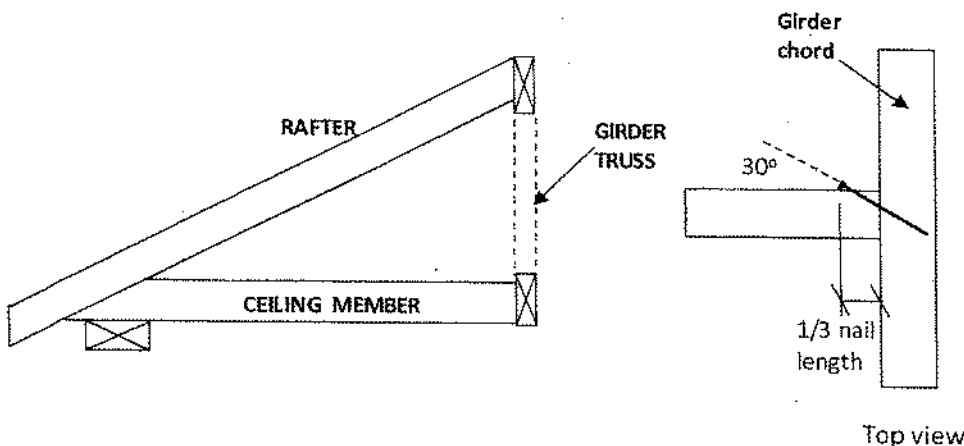


Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss


PEO
Certificate No. 10889485



December 21, 2020

TOE-NAIL CAPACITY DETAILS

Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

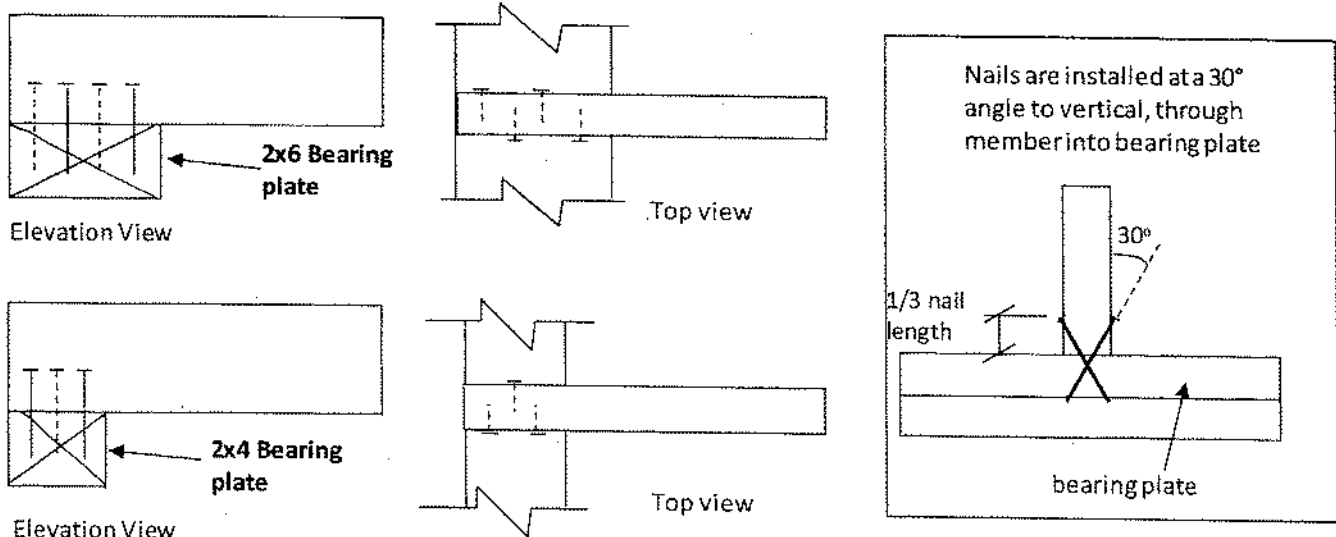

NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of $G = 0.42$ (SPF) and $G = 0.49$ (D. Fir).
5. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 (K_0 factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO
Certificate No. 10889485



LUL/LUS/LJS/HUS/HHUS/HGUS**SIMPSON**
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 217–218.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on pp. 105–107.



Double-Shear
Nailing
Top View











Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing
Side View
(available on
some models)

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

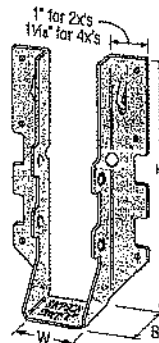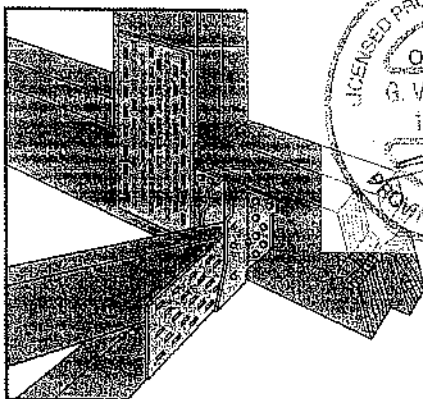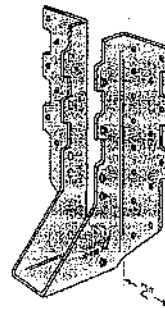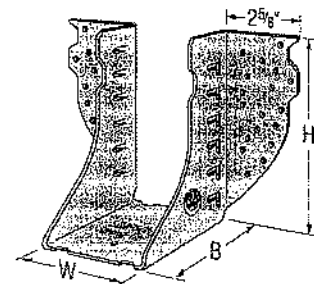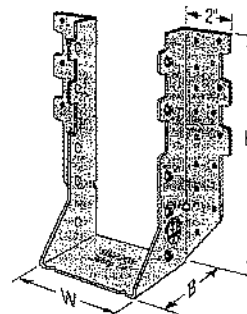**LUS28****LU26L****HUS210**
(HUS26, HUS28,
and HHUS similar)**HGUS28-2****HHUS210-2****LJS26DS**

TECHNICAL BULLETIN

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

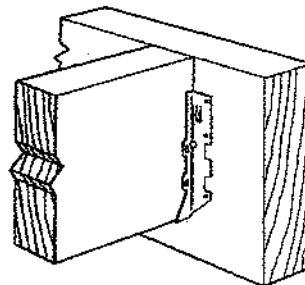


Typical LUS Installation

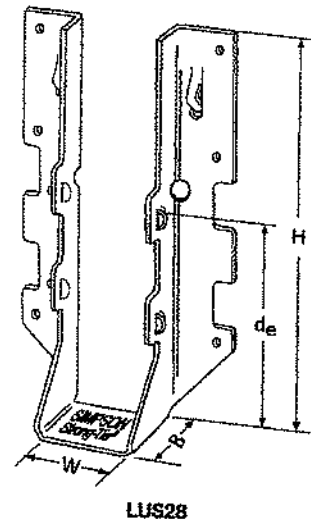


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LUS24	18	1 1/8	3 1/4	1 1/4	1 1/8	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3 1/8	3 1/4	2	1 1/8	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/8	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3 1/8	4 1/4	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4 1/8	4 1/4	2	3 3/4	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/8	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4 1/8	6 1/4	2	3 3/4	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/8	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4 1/8	8 1/8	2	5 1/4	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d_e is the distance from the seat of the hanger to the highest joist nail.



Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Top View.



LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPEC LUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HUS/LJS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation

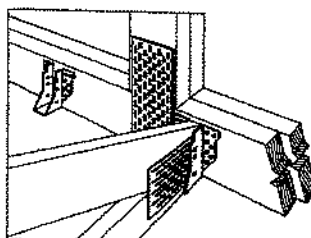


Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist		D.Fir-L		S-P-F	
									Uplift (K _u =1.15) lb.	Normal (K _n =1.00) lb.	Uplift (K _u =1.15) lb.	Normal (K _n =1.00) lb.
LJS26DS	18	1 1/8	5	3 1/2	4 3/8	(16) 16d	(6) 16d		2055	4265	1460	4115
HUS26	16	1 1/8	5 3/4	3	3 1/8	(14) 16d	(6) 16d		2705	4940	2065	3875
HUS28	16	1 1/8	7 3/4	3	6 3/4	(22) 16d	(8) 16d		3605	5365	2675	4345
HUS210	16	1 1/8	9 3/4	3	7 3/4	(30) 16d	(10) 16d		4505	5795	4010	4740
HUS1.81/10	16	1 1/8	9	3	8	(30) 16d	(10) 16d		4505	6450	4010	5200


1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580



Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HGUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

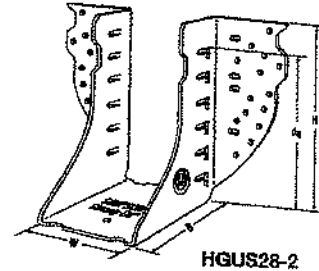

HGUS28-2

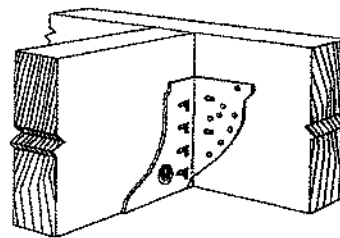


Typical HGUS Installation

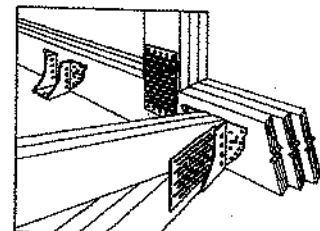

Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d _o	Face	Joist		D-Fir-L		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _o =1.15)	(K _o =1.00)	(K _o =1.15)	(K _o =1.00)
HGUS26	12	1 1/8	5 1/8	5	4 1/2	(20) 16d	(8) 16d		2685	6625	2685	5700
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d		3310	7675	3100	6900
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS210	12	1 1/8	9 1/8	5	7 1/8	(46) 16d	(16) 16d		3535	11070	2510	8090
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645

1. d_o is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

HHUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HHUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 14 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:

- See current catalogue for options

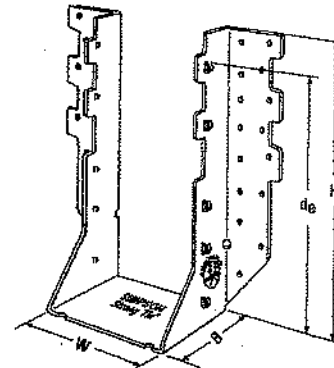


HHUS410

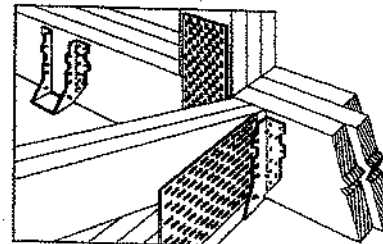

Typical HHUS installation
(Truss Designer to provide
fastener quantity for connecting
multiple members together)


Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d _b	Face	Joist		D-Fir-L		S-P-F	
									Uplift (K _u =1.15)	Normal (K _p =1.00)	Uplift (K _u =1.15)	Normal (K _p =1.00)
HHUS26-2	14	3 3/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2850	7335	2065	5205
HHUS28-2	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d		4670	9660	4235	7000
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d		4670	9670	4235	6865
HHUS210-4	14	6 1/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d		4670	10155	4235	7210
HHUS46	14	3 3/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2540	7335	2065	5205
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
HHUS410	14	3 3/8	9	3	8	(30) 16d	(10) 16d		4670	9855	4235	7000
HHUS5.50/10	14	5 1/8	9	3	8	(30) 16d	(10) 16d		4670	10155	4235	7210
HHUS7.25/10	14	7 1/8	9	3 3/8	7 3/8	(30) 16d	(10) 16d		4670	10155	3370	7210

1. d_b is the distance from the seat of the hanger to the highest joist nail.




Double
Shear
Nailing
prevents tabs
breaking off
(available on
some models).


U.S. Patent
5,603,580



Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.

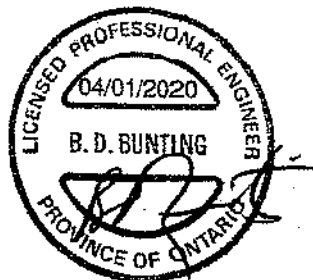

**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020.
This information is updated periodically and should not be relied upon after June 30, 2022.
Contact Simpson Strong-Tie for current information and limited warranty, or see strongtie.com.


















© 2020 Simpson Strong-Tie Company Inc.

T-SPECHHU\$20 3/20 exp. 6/22




(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

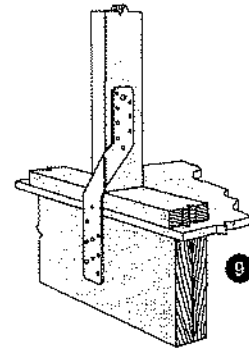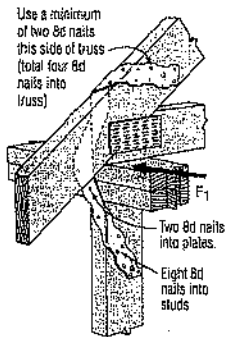**1** H1 Installation**2** H2A Installation**3** TSP Installation**4** H2.5A Installation
(Nails into both top plates)**5** H2.5T Installation
(Nails into both top plates)**6** H2.5T Installation**7** H3 Installation
(Nails into upper top plate)**8** H6 Stud
to Top Plate
Installation**9** H6 Stud to
Band Joist
Installation**10** H7Z Installation**11** H8 Attaching
Rafter to Double
Top Plates**12** H8 attaching Stud to Sill
(4 8d into plate, 5 8d into stud)**13** H8 attaching
I-Joist to Double
Top Plates**14** H10A Field-Bent
Installation**15** H10S Installation**16** H10S Installation
with Stud Offset**17** H10A
Installation

H10A optional positive angle nailing connects shear blocking to rafter. Use 8d common nails. Slot allows maximum field-bending up to a pitch of 6/12, use 75% of the table uplift value; bend one time only.

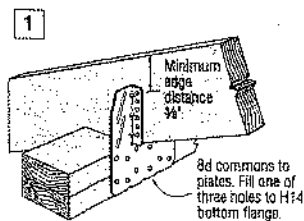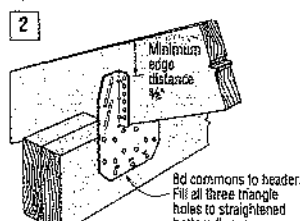**18** H14 Installation to
Double Top Plates**19** H14 Installation
to Double 2x Header**Avoid a Misinstallation**

Do not make new holes or overdrive nails.

H/TSP

Seismic and Hurricane Ties

Simpson Strong-Tie® hurricane ties provide a positive connection between truss/rafter and the wall of the structure to resist wind and seismic forces. New additions to the line provide even more options.


- H10AR — The heavy-duty design of the H10A available with a 2" wide throat to accommodate rough lumber
- H10A-2 — The H10A design with a 3" throat for double 2x members
- H2ASS, H2.5ASS and H10ASS — Popular ties now available in stainless steel

Material: See table

Finish: Galvanized. H7Z and H11Z — ZMAX® coating. Some models available in stainless steel or ZMAX; see Corrosion Information, pp. 20–24 or visit strongtie.com.

Installation:

- Use all specified fasteners; see General Notes.
- H1 can be installed with flanges facing inward (reverse of H1 installation drawing; number 1).
- H2.5T, H3 and H6 ties are shipped in equal quantities of right and left versions (right versions shown).
- Hurricane ties do not replace solid blocking.
- When installing ties on plated trusses (on the side opposite the truss plate) do not fasten through the truss plate from behind. This can force the truss plate off of the truss and compromise truss performance.
- H10A optional nailing to connect shear blocking, use 8d nails. Slots allow maximum field bending up to a pitch of 6:12; use H10A sloped loads for field bent installation.

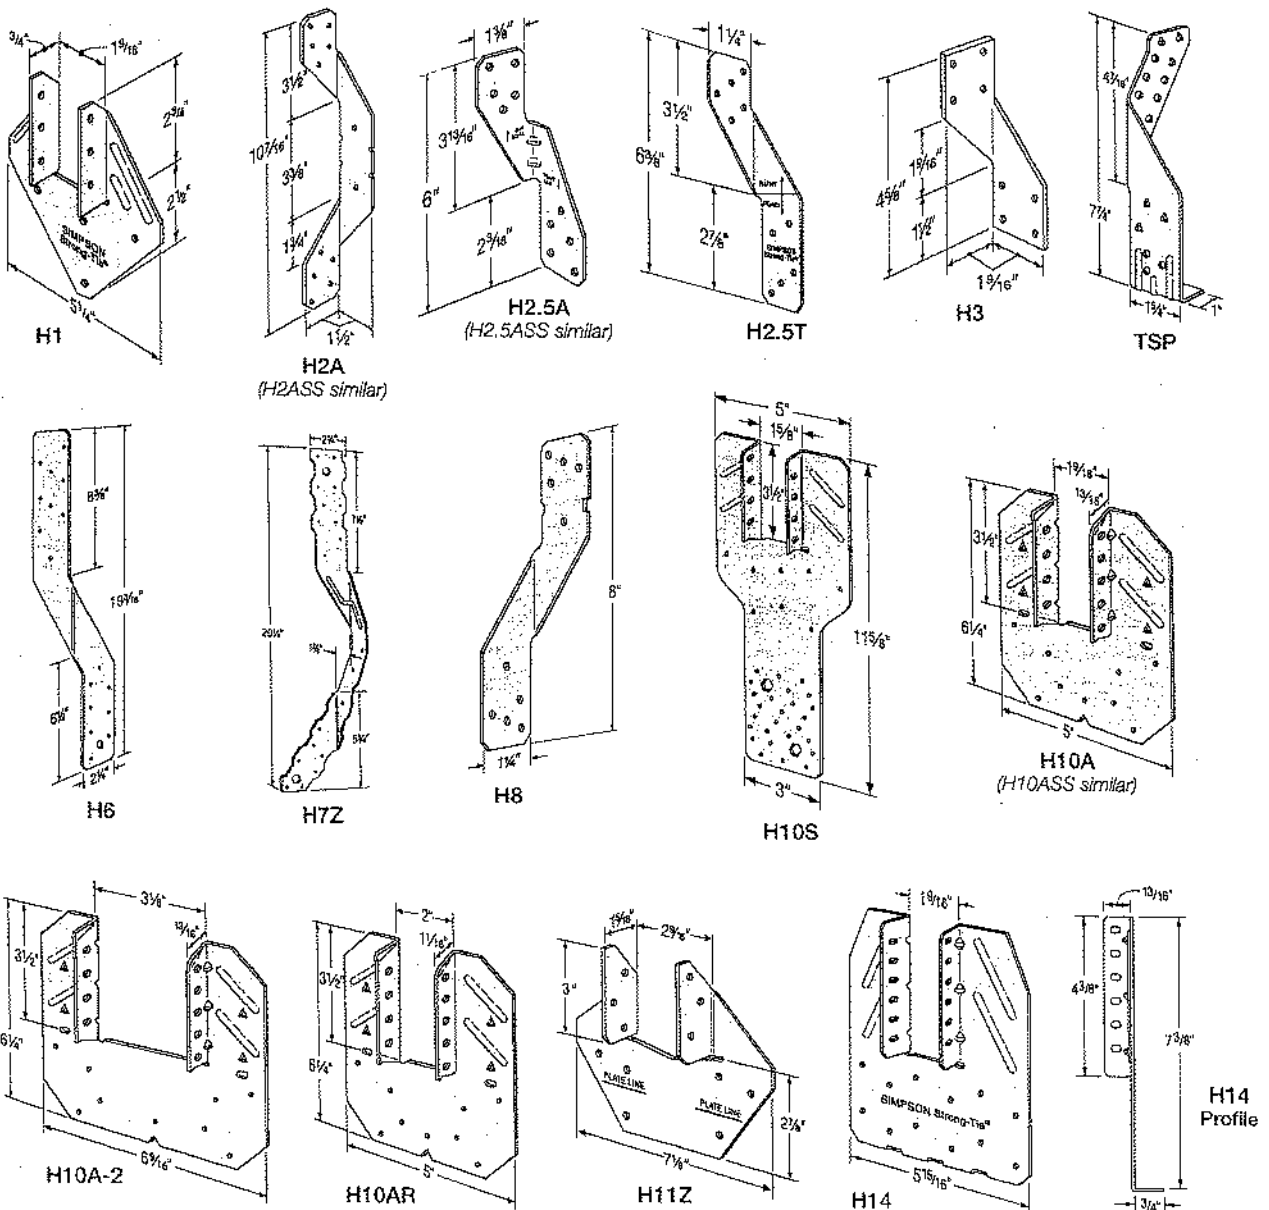

TECHNICAL BULLETIN

H – Seismic and Hurricane Ties

SIMPSON
Strong-Tie


The H connector series provides wind and seismic ties for trusses and rafters.
Material: 18 gauge **Finish:** G90 galvanized

Design: • Factored resistances are in accordance with CSA O86-14
• Factored resistances have been increased 15%. No further increase is permitted.

Installation: • Use all specified fasteners
• Nails: 8d = 0.131" dia. x 2½" long common wire, 8d x 1½" = 0.131" x 1½" long, 10d x 1½" = 0.146" x 1½" long
• H1 can be installed with flanges facing outwards
• Hurricane ties do not replace solid blocking


Factored resistances for more than one direction for a single connection cannot be added together. A factored load which can be divided into components in the directions given must be evaluated as follows: Factored Shear/Resisting Shear + Factored Tension/Resisting Tension ≤ 1.0.

Hurricane Tie Installations to Achieve Twice the Load (Top View)

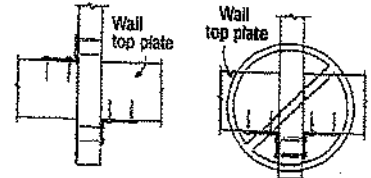


Install diagonally across from each other for minimum 2x truss.

Nailing into both sides of a single ply 2x truss may cause the wood to split.




H1



H1 Installation




H2A




H2A Installation




H2.5A




H2.5A Installation




H2.5T




H2.5T Installation
(Nails into both top plates)




H3



H3 Installation



H10A



H10A Installation

Model No.	Ga.	Fasteners			Factored Resistance (lb.)					
		To Rafter	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Normal		Uplift	Normal	
						F ₁	F ₂		F ₁	F ₂
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
H2.5T	18	(5) 8d	(5) 8d	—	835	175	240	740	160	210
H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
H10A	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.

2. Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on each side of the joist and on the same side of the plate.

3. When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
4. Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a Continuous Load Path, connections must be on same side of the wall.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECH20 3/20 exp. 6/22



(800) 999-5099
strongtie.com

TECHNICAL BULLETIN

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

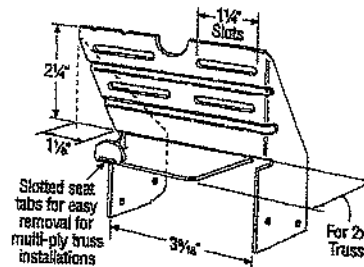


TC24
U.S. Patent 4,932,173

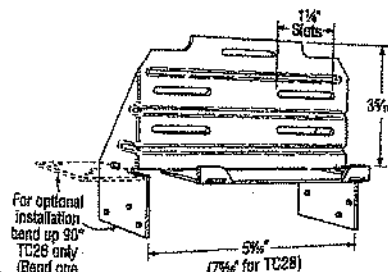


TC26
(TC28 Similar)

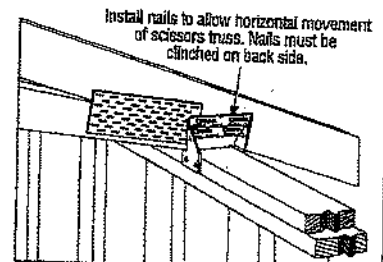

Typical TC24 Installation

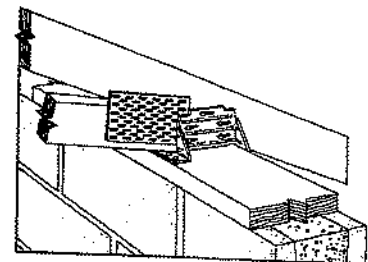

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

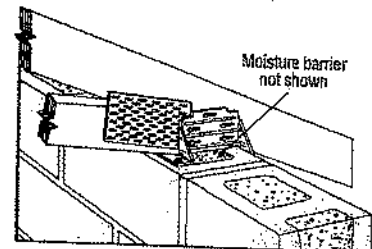

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastener to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



**LIMIT
STATES
DESIGN**

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECTC20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HTU

SIMPSON
Strong-Tie

Face-Mount Truss Hanger (cont.)

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Alternate Installation for (2) 2x4 and (2) 2x6 Headers

Model No.	Min. Nail Height (in.)	Minimum Header Size	Fasteners		Factored Resistance			
					D.Fir-L		S-P-F	
			Header	Joist	Uplift	Normal	Uplift	Normal
					(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
HTU26 (Min.)	3 3/4	(2) 2x4	(10) 16d	(14) 10d x 1 1/2"	1740	3340	1235	2370
					7.74	14.86	5.49	10.54
HTU26 (Max.)	5 1/4	(2) 2x4	(10) 16d	(20) 10d x 1 1/2"	2470	4015	1755	2850
					10.99	17.86	7.81	12.66
HTU28 (Max.)	3 3/4	(2) 2x6	(20) 16d	(26) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.46	13.10	20.19
HTU210 (Max.)	7 1/4	(2) 2x6	(20) 16d	(32) 10d x 1 1/2"	4150	6395	2945	4540
					18.46	28.46	13.10	20.19

See table footnotes on p. 280.




Hanger Options


See Hanger Options Information on pp. 125-127.

Skewed Seat

- Skawable up to 67 1/2°
- Available in single and 2-ply size
- No bevel cut required



Top View HTU Hanger Skewed Right < 51°



Top View HTU Hanger Skewed Right ≥ 51°

Factored Resistances for Skewed HTU Hangers

Model No.	Skew Angle (Degrees)	Fasteners		Factored Resistance			
				D.Fir-L		S-P-F	
		Header	Joist	Uplift	Normal	Uplift	Normal
				(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
				lb.	lb.	lb.	lb.
				kN	kN	kN	kN
HTU26	< 51	(20) 16d	(14) 10d x 1 1/2"	1835	4110	1300	2805
	51-67 1/2	(20) 16d	(12) 10d x 1 1/2"	8.16	18.28	5.78	12.92
HTU28	< 51	(26) 16d	(20) 10d x 1 1/2"	1350	3620	955	2560
	51-67 1/2	(26) 16d	(17) 10d x 1 1/2"	8.01	18.10	4.25	11.38
HTU210	< 51	(32) 16d	(26) 10d x 1 1/2"	2810	4270	1985	3030
	51-67 1/2	(32) 16d	(22) 10d x 1 1/2"	12.60	18.99	8.83	13.48
HTU26-2	< 51	(20) 16d	(14) 10d	2075	3930	1465	2780
	51-67 1/2	(20) 16d	(12) 10d	9.23	17.48	6.52	12.37
HTU28-2	< 51	(26) 16d	(20) 10d	3785	4430	2675	3135
	51-67 1/2	(26) 16d	(17) 10d	16.84	19.71	11.90	13.95
HTU210-2	< 51	(32) 16d	(26) 10d	2795	4240	1980	3000
	51-67 1/2	(32) 16d	(22) 10d	12.43	18.86	8.81	13.35
HTU26-2	< 51	(20) 16d	(14) 10d	2140	3715	1515	2625
	51-67 1/2	(20) 16d	(12) 10d	9.52	16.53	6.74	11.68
HTU28-2	< 51	(26) 16d	(20) 10d	1610	3920	1140	2785
	51-67 1/2	(26) 16d	(17) 10d	7.15	17.44	5.07	12.39
HTU210-2	< 51	(32) 16d	(26) 10d	3980	5425	2815	3855
	51-67 1/2	(32) 16d	(22) 10d	17.62	24.13	12.52	17.15
HTU26-2	< 51	(20) 16d	(14) 10d	2385	5425	1895	3855
	51-67 1/2	(20) 16d	(12) 10d	10.81	24.13	7.54	17.15
HTU28-2	< 51	(26) 16d	(20) 10d	5025	6890	3570	4890
	51-67 1/2	(26) 16d	(17) 10d	22.35	30.65	15.88	21.75
HTU210-2	< 51	(32) 16d	(26) 10d	3145	6580	2225	4745
	51-67 1/2	(32) 16d	(22) 10d	13.99	29.72	9.90	21.10


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Reduced heel heights are not permitted for skewed HTU's.
3. Nails: 16d = 0.162" dia. x 3 1/2" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 10d = 0.148" dia. x 3" long. See pp. 27-28 for other nail sizes and information.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

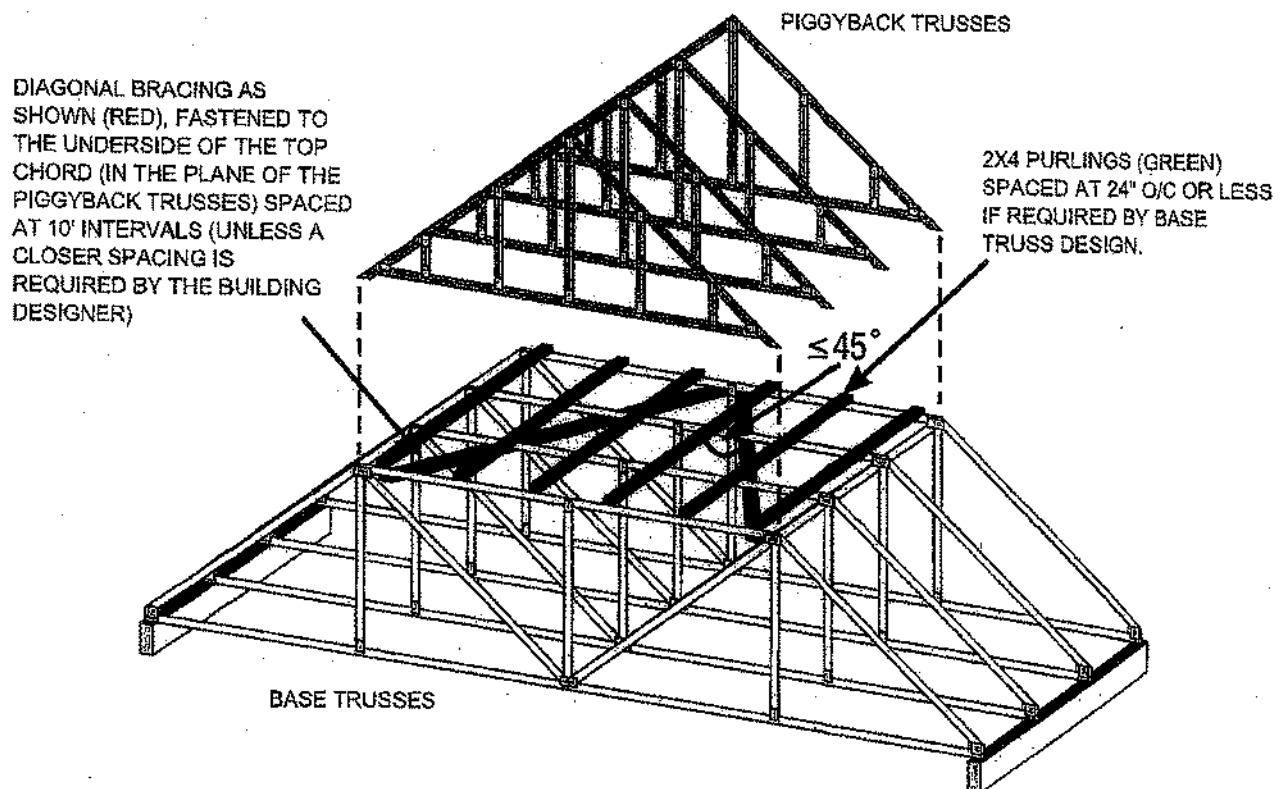

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties

Straps are designed to transfer tension loads in a wide variety of applications.

HRS — Heavy strap designed for installation on the edge of 2x members. The HRS416Z installs with Strong-Drive® SDS Heavy-Duty Connector screws.

LSTA and MSTA — Designed for use on the edge of 2x members, with a nailing pattern that reduces the potential for splitting.

LSTI and MSTI — Light and medium straps that are suitable where pneumatic-nailing is necessary through diaphragm decking and wood chord open-web trusses.


MST — High-capacity strap that can be installed with either nails or bolts. Suitable for double 2x member connections or greater.

MSTC — High-capacity strap that utilizes a staggered nail pattern to help minimize wood splitting. Nail slots have been countersunk to provide a lower nail head profile.

Finish: Galvanized. Some products are available in stainless steel, ZMAX® coating or black powder coat (add PC to sku); contact Simpson Strong-Tie. See Corrosion Information, pp. 18–20.


Installation: Use all specified fasteners; see General Notes

Options: Special sizes can be made to order; contact Simpson Strong-Tie for longer lengths

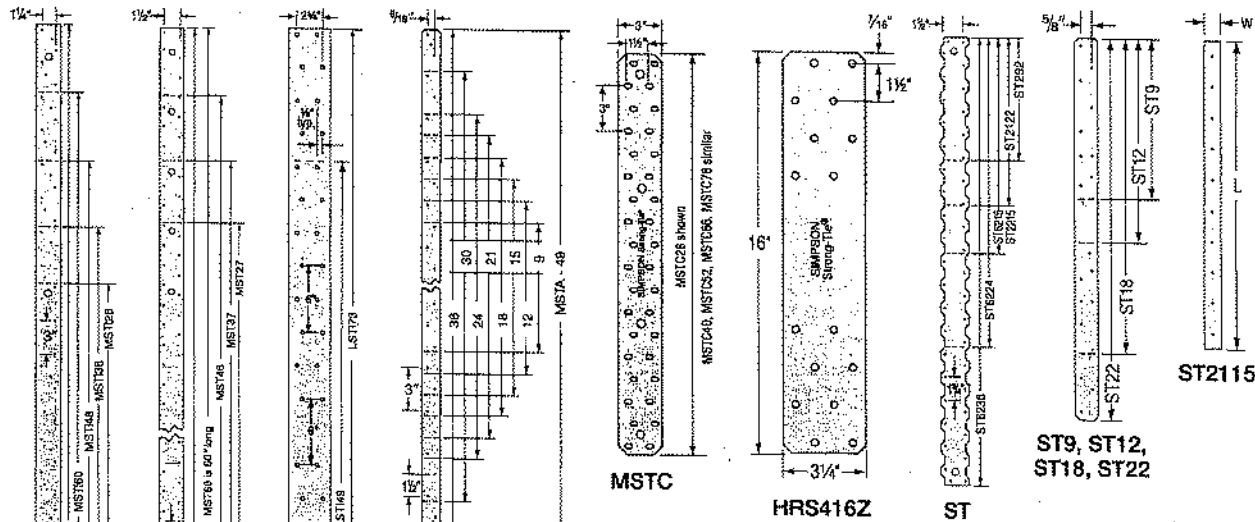


LSTA and MSTA
(Pilot holes not shown)

Stitch nailing
of double studs
by others

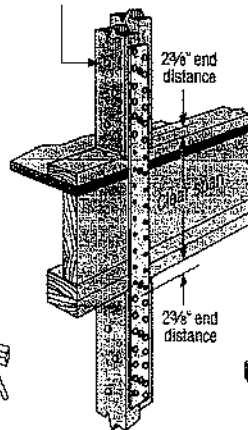


Nails are
not required
in the rim
board area

When nailing
the strap over
wood structural
panel sheathing,
use 2 1/2" long
nail, minimum.

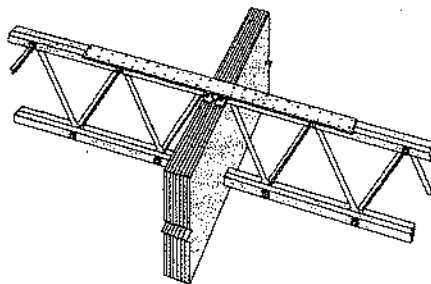


Typical LSTI Installation

Floor-to-Floor Tie
Installation
Showing a
Clear Span



Typical MSTI Installation
(MIT hanger shown)
LSTI similar

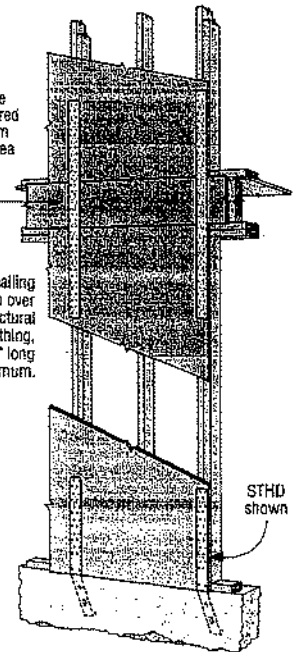

Typical Detail with
Strap Installed over
Wood Structural Panel
Sheathing


HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI

Strap Ties (cont.)


These products are available with additional corrosion protection. For more information, see p. 20.

SD Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366–370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
		W	L		D-Fir-L		S-P-F	
					(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
LSTA9	20	1¼	9	(6) 10d	600	690	555	635
					2.67	3.07	2.47	2.82
					800	920	735	845
LSTA12		1¼	12	(8) 10d	3.56	4.09	3.27	3.76
					1000	1150	920	1060
					4.45	5.12	4.09	4.72
LSTA15		1¼	15	(10) 10d	1200	1380	1105	1270
					5.34	6.14	4.92	5.65
					1400	1610	1290	1485
LSTA18		1¼	18	(12) 10d	6.23	7.16	5.74	6.61
					1600	1840	1475	1695
					7.12	8.19	6.56	7.54
LSTA21		1¼	21	(14) 10d	585	675	535	615
					2.60	3.00	2.38	2.74
					940	1085	865	995
LSTA24		1¼	24	(16) 10d	4.18	4.83	3.85	4.43
	670				770	615	710	
	2.98				3.43	2.74	3.16	
ST292	2⅞	9⅞	(8) 8d	1335	1540	1235	1420	
				5.94	6.85	5.49	6.32	
				2235	2465	2075	2385	
ST2122	2⅞	12⅞	(12) 8d	9.94	10.97	9.23	10.61	
				2465	2465	2465	2465	
				10.97	10.97	10.97	10.97	
ST2115	¾	16⅞	(8) 8d	3115	3580	2852	3280	
				13.66	15.93	12.69	14.59	
				4670	5370	4280	4920	
ST2215	2⅞	16⅞	(16) 8d	20.77	23.89	19.04	21.89	
				670	770	625	715	
				2.98	3.43	2.78	3.18	
LSTA30	1¼	30	(20) 10d	895	1030	830	955	
				3.98	4.58	3.69	4.25	
				1120	1285	1040	1195	
LSTA36	1¼	36	(24) 10d	4.98	5.72	4.63	5.32	
				1340	1545	1245	1430	
				5.96	6.87	5.54	6.36	
LST49	3¾	49	(32) 10d x 1½"	1565	1800	1455	1670	
				6.98	8.01	6.47	7.43	
				1790	2060	1660	1910	
LST173	3¾	73	(48) 10d x 1½"	7.96	9.16	7.38	8.50	
				2470	2840	2260	2595	
				10.99	12.63	10.05	11.54	
MSTA9	1¼	9	(6) 10d	2965	3070	2710	3070	
				13.19	13.66	12.06	13.66	
				2725	2725	2545	2725	
MSTA12	1¼	12	(8) 10d	12.12	12.12	11.32	12.12	
				1405	1615	1300	1500	
				6.25	7.18	5.78	6.67	
MSTA15	1¼	15	(10) 10d	2305	2650	2155	2475	
				10.25	11.79	9.59	11.01	
				525	605	490	560	
MSTA18	1¼	18	(12) 10d	2.34	2.69	2.18	2.49	
				700	805	650	750	
				3.11	3.58	2.89	3.34	
MSTA21	1¼	21	(14) 10d	1050	1210	975	1125	
				4.67	5.38	4.34	5.00	
				1580	1790	1465	1685	
MSTA24	1¼	24	(16) 10d	7.03	7.96	6.52	7.50	

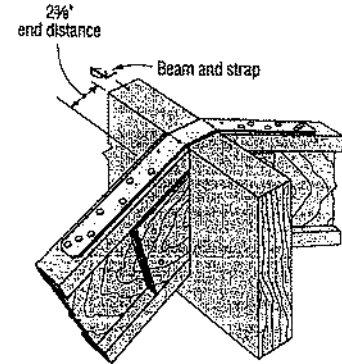

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

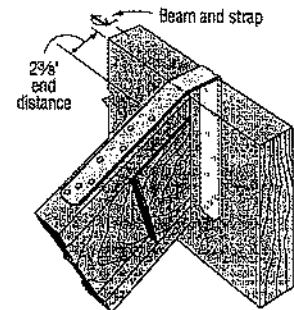

Typical LSTA Installation
(hanger not shown)
Bend strap one time only

- Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
- Use half of the nails in each member being connected to achieve the listed resistances.
- Nails: 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long. See pp. 22–23 for other nail sizes and information.


HRS/HST/ST/PS/LSTA/LSTI/MST/MSTA/MSTC/MSTI
Strap Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 20.


SD Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 366-370 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Factored Tensile Resistance			
		W	L		D.Fir-L		S-P-F	
					(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)
					lb.	lb.	lb.	lb.
					kN	kN	kN	kN
MSTC28	16	3	28¼	(32) 10d	3955	4545	3615	4155
					17.59	20.22	16.08	18.48
MSTC40		3	40¼	(48) 10d	5930	6820	5420	6235
					26.38	30.34	24.11	27.74
MSTC52		3	52¼	(54) 10d	6670	6940	6100	6940
					29.67	30.87	27.14	30.87
MSTC66	14	3	66¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.18	38.10
MSTC78		3	77¾	(66) 10d	8515	8565	7455	8565
					37.88	38.10	33.18	38.10
ST6236		2⅝	33⅞	(36) 8d	3735	4295	3270	3760
					16.61	19.11	14.55	16.73
MSTI26	12	2⅝	26	(22) 10d x 1½"	2825	3250	2475	2850
					12.57	14.46	11.01	12.68
MSTI36		2⅝	36	(32) 10d x 1½"	4110	4725	3600	4140
					18.28	21.02	16.01	18.42
MSTI48		2⅝	48	(44) 10d x 1½"	5650	6500	4955	5695
					25.13	28.91	22.04	25.33
MSTI60		2⅝	60	(56) 10d x 1½"	7195	7360	6305	7250
					32.01	32.74	28.05	32.25
MSTI72		2⅝	72	(68) 10d x 1½"	7360	7360	7240	7360
					32.74	32.74	32.21	32.74
MST27		2⅝	27	(26) 8d	2685	3090	2355	2710
					11.94	13.75	10.48	12.06
MST37		2⅝	37½	(38) 8d	3930	4515	3440	3960
					17.48	20.08	15.30	17.62
MST48		2⅝	48	(50) 8d	5170	5945	4530	5210
					23.00	26.45	20.15	23.18
HRS416Z		3¼	16	(16) ¼" x 1½" SDS	2400	2760	2120	2440
					10.68	12.28	9.43	10.85
MST60	10	2⅝	60	(64) 8d	6820	7610	5800	6670
					29.45	33.85	25.80	29.67
MST72		2⅝	72	(78) 8d	8065	9135	7065	8125
					35.88	40.64	31.43	36.14

1. Factored resistances have been increased 15% for earthquake or wind loading with no further increase allowed.
2. Use half of the nails in each member being connected to achieve the listed resistances.
3. Nails: 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long. See pp. 22-23 for other nail sizes and information.

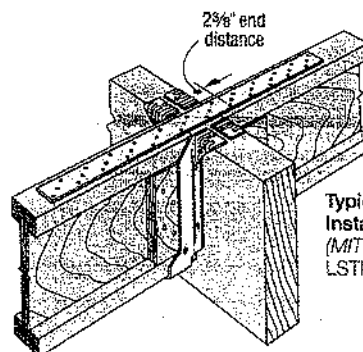


Typical MSTI
Installation
(MIT hanger shown)
LSTI similar

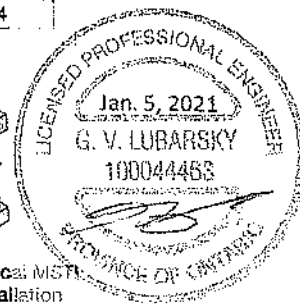

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



This symbol indicates the required direction of slots in connector plates.



* Plate location details available in Mitek software or upon request.

PLATE SIZE


4 x 4
The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

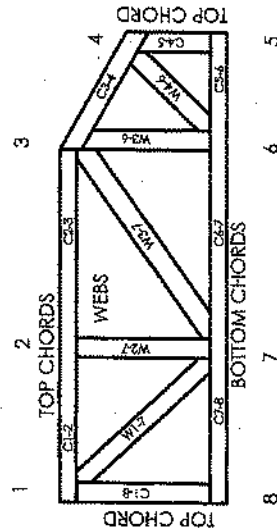

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

Mitek
POWER TO PERFORM.™

Mitek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.