

49-10-00
47-10-00
2-00-00
5-00-00

ALL ROOF PITCHES ARE 6/12
UNLESS OTHERWISE NOTED

BEAMS:
BM1: 2-2X10 SPF#2

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
LUS26-2 - (W)

DENOTES
CONV. FRAMING




DESIGN CONFORMS WITH
OBC 2012
(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL
PART: 9

Ss = 31.3 psf Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C. 2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER
TRUSSES TO BE 2X4 SPF @ 24" O.C. WITH A 2X4 VERT. POST
TO THE TRUSS UNDER NEATH AT EACH CROSS PT. VERT. POST
LONGER THAN 6" TO HAVE LATERAL BRACING SO THAT THE
DISTANCE BETWEEN END PT. & BETWEEN ROWS OF BRACING
DOES NOT EXCEED 6"

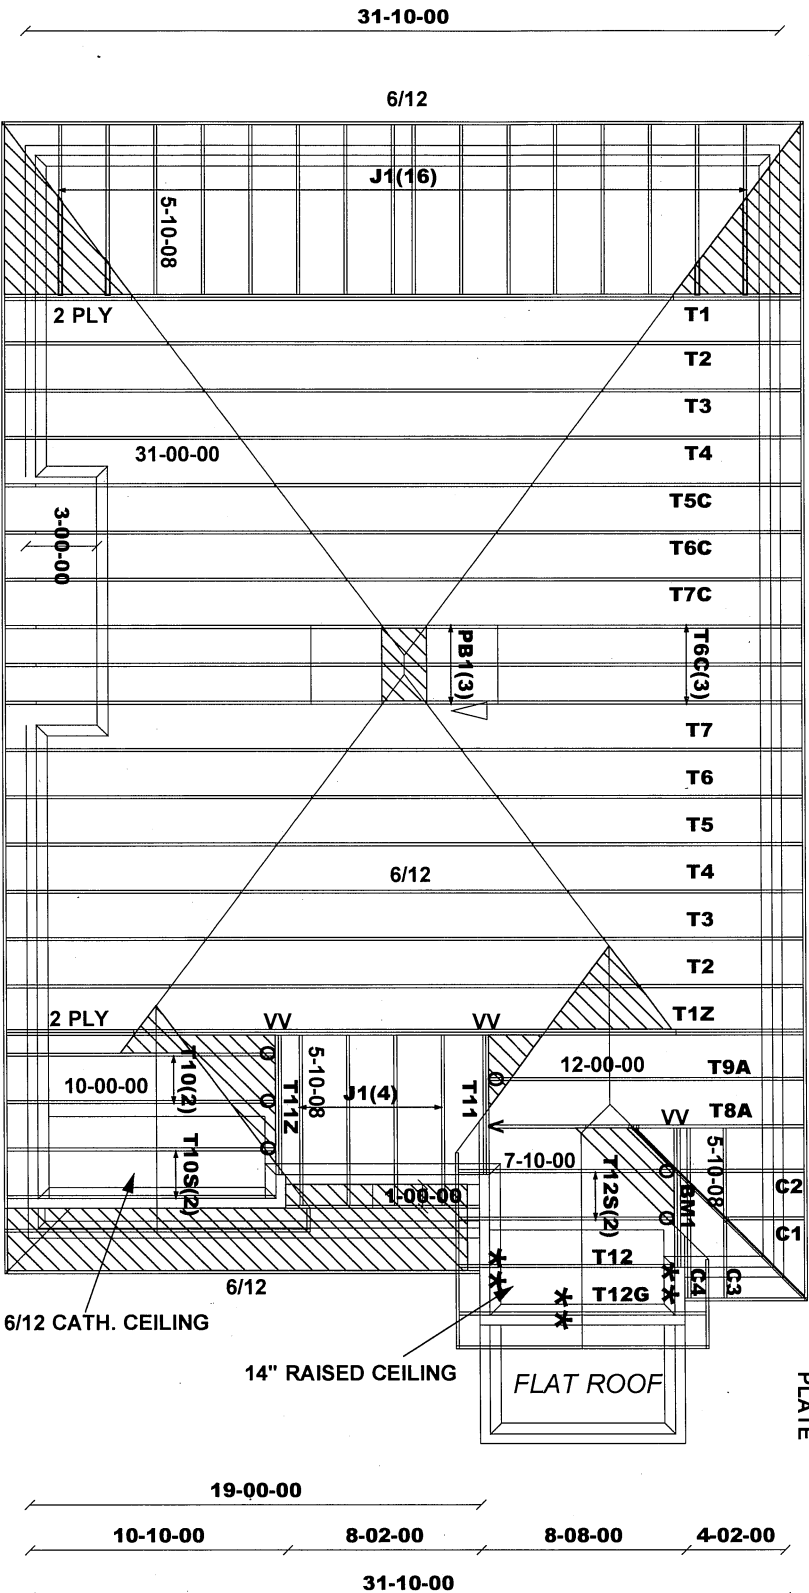

M13459

Job Track: 51012		Builder / Location: ROYAL PINE HOMES / RICHMOND HILL		Model / Elevation: 38-10 / A	
Plan Log: 201953		Project: CENTREFIELD			
Layout ID: 406506		Date: 2021-06-04 Sales: Mario DiCiano Designer: LC			
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.					
Milek ver 8.4.2.286					



Job Track: **51012**

Plan Log: **201953**

Layout ID: **406445**


Builder / Location:		ROYAL PINE HOMES / RICHMOND HILL	
Project:		CENTREFIELD	
Date:	2021-06-04	Sales:	Mario DiCamm
		Designer:	LC
		OR REDS	TAUARRC

Model / Elevation:
38-10 / B

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMAARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMAARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMAARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

March 27th, 2014

Mitek ver 8.4.2.28F

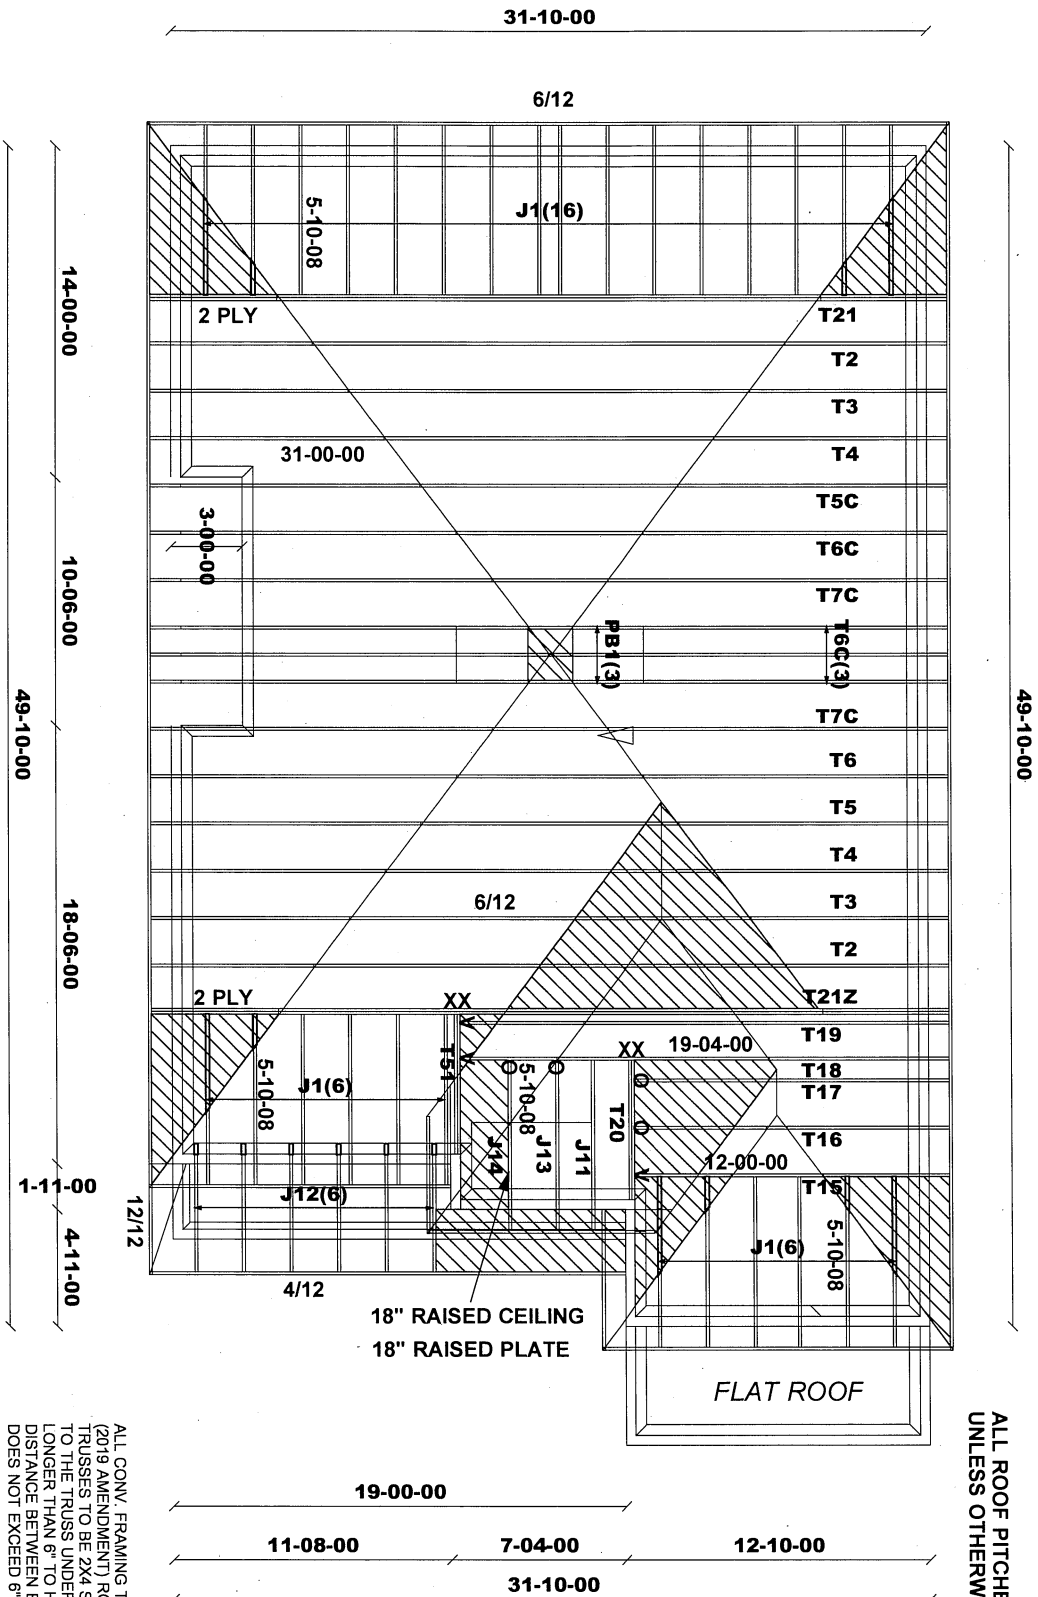

ALL ROOF PITCHES ARE 8/12
UNLESS OTHERWISE NOTED

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING

DESIGN CONFORMS WITH
OBC 2012
(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL
PART: 9

DESIGN LOADS:

- TCSL = 25.6 psf
- TCDL = 6.0 psf
- BCLL = 0.0 psf
- BCDL = 7.4 psf

ALL CONFRAMING TO CONFORM WITH PART 9 OF O.B.C. 2012 (2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2X4 SPS @ 24"O.C. WITH A 2X4 VERT. POST TO THE TRUSS UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6" TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

49-10-00

5-00-00

ALL ROOF PITCHES ARE 8/12
UNLESS OTHERWISE NOTED

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
LUS26-2 - (W)


DENOTES
CONV.
FRAMING



DESIGN CONFORMS WITH
OBC 2012
(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL
PART: 9
Ss = 31.3 psf Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C. 2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER
TRUSSES TO BE 2X4 SPF @ 24" O.C. WITH A 2X4 VERT. POST
TO THE TRUSS UNDER NEATH AT EACH CROSS PT. VERT. POST
LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE
DISTANCE BETWEEN END PT. & BETWEEN ROWS OF BRACING
DOES NOT EXCEED 6'

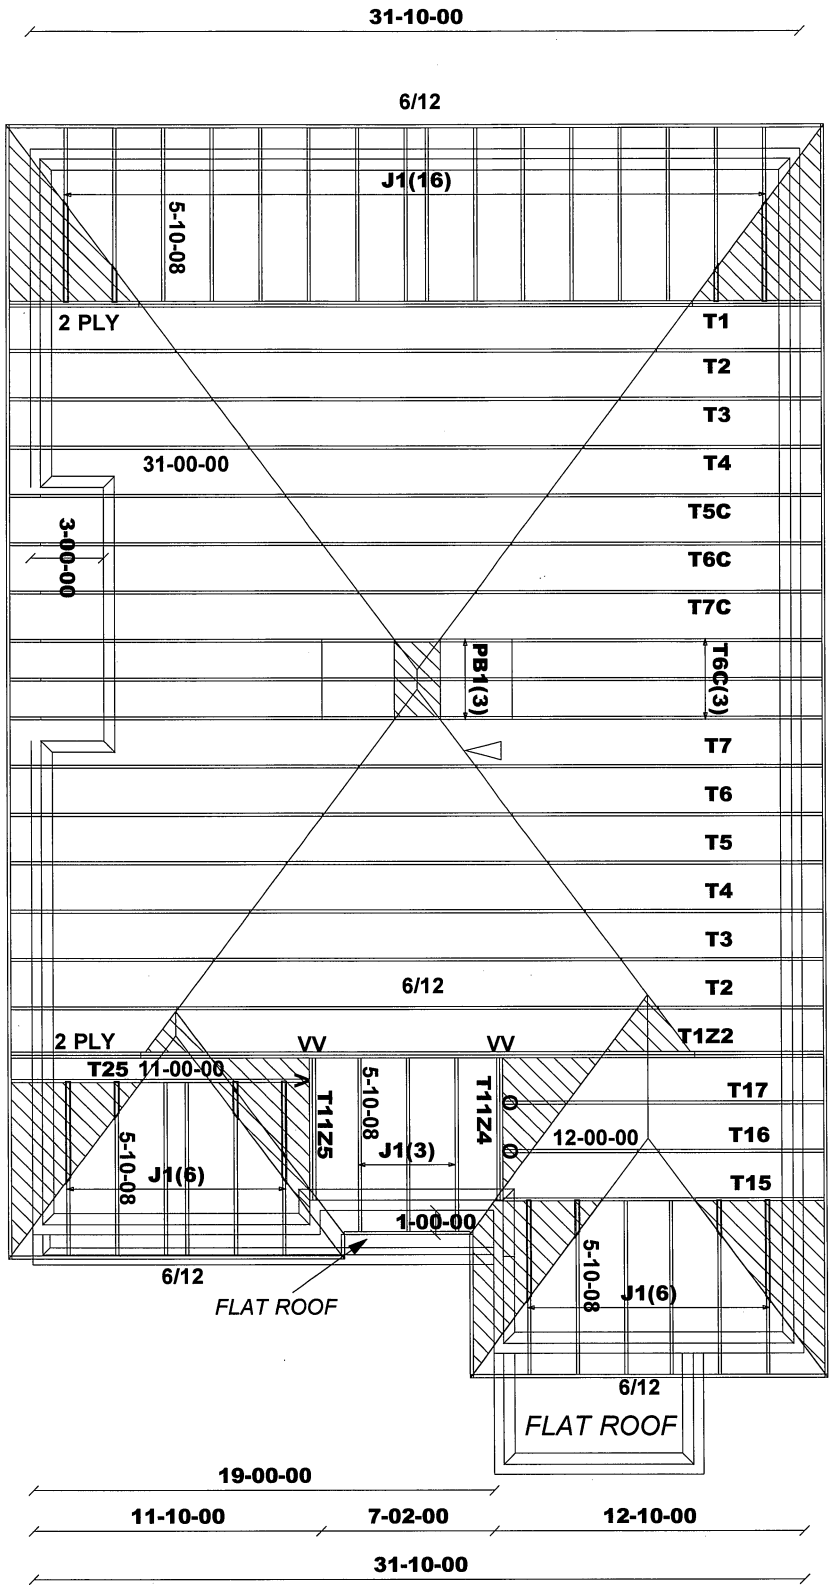

M13459

**TAMARACK**
ROOF TRUSSES INC.
MANUFACTURED IN THE U.S.A.

Job Track: **51012**

Plan Log: **201953**

Layout ID: **413423**

Builder / Location:
ROYAL PINE HOMES / RICHMOND HILL

Project: **CENTREFIELD**

Date: **2020-10-14**

Sales: **Mario DiCano**

Designer: **LC**

Model / Elevation:
38-10 / C

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Milek ver 8.3.3.247







DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: 38-10
 Lot #:
 Elevation: A









Job Track: 51012
 PlanLog: 201953
 Layout ID: 406506
 Ref #: 12606
 Page: 1 of 3
 Date: 10-14-2020
 Designer: Leo Chen
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	293.47 181.33		
	1 2-ply	T1Z Hip Girder	8 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	293.47 181.33		
	2	T2 Hip	8 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	255.62 161.00		
	2	T3 Hip	8 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	269.73 168.67		
	2	T4 Hip	8 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	267.35 169.67		
	1	T5 Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T5C Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T6 Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	149.53 93.33		
	4	T6C Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	598.12 373.33		
	1	T7 Hip	8 /12	31-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.28 97.33		
	1	T7C Hip	8 /12	31-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.28 97.33		
	1	T8A Hip Girder	8 /12	12-00-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-06-13	64.29 40.33		
	1	T9A Common	8 /12	12-00-00	5-11-13	2 x 4	1-03-08	1-04-13 2-06-13	51.69 33.67		
	2	T10 Common	8 /12	10-00-00	4-08-13	2 x 4	1-03-08	1-04-13 1-04-13	80.97 51.00		

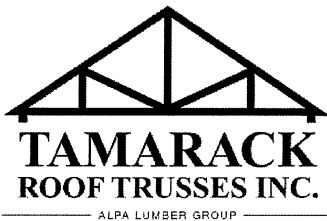 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: 38-10 Lot #: Elevation: A	Job Track: 51012 PlanLog: 201953 Layout ID: 406506 Ref #: 12606 Page: 2 of 3 Date: 10-14-2020 Designer: Leo Chen Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T10S Scissor	8 / 12 6 / 12	10-00-00	4-08-13	2 x 4	1-03-08	1-04-13 1-04-13	82.73 54.00		
	1 2-ply	T11 Monopitch Girder	6 / 12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.39 37.67		
	1 2-ply	T11Z Monopitch Girder	6 / 12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.39 37.67		
	1	T12 Common	8 / 12	7-10-00	4-00-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	34.51 22.00		
	1	T12G GABLE	8 / 12	7-10-00	4-00-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	32 21.00		
	2	T12S Common	8 / 12	7-10-00	5-02-02	2 x 4	1-03-08	2-06-13 2-06-13	74.21 49.67		
	3	PB1 Piggyback	8 / 12	7-10-11	2-00-00	2 x 4			64.14 43.00		
	20	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	335.89 213.33		
	1	C1 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	9.34 6.33		
	1	C2 Jack-Open	8 / 12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	12.08 7.67		
	1	C3 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	13.76 9.00		
	1	C4 Jack-Open	8 / 12	3-04-15	3-08-02	2 x 4	1-03-08 2-05-09	1-04-13 3-08-02	15.81 9.67		

TOTAL # TRUSS= 60 TOTAL BFT OF ALL TRUSSES= 2334.67 BFT. TOTAL WEIGHT OF ALL TRSSES 3710.08 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
1	Hardware	LJS26DS	
6	Hardware	LUS24	

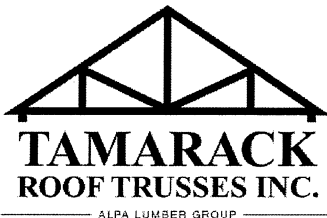DELIVERY SHIPLIST			
	Lumber Yard:	TAMARACK LUMBER	Job Track: 51012
	Builder:	ROYAL PINE HOMES	PlanLog: 201953
	Project:	CENTREFIELD	Layout ID: 406506
	Location:	RICHMOND HILL	Ref #: 12606
	Model:	38-10	Page: 3 of 3
	Lot #:		Date: 10-14-2020
	Elevation:	A	Designer: Leo Chen
			Sales Rep: Mario DiCano







HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 10





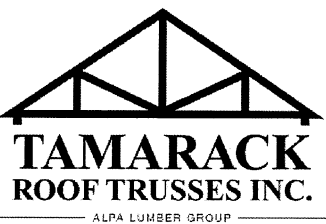
 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST										
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: 38-10 Lot #: Elevation: B						Job Track: 51012 PlanLog: 201953 Layout ID: 406445 Ref #: 12629 Page: 1 of 2 Date: 06-04-2021 Designer: Leo Chen Sales Rep: Mario DiCano				

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T2 Hip	8 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	255.62 161.00		
	2	T3 Hip	8 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	269.73 168.67		
	2	T4 Hip	8 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	267.35 169.67		
	1	T5 Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T5C Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T6 Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	149.53 93.33		
	4	T6C Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	598.12 373.33		
	2	T7C Hip	8 /12	31-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	312.55 194.67		
	1	T15 Hip Girder	8 /12	12-00-00	4-01-04	2 x 4	1-03-08	1-04-13 1-04-13	49.71 31.17		
	1	T16 Hip	8 /12	12-00-00	5-01-04	2 x 4	1-03-08	1-04-13 1-04-13	54.15 34.50		
	1	T17 Common	8 /12	12-00-00	5-04-13	2 x 4	1-03-08	1-04-13 1-04-13	47.65 29.17		
	1	T18 Hip Girder	8 /12	19-04-00	5-07-04	2 x 4 2 x 6	1-03-08	1-04-13 2-10-13	100.9 62.83		
	1	T19 Hip	8 /12	19-04-00	6-04-04	2 x 4	1-03-08	1-04-13 2-10-13	85.53 53.67		
	1 2-ply	T20 Monopitch Girder	6 /12	5-10-08	5-07-04	2 x 4 2 x 6		2-08-00 5-07-04	72.57 47.00		

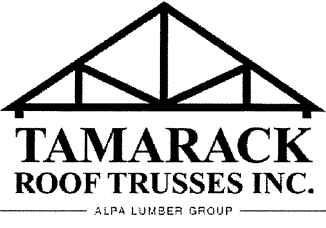 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST									
	Lumber Yard: TAMARACK LUMBER Builder: ROYAL PINE HOMES Project: CENTREFIELD Location: RICHMOND HILL Model: 38-10 Lot #: Elevation: B					Job Track: 51012 PlanLog: 201953 Layout ID: 406445 Ref #: 12629 Page: 2 of 2 Date: 06-04-2021 Designer: Leo Chen Sales Rep: Mario DiCano				

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T21 Hip Girder	8 / 12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	298.15 185.33		
	1 2-ply	T21Z Hip Girder	8 / 12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	298.15 185.33		
	1 2-ply	T51 Monopitch Girder	6 / 12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	60.47 38.67		
	3	PB1 Piggyback	8 / 12	7-10-11	2-00-00	2 x 4			64.14 43.00		
	28	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	470.25 298.67		
	1	J11 Jack-Open	6 / 12	5-10-08	5-07-04	2 x 4	1-03-08	2-08-00 5-07-04	20.59 13.50		
	6	J12 Jack-Open	4 / 12	3-07-00	2-01-03	2 x 4	1-09-08	3-15 1-06-04	63.95 40.00		
	1	J13 Jack-Closed	6 / 12	5-10-08	5-07-04	2 x 4	1-03-08	1-02-00 5-07-04	35.39 23.33		
	1	J14 Jack-Closed	6 / 12	5-10-08	4-02-13	2 x 4	1-03-08	1-02-00 4-02-13	32.52 22.17		


TOTAL # TRUSS= 68 TOTAL BFT OF ALL TRUSSES= 2444.35 BFT. TOTAL WEIGHT OF ALL TRSSES 3889.03 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
4	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 9




DELIVERY SHIPLIST

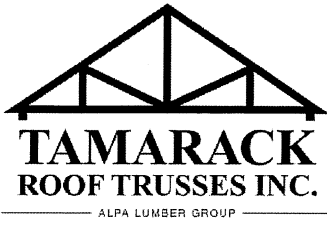

Lumber Yard: TAMARACK LUMBER
 Builder: ROYAL PINE HOMES
 Project: CENTREFIELD
 Location: RICHMOND HILL
 Model: 38-10
 Lot #:
 Elevation: C



Job Track: 51012
 PlanLog: 201953
 Layout ID: 413423
 Ref #: 12606
 Page: 1 of 2
 Date: 10-14-2020
 Designer: Leo Chen
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	293.47 181.33		
	1 2-ply	T1Z2 Hip Girder	8 /12	31-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	293.47 181.33		
	2	T2 Hip	8 /12	31-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	255.62 161.00		
	2	T3 Hip	8 /12	31-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	269.73 168.67		
	2	T4 Hip	8 /12	31-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	267.35 169.67		
	1	T5 Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T5C Hip	8 /12	31-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	141.02 87.67		
	1	T6 Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	149.53 93.33		
	4	T6C Hip	8 /12	31-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	598.12 373.33		
	1	T7 Hip	8 /12	31-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.28 97.33		
	1	T7C Hip	8 /12	31-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.28 97.33		
	1 2-ply	T11Z4 Monopitch Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.39 37.67		
	1 2-ply	T11Z5 Monopitch Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.39 37.67		
	1	T15 Hip Girder	8 /12	12-00-00	4-01-04	2 x 4	1-03-08	1-04-13 1-04-13	49.71 31.17		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard:	TAMARACK LUMBER	Job Track:	51012
	Builder:	ROYAL PINE HOMES	PlanLog:	201953
	Project:	CENTREFIELD	Layout ID:	413423
	Location:	RICHMOND HILL	Ref #	12606
	Model:	38-10	Page:	2 of 2
Lot #:		Date:	10-14-2020	
Elevation:	C	Designer:	Leo Chen	
		Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T16 Hip	8 /12	12-00-00	5-01-04	2 x 4	1-03-08	1-04-13 1-04-13	54.15 34.50		
	1	T17 Common	8 /12	12-00-00	5-04-13	2 x 4	1-03-08	1-04-13 1-04-13	47.65 29.17		
	1	T25 Hip Girder	8 /12	11-00-00	4-01-04	2 x 4	1-03-08	1-04-13 1-04-13	46.9 29.83		
	3	PB1 Piggyback	8 /12	7-10-11	2-00-00	2 x 4			64.14 43.00		
	31	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	520.63 330.67		

TOTAL # TRUSS= 61 TOTAL BFT OF ALL TRUSSES= 2272.34 BFT. TOTAL WEIGHT OF ALL TRSSES 3621.84 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LJS26DS	
2	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 5

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:07 2020 Page 2
ID: pXBePelFV7RX?2FLKzMhgeyOWXJ-4eYnqM04GuD6Y8K?JQHcBhpCclpVH9w7ai1WCeyTZ1E

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	3.75
D	TMWW-t	MT20	4.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TMW+w	MT20	2.0	4.0		
H	TS-t	MT20	3.0	6.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.75
K	TMVW-p	MT20	5.0	6.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.25
P	BMWWWW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWWWW-t	MT20	5.0	8.0		
S	BMWW-t	MT20	5.0	6.0	2.50	2.25
T	BMWW-t	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRAC LENGTH FR-TO	MAX CS1 (LC)
FR-TO		FROM	TO				
AP-AQ	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
AQ-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-40	-40	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-169	-169	---	FRONT	VERT	SNOW	---	C1
E	13-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
G	17-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
H	19-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
J	26-11-5	-40	-40	---	FRONT	VERT	DEAD	---	C1
J	26-11-5	-169	-169	---	FRONT	VERT	SNOW	---	C1
P	17-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
O	15-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
R	13-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
V	5-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
W	7-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
X	9-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	11-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	15-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AA	15-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AB	21-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AC	23-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AD	25-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AE	1-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AF	3-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AG	5-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	7-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	9-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	11-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	15-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	19-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	21-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	23-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	25-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AP	27-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AQ	29-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2022113 3/1

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 Mitek Industries, Inc. Wed Oct 14 09:10:08 2020 Page 1
ID: pXBepelFV7RX?2FLKzMhgeyOWXJ-Yq6920i1BLy9lvCt7orjvLM?i510ZuGoMn4l4yTZ1D

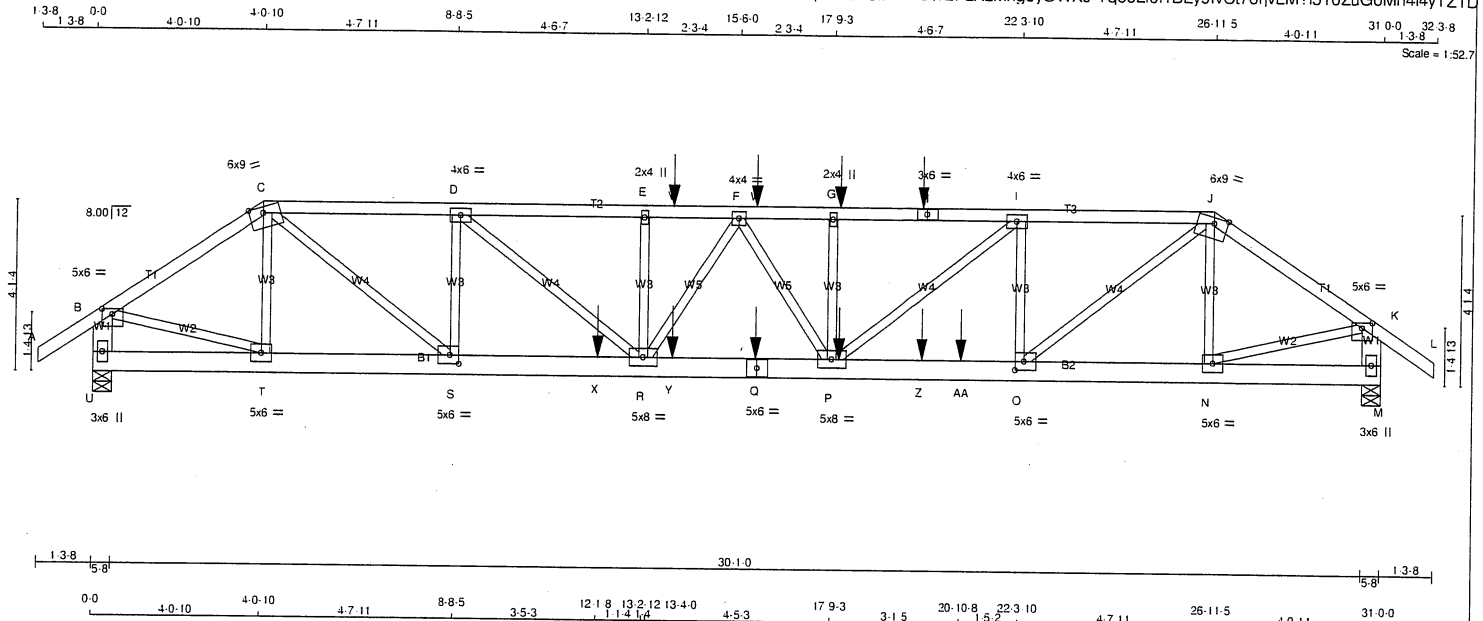

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
U - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
U - Q	2x6	DRY	No.2	SPF	
Q - M	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
H - C	12	SIDE(61.0)
H - J	12	SIDE(0.0)
J - L	12	TOP
U - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - U	12	SIDE(0.0)
Q - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	DOWN	BRG	BRG
M	3330	0	5-8	5-8
U	3131	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED							
M	2349	1576 / 0	0 / 0	0 / 0	0 / 0	773 / 0	0 / 0
U	2209	1482 / 0	0 / 0	0 / 0	0 / 0	727 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, U

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	T-C	-692 / 0	0.09 (1)
B-C	-3676 / 0	-91.8	-91.8 0.21 (1)	4.73	N-J	-799 / 0	0.10 (1)
C-D	-5983 / 0	-91.8	-91.8 0.31 (1)	3.77	B-T	0 / 3140	0.39 (1)
D-E	-7805 / 0	-91.8	-91.8 0.43 (1)	3.25	N-K	0 / 3353	0.42 (1)
E-V	-7805 / 0	-91.8	-91.8 0.26 (1)	3.36	O-J	0 / 4177	0.52 (1)
V-F	-7805 / 0	-91.8	-91.8 0.26 (1)	3.36	C-S	0 / 3777	0.47 (1)
F-W	-7811 / 0	-91.8	-91.8 0.30 (1)	3.32	O-I	-1602 / 0	0.20 (1)
W-G	-7811 / 0	-91.8	-91.8 0.30 (1)	3.32	S-D	-1969 / 0	0.25 (1)
G-H	-7811 / 0	-91.8	-91.8 0.45 (1)	3.22	P-I	0 / 1697	0.21 (1)
H-I	-7811 / 0	-91.8	-91.8 0.45 (1)	3.22	D-R	0 / 2359	0.29 (1)
I-J	-6499 / 0	-91.8	-91.8 0.37 (1)	3.58	P-G	-512 / 0	0.06 (1)
J-K	-3926 / 0	-91.8	-91.8 0.22 (1)	4.60	R-E	-373 / 0	0.05 (1)
K-L	0 / 35	-91.8	-91.8 0.07 (1)	10.00	R-F	-171 / 0	0.03 (1)
U-B	-3090 / 0	0.0	0.0 0.11 (1)	7.81	F-P	-161 / 0	0.03 (1)
M-K	-3279 / 0	0.0	0.0 0.12 (1)	7.66			

U-T	0 / 0	-18.5	-18.5 0.02 (4)	10.00
T-S	0 / 3034	-18.5	-18.5 0.26 (1)	10.00
S-X	0 / 5983	-18.5	-18.5 0.68 (1)	10.00
X-R	0 / 5983	-18.5	-18.5 0.68 (1)	10.00
R-Y	0 / 7894	-18.5	-18.5 0.58 (1)	10.00
Y-Q	0 / 7894	-18.5	-18.5 0.58 (1)	10.00
Q-P	0 / 7894	-18.5	-18.5 0.58 (1)	10.00
P-Z	0 / 6500	-18.5	-18.5 0.75 (1)	10.00
Z-AA	0 / 6500	-18.5	-18.5 0.75 (1)	10.00
AA-O	0 / 6500	-18.5	-18.5 0.75 (1)	10.00
O-N	0 / 3239	-18.5	-18.5 0.33 (1)	10.00
N-M	0 / 0	-18.5	-18.5 0.03 (1)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	17-11.4	-76	-76	---	BACK	VERT	TOTAL	---
H	19-11.4	-76	-76	---	BACK	VERT	TOTAL	---
P	17-11.4	-21	-21	---	BACK	VERT	TOTAL	---
Q	15-11.4	-21	-21	---	BACK	VERT	TOTAL	---
V	13-11.4	-76	-76	---	BACK	VERT	TOTAL	---
W	15-11.4	-76	-76	---	BACK	VERT	TOTAL	---
X	12-1.8	-784	-784	---	BACK	VERT	TOTAL	---
Y	13-11.4	-21	-21	---	BACK	VERT	TOTAL	---
Z	19-11.4	-21	-21	---	BACK	VERT	TOTAL	---
AA	20-10.8	-794	-794	---	BACK	VERT	TOTAL	---

TOTAL WEIGHT = 2 X 147 = 293 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.19")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.35")

CSI: TC=0.45/1.00 (G-I:1), BC=0.75/1.00 (O-P:1), WB=0.52/1.00 (J-O:1), SSI=0.29/1.00 (R-S:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (O) (INPUT = 0.90)

JSI METAL = 0.70 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2022114 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:08 2020 Page 2
ID:pXBePeIFV7RX?2FLKzMngevOWXJ-Yq692i0i1BLy9IvCt7onvLM?i510ZuGoMn4I4yTZ1D

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	4.00
D	TMWW-t	MT20	4.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TMW+w	MT20	2.0	4.0		
H	TS-t	MT20	3.0	6.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	1.75	4.00
K	TMVW-p	MT20	5.0	6.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.50
P	BMWWWW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWWWW-t	MT20	5.0	8.0		
S	BMWW-t	MT20	5.0	6.0	2.50	2.50
T	BMWW-t	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2022114 *W*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
413423	T1Z2	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:48:43 2020 Page 2
ID:pXBepelFV7RX?2FLKzMhgevOWXJ-GBVJvH1qrU0UO3O7 pri25i GuBfwaO08133VOyTYT2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	4.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TMW+w	MT20	2.0	4.0		
H	TS-t	MT20	3.0	6.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	6.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.75
P	BMWWW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BMWW-t	MT20	5.0	6.0	2.50	2.75
T	BMWW-t	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2022146 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:10 2020 Page 1
ID:pXBpElFV7RX?2FLKzMhgeyOWXJ-UDevTO2yZpbqPb3a_YrJpKQhWskUS1ZGqGBpzyTZ1B

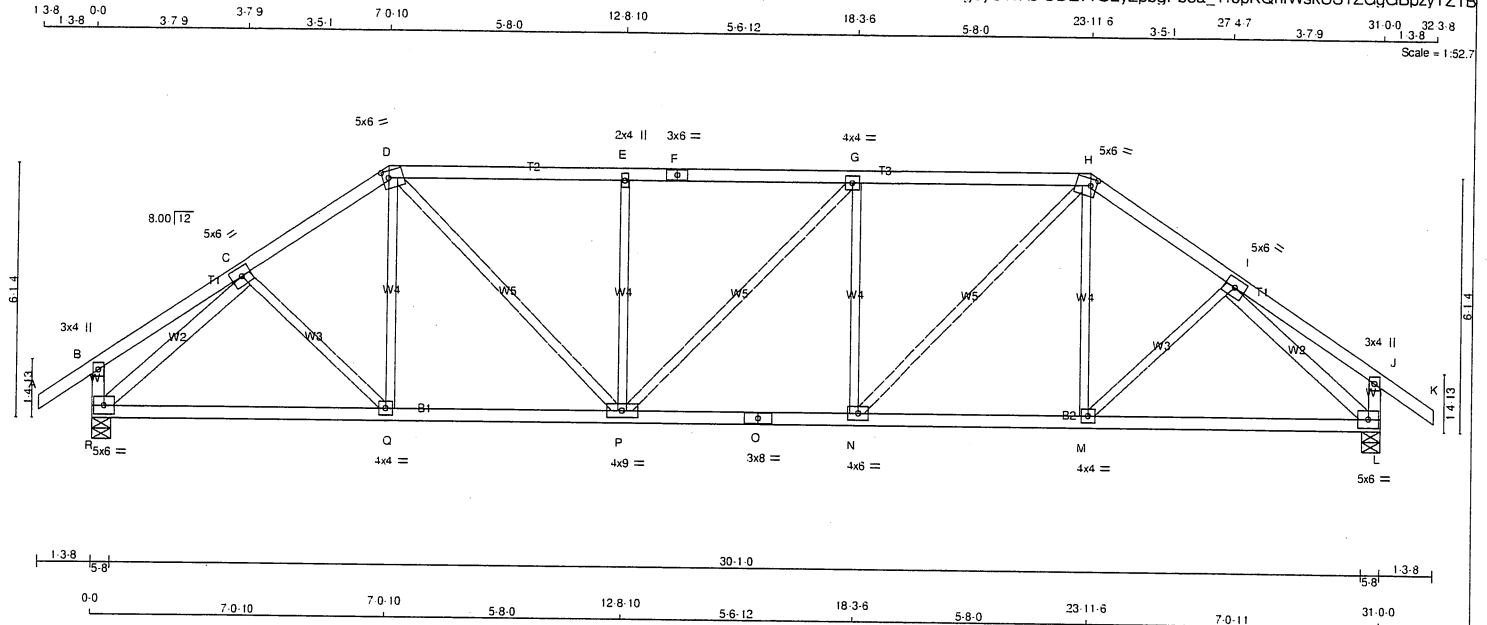

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. TOTAL WEIGHT = 2 X 135 = 270 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
H - K	2x4 DRY	No.2	SPF
R - B	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
R - O	2x4 DRY	No.2	SPF
O - L	2x4 DRY	No.2	SPF

ALL WEBS EXCEPT	SIZE	LUMBER	DESCR.
R - C	2x4 DRY	No.2	SPF
I - L	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER BEARINGS							
FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	JT	HORZ	JT	DOWN	JT	UPLIFT
R	1835	0	1835	0	0	5-8	5-8
L	1835	0	1835	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1295	863	0	0	0	432	0
L	1295	863	0	0	0	432	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.01 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	C-Q	0 72
B-C	0 19	-91.8 -91.8 0.17 (1)	10.00	Q-D	0 106
C-D	-1970 0	-91.8 -91.8 0.22 (1)	4.60	D-P	0 910
D-E	-2257 0	-91.8 -91.8 0.52 (1)	4.02	P-E	-557 0
E-F	-2258 0	-91.8 -91.8 0.52 (1)	4.01	P-G	-2 0
F-G	-2258 0	-91.8 -91.8 0.52 (1)	4.01	N-G	-558 0
G-H	-2259 0	-91.8 -91.8 0.53 (1)	4.01	N-H	0 912
H-I	-1970 0	-91.8 -91.8 0.22 (1)	4.60	M-H	0 106
I-J	0 19	-91.8 -91.8 0.17 (1)	10.00	M-I	0 72
J-K	0 35	-91.8 -91.8 0.12 (1)	10.00	R-C	-2189 0
R-B	-253 0	0 0 0.03 (1)	7.81	I-L	-2189 0
L-J	-253 0	0 0 0.03 (1)	7.81		
R-Q	0 1569	-18.5 -18.5 0.37 (1)	10.00		
Q-P	0 1622	-18.5 -18.5 0.37 (1)	10.00		
P-O	0 2259	-18.5 -18.5 0.42 (1)	10.00		
O-N	0 2259	-18.5 -18.5 0.42 (1)	10.00		
N-M	0 1622	-18.5 -18.5 0.37 (1)	10.00		
M-L	0 1568	-18.5 -18.5 0.37 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL)= L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.53/1.00 (G-H:1), BC=0.42/1.00 (N-P:1), WB=0.60/1.00 (C-R:1), SSI=0.24/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.90)
JSI METAL= 0.74 (O) (INPUT = 1.00)




Structural component only
DWG# T-2022116

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T4	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:10 2020 Page 1
ID: pXBepelFV7RX?2FLKzMhgeyQWXJ-UDEvTO2yZpbqPb3a_YrJpKQfGWtUURmZGgGBpyTZ1B

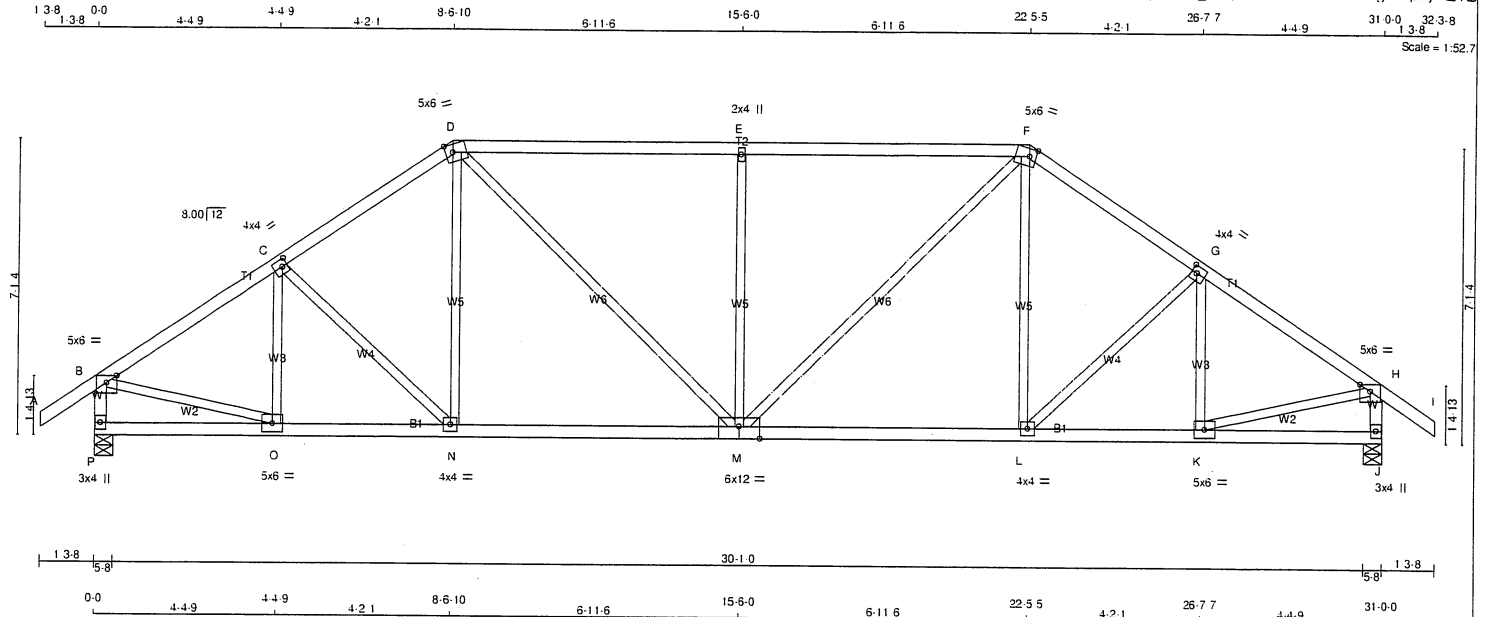

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **BEARINGS** **DESIGN CRITERIA** **SPACING = 24.0 IN. C/C** **TOTAL WEIGHT = 2 X 134 = 267 lb** [M][F]

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
P - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	UPLIFT	IN-SX
P 1835 0	1835 0	0 0	5-8 5-8
J 1835 0	1835 0	0 0	5-8 5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN.	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE PERM. LIVE WIND DEAD SOIL
P 1295	863 / 0	0 / 0 0 / 0 0 / 0 432 0 0 0
J 1295	863 / 0	0 / 0 0 / 0 0 / 0 432 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRAC LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	O-C	-344	0	0.10 (1)
B-C	-1966 / 0	-91.8	-91.8	0.26 (1)	4.58	C-N	-123	0	0.07 (1)
C-D	-1911 / 0	-91.8	-91.8	0.25 (1)	4.64	N-D	0	215	0.06 (4)
D-E	-2023 / 0	-91.8	-91.8	0.66 (1)	3.96	D-M	0	634	0.14 (1)
E-F	-2023 / 0	-91.8	-91.8	0.66 (1)	3.96	M-E	-784	0	0.68 (1)
F-G	-1911 / 0	-91.8	-91.8	0.25 (1)	4.64	M-F	0	634	0.14 (1)
G-H	-1966 / 0	-91.8	-91.8	0.26 (1)	4.58	L-F	0	215	0.06 (4)
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-123	0	0.07 (1)
P-B	-1796 / 0	0.0	0.0	0.18 (1)	6.24	K-G	-344	0	0.10 (1)
J-H	-1796 / 0	0.0	0.0	0.18 (1)	6.24	B-O	0	1706	0.38 (1)
P-O	0 / 0	-18.5	-18.5	0.08 (4)	10.00	K-H	0	1706	0.38 (1)
O-N	0 / 1656	-18.5	-18.5	0.37 (1)	10.00				
N-M	0 / 1570	-18.5	-18.5	0.36 (1)	10.00				
M-L	0 / 1570	-18.5	-18.5	0.36 (1)	10.00				
L-K	0 / 1656	-18.5	-18.5	0.37 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	Edge	1.50
C TMWW-i	MT20	4.0	4.0	2.00	1.50
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TMW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	6.0	2.25	2.00
G TMWW-i	MT20	4.0	4.0	2.00	1.50
H TMWV-p	MT20	5.0	6.0	Edge	
J BMV1-p	MT20	3.0	4.0		
K BMWW-i	MT20	5.0	6.0		
L BMWW-i	MT20	4.0	4.0		
M BSWWW-i	MT20	6.0	12.0	Edge	6.00
N BMWW-i	MT20	4.0	4.0		
O BMWW-i	MT20	5.0	6.0		
P BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2022117

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP = 0.88 (H) (INPUT = 0.90)
JSI METAL = 0.41 (O) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T5	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:11 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMHqeyOWXJ-zPoHgk3bK6jX0lemYFMYLXzpAwDdDseUK?kLPyTZ1A

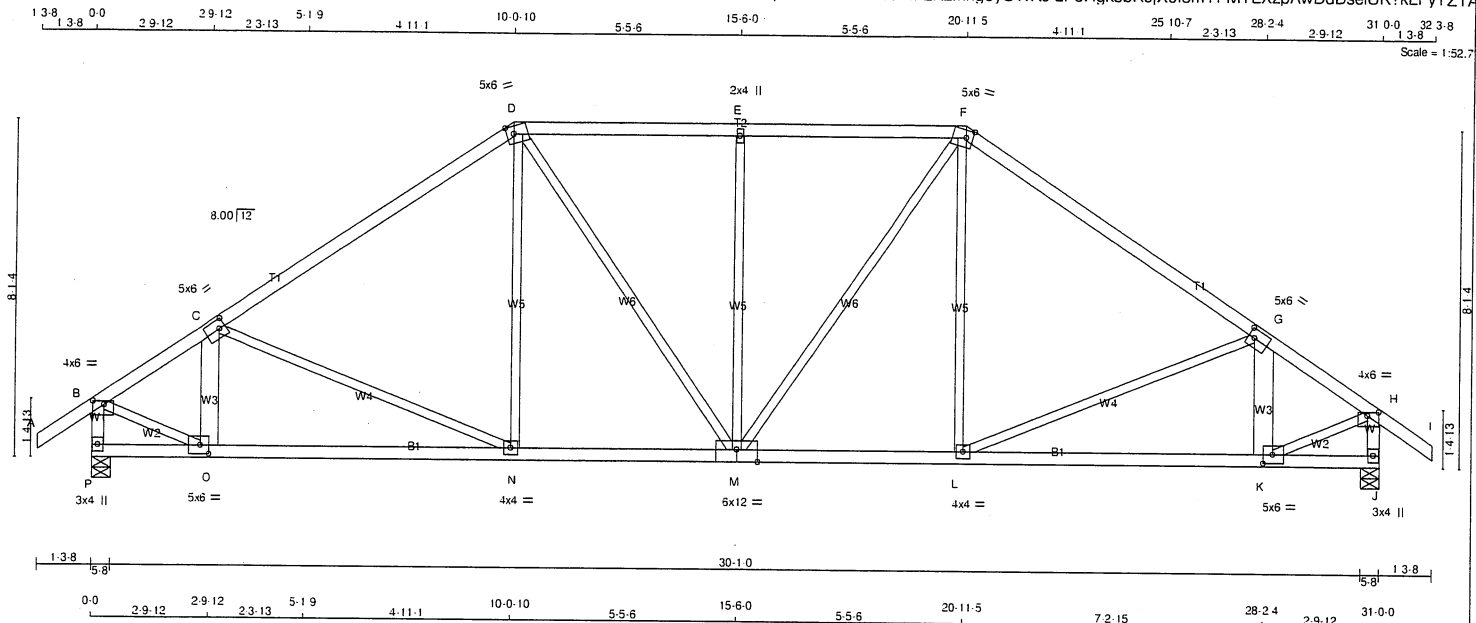

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
F - I	2x4 DRY	No.2	SPF
P - B	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF
P - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
O - C	2x6 DRY	No.2	SPF
K - G	2x6 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
D	TMVW-t	MT20	5.0	6.0	2.50	1.75
C	TTVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-t	MT20	5.0	6.0	2.50	1.75
H	TMVW-p	MT20	4.0	6.0	1.00	3.25
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BSVWVW-t	MT20	6.0	12.0	Edge	6.00
N	BMVW-t	MT20	4.0	4.0		
O	BMVW-t	MT20	5.0	6.0	2.50	2.75
P	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ
P	1835	0	1835	0
J	1835	0	1835	0

UNFACTORED REACTIONS

	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
P	1295	863	0	0	0	432	0
J	1295	863	0	0	0	432	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED	MAX.	MAX.	MEMB.	MAX.	FACTORED
	(LBS)	VERT. LOAD	LC1	UNBRAC		FORCE	MAX
		(PLF)	CSI (LC)			(LBS)	CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 35	-91.8	-91.8	0.12 (1)	N-D	0	197
B-C	-1888 0	-91.8	-91.8	0.50 (1)	4.29	D-M	0 413
C-D	-1836 0	-91.8	-91.8	0.71 (1)	4.13	M-E	-610 0
D-E	-1737 0	-91.8	-91.8	0.39 (1)	4.64	M-F	0 413
E-F	-1737 0	-91.8	-91.8	0.39 (1)	4.64	L-F	0 197
F-G	-1836 0	-91.8	-91.8	0.71 (1)	4.13	B-O	0 1760
G-H	-1888 0	-91.8	-91.8	0.50 (1)	4.29	K-H	0 1760
H-I	0 35	-91.8	-91.8	0.12 (1)	10.00	O-C	-527 0
P-B	-1824 0	0.0	0.0	0.19 (1)	6.20	K-G	-527 0
J-H	-1824 0	0.0	0.0	0.19 (1)	6.20	C-N	-156 0
					L-G	-156 0	0.20 (1)
P-O	0 0	-18.5	-18.5	0.14 (4)	10.00		
O-N	0 1643	-18.5	-18.5	0.38 (1)	10.00		
N-M	0 1500	-18.5	-18.5	0.35 (1)	10.00		
M-L	0 1500	-18.5	-18.5	0.35 (1)	10.00		
L-K	0 1643	-18.5	-18.5	0.38 (1)	10.00		
K-J	0 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL)= L/999 (0.14")

CSI: TC=0.71/1.00 (F-G:1), BC=0.38/1.00 (K-L:1),
WB=0.77/1.00 (E-M:1), SSI=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.42 (H) (INPUT = 1.00)




Structural component only
DWG# T-2022118

JOB NAME 406506	TRUSS NAME T5C	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:12 2020 Page 1
ID:pXBepelFV7RX?2FLKzMHgeyOWXJ-RbMgu44D4QrOevDz62tnuIW_WJYIyJqsi_IHuryTZ19

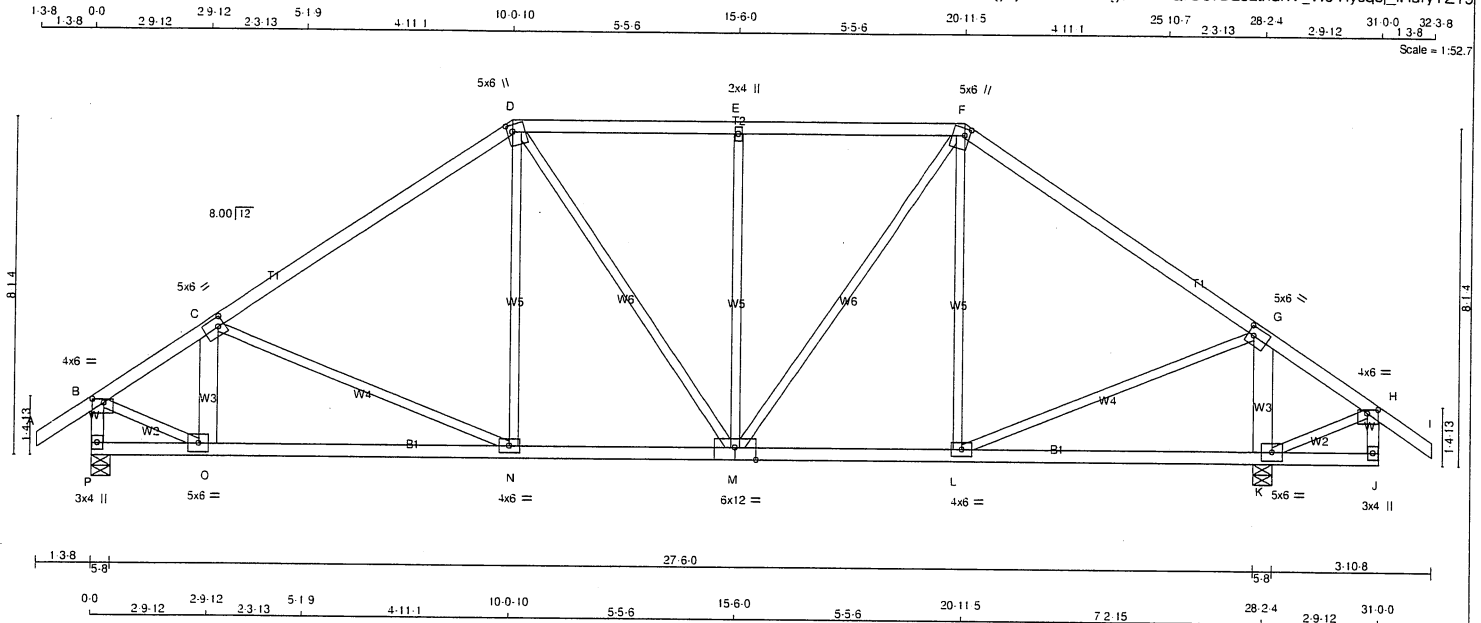

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **BEARINGS** **DESIGN CRITERIA** **SPACING = 24.0 IN. C/C** **TOTAL WEIGHT = 141 lb** **[M/F]**

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
P - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
O - C	2x6	DRY No.2	SPF
K - G	2x6	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	6.0	1.00	3.25
C	TMWV-t	MT20	5.0	6.0	2.50	1.75
D	TTWV+m	MT20	5.0	6.0	2.00	1.50
E	TMW-w	MT20	2.0	4.0		
F	TTWV+m	MT20	5.0	6.0	2.00	1.50
G	TMWV-t	MT20	5.0	6.0	2.50	1.75
H	TMWV-p	MT20	4.0	6.0	1.00	3.25
J	BMV+p	MT20	3.0	4.0		
K	BMWV-t	MT20	5.0	6.0		
L	BMWV-t	MT20	4.0	6.0		
M	BSWVWV-t	MT20	6.0	12.0	Edge 6.00	
N	BMWV-t	MT20	4.0	6.0		
O	BMWV-t	MT20	5.0	6.0		
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

UNFACTORED REACTIONS									
1ST CASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
P	1166	777	0	0	0	389	0	0	0
K	1424	949	0	0	0	475	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0	-91.8	-91.8 0.12 (1)	10.00	N-D	0	0.222
B-C	-1679	-91.8	-91.8 0.49 (1)	4.52	D-M	0	0.192
C-D	-1551	-91.8	-91.8 0.67 (1)	4.44	M-E	-612	0.78 (1)
D-E	-1374	-91.8	-91.8 0.37 (1)	5.11	M-F	0	0.640
E-F	-1374	-91.8	-91.8 0.37 (1)	5.11	L-F	-310	0.39 (1)
F-G	-1253	-91.8	-91.8 0.64 (1)	4.87	B-O	0	0.1574
G-H	0	-91.8	-91.8 0.67 (1)	10.00	K-H	-87	0.02 (1)
H-I	0	-91.8	-91.8 0.12 (1)	10.00	O-C	-459	0.04 (1)
P-B	-1642	0	0.0 0.17 (1)	6.46	K-G	-1862	0.17 (1)
J-H	-3	0	0.0 0.00 (1)	7.81	C-N	-225	0.29 (1)
P-O	0	-18.5	-18.5 0.14 (4)	10.00	L-G	0	0.1178
O-N	0	-18.5	-18.5 0.35 (1)	10.00			
N-M	0	-18.5	-18.5 0.31 (1)	10.00			
M-L	0	-18.5	-18.5 0.27 (4)	10.00			
L-K	-82	-18.5	-18.5 0.14 (4)	6.25			
K-J	0	-18.5	-18.5 0.17 (4)	10.00			

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.94")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.94")
CALCULATED VERT. DEFL.(TL)= L/999 (0.12")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.28")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.28")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.67/1.00 (C-D:1), BC=0.35/1.00 (N-O:1), WB=0.78/1.00 (E-M:1), SSI=0.26/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (G) (INPUT = 0.90)
JSI METAL= 0.42 (G) (INPUT = 1.00)




Structural component only
DWG# T-2022119

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T6	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:13 2020 Page 1
ID:pXBepelFV7RX?2FLKzMHgeyOWXJ-vnw25Q4rrk_FG3o9fg00Qy2Dju?hns?yeUrQHytZ18

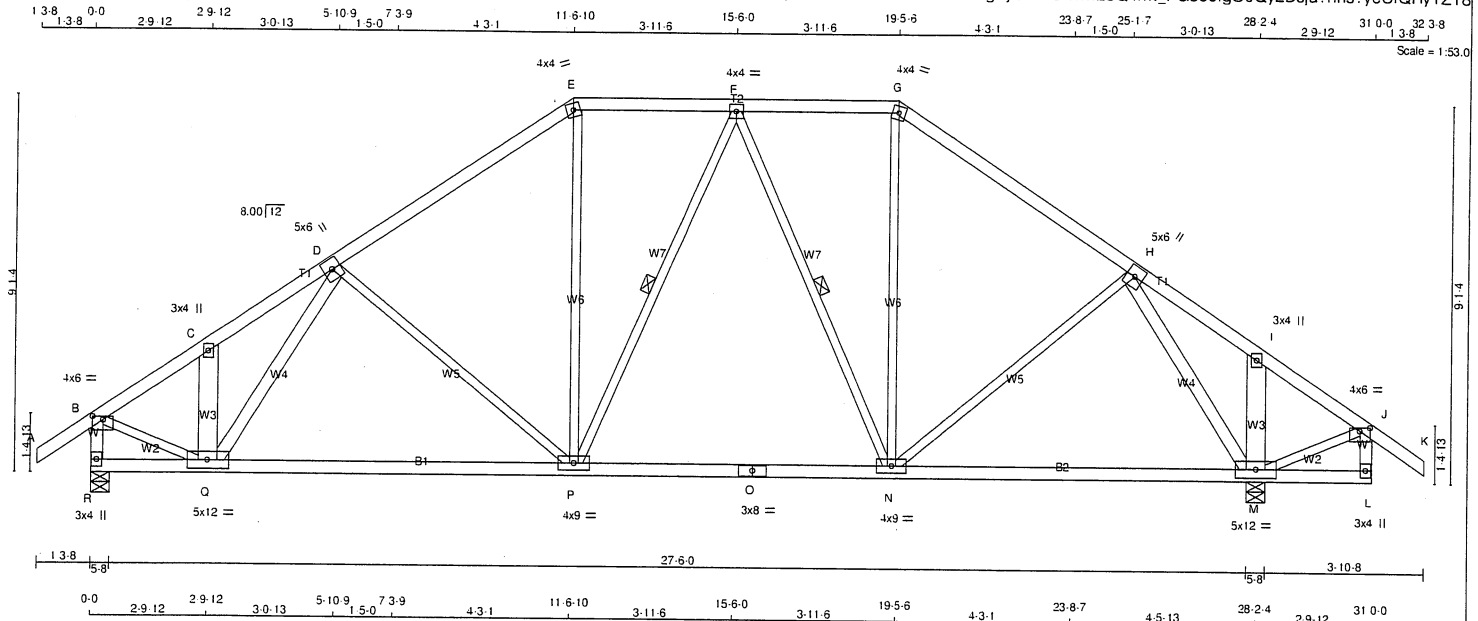

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	GROSS REACTION	GROSS REACTION	INPUT	REQD	TOP CH.	LL	PSF
A - E	2x4	DRY	No.2	SPF	VERT	HORZ	DOWN	HORZ	DL	6.0	PSF
E - G	2x4	DRY	No.2	SPF	JT	1652	0	1652	BOT CH.	LL	0.0
G - K	2x4	DRY	No.2	SPF	R	2018	0	2018	DL	7.4	PSF
R - B	2x4	DRY	No.2	SPF	M				TOTAL LOAD		39.0
L - J	2x4	DRY	No.2	SPF							
R - O	2x4	DRY	No.2	SPF							
O - L	2x4	DRY	No.2	SPF							

ALL WEBS				UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C			
EXCEPT				1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
Q - C	2x6	DRY	No.2	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M - I	2x6	DRY	No.2	R	1166	777	0	0	0	389	0
H - M	2x4	DRY	No.2	M	1424	949	0	0	0	475	0
Q - D	2x4	DRY	No.2								

DRY: SEASONED LUMBER.

PLATES (table is in inches)				BRACING				LOADING			
JT	TYPE	PLATES	W LEN Y X	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.				TOTAL LOAD CASES: (4)			
B	TMVW-p	MT20	4.0 6.0 1.00 3.00	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.				CHORDS			
C	TMVW-w	MT20	3.0 4.0	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				MEMB. FORCE			
D	TMVW-t	MT20	5.0 6.0	1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P, F-N.				FACTORED			
E	TTW-m	MT20	4.0 4.0	END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW				VERT. LOAD LC1 MAX			
F	TMVW-t	MT20	4.0 4.0					FROM TO			
G	TTW-m	MT20	4.0 4.0					MAX. MEMB. FORCE			
H	TMVW-t	MT20	5.0 6.0					FACTORED			
I	TMVW-w	MT20	3.0 4.0					VERT. LOAD LC1 MAX			
J	TMVW-p	MT20	4.0 6.0 1.00 3.00					FROM TO			
L	BMV-p	MT20	3.0 4.0					MAX. MEMB. FORCE			
M	BMVWV1-t	MT20	5.0 12.0					FACTORED			
N	BMVWV1-t	MT20	4.0 9.0					VERT. LOAD LC1 MAX			
O	BS-t	MT20	3.0 8.0					FROM TO			
P	BMVWV1-t	MT20	4.0 9.0					MAX. MEMB. FORCE			
Q	BMVWV1-t	MT20	5.0 12.0					FACTORED			
R	BMV1-p	MT20	3.0 4.0					VERT. LOAD LC1 MAX			



Structural component only
DWG# T-2022120

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (J) (INPUT = 0.90)
JSI METAL = 0.63 (D) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T6C	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:14 2020 Page 1
ID:pXBePcIFV7RX?2FLKzMhgeyOWXJ-N_UQIm5Tc166tDNLDOvFzAbO37EEQE69BIEOyKtZ17

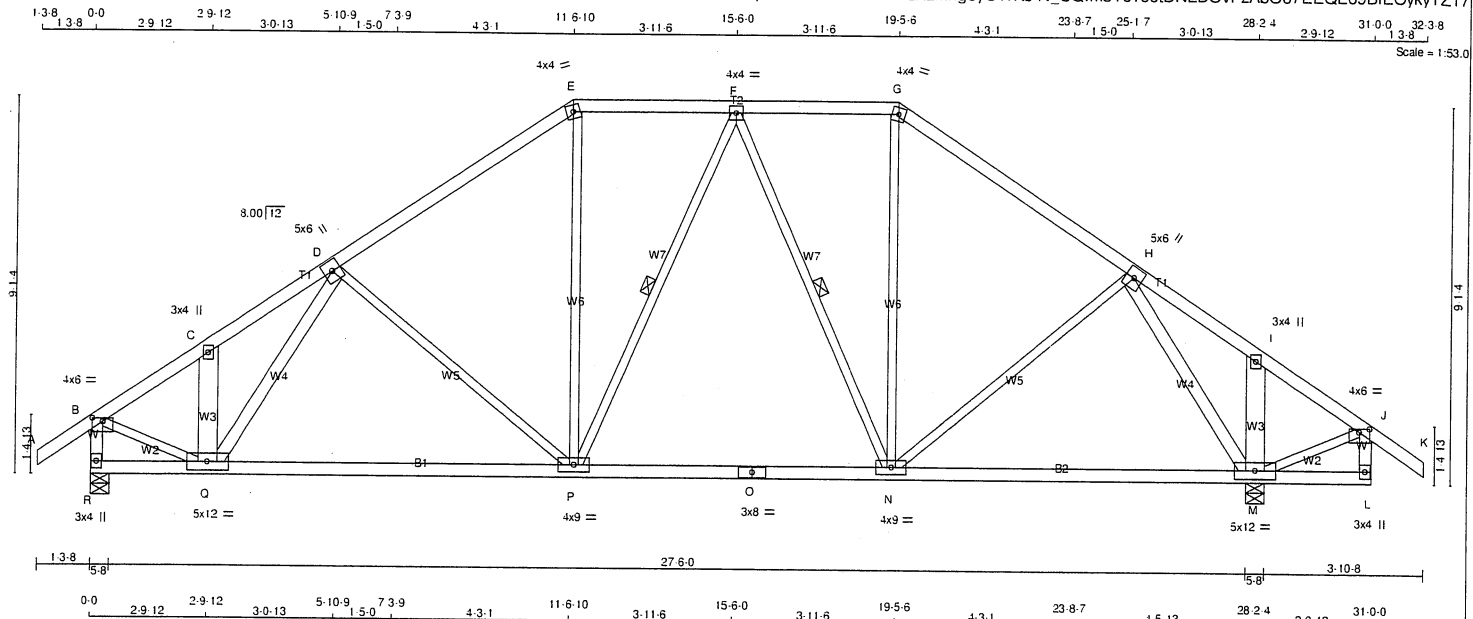

LUMBER				SPF				DESIGN CRITERIA			
N. L. G. A. RULES				FACTORED				SPECIFIED LOADS:			
CHORDS				GROSS REACTION				TOP CH. LL = 25.6 PSF			
A - E				VERT				DL = 6.0 PSF			
E - G				HORZ				BOT CH. LL = 0.0 PSF			
G - K				DOWN				DL = 7.4 PSF			
K - B				UP				TOTAL LOAD = 39.0 PSF			
B - L				BRG							
L - J				IN-SX							
J - O				IN-SX							
O - L				5-8							
ALL WEBS				5-8							
EXCEPT				5-8							
Q - C				5-8							
M - I				5-8							
H - M				5-8							
Q - D				5-8							

UNFACTORED REACTIONS				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R. M			
1ST LCASE							
COMBINED							
JT							
R							
M							

BRACING				LOADING			
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.				TOTAL LOAD CASES: (4)			
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							
1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P, F-N.							

PLATES (table is in inches)				CHORDS				WEBS			
JT TYPE				MAX. FACTORED				MAX. FACTORED			
B				MEMB. FORCE				MEMB. FORCE			
C				VERT. LOAD				VERT. LOAD			
D				FROM TO				FROM TO			
E				MAX. FACTORED				MAX. FACTORED			
F				MEMB. FORCE				MEMB. FORCE			
G				VERT. LOAD				VERT. LOAD			
H				FROM TO				FROM TO			
I				MAX. FACTORED				MAX. FACTORED			
J				MEMB. FORCE				MEMB. FORCE			
K				VERT. LOAD				VERT. LOAD			
L				FROM TO				FROM TO			
M				MAX. FACTORED				MAX. FACTORED			
N				MEMB. FORCE				MEMB. FORCE			
O				VERT. LOAD				VERT. LOAD			
P				FROM TO				FROM TO			
Q				MAX. FACTORED				MAX. FACTORED			
R				MEMB. FORCE				MEMB. FORCE			
S				VERT. LOAD				VERT. LOAD			
T				FROM TO				FROM TO			
U				MAX. FACTORED				MAX. FACTORED			
V				MEMB. FORCE				MEMB. FORCE			
W				VERT. LOAD				VERT. LOAD			
X				FROM TO				FROM TO			
Y				MAX. FACTORED				MAX. FACTORED			
Z				MEMB. FORCE				MEMB. FORCE			



Structural component only
DWG# T-2022121

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (J) (INPUT = 0.90)
JSI METAL= 0.63 (D) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T7	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:14 2020 Page 1
ID:PxBePeIFV7RX?2FLKzMhgeyOWXJ-N_UQIm5Tc166tDNLDovFzAbPP7FsQJh9BIEOkyTZ17

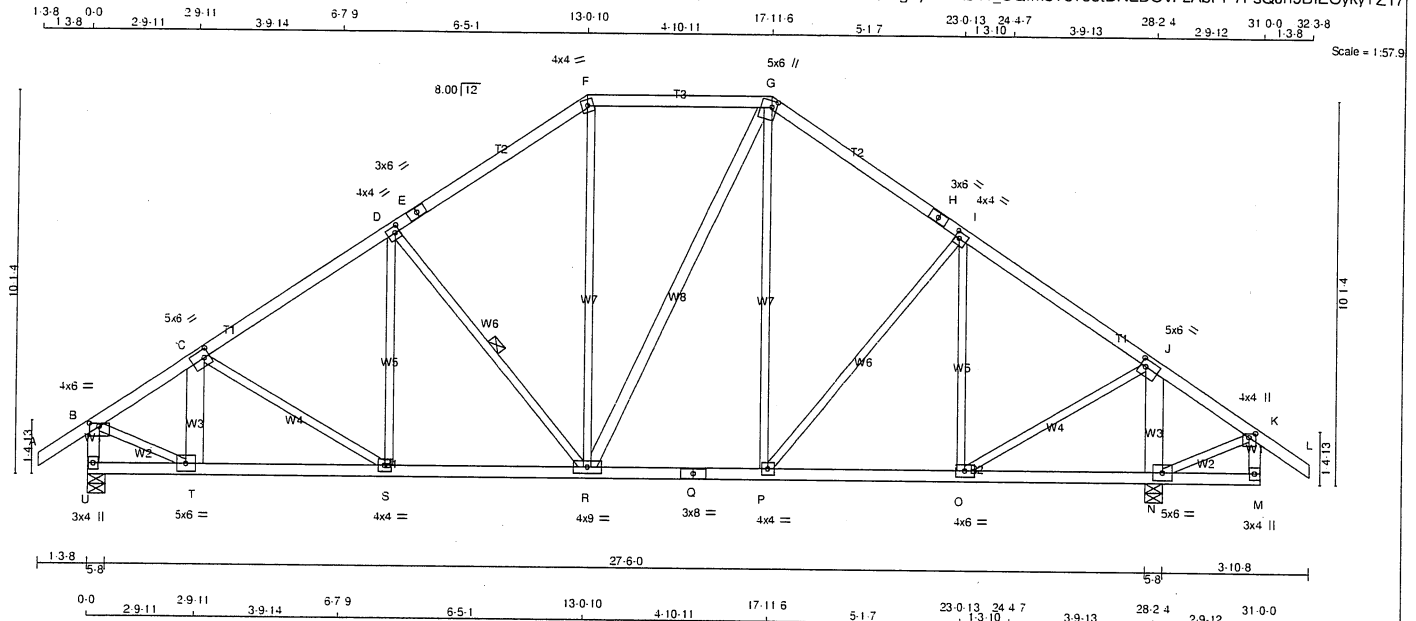

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS										SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG		REQRD BRG		TOP CH. LL = 25.6 PSF			
A - E	2x4	DRY	No.2	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	DL = 6.0 PSF		BOT CH. LL = 0.0 PSF			
E - F	2x4	DRY	No.2	U	1652	0	1652	0	0	5-8	5-8	DL = 7.4 PSF		TOTAL LOAD = 39.0 PSF			
F - G	2x4	DRY	No.2	N	2018	0	2018	0	0	5-8	5-8						
G - H	2x4	DRY	No.2	UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C			
H - L	2x4	DRY	No.2	1ST LCASE MAX. MIN. COMPONENT REACTIONS													
U - B	2x4	DRY	No.2	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL						
M - K	2x4	DRY	No.2	U	1166	777	0	0	0	0	389	0	0	LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
U - Q	2x4	DRY	No.2	N	1424	949	0	0	0	0	475	0	0	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART			
Q - M	2x4	DRY	No.2	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, N													
ALL WEBS EXCEPT	2x3	DRY	No.2														
R - G	2x4	DRY	No.2														
N - J	2x6	DRY	No.2														
T - C	2x6	DRY	No.2														

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TMVW-t	MT20	5.0	6.0	2.50	1.75
D	TMVW-l	MT20	4.0	4.0	2.00	1.50
E	TS-l	MT20	3.0	6.0		
F	TTW-m	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.00	1.50
H	TS-l	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-t	MT20	5.0	6.0	2.25	1.75
K	TMVW-p	MT20	4.0	4.0	1.25	2.00
M	BMV-p	MT20	3.0	4.0		
N	BMVW-t	MT20	5.0	6.0		
O	BMVW-t	MT20	4.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BS-l	MT20	3.0	8.0		
R	BMVW-t	MT20	4.0	9.0		
S	BMVW-t	MT20	4.0	4.0		
T	BMVW-t	MT20	5.0	6.0		
U	BMV-t	MT20	3.0	4.0		

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	S-D	0 / 103	0.04 (4)	
B-C	-1600 / 0	-91.8 -91.8	0.16 (1)	D-R	-520 / 0	0.24 (1)	
C-D	-1672 / 0	-91.8 -91.8	0.33 (1)	R-F	0 / 310	0.07 (1)	
D-E	-1320 / 0	-91.8 -91.8	0.31 (1)	R-G	0 / 204	0.03 (1)	
E-F	-1320 / 0	-91.8 -91.8	0.31 (1)	P-G	0 / 93	0.03 (4)	
F-G	-1076 / 0	-91.8 -91.8	0.30 (1)	B-T	0 / 1449	0.33 (1)	
G-H	-1214 / 0	-91.8 -91.8	0.30 (1)	N-K	-211 / 0	0.04 (1)	
H-I	-1214 / 0	-91.8 -91.8	0.30 (1)	N-J	-1846 / 0	0.17 (1)	
I-J	-1150 / 0	-91.8 -91.8	0.29 (1)	T-C	-446 / 0	0.04 (1)	
J-K	0 / 267	-91.8 -91.8	0.25 (1)	C-S	0 / 58	0.01 (1)	
K-L	0 / 35	-91.8 -91.8	0.12 (1)	P-I	0 / 32	0.01 (1)	
U-B	-1631 / 0	0.0 0.0	0.17 (1)	O-I	-580 / 0	0.43 (1)	
M-K	0 / 14	0.0 0.0	0.00 (4)	O-J	0 / 1343	0.30 (1)	
U-T	0 / 0	-18.5 -18.5	0.06 (4)				
T-S	0 / 1352	-18.5 -18.5	0.27 (1)				
S-R	0 / 1403	-18.5 -18.5	0.28 (1)				
R-Q	0 / 987	-18.5 -18.5	0.21 (1)				
Q-P	0 / 987	-18.5 -18.5	0.21 (1)				
P-O	0 / 966	-18.5 -18.5	0.20 (1)				
O-N	-197 / 0	-18.5 -18.5	0.07 (4)				
N-M	0 / 0	-18.5 -18.5	0.09 (4)				



Structural component only
DWG# T-2022122

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.40 (J) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T7C	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:15 2020 Page 1
ID:pXBpElFV7RX?2FLKzMhgeyOWXJ-rA1oW565NLEzVNxYn5RUWN8a9Xb59mxIPyzxUAYtZ16

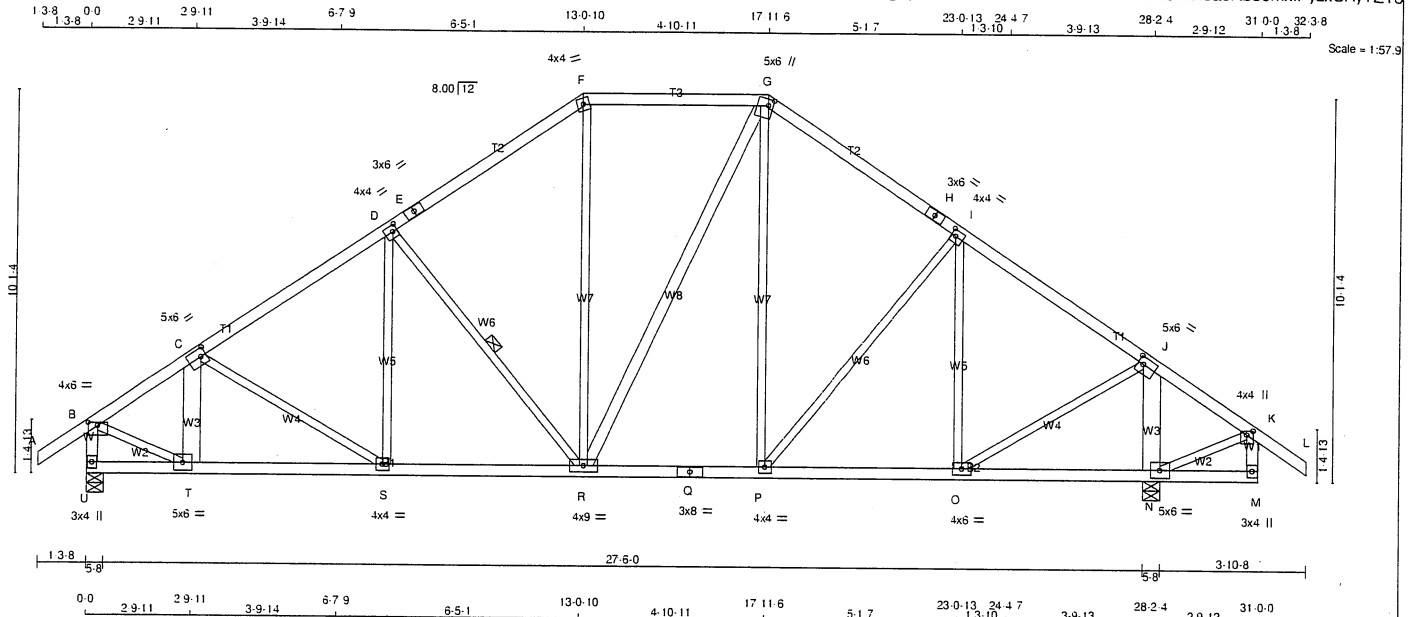

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED				TOP CH. LL = 25.6 PSF			
A - E	2x4	DRY	No.2	GROSS REACTION				DL = 6.0 PSF			
E - F	2x4	DRY	No.2	MAXIMUM FACTORED				BOT CH. LL = 0.0 PSF			
F - G	2x4	DRY	No.2	INPUT				DL = 7.4 PSF			
G - H	2x4	DRY	No.2	REQRD				TOTAL LOAD = 39.0 PSF			
H - L	2x4	DRY	No.2	BRG				SPACING = 24.0 IN. C/C			
U - B	2x4	DRY	No.2	UP-LIFT				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
M - K	2x4	DRY	No.2	IN-SX				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
U - Q	2x4	DRY	No.2	5-8				THIS DESIGN COMPLIES WITH:			
Q - M	2x4	DRY	No.2	5-8				- PART 9 OF BCBC 2018, OBC 2012, ABC 2019			
ALL WEBS	2x3	DRY	No.2	5-8				- PART 9 OF OBC 2012 (2019 AMENDMENT)			
EXCEPT				5-8				- CSA 086-09, CSA 086-14			
R - G	2x4	DRY	No.2	5-8				- TPIC 2011, TPIC 2014			
N - J	2x6	DRY	No.2	5-8				(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
T - C	2x6	DRY	No.2	5-8				ALLOWABLE DEFL.(LL)= L/360 (0.94")			
DRY: SEASONED LUMBER.				5-8				CALCULATED VERT. DEFL.(LL)= L/999 (0.05")			

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B - TMVW-p	MT20	4.0	6.0	1.00	3.00
C - TMVW-t	MT20	5.0	6.0	2.50	1.75
D - TMVW-t	MT20	4.0	4.0	2.00	1.50
E - TS-t	MT20	3.0	6.0		
F - TTW-m	MT20	4.0	4.0		
G - TTW+m	MT20	5.0	6.0	2.00	1.50
H - TS-t	MT20	3.0	6.0		
I - TMVW-t	MT20	4.0	4.0	2.00	1.50
J - TMVW-t	MT20	5.0	6.0	2.25	1.75
K - TMVW-p	MT20	4.0	4.0	1.25	2.00
L - BMV-p	MT20	3.0	4.0		
M - BMVW-t	MT20	5.0	6.0		
N - BMVW-t	MT20	4.0	6.0		
O - BMVW-t	MT20	4.0	4.0		
P - BS-t	MT20	3.0	8.0		
R - BMVW-t	MT20	4.0	9.0		
S - BMVW-t	MT20	4.0	4.0		
T - BMVW-t	MT20	5.0	6.0		
U - BMV-t	MT20	3.0	4.0		

UNFACTORED REACTIONS

1ST LCASE	SNOW	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1166	777 0	0 0	0 0	0 0	389 0	0 0
N	1424	949 0	0 0	0 0	0 0	475 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	S-D	0 103	0.04 (4)	
B-C	-1600 0	-91.8 -91.8 0.16 (1)	5.08	D-R	-520 0	0.24 (1)	
C-D	-1672 0	-91.8 -91.8 0.33 (1)	4.82	R-F	0 310	0.07 (1)	
D-E	-1320 0	-91.8 -91.8 0.31 (1)	5.29	R-G	0 204	0.03 (1)	
E-F	-1320 0	-91.8 -91.8 0.31 (1)	5.29	P-G	0 93	0.03 (4)	
F-G	-1076 0	-91.8 -91.8 0.30 (1)	5.73	B-T	0 1449	0.33 (1)	
G-H	-1214 0	-91.8 -91.8 0.30 (1)	5.47	N-K	-211 0	0.04 (1)	
H-I	-1214 0	-91.8 -91.8 0.30 (1)	5.47	N-J	-1846 0	0.17 (1)	
I-J	-1150 0	-91.8 -91.8 0.29 (1)	5.60	T-C	-446 0	0.04 (1)	
J-K	0 267	-91.8 -91.8 0.25 (1)	10.00	C-S	0 58	0.01 (1)	
K-L	0 35	-91.8 -91.8 0.12 (1)	10.00	P-I	0 32	0.01 (1)	
U-B	-1631 0	0.0 0.0 0.17 (1)	6.48	O-I	-580 0	0.43 (1)	
M-K	0 14	0.0 0.0 0.00 (4)	10.00	O-J	0 1343	0.30 (1)	
U-T	0 0	-18.5 -18.5 0.06 (4)	10.00				
T-S	0 1352	-18.5 -18.5 0.27 (1)	10.00				
S-R	0 1403	-18.5 -18.5 0.28 (1)	10.00				
R-Q	0 987	-18.5 -18.5 0.21 (1)	10.00				
Q-P	0 987	-18.5 -18.5 0.21 (1)	10.00				
P-O	0 966	-18.5 -18.5 0.20 (1)	10.00				
O-N	-197 0	-18.5 -18.5 0.07 (4)	6.25				
N-M	0 0	-18.5 -18.5 0.09 (4)	10.00				



Structural component only
DWG# T-2022123

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.40 (J) (INPUT = 1.00)

JOB NAME 406506	TRUSS NAME T9A	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MITek Industries, Inc. Wed Oct 14 09:10:17 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-nZ9Zxn7LvyUhg5wuWTyboDxuKIAdiBbtFT2Z3yTZ14

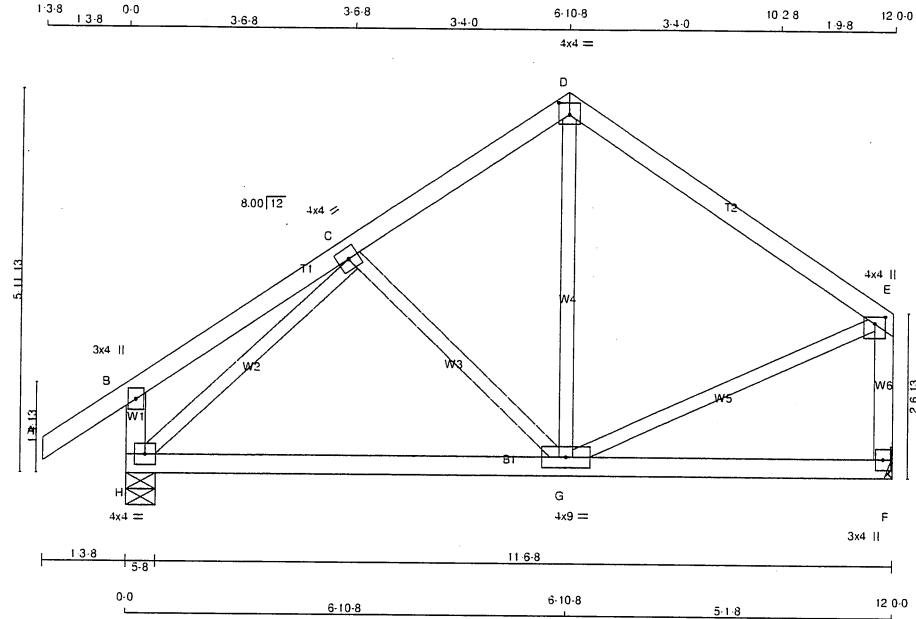

TOTAL WEIGHT = 52 lb
[M/F]

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-t	MT20	4.0	9.0		
H	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	662	0	662	0	0	MECHANICAL			
H	787	0	787	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	468	307.0	0.0	0.0	0.0	161.0	0.0
H	555	377.0	0.0	0.0	0.0	177.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1	
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	C-G	-197.0	0.08 (1)
B-C	0.20	-91.8	-91.8 0.17 (1)	10.00	G-D	0.120	0.04 (4)
C-D	-450.0	-91.8	-91.8 0.13 (1)	6.25	H-C	-698.0	0.26 (1)
D-E	-430.0	-91.8	-91.8 0.31 (1)	6.25	G-E	0.390	0.09 (1)
H-B	-247.0	0.0	0.0 0.03 (1)	7.81			
F-E	-630.0	0.0	0.0 0.09 (1)	7.81			
H-G	0.498	-18.5	-18.5 0.24 (4)	10.00			
G-F	0.0	-18.5	-18.5 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.31/1.00 (D-E:1), BC=0.24/1.00 (G-H:4), WB=0.26/1.00 (C-H:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (C) (INPUT = 0.90)
JSI METAL = 0.24 (C) (INPUT = 1.00)




Structural component only
DWG# T-2022125

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T10	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:18 2020 Page 1
ID:pXBePeIFV7RX?2FLKzHmgeyOWXJ-Fjix878_gGcYMqg7SD_B70m6ike6MCGk5vCc5VyTZ13

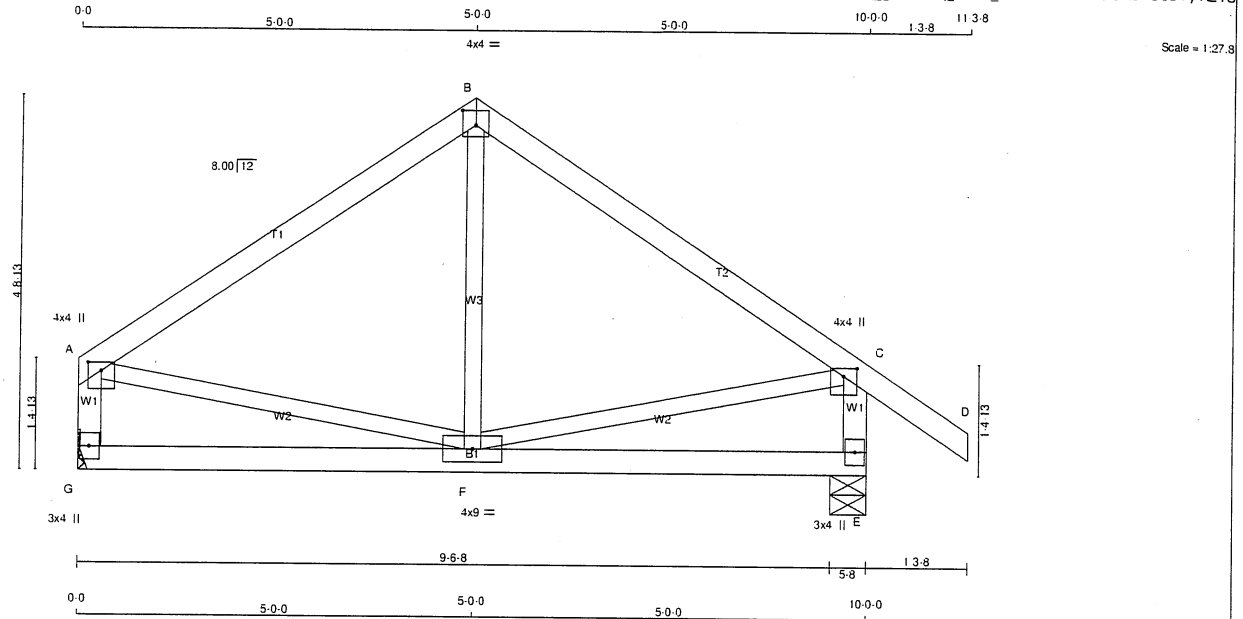

TOTAL WEIGHT = 2 X 40 = 81 lb
[M][F]

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - B	2x4	DRY	No.2		SPF
B - D	2x4	DRY	No.2		SPF
G - A	2x4	DRY	No.2		SPF
E - C	2x4	DRY	No.2		SPF
G - E	2x4	DRY	No.2		SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ
G	551	0	551	0
E	677	0	677	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	390	256	0	0	0	134	0
E	477	326	0	0	0	150	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.
		(LBS)	(PLF)			(LC)	UNBRAC			(LBS)	(PLF)		(LC)	UNBRAC
FR-TO							LENGTH	FR-TO						LENGTH
A-B	-390	0	-91.8	-91.8	0.30	(1)	6.25	F-B	-27	77	0.03	(4)		
B-C	-390	0	-91.8	-91.8	0.30	(1)	6.25	A-F	0	332	0.07	(1)		
C-D	0	35	-91.8	-91.8	0.12	(1)	10.00	F-C	0	332	0.07	(1)		
G-A	-515	0	0.0	0.0	0.05	(1)	7.81							
E-C	-641	0	0.0	0.0	0.07	(1)	7.81							
G-F	0	0	-18.5	-18.5	0.13	(4)	10.00							
F-E	0	0	-18.5	-18.5	0.13	(4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.30/1.00 (A-B:1), BC=0.13/1.00 (F-G:4),
WB=0.07/1.00 (A-F:1), SS=0.15/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.47 (A) (INPUT = 0.90)
JSI METAL= 0.14 (A) (INPUT = 1.00)




Structural component only
DWG# T-2022126

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T10S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:18 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-FIjx878_gGcYMqg7SD_B70m6like1MB4k5vCc5VyTZ13

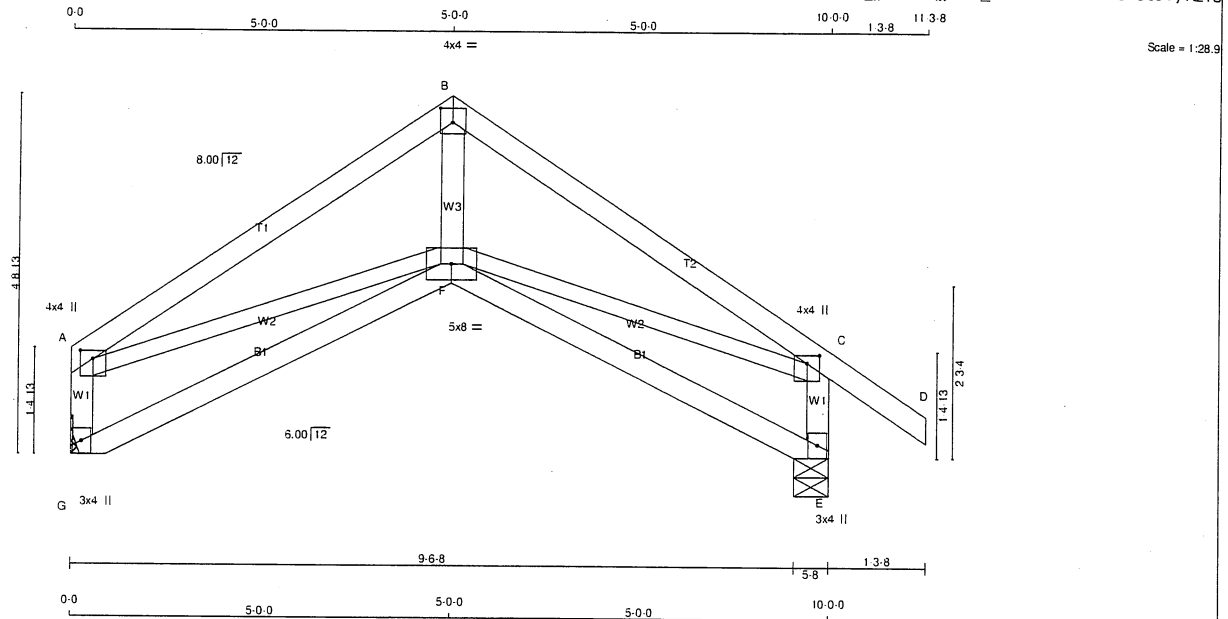

TOTAL WEIGHT = 2 X 41 = 83 lb

LUMBER					TOTAL WEIGHT = 2 X 41 = 83 lb																									
N. L. G. A. RULES					[M](F)																									
CHORDS					SIZE					LUMBER					DESCR.															
A - B		2x4		DRY		No.2		SPF																						
B - D		2x4		DRY		No.2		SPF																						
G - A		2x4		DRY		No.2		SPF																						
E - C		2x4		DRY		No.2		SPF																						
G - F		2x4		DRY		No.2		SPF																						
F - E		2x4		DRY		No.2		SPF																						
ALL WEBS EXCEPT					2x4		DRY		No.2		SPF																			
A - F		2x3		DRY		No.2		SPF																						
F - C		2x3		DRY		No.2		SPF																						
DRY: SEASONED LUMBER.																														
															DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER															
															BEARINGS															
															FACTORED		MAXIMUM FACTORED		INPUT		REQRD									
															GROSS REACTION		GROSS REACTION		BRG		BRG									
															JT		VERT		HORZ		DOWN		HORZ		UPLIFT		IN-SX			
															G		551		0		551		0		0		MECHANICAL			
															E		677		0		677		0		0		5-8		5-8	
															A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.															
															UNFACTORED REACTIONS															
															1ST CASE										MAX./MIN. COMPONENT REACTIONS					
															DESIGN CRITERIA															
															SPECIFIED LOADS:															
															TOP CH. LL = 25.6 PSF															
															DL = 6.0 PSF															
															BOT CH. LL = 0.0 PSF															
															DL = 7.4 PSF															
															TOTAL LOAD = 39.0 PSF															
															SPACING = 24.0 IN. C/C															
															THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015															

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BBWWW-p	MT20	5.0	8.0		
G	BMV1+p	MT20	3.0	4.0		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
G	390	256 / 0	0 / 0	0 / 0	0 / 0	134	0	0 / 0
E	477	326 / 0	0 / 0	0 / 0	0 / 0	150	0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO						FR-TO		
A-B	-779 / 0	-91.8	-91.8	0.30 (1)	6.25	F-B	0 / 406	0.07 (1)
B-C	-779 / 0	-91.8	-91.8	0.30 (1)	6.25	A-F	0 / 667	0.15 (1)
C-D	0 / 35	-91.8	-91.8	0.12 (1)	10.00	F-C	0 / 667	0.15 (1)
G-A	-505 / 0	0.0	0.0	0.05 (1)	7.81			
E-C	-631 / 0	0.0	0.0	0.07 (1)	7.81			
G-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.33")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL)= L/360 (0.33")

CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.30/1.00 (A-B:1), BC=0.14/1.00 (F-G:4), WB=0.15/1.00 (C-F:1), SSI=0.15/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (A) (INPUT = 0.90)

JSI METAL= 0.23 (A) (INPUT = 1.00)




Structural component only
DWG# T-2022127

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T11	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:19 2020 Page 1
ID: pXBepelFV7RX?2FLKzMHgeyOWXJ-kxHJMT9cRakP__FJ0xVQgDIL18zN5e0uKZy9dxyTZ12

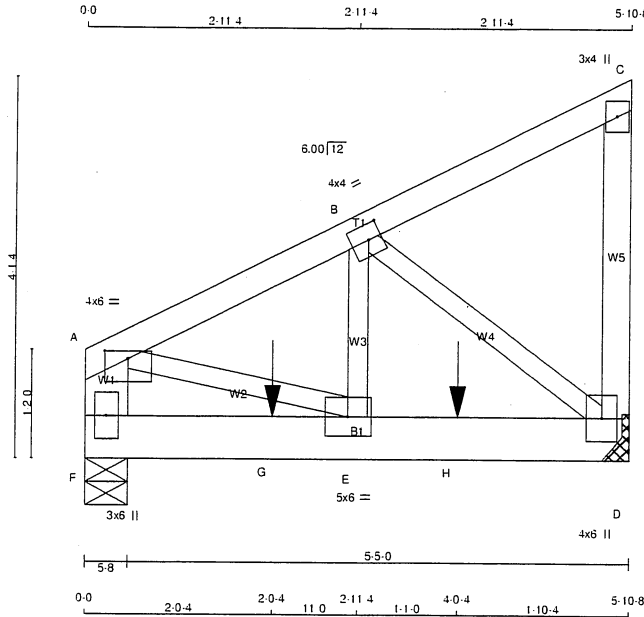

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T11	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:19 2020 Page 2
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-hxHJMT9cRakP FJ0xVQgDILI8zN5e0uKZy9dxyTZ12

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		




Structural component only
DWG# T-2022128 7/2

JOB NAME 406506	TRUSS NAME T11Z	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:20 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-C8rhZpAECtsGb8qVae0fDRrW?YK1q5u1ZDhiANyTZ11

Scale = 1:23.7

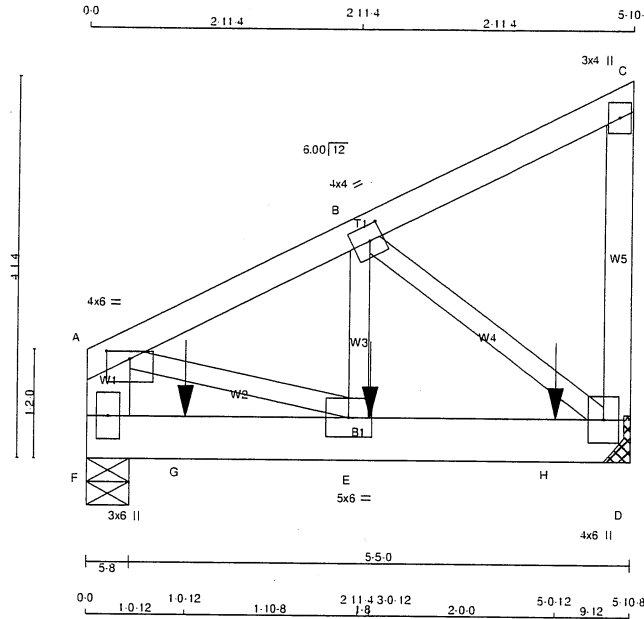

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
F - A	2x6	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF **2** TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD(PLF)
SPACING (IN)		
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	1	12 TOP
C-D	1	12 TOP
F-A	2	12 TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D	2	12 SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TMVW-p	MT20	3.0	4.0		
D	BMVW1-p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	1147	0	1147	0	0
F	1100	0	1100	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	809	545	0	0	0	264	0
F	776	523	0	0	0	253	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-963	-91.8	-91.8 0.06 (1)	6.25	A-E	0 902	0.11 (1)
B-C	-12	-91.8	-91.8 0.06 (1)	6.25	E-B	0 779	0.10 (1)
D-C	-108	0.0	0.0 0.01 (1)	7.81	B-D	-1098	0.13 (1)
F-A	-774	0.0	0.0 0.03 (1)	7.81			
F-G	0	-18.5	-18.5 0.12 (1)	10.00			
G-E	0	-18.5	-18.5 0.12 (1)	10.00			
E-H	0 872	-18.5	-18.5 0.17 (1)	10.00			
H-D	0 872	-18.5	-18.5 0.17 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-12	-375	-375	---	BACK	VERT	TOTAL	---	C1
G	1-0-12	-375	-375	---	BACK	VERT	TOTAL	---	C1
H	5-0-12	-376	-376	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = **24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.06/1.00 (A-B:1), BC=0.17/1.00 (D-E:1), WB=0.13/1.00 (B-D:1), SSI=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.53 (B) (INPUT = 0.90)
JSI METAL= 0.20 (D) (INPUT = 1.00)



Structural component only
DWG# T-2022129

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T11Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MTEK Industries, Inc. Wed Oct 14 09:10:20 2020 Page 2
ID:pXBePelFV7RX?2FLKzMhgeyOWXJ-C8rhZpAECtsGb8qVae0fDRrW?YK1q5u1ZDhiANyTZ11

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		




Structural component only
DWG# T-2022129 *2/11*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406445	T11Z3	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:39:42 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-c6JoNIUTFFsF_wX8oidsd?pcFpZNgzyOkMWy?FyTYbV

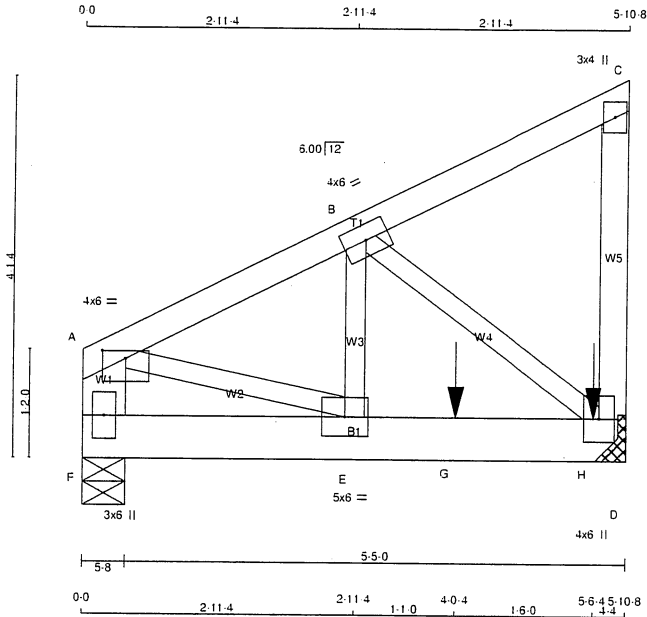

Scale = 1:23.7

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - A	2x6	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	10	SIDE(152.7)
F - A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE(122.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.00
B	TMVW-t	MT20	4.0	6.0		
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
D	3248	0	3248	0
F	1279	0	1279	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	2288	1553	0	0	0	734	0
F	901	613	0	0	0	288	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO				FR-TO		
A-B	-1975	0	-91.8	-91.8	0.07 (1)	6.19	A-E	0
B-C	-9	0	-91.8	-91.8	0.05 (1)	10.00	E-B	0
D-C	-115	0	0.0	0.0	0.01 (1)	7.81	B-D	-2232
F-A	-1470	0	0.0	0.0	0.05 (1)	7.81		
F-E	0	0	-18.5	-18.5	0.24 (1)	10.00		
E-G	0	1774	-18.5	-18.5	0.73 (1)	10.00		
G-H	0	1774	-18.5	-18.5	0.73 (1)	10.00		
H-D	0	1774	-18.5	-18.5	0.73 (1)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	4-0-4	-1986	-1986	---	FRONT	VERT	TOTAL	---	C1
H	5-6-4	-744	-744	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 58 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.07/1.00 (A-B:1), BC=0.73/1.00 (D-E:1), WB=0.27/1.00 (B-D:1), SS=0.71/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.40 (D) (INPUT = 1.00)



Structural component only
DWG# T-2022137

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406445	T11Z3.	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MITek Industries, Inc. Wed Oct 14 09:39:42 2020 Page 2
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-c6JoNIUTFFsF wX8oidsd?pcFpZNqyzOkMWv?FvTYbv

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		




Structural component only
DWG# T-2022137 *ML*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
413423	T11Z4	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MTek Industries, Inc. Wed Oct 14 09:48:44 2020 Page 1
ID:pXBpElFV7RX?2FLKzMhgeyOWXJ-kO3i7d2Scn8L0DzJYXMyblGFahzf6A9Mhod1ryTYT

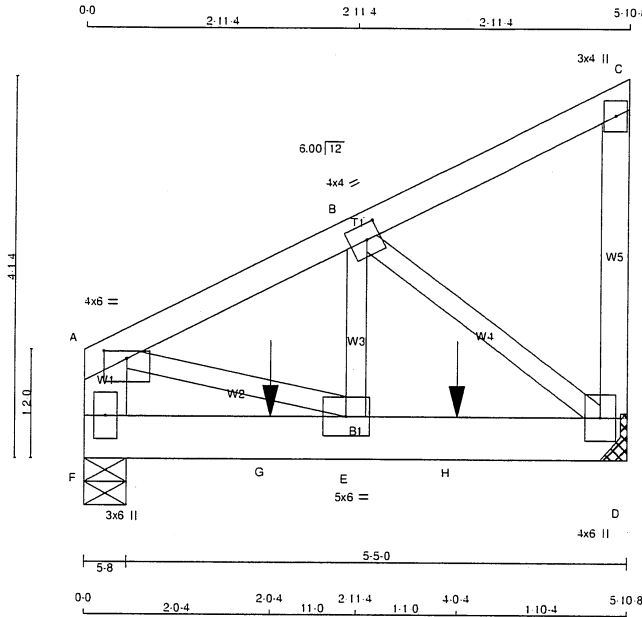

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
413423	T11Z4	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:48:44 2020 Page 2
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-kO3i7d2Scn8L0DzJYXMyblGFalhzf6A9Mhod1ryTYT

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		



Structural component only
DWG# T-2022147

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
413423	T11Z5	1	2	TRUSS DESC.		

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	T12	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:20 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-C8rhZpAEctG8qVae0fDRrU9YLOq731ZDhiAnYtZ11

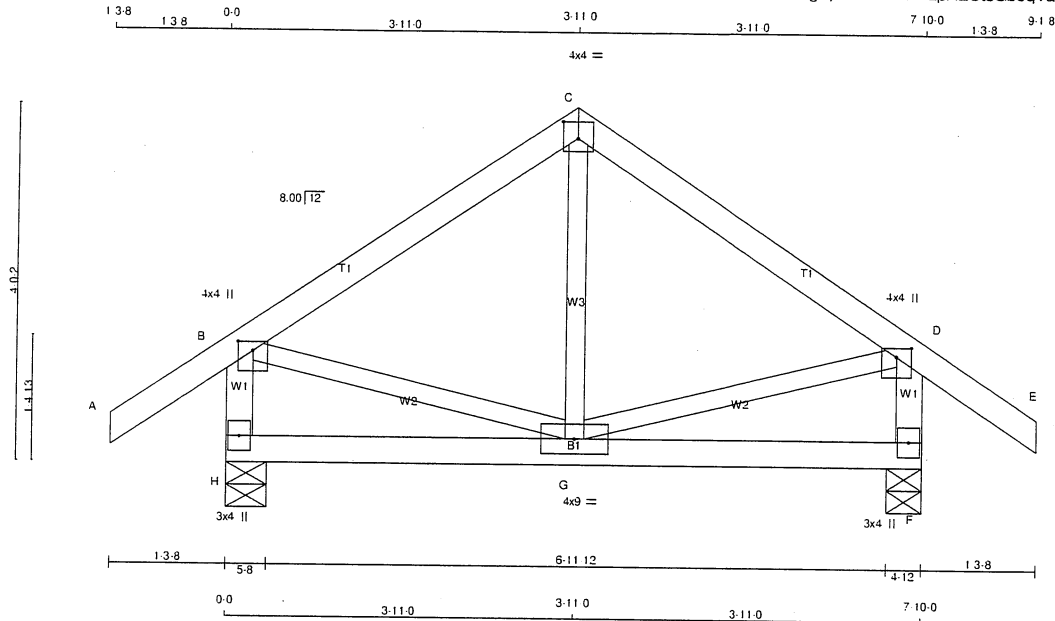

JOB NAME 406506	TRUSS NAME T12G	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 Mitek Industries, Inc. Wed Oct 14 09:10:21 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJgKP3m9AszB_6DIPh7MXuleOgoyicZaGBotRGiqyTZ10

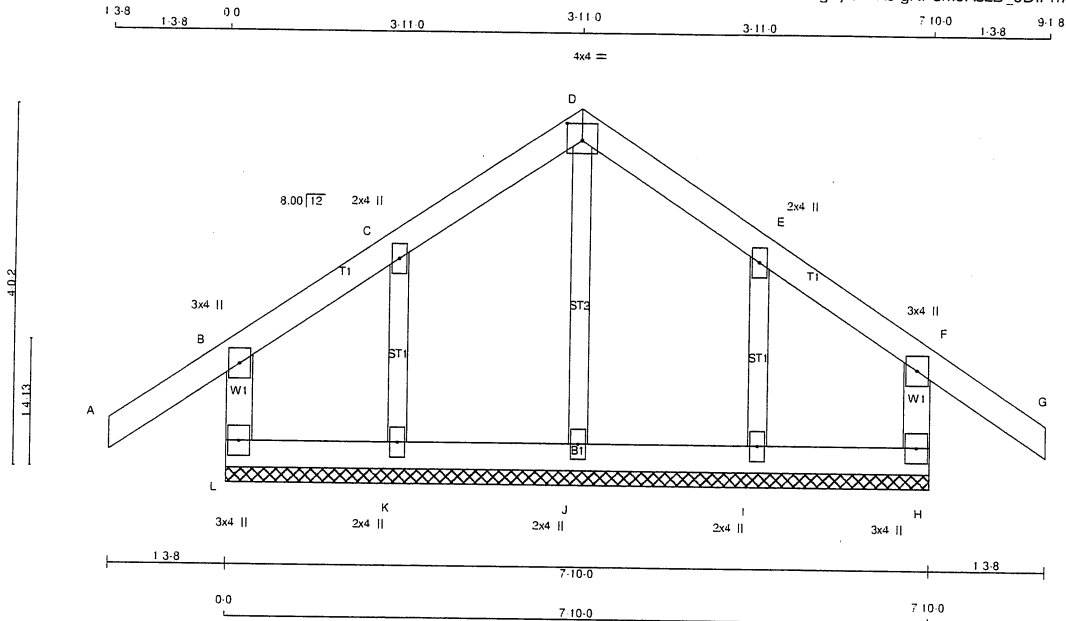

Scale = 1/24.4

LUMBER TOTAL WEIGHT = 32 lb

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
L - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" O.C.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	4.0	2.25	2.00
E	TMW+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMV1+p	MT20	3.0	4.0		
I, J, K						
I	BMV1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1 MAX	MEMB.	FORCE
(LBS)	(PLF)	CSI (LC)	(LBS)	MAX
FR-TO	FROM TO	LENGTH FR-TO		CSI (LC)
L-B	-209 / 0	0.0 0.0 0.04 (1)	J-D	-244 / 0
A-B	0 / 35	-91.8 -91.8 0.12 (1)	K-C	-154 / 0
B-C	0 / 22	-91.8 -91.8 0.08 (1)	I-E	-154 / 0
C-D	0 / 41	-91.8 -91.8 0.05 (1)		
D-E	0 / 41	-91.8 -91.8 0.05 (1)		
E-F	0 / 22	-91.8 -91.8 0.08 (1)		
F-G	0 / 35	-91.8 -91.8 0.12 (1)		
H-F	-209 / 0	0.0 0.0 0.04 (1)		
L-K	-26 / 0	-18.5 -18.5 0.02 (4)		
K-J	-32 / 0	-18.5 -18.5 0.02 (4)		
J-I	-32 / 0	-18.5 -18.5 0.02 (4)		
I-H	-26 / 0	-18.5 -18.5 0.02 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (I-J:4), WB=0.06/1.00 (D-J:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (D) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)



Structural component only
DWG# T-2022131

JOB NAME 406506	TRUSS NAME T12S	QUANTITY 2	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:22 2020 Page 1
ID:pXBepelFV7RX?2FLKzHmgeyOWXJ-8WyS_VBUkV6zR_uh337lswqfL1r1iK0XApeGyTZ1?

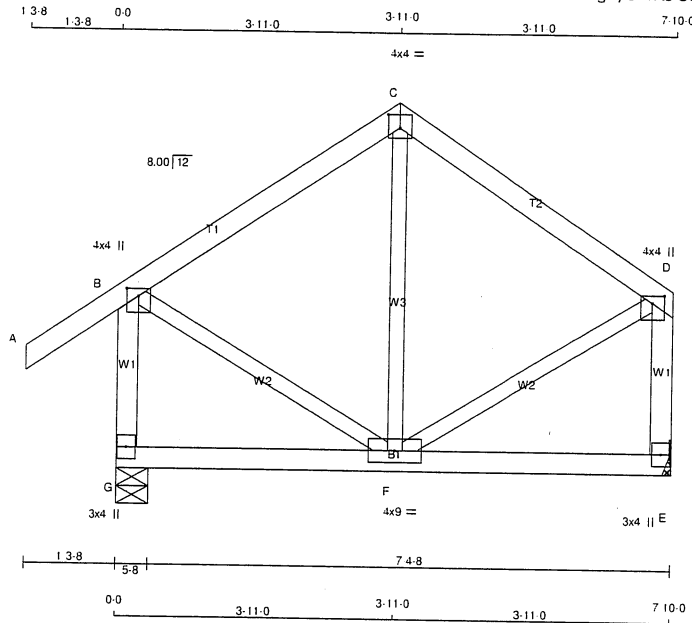

Scale = 1/32" = 1'-0"

LUMBER		CHORDS		SIZE		LUMBER		DESCR.	
N. L. G. A. RULES		A - C		2x4		No.2		SPF	
C - D		2x4		No.2		SPF		FACTORED	
G - B		2x4		No.2		SPF		GROSS REACTION	
E - D		2x4		No.2		SPF		DOWN	
G - E		2x4		No.2		SPF		UP	
ALL WEBS		2x3		No.2		SPF		MECHANICAL	
EXCEPT									

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	558	0	558	0	0	5-8	5-8
E	432	0	432	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	392	271 / 0	0 / 0	0 / 0	0 / 0	121 / 0	0 / 0
E	305	200 / 0	0 / 0	0 / 0	0 / 0	105 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	F-C	-119 / 24	0.05 (1)
B-C	-217 / 0	-91.8	-91.8 0.18 (1)	6.25	B-F	0 / 208	0.05 (1)
C-D	-217 / 0	-91.8	-91.8 0.18 (1)	6.25	F-D	0 / 208	0.05 (1)
G-B	-530 / 0	0.0	0.0 0.07 (1)	7.81			
E-D	-404 / 0	0.0	0.0 0.05 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

TOTAL WEIGHT = 2 X 37 = 74 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.26")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.26")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.18/1.00 (C-D:1), BC=0.08/1.00 (E-F:4), WB=0.05/1.00 (D-F:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.37 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)

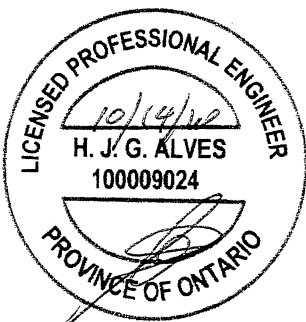


Structural component only
DWG# T-2022132

Structural component only
DWG# T-2022138

JOB NAME 406445	TRUSS NAME T16	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:39:43 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-4JsAaeV50Z_6c46LMP95ADMjLD2SPSSxZ0FVXiyTYbU

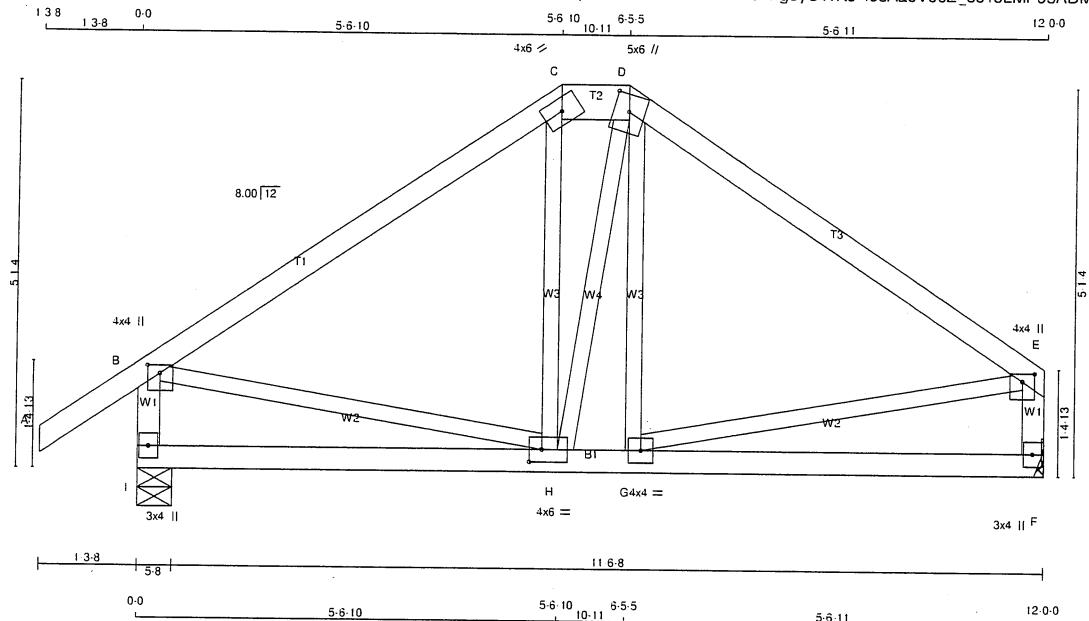

Scale = 1:29.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x6	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - F	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-h	MT20	4.0	6.0		
D	TTW+m	MT20	5.0	6.0	2.75	2.50
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-t	MT20	4.0	4.0		
H	BMVW-t	MT20	4.0	6.0	2.00	2.00
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORZ	UPLIFT	IN-SX
I 787	0	787	0	5-8
F 662	0	662	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	555	377.0	0.0	0.0	0.0	177.0	0.0
F	468	307.0	0.0	0.0	0.0	161.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO		
A-B	0.35	-91.8 -91.8	0.12 (1)	10.00	H-C	-14.48
B-C	-510	-91.8 -91.8	0.37 (1)	6.25	H-D	0.00 (4)
C-D	-426	-91.8 -91.8	0.01 (1)	6.25	G-D	-17.42
D-E	-509	-91.8 -91.8	0.37 (1)	6.25	B-H	0.434
I-B	-745	0.0 0.0	0.08 (1)	7.81	G-E	0.433
F-E	-620	0.0 0.0	0.06 (1)	7.81		
I-H	0	-18.5 -18.5	0.13 (4)	10.00		
H-G	0	-18.5 -18.5	0.17 (4)	10.00		
G-F	0	-18.5 -18.5	0.12 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.40")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.40")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.37/1.00 (B-C:1), BC=0.17/1.00 (G-H:4), WB=0.10/1.00 (B-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

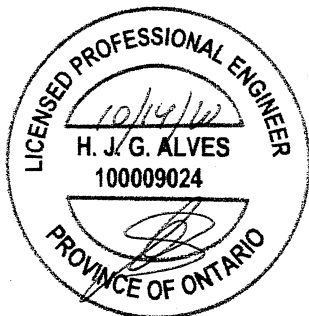


Structural component only
DWG# T-2022139

JOB NAME 406445	TRUSS NAME T17	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:39:44 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMHgeyOWXJ-YVQZn_Wknt6zEEhXv6gKiQvt7dNM8vBgBg?348yTVbT

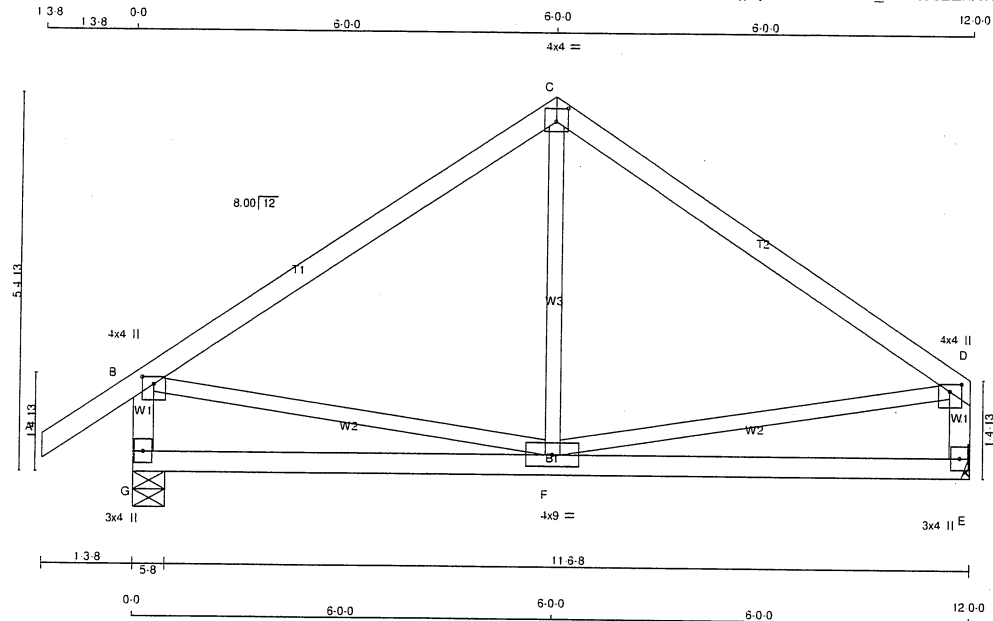

TOTAL WEIGHT = 48 lb
[M/F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
G	787	0	787	0
E	662	0	662	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	555	377	0	0	0	177	0
E	468	307	0	0	0	161	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	F-C	-9	100
B-C	-488 / 0	-91.8	-91.8 0.43 (1)	6.25	B-F	0	412
C-D	-488 / 0	-91.8	-91.8 0.43 (1)	6.25	F-D	0	412
G-B	-745 / 0	0	0 0.08 (1)	7.81			
E-D	-619 / 0	0	0 0.06 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.19 (4)	10.00			
F-E	0 / 0	-18.5	-18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.40")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.40")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.43/1.00 (C-D:1), BC=0.19/1.00 (F-G:4), WB=0.09/1.00 (B-F:1), SS=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.57 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)




Structural component only
DWG# T-2022140

JOB NAME 406445	TRUSS NAME T18	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:50 2021 Page 1
ID: aJLQU5bMioEiVDRZFnhbz9dRb-hHvXLCWjrcSAvn4TatgybXMMwCply9h1F6nup?qz8kwf

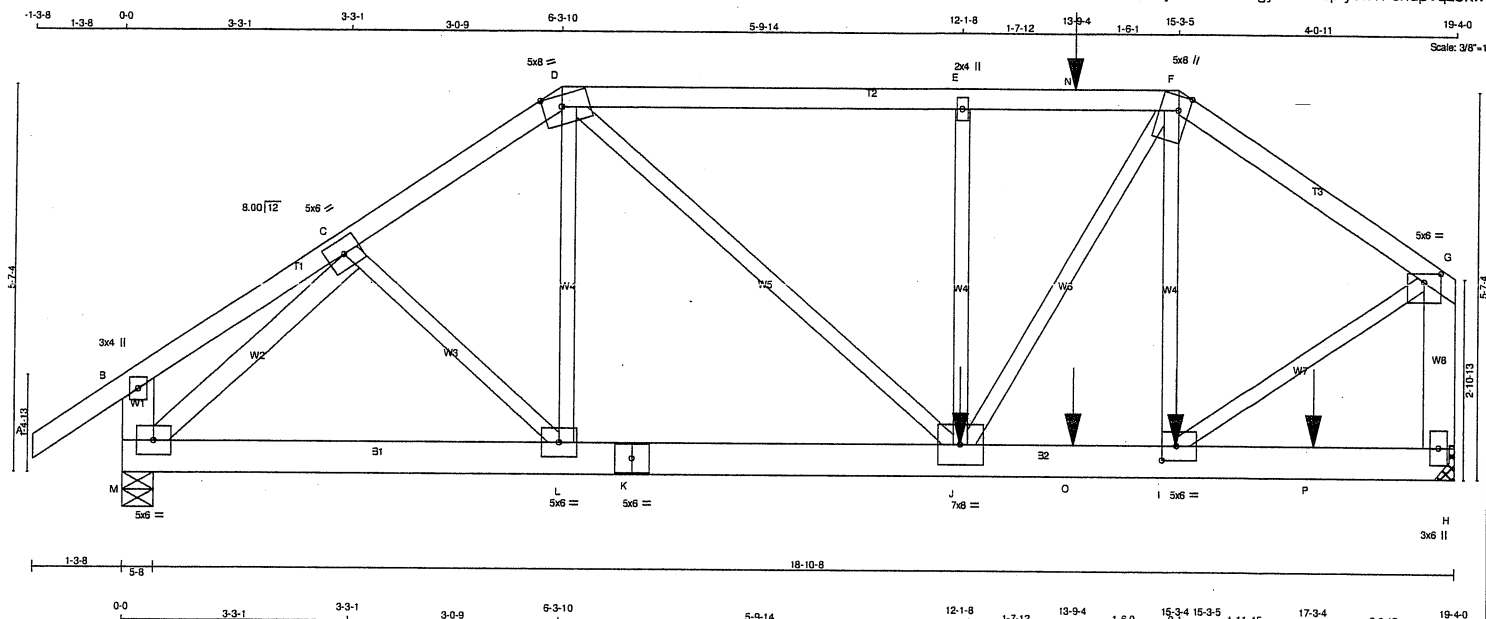

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
M - B	2x6	DRY	No.2	SPF	
H - G	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
K - H	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
M - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	5.0	4.0	
C	TTWW-t	MT20	5.0	6.0	
D	TTWW-m	MT20	5.0	8.0	2.00 3.25
E	TTWW-w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	8.0	Edge 1.75
G	TMVW-p	MT20	5.0	6.0	1.50 3.00
H	BMV1+p	MT20	3.0	6.0	
I	BMVW-t	MT20	5.0	6.0	2.50 2.50
J	BMVW-w	MT20	7.0	8.0	
K	BS-t	MT20	5.0	6.0	
L	BMVW-t	MT20	5.0	6.0	
M	BMVW-t	MT20	5.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
GROSS	REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	2593	0	2593	0	0	MECHANICAL	
M	1864	0	1864	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	1828	1231 / 0	0 / 0	0 / 0	0 / 0	597 / 0	0 / 0
M	1314	888 / 0	0 / 0	0 / 0	0 / 0	426 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.14 (1)	10.00	L-D	0 / 100	0.04 (4)	
B-C	0 / 16	-91.8 -91.8 0.14 (1)	10.00	D-J	0 / 1092	0.27 (1)	
C-D	-2063 / 0	-91.8 -91.8 0.21 (1)	4.50	J-E	-623 / 0	0.28 (1)	
D-E	-2514 / 0	-91.8 -91.8 0.65 (1)	3.63	J-F	0 / 1435	0.36 (1)	
E-N	-2514 / 0	-91.8 -91.8 0.55 (1)	3.63	I-F	-378 / 0	0.17 (1)	
N-F	-2514 / 0	-91.8 -91.8 0.55 (1)	3.63	I-G	0 / 2075	0.51 (1)	
F-G	-2142 / 0	-91.8 -91.8 0.39 (1)	4.22	C-L	0 / 131	0.03 (1)	
M-B	-241 / 0	0.0 0.0 0.02 (1)	7.81	M-C	-2251 / 0	0.49 (1)	
H-G	-2446 / 0	0.0 0.0 0.25 (1)	6.56				
M-L	0 / 1605	-18.5 -18.5 0.28 (1)	10.00				
L-K	0 / 1701	-18.5 -18.5 0.31 (1)	10.00				
K-J	0 / 1701	-18.5 -18.5 0.31 (1)	10.00				
J-O	0 / 1771	-18.5 -18.5 0.37 (1)	10.00				
O-I	0 / 1771	-18.5 -18.5 0.37 (1)	10.00				
I-P	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
P-H	0 / 0	-18.5 -18.5 0.19 (1)	10.00				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
I	15-3-4	-214	-214	---	BACK	VERT	TOTAL	---	C1
J	12-1-8	-968	-968	---	BACK	VERT	TOTAL	---	C1
N	13-9-4	-122	-122	---	BACK	VERT	TOTAL	---	C1
O	13-9-4	-29	-29	---	BACK	VERT	TOTAL	---	C1
P	17-3-4	-214	-214	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.64")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.06")
ALLOWABLE DEFL. (TL) = $L/360$ (0.64")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.11")

CSI: TC=0.65/1.00 (D-E:1), BC=0.37/1.00 (I-J:1), WB=0.51/1.00 (G-I:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (C) (INPUT = 0.90)
JSI METAL= 0.51 (C) (INPUT = 1.00)




Structural component only
DWG# T-2117966

Structural component only DWG# T-2117967			
---	--	--	--

JOB NAME 406445	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:52 2021 Page 1
ID: aJLQU5bMioEIVDRZFnhbz9dRb-df1HmtyzNDiu95EshljQgMR_Bd0ldgMYZ5Nw4iz8kwr

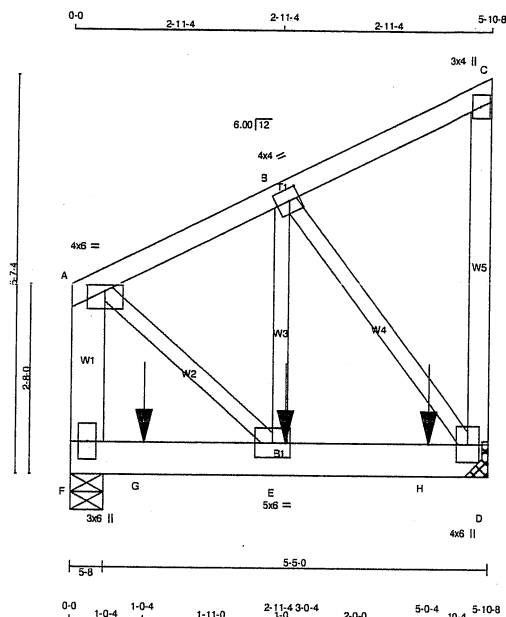

Scale = 1/32

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - A	2x6	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - D	12	TOP
F - A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMVW-p	MT20	4.0	6.0	1.00	3.00
B TMWW-t	MT20	4.0	4.0	2.00	1.75
C TMV-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION		INPUT BRG	REQD BRG
			DOWN	HORZ	IN-SX	IN-SX
D	1394	0	1394	0	MECHANICAL	
F	1680	0	1680	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS				
		1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND
D	983	660 / 0	0 / 0	0 / 0	0 / 0	323 / 0
F	1185	794 / 0	0 / 0	0 / 0	0 / 0	391 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-776 / 0	-91.8 -91.8	0.07 (1)	E-B	0 / 924	0.11 (1)	
B-C	-13 / 0	-91.8 -91.8	0.06 (1)	B-D	-1142 / 0	0.20 (1)	
D-C	-106 / 0	0.0 0.0	0.03 (1)	A-E	0 / 892	0.11 (1)	
F-A	-1005 / 0	0.0 0.0	0.05 (1)				
F-G	0 / 0	-18.5 -18.5	0.25 (1)				
G-E	0 / 0	-18.5 -18.5	0.25 (1)				
E-H	0 / 705	-18.5 -18.5	0.17 (1)				
H-D	0 / 705	-18.5 -18.5	0.17 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-4	-453	-453	---	FRONT	VERT	TOTAL	---	C1
G	1-0-4	-803	-803	---	FRONT	VERT	TOTAL	---	C1
H	5-0-4	-454	-454	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 36 = 73 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.07/1.00 (A-B:1), BC=0.25/1.00 (E-F:1), WB=0.20/1.00 (B-D:1), SSI=0.22/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.60 (B) (INPUT = 0.90)

JSI METAL = 0.16 (D) (INPUT = 1.00)



Structural component only
DWG# T-2117968

CONTINUED ON PAGE 2

JOB NAME 406445	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---	----------

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:52 2021 Page 2
ID:eJLQU5bMioEiViDRZFnhbz9dRb-df1HmtyzNDiu95EshIjQgMR Bd0ldgMYZ5Nw4iz8kwr

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW-t	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		



Structural component only
DWG# T-2117968 *2/6*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406445	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington



LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
U - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
U - Q	2x6	DRY	No.2
Q - M	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - C	12	SIDE(61.0)
H - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
U - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - U	12	SIDE(0.0)
Q - M	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	GROSS REACTION	MAXIMUM FACTORED	GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
M	3012	0	3012	0	5-8
U	3012	0	3012	0	5-8

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED					
M	2129	1402.0	0.0	0.0	728.0	0.0
U	2129	1402.0	0.0	0.0	727.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, U

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.73 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	MAX. FACTORED	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO		
A-B	0.35	-91.8	-91.8 0.07 (1)	10.00	T-C	-547.0
B-C	-3495.0	-91.8	-91.8 0.20 (1)	4.83	N-J	-547.0
C-V	-4686.0	-91.8	-91.8 0.25 (1)	4.24	B-T	0.2986
V-W	-4686.0	-91.8	-91.8 0.25 (1)	4.24	N-K	0.2986
W-D	-4686.0	-91.8	-91.8 0.25 (1)	4.24	P-G	-958.0
D-X	-5728.0	-91.8	-91.8 0.29 (1)	3.84	R-E	-960.0
X-Y	-5728.0	-91.8	-91.8 0.29 (1)	3.84	D-R	0.1481
Y-E	-5728.0	-91.8	-91.8 0.29 (1)	3.84	C-S	0.2516
E-Z	-6170.0	-91.8	-91.8 0.29 (1)	3.73	S-D	-1650.0
Z-AA	-6170.0	-91.8	-91.8 0.29 (1)	3.73	O-J	0.2517
AA-F	-6170.0	-91.8	-91.8 0.29 (1)	3.73	P-I	0.1479
F-AB	-6170.0	-91.8	-91.8 0.29 (1)	3.73	O-I	-1651.0
AB-AC	-6170.0	-91.8	-91.8 0.29 (1)	3.73	Q-F	-655.0
AC-G	-6170.0	-91.8	-91.8 0.29 (1)	3.73	E-Q	0.607
G-H	-5728.0	-91.8	-91.8 0.29 (1)	3.84	Q-G	0.607
H-AD	-5728.0	-91.8	-91.8 0.29 (1)	3.84		
AD-I	-5728.0	-91.8	-91.8 0.29 (1)	3.84		
I-AE	-4688.0	-91.8	-91.8 0.25 (1)	4.23		
AE-AF	-4688.0	-91.8	-91.8 0.25 (1)	4.23		
AF-J	-4688.0	-91.8	-91.8 0.25 (1)	4.23		
J-K	-3496.0	-91.8	-91.8 0.20 (1)	4.83		
K-L	0.35	-91.8	-91.8 0.07 (1)	10.00		
U-B	-2954.0	0.0	0.0 0.11 (1)	7.81		
M-K	-2955.0	0.0	0.0 0.11 (1)	7.81		
U-AG	0.0	-18.5	-18.5 0.03 (4)	10.00		
AG-AH	0.0	-18.5	-18.5 0.03 (4)	10.00		
AH-T	0.0	-18.5	-18.5 0.03 (4)	10.00		
T-AI	0.2888	-18.5	-18.5 0.21 (1)	10.00		
AI-AJ	0.2888	-18.5	-18.5 0.21 (1)	10.00		
AJ-S	0.2888	-18.5	-18.5 0.21 (1)	10.00		
S-AK	0.4686	-18.5	-18.5 0.34 (1)	10.00		
AK-AL	0.4686	-18.5	-18.5 0.34 (1)	10.00		
AL-R	0.4686	-18.5	-18.5 0.34 (1)	10.00		
R-AM	0.5728	-18.5	-18.5 0.41 (1)	10.00		
AM-AN	0.5728	-18.5	-18.5 0.41 (1)	10.00		
AN-Q	0.5728	-18.5	-18.5 0.41 (1)	10.00		
Q-AO	0.5728	-18.5	-18.5 0.41 (1)	10.00		
AO-AP	0.5728	-18.5	-18.5 0.41 (1)	10.00		
AP-P	0.5728	-18.5	-18.5 0.41 (1)	10.00		
P-AQ	0.4688	-18.5	-18.5 0.34 (1)	10.00		
AQ-AR	0.4688	-18.5	-18.5 0.34 (1)	10.00		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")

CALCULATED VERT. DEFL.(LL) = L/999 (0.15")

ALLOWABLE DEFL.(TL) = L/360 (1.03")

CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.29/1.00 (F-G:1), BC=0.41/1.00 (Q-R:1), WB=0.37 1.00 (K-N:1), SSI=0.15/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.55 (T) (INPUT = 0.90)

JSI METAL= 0.40 (Q) (INPUT = 1.00)



Structural component only

DWG# T-2022144

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406445	T21	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:39:48 2020 Page 2
ID:pXBepelFV7RX?2FLKzMhgevOWXJ-RGq3dLZEg5cPir I8ykGsG3bGEhg4frG6lzGDwTYbP

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	5.0	6.0		
E	TMWW-t	MT20	4.0	6.0		
F	TMW+w	MT20	2.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TS-t	MT20	3.0	8.0		
I	TMWW-t	MT20	5.0	6.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	5.0	6.0	2.50	2.00
P	BMWW-t	MT20	5.0	8.0	4.25	2.50
Q	BSWWW-l	MT20	8.0	12.0	5.00	6.00
R	BMWW-t	MT20	5.0	8.0	4.25	2.50
S	BMWW-t	MT20	5.0	6.0	2.50	2.00
T	BMWW-t	MT20	5.0	6.0	2.50	2.00
U	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO					
AR-O	0 / 4688	-18.5	-18.5	0.34 (1)	10.00		
O-AS	0 / 2889	-18.5	-18.5	0.21 (1)	10.00		
AS-AT	0 / 2889	-18.5	-18.5	0.21 (1)	10.00		
AT-N	0 / 2889	-18.5	-18.5	0.21 (1)	10.00		
N-AU	0 / 0	-18.5	-18.5	0.03 (4)	10.00		
AU-AV	0 / 0	-18.5	-18.5	0.03 (4)	10.00		
AV-M	0 / 0	-18.5	-18.5	0.03 (4)	10.00		

SPECIFIED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-40	-40	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-169	-169	---	FRONT	VERT	SNOW	---	C1
H	19-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
J	26-11-5	-40	-40	---	FRONT	VERT	DEAD	---	C1
J	26-11-5	-169	-169	---	FRONT	VERT	SNOW	---	C1
V	5-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
W	7-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
X	9-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Y	11-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
Z	13-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AA	15-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AC	17-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AF	25-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
AG	1-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AH	3-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AI	5-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AJ	7-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AK	9-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AL	11-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AM	13-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AN	15-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AO	15-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AP	17-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AQ	19-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AR	21-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AS	23-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AT	25-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AU	27-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
AV	29-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2022144 7/2

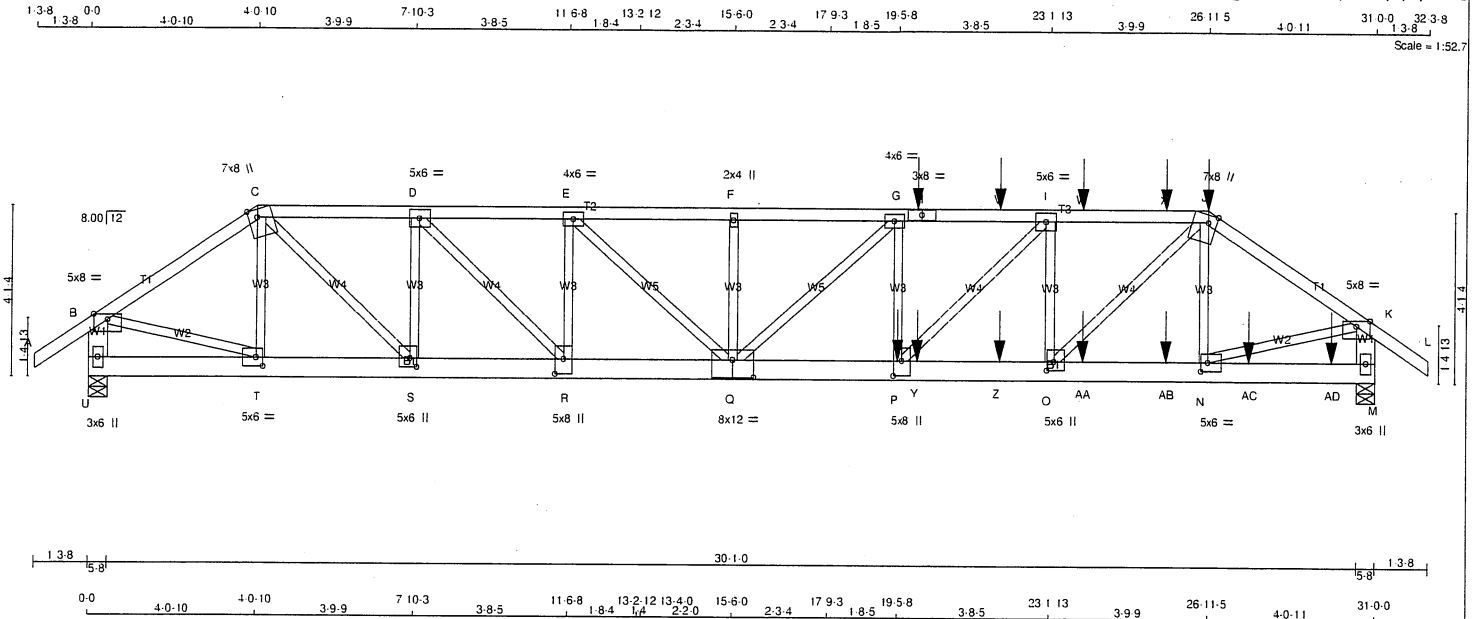

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
U - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
U - Q	2x6	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT
SEPARATELY THEN FASTENED TOGETHER AS
FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A-C	1	12	TOP
H-C	1	12	SIDE(0.0)
H-J	1	12	SIDE(61.0)
J-L	1	12	SIDE(61.0)
U-B	2	12	TOP
M-K	2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
Q-U	2	12	TOP
Q-M	2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	6	
G-P	1	3	SIDE(659.3)
E-R	1	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	4583	0	4583	0	0	5-8	5-8
U	3223	0	3223	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	3232	2170 / 0	0 / 0	0 / 0	0 / 0	1063 / 0	0 / 0
U	2273	1528 / 0	0 / 0	0 / 0	0 / 0	745 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, U

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MAX. FACTORED		FACTORED			MAX. FACTORED		W E B S		
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX.	FORCE	MAX
	(LBS)	(PLF)	CSI	(LC)	UNBRAC			(LBS)	CSI (LC)
FR-TO		FROM	TO		LENGTH	FR-TO			
A-B	0 35	-91.8	-91.8	0.07	1	10.00	T-C	-661 0	0.08 (1)
B-C	-3808 0	-91.8	-91.8	0.21	1	4.66	N-J	-968 0	0.12 (1)
C-D	-5625 0	-91.8	-91.8	0.22	1	3.96	B-T	0 3252	0.40 (1)
D-E	-7606 0	-91.8	-91.8	0.32	1	3.37	N-K	0 -4760	0.59 (1)
E-F	-9342 0	-91.8	-91.8	0.44	1	2.96	P-G	0 634	0.08 (1)
F-G	-9342 0	-91.8	-91.8	0.44	1	2.95	R-E	-1976 0	0.25 (1)
G-H	-10486 0	-91.8	-91.8	0.59	1	2.61	D-C	0 2815	0.35 (1)
H-V	-10486 0	-91.8	-91.8	0.59	1	2.61	S-D	0 -3471	0.43 (1)
V-I	-10486 0	-91.8	-91.8	0.59	1	2.61	C-S	-2360 0	0.30 (1)
I-W	-7993 0	-91.8	-91.8	0.41	1	3.19	O-J	0 4746	0.59 (1)
W-X	-7993 0	-91.8	-91.8	0.41	1	3.19	P-I	0 3543	0.44 (1)
X-J	-7993 0	-91.8	-91.8	0.41	1	3.19	O-I	-3123 0	0.40 (1)
J-K	-5572 0	-91.8	-91.8	0.29	1	3.91	Q-F	-368 0	0.05 (1)
K-L	0 35	-91.8	-91.8	0.07	1	10.00	E-Q	0 2386	0.30 (1)
U-B	-3190 0	0 0	0 0	0.11	1	7.74	Q-G	-1572 0	0.39 (1)
M-K	-4524 0	0 0	0 0	0.16	1	6.77			

U-T	0 0	-18.5	-18.5	0.02 (4)	10.00
T-S	0 3144	-18.5	-18.5	0.22 (1)	10.00
S-R	0 5625	-18.5	-18.5	0.11 (1)	10.00
R-Q	0 7606	-18.5	-18.5	0.54 (1)	10.00
Q-P	0 10486	-18.5	-18.5	0.81 (1)	10.00
P-Y	0 7993	-18.5	-18.5	0.65 (1)	10.00
Y-Z	0 7993	-18.5	-18.5	0.65 (1)	10.00
Z-O	0 7993	-18.5	-18.5	0.65 (1)	10.00
AA-AB	0 4602	-18.5	-18.5	0.32 (1)	10.00
AA-AA	0 4602	-18.5	-18.5	0.32 (1)	10.00
AB-N	0 4602	-18.5	-18.5	0.32 (1)	10.00
N-AC	0 0	-18.5	-18.5	0.03 (4)	10.00
AC-AD	0 0	-18.5	-18.5	0.03 (4)	10.00
AD-M	0 0	-18.5	-18.5	0.03 (4)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	19-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
J	26-11-5	-40	-40	---	FRONT	VERT	DEAD	---	C1
P	26-11-5	-171	-171	---	FRONT	VERT	SNOW	---	C1
P	19-5-8	-2273	-2273	---	BACK	VERT	TOTAL	---	C1
W	21-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
V	23-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
X	25-11-4	-76	-76	---	BACK	VERT	TOTAL	---	C1
Y	19-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED
BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP	CH.	LL =	25.6	PSF
		DL =	6.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL
LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF PART
9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.23")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/ 873 (0.43")

CSI: TC=0.59/1.00 (G-I:1) , BC=0.81/1.00 (P-Q:1) .
WB=0.59/1.00 (K-N:1) , SSI=0.15/1.00 (J-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (O) (INPUT = 0.90)
JSI METAL= 0.73 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2022145 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406445	T21Z	1	2	TRUSS DESC.		

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	5.0	6.0		
E	TMWW-t	MT20	4.0	6.0		
F	TMW-w	MT20	2.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TS-t	MT20	3.0	8.0		
I	TMWW-t	MT20	5.0	6.0		
J	TTWW-m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	5.0	6.0	2.50	2.00
P	BMWW-t	MT20	5.0	8.0	4.25	2.50
Q	BSWWW-l	MT20	8.0	12.0	5.00	6.00
R	BMWW-t	MT20	5.0	8.0	4.25	2.50
S	BMWW-t	MT20	5.0	6.0	2.50	2.00
T	BMWW-t	MT20	5.0	6.0	2.50	2.00
U	BMV1+p	MT20	3.0	6.0		


SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Z	21-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AA	23-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AB	25-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AC	27-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
AD	29-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

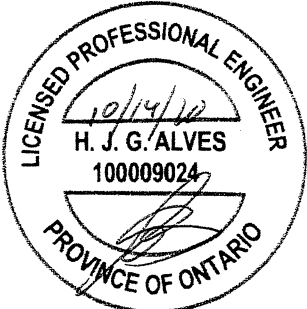

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
413423	T25	1	1	TRUSS DESC.		

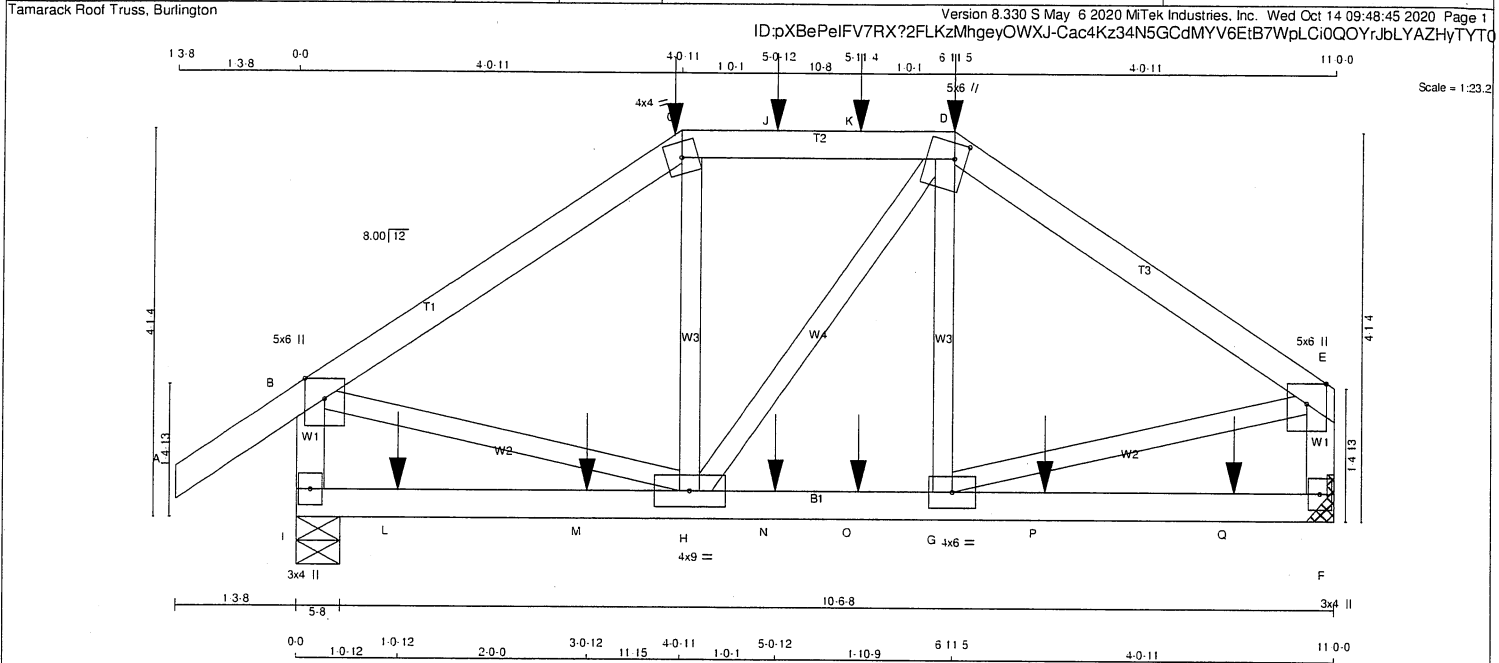

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2 SPF
C - D	2x4	DRY	No.2 SPF
D - E	2x4	DRY	No.2 SPF
I - B	2x4	DRY	No.2 SPF
F - E	2x4	DRY	No.2 SPF
I - F	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	6.0	Edge
C	TTW-m	MT20	4.0	4.0	
D	TTWW+m	MT20	5.0	6.0	2.00 1.50
E	TMVW+p	MT20	5.0	6.0	Edge
F	BMV1+p	MT20	3.0	4.0	
G	BMVW-t	MT20	4.0	6.0	
H	BMVWW-t	MT20	4.0	9.0	
I	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
I	1228	0	1228	0	0	5-8	5-8
F	1103	0	1103	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	866	584 / 0	0 / 0	0 / 0	0 / 0	282 0	0 / 0
F	779	514 / 0	0 / 0	0 / 0	0 / 0	265 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO	CSI (LC)	FR-TO			
A-B	0 / 35	-91.8 -91.8	0.14 (1)	10.00	H-C	-113 65	0.03 (1)
B-C	-1118.0	-91.8 -91.8	0.32 (1)	5.56	H-D	0 3	0.00 (4)
C-J	-923.0	-91.8 -91.8	0.33 (1)	5.94	G-D	-116 62	0.03 (1)
J-K	-923.0	-91.8 -91.8	0.33 (1)	5.94	B-H	0 958	0.24 (1)
K-D	-923.0	-91.8 -91.8	0.33 (1)	5.94	G-E	0 956	0.24 (1)
D-E	-1114.0	-91.8 -91.8	0.32 (1)	5.57			
I-B	-1172.0	0.0 0.0	0.13 (1)	7.33			
F-E	-1047.0	0.0 0.0	0.12 (1)	7.65			
I-L	0.0	-18.5 -18.5	0.13 (4)	10.00			
L-M	0.0	-18.5 -18.5	0.13 (4)	10.00			
M-H	0.0	-18.5 -18.5	0.13 (4)	10.00			
H-N	0.923	-18.5 -18.5	0.22 (1)	10.00			
N-O	0.923	-18.5 -18.5	0.22 (1)	10.00			
O-G	0.923	-18.5 -18.5	0.22 (1)	10.00			
G-P	0.0	-18.5 -18.5	0.13 (4)	10.00			
P-Q	0.0	-18.5 -18.5	0.13 (4)	10.00			
Q-F	0.0	-18.5 -18.5	0.13 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-40	-40	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-171	-171	---	FRONT	VERT	SNOW	---	C1
D	6-11-5	-40	-40	---	FRONT	VERT	DEAD	---	C1
D	6-11-5	-171	-171	---	FRONT	VERT	SNOW	---	C1
J	5-0-12	-76	-76	---	FRONT	VERT	TOTAL	---	C1
K	5-11-4	-76	-76	---	FRONT	VERT	TOTAL	---	C1
L	1-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
M	3-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
N	5-0-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
O	5-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
P	7-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
Q	9-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.33/1.00 (C-D:1), BC=0.22/1.00 (G-H:1), WB=0.24/1.00 (B-H:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (G) (INPUT = 0.90)
JSI METAL= 0.47 (B) (INPUT = 1.00)


Structural component only
DWG# T-2022149



Structural component only
DWG# T-2022149

JOB NAME 406445	TRUSS NAME T51	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:53 2021 Page 1
ID:pXBePelFV7RX?2FLKzHhgeyOWXJ-5sbf_Dzb8XqlmFp2F?EfDZ_991L3M68ho17Tc8z8kw

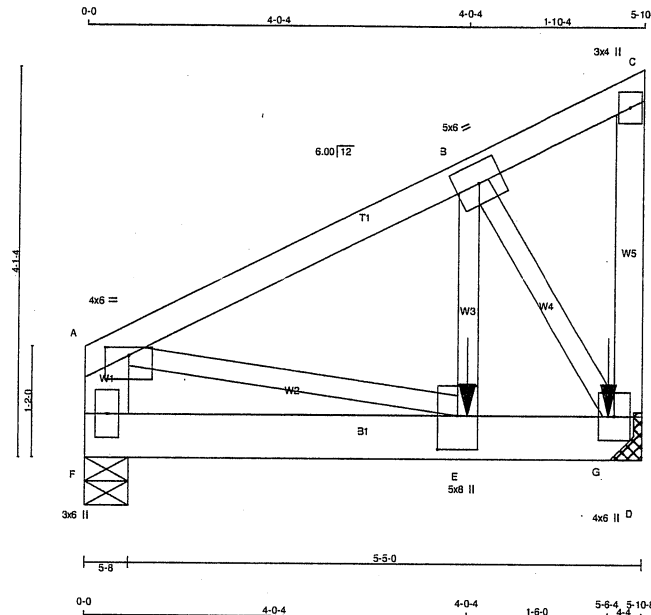

Scale = 1:23.1

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - A	2x6	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	10	SIDE(152.7)
F - A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
E - B 1	2	SIDE(488.6)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.00
B	TMVW-t	MT20	5.0	6.0		
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	3076	0	3076	0	0
F	1200	0	1200	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	2169	1458 / 0	0 / 0	0 / 0	0 / 0	711 / 0	0 / 0
F	846	569 / 0	0 / 0	0 / 0	0 / 0	277 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	-1525 / 0	-91.8	-91.8 0.12 (1)	A-E	0 / 1400
B-C	-24 / 0	-91.8	-91.8 0.07 (1)	E-B	0 / 2403
D-C	-31 / 0	0.0	0.0 0.00 (1)	B-D	-2480 / 0
F-A	-1112 / 0	0.0	0.0 0.04 (1)		
F-E	0 / 0	-18.5	-18.5 0.08 (1)		
E-G	0 / 1374	-18.5	-18.5 0.22 (1)		
G-D	0 / 1374	-18.5	-18.5 0.22 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	4-0-4	-1813	-1813	---	FRONT	VERT	TOTAL	---	C1
G	5-6-4	-744	-744	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 30 = 60 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (D-E:1), WB=0.30/1.00 (B-E:1), SSI=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (B) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)



Structural component only
DWG# T-2117969

CONTINUED ON PAGE 2

JOB NAME 406445	TRUSS NAME T51	QUANTITY 1	PLY 2	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:53 2021 Page 2
ID:pXBePelFV7RX?2FLKzMhgeyOWXJ-5sbf Dzb8XqlmFp2F?EfDZ 991L3M68hoI7Tc8z8kwo

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
E	BMWw+t	MT20	5.0	8.0	4.25	2.50
F	BMV1+p	MT20	3.0	6.0		




Structural component only
DWG# T-2117969

JOB NAME 406506	TRUSS NAME PB1	QUANTITY 3	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:05 2020 Page 1
ID: pXBepelFV7RX?2FLKzMhgeyOWXJ-8FR0Qh_qkGzOlqBdB?F86GiyvVFEpLuq6OYQ8lyTZ1G

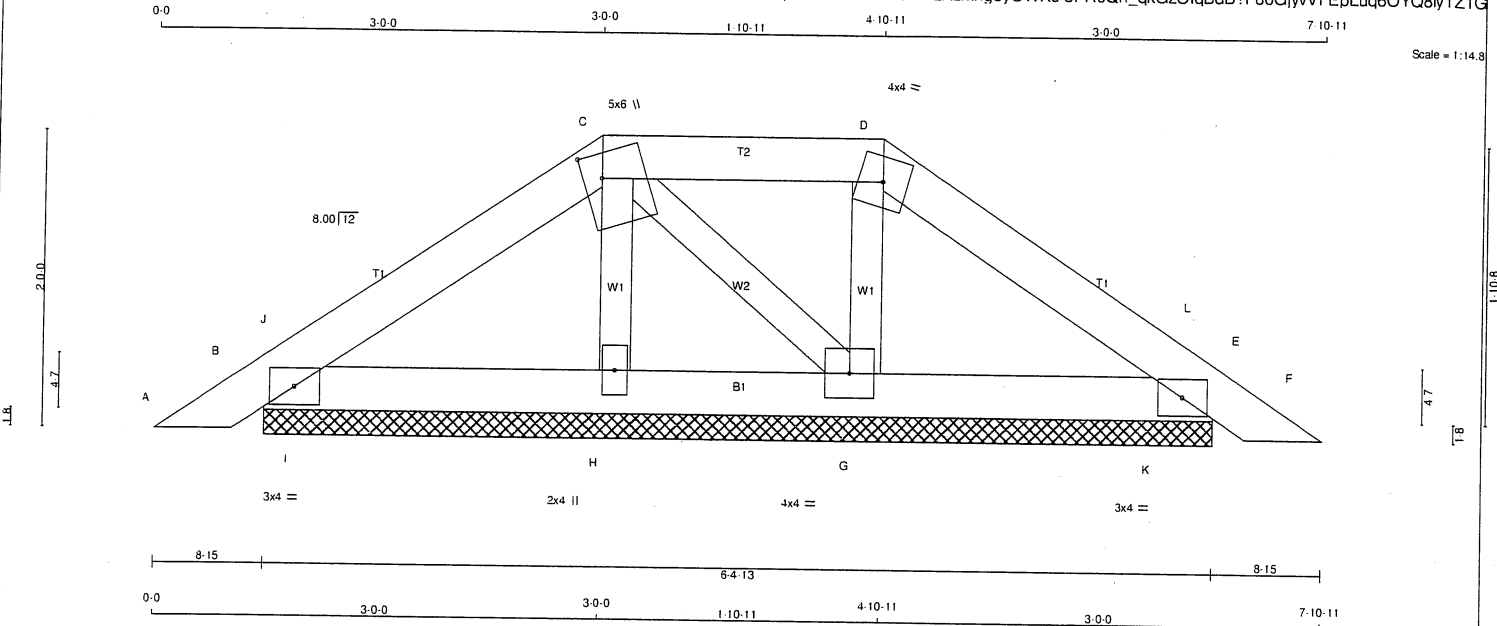

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 3 X 21 = 64 lb			
CHORDS	SIZE	LUMBER	DESCR.	SPECIFIED LOADS:			
A - C	2x4	DRY	No.2	TOP CH.	LL =	25.6	PSF
C - D	2x4	DRY	No.2		DL =	6.0	PSF
D - F	2x4	DRY	No.2	BOT CH.	LL =	0.0	PSF
B - E	2x4	DRY	No.2		DL =	7.4	PSF
ALL WEBS	2x3	DRY	No.2	TOTAL LOAD	=	39.0	PSF
DRY: SEASONED LUMBER.				SPACING = 24.0 IN. C/C			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-i	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	6.0	2.00 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMB1-i	MT20	3.0	4.0	
G	BMWV1-i	MT20	4.0	4.0	
H	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
		FACTORED		MAXIMUM FACTORED		INPUT	REQRD
JT	COMBINED	GROSS REACTION		GROSS REACTION		BRG	BRG
B		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E		219	0	219	0	6-4-13	6-4-13
H		205	0	205	0	6-4-13	6-4-13
G		176	0	176	0	6-4-13	6-4-13
		227	0	227	0	6-4-13	6-4-13

UNFACTORED REACTIONS							
JT	1ST LCASE			MAX. MIN. COMPONENT REACTIONS			
B		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E		153	111	0	0	43	0
H		144	103	0	0	41	0
G		125	77	0	0	49	0
		161	105	0	0	56	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING				CHORDS				WEBS			
TOTAL LOAD CASES: (4)				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
				A-B	0 : 15	-91.8	-91.8 0.03 (1)	H-C	-116 : 0	10.00	0.02 (1)
				B-J	-60 : 0	-91.8	-91.8 0.01 (1)	C-G	-29 : 0	6.25	0.00 (1)
				J-C	-70 : 0	-91.8	-91.8 0.06 (1)	G-D	-148 : 0	6.25	0.02 (1)
				C-D	-27 : 0	-91.8	-91.8 0.06 (1)	I-J	-119 : 0	6.25	0.00 (1)
				D-L	-47 : 0	-91.8	-91.8 0.06 (1)	K-L	-121 : 0	6.25	0.00 (1)
				L-E	-35 : 0	-91.8	-91.8 0.01 (1)				
				E-F	0 : 15	-91.8	-91.8 0.03 (1)				
				B-I	0 : 57	-18.5	-18.5 0.06 (1)				
				I-H	0 : 57	-18.5	-18.5 0.06 (1)				
				H-G	0 : 49	-18.5	-18.5 0.03 (1)				
				G-K	0 : 37	-18.5	-18.5 0.05 (1)				
				K-E	0 : 37	-18.5	-18.5 0.05 (1)				

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.06/1.00 (C-D:1), BC=0.06/1.00 (B-I:1), WB=0.02/1.00 (D-G:1), SS=0.09/1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)




Structural component only
DWG# T-2022112

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	J1	20	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:04 2020 Page 1
ID:pXBePelFV7RX?2FLKzMhgeyOWXJ-g3teCLzCzzrXggcQeHkvZ3Bfb5tr4uzgikpscljTZ1H

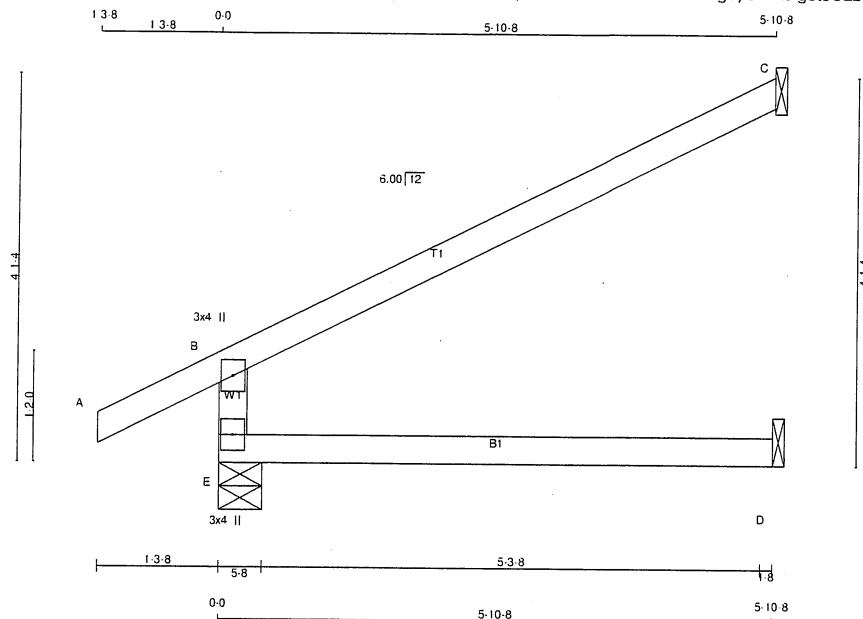

Scale = 1:23.3

TOTAL WEIGHT = 20 X 17 = 336 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	525	0	5-8	5-8
C	202	0	1-8	1-8
D	45	0	5-8	5-8

SEE MITTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
E	369	257 0 0 0 0 0 0 0
C	139	113 0 0 0 0 0 0 0
D	36	0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
E-B	-461	0	0.0	0.0	0.13 (4)	7.81			
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-30	0	-91.8	-91.8	0.54 (1)	6.25			
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)


JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2022111

JOB NAME 406445	TRUSS NAME J11	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:47 2021 Page 1
ID:aJLQU5bMioEiVIDRZFnhbz9dRb-HiEOjAuqYh4b2KLvuk7Fzlk13cJ6ySlpQgg9PVz8kww

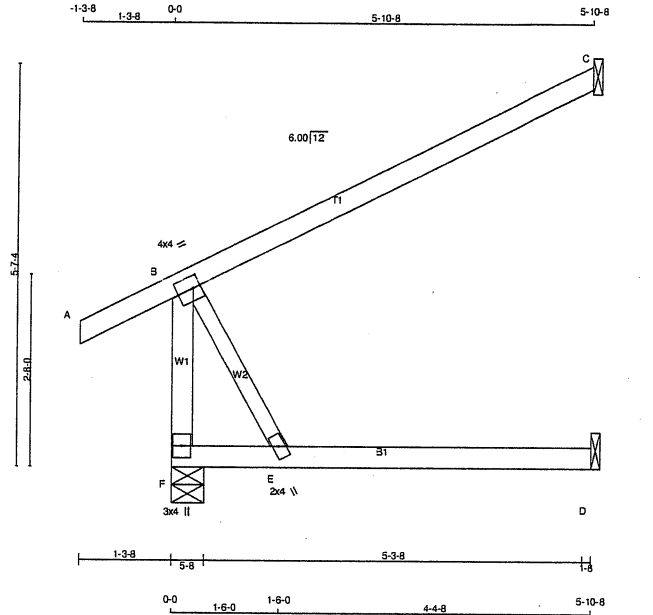

Scale = 1:30.6

TOTAL WEIGHT = 21 lb

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	2.00 1.25
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
GROSS REACTION		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	448	0	448	0	5-8
C	270	0	270	0	1-8
D	54	0	51	0	1-8

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	315	220 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
C	186	150 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	MAX. UNBRAC LENGTH
FR-TO		FROM	TO			FR-TO			
F-B	-394 / 0	0.0	0.0	0.05 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	0 / 0	-91.8	-91.8	0.54 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117963

JOB NAME 406445	TRUSS NAME J12	QUANTITY 6	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:39:39 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-CXdgkGSbyKTg7SoZ749?NC3XchJTfOx2OHIOwyTYbY

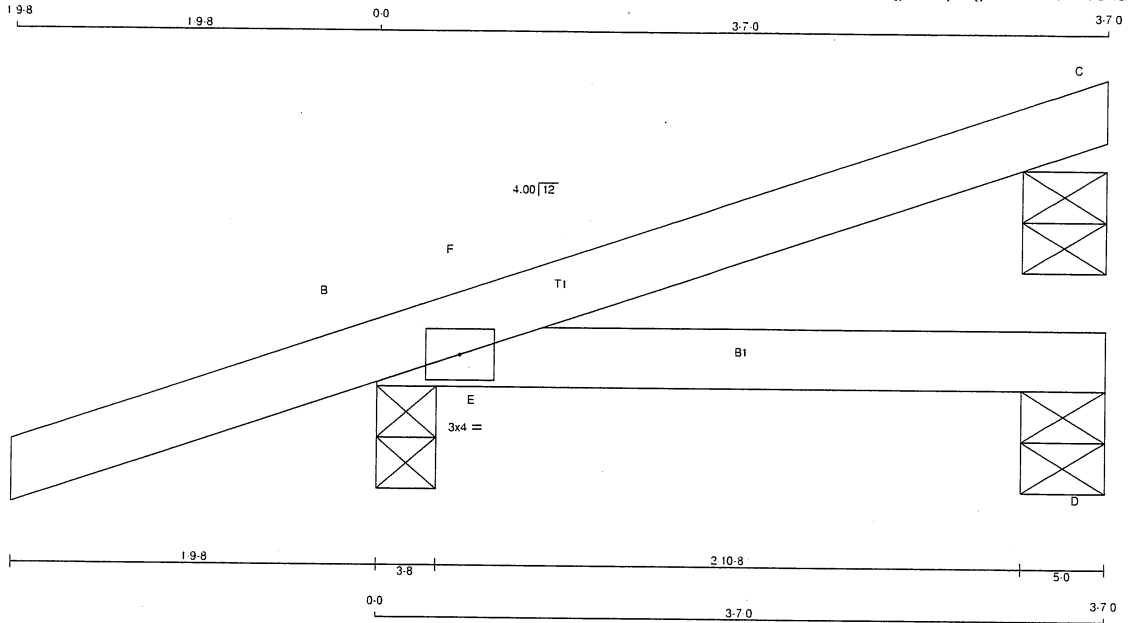

TOTAL WEIGHT = 6 X 11 = 64 lb [M]

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
C	141	0	141	0
B	366	0	366	0
D	57	0	57	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	98	76.0	0.0	0.0	0.0	22.0	0.0
B	256	186.0	0.0	0.0	0.0	70.0	0.0
D	42	16.0	0.0	0.0	0.0	26.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH FR-TO	MAX. FACTORED LC1 MAX (LC)
A-B	0.26	-91.8	-91.8 0.23 (5)	10.00	E-F	-138.5	0.00 (1)
B-F	-10.0	-91.8	-91.8 0.04 (4)	6.25			
F-C	0.2	-91.8	-91.8 0.15 (1)	10.00			
B-E	0.0	-18.5	-18.5 0.12 (1)	10.00			
E-D	0.0	-18.5	-18.5 0.12 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

CSI: TC=0.23/1.00 (A-B-5), BC=0.12/1.00 (B-E-1), WB=0.00/1.00 (E-F-1), SS=0.13/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2022134

JOB NAME 406445	TRUSS NAME J13	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:48 2021 Page 1
ID: aJLQU5bMioEIViDRZFnhbz9dRb-luomwWvTJ_CSGtW5SSeUWWGle0hIhuDyeUPixx28kww

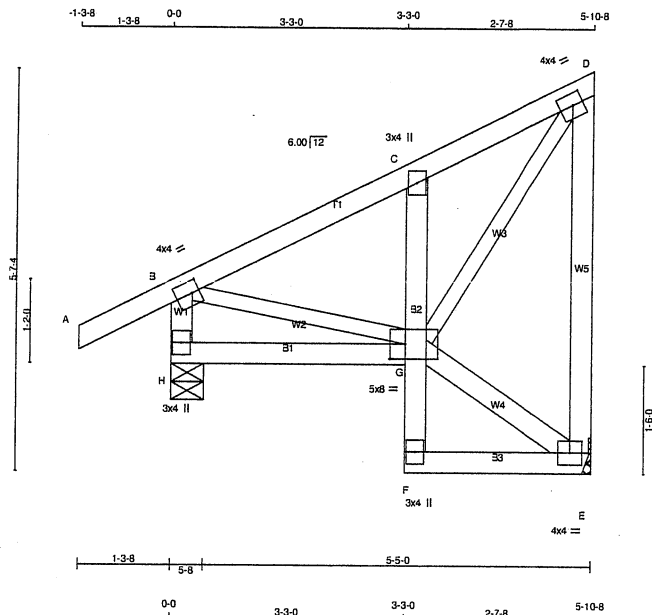

TOTAL WEIGHT = 35 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
H - B	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
F - C	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TMV+p	MT20	3.0	4.0		
D	TMVW-t	MT20	4.0	4.0	2.00	1.75
E	BMVW1-t	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMVWV-t	MT20	5.0	8.0	2.50	2.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
H	448	0	448	0	0	5-8			
E	324	0	324	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	315	220 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
E	229	150 / 0	0 / 0	0 / 0	0 / 0	79 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO			FR-TO			
H-B	-417 / 0	0.0	0.0	0.04 (1)	7.81	B-G	0 / 230	0.05 (1)	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	G-E	-11 / 0	0.00 (1)	
B-C	-237 / 0	-91.8	-91.8	0.13 (1)	6.25	G-D	0 / 381	0.09 (1)	
C-D	-249 / 0	-91.8	-91.8	0.13 (1)	6.25				
E-D	-295 / 0	0.0	0.0	0.16 (1)	7.81				
H-G	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
F-G	0 / 26	0.0	0.0	0.02 (1)	10.00				
G-C	-327 / 0	0.0	0.0	0.02 (1)	7.81				
F-E	0 / 10	-18.5	-18.5	0.03 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.16/1.00 (D-E:1) , BC=0.06/1.00 (G-H:4) ,
WB=0.09/1.00 (D-G:1) , SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.40 (G) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117964

JOB NAME 406445	TRUSS NAME J14	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.420 S Jan 21 2021 MiTek Industries, Inc. Mon Jun 7 08:27:49 2021 Page 1
ID: aJLQU5bMioEIViDRZFnbz9dRb-D4M98sv54IKJdVH099j3pTMQ1XQMw5t89GTNz8kwu

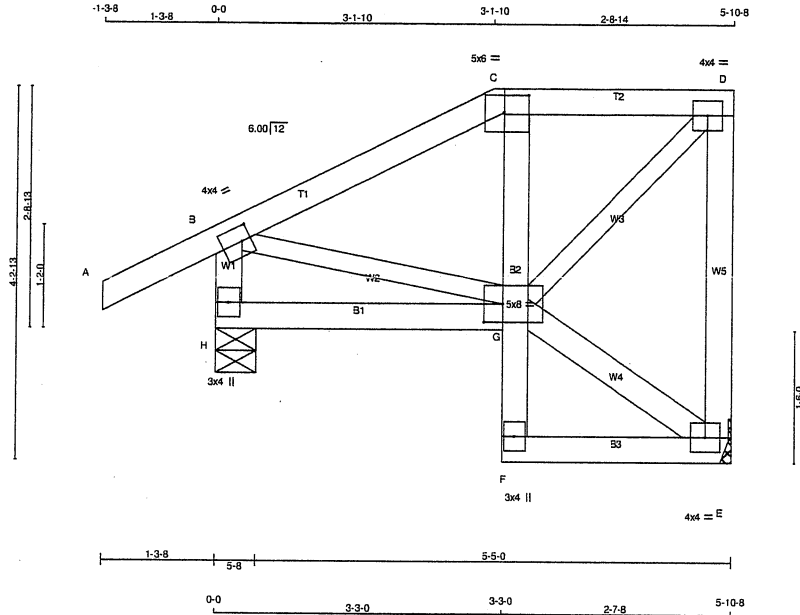

TOTAL WEIGHT = 33 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
H - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
F - C	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
G - E	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTV-m	MT20	5.0	6.0	2.25	3.50
D	TMVW-t	MT20	4.0	4.0		
E	BMVW1-t	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMVWV-t	MT20	5.0	8.0	2.50	2.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
H	448	0	448	0	5-8	5-8
E	324	0	324	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	COMBINED	220 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
E		150 / 0	0 / 0	0 / 0	0 / 0	79 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-417 / 0	0.0	0.0 0.04 (1)	B-G	0 / 198	0.04 (1)	
A-B	0 / 28	-91.8	-91.8 0.12 (1)	G-E	-6 / 0	0.00 (1)	
B-C	-214 / 0	-91.8	-91.8 0.17 (1)	G-D	0 / 251	0.06 (1)	
C-D	-179 / 0	-91.8	-91.8 0.11 (1)				
E-D	-298 / 0	0.0	0.0 0.08 (1)				
H-G	0 / 0	-18.5	-18.5 0.06 (4)				
F-G	0 / 26	0.0	0.0 0.01 (1)				
G-C	-174 / 0	0.0	0.0 0.01 (1)				
F-E	0 / 5	-18.5	-18.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.17/1.00 (B-C:1), BC=0.06/1.00 (G-H:4), WB=0.06/1.00 (D-G:1), SS=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.32 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2117965


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	C1	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MITek Industries, Inc. Wed Oct 14 09:10:01 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-FUBWajJg2TypDtry9ACxQZFrutrtXDEBmaC?_yTZ1K

1-3-8 1-3-8 0-0 1-10-15 1-10-15 2-0-0

Scale = 1:16.5

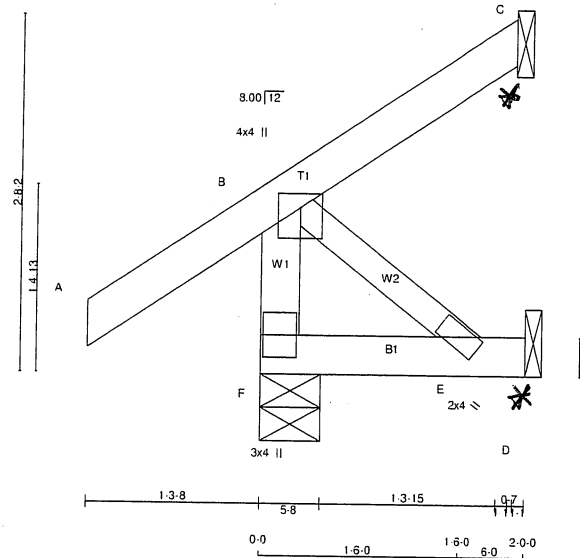

TOTAL WEIGHT = 9 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	277	0	0	5-8
C	42	0	42	1-8
D	18	0	21	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	193	144.0	0.0	0.0	0.0	0.0	49.0	0.0
C	29	24.25	0.0	0.0	0.0	0.0	6.0	0.0
D	15	0.0	0.0	0.0	0.0	0.0	15.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
F-B		-259.0	0.0	0.0	0.03 (1)	B-E		0.0	0.00 (1)
A-B		0.35	-91.8	-91.8	0.12 (1)				
B-C		-25.0	-91.8	-91.8	0.12 (1)				
F-E		0.0	-18.5	-18.5	0.02 (4)				
E-D		0.0	-18.5	-18.5	0.02 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	(PSI)	(PLI)	(PLI)	SECTION
MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)

JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2022107

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	C2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 Mitek Industries, Inc. Wed Oct 14 09:10:02 2020 Page 1
ID:pXBePelFV7RX?2FLKzMHgeyOWXJ-igIunfyxRLbpRNS2WsiRu5OoHD4c_TOQQKIXQyTZ1J

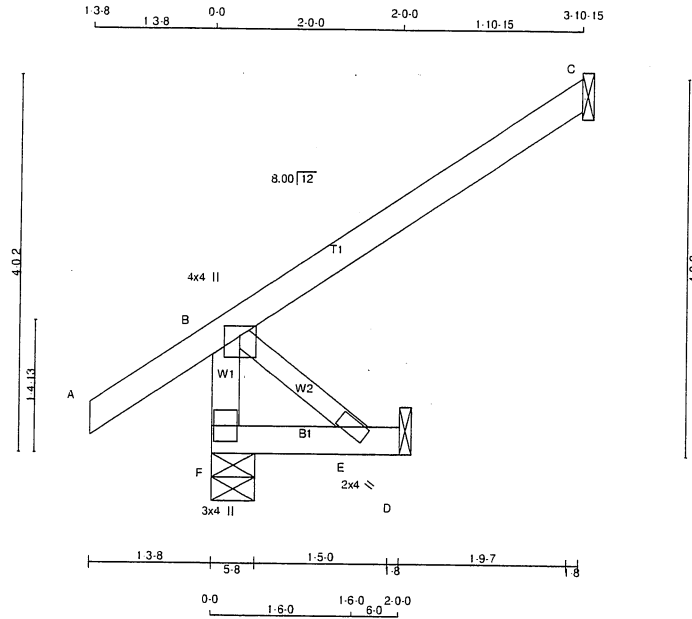

TOTAL WEIGHT = 12 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:			
CHORDS				GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.6 PSF			
F - B	2x4	DRY	No.2	VERT	DOWN	HORIZ	UPLIFT	DL = 6.0 PSF			
A - C	2x4	DRY	No.2					BOT CH. LL = 0.0 PSF			
F - D	2x4	DRY	No.2					DL = 7.4 PSF			
ALL WEBS	2x3	DRY	No.2					TOTAL LOAD = 39.0 PSF			
DRY: SEASONED LUMBER.											

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	225	170 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-B	-305 / 0	0.0	0.0 0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8 0.13 (5)	10.00			
B-C	0 / 0	-91.8	-91.8 0.24 (1)	10.00			
F-E	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
E-D	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN




Structural component only
DWG# T-2022108

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ROYAL PINE HOMES	DRWG NO.
406506	C3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:03 2020 Page 1
ID:pXBePeIFV7RX?2FLKzMhgeyOWXJ-CsJG??zCfig3X1E4aDg0rebJhXjLRjXf43J3tyTZ1

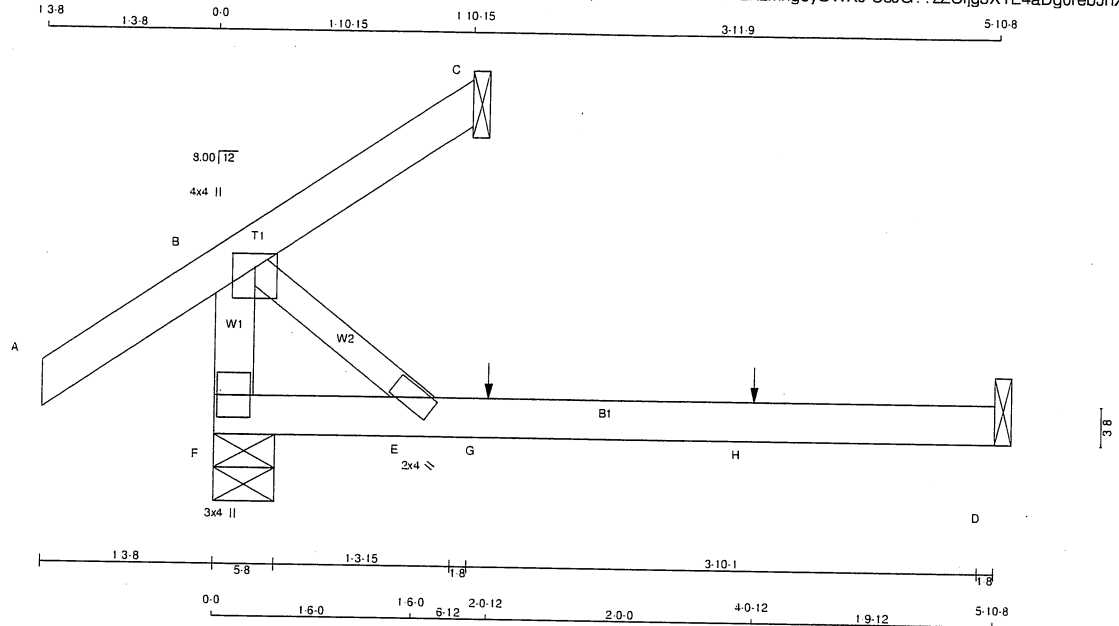

Scale = 1:16.5

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	313	0	313	0	5-8	5-8
C	42	0	42	0	1-8	1-8
D	54	0	61	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	222	144	0	0	0	77	0
C	29	24	0	0	0	6	0
D	43	0	0	0	0	43	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	LC1 MAX (PLF)			MAX. FORCE (LBS)	MAX. FORCE (LBS)
FR-TO								
F-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.13 (1)	10.00			
B-C	-25 / 0	-91.8	-91.8	0.12 (1)	6.25			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
E-G	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
G-H	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
H-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1
H	4-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2022109

JOB NAME 406506	TRUSS NAME C4	QUANTITY 1	PLY 1	JOB DESC. ROYAL PINE HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.330 S May 6 2020 MiTek Industries, Inc. Wed Oct 14 09:10:03 2020 Page 1
ID:pXBepelFV7RX?2FLKzMhgeyOWXJ-CsJG??zZCfig3X1E4aDg0reaRhXjLRjXf43J3tyTZ1

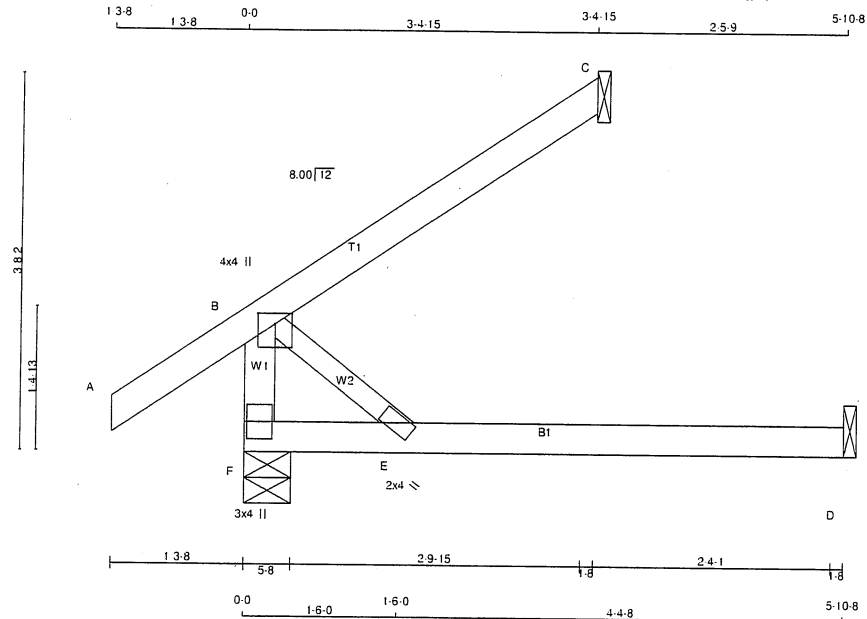

TOTAL WEIGHT = 16 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	337	337	5-8	5-8
C	157	157	1-8	1-8
D	54	61	1-8	1-8

SEE MITTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	238	158.0	0.0	0.0	0.0	80.0	0.0
C	108	87.0	0.0	0.0	0.0	20.0	0.0
D	43	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRAC LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX
FR-TO		FROM	TO			FR-TO		
F-B	-282.0	0.0	0.0	0.03 (1)	7.81	B-E	0.0	0.00 (1)
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00			
B-C	0.0	-91.8	-91.8	0.18 (1)	10.00			
F-E	0.0	-18.5	-18.5	0.14 (4)	10.00			
E-D	0.0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.18/1.00 (B-C:1), BC=0.19/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2022110

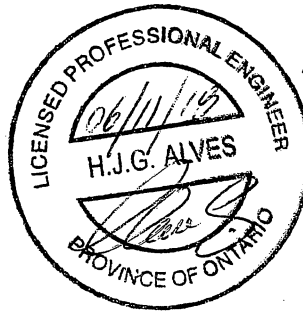

Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1300213

Feb 09, 2018



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

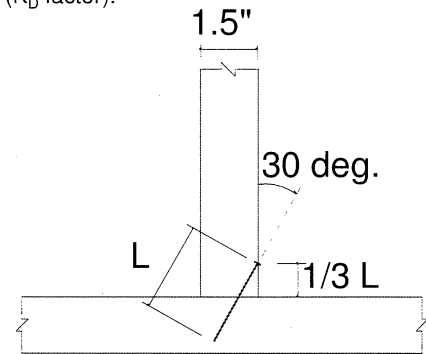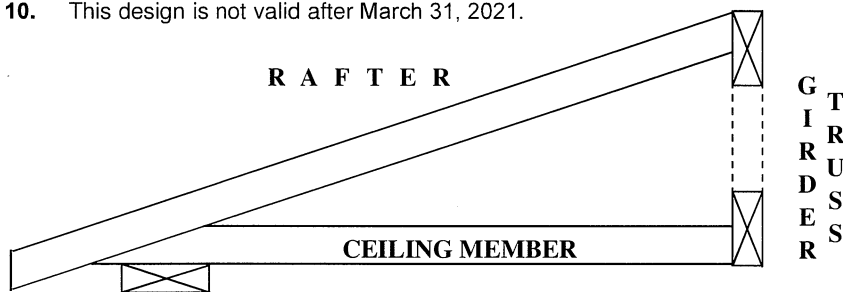

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

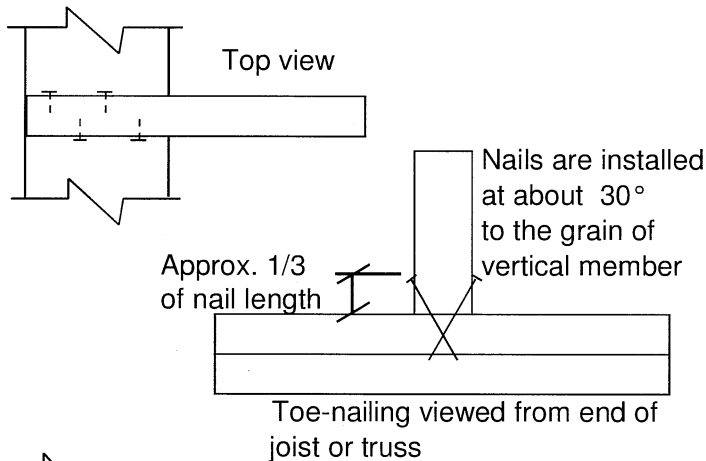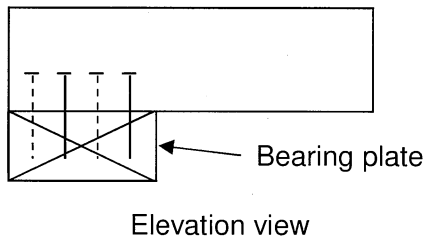

Toe-nailing on 2x4 Bearing Plate

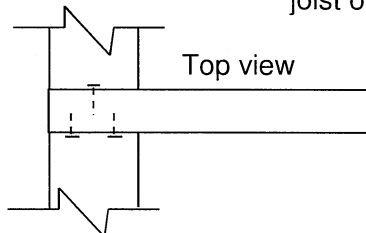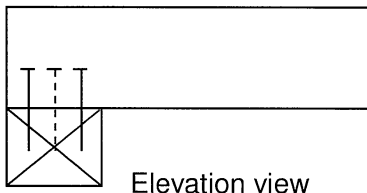

MiTek®

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



December 2, 2019

HUS/LJS – Double Shear Joist Hangers



All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

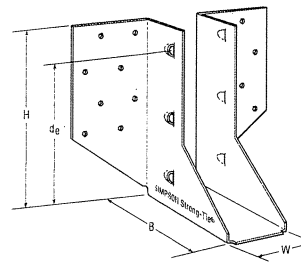


LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation

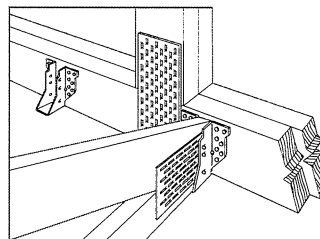


Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	dg ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K ₀ =1.15) lb.	Normal (K ₀ =1.00) lb.	Uplift (K ₀ =1.15) lb.	Normal (K ₀ =1.00) lb.
LJS26DS	18	1½	5	3½	4⅝	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1½	5⅝	3	3⅝	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1½	7⅞	3	6⅞	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1½	9⅞	3	7⅞	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1⅜	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200


1. dg is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580



Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.

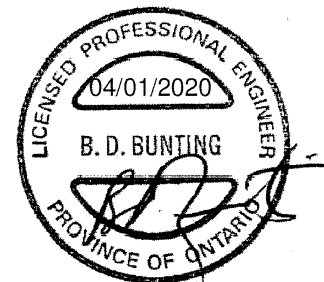

LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

LUS – Double Shear Joist Hangers



All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3½" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

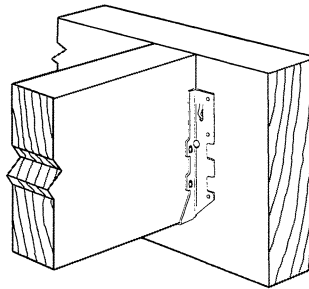


Typical LUS Installation

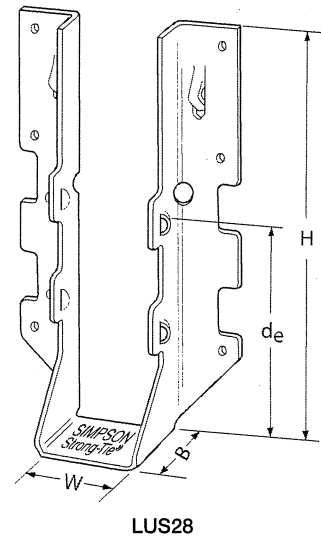


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _p =1.15)	(K _p =1.00)	(K _p =1.15)	(K _p =1.00)
LUS24	18	1⅞	3⅞	1¾	1 15/16	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3⅞	3⅞	2	1 13/16	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1⅞	4¾	1¾	3⅞	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3⅞	4¾	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4⅞	4⅞	2	3¼	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1⅞	6⅞	1¾	3¾	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3⅞	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4⅞	6¼	2	3¼	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1⅞	7 13/16	1¾	3⅞	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3⅞	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4⅞	8⅞	2	5¼	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Top View.



LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECLUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HGUS – Double Shear Joist Hangers

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:



- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:

- See current catalogue for options

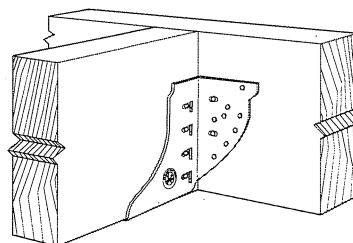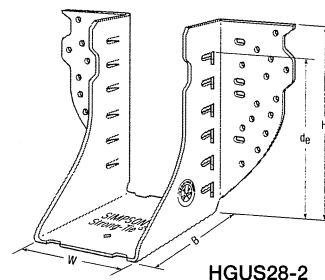


Typical HGUS Installation

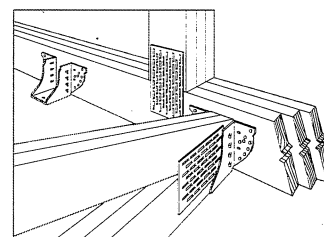


Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
								D.Fir-L		S-P-F	
		W	H	B	d _e ¹	Face	Joist	Uplift (K _o =1.15)	Normal (K _o =1.00)	Uplift (K _o =1.15)	Normal (K _o =1.00)
HGUS26	12	1 5/8	5 3/8	5	4 3/32	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3 5/16	5 7/16	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4 15/16	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6 3/16	5 7/16	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1 5/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3 5/16	7 3/16	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4 15/16	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6 3/16	7 3/16	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1 5/8	9 1/8	5	7 7/8	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3 5/16	9 3/16	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4 15/16	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6 3/16	9 3/16	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6 3/16	10 5/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6 3/16	12 5/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645


1. d_e is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

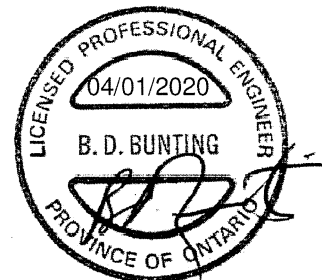

LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com




Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

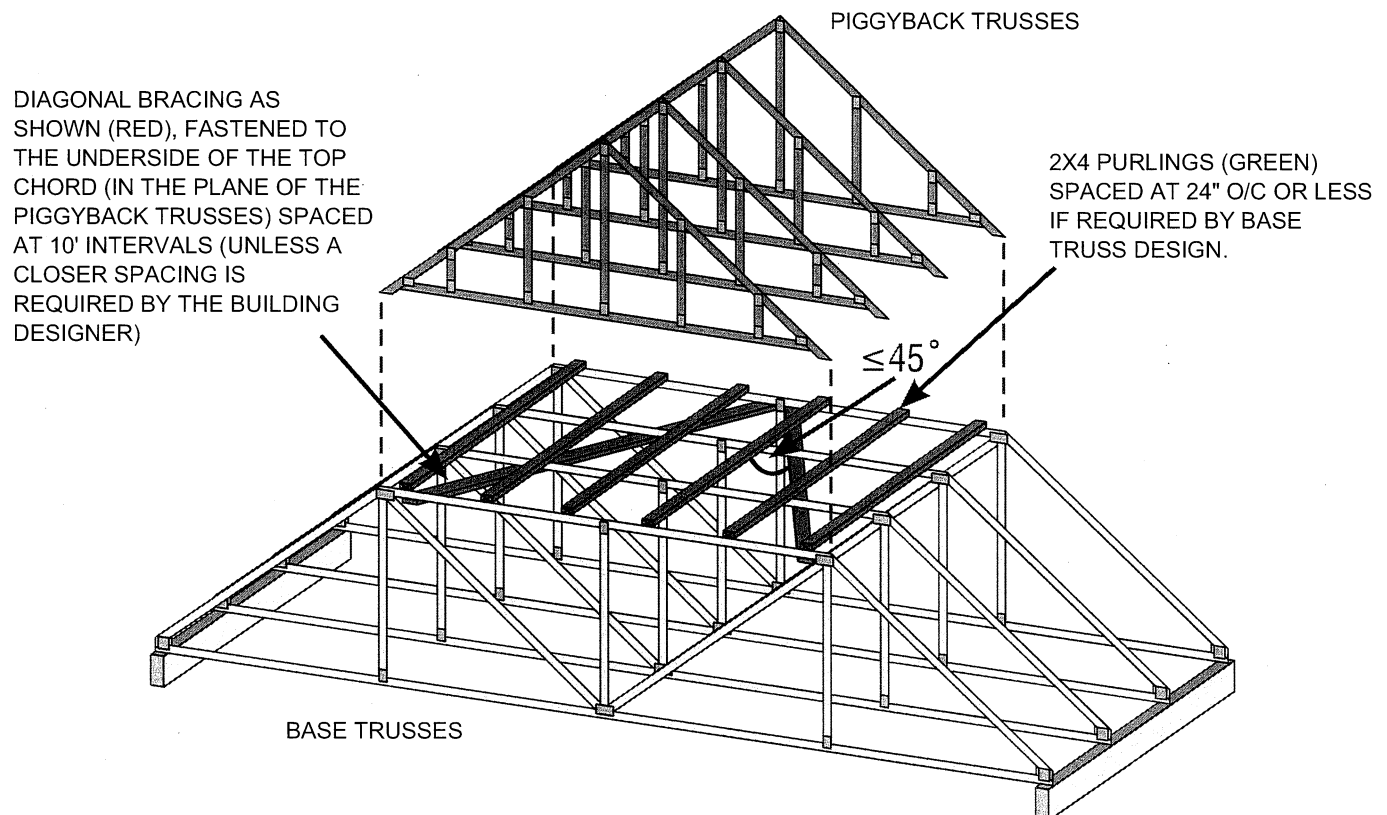

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.




SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

Symbols

PLATE LOCATION AND ORIENTATION

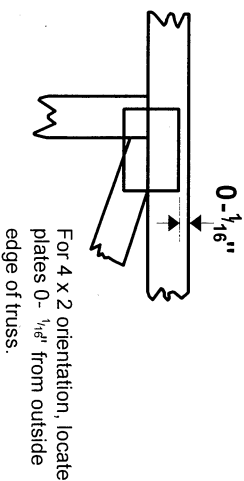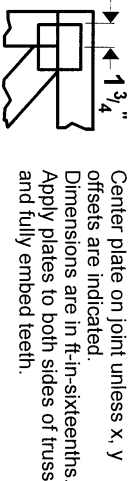

* Plate location details available in MITek 20/20 software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING





Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP11: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

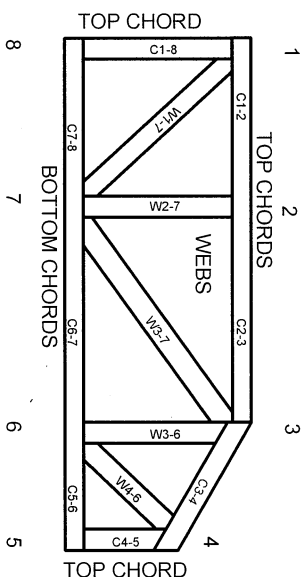

JOINTS ARE GENERALLY NUMBERED/CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MIL-7473 rev. 10/03/2015



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.