



'UNIT - 2502'

SB-12 ENERGY EFFICIENCY DESIGN MATRIX	
PERFORMANCE COMPLIANCE	SPACE HEATING FUEL
	<input type="checkbox"/> GAS <input type="checkbox"/> OIL
	<input type="checkbox"/> ELECTRIC <input type="checkbox"/> PROPANE
	<input type="checkbox"/> EARTH <input type="checkbox"/> SOLID FUEL
BUILDING COMPONENT	PROPOSED
INSULATION RSI (R) VALUE	
CEILING W/ ATTIC SPACE	10.56 (R60)
CEILING W/O ATTIC SPACE	5.46 (R31)
EXPOSED FLOOR	5.46 (R31)
WALLS ABOVE GRADE	3.87 (R22) + 1.5ci
BASEMENT WALLS	R20 Blanket or R12 + R10ci
BELOW GRADE SLAB ENTIRE SURFACE > 600mm BELOW GRADE	-
EDGE OF BELOW GRADE SLAB ≤ 600mm BELOW GRADE	1.76 (R10)
HEATED SLAB ≤ 600mm BELOW GRADE	1.76 (R10)
CONC. SLAB ≤ 600mm BELOW GRADE	1.76 (R10)
WINDOWS & DOORS	
WINDOWS/SLIDING GLASS DOORS (MAX U-VALUE or MIN. ER)	1.6
SKYLIGHTS (MAX. U-VALUE)	2.8
APPLIANCE EFFICIENCY	
SPACE HEATING EQUIP. (AFUE%)	Combo 95% AFUE GLOW C140
HRV EFFICIENCY (%)	75%
DOMESTIC HOT WATER HEATER (EF)	0.84
DWHR UNIT (%)	53.3% ON 1 SHOWERS MIN.
AREA CALCULATIONS EL. 'A1'(REV)EL. 'B1'(REV)	
	& EL. 'A2' & EL. 'B2'
GROUND FLOOR AREA	931 sq. ft. 931 sq. ft. (86.49 sq. m.) (86.49 sq. m.)
SECOND FLOOR AREA	1005 sq. ft. 1005 sq. ft. (93.37 sq. m.) (93.37 sq. m.)
SUBTOTAL	1936 sq. ft. 1936 sq. ft. (179.86 sq. m.) (179.86 sq. m.)
DEDUCT ALL OPEN AREAS	0 sq. ft. 0 sq. ft. (0.00 sq. m.) (0.00 sq. m.)
TOTAL NET AREA	1936 sq. ft. 1936 sq. ft. (179.86 sq. m.) (179.86 sq. m.)
FINISHED BASEMENT AREA	0 sq. ft. 0 sq. ft. (0.00 sq. m.) (0.00 sq. m.)
COVERAGE W/OUT PORCH	1142 sq. ft. 1142 sq. ft. (106.10 sq. m.) (106.10 sq. m.)
COVERAGE W/ PORCH	1228 sq. ft. 1228 sq. ft. (114.08 sq. m.) (114.08 sq. m.)



- 1 - TITLE PAGE
- 2 - BASEMENT PLANS ELEV. 'A1', 'B1' (REV.) & 'A2', 'B2'
- 3 - GROUND FLOOR PLANS, ELEV. 'A1' (REV.) & 'A2'
- 4 - SECOND FLOOR PLANS, ELEV. 'A1' (REV.) & 'A2'
- 5 - PARTIAL FLOOR PLANS, ELEV 'B1' (REV.) & 'B2'
- 6 - FRONT & REAR ELEVATION 'A1' (REV.), 'A2'
- 7 - LEFT SIDE ELEV. 'A1' (REV) & RIGHT SIDE ELEV. 'A2'
- 8 - FRONT ELEVATION 'B1' (REV.), 'B2' / CROSS SECTION 'A-A'
- 9 - LEFT SIDE ELEV. 'B1' (REV) & RIGHT SIDE ELEV. 'B2'
- 10 - WALK-OUT DECK CONDITION
- 11 - CONSTRUCTION NOTES



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

7. ISSUED FOR PERMIT	-	-
6. ISSUED FOR FINAL APPROVAL	2023/01/12	MM
5. REVISED AS PER ARCHITECTURAL CONTROL COMMENTS	-	-
4. REVISED AS PER ENGINEER COMMENTS	2023/02/14	MM
3. REVISED AS PER ROOF TRUSS MANUFACTURE PLANS	2022/06/14	MM
2. REVISED AS PER FLOOR MANUFACTURE PLANS	2022/06/13	MM
1. REVISED AS PER CLIENT'S COMMENTS	2021/09/29	DSI
REVISIONS		DATE (YYYY/MM/DD) BY




THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos 37308
NAME SIGNATURE BCIN
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC. 19695

HUNT DESIGN ASSOCIATES INC.
www.huntdesign.ca

ROYAL PINE HOMES - 216051
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO
Drawn By JMc Checked By VL Scale 3/16"=1'-0" File Number 216051WS2502
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326


TITLE PAGE
'UNIT - 2502'
REV.2023.02.14

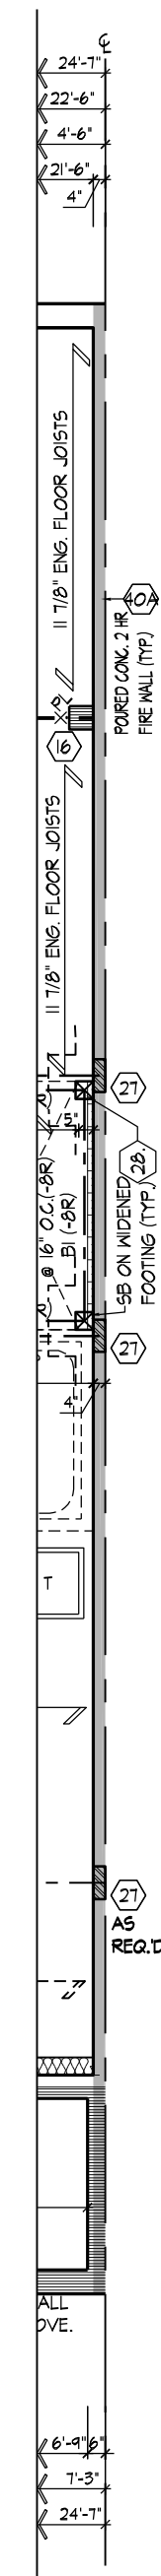

PART. BASEMENT
PLAN EL. 'A1' & 'B1'
(REV) W/ FIREWALL
(EL. 'A2' & 'B2'
SIMILAR)

- SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILE AREAS.
- PROVIDE SOLID WOOD BLOCKING @ 24" O.C. FOR FIRST JOIST SPAN WHEN PARALLEL W/ EXTERIOR WALL.
- REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BLOCKING & STRAPPING REQUIREMENTS, INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS.

W Architect Inc.
DESIGN CONTROL REVIEW
MAR. 31, 2023
FINAL BY: *W*

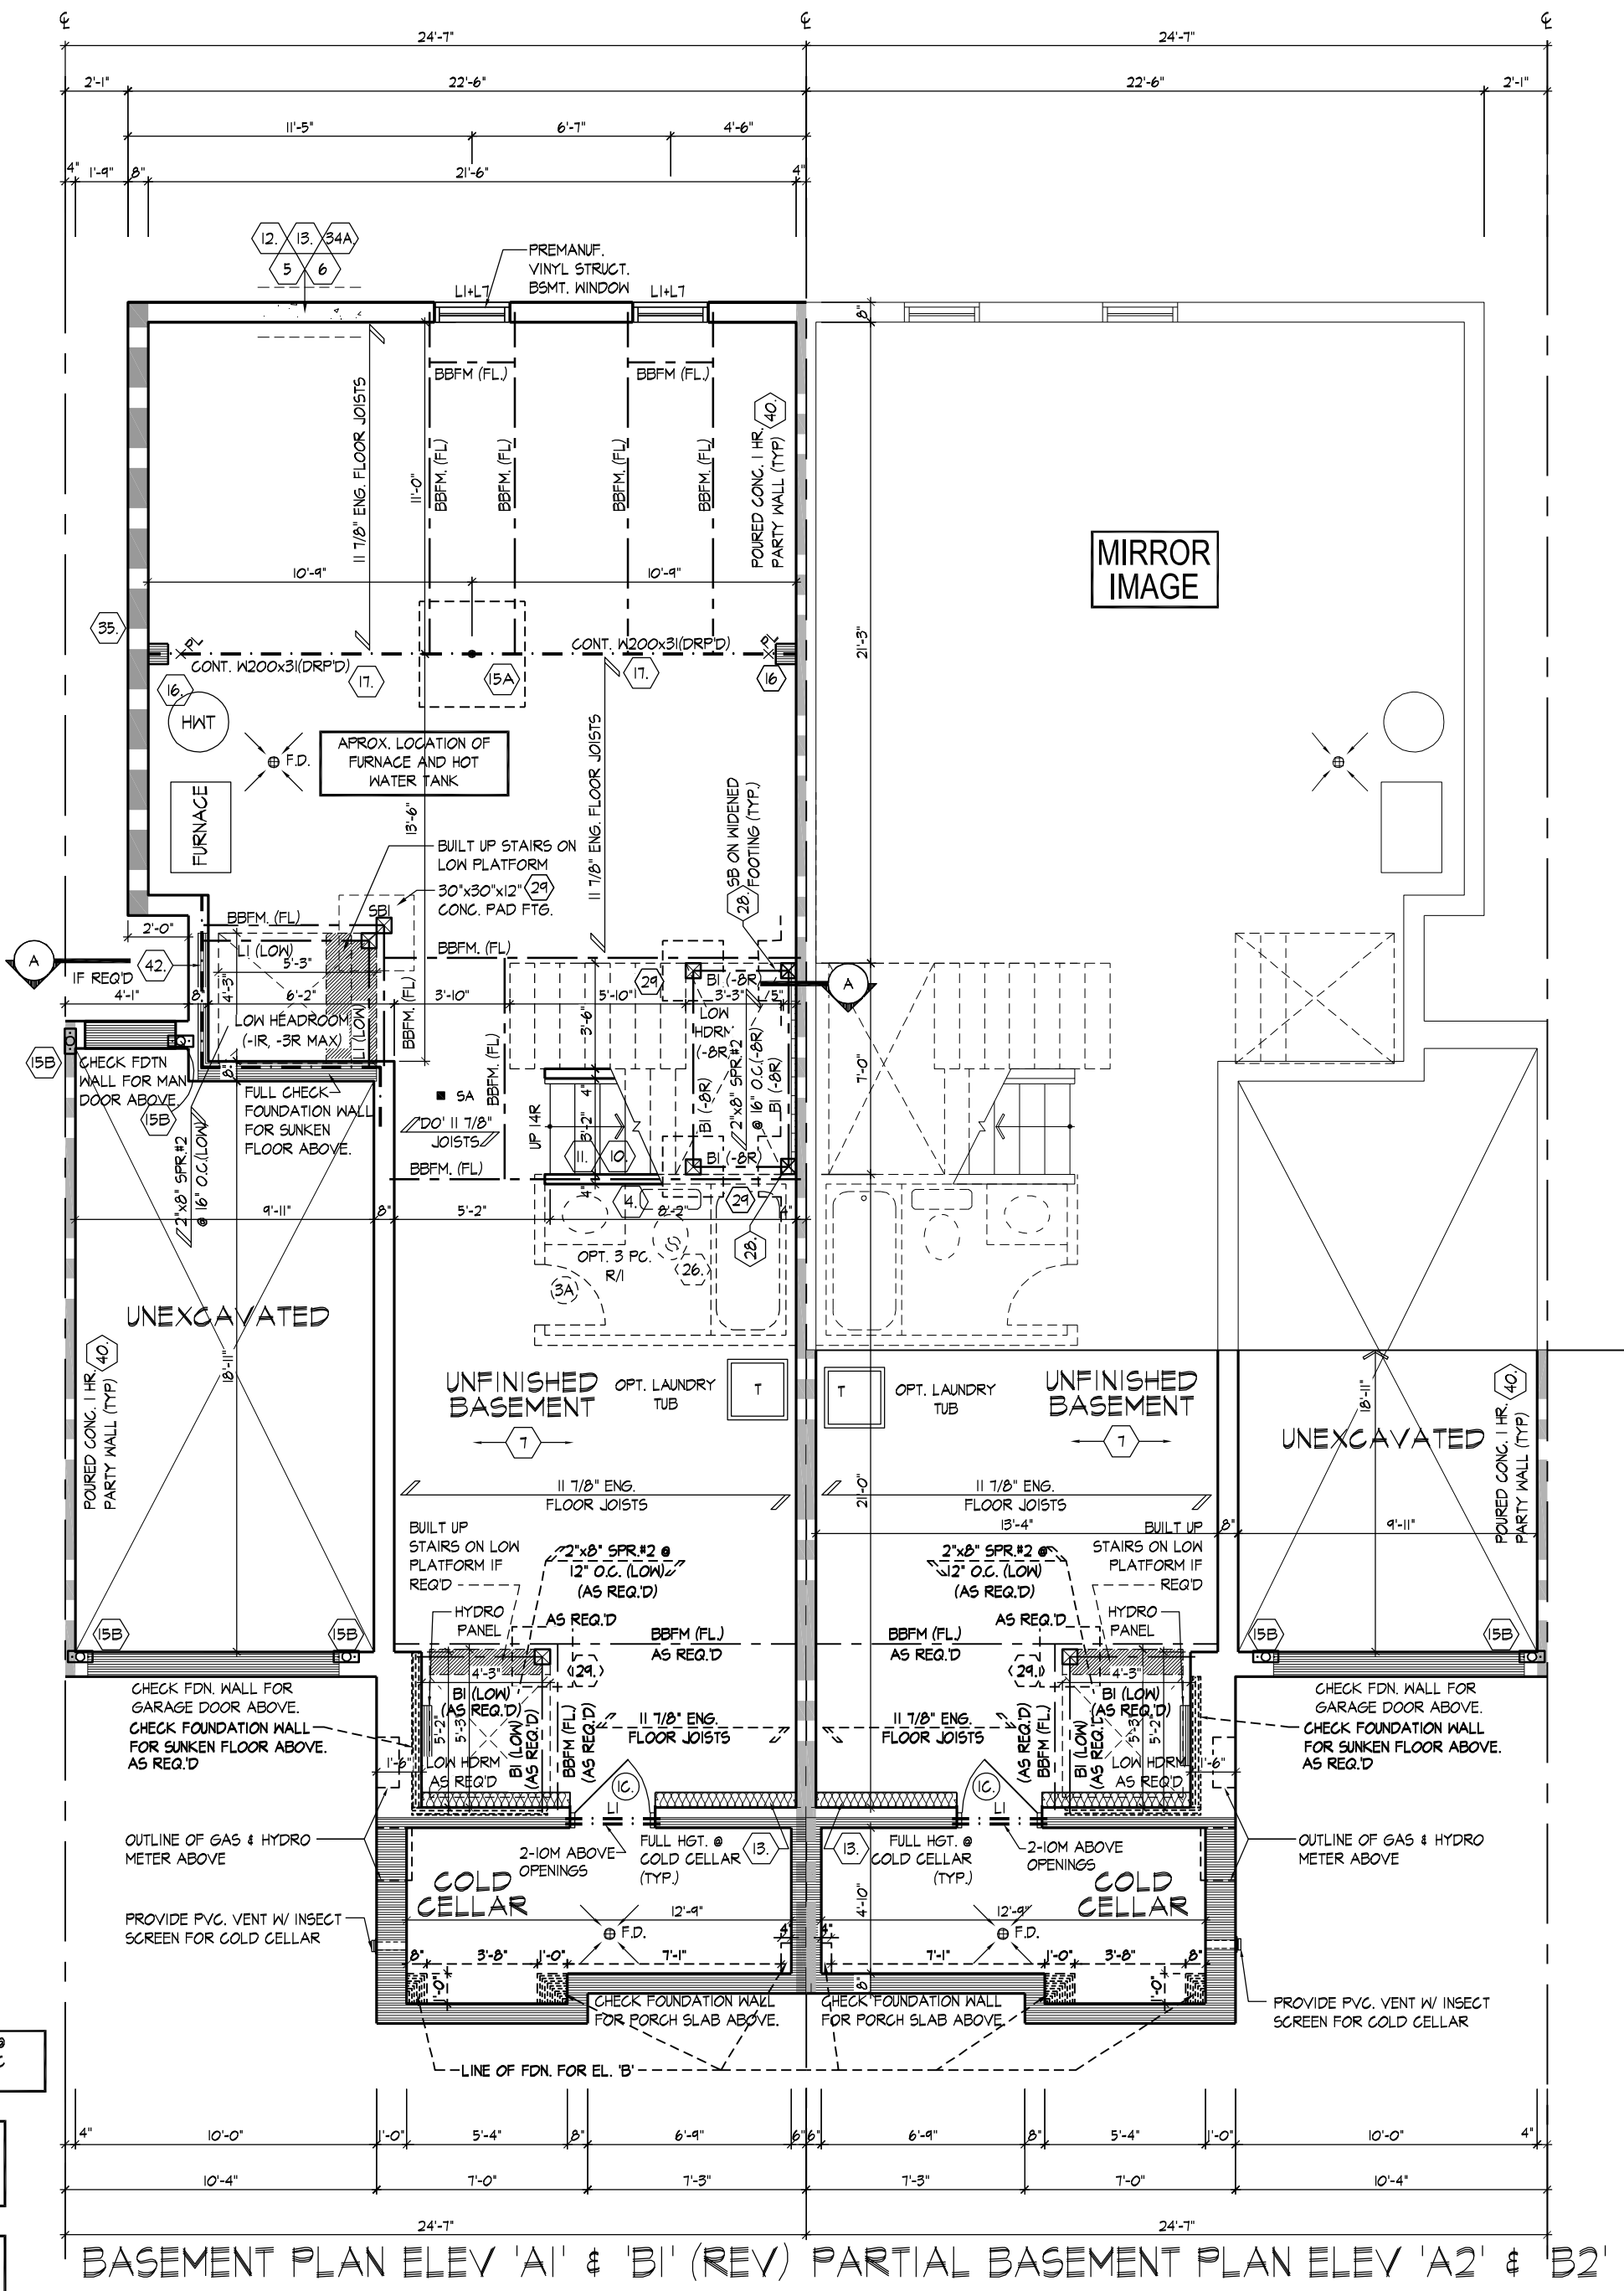

BASEMENT PLAN ELEV 'A1' & 'B1' (REV) PARTIAL BASEMENT PLAN ELEV 'A2' & 'B2'




FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

BASEMENT PLANS ELEV. 'A1', 'B1' (REV.) & 'A2', 'B2'	
ROYAL PINE HOMES - 216051	
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO	
UNIT - 2502	
REV. 2023.02.14	
Drawn By JMc	Checked By VL
Scale 3/16"=1'-0"	File Number 216051WS2502
8966 Woodbine Ave., Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326	
2 of 11	

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE FOR A DESIGNER.
Derek R. Santos 37308
NAME SIGNATURE BCIN
HUNT DESIGN ASSOCIATES INC. 19695

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature).



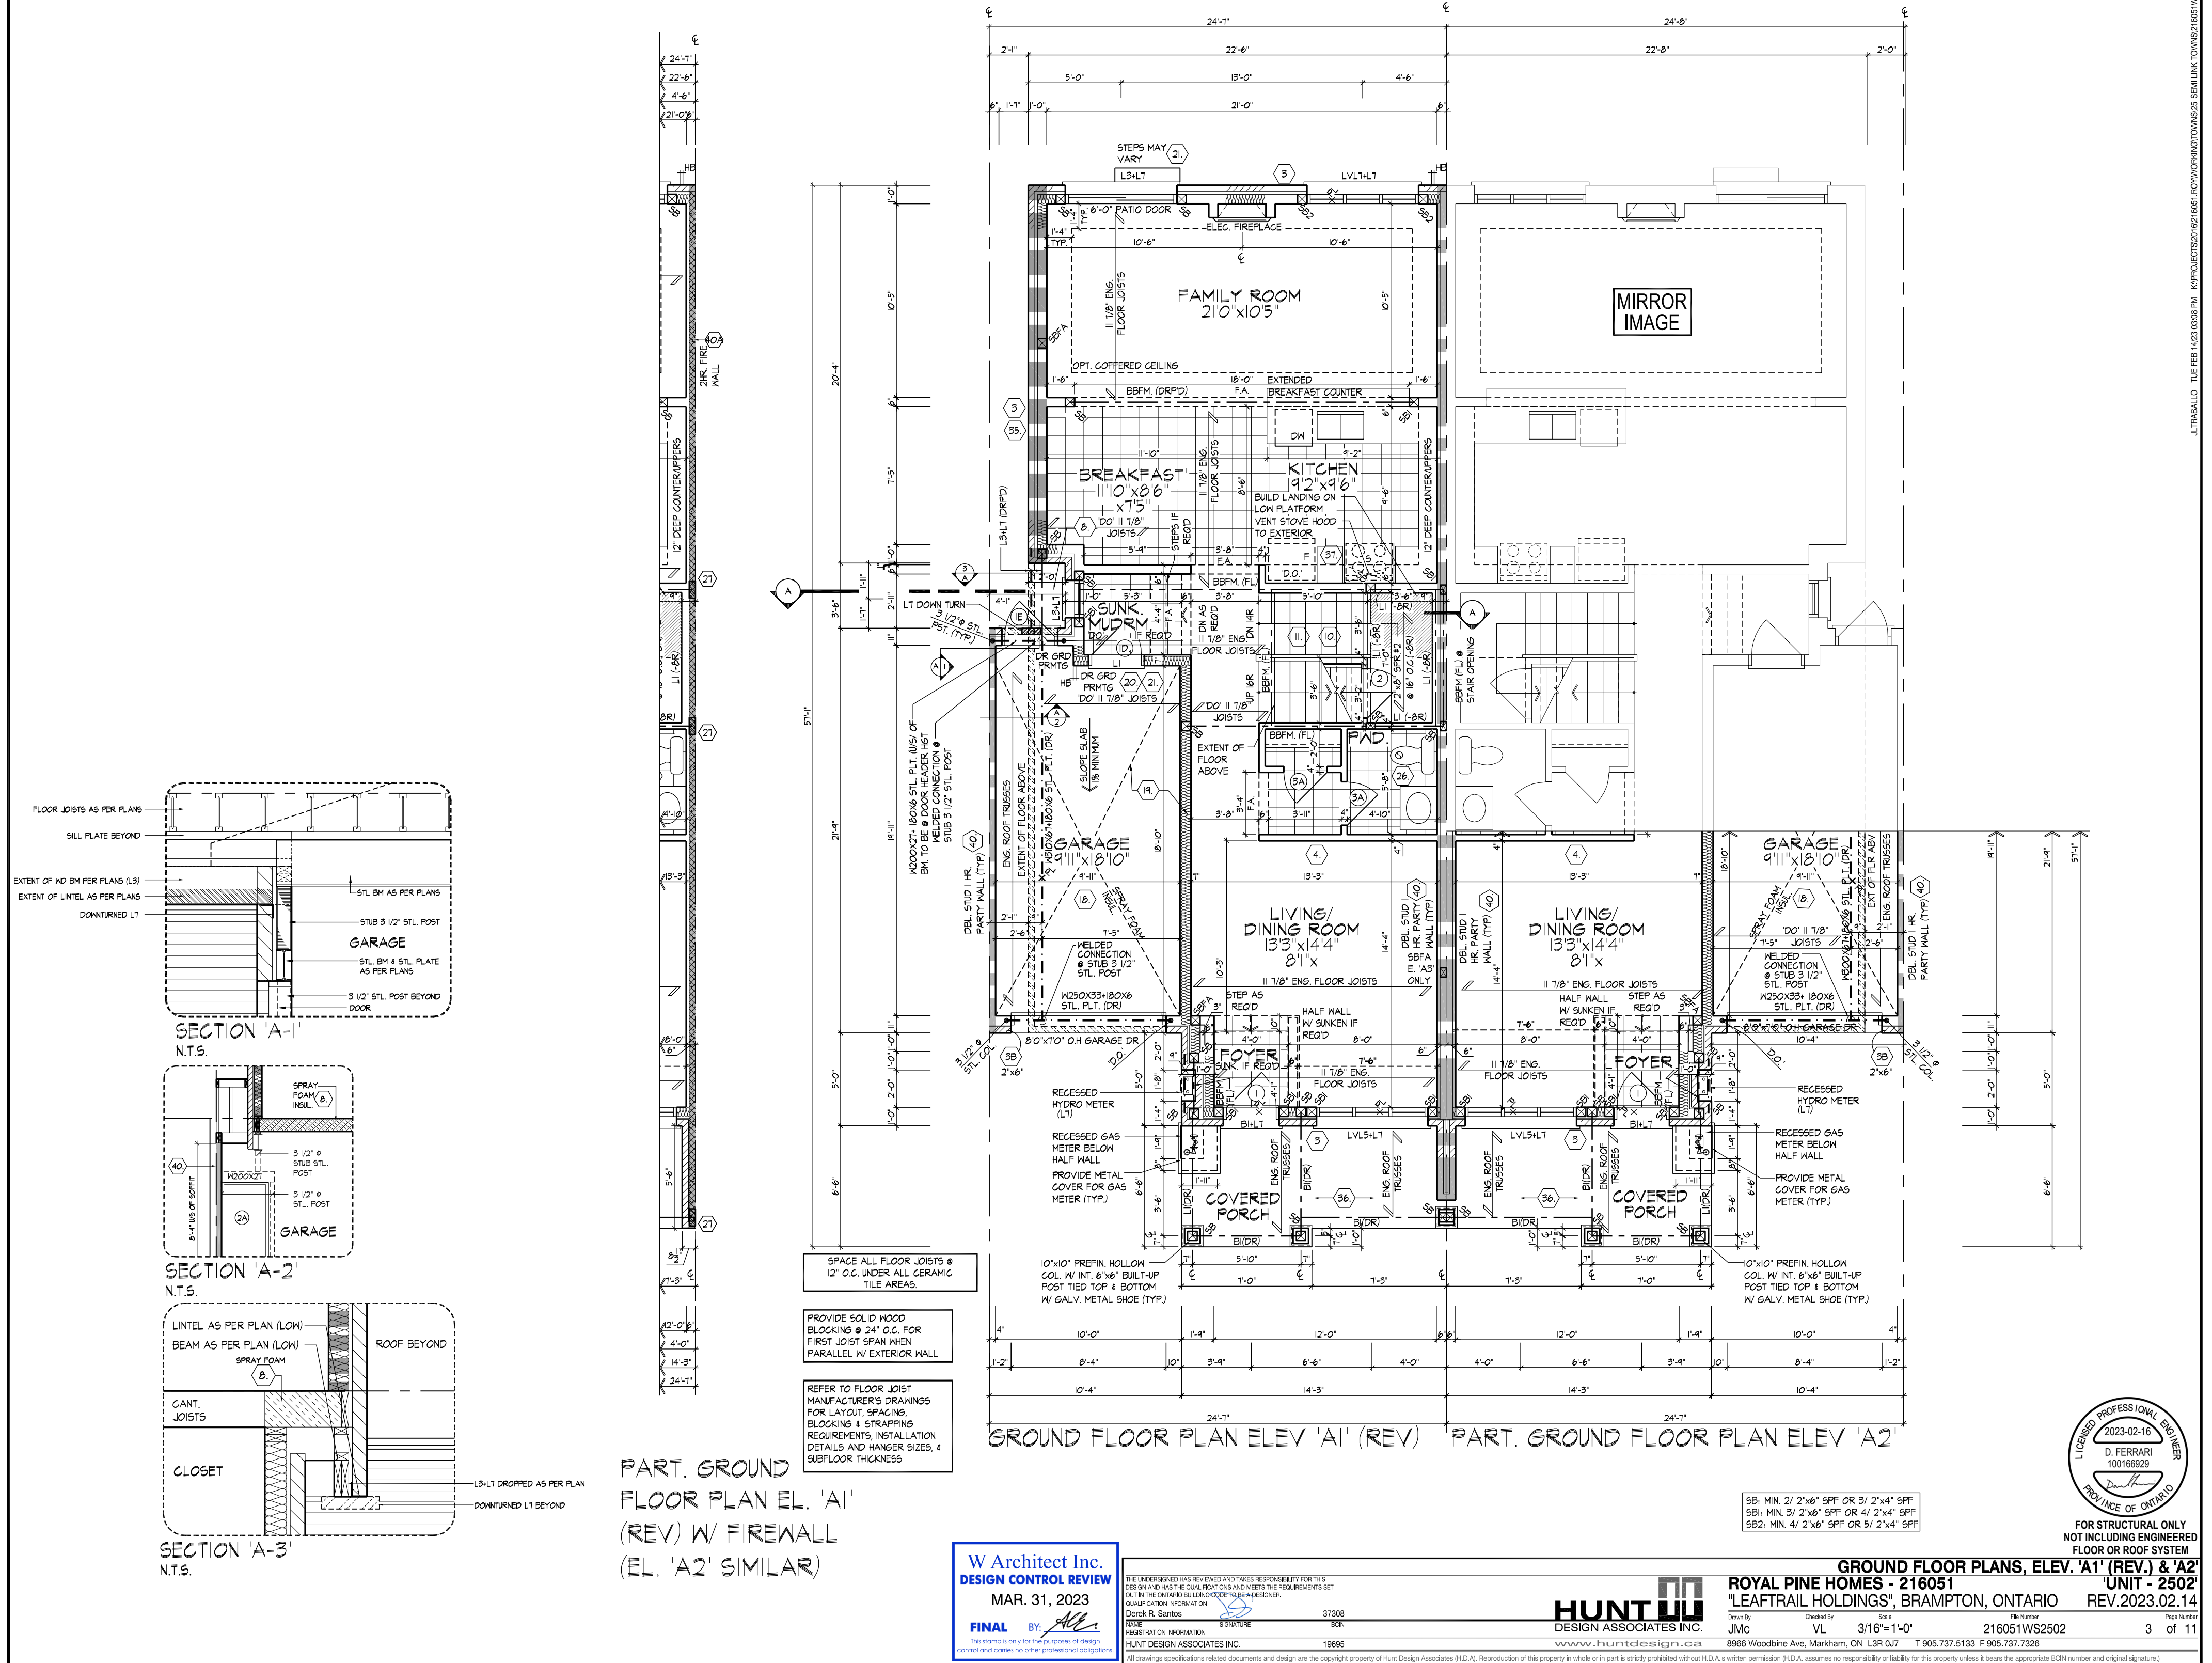


W Architect Inc.
DESIGN CONTROL REVIEW
MAR. 31, 2023
FINAL BY: *W*

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

GROUND FLOOR PLANS, ELEV. 'A1' (REV.) & 'A2'
UNIT - 2502
REV. 2023.02.14
ROYAL PINE HOMES - 216051
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO
8966 Woodbine Ave., Markham, ON L3R 0J7
T 905.737.5133 F 905.737.7326
3 of 11

PROFESSIONAL ENGINEER
2023-02-16
D. FERRARI
100166929
PROVINCE OF ONTARIO
FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

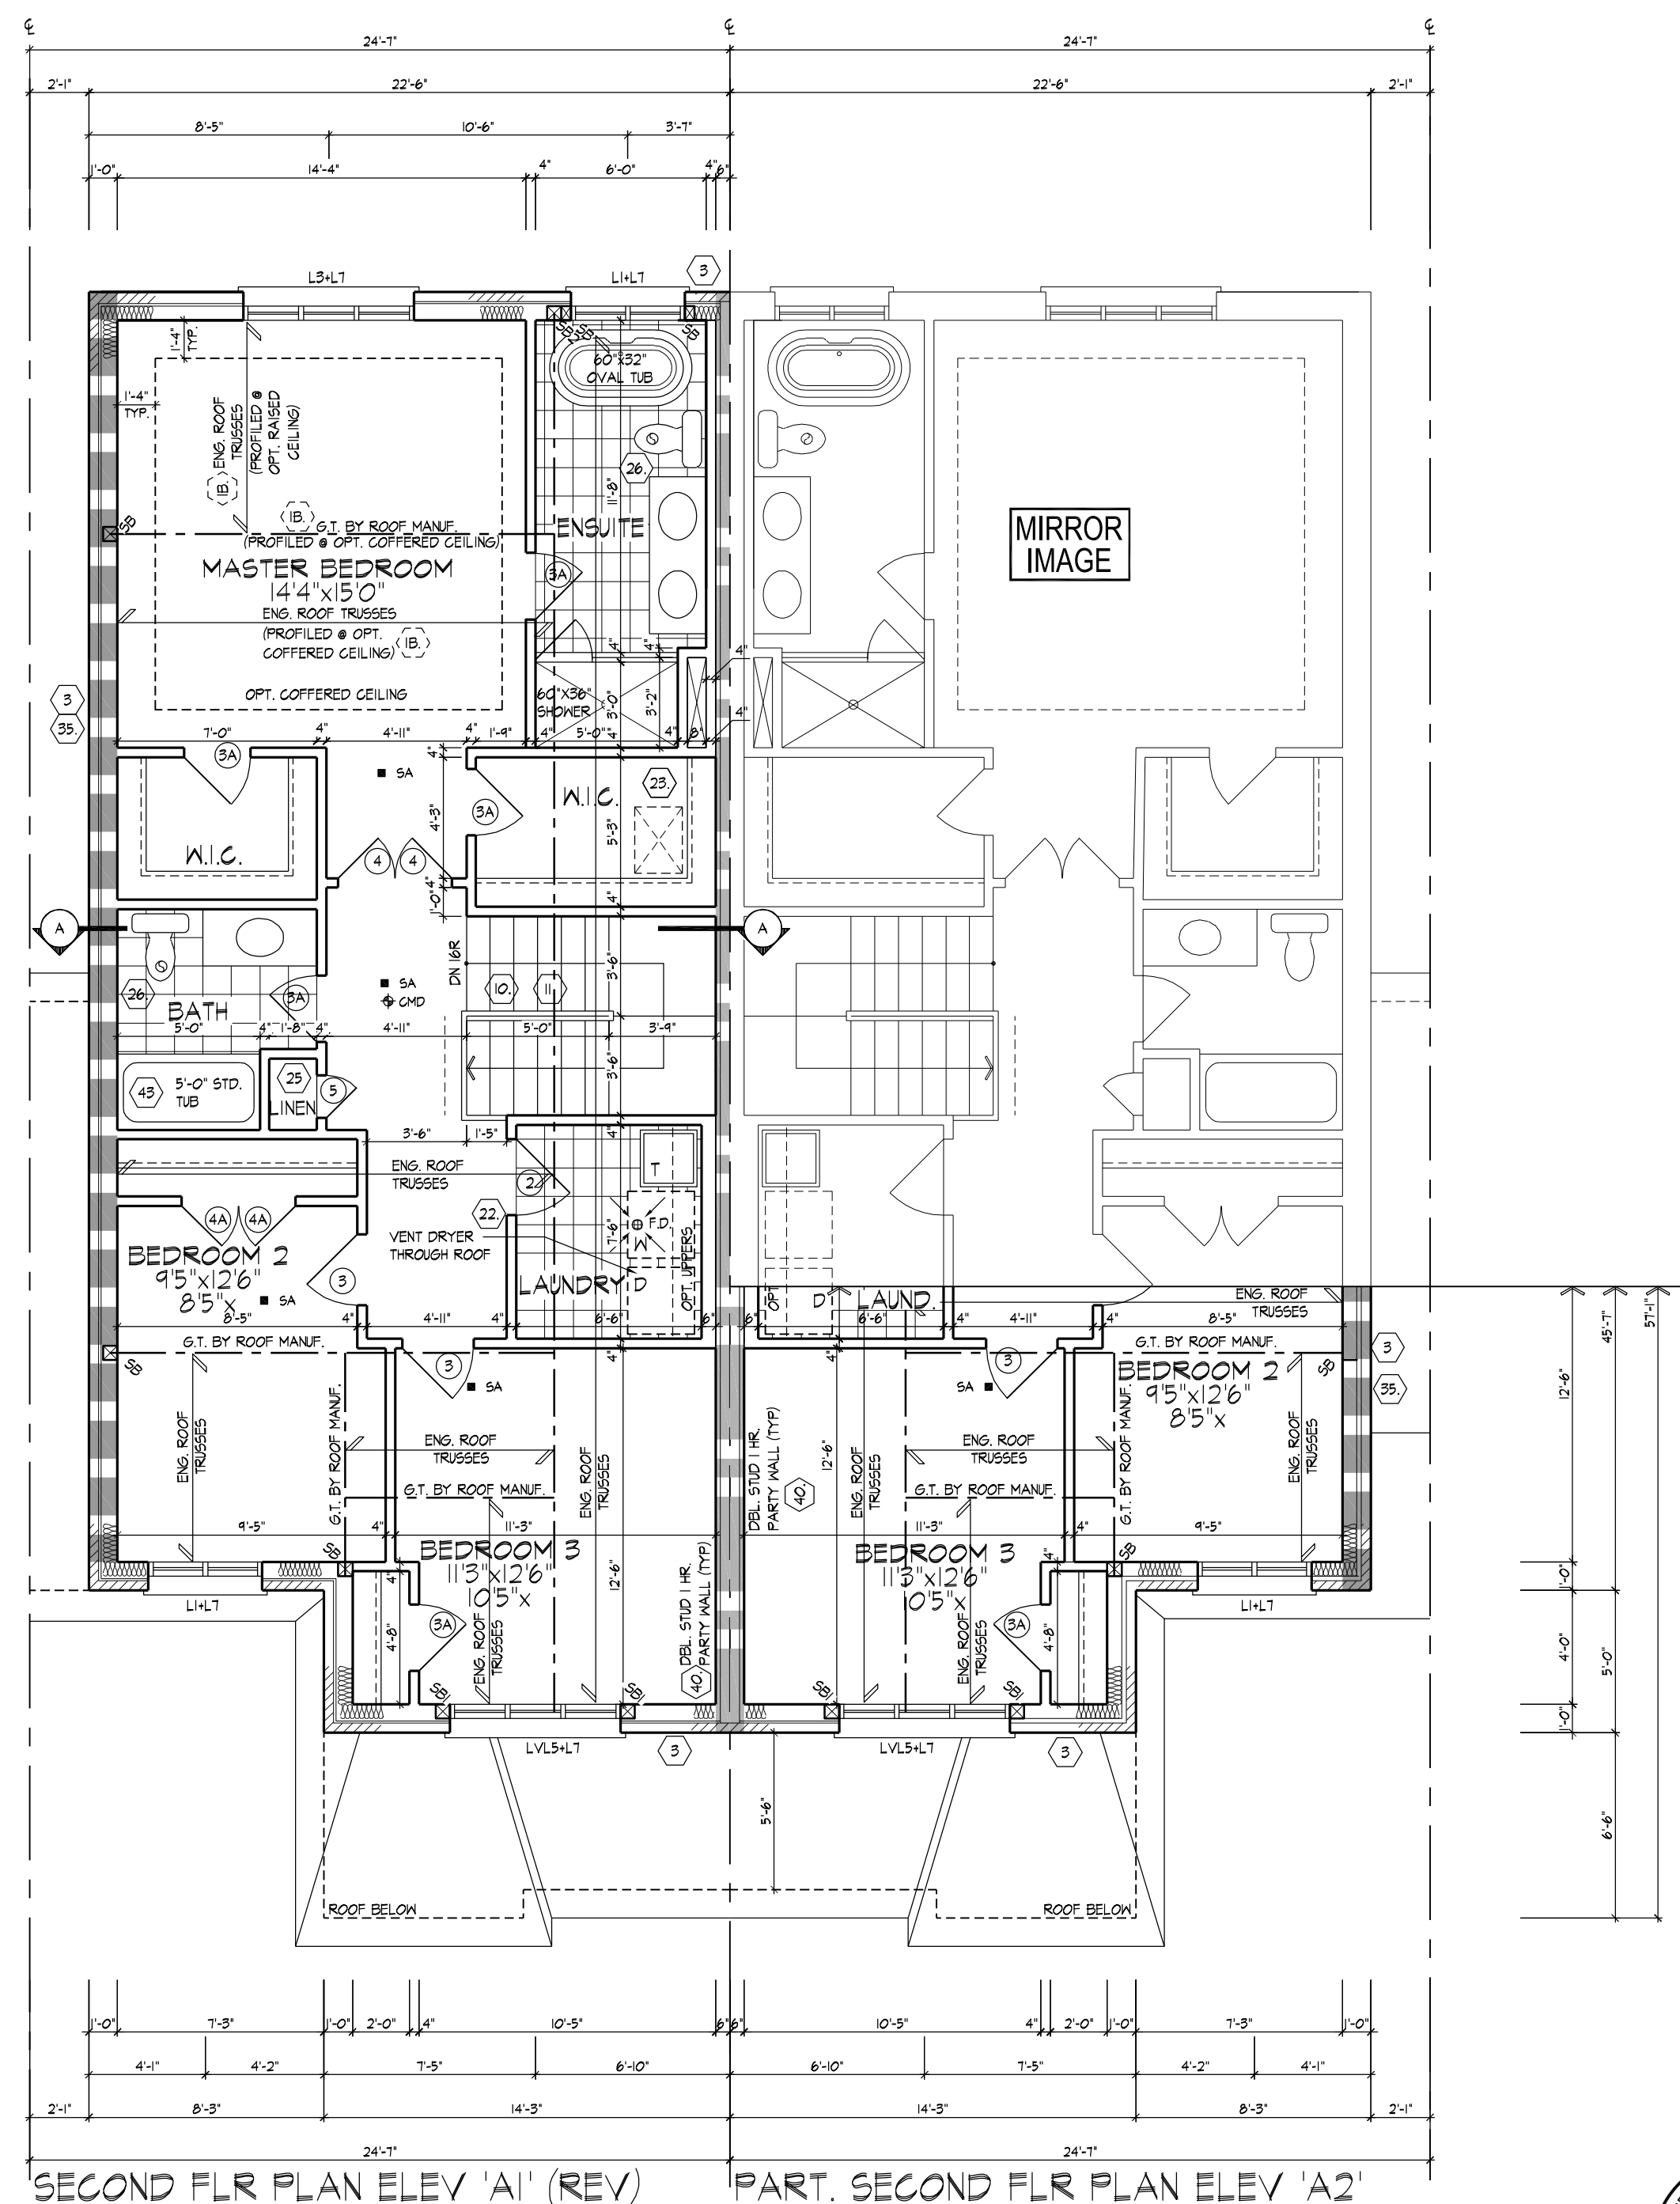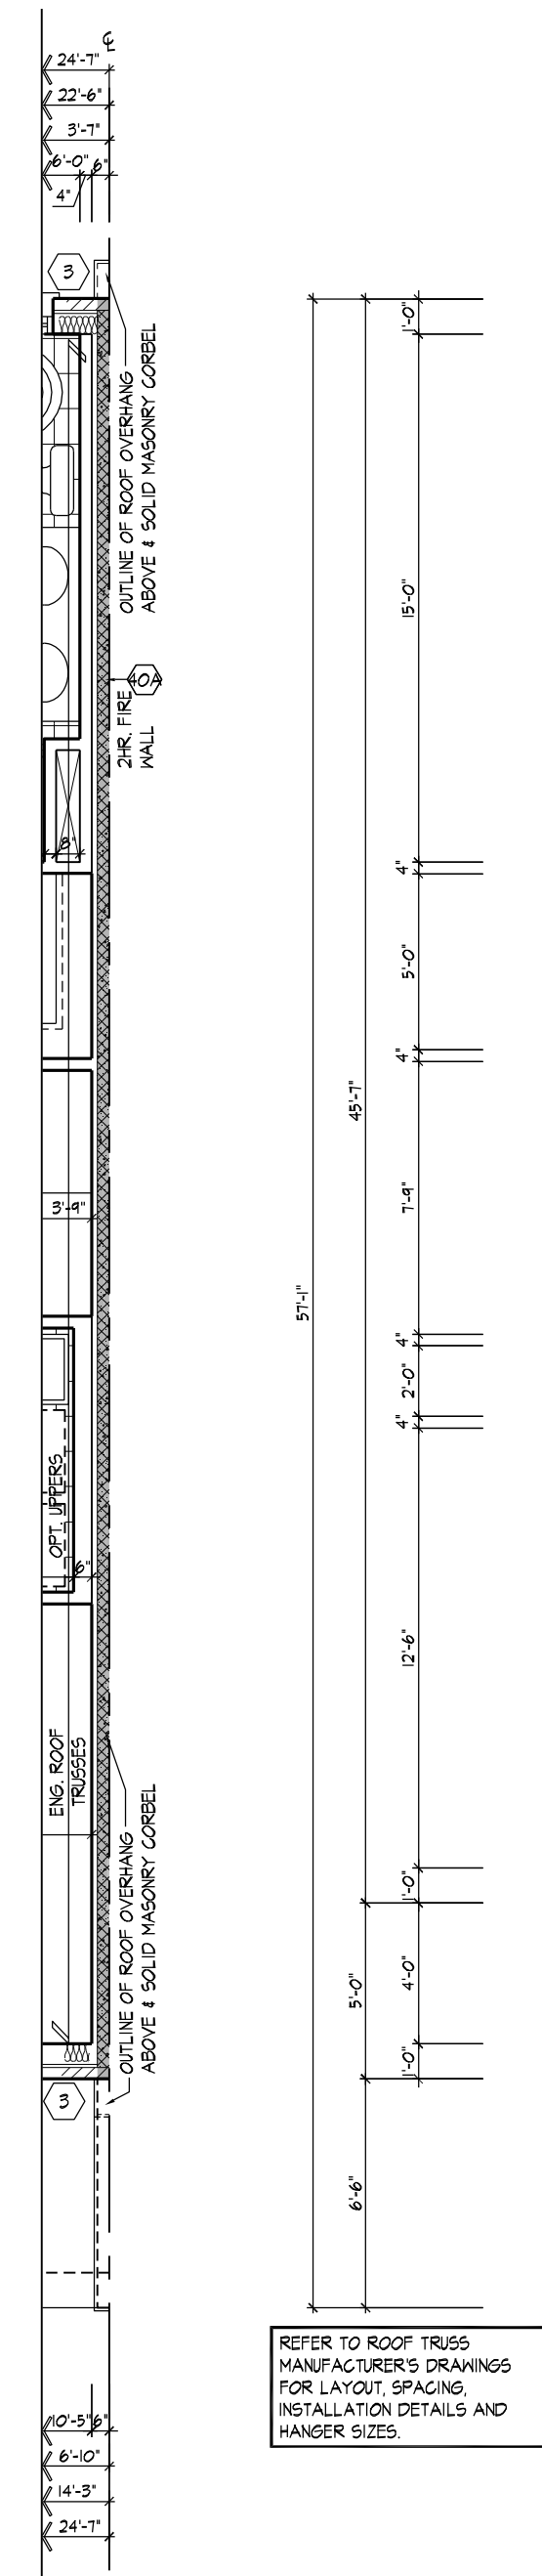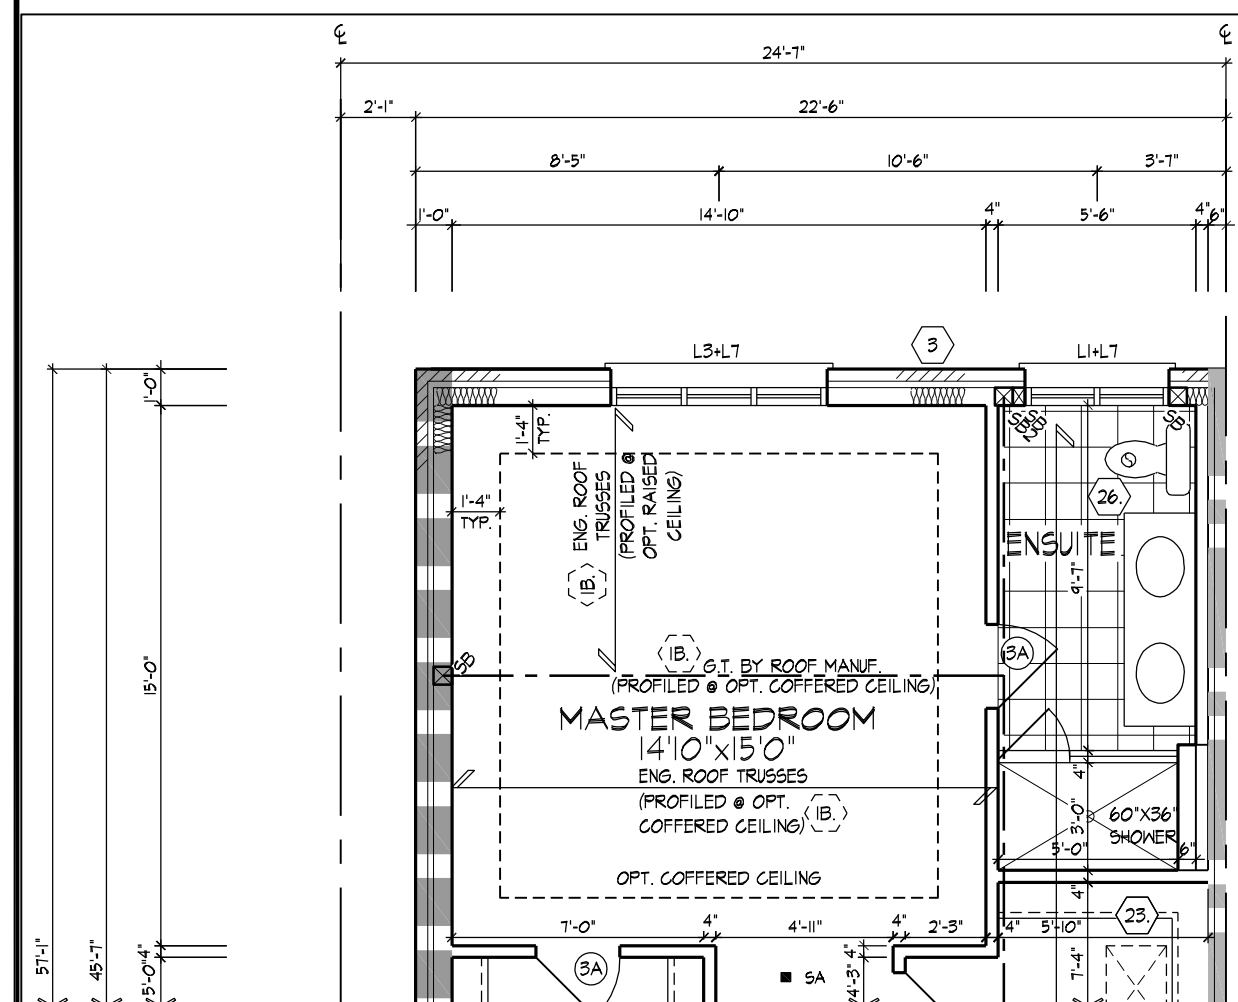

SB: MIN. 2/ 2"x6" SPF OR 3/ 2"x4" SPF
SBI: MIN. 3/ 2"x6" SPF OR 4/ 2"x4" SPF
SB2: MIN. 4/ 2"x6" SPF OR 5/ 2"x4" SPF



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

FLOOR OR ROOF SYSTEM
SECOND FLOOR PLANS, ELEV. 'A1' (REV.) & 'A2'

ROYAL PINE HOMES - 216051 'UNIT - 2502'
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO REV.2023.02.14

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.com

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION
Derek R. Santos 37





NAME	SIGNATURE	DATE
REGISTRATION INFORMATION		
HUNT DESIGN ASSOCIATES INC.		19

W Architect Inc.
DESIGN CONTROL REVIEW

FINAL BY: *ACE*

This stamp is only for the purposes of design control and carries no other professional obligation

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission. H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.

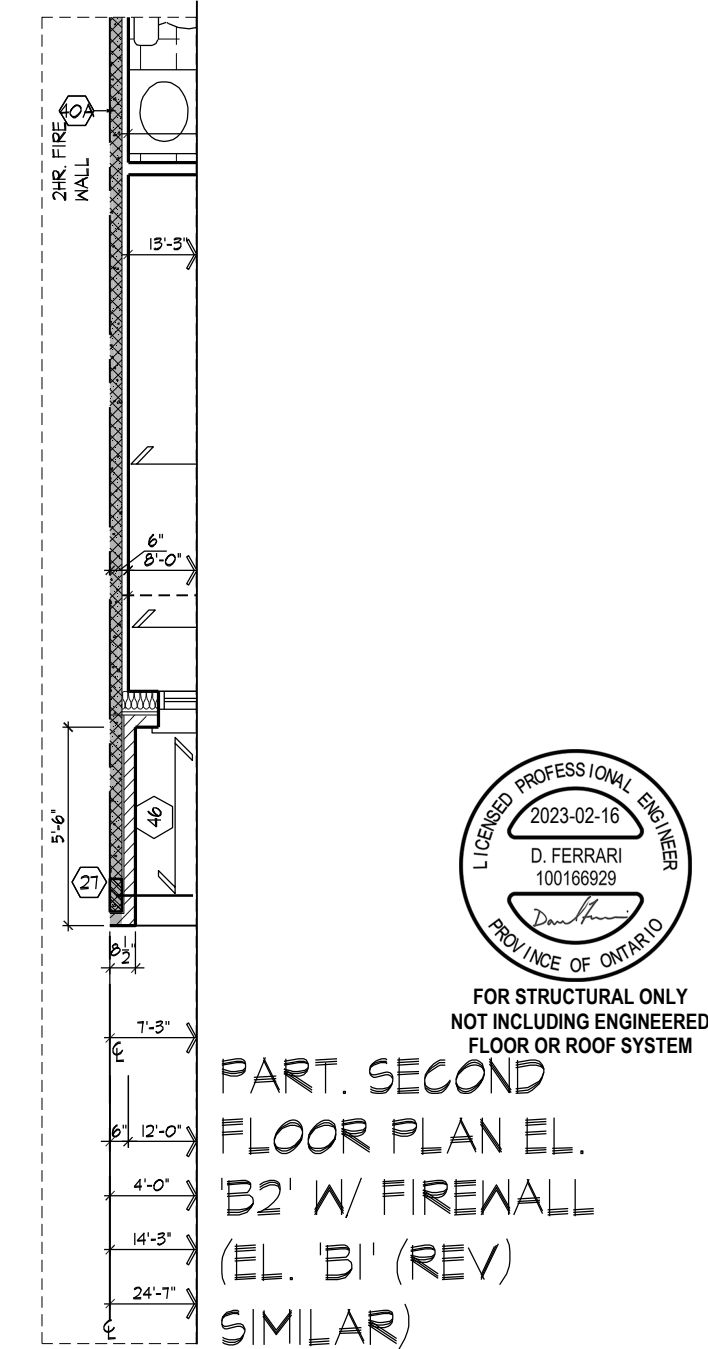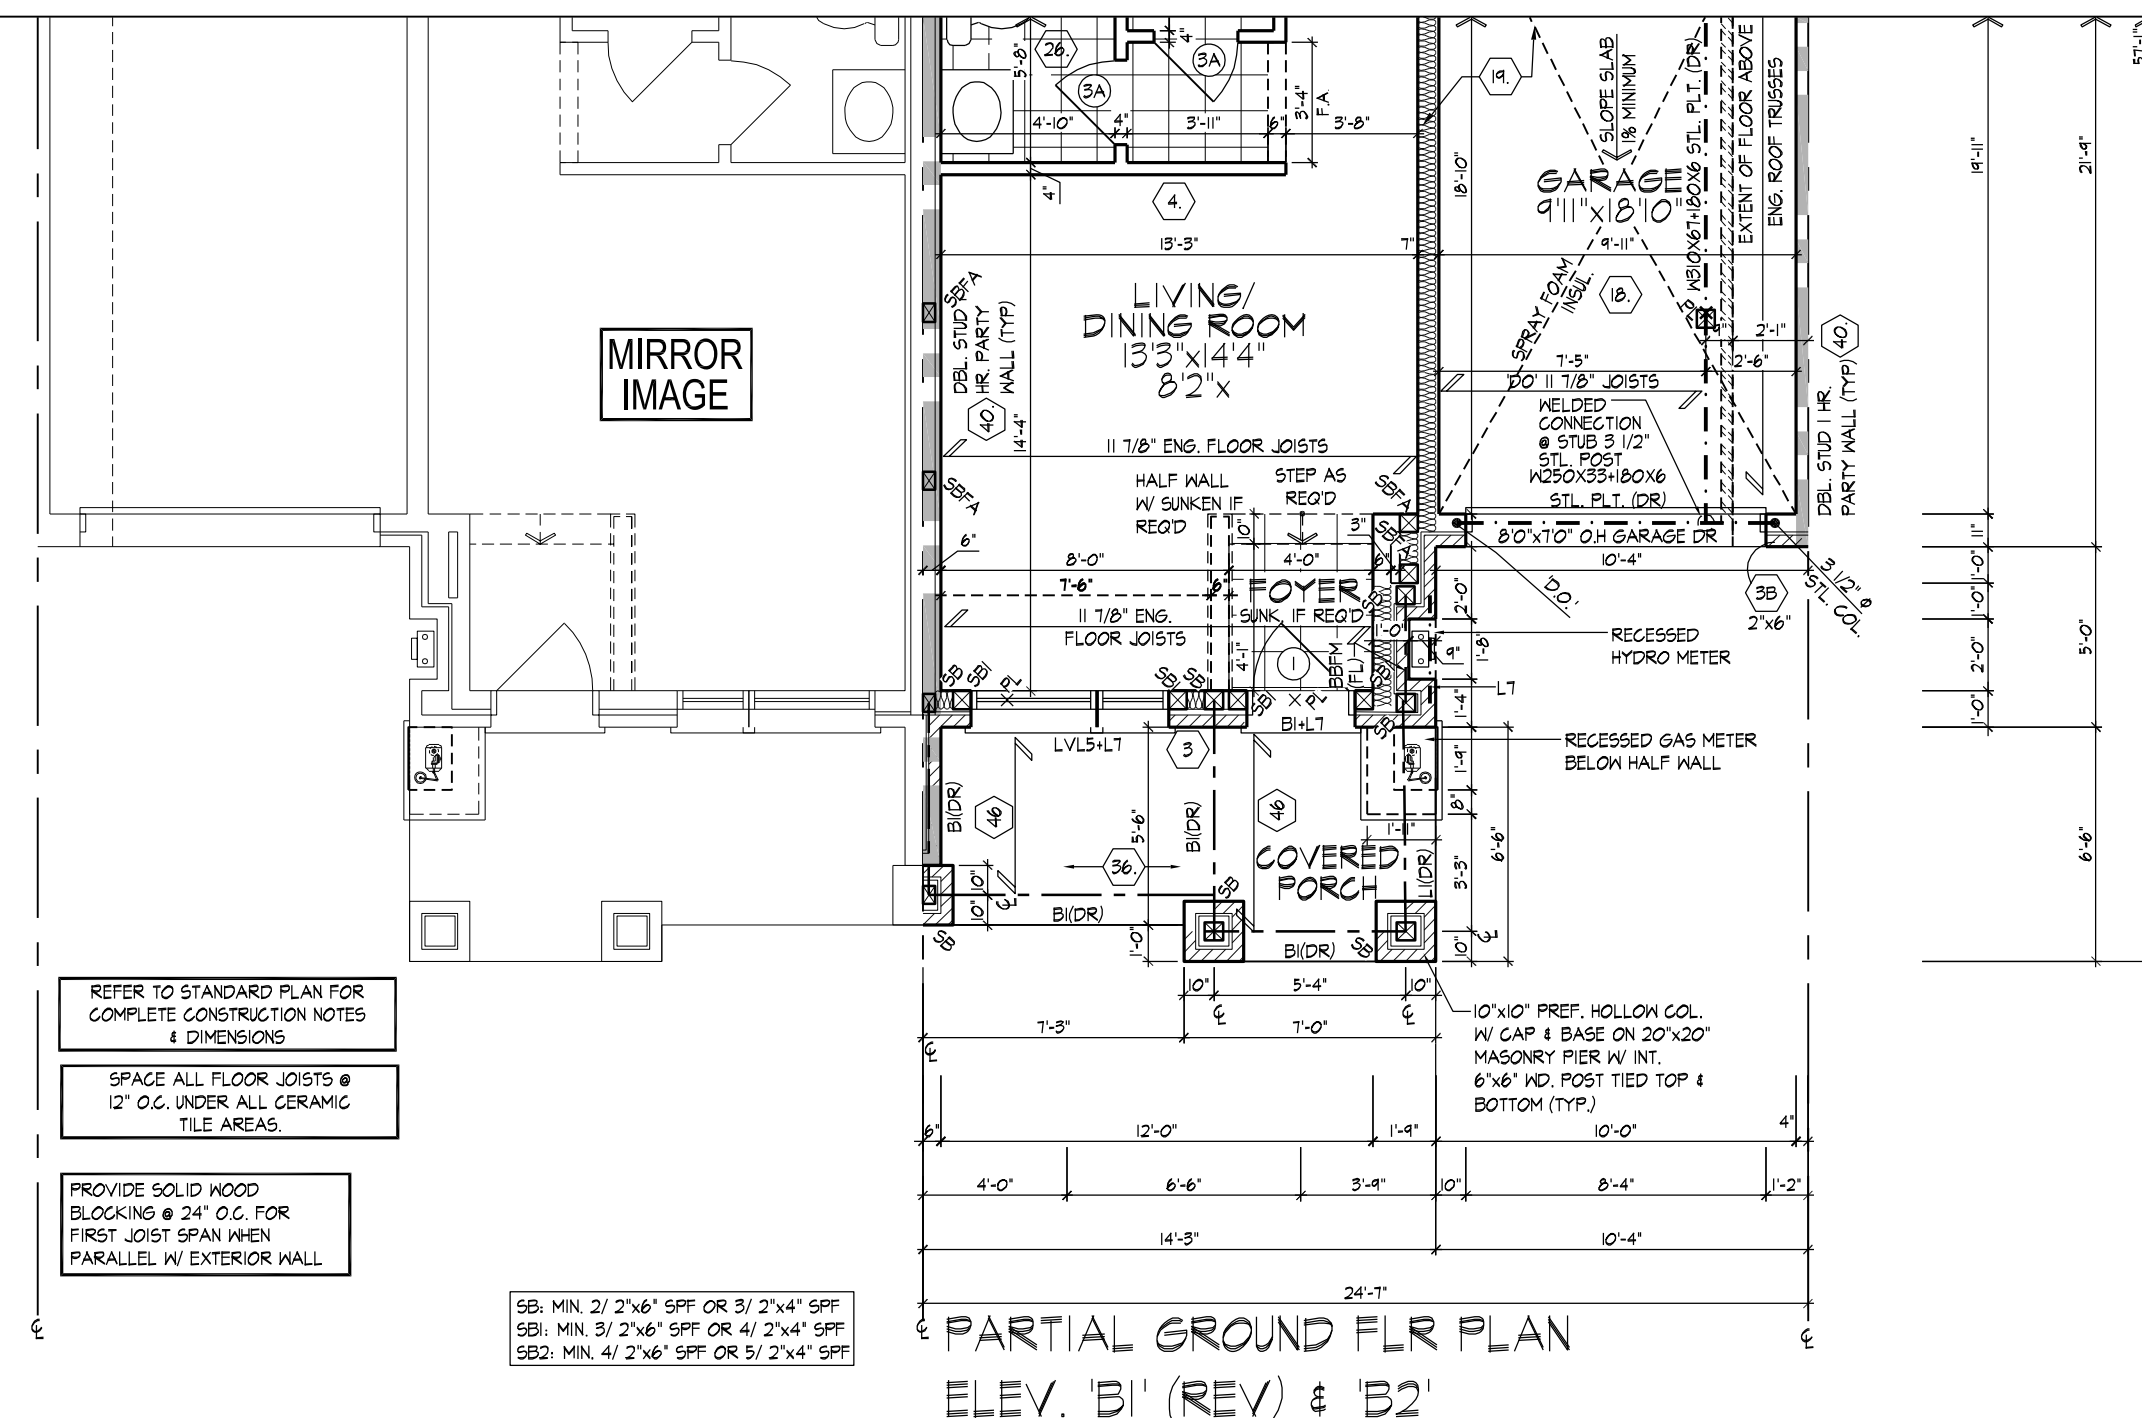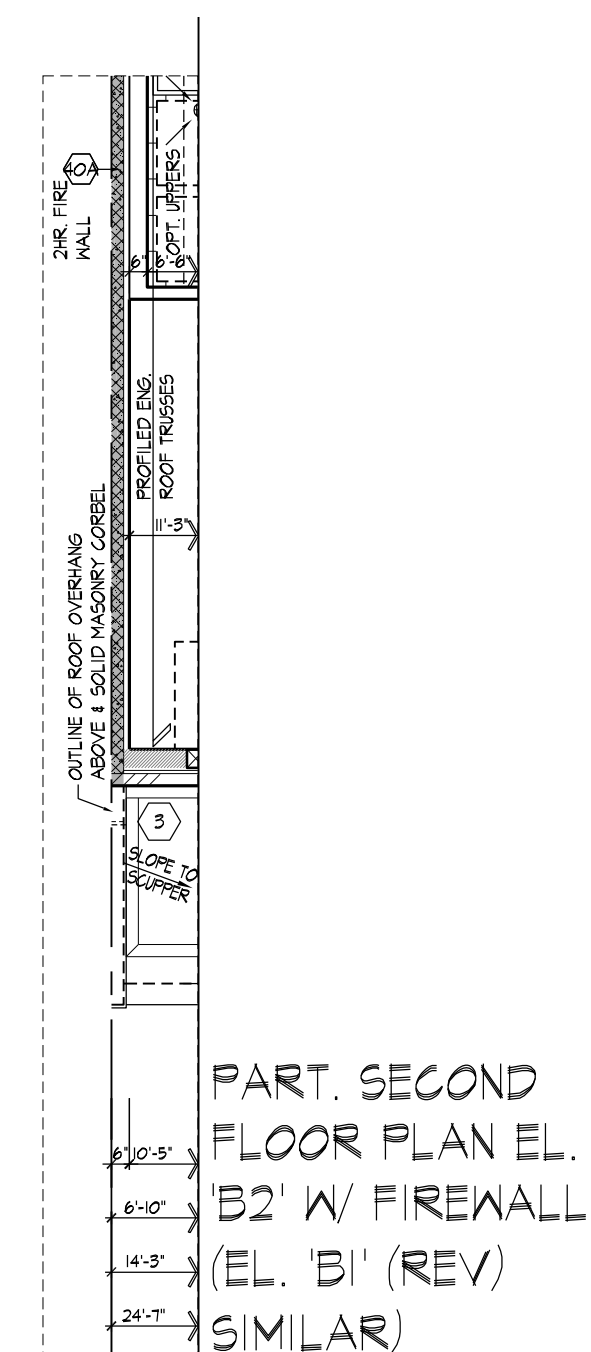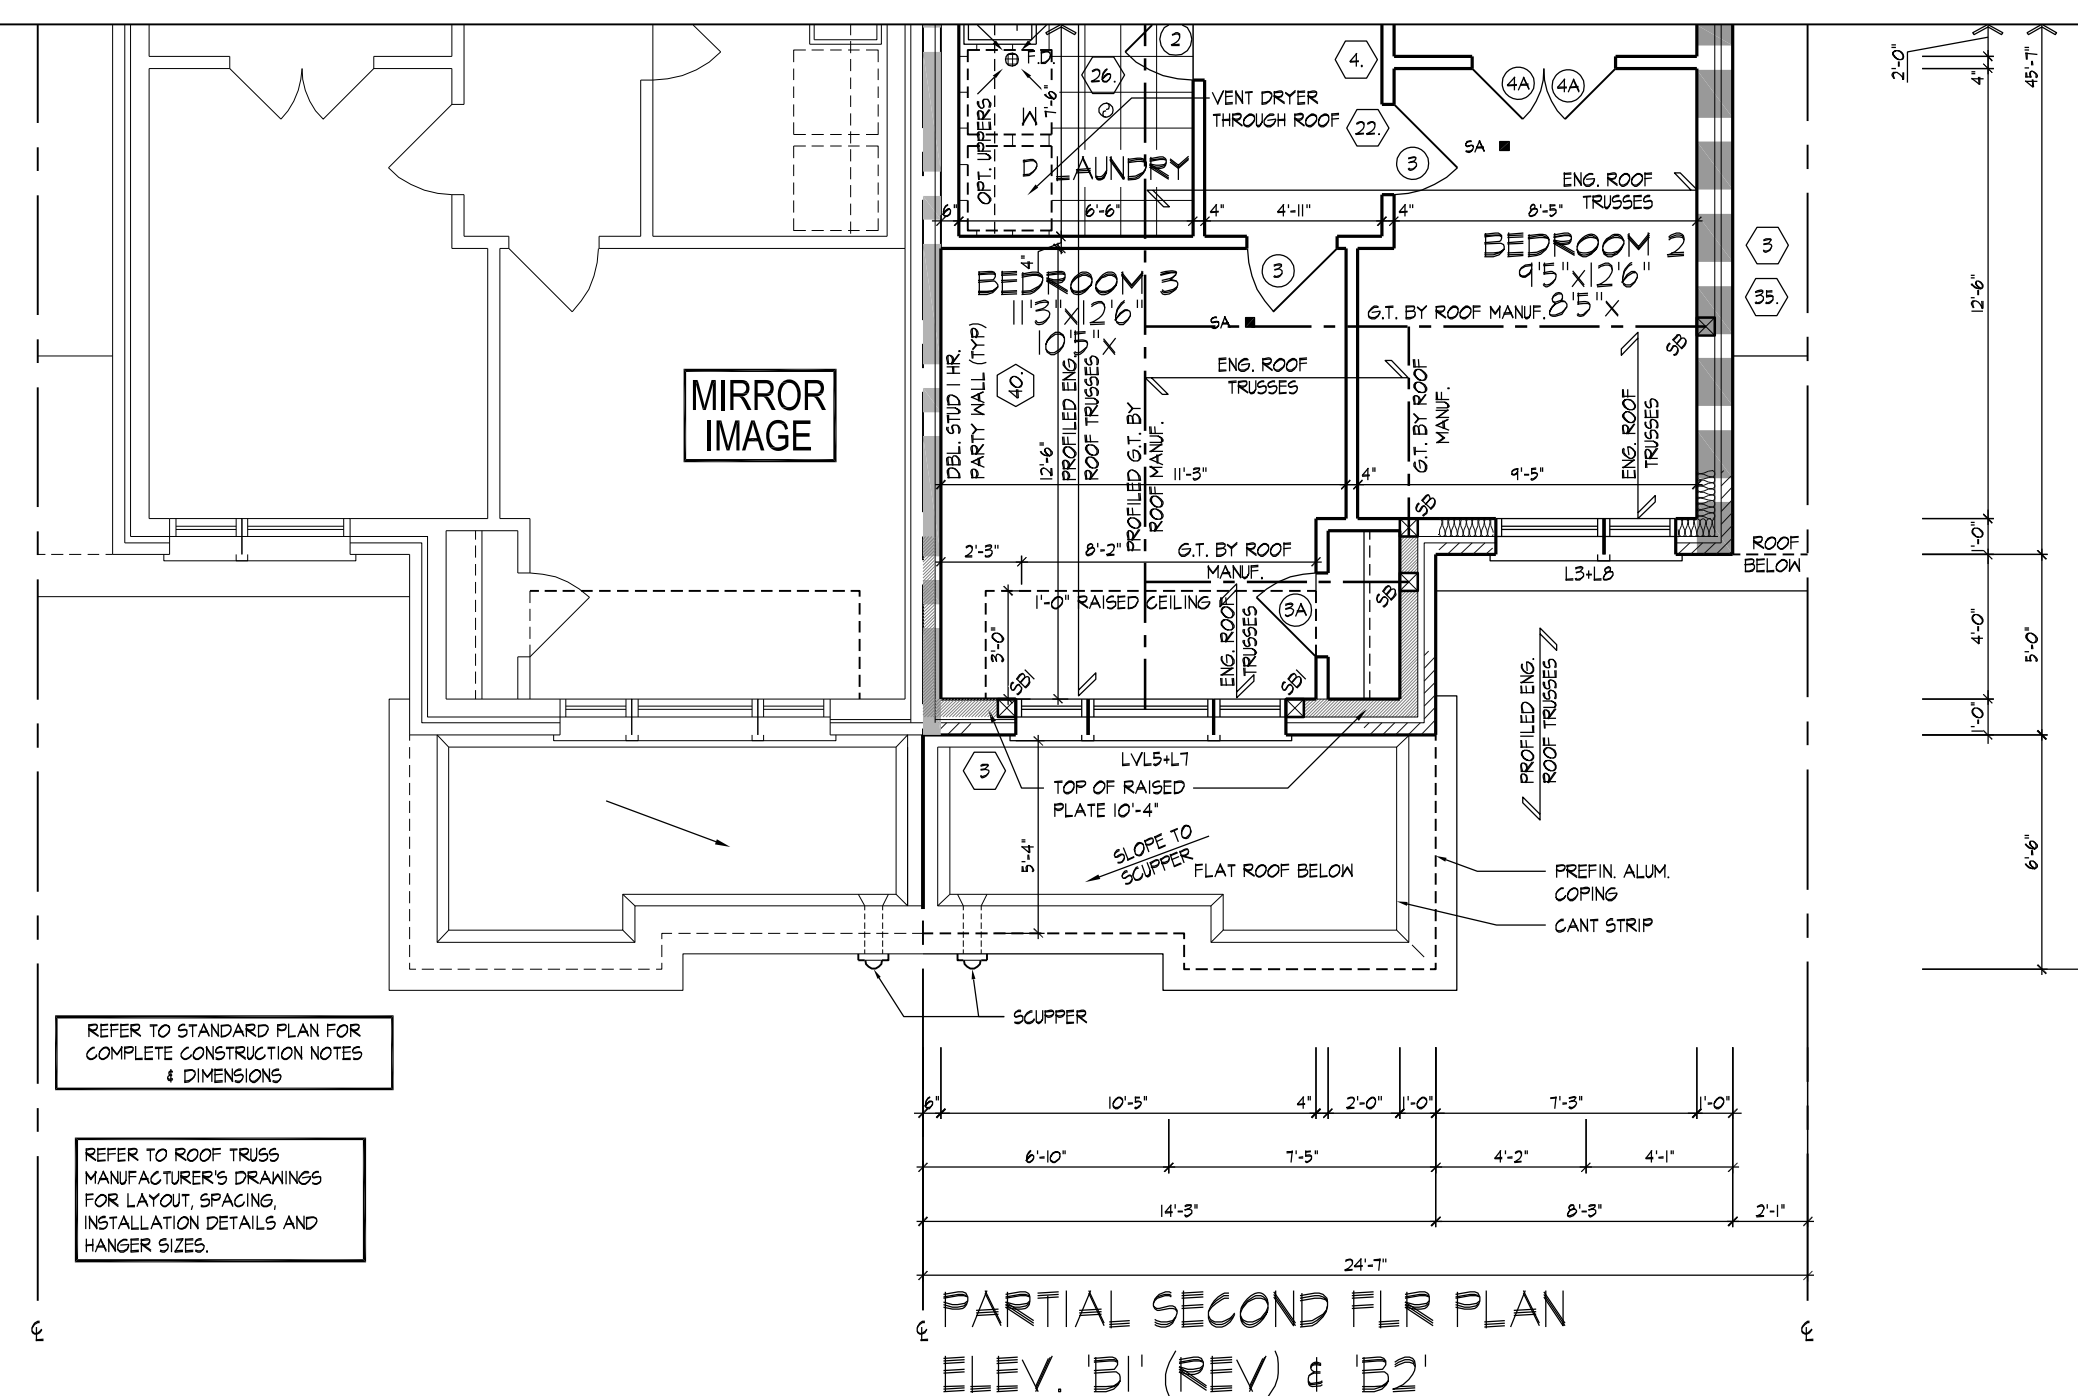

W Architect Inc.
DESIGN CONTROL REVIEW
MAR. 31, 2023

FINAL BY: ALC

SB: MIN. 2/ 2"x6" SPF OR 3/ 2"x4" SPF
SBI: MIN. 3/ 2"x6" SPF OR 4/ 2"x4" SPF
SB2: MIN. 4/ 2"x6" SPF OR 5/ 2"x4" SPF

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION		
Derek R. Santos		3730
NAME	SIGNATURE	BC
REGISTRATION INFORMATION		
HUNT DESIGN ASSOCIATES INC.		1969




All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission. H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.com

PARTIAL FLOOR PLANS, ELEV 'B1' (REV.) & 'B2'				
ROYAL PINE HOMES - 216051			'UNIT - 250251	
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO			REV.2023.02.14	
Drawn By	Checked By	Scale	File Number	Page Number
JMc	VL	3/16"=1'-0"	216051WS2502	5 of 11



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEER
FLOOR OR ROOF SYSTEM

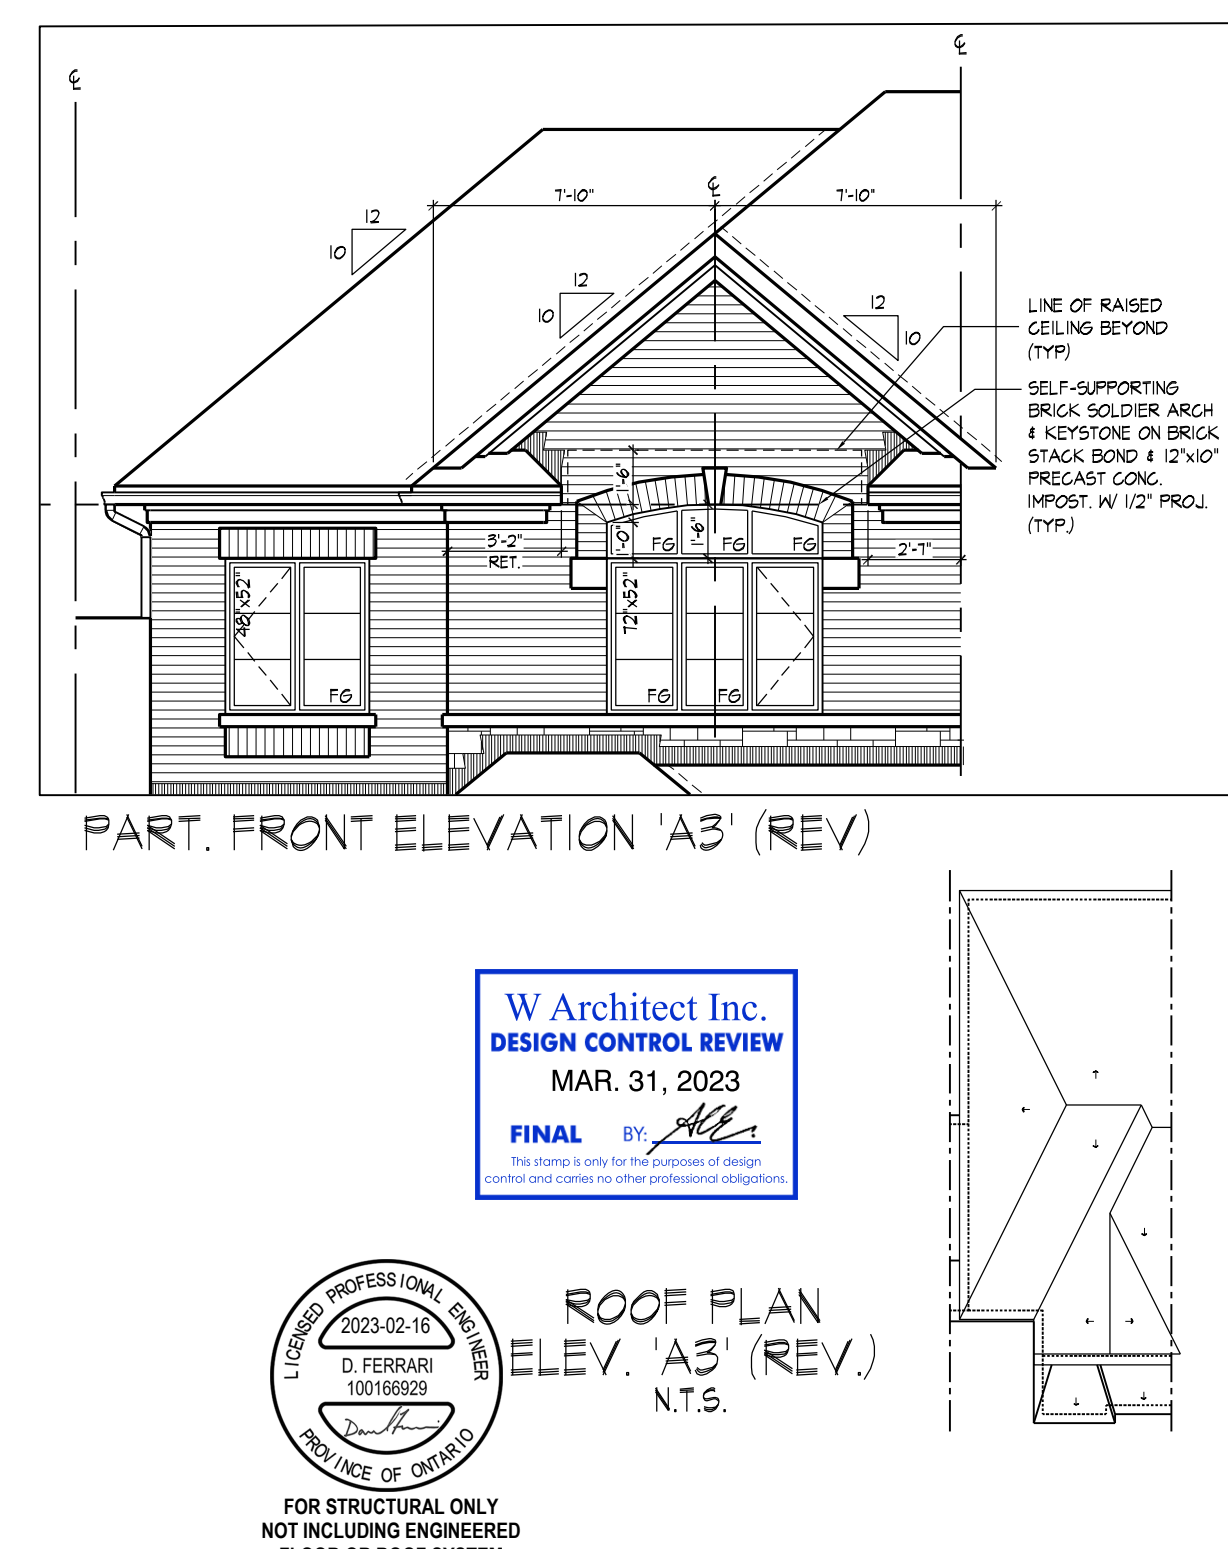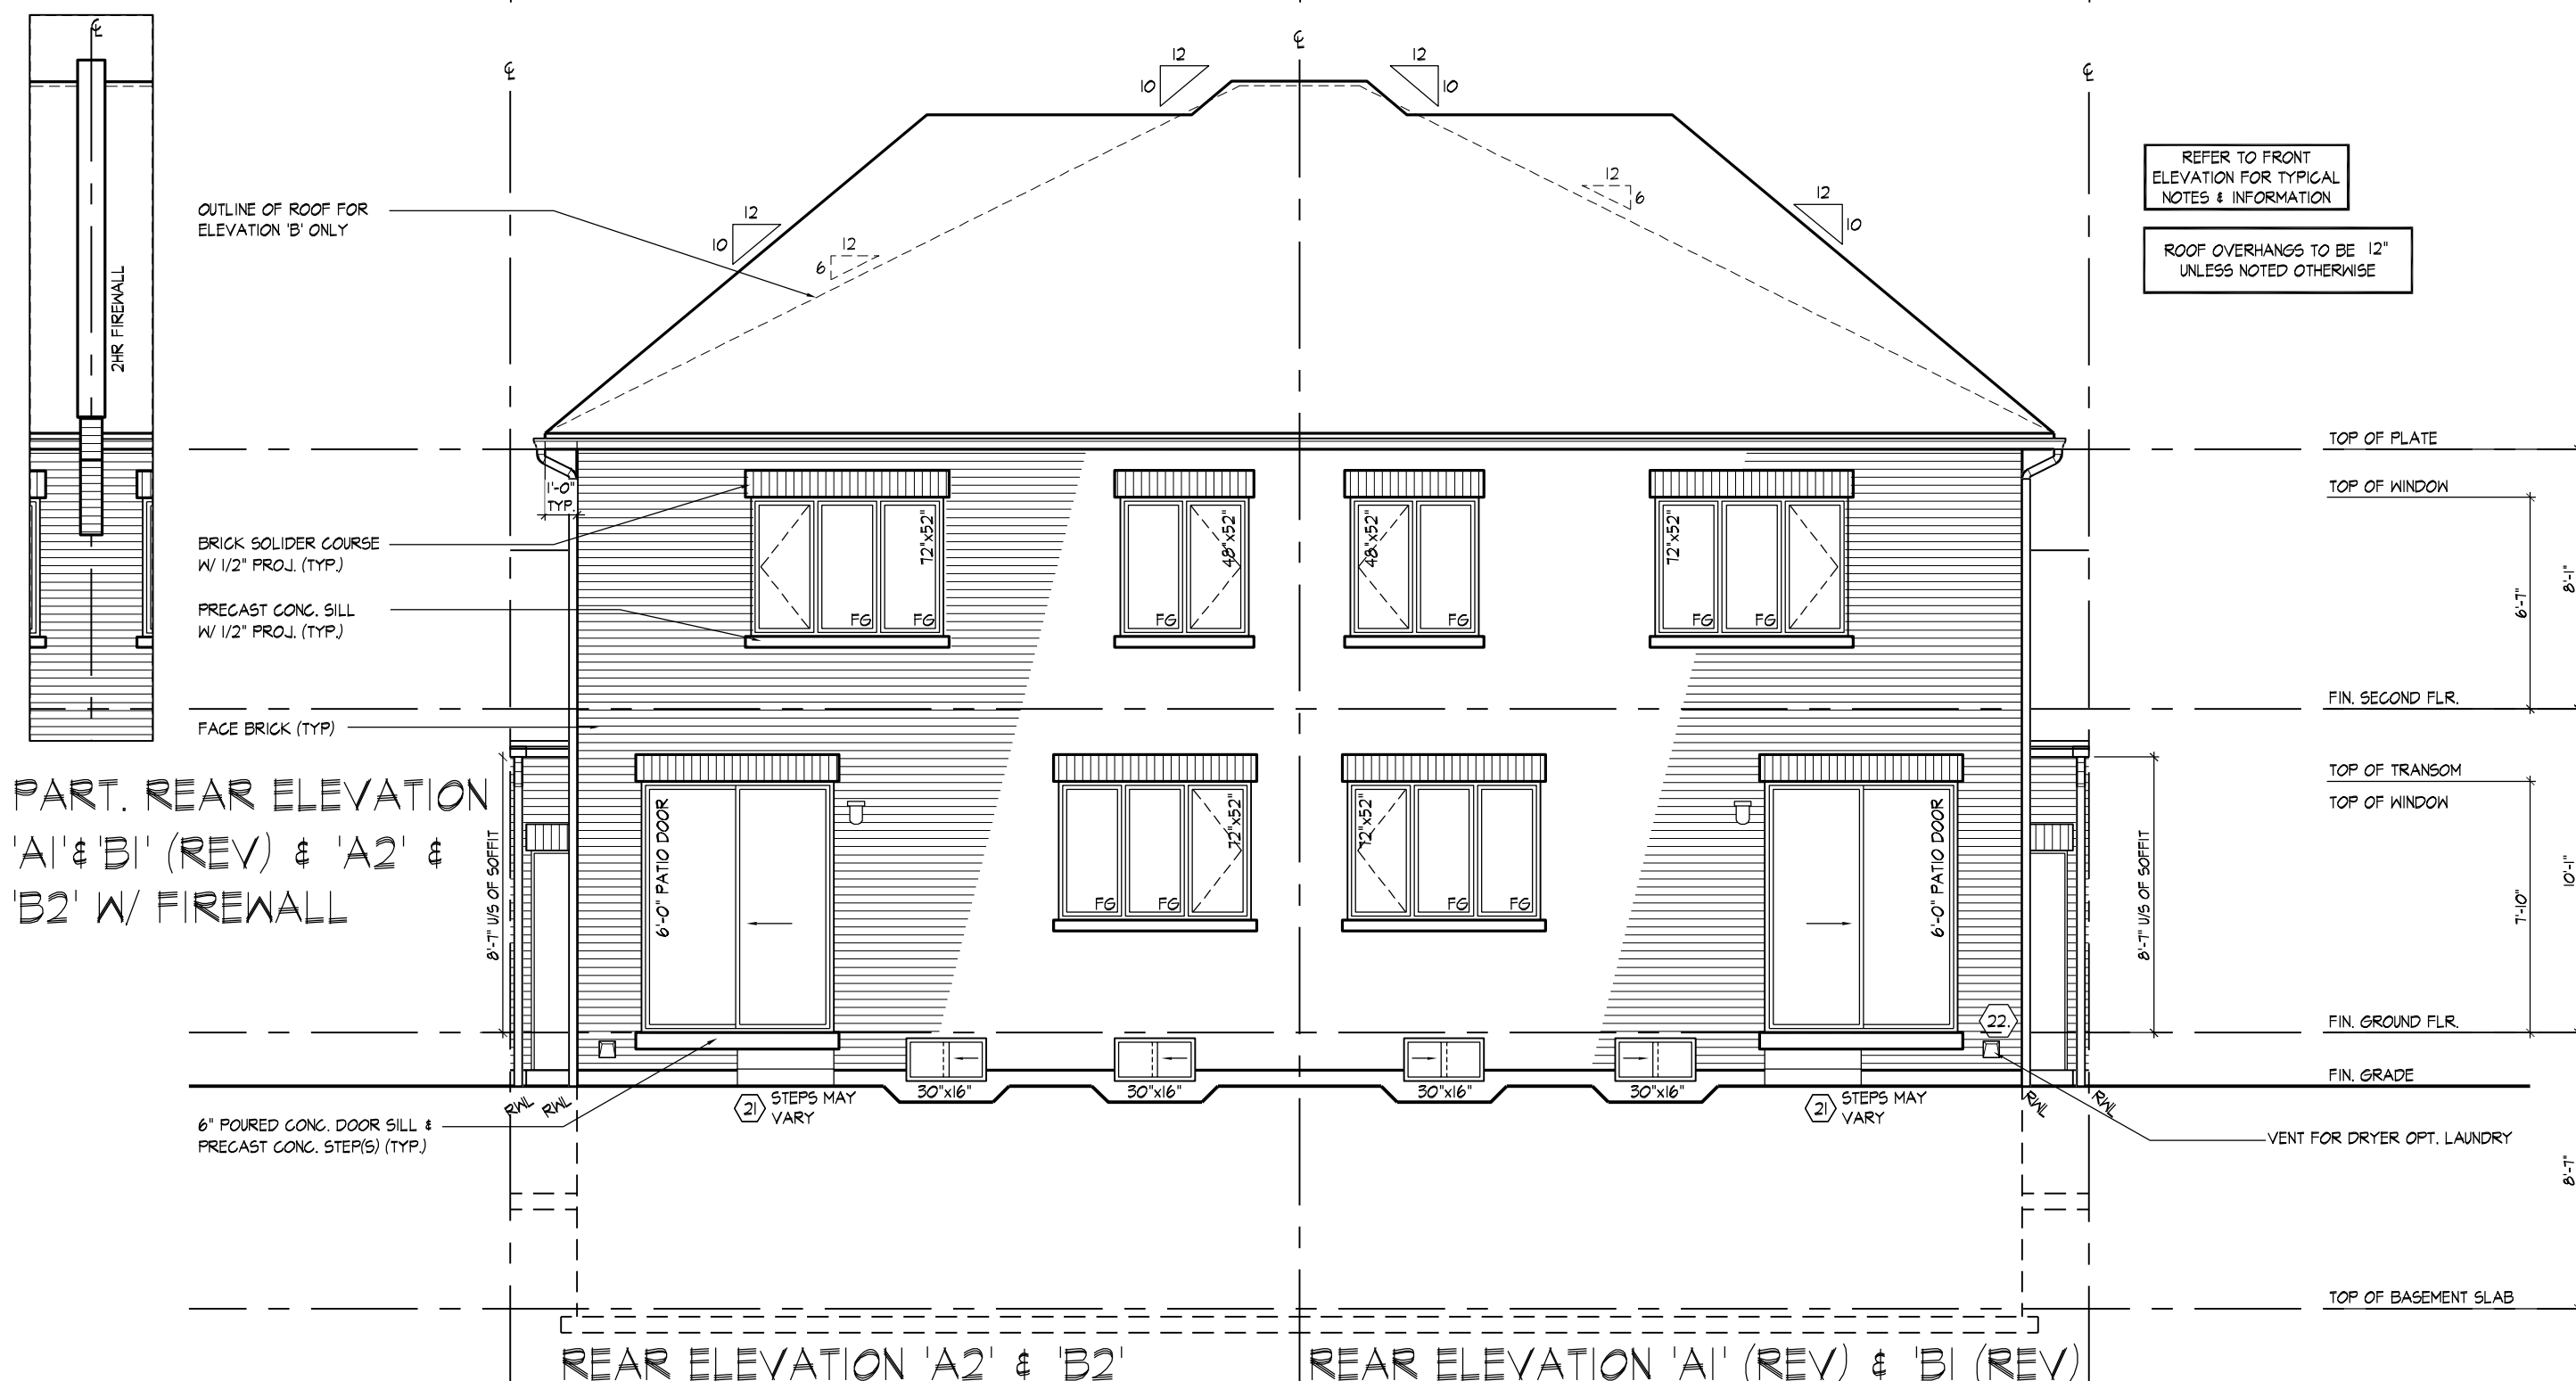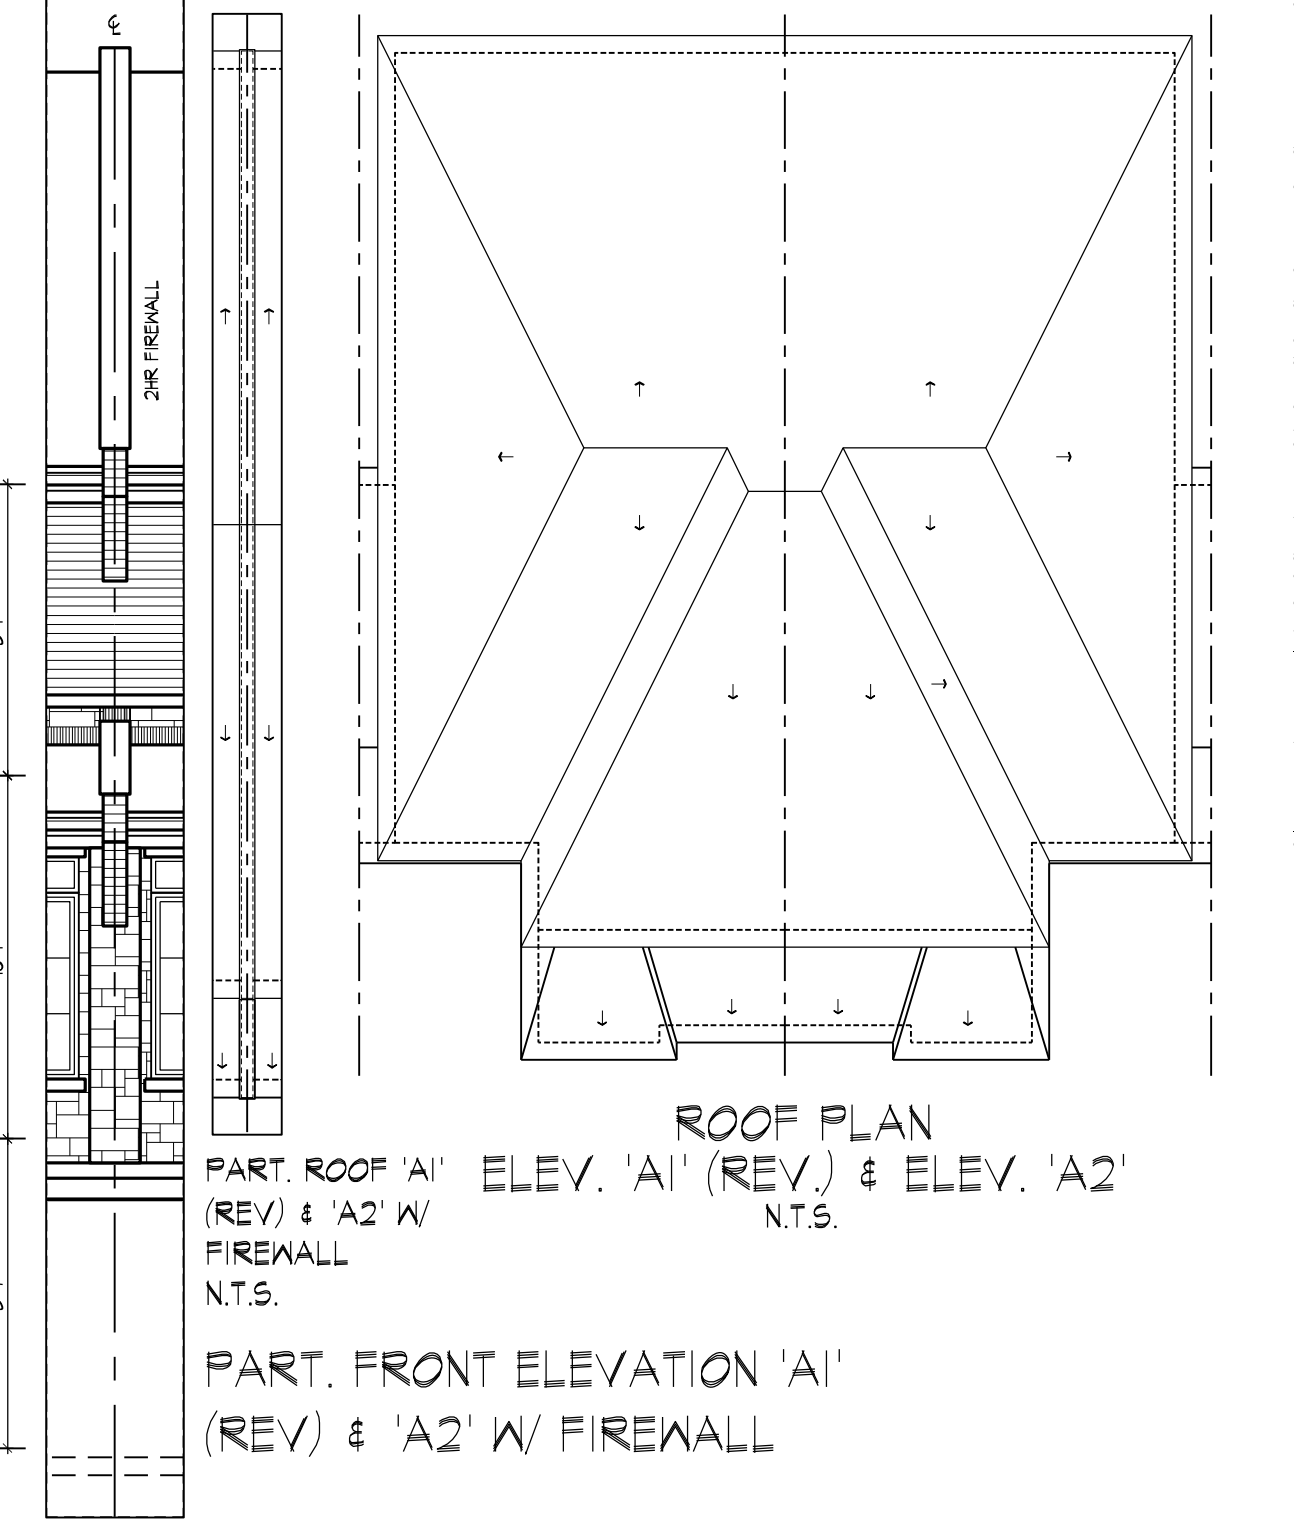

PART. REAR ELEVATION
'A1' & 'B1' (REV) & 'A2' &
'B2' W/ FIREWALL


PART. FRONT ELEVATION 'A3' (REV)

W Architect Inc.
DESIGN CONTROL REVIEW
MAR. 31, 2023
FINAL BY: *ALH*
This stamp is only for the purposes of design
control and carries no other professional obligations.

PROFESSIONAL ENGINEER
2023-02-16
D. FERRARI
100166929
PROVINCE OF ONTARIO


ROOF PLAN
ELEV. 'A3' (REV.)
N.T.S.

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

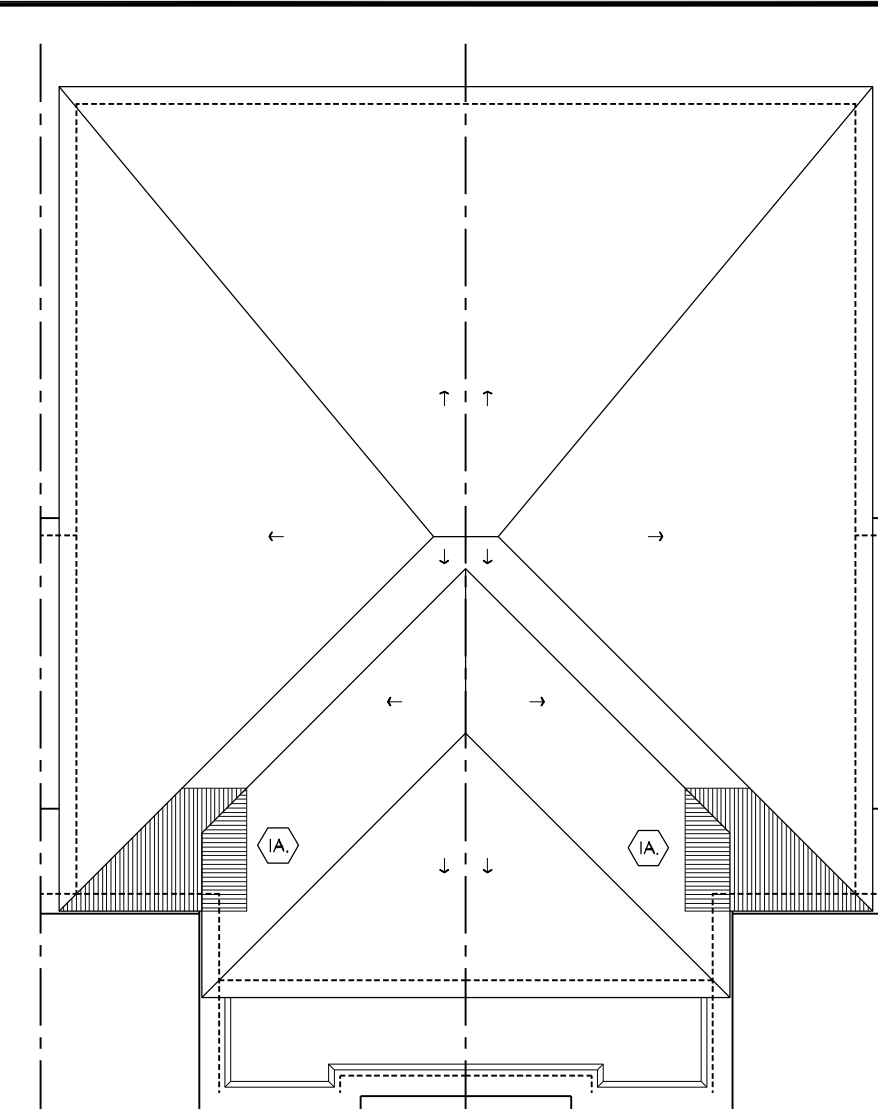

PART. ROOF 'B1' (REV) & 'B2' W/ FIREWALL N.T.S.

PART. FRONT ELEVATION 'B1' (REV) & 'B2' W/ FIREWALL

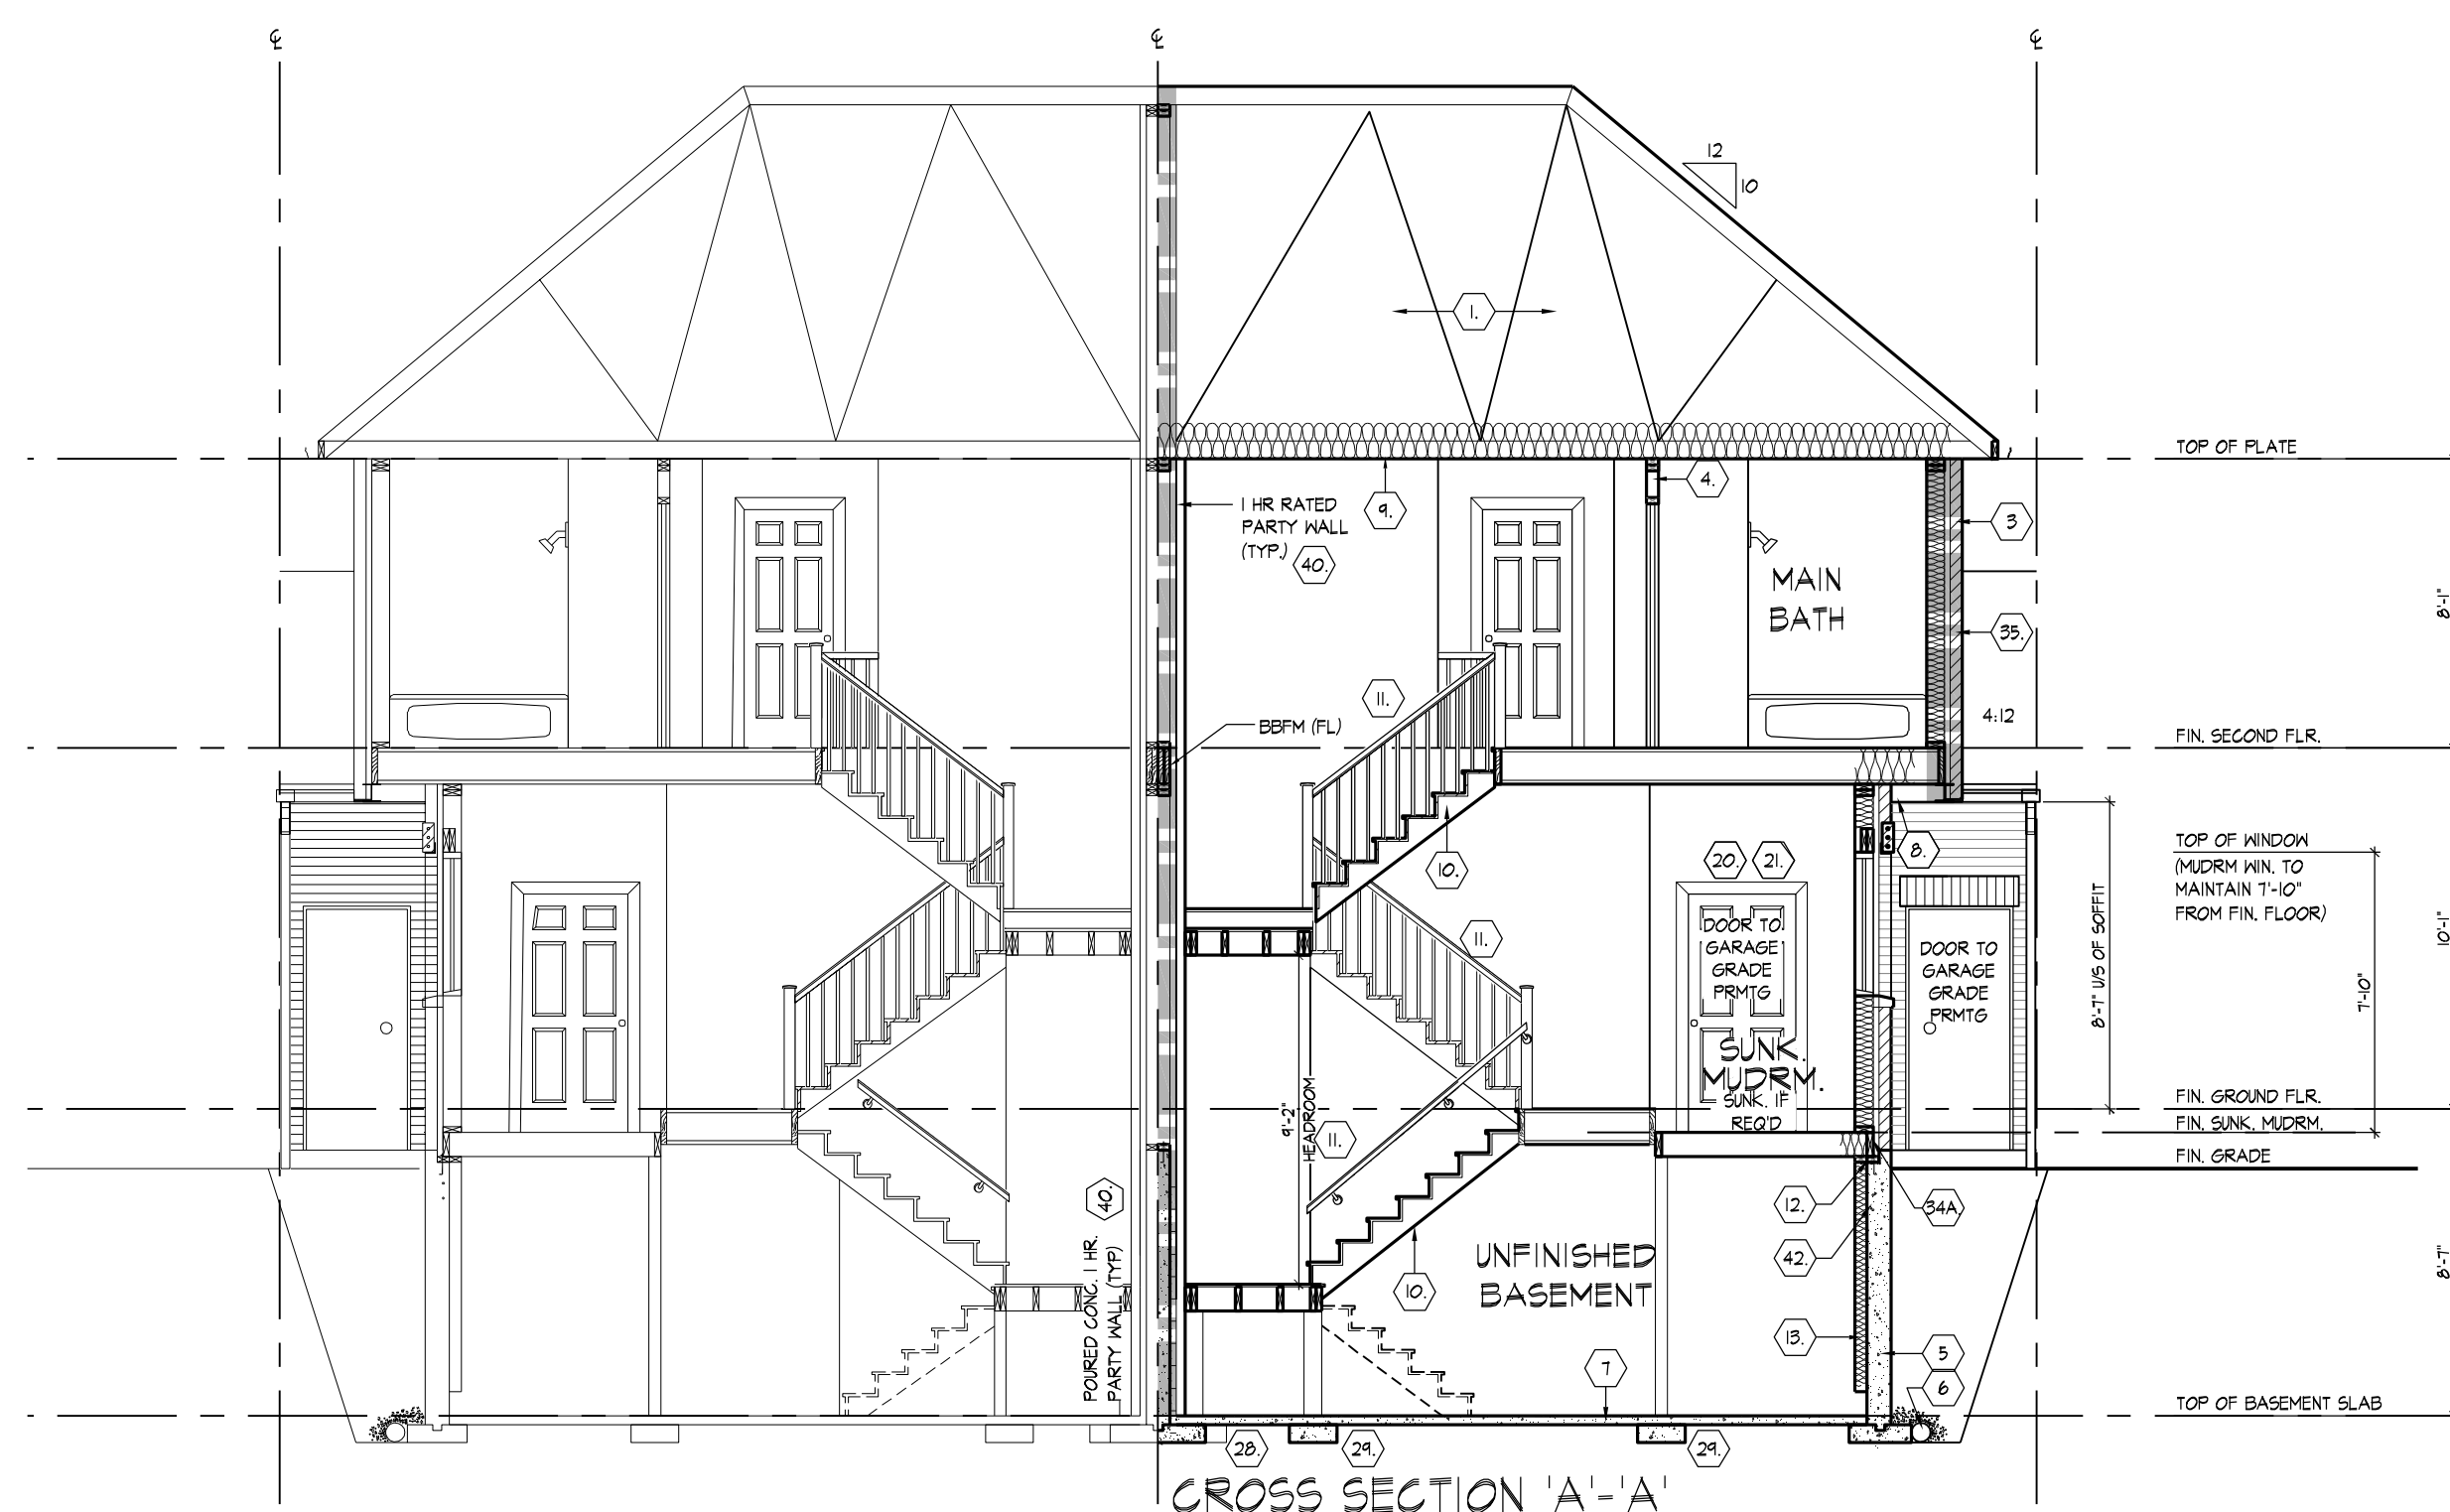

W Architect Inc.
DESIGN CONTROL REVIEW
MAR. 31, 2023
FINAL BY: *ALC*

PROFESSIONAL ENGINEER
2023-02-16
D. FERRARI
100166929
PROVINCE OF ONTARIO

FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

FRONT ELEVATION 'B1' (REV.), 'B2' / CROSS SECTION 'A-A'
UNIT - 2502
REV.2023.02.14

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Derek R. Santos 37308
NAME: DRS
SIGNATURE: *DRS*
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC. 19695
8966 Woodbine Ave., Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326
www.huntdesign.ca

HUNT DESIGN ASSOCIATES INC.

24'-7"

11'-5"

2'-1"

6"

6'-7"

4'-6"

4"

1'-0"

8'-0"

7'-4"

13'-6"

4"

4"

6" x 6" P.T. POSTS TIED TO TOP OF 12" Ø 15MPA POURED CONC. PIER WITH NON-CORROSIVE METAL SHOE (TYP)

2" x 4" P.T. CROSS BRACING

JOISTS TO BEAR ON DOUBLE 2" x 8" P.T. RIM BOARD. RIM BOARD TIED TO FOUNDATION WALL WITH 5/8" Ø GALV. MACHINE BOLTS @ 24" O.C. STAGGERED. BRICK VENEER SHALL NOT BE LOAD BEARING. REFER TO DETAIL OT ON PAGE 1-6 OF STD. DETAILS (TYP)

LINE OF DECK ABOVE

3" x 2" x 8" P.T. BM. (DR)

2" x 8" P.T. 15/15 @ 16" O.C.

4'-8"

5'-0"

BOND MASONRY VENEER TO FOUNDATION WALL AS PER DETAIL OT ON PAGE 1-6 OF STD. DETAILS (TYP)

UNFINISHED BASEMENT

NOTE:
10' CONC. FOUNDATION WALL W/ 2" x 6" KNEEWALL MAY BE REQUIRED DEPENDING ON BACKFILL HEIGHT. REFER TO SITING & DETAIL 05 ON PAGE 1-5 OF STD. DETAILS

REFER TO STANDARD PLAN FOR COMPLETE CONSTRUCTION NOTES & DIMENSIONS

2'x4" P.T. TOP RAIL, 2'x4" P.T. RAIL, 2'x2" P.T. PICKETS @ 4" O.C. MAX. (TYP)

4'x4" P.T. MAIN CORNER POSTS, 4'x4" P.T. INTER. POSTS AT 5'-1" O.C. MAXIMUM (TYP)

P.T. BEAM AS PER PLANS TIED TO TOP OF 6'x6" P.T. POSTS TIED TO TOP OF 12" x 16" x 8" CONG. PIER WITH NON-CORROSIVE METAL SHOE (TYP)

FIN. SECOND FLR

TOP OF TRANSOM

TOP OF WINDOW

FIN. GROUND FLR

FIN. GRADE

TOP OF BASEMENT SLAB

10'-1"

10'-0"

4'-0" MIN.

REAR ELEVATION - NO D CONDITION

W Architect Inc.

W Architect Inc
DESIGN CONTROL REVIEW
MAR. 31, 2023
FINAL BY: *ACE*
This stamp is only for the purposes of design control and carries no other professional obligation.



FOR STRUCTURAL ONLY
NOT INCLUDING ENGINEERED
FLOOR OR ROOF SYSTEM

WALK-OUT DECK CONDITION

'UNIT - 2502'

REV.2023.02.14

Page Number

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
 QUALIFICATION INFORMATION
 E. J. B. C. A.

Derek R. Santos		3730
NAME	SIGNATURE	DO

NAME	SIGNATURE	BO
REGISTRATION INFORMATION		

HUNT DESIGN ASSOCIATES INC.	1969
-----------------------------	------

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission. (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.com

ROYAL PINE HOMES - 216051
"LEAFTRAIL HOLDINGS", BRAMPTON, ONTARIO

Drawn By	Checked By	Scale	File Number
----------	------------	-------	-------------

JMc	VL	3/16"=1'-0"	216051WS250
-----	----	-------------	-------------

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

SECTION 1.0. CONSTRUCTION NOTES

- 1 ROOF CONSTRUCTION** (9.19, 9.23.13, 9.23.15)
- NO. 210 (10.25 KG/M2) ASPHALT SHINGLES, 3/8" (9.5) PLYWOOD SHEATHING WITH 1" CLIPS, APPROVED WOOD TRUSSES @ 24" (610) C.C. MAX. APPROVED EAVES PROTECTION AND DRAIN @ 24" (610) C.C. MIN. PROVIDE 2" (51) MIN. 12" (305) BEYOND INNER FACE OF EXTERIOR WALL, 2"x4" (38x89) TRUSS BRACING @ 6'-0" (1830) C.C. AT BOTTOM CHORD, PREFIN. ALUM. EAVESTROUGH, FASCIA, RVL, & VENTED SOFFIT, ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH TOP OF RAISED OPENINGS LOCATED AT TOP OF SPACE & MIN. 25% OF REQUIRED OPENINGS LOCATED AT BOTTOM OF SPACE. EAVESTROUGH TO BE 4" MIN. WITH RVL DISCHARGING ONTO CONCRETE SPLASH PADS OR PER MUNICIPAL REQUIREMENTS. TOWNHOUSES TO HAVE 9" MIN. EAVESTROUGH WITH ELEG. TRACED HEATER CALE ALONGS EAVESTROUGH AND DOWN RVL.
- 1A ICE AND WATER SHEILD**
- PROVIDE ICE AND WATER SHEILD IN THE AREAS INDICATED. THE ICE AND WATER SHEILD SHALL BE A SELF-ADHERING AND SELF-SEALING MEMBRANE. SIDE LAPS MUST BE A MINIMUM 5" (127) AND END LAPS A MINIMUM 6" (152), AND TO EXTEND UP DORMER WALLS A MINIMUM 12" (305).
- 1B PROFILED ROOF TRUSSES**
- ROOF TRUSSES SHALL BE PROFILED AND/OR STEPPED AT RAISED COFFERTRAY CEILINGS, ANGLED TRAY CEILINGS WILL BE SHEATHED W/ 3/8" (9.5) PLYWOOD.
- 2 SIDING WALL CONSTRUCTION (2"x6")**
- SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS, FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1) (REFER TO 35 NOTE AS REQ.)
- 2A SIDING WALL CONSTRUCTION (2"x6") W/ CONTIN. INSULATION**
- SIDING MATERIAL AS PER ELEVATION ATTACHED TO FURNISH MEMBERS ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.2.7.3, ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS ON 3/8" (9.5) EXT. GRADE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1) (REFER TO 35 NOTE AS REQ.)
- 2B SIDING WALL @ GARAGE CONSTRUCTION**
- SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS, FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, GYPSUM SHEATHING, RIGID INSULATION AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1) (REFER TO 35 NOTE AS REQ.)
- 3 BRICK VENEER WALL CONSTRUCTION (2"x6")**
- 3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) C.C. HORIZ. 24" (600) C.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.3. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, AND 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, PROVIDE WEEP HOLES @ 32" (800) C.C. BOTTOM COURSE AND OVER OPENINGS, PROVIDE BASE FLASHING UP MIN. 6" (150) BEHIND BUILDING PAPER (9.20.13.6) (REFER TO 35 NOTE AS REQUIRED).
- 3A BRICK VENEER WALL CONSTRUCTION (2"x6") W/ CONTIN. INSULATION**
- 3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) C.C. HORIZ. 24" (600) C.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.3. ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.2.7.3, ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION AND 6 MIL. POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, PROVIDE WEEP HOLES @ 32" (800) C.C. BOTTOM COURSE AND OVER OPENINGS, PROVIDE BASE FLASHING UP MIN. 6" (150) OVER RIGID INSULATION (9.20.13.6) (REFER TO 35 NOTE AS REQUIRED)
- 3B BRICK VENEER WALL @ GARAGE CONSTRUCTION**
- 3 1/2" (90) BRICK VENEER, MIN. 1" (25) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) C.C. HORIZ. 24" (600) C.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.3. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION AND 6 MIL. POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, PROVIDE WEEP HOLES @ 32" (800) C.C. BOTTOM COURSE AND OVER OPENINGS, PROVIDE BASE FLASHING UP 6" (150) MIN. BEHIND BUILDING PAPER (9.20.13.6) (REFER TO 35 NOTE AS REQ.)
- 4 INTERIOR STUD PARTITIONS** (9.23.9.8, 9.23.10)
- BEARING PARTITIONS SHALL BE A MINIMUM 2"x4" (38x89) @ 16" (406) C.C. FOR 2 STOREY AND 12" (305) C.C. FOR 3 STOREY, NON-BEARING PARTITIONS 2"x4" (38x89) @ 24" (610) C.C. PROVIDE 2"x4" (38x89) BOTTOM PLATE AND 2"x4" (38x89) TOP PLATE, 1/2" (12.7) INT. DRYWALL, BOTH SIDES OF STUDS, PROVIDE 2"x6" (38x140) STUDS WHERE NOTED, PROVIDE 2"x4" (38x89) @ 24" (610) C.C. LADDER FRAMING WHERE WALLS INTERSECT PERPENDICULAR TO ONE ANOTHER, PROVIDE 2"x4" (38x89) WOOD BLOCKING @ 16" (406) C.C. MAX. BETWEEN RAISED DOOR OR JOISTS WHEN NON-ADJACENT WALLS ARE PARALLEL TO FLOOR JOISTS.
- 4A EXT. LOFT WALL CONSTRUCTION (2"x6") - NO CLADDING**
- 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION AND 6 MIL. POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (9.23.)
- 4B EXT. LOFT WALL CONSTRUCTION (2"x6") NO CLADDING W/ CONTINUOUS INSULATION**
- APPROVED AIRWATER BARRIER AS PER O.B.C. 9.2.7.3, ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION AND 6 MIL. POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (9.23.)
- 5 FOUNDATION WALL/FOOTINGS**
- POURED CONC. FOUNDATION WALL AS PER CHART BELOW ON CONTINUOUS KEYED CONCRETE FOOTING. FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150) ABOVE FINISHED GRADE, THE OUTSIDE OF THE FOUNDATION SHALL BE DAMPROOFED FROM THE TOP OF THE FOOTING TO FINISHED GRADE AND BRUSH COAT FROM THE TOP TO 2" BELOW GRADE, PROVIDE A DRAINAGE LAYER ON THE OUTSIDE OF THE FOUNDATION WALL, SEAL THE DRAINAGE LAYER AT THE TOP, THE TOP OF THE CONC. FOOTING SHALL BE DAMPROOFED. CONCRETE FOOTINGS SUPPORTING JOIST SPANS GREATER THAN 16' (4890) SHALL BE SIZED IN ACCORDANCE WITH 9.15.3.4.1 (1)2 OF THE O.B.C. (REFER TO CHART BELOW FOR RESPECTIVE SIZE), BRACE FOUNDATION WALL PRIOR TO BACKFILLING, ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OF 75kPa OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150kPa. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED, ACTUAL SOIL BEARING CAPACITY TO BE VERIFIED WITH SOIL ENGINEERING REPORT.
- REFER TO CONSTRUCTION DRAWINGS AND DETAILS FOR FOUNDATION WALL STRENGTH AND THICKNESS AND 9.15.4.
- FOUNDATION WALLS SHALL NOT EXCEED 9' (3.0m) IN UNSUPPORTED HEIGHT UNLESS OTHERWISE NOTED. (9.15.4.2.1.1)
- | UNREINFORCED SOLID CONCRETE FOUNDATION WALLS (9.15.4.2) | | | | |
|---|----------------|------------------|------------------|-------------------|
| MAX. HEIGHT FROM FIN. SLAB TO GRADE | | | | |
| AT TOP | UNSUPPORTED | SUPPORTED AT TOP | | |
| 10' 15 MPa | 3'-11" (1.20m) | 2'-5 1/2" (7.6m) | 2'-5 1/2" (7.6m) | 3'-7 1/2" (1.10m) |
| 10' | 4'-7" (1.40m) | 7'-4" (2.25m) | 7'-4" (2.25m) | 8'-2" (2.50m) |
| 12' | 4'-11" (1.50m) | 7'-4" (2.25m) | 8'-6" (2.60m) | 9'-3" (2.85m) |
| * 8' | 3'-11" (1.20m) | 7'-4" (2.25m) | 7'-4" (2.25m) | 7'-2" (2.20m) |
| 10' | 4'-7" (1.40m) | 7'-4" (2.25m) | 8'-6" (2.60m) | 9'-3" (2.85m) |
| 12' | 4'-11" (1.50m) | 7'-4" (2.25m) | 8'-6" (2.60m) | 9'-3" (2.85m) |
- * 9" MIN. THICK FOUNDATION WALL IS REQUIRED FOR MASONRY VENEER FINISHED EXTERIOR WALLS WITH CONTINUOUS INSULATION CONDITION, TO PROVIDE MIN. BEARING FOR 3" PLATES, BEAMS AND FLOOR JOIST AS PER 9.23.7.2, 9.23.8.1, & 9.23.9.1, OF THE O.B.C.
- | MINIMUM STRIP FOOTING SIZES (9.15.3) | | | | |
|--------------------------------------|------------------------------|---------------------|----------------------|--|
| NUMBER FLOORS SUPPORTED | SUPPORTING INT. LOAD BEARING | SUPPORTING EXTERIOR | SUPPORTING PARTWALL | |
| 1 | 16" WIDE x 8" THICK | 16" WIDE x 8" THICK | 16" WIDE x 8" THICK | |
| 2 | 24" WIDE x 8" THICK | 20" WIDE x 8" THICK | 24" WIDE x 8" THICK | |
| 3 | 36" WIDE x 8" THICK | 26" WIDE x 8" THICK | 36" WIDE x 14" THICK | |

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

- 5A FOUNDATION REDUCTION IN THICKNESS FOR MASONRY**
- WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF MASONRY EXTERIOR FACING, THE REDUCED SECTION SHALL BE NOT LESS THAN 3 1/2" (90) THICK. THE BRICK VENEER SHALL BE TIED TO THE FOUNDATION WALL WITH CORROSION RESISTANT METAL TIES @ 7' 7/8" (200) VERTICAL AND 2' 1" (89) HORIZONTAL, HILL VOID WITH MORTAR BETWEEN WALL AND BRICK VENEER (9.15.4.2.1.3) & 9.20.9.4(3)
- 5B FOUNDATION REDUCTION IN THICKNESS FOR JOISTS**
- WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF JOIST JOINTS, THE REDUCED SECTION SHALL BE NOT MORE THAN 3 1/4" (86) HIGH AND NOT LESS THAN 3 1/2" (90) THICK (9.15.4.2.1.1)
- 6 WEeping TIE** (9.14.3)
- 4" (100) Ø WEeping TIE W/ FILTER CLOTH WRAP & 6" (152) CRUSHED STONE COVER
- 7 BASEMENT SLAB OR SLAB ON GRADE** (9.16.4) (9.13)
- 3" (80) MIN. 25MPa (3800psi) CONC. SLAB ON 4" (100) COARSE GRANULAR FILL OR 20MPa (2900psi) CONC. SLAB ON 4" (100) COARSE GRANULAR FILL, PROVIDE 1/2" (12.7) IMPERVIOUS BOARD FOR SOND BREAK AT EDGE, WHERE A BASEMENT SLAB IS WITHIN 24" (610) OF THE EXTERIOR GRADE, PROVIDE RIGID INSUL. 1/2" (12.7) ABOVE THE PERIMETER EXTENDING MIN. 24" (610) BELOW GRADE, FOR SLAB ON GRADE CONDITIONS RIGID INSULATION SHALL BE APPLIED TO THE UNDERSIDE OF THE ENTIRE SLAB (INS-12) 3.1.1.7.6 (5) & (6)
- 8 EXPOSED FLOOR TO EXTERIOR** (9.10.17.10, & CANULC-S705.2)
- PROVIDE SPRAY FOAM INSULATION BETWEEN JOIST, SEAL AND INSTALL OSB CONFORMING TO 9.10.20.3. INT. FIN. SOFFIT OR CLADDING AS PER ELEVATION TO US OF EXPOSED CANT, JOIST.
- 9 EXPOSED CEILING TO EXTERIOR W/ ATTIC** (9.25.2.4)
- INSULATION 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INTERIOR FINISH OR APPROVED EQ.
- 9 EXPOSED CEILING TO EXTERIOR W/O ATTIC**
- JOISTS/TRUSSES AS PER PLANS W/ 2"x2" (38x38) PURLINS @ 16" (406) C.C. PERPENDICULAR TO JOISTS, PURLINS NOT REQ. W/ SPRAY FOAM OR ROOF TRUSSES) W/ INSULATION BETWEEN JOIST JOINTS, INSULATION TO BE 1/2" (12.7) GYPSUM BOARD INT. FINISH OR APPROVED EQ. (CANULC-S705.2, 9.19.1, 9.10.17.10)
- 10 ALL STAIRS/EXTERIOR STAIRS** (9.8.1.2, 9.8.2, 9.8.4)
- | MAX. RISE | MIN. RISE | MAX. RUN | MIN. RUN | ALL STAIRS |
|-----------------------|-----------|-----------|-----------|---------------------|
| PRIVATE 7' 7/8" (200) | 9" (125) | 14" (355) | 10" (255) | |
| PUBLIC 7' (203) | 9" (125) | 14" (355) | 11" (280) | MAX. NOSING 1" (25) |
- MIN. STAIR WIDTH TAPERED TREAS MIN. RUN 5' 7" (150) MIN. AVG. RUN 10" (255) MIN. AVG. RUN 5' 7" (150)
- AVERAGE RUN OF TAPERED TREAD MEASURED AT A POINT 300mm FROM THE CENTER LINE OF THE TREAD, (9.8.4.3.1)
- * HEIGHT OVER STAIRS HEADROOM IS MEASURED VERTICALLY ACROSS WIDTH OF STAIRS FROM A STRAIGHT LINE TO THE TREAD & LANDING NOSING TO LOWEST POINT ABOVE AND NOT LESS THAN 6'-9" (1950) FOR SINGLE DWELLING UNIT & 6'-8" (1905) FOR EVERYTHING ELSE. (9.8.2.2)
- REQUIRED LANDING IN GARAGE - O.B.C. 9.8.6.2.3)
- FOR AN EXTERIOR STAIR SERVING A GARAGE, W/ MORE THAN 3 RISERS, GUARDS, HANDRAILS & STEPS AS PER CONSTRUCTION HEX NOTE 10 & 11.
- 11 GUARDS/HANDRAILS** (9.8.7, 9.8.8)
- GUARDS TO BE DESIGNED NOT TO FACILITATE CLIMBING AND PROVIDING MAX. OPENING CONFORMING TO O.B.C. 9.8.8.5, & 9.8.8.6, AND BE ABLE TO RESIST LOADS AS PER TABLE 9.8.8.2
- GUARD HEIGHTS - O.B.C. 9.8.8
- INTERIOR GUARDS: 2' 10" (500) MIN. (LESS THAN 5'-11" (1800) TO GRADE)
- EXTERIOR GUARDS: 2' 10" (500) MIN. (LESS THAN 5'-11" (1800) TO GRADE)
- 5'-6" (1670) MIN. (FROM MORE THAN 5'-11" (1800) TO GRADE)
- GUARDS FOR EXIT STAIRS: 3'-6" (1070) MIN.
- GUARDS FOR LANDINGS @ EXIT STAIRS: 3'-6" (1070) MIN.
- GUARDS FOR FLOORS & RAMPS IN GARAGES (SERVICE STAIRS)
- ROOF OR RAMP W/ EXTERIOR WALLS THAT ARE 23' 5" (690) OR MORE ABOVE ADJACENT SURFACE REQUIRES CONT. CURB MIN. 5' 1/2" (140) HIGH, AND GUARD MIN. 3'-6" (1070) HIGH.
- REQUIRED GUARDS
- BETWEEN WALKING SURFACE & ADJACENT SURFACE WITH A DIFFERENCE IN ELEVATION MORE THAN 23' 5" (690) OR ADJACENT SURFACE WITHIN 3'-11" (1200) & WALKING SURFACE W/ A SLOPE OF MORE THAN 1 IN 12 SHALL BE PROTECTED WITH GUARDS PER CONSTRUCTION HEX NOTE 11.
- HANDRAIL HEIGHTS - O.B.C. 9.8.8.7, - REQUIRED AS PER 9.8.7.1.1(3)
- MIN. HEIGHT AT STAIRS, RAMPS AND LANDINGS: 2'-10" (685) MIN. MAX. HEIGHT AT STAIRS, RAMPS AND LANDINGS: 3'-6" (1070)
- 12 SILL PLATES**
- 2"x4" (38x89) SILL PLATE 1/2" (12.7) ANCHOR BOLTS 8" (200) LONG EMBEDDED MIN. 4" (100) INTO CONC. @ 7'-10" (2380) C.C., CAULKING OR GASKET BETWEEN PLATE AND TOP OF FOUNDATION WALL, USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED (9.23.7)
- 13 BASEMENT INSULATION** (INS-12) 3.1.1.7.1
- PROVIDE CONTINUOUS BLANKET INSULATION W/ BUILT IN 6 MIL. POLYETHYLENE VAPOUR BARRIER INSULATION TO EXTEND NO MORE THAN 2" (51) ABOVE FINISHED BASEMENT FLOOR, DAMPROOFED WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL.
- 14 BEARING STUD PARTITION IN BASEMENT** (9.15.3.6, 9.23.10.1)
- 2"x4" (38x89) STUDS @ 16" (406) C.C., 2"x4" (38x89) SILL PLATE 2"x6" (38x140) AS REQUIRED ON DAMPROOFING MATERIAL OR 2 MIL. POLYETHYLENE FILM, 1/2" (12.7) Ø ANCHOR BOLTS @ 8" (200) LONG, EMBEDDED 4" (100) MIN. INTO CONC. @ 7'-10" (2380) C.C., 4" (100) HIGH CONC. CURB ON CONC. FOOTING, FOR SIZE REFER TO HEX NOTE 10, & ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.
- 15 ADJUSTABLE STEEL BASEMENT COLUMN** (9.15.3.4)
- 9'-10" (3000) MAX. SPAN BETWEEN COLUMNS, 3 1/2" (90) SINGLE TUBE ADJUSTABLE STEEL COLUMN CONFORMING TO CAN/CSS-57.2M, AND WITH 6"x6"x8" (152x152x9.5) STEEL PLATE TOP & BOTTOM, FIELD WELD BASEMENT COLUMN CONNECTION, POURED CONCRETE FOOTING ON NATURAL UNDISTURBED SOIL OF 75kPa OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150kPa AS PER SOILS REPORT
- [SUPPORTING 2 STOREY FLR. LOAD PROVIDE 34"x34"x16" (870x870x410) CONC. FOOTING]
- [SUPPORTING 3 STOREY FLR. LOAD PROVIDE 40"x40"x19" (1060x1060x480) CONC. FOOTING]
- 15A NON-ADJUSTABLE STEEL BASEMENT COLUMN**
- 3 1/2" (90) Ø x 0.188" (4.78) NON-ADJUSTABLE STEEL COLUMN WITH 6"x6"x3" (152x152x9.5) STEEL TOP PLATE & 6"x4"x3" (152x106x9.5) BOTTOM PLATE, BASE PLATE 4" x 24" (104x127) (120x206x12.7) WITH 1/2" (12.7) 12" (305) X 2" (51) HOLES (2-12/70x305x60), FIELD WELD COLUMN TO BASE PLATE & STEEL BM.
- 16 STEEL BEAM BEARING AT FOUNDATION WALL** (9.23.8.1)
- ADJUSTABLE STEEL COLUMN CONFORMING TO CAN/CSS-57.2M, AND WITH 6"x6"x8" (152x152x9.5) STEEL PLATE TOP & BOTTOM, FIELD WELD BASEMENT COLUMN CONNECTION, POURED CONCRETE FOOTING ON NATURAL UNDISTURBED SOIL OF 75kPa OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150kPa AS PER SOILS REPORT
- 17 WOOD STRAPPING AT STEEL BEAMS** (9.23.4.3, (3), 9.23.9.3)
- 17x3" (19x64) CONTIN. WOOD STRAPPING BOTH SIDES OF STEEL BEAM.
- 18 GARAGE SLAB** (9.16, 9.35)
- 4" (100) 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. (100) COARSE GRANULAR FILL WITH MIN. BEARING CAPACITY OF 150kPa OR COMPACTED NATURAL FILL, SLOPE TO FRONT @ 1% MIN.
- 19 GARAGE TO HOUSE WALLS/CEILING** (9.10.9.1.6)
- 1/2" (12.7) GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE, PLUS REQUIRED INSULATION IN WALLS AND SPRAY FOAM FOR CEILINGS, TAPE AND SEAL ALL JOINTS GAS TIGHT, (9.10.17.10, CANULC-S705.2)

STAMP

cont. SECTION 1.0. CONSTRUCTION NOTES

- 39 TWO STOREY VOLUME SPACES** (9.23.10.1, 9.23.11, 9.23.16)
- | WALL ASSEMBLY | WIND LOADS | |
|------------------------------|------------------------------|------------------------------|
| | <= 0.5 kPa (g50) | > 0.5 kPa (g50) |
| EXTERIOR | SPACING MAX HEIGHT | SPACING MAX HEIGHT |
| BRICK 2"x6" (38x140) SPR.#2 | 12" (305) C.C. 18'-4" (5588) | 8" (200) C.C. 18'-4" (5588) |
| SIDING 2"x6" (38x140) SPR.#2 | 16" (406) C.C. 18'-4" (5588) | 12" (305) C.C. 18'-4" (5588) |
| BRICK 2"x6" (38x140) SPR.#2 | 12" (305) C.C. 21'-0" (6400) | 12" (305) C.C. 21'-0" (6400) |
| SIDING 2"x6" (38x140) SPR.#2 | 16" (406) C.C. 21'-0" (6400) | 16" (406) C.C. 21'-0" (6400) |
- ** STUD SIZE & SPACING TO BE VERIFIED BY STRUCTURAL ENGINEER **
- STUDS ARE TO BE CONTINUOUS, CW 3/8" (9.5) THICK EXTERIOR PLYWOOD SHEATHING, PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 4'-0" (1220) C.C. VERTICALLY.
- FOR HORIZ. DISTANCES LESS THAN 9'-6" (2896) PROVIDE 2"x6" (38x140) STUDS @ 16" (406) C.C. WITH CONTIN. 2"x6" (38x140) TOP PLATE + 1-2"x6" (1-38x140) BOTTOM PLATE & MIN. OF 3-2"x6" (3-38x184) CONT. HEADER AT GROUND FLOOR CEILING LEVEL, TOE-NAIL & GLUED AT TOP, BOTTOM PLATES & HEADERS.
- 40 1 HR. PARTY WALL (CONC. BLOCK)** (SB-3) WALL TYPE B66 & B10)
- 1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WD. STRAPPING @ 24" (610) C.C. ON 8" (200) CONC. BLOCK FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS, TAPE, FILM & SAND ALL GYPSUM JOINTS, EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT OR FURRED WITH 2"x2" (38x38) WD. STRAPPING & 1/2" (12.7) GYPSUM SHEATHING.
- 40 1 HR. PARTY WALL (DOUBLE STUD)** (SB-3) WALL TYPE W130)
- 5/8" (15.9) TYPE 'X' GYPSUM SHEATHING ON EXTERIOR SIDE OF 2 ROWS OF 2"x4" (38x89) STUDS @ 16" (406) C.C. ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. FINISH, (REFER TO 35 NOTE AS REQUIRED)
- 40A 2 HR. FIREWALL** (SB-3) WALL TYPE B66 & B10)
- 1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WOOD STRAPPING @ 24" (610) C.C. ON 8" (200) CONC. BLOCK FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS, TAPE, FILM & SAND ALL GYPSUM JOINTS, EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT, GYPSUM SHEATHING TO BE ATTACHED TO CONC. BLOCK, (REFER TO DETAILS)
- 41 STUCCO WALL CONSTRUCTION (2"x6")**
- STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.F.S. MINIMUM ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BOARD ON STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (REFER TO 35 NOTE AS REQUIRED)
- 41A STUCCO WALL CONSTRUCTION (2"x6") W/ CONTIN. INSUL.**
- STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.F.S. MINIMUM ON APPROVED DRAINAGE MAT ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.2.7.3, ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 7/16" EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIRVAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (REFER TO 35 NOTE AS REQUIRED)
- 41B STUCCO WALL @ GARAGE CONST.**
- STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1 1/2" (38) E.F.S. MINIMUM ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BRD. ON STUDS CONFORMING TO O.B.C. (9.23.10.1), & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (REFER TO 35 NOTE AS REQ.)
- 42 UNSUPPORTED FOUNDATION WALLS** (9.15.4.2)
- REINFORCING AT STAIRS AND SUNKEN FLOOR AREAS
- 2-20M BARS IN TOP PORTION OF WALL (10'-0" TO 10'-0" OPENING)
- 3-20M BARS IN TOP PORTION OF WALL (10'-0" TO 10'-0" OPENING)
- 4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 10'-0" OPENING)
- BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL
- REINFORCING AT BASEMENT WINDOW
- 2-15M HORIZ. REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SILL, EXTEND BARS 24" (610) BEYOND THE OPENING, 2-15M VERTICAL REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL ON EACH SIDE OF THE WINDOW OPENING.
- BARS TO HAVE MIN. 12" (305) C.C. BETWEEN BARS
- BARS TO EXTEND 2'-0" (610) BEYOND BOTH SIDES OF OPENING
- 43 STUD WALL REINFORCEMENT**
- PROVIDE STUD WALL REINFORCEMENT IN MAIN BATHROOM CONFORMING TO O.B.C. (9.5.2.3.1.1) (REFER TO DETAILS)
- 44 WINDOW WELLS**
- WHERE A WINDOW OPENS INTO A WINDOW WELL, A CLEARANCE OF NOT LESS THAN 21" 5/8" (550) SHALL BE PROVIDED IN FRONT OF THE WINDOW, EVERY WINDOW WELL SHALL BE DRAINED TO THE FOOTING LEVEL OR OTHER SUITABLE LOCATION WITH A 4" (100) WEeping TILE CW A FILTER CLOTH WRAP AND FILLED WITH CRUSHED STONE, (9.9.10.1.5), 9.14.6.3)
- 45 SLOPED CEILING CONSTRUCTION** (INS-12) 3.1.1.8, 9.23.4.2)
- 2"x12" (38x286) ROOF JOISTS @ 16" (406) C.C. MAX. UNLESS OTHERWISE NOTED W/ 2"x2" (38x38) PURLINS @ 16" (406) C.C. PERPENDICULAR TO ROOF JOIST, PURLINS NOT REQ. W/ SPRAY FOAM, W/ INSULATION BETWEEN JOIST, 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH OR APPROVED EQ. INSULATION VALUE DIRECTLY ABOVE THE INNER SURFACE OF EXTERIOR WALLS SHALL NOT BE LESS THAN R2 (3.52 RSI).
- 46 FLAT ROOF/BALCONY CONSTRUCTION**
- WATERPROOFING MEMBRANE (9.26.11, 9.26.15, 9.26.16) FULLY ADHERED TO 2"x8" (15.9) 1x2 EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x2" (38x38) PURLINS ANGLED TOWARDS SLOPER @ 2% MINIMUM LAID PERPENDICULAR TO 2"x8" (38x184) FLOOR JOISTS @ 16" (406) C.C. (UNLESS OTHERWISE NOTED), BUILT UP CURBS TO BE 4" (100) MIN. ABOVE FINISHED BALCONY FLOOR, CONTINUOUS 1" TRIM Drip EDGE TO BE PROVIDED ON OUTSIDE FACE OF CURB, SLOPER BEING TO BE LOCATED 24" (610) MIN. AWAY FROM HOUSE, PREFINISHED ALUMINUM OR PANEL FOR UNDERSIDE OF SOFFIT (9.23.2.3), REMOVE CURB WHERE REQ.
- BALCONY CONDITION**
- SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE INCLUDE 2"x4" (38x89) PT. DECKING W/ 1/4" (6.4) GAPS LAID PLAT PARALLEL TO JOISTS ON 2"x4" (38x89) PT. SLEEPERS @ 12" (305) C.C. LAID PLAT PERPENDICULAR TO JOISTS
- BALCONY OVER HEATED SPACE CONDITION**
- SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE FOR ASSEMBLY. REFER TO PLANS FOR FLOOR JOIST SIZE & REFER TO HEX NOTE 99 FOR INSULATION AND INTERIOR FINISH.
- 47 BARREL VAULT CONSTRUCTION**
- CANTILEVERED 2"x4" (38x89) SPACERS LAID FLAT ON 2"x10" (38x235) SPR. #2 ROOF JOIST NAIL TO BUILT-UP 3/4" (19) PLYWOOD HEADER PROFILED FOR BARREL, SPRAY FOAM INSULATION BETWEEN JOISTS W/ GYPSUM BOARD, INTERIOR FIN. (REFER TO DETAILS)

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

SECTION 1.1. WALL STUDS

- REFER TO THIS CHART FOR STUD SIZE & SPACING AS REQUIRED FOR EXTERIOR WALLS ON RAMP, SLOPE SITS & GRADING PLAN OF THIS UNIT FOR CONFORMATION OF TOP OF FOUNDATION WALL AND ADDITIONAL INFORMATION.
- IF STUD WALL HEIGHT EXCEEDS MAX. UNSUPPORTED HEIGHT, WALL NEEDS TO BE REVIEWED AND APPROVED BY ENGINEER.

SIZE & SPACING OF STUDS (OBC REFERENCE - TABLE 9.23.10.1)		SUPPORTED LOADS (EXTERIOR)	
MIN. STUD SIZE, in (mm)	ROOF w/o ATTIC	ROOF w/ w/o ATTIC	ROOF w/ w/o ATTIC
2"x4" (38x89)	24" (610)	9'-10" (3.0)	9'-10" (3.0)
2"x6" (38x140)	9'-10" (3.0)	11'-10" (3.6)	5'-11" (1.8)

SECTION 2.0. GENERAL NOTES

- 2.1. WINDOWS**
- 1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IS TO HAVE AN EXIT DOOR TO THE EXTERIOR, UNLESS OTHERWISE NOTED. THE PORTION W/ NO DIMENSION LESS THAN 1'-3" (380), CAPABLE OF MAINTAINING THE OPENING WITHOUT THE NEED FOR ADDITIONAL SUPPORT, CONFORMING TO 9.9.10.
- 2) WINDOW GUARDS: A GUARD OR WINDOW WITH A MAXIMUM RESTRICTED OPENING LESS THAN 1'-0" (300) ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FINISHED FLOOR TO THE ADJACENT GRADE IS GREATER THAN 5'-11" (1800), (9.8.8.1.1)
- 3) WINDOWS IN EXIT STAIRWAYS THAT EXTEND TO LESS THAN 2'-11" (900) 13'-6" (1070) FOR ALL OTHER BUILDINGS SHALL BE PROTECTED BY GUARDS