


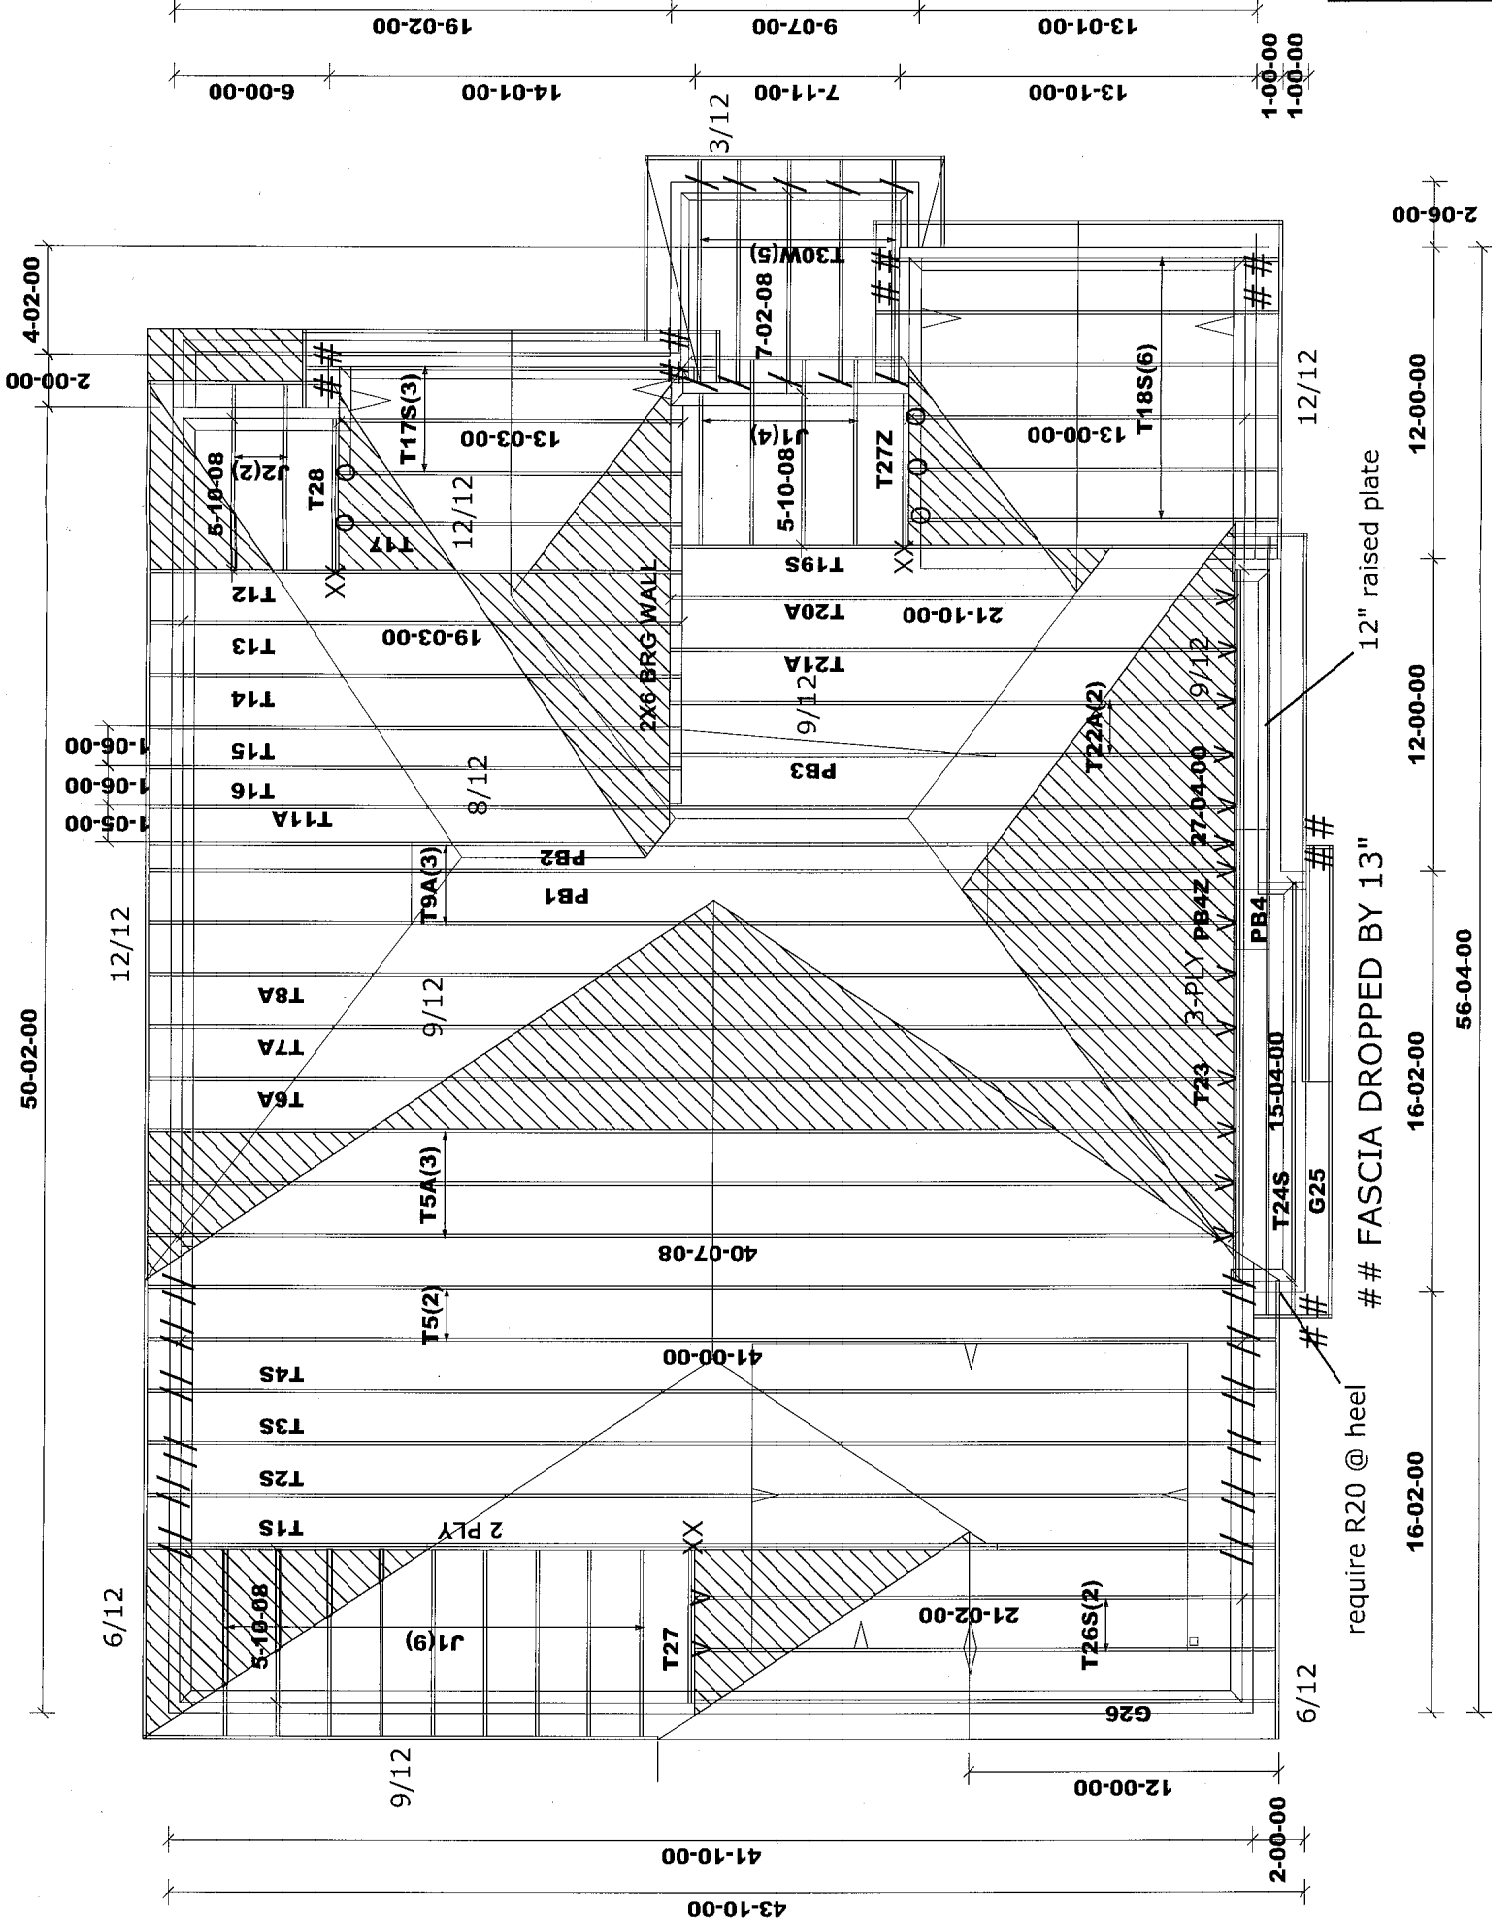

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2- (XX)
H2.5A - (I)


DESIGN CONFORMS WITH OBC 2012
(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with
Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses
to be min. 2x4 SPF #2 @ 24" o/c with a
vertical post to the truss at each cross
point. Vertical posts longer than 6' to have
lateral bracing so that the distance between
the post end points and lateral bracing does
not exceed 6'.

DWG# T-2205453 to T-2205491,
T1800218

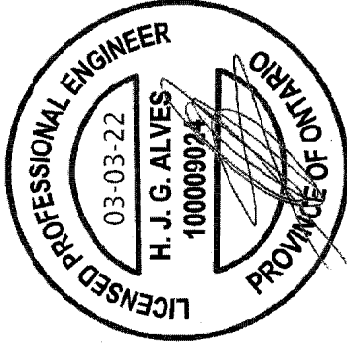


Structural component only
DWG# T-2206158

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.

 TAMARACK ROOF TRUSSES INC. — A LAMAR GROUP —	Job Track: 52545		Builder / Location: ROYAL PINE HOMES / BRAMPTON		Model / Elevation: UNIT 5003-COR / A-STD OR OPT. (WITH COFF) THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE. Milek ver 8.4.2.286
	Layout ID: 424245		Project: VALES OF HUMBER		
	Plan Log: 205714		Date: 2022-03-03		
			Designer: JG		

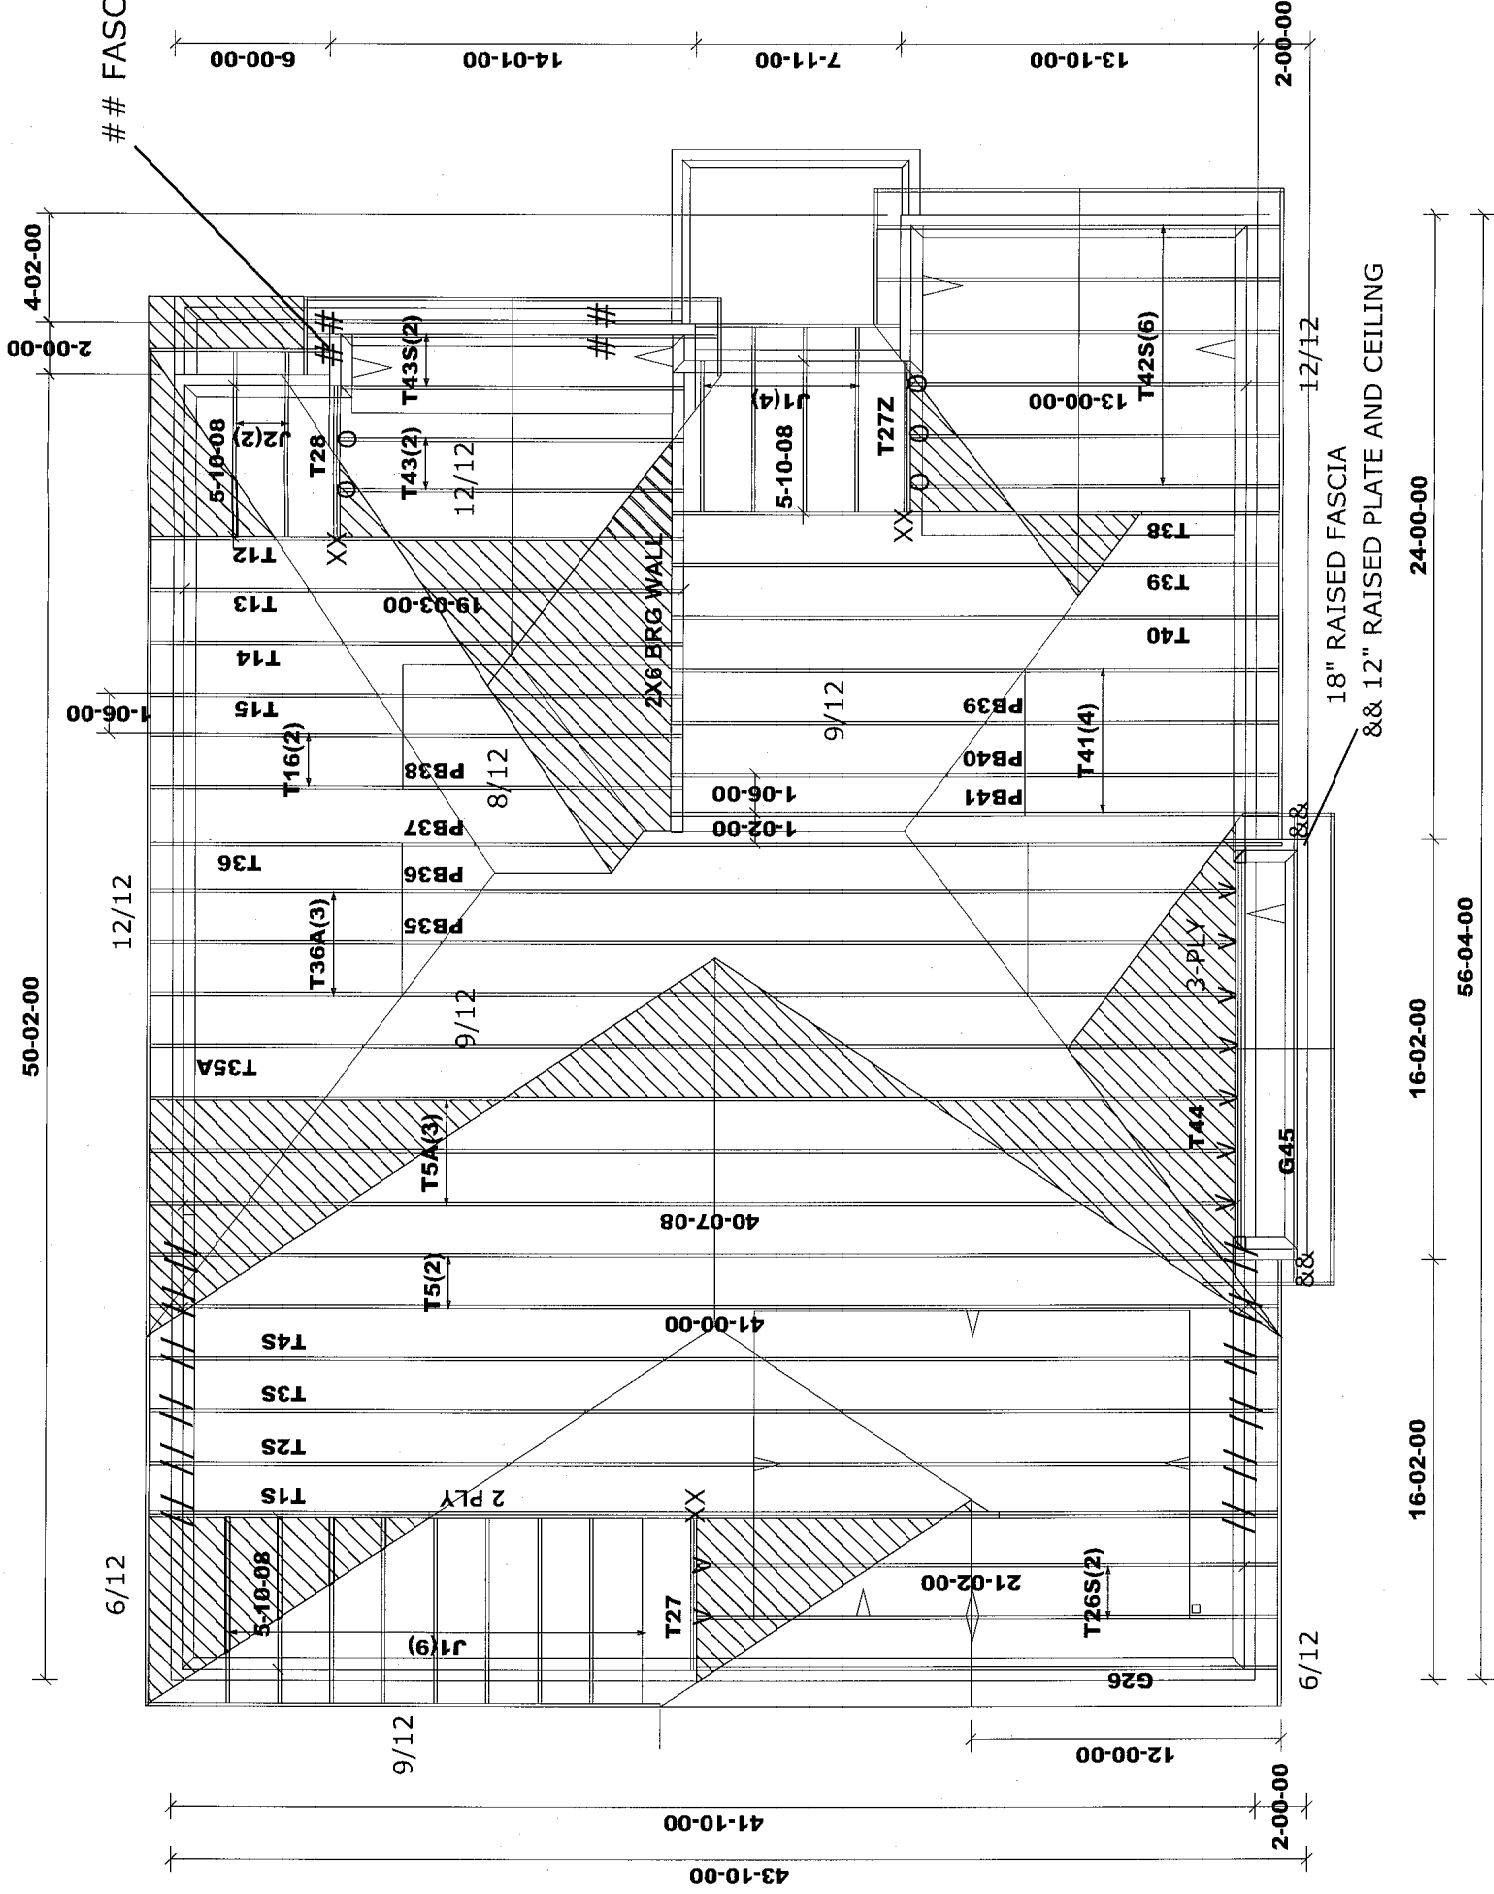

FASCIA RAISED BY 18"

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
H2.5A - (I)


DESIGN CONFORMS WITH OBC 2012
(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 27.2 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 23.3 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

DENOTES:
CONVENTIONAL
FRAMING

All conventional framing to conform with
Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses
to be min. 2x4 SPF #2 @ 24" o/c with a
vertical post to the truss at each cross
point. Vertical posts longer than 6' to have
lateral bracing so that the distance between
the post end points and lateral bracing does
not exceed 6'.

DWG# T-2205454 to T-2205456,
T-2205462 to T-2205467, T-2205473 to
T-2205477, T-2205487 to T-2205490,
T-2205497 to T-2205515, T1800218

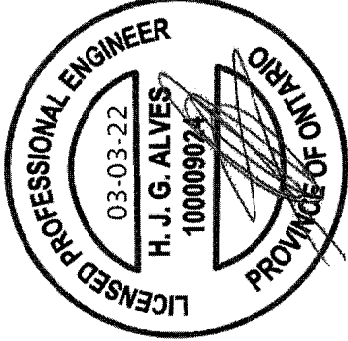

Structural component only
DWG# T-2206160

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.
Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/ permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.

M14706

	Job Track:	52545	Builder / Location:	ROYAL PINE HOMES / BRAMPTON	Model / Elevation:	Mitek ver 8.4.2.286
	Layout ID:	424247	UNIT 5003-COR / B-STD OR OPT. (WITH COFF)			THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. - SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.
	Plan Log:	205714	Project:	VALES OF HUMBER	FOR ANY OTHER PURPOSE.	
			Date:	2022-03-03	Designer:	JG