

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality BRAMPTON	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 7003 Project: VALES OF HUMBER SOUTH	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> (print name) declare that (choose one as appropriate):			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
April 7, 2022			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: VALES OF HUMBER SOUTH										DATE Apr-22		WINTER NATURAL AIR CHANGE RATE 0.241										HEAT LOSS AT °F. 74		CSA-F280-12					
BUILDER: ROYAL PINE HOMES										TYPE: 7003		GFA: 6169		LO# 95348		SUMMER NATURAL AIR CHANGE RATE 0.078										HEAT GAIN AT °F. 11		SB-12 PERFORMANCE	
ROOM USE		GREAT		KIT		DIN		LIV		FOY		LIBR		PWD-1		MUD		LAUN											
EXP. WALL		52		59		19		40		13		29		9		32		7											
CLG. HT.		11		11		21		11		11		11		11		11		11											
FACTORS																													
GRS.WALL AREA		LOSS GAIN		572		649		399		440		143		319		99		352		77									
GLAZING				LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN									
NORTH		20.8	15.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0							
EAST		20.8	41.0	0	0	0	0	0	0	0	44	914	1806	13	270	534	44	914	1806	0	0	0	0						
SOUTH		20.8	24.4	0	0	0	0	0	0	86	1787	2098	8	166	195	0	0	0	0	0	0	0							
WEST		20.8	41.0	102	2119	4187	100	2078	4105	0	0	0	0	0	0	0	0	0	0	0	0	0							
SKYLT.		34.1	100.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0							
DOORS		24.7	3.7	0	0	0	0	0	0	0	0	0	40	986	146	0	0	0	20	493	73	0							
NET EXPOSED WALL		3.5	0.5	470	1630	242	549	1904	282	313	1085	161	388	1345	199	90	312	46	275	954	141	99							
NET EXPOSED BSMT WALL ABOVE GR		3.5	0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0							
EXPOSED CLG		1.3	0.6	0	0	0	0	0	0	285	357	159	0	0	0	0	0	0	0	0	0	0							
NO ATTIC EXPOSED CLG		2.7	1.2	10	27	12	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0							
EXPOSED FLOOR		2.5	0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0							
BASEMENT/CRAWL HEAT LOSS				0		0		0		0		0		0		0		0		0		0							
SLAB ON GRADE HEAT LOSS				0		0		0		0		0		0		0		0		0		0							
SUBTOTAL HT LOSS				3776		3981		3229		2426		1568		1868		343		1644		267									
SUB TOTAL HT GAIN				4440		4387		2418		2201		726		1947		51		244		40									
LEVEL FACTOR / MULTIPLIER		0.30	0.48			0.30	0.48			0.30	0.48			0.30	0.48			0.30	0.48										
AIR CHANGE HEAT LOSS				1804		1902		1543		1159		749		892		164		785		128									
AIR CHANGE HEAT GAIN				223		221		122		111		37		98		3		12		2									
DUCT LOSS				0		0		0		0		0		0		0		0		0									
DUCT GAIN				0		0		0		0		0		0		0		0		0									
HEAT GAIN PEOPLE		240	0	0		0		0		0		0		0		0		0		0									
HEAT GAIN APPLIANCES/LIGHTS				2095		2095		2095		2095		2095		2095		0		2095		0		2095							
TOTAL HT LOSS BTU/H				5579		5883		4772		3584		2317		2760		507		2430		395									
TOTAL HT GAIN x 1.3 BTU/H				8786		8713		6024		5728		991		5382		69		333		2777									

ROOM USE																			
EXP. WALL																			
CLG. HT.																			
FACTORS																			
GRS.WALL AREA	LOSS GAIN																		
GLAZING																			
NORTH	20.8 15.5																		
EAST	20.8 41.0																		
SOUTH	20.8 24.4																		
WEST	20.8 41.0																		
SKYLT.	34.1 100.3																		
DOORS	24.7 3.7																		
NET EXPOSED WALL	3.5 0.5																		
NET EXPOSED BSMT WALL ABOVE GR	3.5 0.5																		
EXPOSED CLG	1.3 0.6																		
NO ATTIC EXPOSED CLG	2.7 1.2																		
EXPOSED FLOOR	2.5 0.4																		
BASEMENT/CRAWL HEAT LOSS																			
SLAB ON GRADE HEAT LOSS																			
SUBTOTAL HT LOSS																			
SUB TOTAL HT GAIN																			
LEVEL FACTOR / MULTIPLIER	0.50 1.24																		
AIR CHANGE HEAT LOSS																			
AIR CHANGE HEAT GAIN																			
DUCT LOSS																			
DUCT GAIN																			
HEAT GAIN PEOPLE	240																		
HEAT GAIN APPLIANCES/LIGHTS																			
TOTAL HT LOSS BTU/H																			
TOTAL HT GAIN x 1.3 BTU/H																			

TOTAL HEAT GAIN BTU/H: 87105 TONS: 7.26 LOSS DUE TO VENTILATION LOAD BTU/H: 6010 STRUCTURAL HEAT LOSS: 88855 TOTAL COMBINED HEAT LOSS BTU/H: 94866

SITE NAME: VALES OF HUMBER SOUTH										DATE Apr-22		WINTER NATURAL AIR CHANGE RATE 0.241										HEAT LOSS ΔT °F. 74		CSA-F280-12	
BUILDER: ROYAL PINE HOMES										LO# 95348		SUMMER NATURAL AIR CHANGE RATE 0.078										HEAT GAIN ΔT °F. 11		SB-12 PERFORMANCE	
TYPE: 7003										GFA: 6169															
ROOM USE		PR/ST		ENS		WIC-1		WIC-2		BED-2		BED-3		BED-4		BED-5		ENS-2		ENS-3					
EXP. WALL		59		34		8		0		14		24		14		51		12		0					
CLG. HT.		11		10		10		10		10		10		10		11		10		10					
FACTORS																									
GRS.WALL AREA		LOSS GAIN		649		340		80		0		140		240		140		561		120		0			
GLAZING		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN			
NORTH		20.8	15.5	0	0	0	28	582	433	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
EAST		20.8	41.0	0	0	0	0	0	0	0	0	0	0	0	32	665	1314	40	831	1642	78	1621	3202		
SOUTH		20.8	24.4	8	166	195	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
WEST		20.8	41.0	92	1911	3776	40	831	1642	0	0	0	0	0	0	0	0	0	0	0	16	332	657		
SKYLT.		34.1	100.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
DOORS		24.7	3.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	15	370	55	0	0	0		
NET EXPOSED WALL		3.5	0.5	549	1904	282	272	943	140	80	277	41	0	0	116	402	60	184	638	95	100	347	51		
NET EXPOSED BSMT WALL ABOVE GR		3.5	0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
EXPOSED CLG		1.3	0.6	1199	1502	668	288	361	160	88	110	49	176	221	98	350	439	195	350	439	195	346	434		
NO ATTIC EXPOSED CLG		2.7	1.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	98	263			
EXPOSED FLOOR		2.5	0.4	0	0	0	0	0	0	0	0	0	0	0	150	373	55	250	622	92	100	249			
BASEMENT/CRAWL HEAT LOSS				0		0		0		0		0		0		0		0		0		0			
SLAB ON GRADE HEAT LOSS				0		0		0		0		0		0		0		0		0		0			
SUBTOTAL HT LOSS				5483		2717		388		221		1713		2862		1860		4900		940		113			
SUB TOTAL HT GAIN					4922			2375		90			98		681		2067		1923		3922		776		
LEVEL FACTOR / MULTIPLIER		0.20	0.24			0.20	0.24			0.20	0.24			0.20	0.24		0.20	0.24		0.20	0.24		0.20		
AIR CHANGE HEAT LOSS				1328		658		94		53		415		693		450		1186		228		27			
AIR CHANGE HEAT GAIN					247			119		5		34		104		97		197		39		3			
DUCT LOSS				0		0		0		0		213		356		231		609		117		0			
DUCT GAIN				0		0		0		0		305		451		435		645		81		0			
HEAT GAIN PEOPLE		240		2	480	0	0	0	0	0	0	1	240	1	240	1	240	1	240	0	0	0	0		
HEAT GAIN APPLIANCES/LIGHTS					2095	0		0		0		2095		2095		2095		2095		2095		0			
TOTAL HT LOSS BTU/H				6811		3374		481		274		2340		3911		2542		6695		1285		140			
TOTAL HT GAIN x 1.3 BTU/H				10067		3243		123		134		4362		6443		6227		9229		1165		68			

[illegible]

TOTAL HEAT GAIN BTU/H:

87105

TONS: 7.26

LOSS DUE TO VENTILATION LOAD BTU/H: 6010

STRUCTURAL HEAT LOSS: 88855

TOTAL COMBINED HEAT LOSS BTU/H: 94866

SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

TYPE: 7003

DATE: Apr-22

GFA: 6169

LO# 95348

FURNACE 1

HEATING CFM 1370 COOLING CFM 1370
TOTAL HEAT LOSS 55,695 TOTAL HEAT GAIN 40,493
AIR FLOW RATE CFM 24.6 AIR FLOW RATE CFM 33.83

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure for s/a & r/a 0.35

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 58700 BTUH

#CARRIER

59SP5A-80-16

80

AFUE = 97 %

INPUT (BTU/H) = 80,000

OUTPUT (BTU/H) = 78,000

FAN SPEED

LOW 0

MEDLOW 975

MEDIUM 1200

MEDIUM HIGH 1370

HIGH 1540

DESIGN CFM = 1370

CFM @ .6" E.S.P.

TEMPERATURE RISE 53 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	0	20	9
R/A	0	0	0	5	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	GREAT	GREAT	GREAT	GREAT	KIT	KIT	KIT	KIT	DIN	DIN	DIN	LIV	LIV	LIV	FOY	LIBR	LIBR	PWD-1	MUD	LAUN	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.39	1.39	1.39	1.39	1.47	1.47	1.47	1.47	1.59	1.59	1.59	1.19	1.19	1.19	2.32	1.38	1.38	0.51	2.43	0.39	3.05	3.05	3.05	3.05
CFM PER RUN HEAT	34	34	34	34	36	36	36	36	39	39	39	29	29	29	57	34	34	12	60	10	75	75	75	75
RM GAIN MBH.	2.20	2.20	2.20	2.20	2.18	2.18	2.18	2.18	2.01	2.01	2.01	1.91	1.91	1.91	0.99	2.69	2.69	0.07	0.33	2.78	0.19	0.19	0.19	0.19
CFM PER RUN COOLING	74	74	74	74	74	74	74	74	68	68	68	65	65	65	34	91	91	2	11	94	6	6	6	6
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.17	0.17	0.16	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	47	40	36	30	24	24	24	36	37	33	39	60	57	54	53	68	72	58	48	42	31	18	33	43
EQUIVALENT LENGTH	100	130	90	120	130	120	130	120	170	130	110	140	130	130	170	190	190	120	140	130	100	130	110	120
TOTAL EFFECTIVE LENGTH	147	170	126	150	154	144	154	156	207	163	149	200	187	184	223	258	262	178	188	172	131	148	143	163
ADJUSTED PRESSURE	0.12	0.1	0.14	0.11	0.11	0.12	0.11	0.11	0.08	0.11	0.12	0.09	0.09	0.09	0.08	0.06	0.06	0.1	0.09	0.09	0.13	0.12	0.12	0.11
ROUND DUCT SIZE	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	6	6	4	5	6	5	5	5	5
HEATING VELOCITY (ft/min)	250	250	250	250	264	264	264	264	286	286	286	213	213	213	419	173	173	138	441	51	551	551	551	551
COOLING VELOCITY (ft/min)	543	543	543	543	543	543	543	543	499	499	499	477	477	477	250	464	464	23	81	479	44	44	44	44
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	4X10	3X10	3X10	3X10	3X10
TRUNK	A	A	B	B	B	C	C	C	F	F	F	E	E	E	E	E	E	F	A	A	C	C	B	A

RUN #	25	26	27	28	29
ROOM NAME	BAS	BAS	BAS	BAS	BAS
RM LOSS MBH.	3.05	3.05	3.05	3.05	3.05
CFM PER RUN HEAT	75	75	75	75	75
RM GAIN MBH.	0.19	0.19	0.19	0.19	0.19
CFM PER RUN COOLING	6	6	6	6	6
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	33	38	42	53	65
EQUIVALENT LENGTH	180	130	100	150	180
TOTAL EFFECTIVE LENGTH	213	168	142	203	245
ADJUSTED PRESSURE	0.08	0.1	0.12	0.08	0.07
ROUND DUCT SIZE	5	5	5	6	6
HEATING VELOCITY (ft/min)	551	551	551	382	382
COOLING VELOCITY (ft/min)	44	44	44	31	31
OUTLET GRILL SIZE	3X10	3X10	3X10	4X10	4X10
TRUNK	F	F	B	E	E

SUPPLY AIR TRUNK SIZE														RETURN AIR TRUNK SIZE										
		TRUNK	STATIC	ROUND	RECT				TRUNK	STATIC	ROUND	RECT						TRUNK	STATIC	ROUND	RECT			
		CFM	PRESS.	DUCT	DUCT	(ft/min)			CFM	PRESS.	DUCT	DUCT	(ft/min)					CFM	PRESS.	DUCT	DUCT	(ft/min)		
TRUNK A	213	0.09	7.6	8	x	8	479	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.05	0	0	x	8	0	
TRUNK B	467	0.09	10.2	12	x	8	701	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.05	0	0	x	8	0	
TRUNK C	258	0.11	7.8	8	x	8	581	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.05	0	0	x	8	0	
TRUNK D	725	0.09	12.1	18	x	8	725	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.05	0	0	x	8	0	
TRUNK E	362	0.06	10.3	12	x	8	543	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.05	0	0	x	8	0	
TRUNK F	641	0.06	12.8	20	x	8	577	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.05	0	0	x	8	0	

RETURN AIR #	1	2	3	4	5	BR									
AIR VOLUME	280	310	205	155	135	0	0	0	0	0	0	0	0	0	285
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	44	30	20	58	71	1	1	1	1	1	1	1	1	1	18
EQUIVALENT LENGTH	160	145	145	195	200	0	0	0	0	0	0	0	0	0	150
TOTAL EFFECTIVE LH	204	175	165	253	271	1	1	1	1	1	1	1	1	1	168
ADJUSTED PRESSURE	0.07	0.08	0.09	0.06	0.05	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.09
ROUND DUCT SIZE	9	9	7.5	7.5	7.5	0	0	0	0	0	0	0	0	0	8.5
INLET GRILL SIZE	8	8	8	8	8	0	0	0	0	0	0	0	0	0	8
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	30	30	14	14	14	0	0	0	0	0	0	0	0	0	24

SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

TYPE: 7003

DATE: Apr-22

GFA: 6169 LO# 95348

FURNACE 2

HEATING CFM 1440 COOLING CFM 1440
TOTAL HEAT LOSS 33,161 TOTAL HEAT GAIN 46,167
AIR FLOW RATE CFM 43.42 AIR FLOW RATE CFM 31.19

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure
for s/a & r/a 0.35

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 36166 BTUH

#*CARRIER

59SP5A-60-14

FAN SPEED

LOW 0

MEDLOW 785

MEDIUM 960

MEDIUM HIGH 1145

HIGH 1440

AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000

DESIGN CFM = 1440
CFM @ .6" E.S.P.

TEMPERATURE RISE 37 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	27	0	0
R/A	0	0	7	0	0

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	PR/ST	PR/ST	PR/ST	PR/ST	ENS	ENS	ENS	WIC-1	WIC-2	BED-2	BED-2	ENS-2	BED-3	BED-3	BED-3	ENS-3	WIC-3	BED-4	BED-4	BED-4	ENS-4	ENS-4	BED-5	BED-5
RM LOSS MBH.	1.70	1.70	1.70	1.70	1.12	1.12	1.12	0.48	0.27	1.17	1.17	1.28	1.30	1.30	1.30	0.14	1.74	0.85	0.85	0.85	1.47	1.47	1.67	1.67
CFM PER RUN HEAT	74	74	74	74	49	49	49	21	12	51	51	56	57	57	57	6	75	37	37	37	64	64	73	73
RM GAIN MBH.	2.52	2.52	2.52	2.52	1.08	1.08	1.08	0.12	0.13	2.18	2.18	1.17	2.15	2.15	2.15	0.07	1.25	2.08	2.08	2.08	1.73	1.73	2.31	2.31
CFM PER RUN COOLING	79	79	79	79	34	34	34	4	4	68	68	36	67	67	67	2	39	65	65	65	54	54	72	72
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	68	73	45	41	47	52	47	37	30	53	61	43	96	96	98	76	100	84	88	92	86	96	79	75
EQUIVALENT LENGTH	200	200	190	190	110	160	140	130	120	150	160	160	150	140	180	160	160	200	210	220	140	150	160	160
TOTAL EFFECTIVE LENGTH	268	273	235	231	157	212	187	167	150	203	221	203	246	236	278	236	260	284	298	312	226	246	239	235
ADJUSTED PRESSURE	0.06	0.06	0.07	0.07	0.11	0.08	0.09	0.1	0.11	0.08	0.08	0.08	0.07	0.07	0.06	0.07	0.07	0.06	0.06	0.06	0.08	0.07	0.07	0.07
ROUND DUCT SIZE	6	6	6	6	5	5	5	4	4	6	6	5	6	6	6	4	6	6	6	6	5	5	6	6
HEATING VELOCITY (ft/min)	377	377	377	377	360	360	360	241	138	260	260	411	291	291	291	69	382	189	189	189	470	470	372	372
COOLING VELOCITY (ft/min)	403	403	403	403	250	250	250	46	46	347	347	264	342	342	342	23	199	331	331	331	396	396	367	367
OUTLET GRILL SIZE	4X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	4X10	4X10	4X10	3X10	4X10	4X10	4X10	4X10	3X10	3X10	4X10	4X10
TRUNK	C	C	E	E	E	D	D	E	E	D	D	D	C	C	B	C	B	A	A	A	B	B	A	A

RUN #	25	26	27
ROOM NAME	BED-5	BED-5	ENS-5
RM LOSS MBH.	1.67	1.67	0.64
CFM PER RUN HEAT	73	73	28
RM GAIN MBH.	2.31	2.31	0.39
CFM PER RUN COOLING	72	72	12
ADJUSTED PRESSURE	0.17	0.17	0.17
ACTUAL DUCT LGH.	69	73	60
EQUIVALENT LENGTH	180	180	160
TOTAL EFFECTIVE LENGTH	249	253	220
ADJUSTED PRESSURE	0.07	0.07	0.08
ROUND DUCT SIZE	6	6	4
HEATING VELOCITY (ft/min)	372	372	321
COOLING VELOCITY (ft/min)	367	367	138
OUTLET GRILL SIZE	4X10	4X10	3X10
TRUNK	A	A	C

SUPPLY AIR TRUNK SIZE														RETURN AIR TRUNK SIZE													
TRUNK		STATIC	ROUND	RECT	VELOCITY				TRUNK		STATIC	ROUND	RECT	VELOCITY				TRUNK		STATIC	ROUND	RECT	VELOCITY				
	CFM	PRESS.	DUCT	DUCT			(ft/min)		CFM	PRESS.	DUCT	DUCT			(ft/min)		CFM	PRESS.	DUCT	DUCT							(ft/min)
TRUNK A	403	0.06	10.7	14	x	8	518	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.05	0	0	x	8	0				
TRUNK B	663	0.06	12.9	20	x	8	597	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.05	0	0	x	8	0				
TRUNK C	959	0.06	14.8	26	x	8	664	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.05	0	0	x	8	0				
TRUNK D	256	0.08	8.4	8	x	8	576	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.05	0	0	x	8	0				
TRUNK E	486	0.07	11.1	14	x	8	625	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.05	0	0	x	8	0				
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.05	0	0	x	8	0				

RETURN AIR #	1	2	3	4	5	6	7	BR																			
AIR VOLUME	260	115	230	115	230	230	260	0	0	0	0	0	0	0	0	0	0										
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15										
ACTUAL DUCT LGH.	45	69	108	103	110	91	53	1	1	1	1	1	1	1	1	1	1										
EQUIVALENT LENGTH	165	220	215	195	200	215	215	0	0	0	0	0	0	0	0	0	0										
TOTAL EFFECTIVE LH	210	289	323	298	310	306	268	1	1	1	1	1	1	1	1	1	1										
ADJUSTED PRESSURE	0.07	0.05	0.05	0.05	0.05	0.05	0.06	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80										
ROUND DUCT SIZE	8.8	7	9.1	7	9.1	9.1	9.1	0	0	0	0	0	0	0	0	0	0										
INLET GRILL SIZE	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	0										
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X										
INLET GRILL SIZE	30	14	30	14	30	30	30	0	0	0	0	0	0	0	0	0	0										

TYPE: 7003
SITE NAME: VALES OF HUMBER SOUTH

LO # 95348

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>4</u> @ 10.6 cfm	<u>42.4</u> cfm
Kitchen & Bathrooms	<u>8</u> @ 10.6 cfm	<u>84.8</u> cfm
Other Rooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Table 9.32.3.A.	TOTAL	<u>233.2</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>95.4</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>233.2</u>	cfm
Less Principal Ventil. Capacity	<u>150</u>	cfm
Required Supplemental Capacity	<u>83.2</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE V150H
Location:	BSMT
<u>150.0</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
150.0 CFM	X 74 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-2	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-3	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-4	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE V150H	INSTALL 2 HRV / ERV's
<u>150</u>	cfm high	<u>35</u> cfm low
<u>75</u>	% Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	April-22

I REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED IN THE APPROPRIATE CATEGORY AS AN "OTHER DESIGNER" UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE

Michael O'Rourke

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																													
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																													
LO#: 95348		Model: 7003		Builder: ROYAL PINE HOMES																																																									
				Date: 2022-04-07																																																									
Volume Calculation			Air Change & Delta T Data																																																										
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>2783</td> <td>10</td> <td>27830</td> </tr> <tr> <td>First</td> <td>2783</td> <td>11</td> <td>30613</td> </tr> <tr> <td>Second</td> <td>3651</td> <td>10</td> <td>36510</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="2" style="text-align: right;">Total:</td> <td></td> <td>94,953.0 ft³</td> </tr> <tr> <td colspan="2" style="text-align: right;">Total:</td> <td></td> <td>2688.8 m³</td> </tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	2783	10	27830	First	2783	11	30613	Second	3651	10	36510	Third	0	9	0	Fourth	0	9	0	Total:			94,953.0 ft³	Total:			2688.8 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%;">0.241</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.078</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-19</td> <td>41</td> <td>74</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>30</td> <td>6</td> <td>11</td> </tr> </table>			WINTER NATURAL AIR CHANGE RATE	0.241	SUMMER NATURAL AIR CHANGE RATE	0.078	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-19	41	74	Summer DTDc	24	30	6	11
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																										
Bsmt	2783	10	27830																																																										
First	2783	11	30613																																																										
Second	3651	10	36510																																																										
Third	0	9	0																																																										
Fourth	0	9	0																																																										
Total:			94,953.0 ft³																																																										
Total:			2688.8 m³																																																										
WINTER NATURAL AIR CHANGE RATE	0.241																																																												
SUMMER NATURAL AIR CHANGE RATE	0.078																																																												
Design Temperature Difference																																																													
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																									
Winter DTDh	22	-19	41	74																																																									
Summer DTDc	24	30	6	11																																																									
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																										
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.241 x 746.88 x 41 °C x 1.2 = 8915 W = 30417 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.078 x 746.88 x 6 °C x 1.2 = 430 W = 1466 Btu/h																																																										
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																										
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E) \times 2 \text{ HRV / ERV's}$ 300 CFM x 74 °F x 1.08 x 0.25 = 6010 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 300 CFM x 11 °F x 1.08 x 0.25 = 891 Btu/h																																																										
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																													
$HL_{airr} = \text{Level Factor} \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																																													
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																									
1	0.5	30,417	12,259	1.241																																																									
2	0.3		19,102	0.478																																																									
3	0.2		25,128	0.242																																																									
4	0		0	0.000																																																									
5	0		0	0.000																																																									
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																																																													
				Michael O'Rourke BCIN# 19669 																																																									

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 7003	BUILDER: ROYAL PINE HOMES
SFQT: 6169	SITE: VALES OF HUMBER SOUTH
LO# 95348	

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-2	OUTDOOR DESIGN TEMP.	86
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.60

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	94953.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	2.50	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 64.0 ft	WIDTH: 57.0 ft	EXPOSED PERIMETER:	242.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
SB-12 PERFORMANCE****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22+1.5	21.40
Basement Walls Minimum RSI (R)-Value	20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	1.6	-
Skylights Maximum U-Value	2.6	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.9	-

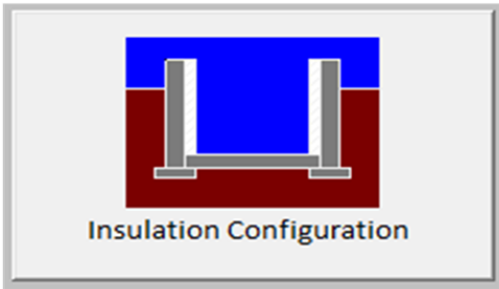
INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description		
Province:	Ontario	
Region:	Brampton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	19.5	
Floor Width (m):	17.4	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	2.2	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2554

TYPE: 7003

LO# 95348

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Brampton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.32			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	2688.8			
Air Leakage/Ventilation				
Air Tightness Type:	Energy Star Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	2510.0 cm ²		
	2.50	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	70.8	70.8		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.241			
Cooling Air Leakage Rate (ACH/H):	0.078			

TYPE: 7003

LO# 95348