

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name			Unit no.
Municipality BRAMPTON			Postal code
Plan number/ other description			Lot/con.
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdsgns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 5008 - ELEV B OPT 2ND Project: VALES OF HUMBER SOUTH	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> (print name)		declare that (choose one as appropriate):	
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
July 11, 2024		 Signature of Designer	
Date			

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: VALES OF HUMBER SOUTH				OPT 2ND				DATE Jul-24				WINTER NATURAL AIR CHANGE RATE 0.234				HEAT LOSS AT °F. 74				CSA-F280-12															
BUILDER: ROYAL PINE HOMES				TYPE: 5008 - ELEV B				GFA: 4398				LO# 95291				SUMMER NATURAL AIR CHANGE RATE 0.076				HEAT GAIN AT °F. 11				SB-12 PERFORMANCE											
ROOM USE				STUDY				GREAT				KIT				DIN				LIV				FOY				LAUN							
EXP. WALL				30				27				44				16				40				19				41							
CLG. HT.				11				11				11				11				11				21				13							
FACTORS																																			
GRS.WALL AREA		LOSS GAIN		330				297				484				176				440				399				533							
GLAZING				LOSS GAIN				LOSS GAIN				LOSS GAIN				LOSS GAIN				LOSS GAIN				LOSS GAIN				LOSS GAIN							
NORTH		20.8	15.5	0	0	0		12	249	186	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	21	436	325						
EAST		20.8	41.0	0	0	0		0	0	0	0	0	0	0	0	0	48	997	1970	56	1163	2299	0	0	0	0	0	0	0	0	0				
SOUTH		20.8	24.4	0	0	0		12	249	293	42	873	1025	26	540	634	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
WEST		20.8	41.0	36	748	1478		36	748	1478	71	1475	2914	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
SKYLT.		34.1	100.3	0	0	0		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0						
DOORS		24.7	3.7	0	0	0		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	20	493	73	20	493	73							
NET EXPOSED WALL		3.5	0.5	294	1019	151		237	822	122	371	1286	191	150	520	77	392	1359	201	323	1120	166	492	1706	253										
NET EXPOSED BSMT WALL ABOVE GR		3.5	0.5	0	0	0		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0										
EXPOSED CLG		1.3	0.6	0	0	0		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0										
NO ATTIC EXPOSED CLG		2.7	1.2	0	0	0		10	27	12	0	0	0	0	0	0	20	54	24	56	150	67	0	0	0										
EXPOSED FLOOR		2.5	0.4	0	0	0		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0											
BASEMENT/CRAWL HEAT LOSS				0				0				0				0				0				0				0							
SLAB ON GRADE HEAT LOSS				0				0				0				0				0				0				0							
SUBTOTAL HT LOSS				1767				2095				3634				1060				2410				2927				2635							
SUB TOTAL HT GAIN						1629				2090				4130				711				2196				2605				651					
LEVEL FACTOR / MULTIPLIER		0.30 0.37						0.30 0.37				0.30 0.37				0.30 0.37				0.30 0.37				0.30 0.37				0.30 0.37							
AIR CHANGE HEAT LOSS				650				771				1337				390				887				1077				969							
AIR CHANGE HEAT GAIN				90				115				228				39				121				144				36							
DUCT LOSS				0				0				0				0				0				0				0							
DUCT GAIN				0				0				0				0				0				0				0							
HEAT GAIN PEOPLE		240		0				0		0		0		0		0		0		0		0		0		0		0							
HEAT GAIN APPLIANCES/LIGHTS						693				693				693				693				693				0				693					
TOTAL HT LOSS BTU/H						2417				2866		4971		1450		3297		4003						3605											
TOTAL HT GAIN x 1.3 BTU/H						3135				3768		6566		1876		3913		3573						1793											

ROOM USE														BAS
EXP. WALL														222
CLG. HT.														10
FACTORS														
GRS.WALL AREA	LOSS GAIN													1554
GLAZING	LOSS GAIN													
NORTH	20.8 15.5													4 83 62
EAST	20.8 41.0													0 0 0
SOUTH	20.8 24.4													8 166 195
WEST	20.8 41.0													12 249 493
SKYLT.	34.1 100.3													0 0 0
DOORS	24.7 3.7													20 493 73
NET EXPOSED WALL	3.5 0.5													0 0 0
NET EXPOSED BSMT WALL ABOVE GR	3.5 0.5													666 2340 347
EXPOSED CLG	1.3 0.6													0 0 0
NO ATTIC EXPOSED CLG	2.7 1.2													0 0 0
EXPOSED FLOOR	2.5 0.4													0 0 0
BASEMENT/CRAWL HEAT LOSS														8044
SLAB ON GRADE HEAT LOSS														
SUBTOTAL HT LOSS														11375
SUB TOTAL HT GAIN														1170
LEVEL FACTOR / MULTIPLIER	0.50 0.89													
AIR CHANGE HEAT LOSS														10134
AIR CHANGE HEAT GAIN														65
DUCT LOSS														0
DUCT GAIN														0
HEAT GAIN PEOPLE	240													0
HEAT GAIN APPLIANCES/LIGHTS														0
TOTAL HT LOSS BTU/H														21509
TOTAL HT GAIN x 1.3 BTU/H														1604

TOTAL HEAT GAIN BTU/H: 48981 TONS: 4.08 LOSS DUE TO VENTILATION LOAD BTU/H: 6010 STRUCTURAL HEAT LOSS: 64304 TOTAL COMBINED HEAT LOSS BTU/H: 70314

SITE NAME: VALES OF HUMBER SOUTH

OPT 2ND

DATE Jul-24

WINTER NATURAL AIR CHANGE RATE 0.234

HEAT LOSS AT °F. 74

CSA-F280-12

BUILDER: ROYAL PINE HOMES

TYPE: 5008 - ELEV B

GFA: 4398

LO# 95291

SUMMER NATURAL AIR CHANGE RATE 0.076

HEAT GAIN ΔT °F. 11

SB-12 PERFORMANCE

ROOM USE			PRI		ENS		BED-5		MEDIA		BED-2		BED-3		BATH-1		BED-4		BATH-2												
EXP. WALL			28		24		14		21		39		40		7		16		10												
CLG. HT.			9		9		9		9		10		10		9		9		9												
FACTORS																															
GRS.WALL AREA			252		216		126		189		390		400		63		144		90												
GLAZING			LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN												
NORTH			20.8	15.5	9	187	139	9	187	139	0	0	0	24	499	371	0	0	0	9	187	139	0	0	0	0	0	0	0	0	0
EAST			20.8	41.0	0	0	0	0	0	0	0	0	0	0	0	0	55	1143	2258	42	873	1724	0	0	0	0	0	0	0	0	0
SOUTH			20.8	24.4	9	187	220	0	0	0	18	374	439	0	0	0	0	0	0	0	0	0	18	374	439	0	0	0	0	0	0
WEST			20.8	41.0	26	540	1067	18	374	739	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SKYLT.			34.1	100.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
DOORS			24.7	3.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL			3.5	0.5	208	721	107	189	655	97	108	374	56	165	572	85	335	1162	172	358	1241	184	54	187	28	126	437	65	90	312	46
NET EXPOSED BSMT WALL ABOVE GR			3.5	0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG			1.3	0.6	404	506	225	143	179	80	210	263	117	441	553	246	306	383	171	260	326	145	84	105	47	320	401	178	150	188	84
NO ATTIC EXPOSED CLG			2.7	1.2	0	0	0	0	0	0	0	0	0	0	0	0	30	81	36	75	201	90	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR			2.5	0.4	0	0	0	0	0	0	0	0	0	0	0	0	336	837	124	0	0	0	84	209	31	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS						0			0			0		0			0			0			0			0					
SLAB ON GRADE HEAT LOSS						0			0			0		0			0			0			0			0					
SUBTOTAL HT LOSS						2142			1395			1012				1623			3605			2641			689			1212			500
SUB TOTAL HT GAIN							1758			1055		612			702			2760			2142		245			682				130	
LEVEL FACTOR / MULTIPLIER				0.20	0.26			0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26	
AIR CHANGE HEAT LOSS						557			363			263			422			937			687			179			315			130	
AIR CHANGE HEAT GAIN							97			58		34		39			152			118			14			38				7	
DUCT LOSS						0			0			0			0			454			0			87			0			0	
DUCT GAIN							0			0		0		0			385			0			26			0				0	
HEAT GAIN PEOPLE			240		2		480	0		0	1		240	0		0	1		240	0		0	1		240	0		0		0	
HEAT GAIN APPLIANCES/LIGHTS							693			0		693			693			693			693			0			693			0	
TOTAL HT LOSS BTU/H						2698			1758			1275			2045			4996			3327			954			1527			630	
TOTAL HT GAIN x 1.3 BTU/H							3936			1447		2052			1863			5499			4152		369			2148				178	

ROOM USE					ENS-5																	
EXP. WALL					17																	
CLG. HT.					9																	
FACTORS																						
GRS.WALL AREA	LOSS	GAIN			153																	
GLAZING					LOSS	GAIN																
NORTH	20.8	15.5	0	0	0	0																
EAST	20.8	41.0	0	0	0	0																
SOUTH	20.8	24.4	0	0	0	0																
WEST	20.8	41.0	9	187	369																	
SKYLT.	34.1	100.3	0	0	0																	
DOORS	24.7	3.7	0	0	0																	
NET EXPOSED WALL	3.5	0.5	144	499	74																	
NET EXPOSED BSMT WALL ABOVE GR	3.5	0.5	0	0	0																	
EXPOSED CLG	1.3	0.6	70	88	39																	
NO ATTIC EXPOSED CLG	2.7	1.2	0	0	0																	
EXPOSED FLOOR	2.5	0.4	0	0	0																	
BASEMENT/CRAWL HEAT LOSS				0																		
SLAB ON GRADE HEAT LOSS				0																		
SUBTOTAL HT LOSS					774																	
SUB TOTAL HT GAIN						482																
LEVEL FACTOR / MULTIPLIER			0.20	0.26																		
AIR CHANGE HEAT LOSS					201																	
AIR CHANGE HEAT GAIN						27																
DUCT LOSS					0																	
DUCT GAIN						0																
HEAT GAIN PEOPLE	240		0		0																	
HEAT GAIN APPLIANCES/LIGHTS					0																	
TOTAL HT LOSS BTU/H					975																	
TOTAL HT GAIN x 1.3 BTU/H						662																

TOTAL HEAT GAIN BTU/H:

48981

TONS: 4.08

LOSS DUE TO VENTILATION LOAD BTU/H: 6010

STRUCTURAL HEAT LOSS: 64304

TOTAL COMBINED HEAT LOSS BTU/H: 70314



SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

OPT 2ND
TYPE: 5008 - ELEV B

DATE: Jul-24

GFA: 4398 LO# 95291

FURNACE 1

HEATING CFM 790 COOLING CFM 790
TOTAL HEAT LOSS 44,118 TOTAL HEAT GAIN 26,228
AIR FLOW RATE CFM 17.91 AIR FLOW RATE CFM 30.12

FACTORY furnace pressure 0.6
INSTALLED furnace filter 0.00
a/c coil pressure 0.25
available pressure
for s/a & r/a 0.35

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 47123 BTUH

CARRIER
59SC6A060M17--16
FAN SPEED 60
LOW 0
MEDLOW 790
MEDIUM 975
MEDIUM HIGH 1140
HIGH 1300

AFUE = 97 %
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 58,000

DESIGN CFM = 790
CFM @ .6" E.S.P.

TEMPERATURE RISE 68 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	0	14	7
R/A	0	0	0	3	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	21	22	23	24
ROOM NAME	STUDY	STUDY	GREAT	GREAT	KIT	KIT	KIT	DIN	LIV	LIV	LIV	FOY	FOY	LAUN	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.21	1.21	1.43	1.43	1.66	1.66	1.66	1.45	1.10	1.10	1.10	2.00	2.00	3.60	3.07	3.07	3.07	3.07
CFM PER RUN HEAT	22	22	26	26	30	30	30	26	20	20	20	36	36	65	55	55	55	55
RM GAIN MBH.	1.57	1.57	1.88	1.88	2.19	2.19	2.19	1.88	1.30	1.30	1.30	1.79	1.79	1.79	0.23	0.23	0.23	0.23
CFM PER RUN COOLING	47	47	57	57	66	66	66	57	39	39	39	54	54	54	7	7	7	7
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	47	41	39	25	24	30	20	31	48	43	38	44	39	42	23	31	37	26
EQUIVALENT LENGTH	160	150	160	140	110	110	100	100	120	110	100	130	100	160	100	140	100	110
TOTAL EFFECTIVE LENGTH	207	191	199	165	134	140	120	131	168	153	138	174	139	202	123	171	137	136
ADJUSTED PRESSURE	0.08	0.09	0.09	0.1	0.13	0.12	0.14	0.13	0.1	0.11	0.12	0.1	0.12	0.09	0.14	0.1	0.13	0.13
ROUND DUCT SIZE	5	4	6	6	6	6	6	4	4	4	4	5	4	5	4	5	4	4
HEATING VELOCITY (ft/min)	162	252	133	133	153	153	153	298	229	229	229	264	413	477	631	404	631	631
COOLING VELOCITY (ft/min)	345	539	291	291	337	337	337	654	447	447	447	396	620	396	80	51	80	80
OUTLET GRILL SIZE	3X10	3X10	4X10	4X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	A	A	A	A	A	A	B	D	C	C	C	C	D	B	B	A	B	B

RUN #	25	26	27
ROOM NAME	BAS	BAS	BAS
RM LOSS MBH.	3.07	3.07	3.07
CFM PER RUN HEAT	55	55	55
RM GAIN MBH.	0.23	0.23	0.23
CFM PER RUN COOLING	7	7	7
ADJUSTED PRESSURE	0.17	0.17	0.17
ACTUAL DUCT LGH.	27	26	39
EQUIVALENT LENGTH	140	100	120
TOTAL EFFECTIVE LENGTH	167	126	159
ADJUSTED PRESSURE	0.1	0.14	0.11
ROUND DUCT SIZE	5	4	4
HEATING VELOCITY (ft/min)	404	631	631
COOLING VELOCITY (ft/min)	51	80	80
OUTLET GRILL SIZE	3X10	3X10	3X10
TRUNK	D	D	C

SUPPLY AIR TRUNK SIZE														RETURN AIR TRUNK SIZE													
	TRUNK	STATIC	ROUND	RECT		VELOCITY		TRUNK	STATIC	ROUND	RECT		VELOCITY		TRUNK	STATIC	ROUND	RECT		VELOCITY							
	CFM	PRESS.	DUCT	DUCT		(ft/min)		CFM	PRESS.	DUCT	DUCT		(ft/min)		CFM	PRESS.	DUCT	DUCT		(ft/min)							
TRUNK A	211	0.08	7.8	10	x	8	380	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.07	0	0	x	8	0				
TRUNK B	471	0.08	10.6	14	x	8	606	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.07	0	0	x	8	0				
TRUNK C	151	0.10	6.5	8	x	8	340	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.07	0	0	x	8	0				
TRUNK D	323	0.10	8.7	12	x	8	485	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.07	0	0	x	8	0				
TRUNK E	0	0.00	0	0	x	8	0	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.07	0	0	x	8	0				
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.07	0	0	x	8	0				

RETURN AIR #	1	2	3												BR								
AIR VOLUME	150	230	230	0	0	0	0	0	0	0	0	0	0	0	180	TRUNK X	640	0.07	12.3	18	x	8	640
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	TRUNK Y	150	0.07	7.1	8	x	8	338
ACTUAL DUCT LGH.	43	23	23	1	1	1	1	1	1	1	1	1	1	1	18	TRUNK Z	0	0.07	0	0	x	8	0
EQUIVALENT LENGTH	130	145	150	0	0	0	0	0	0	0	0	0	0	0	190	DROP	790	0.07	13.3	24	x	10	474
TOTAL EFFECTIVE LH	173	168	173	1	1	1	1	1	1	1	1	1	1	1	208								
ADJUSTED PRESSURE	0.09	0.09	0.09	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.07								
ROUND DUCT SIZE	6.7	7.9	7.9	0	0	0	0	0	0	0	0	0	0	0	7.6								
INLET GRILL SIZE	8	8	8	0	0	0	0	0	0	0	0	0	0	0	8								
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X								
INLET GRILL SIZE	14	24	24	0	0	0	0	0	0	0	0	0	0	0	24								

SITE NAME: VALES OF HUMBER SOUTH
BUILDER: ROYAL PINE HOMES

OPT 2ND
TYPE: 5008 - ELEV B

DATE: Jul-24

GFA: 4398

LO# 95291

FURNACE 2

HEATING CFM 770 COOLING CFM 770
TOTAL HEAT LOSS 20,186 TOTAL HEAT GAIN 22,307
AIR FLOW RATE CFM 38.14 AIR FLOW RATE CFM 34.52

FACTORY furnace pressure 0.6
INSTALLED furnace filter 0.00
a/c coil pressure 0.26
available pressure for s/a & r/a 0.34

FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 23191 BTUH

CARRIER 26
59SC6A026M14--10
FAN SPEED LOW 0
MEDLOW 545
MEDIUM 770
MEDIUM HIGH 0
HIGH 0

AFUE = 96 %
INPUT (BTU/H) = 26,000
OUTPUT (BTU/H) = 25,000

DESIGN CFM = 770
CFM @ .6" E.S.P.

TEMPERATURE RISE 30 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	18	0	0
R/A	0	0	7	0	0

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
ROOM NAME	ENS-5	PRI	PRI	ENS	MEDIA	MEDIA	BATH-1	BED-2	BED-2	BED-2	BED-3	BED-3	BATH-2	BED-4	BED-4	BATH-1	BED-5	BED-5
RM LOSS MBH.	0.98	1.35	1.35	1.76	1.02	1.02	0.48	1.67	1.67	1.67	1.66	1.66	0.63	0.76	0.76	0.48	0.64	0.64
CFM PER RUN HEAT	37	51	51	67	39	39	18	64	64	64	63	63	24	29	29	18	24	24
RM GAIN MBH.	0.66	1.97	1.97	1.45	0.93	0.93	0.18	1.83	1.83	1.83	2.08	2.08	0.18	1.07	1.07	0.18	1.03	1.03
CFM PER RUN COOLING	23	68	68	50	32	32	6	63	63	63	72	72	6	37	37	6	35	35
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	41	69	53	58	56	54	59	58	62	68	62	59	57	67	31	60	49	44
EQUIVALENT LENGTH	160	150	140	160	170	190	140	140	140	110	170	150	110	150	160	140	170	170
TOTAL EFFECTIVE LENGTH	201	219	193	218	226	244	199	198	202	178	232	209	167	217	191	200	219	214
ADJUSTED PRESSURE	0.08	0.08	0.09	0.08	0.07	0.07	0.08	0.08	0.08	0.09	0.07	0.08	0.1	0.08	0.09	0.08	0.08	0.08
ROUND DUCT SIZE	4	6	6	5	5	5	4	5	5	5	6	6	4	4	5	4	4	4
HEATING VELOCITY (ft/min)	424	260	260	492	286	286	207	470	470	470	321	321	275	333	213	207	275	275
COOLING VELOCITY (ft/min)	264	347	347	367	235	235	69	463	463	463	367	367	69	424	272	69	402	402
OUTLET GRILL SIZE	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	C	C	C	C	C	C	B	A	A	B	A	A	B	B	B	B	C	C

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
ROOM NAME	ENS-5	PRI	PRI	ENS	MEDIA	MEDIA	BATH-1	BED-2	BED-2	BED-2	BED-3	BED-3	BATH-2	BED-4	BED-4	BATH-1	BED-5	BED-5
RM LOSS MBH.	0.98	1.35	1.35	1.76	1.02	1.02	0.48	1.67	1.67	1.67	1.66	1.66	0.63	0.76	0.76	0.48	0.64	0.64
CFM PER RUN HEAT	37	51	51	67	39	39	18	64	64	64	63	63	24	29	29	18	24	24
RM GAIN MBH.	0.66	1.97	1.97	1.45	0.93	0.93	0.18	1.83	1.83	1.83	2.08	2.08	0.18	1.07	1.07	0.18	1.03	1.03
CFM PER RUN COOLING	23	68	68	50	32	32	6	63	63	63	72	72	6	37	37	6	35	35
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	41	69	53	58	56	54	59	58	62	68	62	59	57	67	31	60	49	44
EQUIVALENT LENGTH	160	150	140	160	170	190	140	140	140	110	170	150	110	150	160	140	170	170
TOTAL EFFECTIVE LENGTH	201	219	193	218	226	244	199	198	202	178	232	209	167	217	191	200	219	214
ADJUSTED PRESSURE	0.08	0.08	0.09	0.08	0.07	0.07	0.08	0.08	0.08	0.09	0.07	0.08	0.1	0.08	0.09	0.08	0.08	0.08
ROUND DUCT SIZE	4	6	6	5	5	5	4	5	5	5	6	6	4	4	5	4	4	4
HEATING VELOCITY (ft/min)	424	260	260	492	286	286	207	470	470	470	321	321	275	333	213	207	275	275
COOLING VELOCITY (ft/min)	264	347	347	367	235	235	69	463	463	463	367	367	69	424	272	69	402	402
OUTLET GRILL SIZE	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	C	C	C	C	C	C	B	A	A	B	A	A	B	B	B	B	C	C

SUPPLY AIR TRUNK SIZE	TRUNK	STATIC	ROUND	RECT	VELOCITY	TRUNK	STATIC	ROUND	RECT	VELOCITY	RETURN AIR TRUNK SIZE	TRUNK	STATIC	ROUND	RECT	VELOCITY
	CFM	PRESS.	DUCT	DUCT	(ft/min)	CFM	PRESS.	DUCT	DUCT	(ft/min)		CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK A	254	0.07	8.7	10	x 8	457	0	0.00	0	0	x 8	0	0.05	0	0	x 8
TRUNK B	436	0.07	10.6	14	x 8	561	0	0.00	0	0	x 8	0	0.05	0	0	x 8
TRUNK C	332	0.07	9.6	12	x 8	498	0	0.00	0	0	x 8	0	0.05	0	0	x 8
TRUNK D	0	0.00	0	0	x 8	0	0	0.00	0	0	x 8	0	0.05	0	0	x 8
TRUNK E	0	0.00	0	0	x 8	0	0	0.00	0	0	x 8	0	0.05	0	0	x 8
TRUNK F	0	0.00	0	0	x 8	0	0	0.00	0	0	x 8	0	0.05	0	0	x 8

RETURN AIR #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
AIR VOLUME	120	120	125	115	85	105	100	0	0	0	0	0	0	0	0	0	0	0
PLENUM PRESSURE	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14
ACTUAL DUCT LGH.	62	57	61	82	66	64	58	1	1	1	1	1	1	1	1	1	1	1
EQUIVALENT LENGTH	180	175	175	220	215	215	165	0	0	0	0	0	0	0	0	0	0	0
TOTAL EFFECTIVE LH	242	232	236	302	281	279	223	1	1	1	1	1	1	1	1	1	1	1
ADJUSTED PRESSURE	0.06	0.06	0.06	0.05	0.05	0.05	0.06	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32	14.32
ROUND DUCT SIZE	6.8	6.8	6.9	7	6.3	6.8	6.4	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	14	14	14	0	0	0	0	0	0	0	0	0	0	0

TYPE: 5008 - ELEV B
SITE NAME: VALES OF HUMBER SOUTH

LO # 95291
OPT 2ND

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>4</u> @ 10.6 cfm	<u>42.4</u> cfm
Kitchen & Bathrooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Other Rooms	<u>7</u> @ 10.6 cfm	<u>74.2</u> cfm
Table 9.32.3.A.	TOTAL	<u>222.6</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>95.4</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>222.6</u>	cfm
Less Principal Ventil. Capacity	<u>150</u>	cfm
Required Supplemental Capacity	<u>72.6</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model: VANEE V150H	Location: BSMT
<u>150.0</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
150.0 CFM	X 74 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-1	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-2	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH-3	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE V150H	INSTALL 2 HRV / ERV's	
<u>150</u> cfm high	<u>35</u> cfm low	
<u>75</u> % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER: ROYAL PINE HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	July-24

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 95291		Model: 5008 - ELEV B		Builder: ROYAL PINE HOMES																																																								
				Date: 7/11/2024																																																								
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr><td>Bsmt</td><td>2073</td><td>10</td><td>20730</td></tr> <tr><td>First</td><td>2073</td><td>11</td><td>22803</td></tr> <tr><td>Second</td><td>2400</td><td>9</td><td>21600</td></tr> <tr><td>Third</td><td>0</td><td>9</td><td>0</td></tr> <tr><td>Fourth</td><td>0</td><td>9</td><td>0</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>65,133.0 ft³</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>1844.4 m³</td></tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	2073	10	20730	First	2073	11	22803	Second	2400	9	21600	Third	0	9	0	Fourth	0	9	0	Total:			65,133.0 ft³	Total:			1844.4 m³	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%;">0.234</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.076</td> </tr> </table> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-19</td> <td>41</td> <td>74</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>30</td> <td>6</td> <td>11</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.234	SUMMER NATURAL AIR CHANGE RATE	0.076	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-19	41	74	Summer DTDc	24	30	6	11
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	2073	10	20730																																																									
First	2073	11	22803																																																									
Second	2400	9	21600																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			65,133.0 ft³																																																									
Total:			1844.4 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.234																																																											
SUMMER NATURAL AIR CHANGE RATE	0.076																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-19	41	74																																																								
Summer DTDc	24	30	6	11																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.234 x 512.32 x 41 °C x 1.2 = 5940 W = 20268 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.076 x 512.32 x 6 °C x 1.2 = 286 W = 977 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E) \times 2 \text{ HRV / ERV's}$ 300 CFM x 74 °F x 1.08 x 0.25 = 6010 Btu/h			$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 300 CFM x 11 °F x 1.08 x 0.25 = 891 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level \ Factor \times HL_{airbv} \times \{ (HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel}) \}$ <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairve Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr><td>1</td><td>0.5</td><td rowspan="5" style="text-align: center; vertical-align: middle;">20,268</td><td>11,375</td><td>0.891</td></tr> <tr><td>2</td><td>0.3</td><td>16,529</td><td>0.368</td></tr> <tr><td>3</td><td>0.2</td><td>15,592</td><td>0.260</td></tr> <tr><td>4</td><td>0</td><td>0</td><td>0.000</td></tr> <tr><td>5</td><td>0</td><td>0</td><td>0.000</td></tr> </tbody> </table> *HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0					Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	20,268	11,375	0.891	2	0.3	16,529	0.368	3	0.2	15,592	0.260	4	0	0	0.000	5	0	0	0.000																														
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																								
1	0.5	20,268	11,375	0.891																																																								
2	0.3		16,529	0.368																																																								
3	0.2		15,592	0.260																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								
				Michael O'Rourke BCIN# 19669 																																																								

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 5008 - ELEV B	OPT 2ND	BUILDER: ROYAL PINE HOMES
SFQT: 4398	LO# 95291	SITE: VALES OF HUMBER SOUTH

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-2	OUTDOOR DESIGN TEMP.	86
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.60

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	2.50	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	TIGHT	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	65133.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 69.0 ft	WIDTH: 42.0 ft	EXPOSED PERIMETER:	222.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
SB-12 PERFORMANCE****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22+1.5	21.40
Basement Walls Minimum RSI (R)-Value	20	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	1.6	-
Skylights Maximum U-Value	2.6	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.9	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

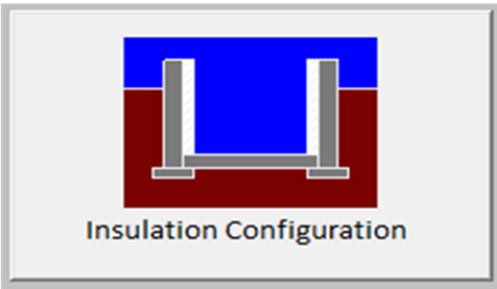Weather Station Description		
Province:	Ontario	
Region:	Brampton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	21.0	 Insulation Configuration
Floor Width (m):	12.8	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	2.2	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2357

TYPE: 5008 - ELEV B
LO# 95291

OPT 2ND


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Brampton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.01			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1844.4			
Air Leakage/Ventilation				
Air Tightness Type:	Energy Star Detached (2.5 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1721.7 cm ²		
	2.50	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	70.8	70.8		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.234			
Cooling Air Leakage Rate (ACH/H):	0.076			

TYPE: 5008 - ELEV B
LO# 95291

OPT 2ND

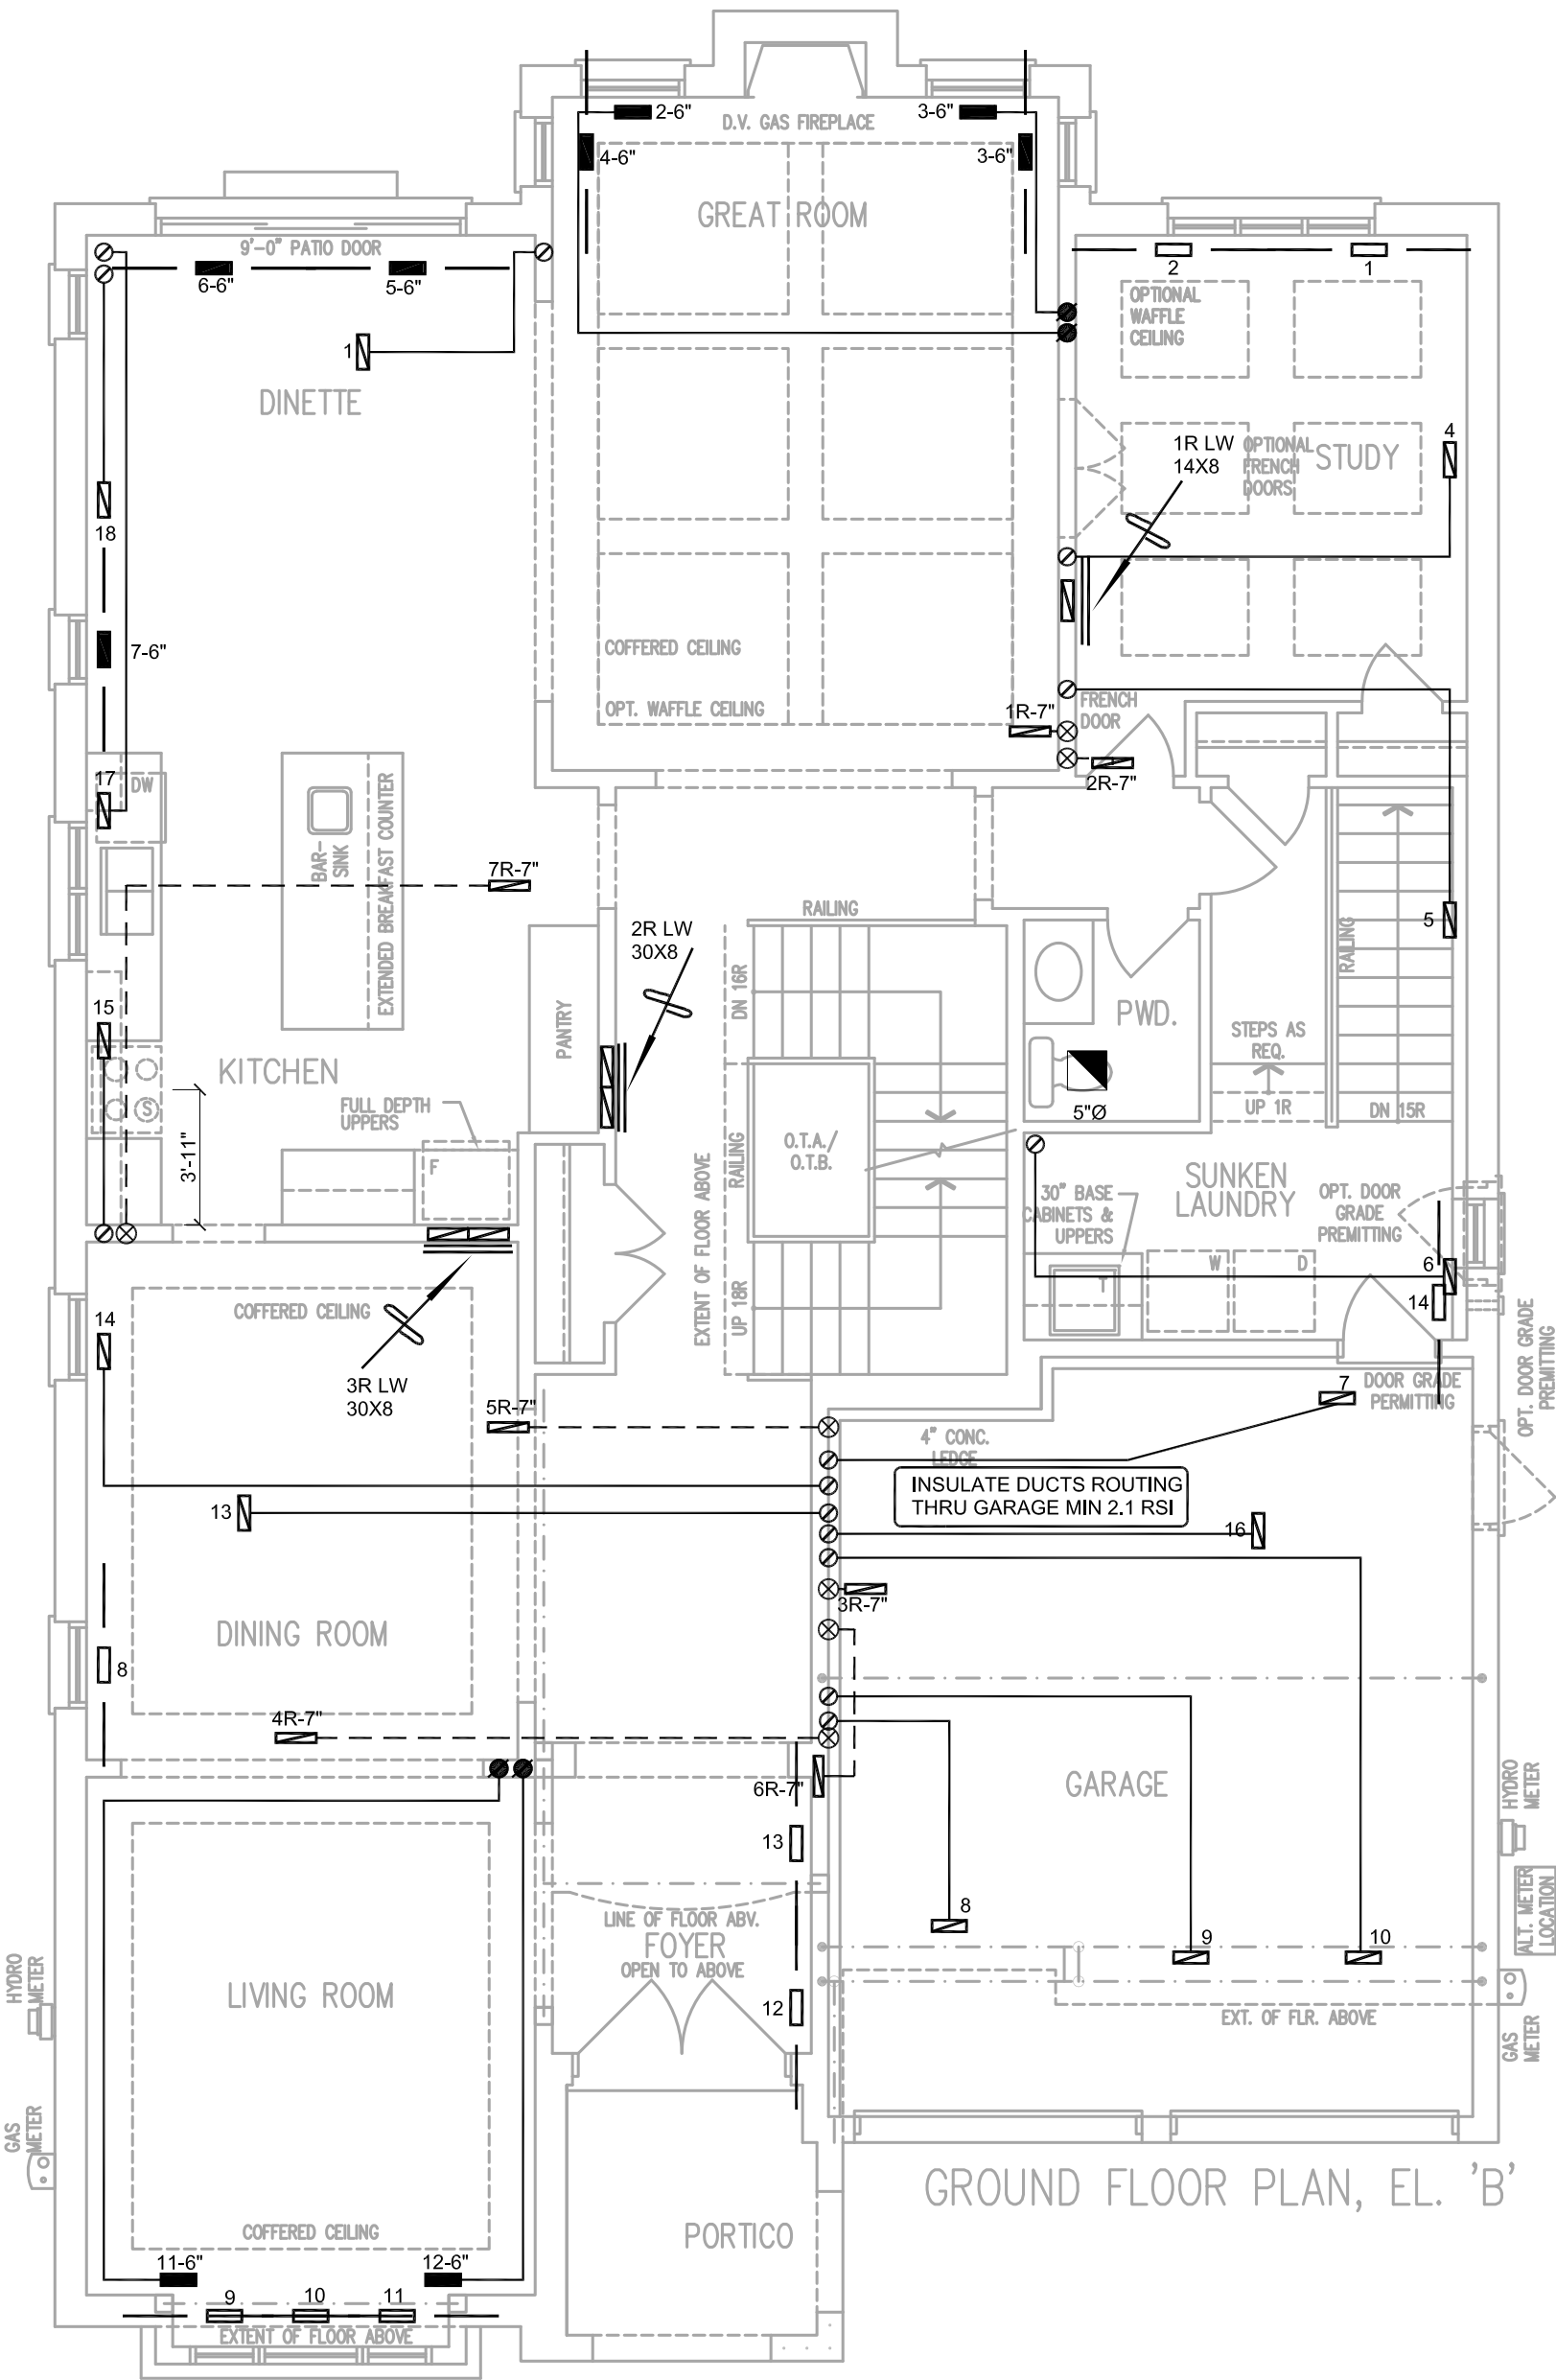

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED EQUIPMENT	JULY/24
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH	APR/2022
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C.3.2.5 of the building code.

Michael O'Rourke
Michael O'Rourke BCIN # 19669
HVAC Designs Ltd.

SB-12 PERFORMANCE

Client
ROYAL PINE HOMES

Project Name
VALES OF HUMBER SOUTH BRAMPTON, ONTARIO

OPT 2ND
5008 - ELEV B

4398 sqft

HVACDESIGNS LTD.
375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdsgns.ca
Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.


Sheet Title
FIRST FLOOR HEATING LAYOUT

Date
MAR/2022

Scale
3/16" = 1'-0"

BCIN# 19669

LO# 95291

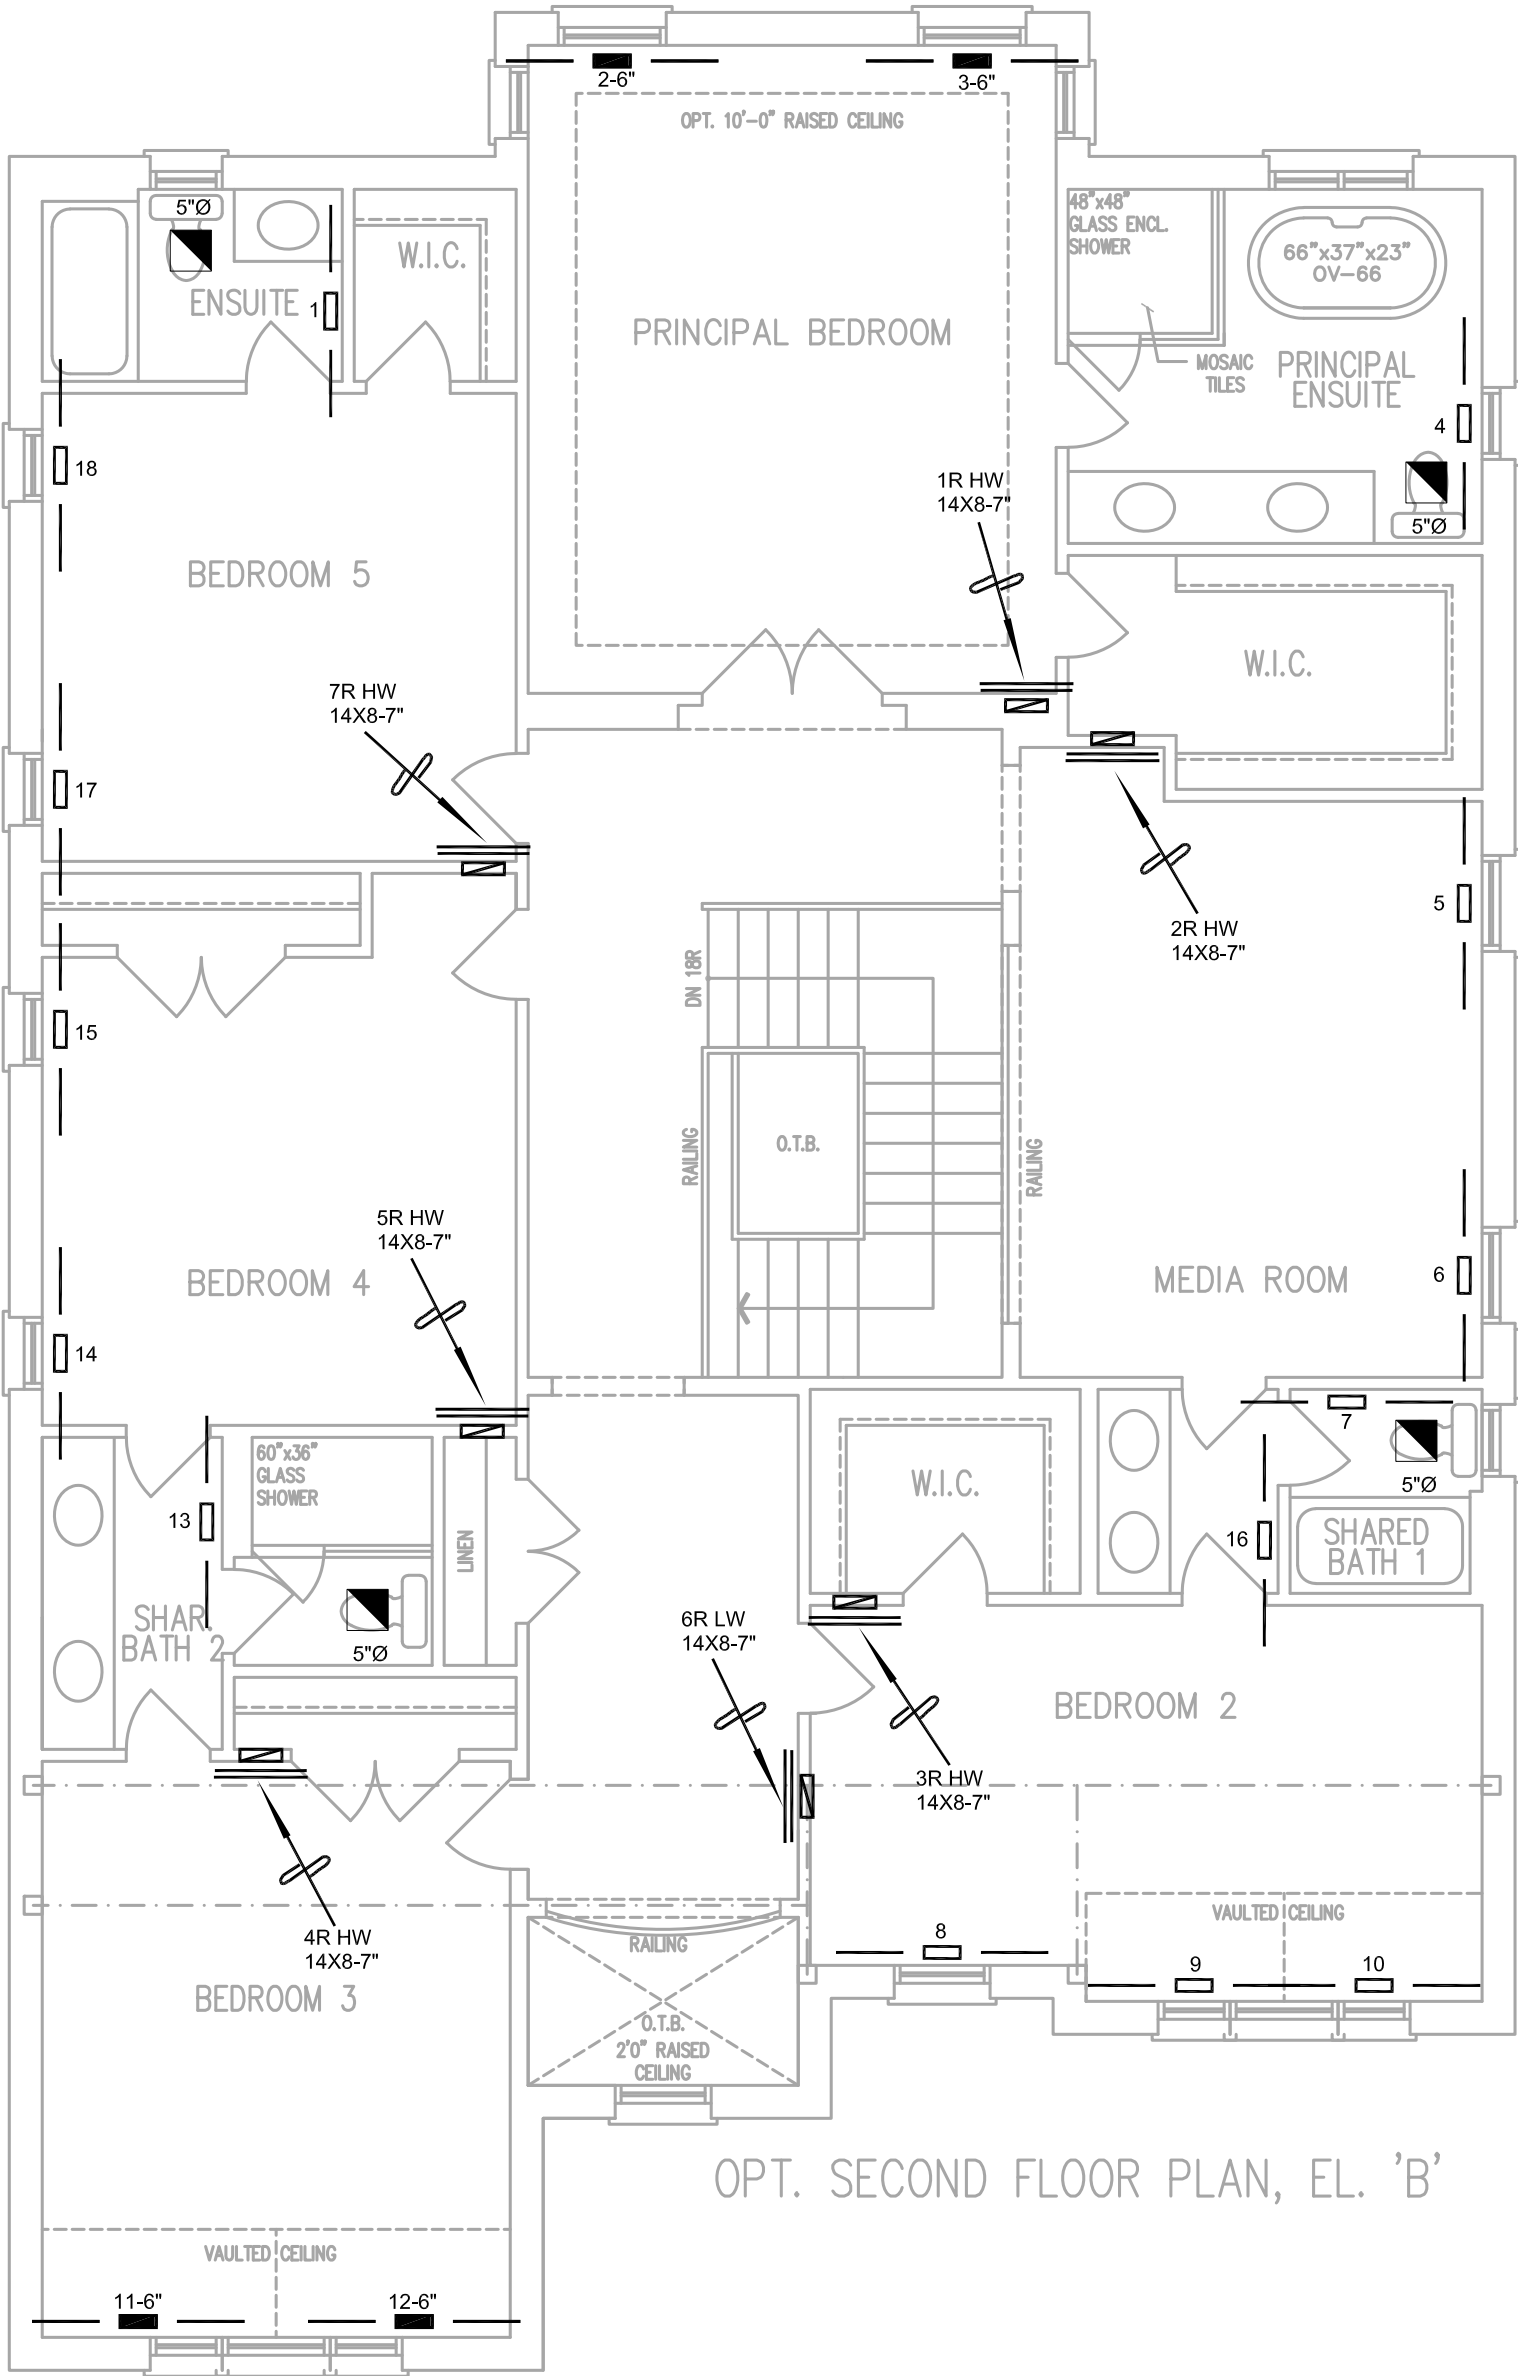

OPT. SECOND FLOOR PLAN, EL. 'B'

HVAC LEGEND								3.			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	REVISED EQUIPMENT	JULY/24	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	REVISED TO PERFORMANCE PATH	APR/2022	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date	
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS			
ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.						I Michael O'Rourke have reviewed and take responsibility for the design work and am qualified under division C,3.2.5 of the building code.		 Michael O'Rourke BCIN # 19669 HVAC Designs Ltd.		SB-12 PERFORMANCE	
Client ROYAL PINE HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.								Sheet Title SECOND FLOOR HEATING LAYOUT	
Project Name VALES OF HUMBER SOUTH BRAMPTON, ONTARIO										Date MAR/2022	
OPT 2ND 5008 - ELEV B 4398 sqft										Scale 3/16" = 1'-0"	
										BCIN# 19669	
						LO# 95291					