CONSTRUCTION NOTES: **COMPLIANCE PACKAGE A1 - OBC 2012 - 2022 ENACTMENT**

(INLESS OTHERWISE NOTED) — -ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BULLDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION. -ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.

-THERMAL RESISTANCE VALUES BASED ON ZONE FOOTINGS / SLABS: TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.

-BASED ON 16-1*(4.9m) MAX. SUPPORTED JOIST LENGTH
-MIN. 22009; (15MPC) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACIT

FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

-REFER TO WORKING DRAWINGS FOR SPECIFIC SIZES THAT MAY SUPERSEDE NOTES #1

& #2 FOR FOOTING SIZES

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.

-FIG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
BRICK VENEER -1 STOREY -13" X 4" (330mm X 100mm)
-2 STOREY -19" X 6" (485mm X 155mm)
-3 STOREY -26" X 9" (660mm X 230mm) SIDING--1 STOREY - 10" X 4" (255mm X 100mm -1 STOREY - 10 X 4 (255mm X 100mm) -2 STOREY - 14" X 4" (360mm X 100mm) -3 STOREY - 18" X 5" (460mm X 130mm) 2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

1 STOREY MASONRY -1 STOREY STUD - 12" X 4" (305mm X 100mm) -2 STOREY MASONRY - 26" X 9" (650mmX 230mm) -2 STOREY STUD -18" X 5" (450mm X 130mm) -3 STOREY MASONRY -36" X 14" (900mm X 360mm) - 24" X 8" (600mm X 200mm

3 STEP FOOTING:

O.B.C. 9.15.3.9. -23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL RUN.

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3. & 9.16.3. -4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BLOW BOTTOM OF F.R. SLAB. -COVER TOP & SIDES OF TILE OR PIPE W/ 5.7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL

5 BASEMENT SLAB:

O.B.C. 9.13. & 9.16. -3" (75mm) CONCRETE SLAB -2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5. -ZZUDB (15MPG) AFIEK 28 DA15 - O.B.C., Y.16.4.3.

PAMPPROOF BELOW SLAB W/ MIN. 0006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.

-DAMPPROOFING MAY BE OMITED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS

-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.

MULEDS (1.8 AS IP SECHIBED TO BE MATERIBED COSED) IT SMALL COMEDIAL TO OR

WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT. SHALL CONFORM TO OBC

FLOOR DRAIN PER O.B.C.9.31.4.4. -RIO (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2"
(600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN
23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (OBC SB-12-3,11.7 (5)) UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

5a SLAB ON GROUND:

-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3. 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.

DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE: S' ROLL ROOFING W, 4" (100mm) LAPPED JOINTS.

DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 (RS) 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. (OBC SB-12 3.1.1 7 (6)) 4" (100mm) OF COURSE GRANULAR MATERIAL
PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C.

UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD 6 GARAGE SLAB / EXTERIOR SLAB:

-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6. 6" X 6" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB 4" (100mm) OF COURSE GRANULAR MATERIAL ANY FILL PLACED UNDER SLAB , OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTERS:

O.B.C. 9.15.5.3. PILASTER
-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER
O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET 4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE. -1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.) STRUCTURAL COLUMNS

-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUC BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES

8 STEEL PIPE COLUMN: O.B.C. 9.15.3.4. & 9.17.3.

-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS -FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mmX 100mmx 6.35mm) STEEL BTM. PLATE -FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mmX 100mm X 6.35mm). STEEL TOP & BTM. -FOR WOOD BEAMS, MIN. 4 A4 A1/4 (TOUTHIN A 0.39THIN) STEEL FOR 6. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
-ADJUSTABLE COLUMNS TO CONFORM TO CAN//CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9,17.3.4.)

COL. SPACING: 2 STOREY -MAX. 9'-10" (2997mm) - 34" X 34" X 16" (860mmX 860mmX 400mm) - 44" X 44" X 21" - (1120mmX 1120mmX 530mm) -MAX, 16'-0" (4880mm)

- 40" X 40" X 19 (1010mmX 1010mmX 480mm) -MAX. 16'-0" (4880mm) - 51" X 51" X 24" mX 1295mmX 610mm)

-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mmX 200mmX 16mm) STEEL 9 WOOD COLUMN:

OBC 9.17.4.1 , 9.17.4.2, & 9.17.4.3.

-5 1/2" x 5 1/2" (140mm x 140mm) SOLID WOOD COLUMN - OR 3-2"x6" (38mm x 140mm) BUILT UP COLUMN NAILED TOGETHER W/ 3" (76mm) NAILS SPACED NOT MORE THAN 12" (300mm) APART OR BOLTED TOGETHER W/ 3/8"(9.52mm) DIA BOLTS SPACED AT 18" (450mm) O.C. -COLUMN TO SIT DIRECTLY ON CONC PAD (NOT ON CONC SLAB)

25"x25"x12" (640mm x 640mm x 300mm) CONC PAD (1 FLOOR SUPPORTED W/ 9'-10" 4"x34"x14" (860mm x 860mm x 360mm) CONC PAD (2 FLOORS SUPPORTED W/ 9'-10"

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES) -2"X8"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C. -WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

11 BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM) 12"X11"X 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH

2- 1/2"Ø x8" ANCHOR BOLTS. USE TO OBTAIN 5" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

WALL ASSEMBLIES: FOUNDATION WALL:

O.B.C. 9.15.4.2. -FOR WALLS NOT EXCEEDING 8-2" (2500mm) IN LATERALLY SUPPORTED HEIGHT. -8" (200mm) SOLID 2200psi (15MPa) CONCRETE -MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. -FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT. -10" (250mm) SOLID 2200psi (15MPa) CONCRETE -MAX, UNSUPPORTED HEIGHT OF 4-7" (1400mm) & MAX, SUPPORTED HEIGHT OF 8-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS

-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.-19.15.4.2.A SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.- PART 4
-WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE
-INSULATE W, R20 (RS) 3.52 (OONTINUOUS INSULATION FROM UNDERSIDE OF SUBFLOOR TO
NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1 OBC SB-12

ALTERNATE INSULATION METHOD: 2" (51mm) R10 (RSI 1.76)RIGID INSULATION W/ 2"x4"(38mm X 89mm) WOOD STUD W/ R12 (RSI 2.11) BATT INSULATION -BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL -1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4.)

REDUCTION OF THICKNESS:

O.B.C. 9.15.4.7. -WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2 90mm) THICK. -TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) VERTICALLY O.C. & 2-11" (900mm) HORIZONTALLY,
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOSTS, THE REDUCED THICKNESS SHALL BE MAX,
13-3/4" (350mm) HIGH & MIN, 3-1/2" (90mm) THICK DAMPPROOFING & WATERPROOFING: -DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2. -WHERE INSULATION EXTENDS TO MORE THAN 2-11" (900mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4)

-Finished Basements shall have interior dampproofing extending from SLAB

TO GRADE LEVEL 8. SHALL CONFORM TO O.B.C. 9.13.2.5.(2)(b)

-where hydrostatic pressure occurs, fdn. walls shall be waterproofed as

$\langle 140 \rangle$ FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) -2-20M BARS IN TOP PORTION OF WALL (DP 10 6-0 'OFENING)
-3-20M BARS IN TOP PORTION OF WALL (10"-0" TO 10"-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (10"-0" TO 15"-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE APPROX 4" TO 6" APART. -BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER -BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING

15 FRAME WALL CONSTRUCTION: O.B.C. 9.23. -SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C 9.28.1.4. & 9.27.) -WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. -1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16 -27'X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1. OBC SB-12 T.3.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4...

-1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm)X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW2c (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING BATT INSULATION REQUIRES A MASS OF AT LEAST 1.0 kg/ sq.m.

REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 5/8" (15.9mm) TYPE 'X'

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -refer to requirements for less than 4'-0" limiting distance and add/replace the -NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER $1/2^{\circ}$ (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION:

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4.) BRACE W/ CONT. 16 GAUGE STEEL 'T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE EILL LENGTH OF WALL. OR CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS. -R14 (RSI 2.46) INSULATION

CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. .1/2" (12.7mm) GYPSUM BOARD. NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C

$\underline{\text{REQ. FOR FIRE RATING (LESS THAN 4'-0'' LIMITING DISTANCE):}}$

O.B.C. SB-3 WALL = EW2c (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE -ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. TWEEN RIGID INSULATION AND WOOD STUD BETWEEN KIGBLINSULATION AND WOOD STUD. -BATTINSULATION REQUIRES A MASS OF AT LEAST 1.0 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 5/8" (15.9mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

OK -VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

(15b) FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. -WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-1/4" (38mm) PLYMOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C.

-1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO

BESPACED & 12" (300mm) O.C.

BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW2c (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE

-ADD GLASS FIBRE BATT TO FILL CAVITY WITH A MASS OF AT LEAST 1.0 kg/ sq.m. _RFPI ACF 1/2"(12.7mm1 GYPSUM BD. W/ 5/8" (15.9mm) TYPE 'X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND

-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO

OK VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" [12.7mm] GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD

$\langle 16 \rangle$ BRICK VENEER CONSTRUCTION:

O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 16" (406mm) O.C. HORIZONTAL & 24" (610mm) O.C. VERTICAL -PROVIDE WEEP HOLES @ 2-7" (800mm)O.C. @ BTM. COURSE & OVER OPENINGS -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER -1" (25mm) AIR SPACE VALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. -1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16

-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O C -MIN. R22 (RSI 3.87) INSULATION (ZONE 1. OBC SB-12 T.3.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. 1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW2b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE -BATT INSULATION REQUIRES A MASS OF AT LEAST 1.0 kg/sq.m. REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

160 ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.

-3-1/2" [90mm] FACE BRICK OR 4" [100mm] STONE @ 36-1" [11m] MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK. 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX.
16" [406mm] O.C. HORIZONTAL & 24" [610mm] O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2-7" (800mm)O.C. @ BTM. COURSE & OVER OPENINGS

-BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS

-BRACE W/ CONT. 16 GAUGE STEEL 'T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR

-CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG.

-ROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL

-R14 (RSI 2.46) INSULATION -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. -1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = NOIE-SUPPORTED A BOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE \$PACED @ 12" (300mm) O.C.

-FOR 3 FLOORS SUPPORTED A BOVE, 2" X 4" (38mmX 140mm) STUDS ARE REQUIRED TO BE \$PACED @ 12" (300mm) O.C.

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE \$PACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW2c (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS: -ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD -BATT INSULATION REQUIRES A MASS OF AT LEAST 1.0 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 5/8" (15.9mm) TYPE 'X' GYPSUM BD.

16b BRICK VENEER CONSTRUCTION @ GARAGE:

O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ -ANIN, OUS (U.) FOILINI HICK, 7/8 (22mm) WIDE CORKOSION RESISTANT STRAPS @ MAX, 16" (406mm) O.C. HORIZONTAL & 24" (610mm) O.C. VERTICAL SPACING -PROVIDE WEEP HOLES @ 2-7" (800mm) O.C., @ BTM. COURSE & OVER OPENINGS -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2)) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER 1" (25mm) AIR SPACE WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16
2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C.
1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.0

 $\underline{\text{REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):}}$ O.B.C. SB-3 WALL = EW2b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE
FOLLOWING MATERIALS:
-ADD GLASS FIBRE BATT TO FILL CAVITY WITH A MASS OF AT LEAST

1.0 kg/ sq.m. REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD. INTERIOR STUD WALLS:

O.B.C. T.9.23.10.1. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR 2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE 1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

BEARING STUD WALL (BASEMENT): -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ -DBL. 2" X 4" OR 2" X 6" TOP PLATE. - 2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL -1/2" (12.7mm) GYPSUM BOARD BOTH SIDES. -1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7"-10" (2400mm) O.C. FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURE

PARTY WALL - BLOCK: O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR) -MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE -MIN. THE HER-ESSIVANCE BATING COMINDUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
-FLANKING FLOOR ASSEMBLIES TO COMPLY WITH OBC 9.11.1.4.(4)
-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT SMOKE PASSAGE
-1/2" [12.7mm] GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES -2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH SIDES ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY. -7-1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-5TAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C.
9.10.9.9.(1) & TABLE 2.1.1. SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 NOTE (4) TO TABLE 1

PARTY WALL - BLOCK (AGAINST GARAGE):

O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR) -MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS -1/2" (12.7mm) GYPSUM BOARD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 2" X 6" (38mmX 140mm) WOOD STRAPPING @ 16" (400mm) O.C. 2-2 (Set) 3.5 (Genthia) Model Start-Ind @ 16 (4001111) O.C. -22 (Set) 3.5 (RGID INSULATION -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) -1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN HOUSE AND TAPE AND SEAL ALL JOINTS GAS TIGHT

(9b) FIREWALL:

O.B.C. 9.10.11. & 3.1.10. & SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

- ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING AREA, O.B.C. T.3.2.2.47 -FLANKING FLOOR ASSEMBLIES TO COMPLY WITH OBC 9.11.1.4.(4) 1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS 2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES OF wall Sound absorptive material each side filling 90% of the Cavity -7 1/2" (190mm) Conc. block, min. 2 hr. fire-resistant rating Every firewall shall be Continuous through all building storeys STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1 SB-2 O.B.C., 9.10.9.7.(1) & TABLE 2.1.1 SB-2 -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 NOTE (4) TO TABLE 1 -PROTRUDE PAST FASCIA, @ EAVES WJ BRICK CORBELLING -EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/ THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.(1) WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER THAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER O.B.C. 3.1.10.4.(2)

20 PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2. -7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS -FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
-FLANKING FLOOR ASSEMBLIES TO COMPLY WITH OBC 9.11.1.4.(4) 2" X 4" (38mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" (38mmX Sound absorptive material on both sides filling a minimum of 90% of

-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED & FILLED. -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 NOTE (4) TO TABLE 1 NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE

PEQUIPED TO BE SPACED @ 12" (300mm) O C FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. - IF 2"x6" STUDS ARE USED AT STAIR OPENING CONTINUE TO USE ON REMAINING FLOORS AT THE STAIR OPENING AT 16" O.C

(22) GARAGE WALL & CEILING: O.B.C. 9.10.9.16.(3) mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING -1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING
BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS,
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. & 9.25.4.. FOR FLOOR ABOVE. -INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN. REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS) '2" (12.7mm) ĠYPSUM BOARD -ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH -ROUT PRAMINE WINDERS ARE 4-3 1/4" (82mm) TOE NAILS -BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C.

(220) WALLS ADJACENT TO ATTIC SPACE: CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. .R22 (RSI 3.87) INSULATION -1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING ON ATI -ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.

 $\langle 23 \rangle$ double volume walls: -3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING REFER TO PLAN FOR STUD SPECIFICATION
STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS
DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT -SOLID BRIDGING AT 3'-11" (1200mm) O.C. MIN. R22 (RSI 3.87) INSULATION (ZONE 1 OBC SB-12 T.3.1.1.2.A.) CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. &

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY

CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIE MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

EXPOSED FLOOR:

-FLOOR AS PER NOTE # 28

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. & 9.25.4.

-R31 (RSI 5.46) INSULATION 240 SUNKEN FINISHED AREAS:

-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS. WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS

LOOR STRUCTURE AS PER NOTE # 28. 25) DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2.

-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9. SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBER SILL PLATE REQUIRED FOR ROOF AND CELLING FRAMING MEMBERS

-6" SILL W, PE BARRING ON BACH SIDE & ANCHOR BOLTS @ 4"3" O.C.

NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS
BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY AREA.

(250) CORBEL MASONRY VENEER:

MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1) FLOOR ASSEMBLIES:

$\langle \overline{26} \rangle$ SILL PLATE:

O.B.C. 9.23.7. -2" X 4" (38mm X 89mm) PLATE -1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO -SILL PLATE TO BE CALLEKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm

HICK BEFORE COMPRESSING, OR FOAM GASKET, OR PLACED ON FULL BED OF 27 BRIDGING & STRAPPING:

-1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C. PASTENED TO SILL OR HEADER @ FNDS b) BRIDGING -1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX. 6'-11"

(2100mm) O.C. c) BRIDGING & STRAPPING -) ship ประการ - ๆ & b) USD TOGETHER OR - 1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH STRAPPING

d) FURRING OR PANEL TYPE CEILING STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH IS ATTACHED DIRECTLY TO JOISTS.

 $\langle 28 \rangle$ FLOOR ASSEMBLY: O.B.C. 9.23.14.3, 9.23.14.4 -5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS

29 PORCH SLAB: O.B.C. 9.39.1.4 C.B.C., 9.39.1.4.

-4.7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7.7/8" (200mm) EACH WAY
-1.1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB

-3" (75mm) END BEARING ON FOUNDATION WALL -23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C. IF A COLD CELLAR IS LOCATED BELOW THE SLAB, SUPPORT ON FOUNDATION WALLS

(30) EXTERIOR BALCONY ASSEMBLY: -1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING -2"2" OR 2"X" PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED -2 PLY MODIFIED BITUMINOUS MEMBRANE ON 1/8" ROOF BOARD (2 LAYERS MODIFIED BITMINOUS MEMBRANE ON 176 ROOF BOARD (2 LATERS) ASPHALT-SATURATED GLASS MAT WITH MINERAL-FORTIFIED ASPHALTIC CORE) PER MANUF SPECS. ON 5/8" (15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X4" OR

MANDIA STEES. ON 30 (15,7111) EXTENDE ASALETET WOOD SITEATING ON 2 24-27X6" PURINS (CUT TAPERED) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN) MIN 2% TO ROOF SCUPPER - EXTERIOR GUARD AS PER #364 REQUIRED FOR OVER HEATED SPACES: -ADD 2"X2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C., FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA) -ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. &

ADD 5/8" (15.9mm) GYPSUM BOARD W/ TAINTED CEILING (O.B.C.-T.9.29.5.3.) 30a EXTERIOR FLAT ROOF ASSEMBLY:

2 PLY MODIFIED BITUMINOUS MEMBRANE ON 1/8" ROOF BOARD (2 LAYERS ASPHALT-SATURATED GLASS MAT WITH MINERAL-FORTIFIED ASPHALTIC CORE) PER MANUT SPECS.

-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON ON 2"X4" OR 2"X6" PURLINS (CUT
TAPERED) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON
PLAN) SLOPED MIN 2% TO ROOF SCUPPER

ADD 179" (12 7mm) GYPSUM BOARD W/ PAINTED CEILING OR

REQUIRED FOR OVER HEATED SPACES: -ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR -ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. -ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

ROOF ASSEMBLIES

$\langle 31 \rangle$ TYPICAL ROOF:

POR COOF SLOPES EQUAL TO AND GREATER THAN 4:12 AND LESS THAN 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL AVES PROTECTION LAID BENEATH STARTER STRIP -EAVES PROTECTION LAID BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT RECOURED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 CRADE) WITH "H" CLIPS
-APPROVED WOOD TRUSSES @ 24" (400mm) O.C. (REFER TO MANUFACTURER'S LAYOUT)
-TRUSS BRACING AS PER TRUSS MANUFACTURER
-EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.

$\langle \overline{32} \rangle$ <u>CEILING:</u> R60 (RSI 10.56) INSULATION TINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) 320 VAULTED OR CATHEDRAL CEILING:

O.B.C. 9.26. & TABLE A4
-NO. 210 (30. 5KG/m2) ASPHALT SHINGLES -POL 2 IU (3U. 3KG/MZ) ASYTHAL I SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP
THE ROOF SLOPE MIN. 2-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12"
(300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP.
-EAVES PROTECTION NOT BEQUIPED OVER UNIVERSED SPACES OR WHITE PROCE

EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1. -STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3) 3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS 2-72-8" (38mm x 184mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 13-3" (4050mm) OR -2"x10" (38mm x 235mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 17"-0" (5180mm)

-R31 (RSI 5.46) INSULATION MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION ONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. & 9.25.4.

<u>LEGEND</u>

SMOKE ALARM (44)

ALARM (CMA)

DUPLEX OUTLET

VENTS AND INTAKES

COLD CELLAR VENT (50)

FIRE PLACE VENT

.8 4-7/8" X 3-1/2" X 1/4" L L13 5-7/8" X 3-1/2" X 3/8" L

DRYER VENT

FLOOR DRAIN

SOLID BEARING

2/ 2" X 8" SPR

3 2/2" X 10" SPR

5 2/2" X 12" SPR

WATERPROOF

HOSE BIB

38 EXHAUST FAN

STOVE VENT

CARBON MONOXIDE (45)

FLAT ARCH 2 STORY WALL

EXT. LIGHT FIXTURE (WALL MOUNTED) (H) HYDRO METER GAS METER DJ DOUBLE JOIST PRESSURE TREATED PT LUMBER GT GIRDER TRUSS

AFF ABOVE FINISHED FLOOR **BBFM** BEAM BY FLOOR MANUF FLUSH (FL) DROPPED 'DO' REPEAT SAME JOIST SIZE U/S UNDER SIDE FG FIXED GLAZING GLASS BLOCK BLACK GLASS

BG LINTELS L9 4" X 3-1/2" X 1/4" L L14 5-7/8" X 3-1/2" X 1/2" I L10 4-7/8" X 3-1/2" X 5/16" L L15 5-7/8" X 4" X 1/2" L WD14 2/ 1 3/4" X11 7/8" (2.0E) L L11 4-7/8" X 3-1/2" X 3/8" L L16 7-1/8" X 4" X 3/8" L WD16A 1/13/4" X14" (2.0E) I VI 3-1/2" X 3-1/2" X 1/4" L L12 5 7/8" X 3-1/2" X 5/16" L L17 7-1/8" X 4" X 1/2" L

 $\langle 33 \rangle$ Conventional framing:

O.B.C. TABLE A6 OR A7 -2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9" (3890mm) 2"X4" (38mm X 89mm) COLLAR TIES AT MIDSPAN CEILING JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C. LINI FSS HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON RAFTERS & MIN. 1 1/2" (38mm) THICK.

34 ATTIC ACCESS HATCH:

OBC 9.19.2.1. & SB-12 3.1.1.8.(1)
-19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH WEATHERSTRIPPING &
BACKED W/ R20 (RSI 3.52) INSULATION.
GENERAL:

$\langle 35 \rangle$ PRIVATE STAIRS: O.B.C. 9.8.4. = 7-7/8" (200mm) -MAX. RISE

= 10" (255mm)
-MIN. TREAD = 11" (280mm)
-NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (860mm)
(BETWEEN WALL FACES)
MIN. WIDTH = 2'-11" (2011)

-MIN. WIDTH = 2'-11" (900m (EXIT STAIRS, BETWEEN GUARDS)

(RAI STAIRS, DELIVEDRI GUNRAS)

TAPERED TREADS: (9.8.4.3.)

-MIN. RUN = 5.7/8" (150mm)

-MIN. AVG., RUN** = 10" (255mm)

(**MEASURE FROM 300mm FROM MIDPOINT OF INSIDE HANDRAIL)

-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS

-EXTERIOR CONC. STEPS TO HAVE MIN. 11" (280mm) TREAD &

MAX. 7.78" (200mm) PISE MAX. 7 7/8" (200mm) RISE -FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 -FTG. FOR FOUND, WALL TO BE MIN, 4'-0" (1220mm) BELOW GRADE

HANDRAILS: O.B.C. 9.8.7 -ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1100mm)
ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN DWELLING JNITS HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

HEIGHT: O.B.C. 9.8.7.4 - 2'-10" (865mm) MIN. TO 3'-6" (1070mm) MAX. - 2-10 (865mm) WHERE GUARDS ARE REQUIRED ON LANDINGS - 3-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS - MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING PROJECTIONS:

O.B.C. 9.8.7.6 -HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

35a PUBLIC STAIRS:

O.B.C. 9.8.4. = 7-3/32" (180mm) = 11" (280mm) -MAX. RISE (2) 12" (305mm) = 1" -MIN. RUN = 12" -MIN. TREAD -MIN. IKEAU
-NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (900mm)
-MIN. WIDTH = (2'-11" (900mm)
-MIN. WIDTH = CHI STAIRS, BETWEEN GUARDS)
-FINSHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS -FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 -FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

HANDRAILS: O.B.C. 9.8.7 ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm -TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1100mm)
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT WHERE
INTERRUPTED BY DOOR WAYS

HEIGHT: O.B.C. 9.8.7.4

- 2-10" (865mm) MIN. TO 3"-6" (1070mm) MAX. - 3"-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS) - MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING PROJECTIONS: O.B.C. 9.8.7.6 - HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO

- ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" (300mm) BEYOND THE TOP & BOTTOM OF EACH FLIGHT

PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

O.B.C. 9.8.9.6 -TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.(4) - STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP

36 INTERIOR GUARDS: O.B.C. SB-7 & 9.8.8.3. -GUARDS TO BE 3"-6" (1070mm) HIGH -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2"-11" (900mm) HIGH

INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH (36a) EXTERIOR GUARDS: O.B.C. SB-7 & 9.8.8.3. -GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23.5/8"

-COUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2"-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING SURFACE IS
MORE THAN 5"-11" (1800mm) ABOVE ADJACENT GRADE. -PICKETS TO HAVE 4" (100mm) MAX, SPACING -FOR WOOD GUARDS PROVIDE MID-SPAN POSTS AS PER SB-7.

-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

(36b) EXTERIOR GUARDS @ JULIET BALCONY: -FOR RAILING SPANNING MAXIMUM OF 6'-0". -PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5. -GUARDS TO BE 3'-6" (1070mm)

-FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C.

9.8.8.2. OR -FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2. -VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS. PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION

37 -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP (38) CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)

 $\langle 40 \rangle$ -1"X2" (19mmX38mm) BOTH SIDES OF STEEL.

41 -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE. ONTARIO REGULATION 332/12 OBC. AMMENDMENT O. REG. 88/19 JAN 1, 2020 A 865x2030x45 (2'10"x6'8"x1-3/4 B 815x2030x35 (2'8"x6'8"x1-3/8" 760x2030x35 (2'6"x6'8"x1-3/8

460x2030x35 (1'6"x6'8"x1-3/8" G OVER SIZED EXTERIOR DOO STEEL BEAMS ST1 W 6 X 15 ST2 W 6 X 20 ST4 W 8 X 21 ST5 W 8 X 24 WOOD BEAMS

3/ 2" X 8" SPR /D2 4/ 2" X 8" SPR 5/ 2" X 8" SPR 3/ 2" X 10" SPR 4/ 2" X 10" SPR WD6 5/2" X 10" SPR 3/ 2" X 12" SPR WD8 4/ 2" X 12" SPR 5/ 2" X 12" SPR WD10 2/13/4" X7 1/4" (2.0F) I \ 3/ 1 3/4" X7 1/4" (2.0E) L' WD12A 1/ 1 3/4" X9 1/2" (2.0E) L WA13 3/13/4" X9 1/2" (2.0E) L\

WD17 3/13/4" X14" (2.0F) LVI

Areas:

♦ CLIENT SPECIFIC REVISIONS

	ELEVAT	ELEVATION 'A'		ON 'B'
	SF	SM	SF	SM
BASEMENT FLOOR PLAN	205.3	19.1	205.3	19.1
GROUND FLOOR PLAN	1808.5	168.0	1808.5	168.0
GROUND FLOOR PLAN OTB	(16.7)	(1.6)	(16.7)	(1.6)
SECOND FLOOR PLAN	1214.6	112.8	1214.6	112.8
SECOND FLOOR PLAN OTB	(350.6)	(32.6)	(350.6)	(32.6)
TOTAL AREA	2861.1	265.8	2861.1	265.8
COVERAGE INC PORCH	2458.4	228.4	2434.7	226.2
COVERAGE NOT INC PORCH	2344.3	217.8	2339.8	217.4

-PRECAST CONC. STEP
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

44 SMOKE ALARM, O.B.C.- 9.10.19. PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS -PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
-INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS
WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALLING ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN

POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4. CARBOT MONOCOLE ALARM (CMA), O.B.C. 7-30-34.
-WHERE THERE IS A FULE BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.

46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS
GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
-RA (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED

47 -GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.

ONE FLOOR EXCEPT;

1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED 27 MILES THAT INCOMENTAL BY A MINISON IN HEIGHT AND 21 5/8' (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3-3" (1000mm) ABOVE FLOOR AND 23-0" (7.0m) ABOVE ADJACENT GROUND

49 EXTERIOR COLUMN W/ MASONRY PIER: MIN. 6"X6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.

-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.

-MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP. REFER TO ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT.

-SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C.

-3/4" AIR SPACE AROUND POST.

OR

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER
ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.

-MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP. REFER TO ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.

-MIN_6"X6" (140mm X_140mm) WOOD POST CLAD W/ DECOR_SURROUND (PER

FOR COLD CELLARS PROVIDE THE FOLLOWING:

ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB WA METAL SADDLE NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17. $\langle 50 \rangle$ COLD CELLARS:

VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA. COVER VENT W/ BUG SCREEN WALL MOUNTED LIGHT FIXTURE THALL MOUNTED EIGHT HAIDE LI-HLT FOR DOOR OPENING -2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN.R-4 RSI 0.7) INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ R20 (RSI 3.52) CONTINUOUS

INSULATION (ZONE 1 OBC SB-12 T.3.1.1.2.A.) - ALTERNATE INSULATION METHOD: 2" (51mm) R10 (RSI 1.76)RIGID INSULATION W, 2"x4"(38mm X 89mm) WOOD STUD W/ R12 (RSI 2.11) BATT INSULATION STUD WALL REINFORCEMENT:

-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(q)&(c) & 3.8.3.13.(2)(g) & 3.8.3.13.(4)(e) -GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

53 WINDOW GUARDS:

@ STAIRS, LANDINGS & RAMPS - OBC 9.8.8.1.(8)
WINDOW SILL AT 3'-0" (900mm) OR GREATER DOES NOT REQUIRE GUARDS

WINDOW TO BE NON-OPERABLE AND DESIGNED TO WITHSTAND LATERAL LOADS PER OBC 9.8.8.1.(8)(b) © FLOORS - OBC 9.8.8.1.(6)

OPERABLE WINDOWS LESS THAN 1'-7" (480mm) ABOVE FLOORS WHERE ADJACENT GRADE IS GREATER THAN 5'-11" (1800mm) REQUIRE A GUARD PER OBC 9.8.8.2.

FRAME CONSTRUCTION: -ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED OTHERWISE ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN

JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING -BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING -DOUBLE STUDS @ OPENINGS DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mn

-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS -BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE -BEAMS IN BE FLACED UNDER COADBLAKING WALLS WHEN WALLS AKE
PARALLEL TO FLOOR JOISTS
-BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE

THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)

THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR

WATERPROOF WALLS IN BATHROOMS:

-REQUIRED AS PER OBC 9.29.2.1. -WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER "MINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

1.6 W/(m2 K) OR AN ENERGY RATING OF NOT LESS THAN 25 FOR WINDOWS -BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING

-SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8

-FOR GROSS GLAZED AREAS LESS THAN AND EQUAL TO 17% DRAIN WATER HEAT RECOVERY:

- DWHR UNITS TO BE INSTALLED AS PER OBC SB-12 3.1.1.1.(22) & 3.1.1.12. SENTENCES DWHR ARE REQUIRED IN ALL DWELLING UNITS TO RECEIVE DRAIN WATER FROM ALL SHOWERS OR FROM AT LEAST 2 SHOWERS WHERE THERE ARE 2 OR MORE SHOWERS PROVIDED THERE IS A CRAWL SPACE OR STOREY BELOW THE SHOWERS.


Signature

Huntsvi**ll**e 60-02 Violet 21020 3/16" = 1'-0"





WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA



TITLE SHEET

BASEMENT FLOOR PLAN ELEV 'A' GROUND FLOOR PLAN ELEV 'A'

Α3 SECOND FLOOR PLAN ELEV 'A' BASEMENT FLOOR PLAN ELEV 'B GROUND FLOOR PLAN ELEV 'B'

SECOND FLOOR PLAN ELEV 'B'

FRONT ELEVATION 'A' ROOF PLAN ELEV 'A' REAR ELEVATION 'A'

LEFT ELEVATION 'A' A 10 FRONT ELEVATION 'B'

A11 REAR ELEVATION 'B'

RIGHT ELEVATION 'A'

ROOF PLAN ELEV 'B'


A12 RIGHT ELEVATION 'B' LEFT ELEVATION 'B' A13 BUILDING CROSS-SECTION ELEVATION 'A' - "1-1" **BUILDING CROSS-SECTION**

ELEVATION 'B' - "2-2"

date dwn chk revisions ISSUED FOR CLIENT REVIEW 24-SEP-21 CR SH 15-Nov-21 WU AL REVISED PER CLIENT COMMENTS

Communities

Northern Lights

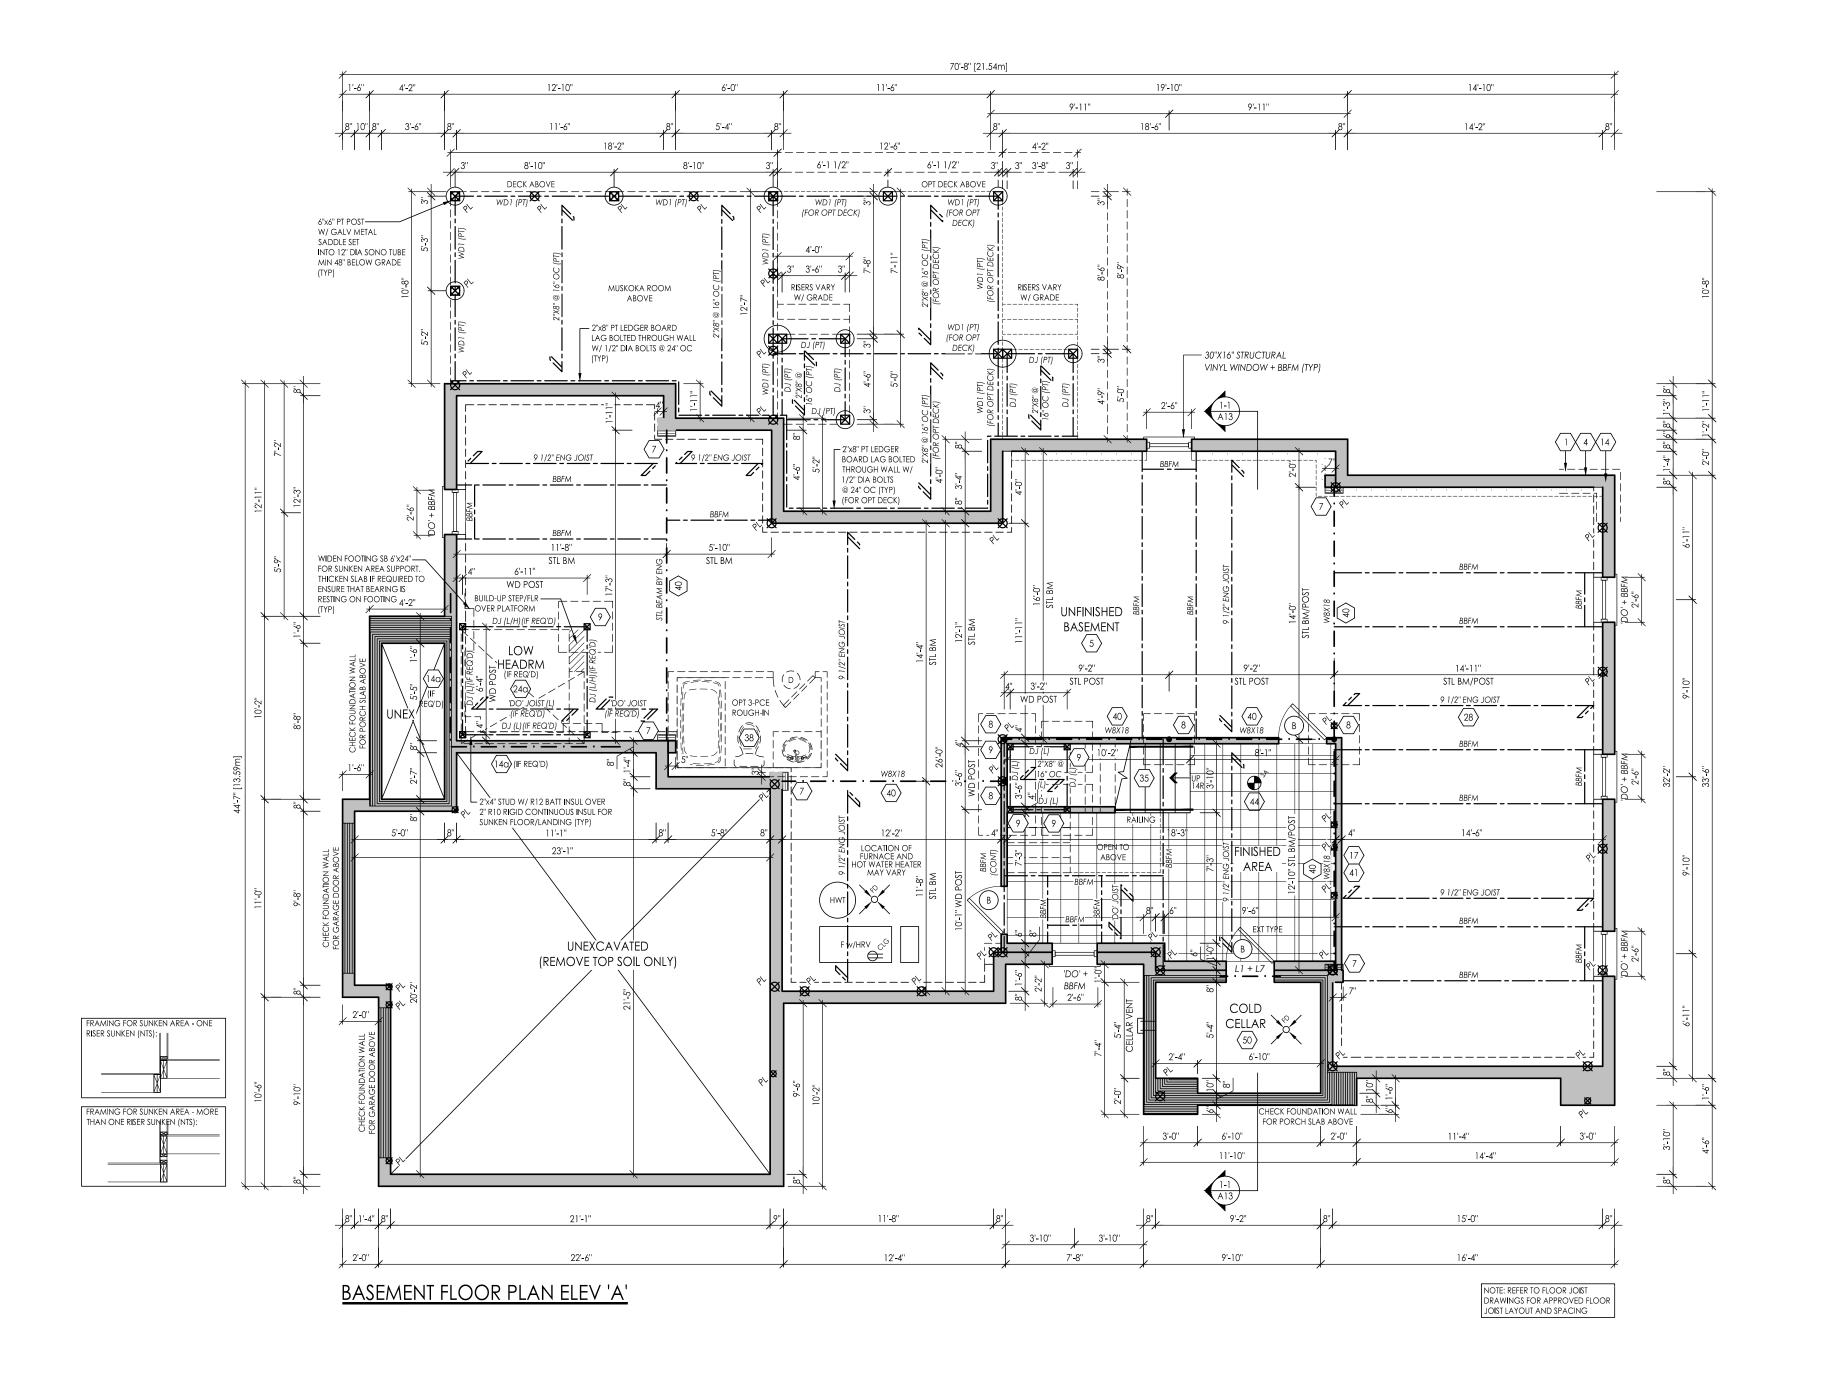



I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO NO BEHALF OF RN DESIGN LTD, UNDER DAY OF THE BUILDING REGISTER CONSTRUCTION IES.

PRELIMINARY - NOT LESS.


September 24, 2021

SIGNATURE:

#	revisions	date	dwn	chk
1 ISSUED	FOR CLIENT REVIEW	24-SEP-21	CR	SH
2 REVISE	D PER CLIENT COMMENTS	15-Nov-21	WU	AL
'				

Signature Communities


	Commoning	
project	Northern Lights Huntsville	
model	60-02 Violet	
project #	21020	
scale	3/16" = 1'-0"	
page		

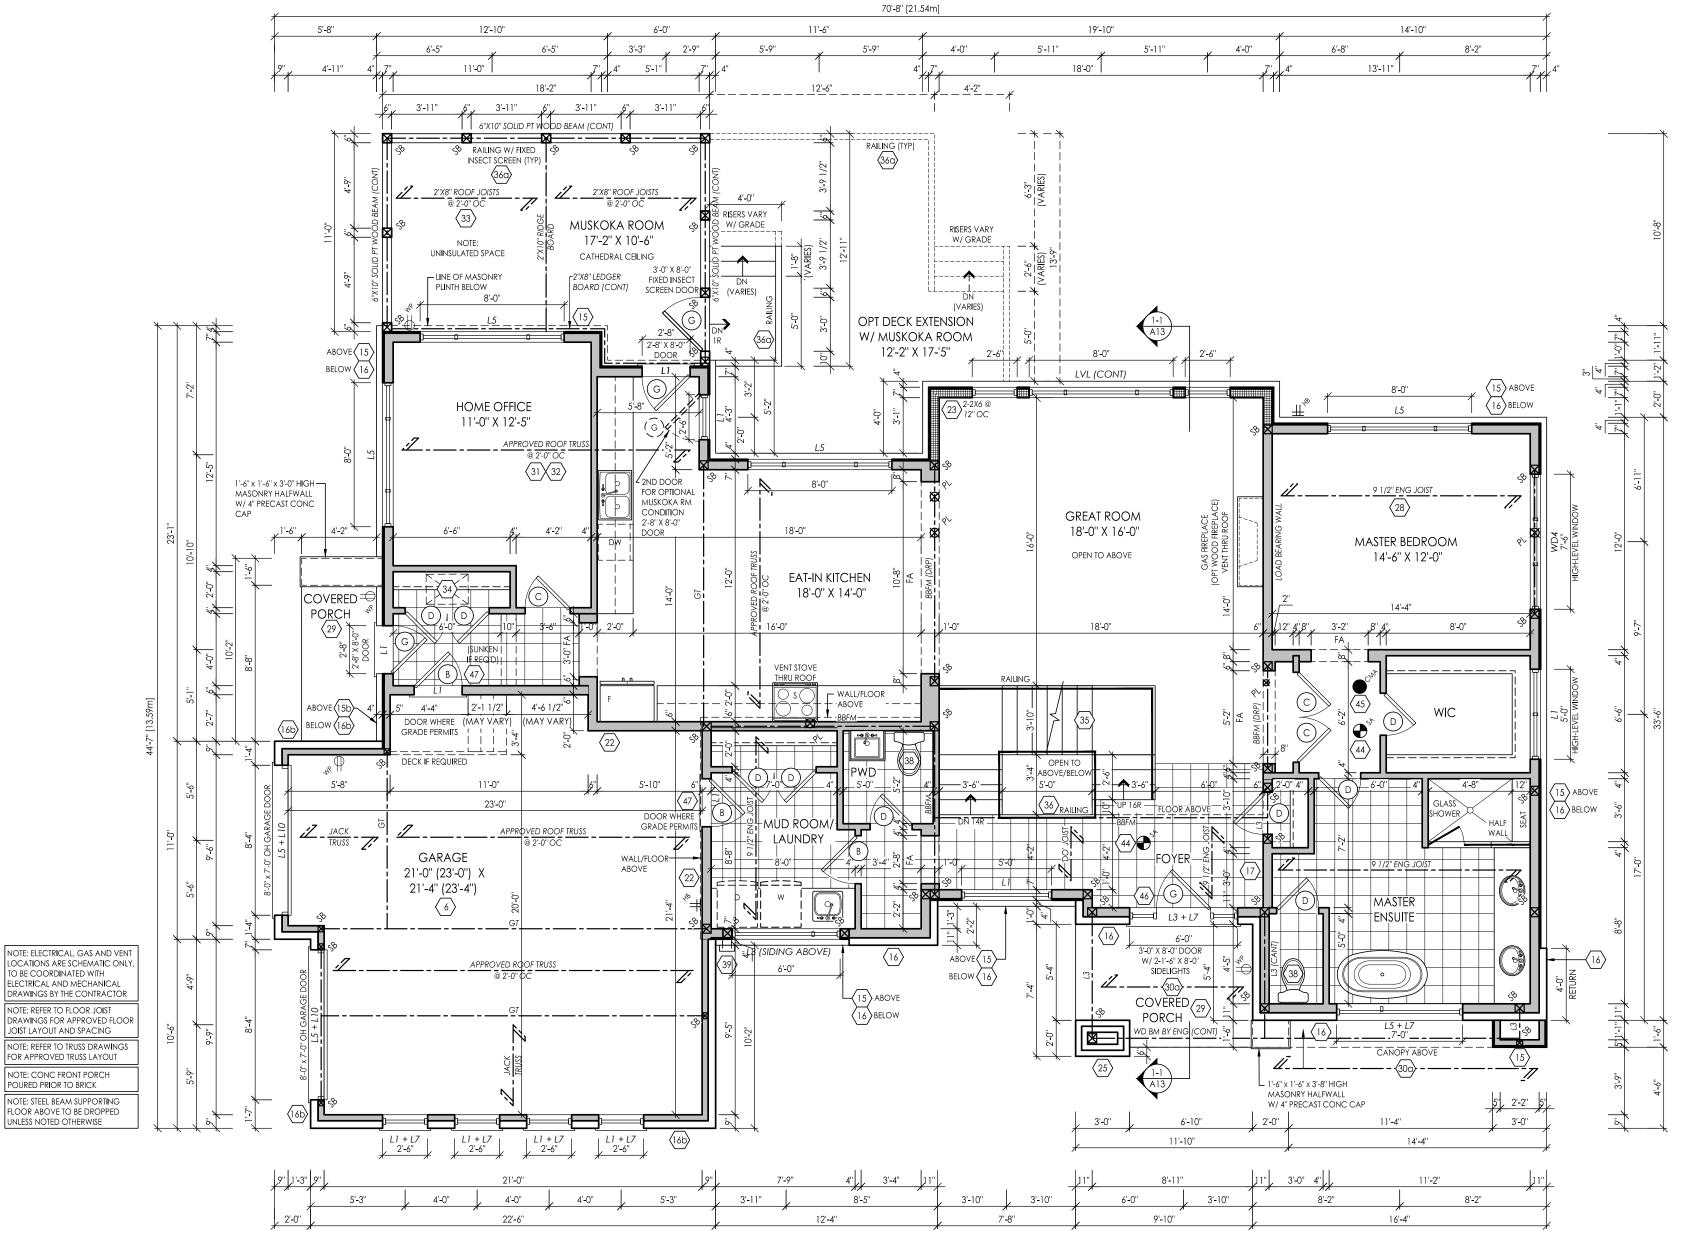

GROUND FLOOR PLAN ELEV 'A'




WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA



#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities

project	Northern Lights
	Huntsville
model	
	60-02
	Violet
project #	21020
scale	3/16" = 1'-0"
page	

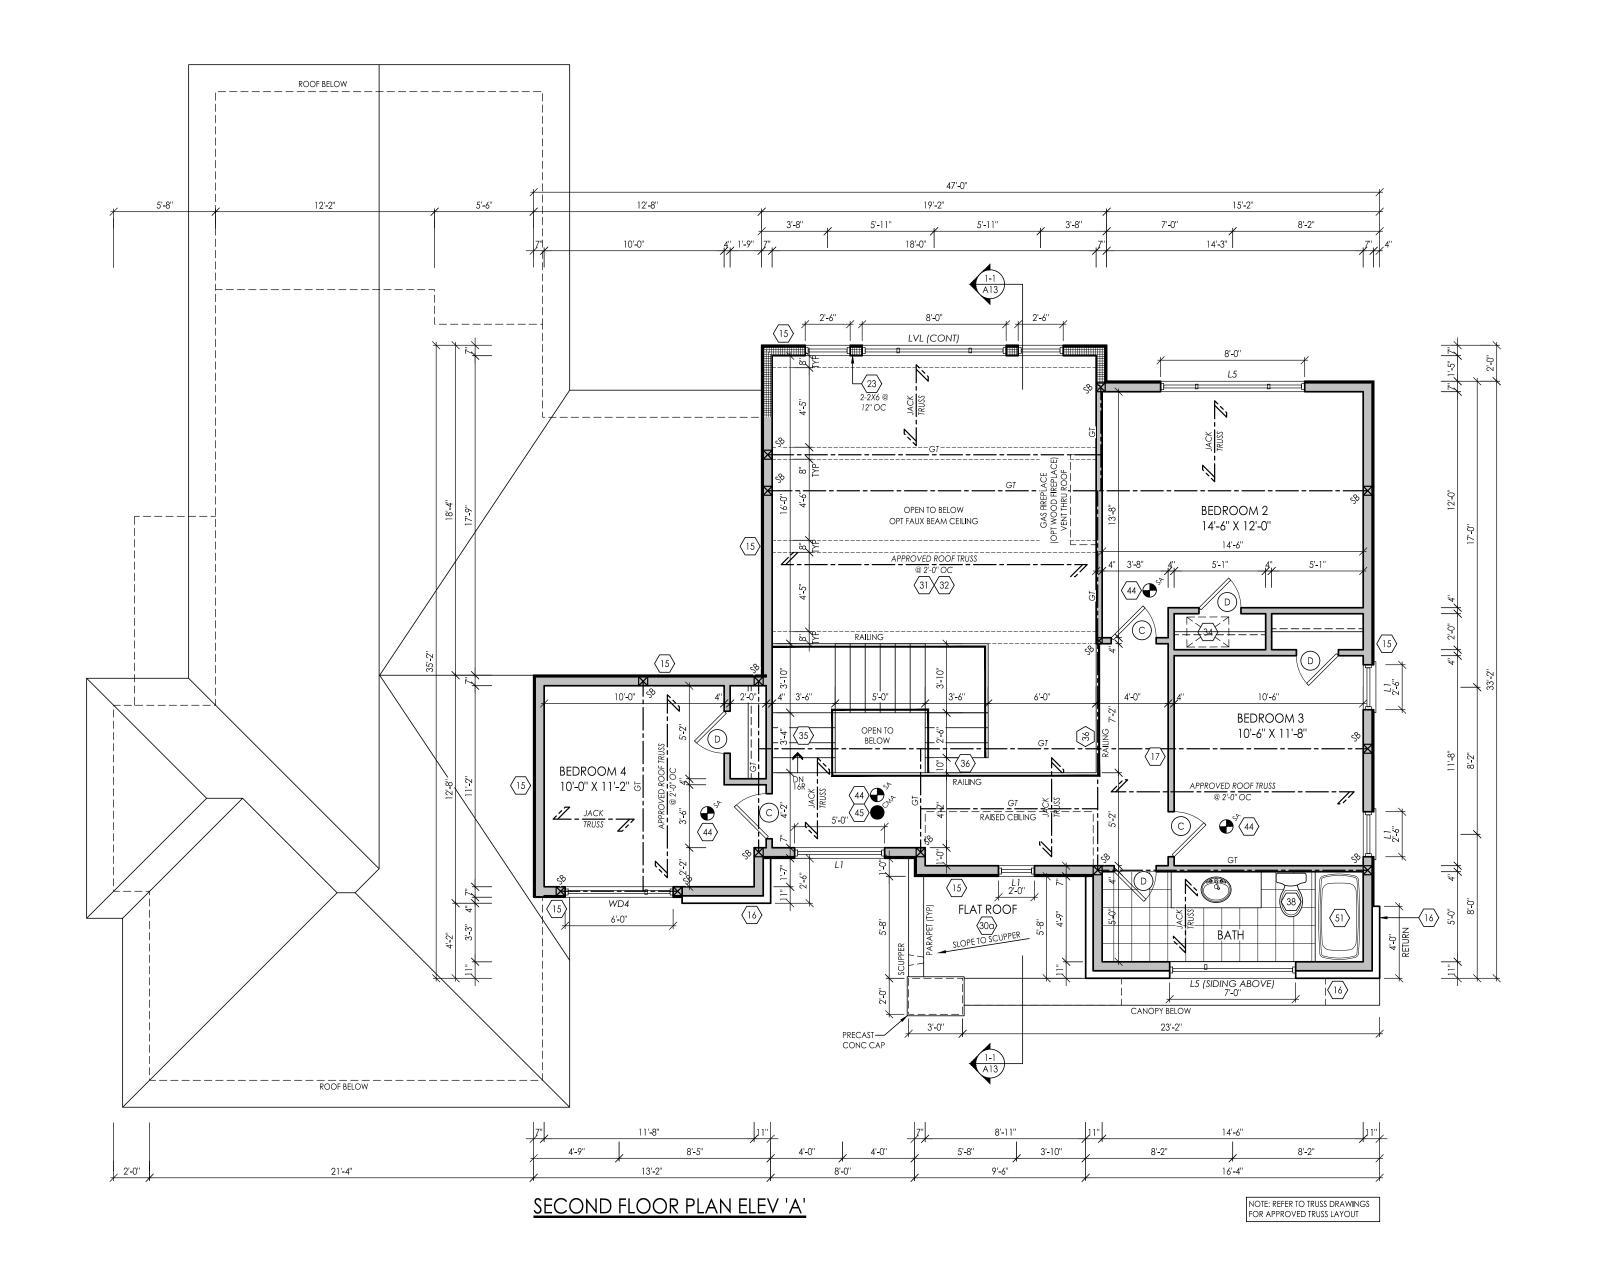




I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO NO BEHALF OF RN DESIGN LTD, UNDER DESIGN TO, UNDER DESIGN TO

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL
			•	

Signature Communities

project	Northern Lights Huntsville	
model	60-02 Violet	
project #	21020	
scale	3/16" = 1'-0"	
page		

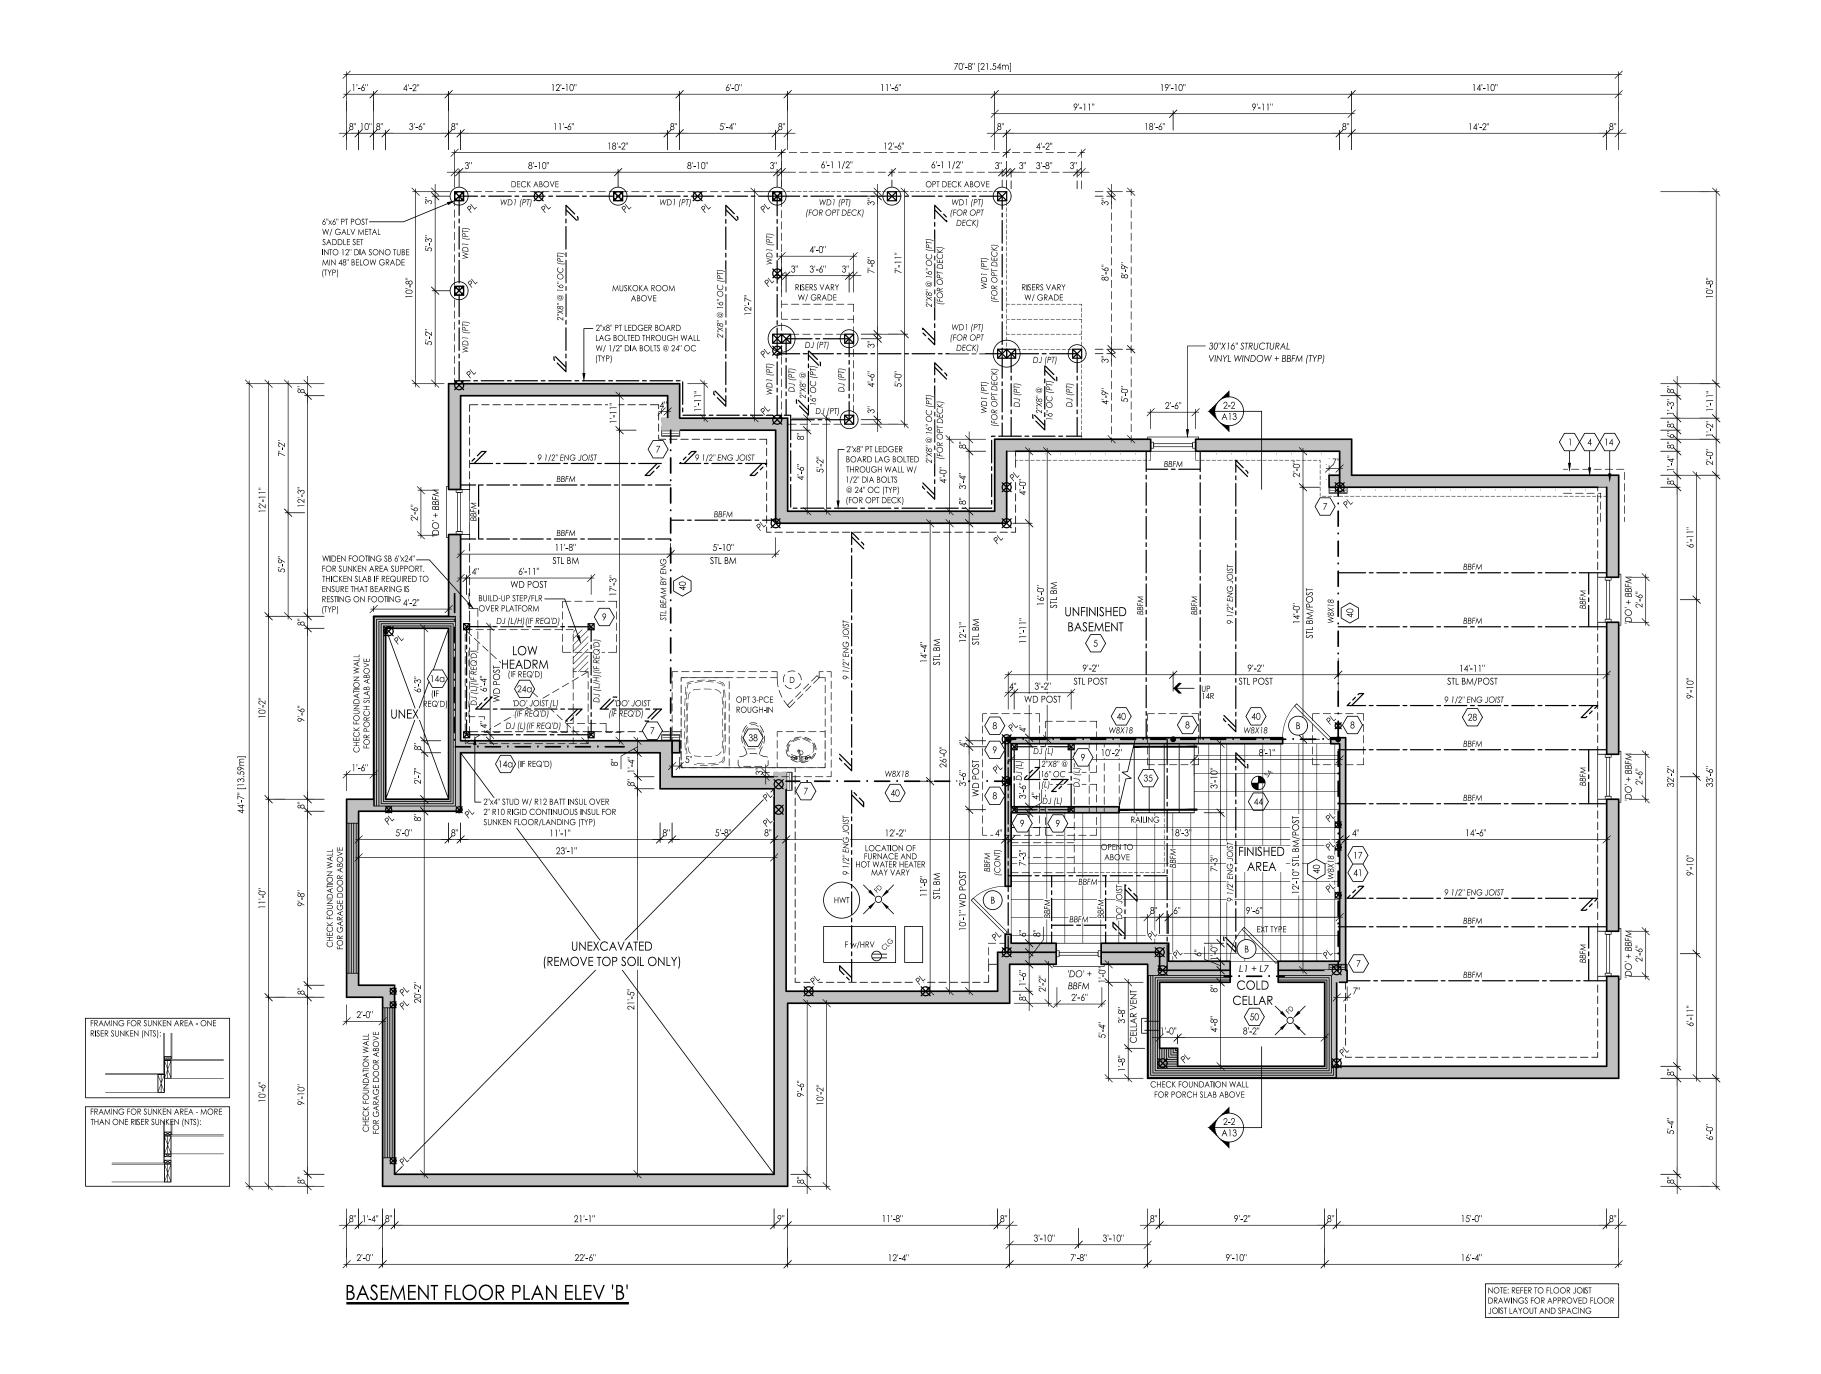



I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN ON BEHALF OF RN DESIGN LTD, UNDER DESIGN TO THE BUILDING REGISTER CONSTRUCTION IES.


PRELIMINARY - NOT THE FIRM IS REGISTER CONSTRUCTION IES.

September 24, 2021

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities


	project	Northern Lights	
21 By:WadeU		Huntsvi ll e	
Nov 15, 20	model	60-02	
offed:			
DER.dwg Plc		Violet	
AcPublish_10616\21020-60-02-TENDER.dwg Plotted: Nov 15, 2021 By:WadeU	project #	21020	
ublish_10616\2	scale	3/16" = 1'-0"	
AcPu	page		

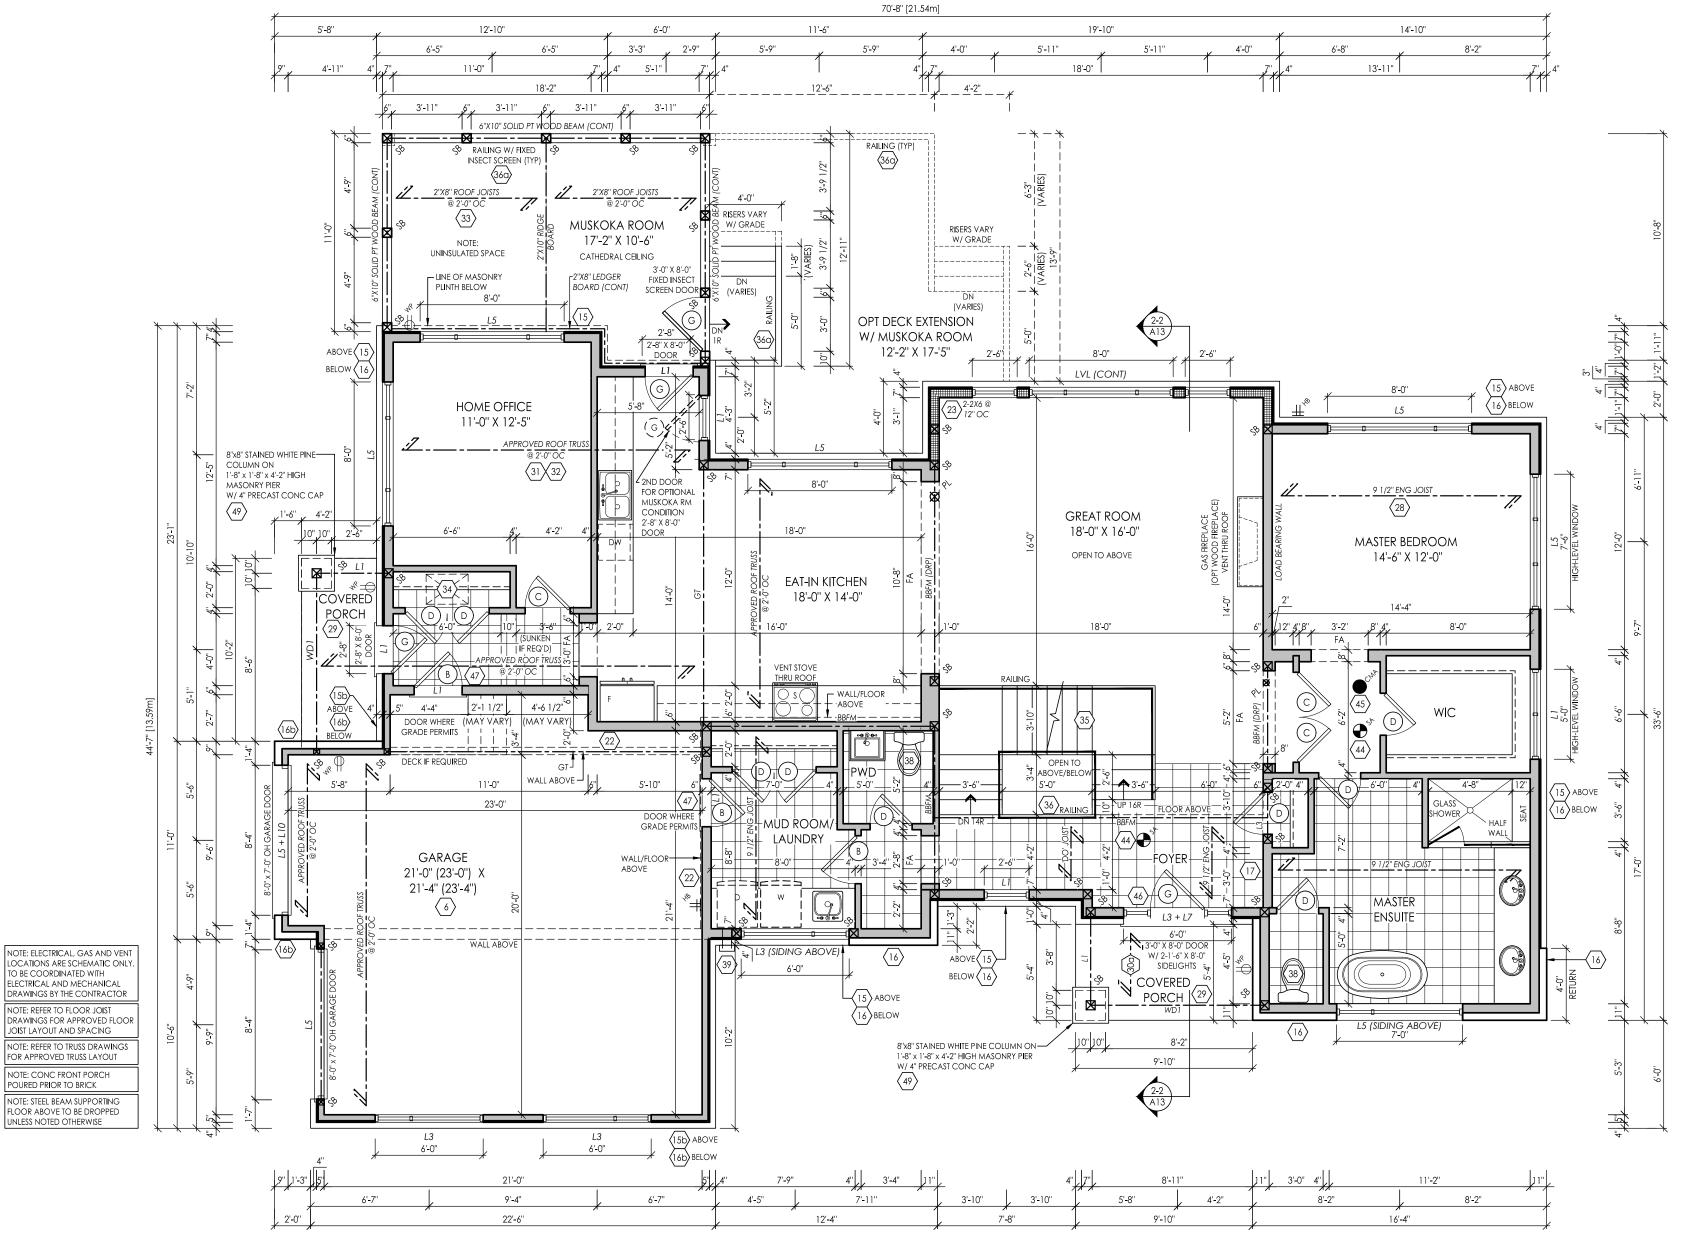

GROUND FLOOR PLAN ELEV 'B'




WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA



#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL
ient	_			

Signature Communities

	Huntsville
model	60-02
	Violet
project #	21020
scale	3/16" = 1'-0"

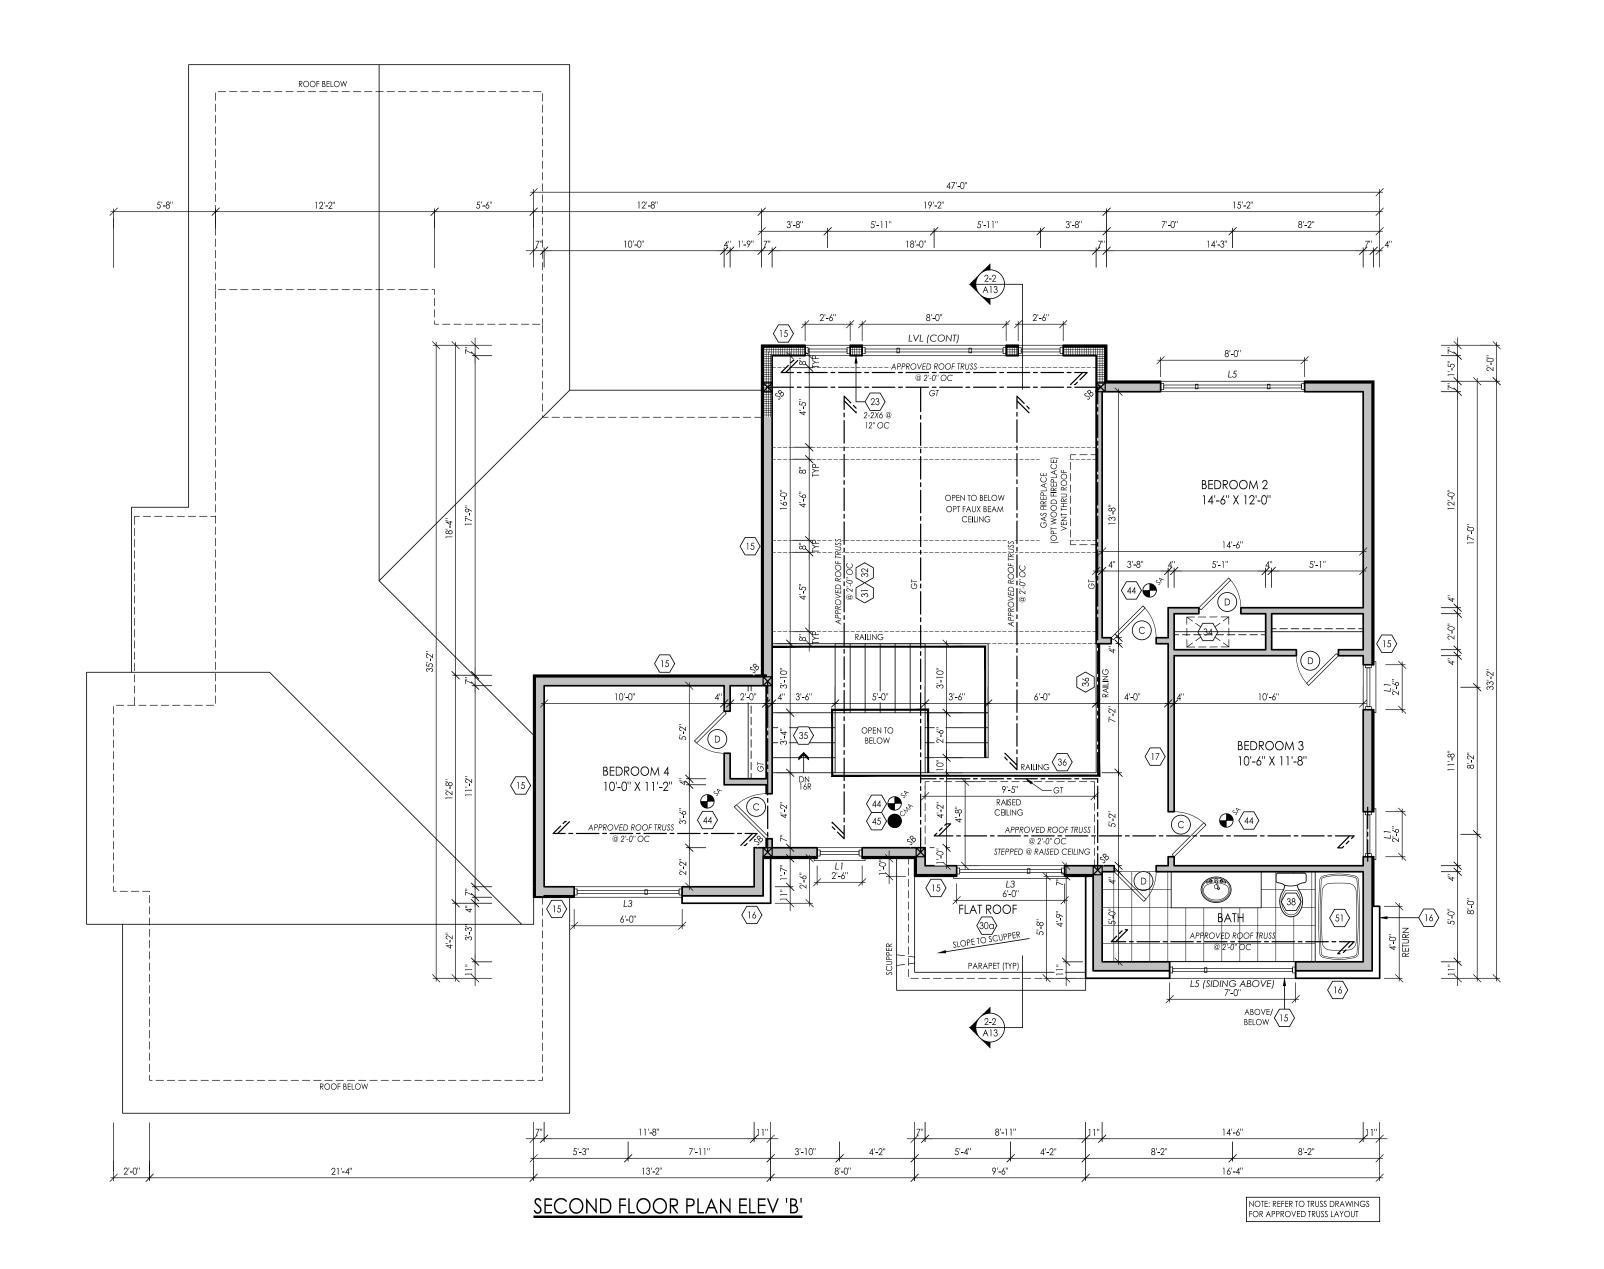



I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN ON BEHALF OF RN DESIGN LTD, UNDER DUTON OF THE BUILDING REGISTER PRELIMINARY NESSERVENT ON IES.


PRELIMINARY September 24, 2021

SIGNATURE:

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL
cliont				

Signature Communities

ndeU	project	Northern Lights	
AcPublish_10616\21020-60-02-TENDER.ciwg Plottect: Nov 15, 2021 By:WadeU	model	Huntsville 	
vg Plotted: No		60-02 Violet	
NDER.d		VIOIGI	
21020-60-02-TEI	project #	21020	
ublish_10616\2	scale	3/16" = 1'-0"	
AcPt	page		

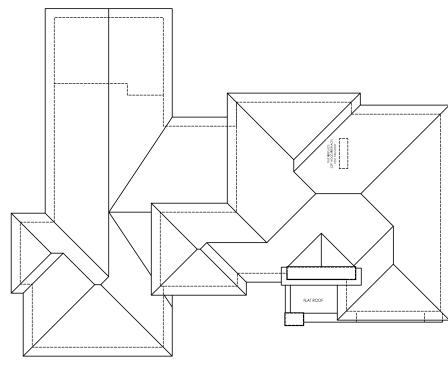

ROOF PLAN ELEV 'A'



FRONT ELEVATION 'A'
TRANSITIONAL CONTEMPORARY



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO N BEHALF OF RN DESIGN LTD, UNDER DIV. ARY -NOT STION-3, 2, 4 OF THE BUILDING REGISTE PRELIMINARY -NOT SEPTEMBER.

PRELIMINARY -NOT SEPTEMBER.

SEPTEMBER 24, 2021

SIGNATURE:

HARDIE PLANK LAP SIDING

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities

21 By:WadeU	project	Northern Lights Huntsville	
acPublish_10616\21020-60-02-TENDER.dwg Plotted: Nov 15, 2021 By:WadeU	model	⁶⁰⁻⁰² Violet	
1020-60-02-TEN	project #	21020	
ublish_10616\2	scale	3/16" = 1'-0"	
AcP	page		



REAR ELEVATION 'A'

TRANSITIONAL CONTEMPORARY



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO NO BEHALF OF RN DESIGN LTD, UNDER DIVORT THE BUILDING REGISTE PRELIMINARY NES.


FOR CONSTRUCTION IES.

September 24, 2021

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities

opon who is	project	Northern Lights Huntsville	
cPublish_10616\21020-60-02-TENDER.awg Plotted: Nov 15, 2021 By:WadeU	model	60-02 Violet	
1020-60-02-1EN	project #	21020	
vblish_10616\2	scale	3/16" = 1'-0"	
S.	nage		

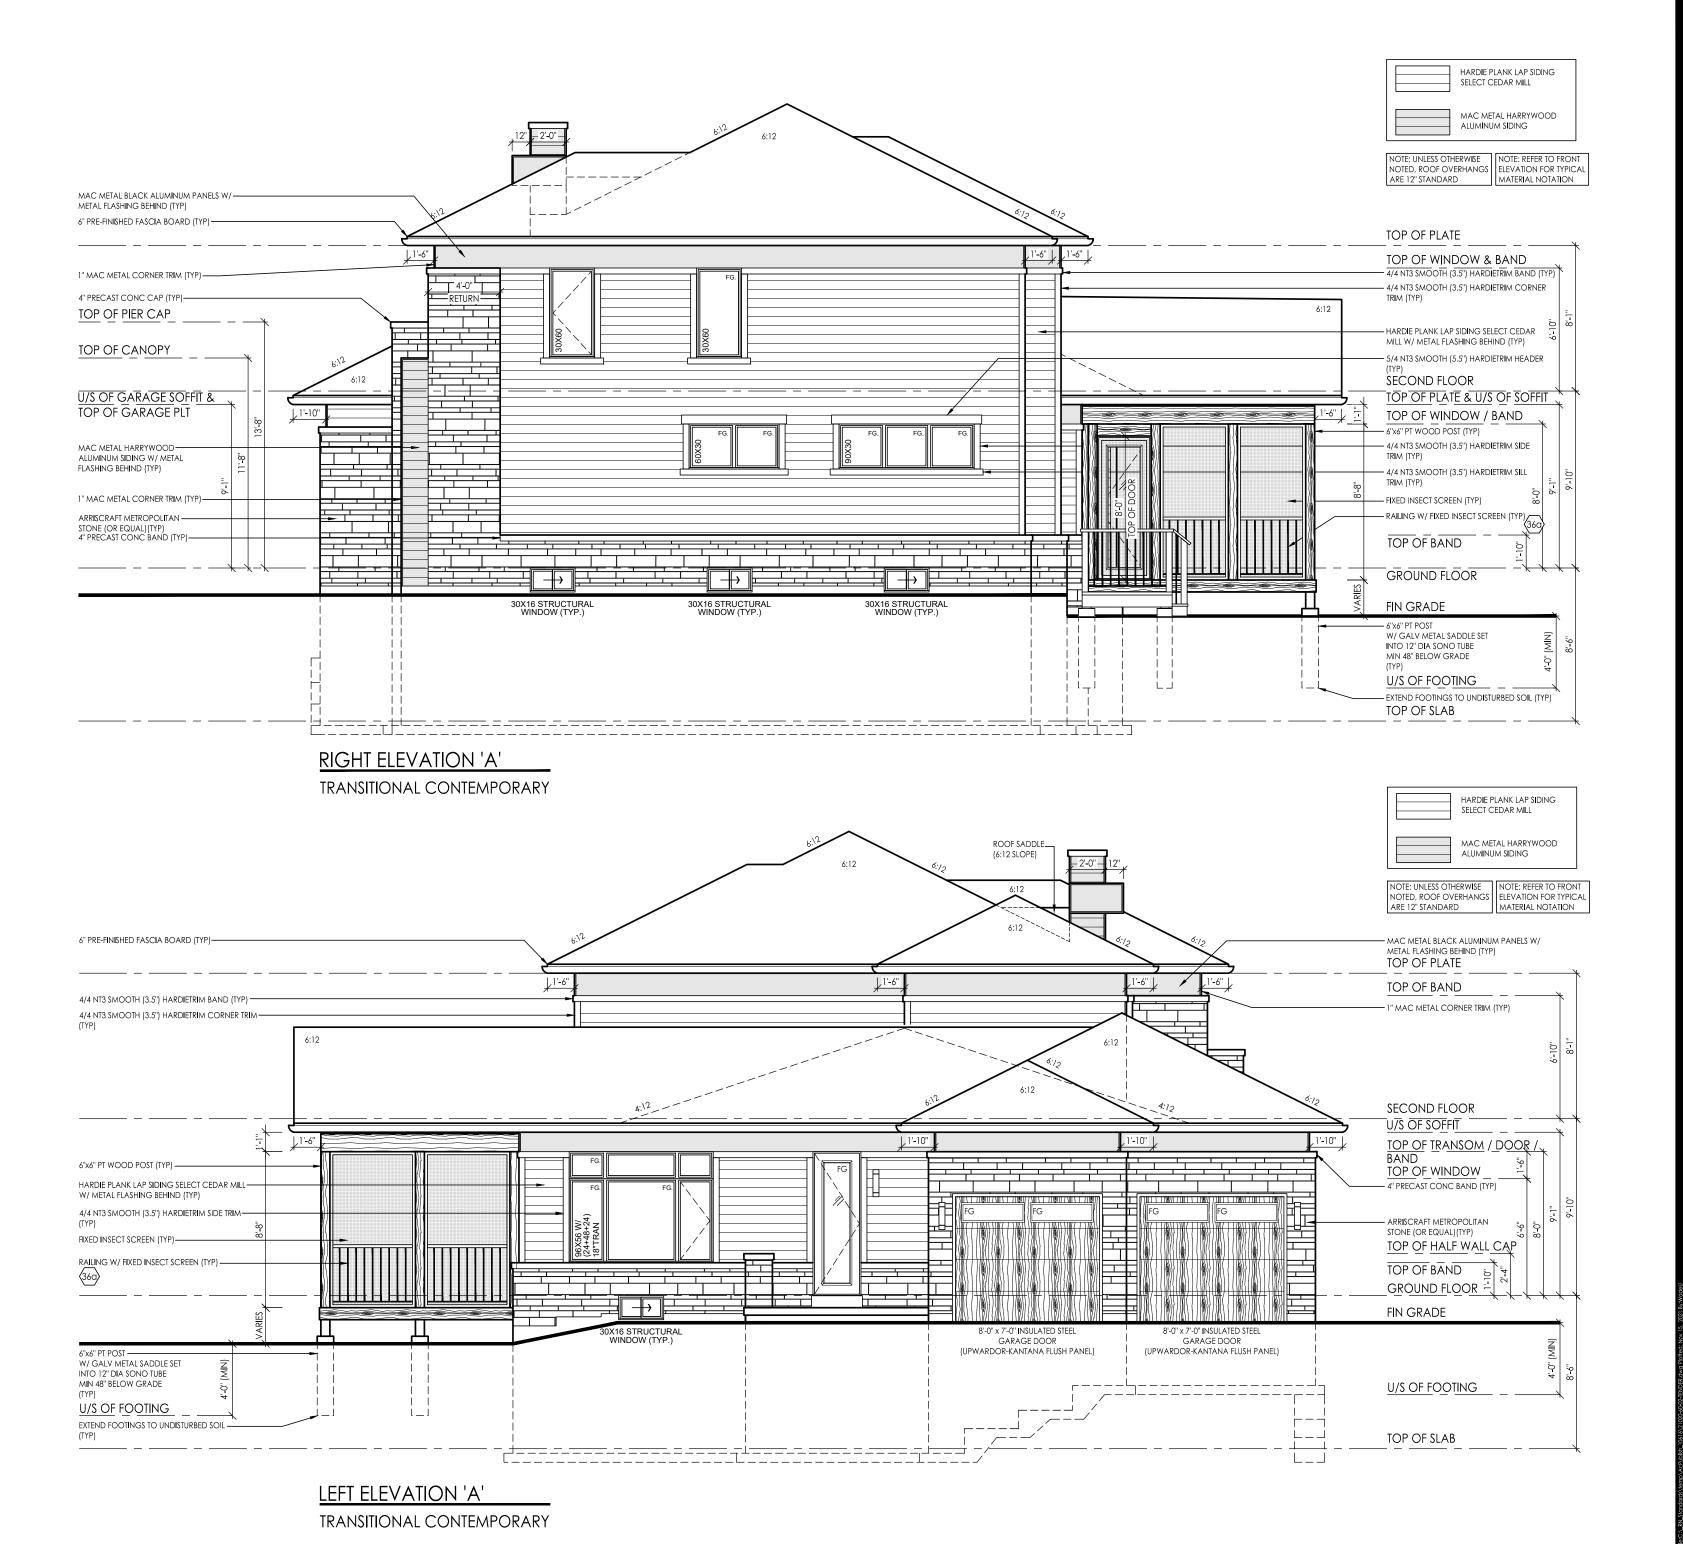



DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO BE HALF OF RN DESIGN LTD, UNDER DIVERSITY FOR THE BUILDING FOR

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL
client	Signatu	re		

Communities

Northern Lights

Huntsville

model

60-02

Viole†

project # 21020

scale 3/16" = 1'-0"





FRONT ELEVATION 'B'
SHED CONTEMPORARY



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESCRIPTION BEHALF OF RN DESIGN LTD, UNDER DIV. ARCHITECTURE OF THE BUILDING REGISTE PRELIMINARY - NOT LESS.

PRELIMINARY - NOT LESS.

PRELIMINARY - NOT LESS.

September 24, 2021

SIGNATURE:

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities

Northern Lights

Huntsville


model

60-02

Viole†

project # 21020

scale 3/16" = 1'-0"

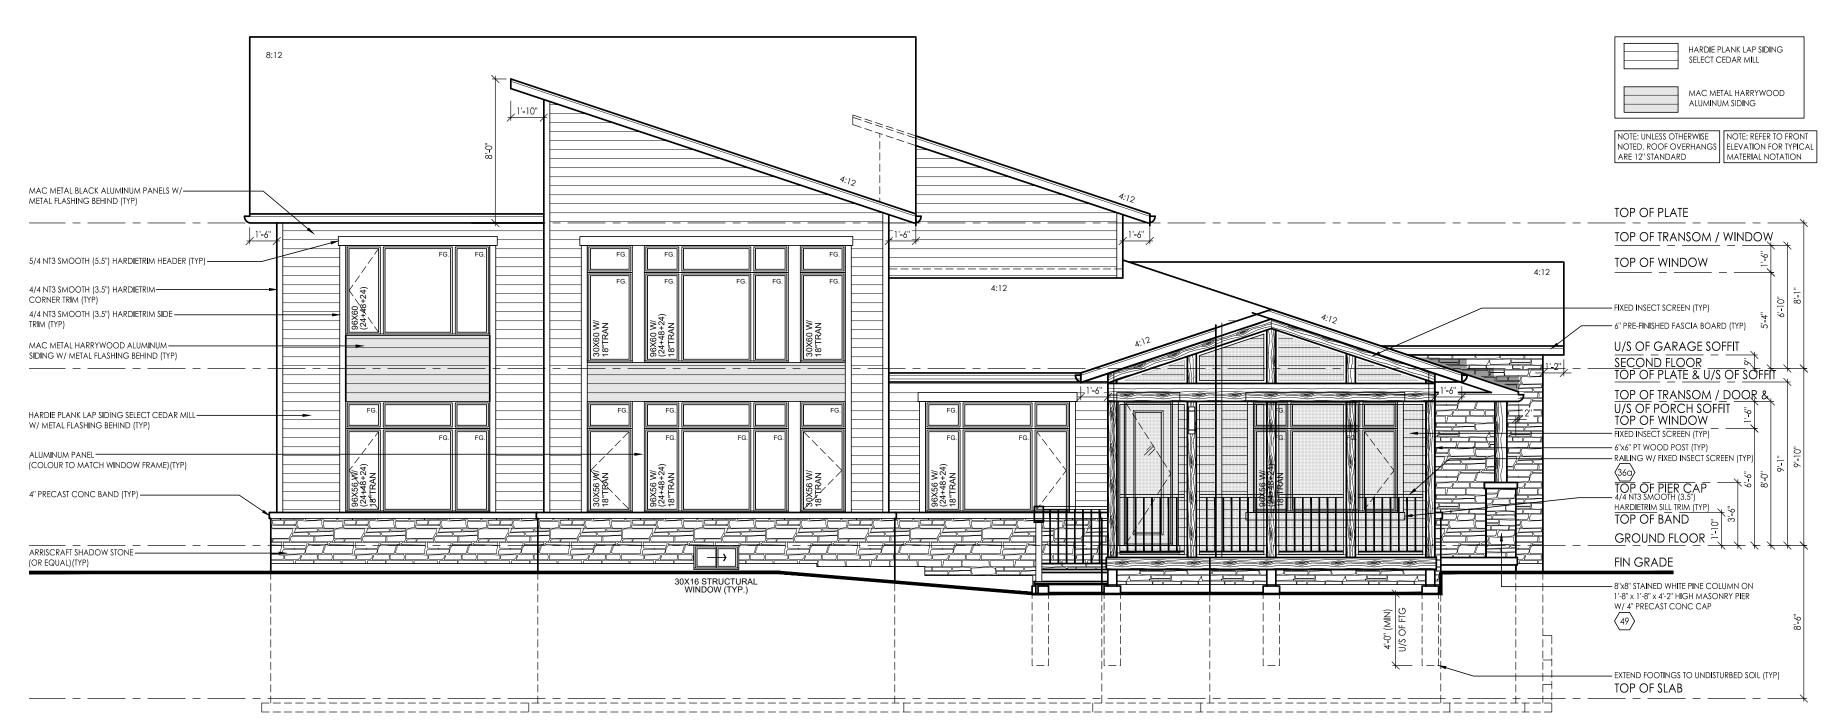

REAR ELEVATION 'B'
SHED CONTEMPORARY



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN OF RN DESIGN LTD, UNDER DIVIDIONAL OF THE BUILDING REGISTE PRELIMINARY - NOT RESERVED RESERVED


#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL
client				

Signature Communities

project	Northern Lights Huntsville	
model	60-02	
	Violet	
project #	21020	
scale	3/16" = 1'-0"	
2222		







#	revisions	date	dwn	chk		
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH		
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL		
- 12 1						
client	Signature Communities					


model


Morthern Lights
Huntsville

60-02
Violet

project # 21020

scale 3/16" = 1'-0"

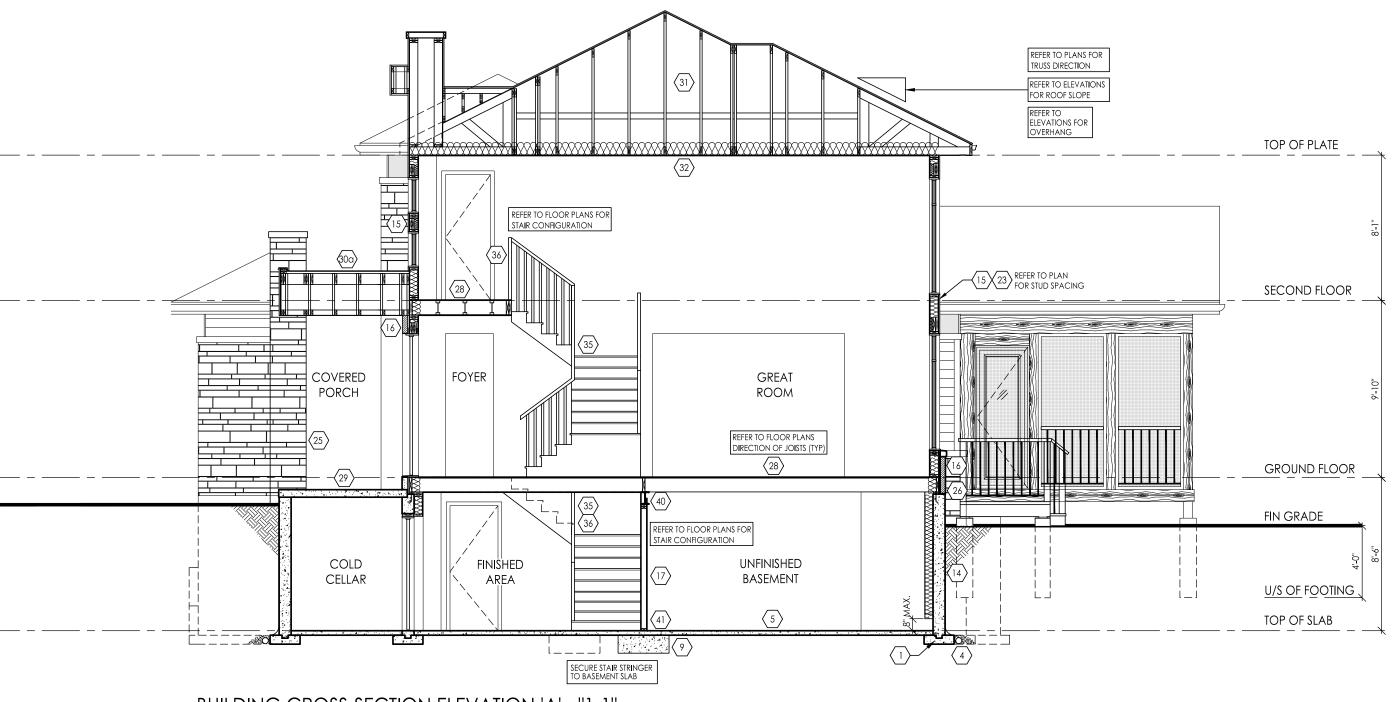

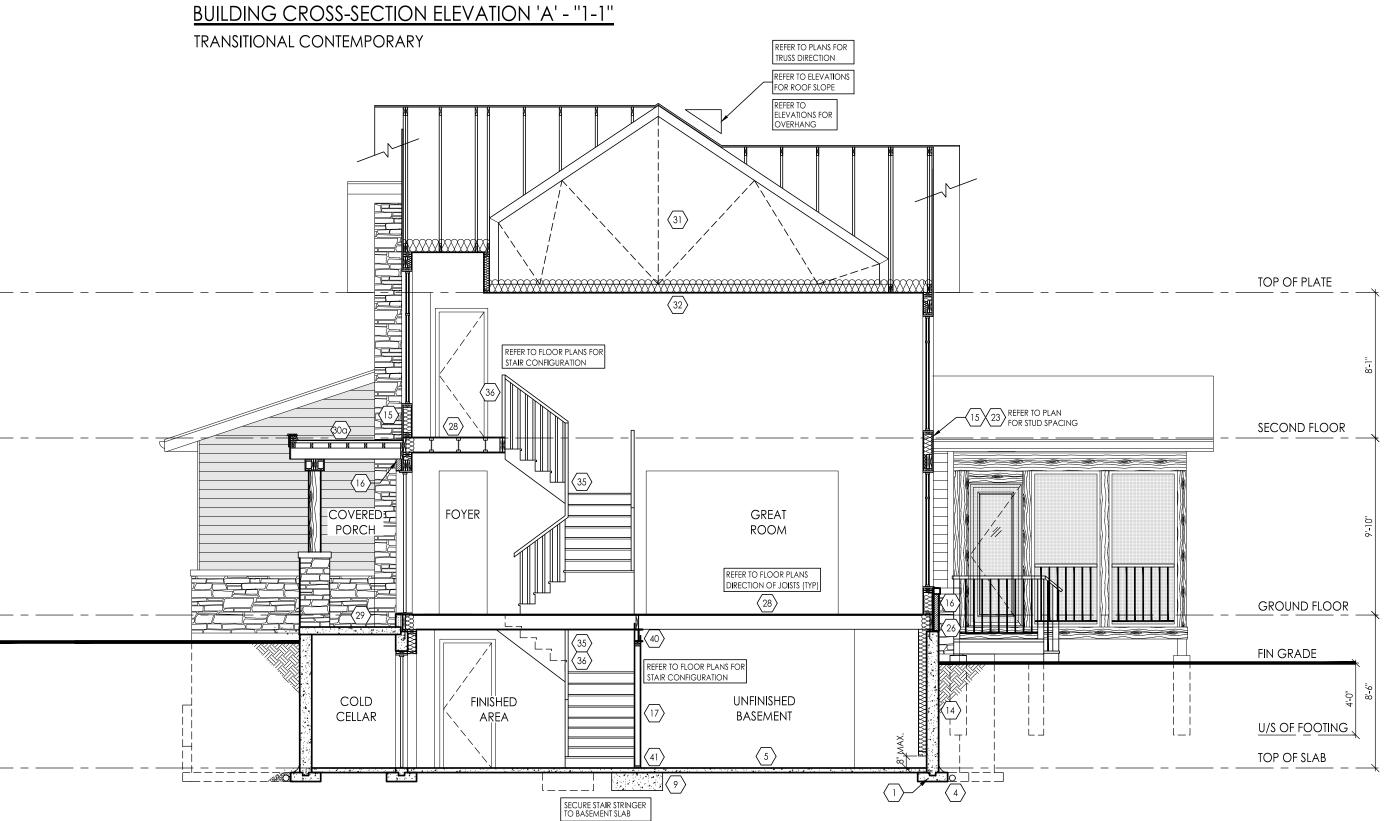

BUILDING CROSS-SECTION ELEVATION 'B' - "2-2" SHED CONTEMPORARY

DESIGN

WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN OF RN BEHALF OF RN DESIGN ITD, UNDER DUTY OF THE BUILDING REGISTE PRELIMINARY - NOT SEPTEMBER CONSTRUCTION (IES.)

SEPTEMBER CONSTRUCTION (IES.)

SEPTEMBER 24, 2021

#	revisions	date	dwn	chk
#	Tevisions	uule	uwn	CH
1	ISSUED FOR CLIENT REVIEW	24-SEP-21	CR	SH
2	REVISED PER CLIENT COMMENTS	15-Nov-21	WU	AL

Signature Communities

Northern Lights

Huntsville

model

60-02

Viole†

project # 21020

scale 3/16" = 1'-0"