
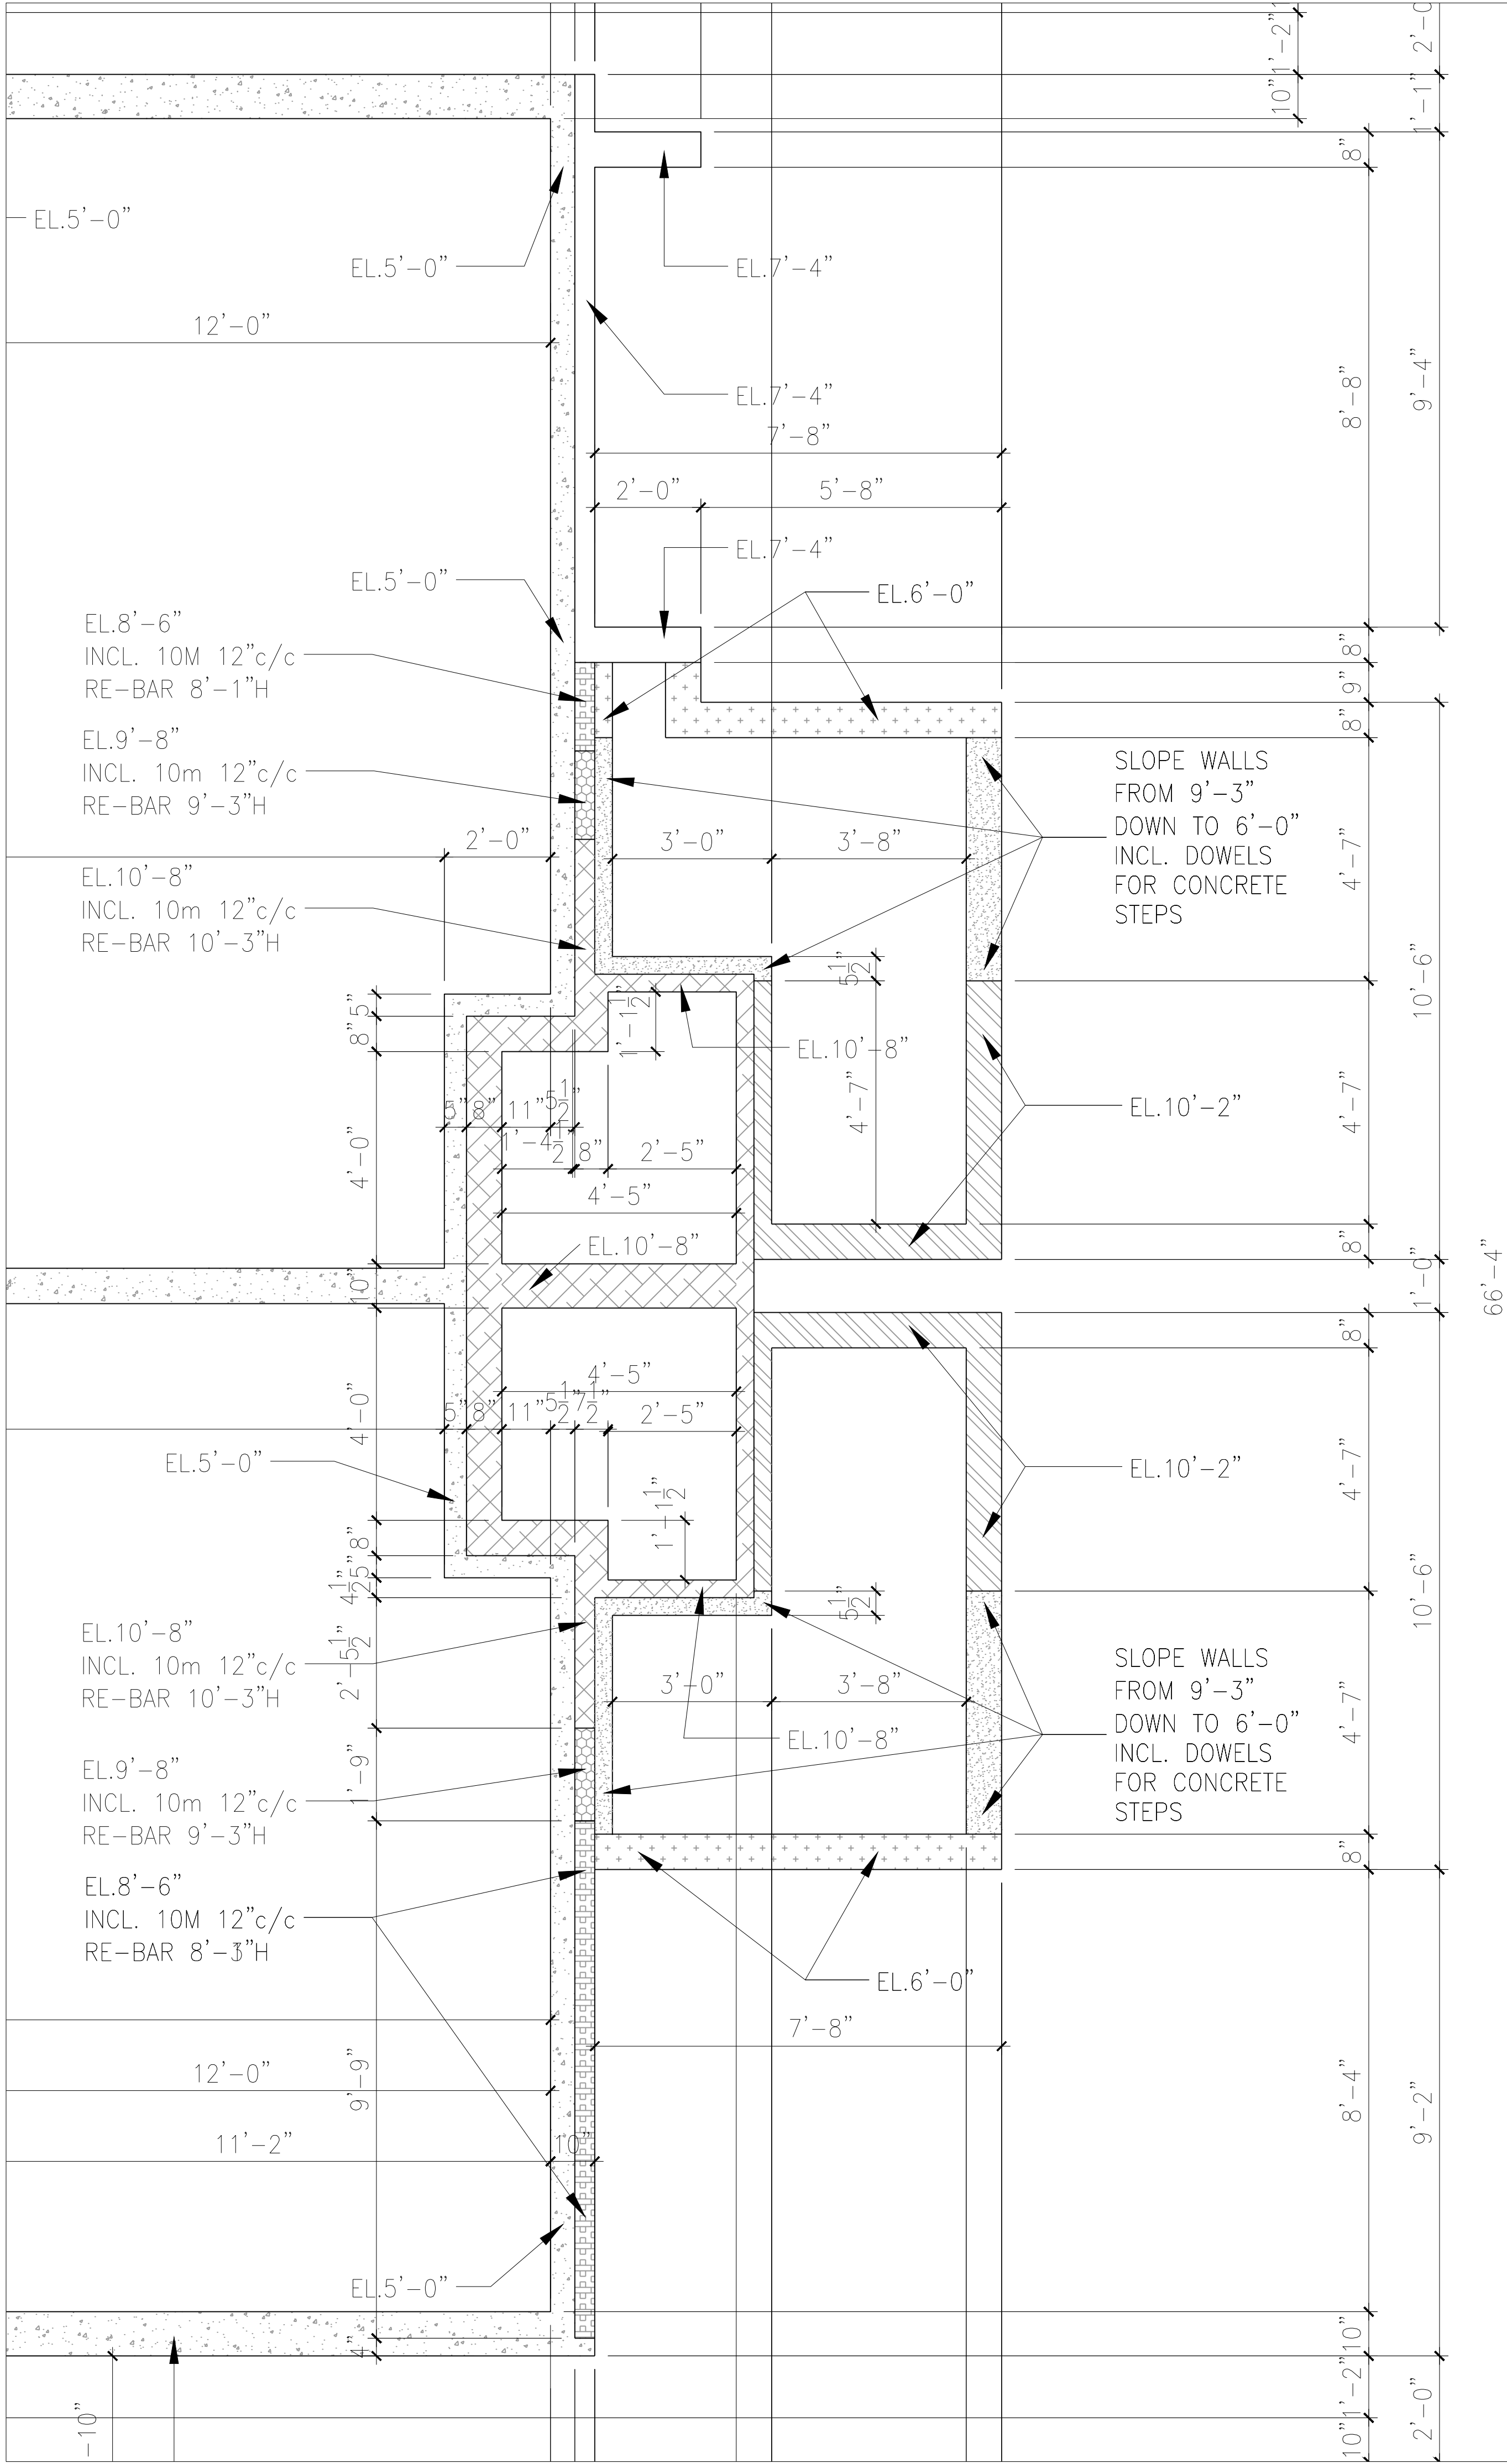


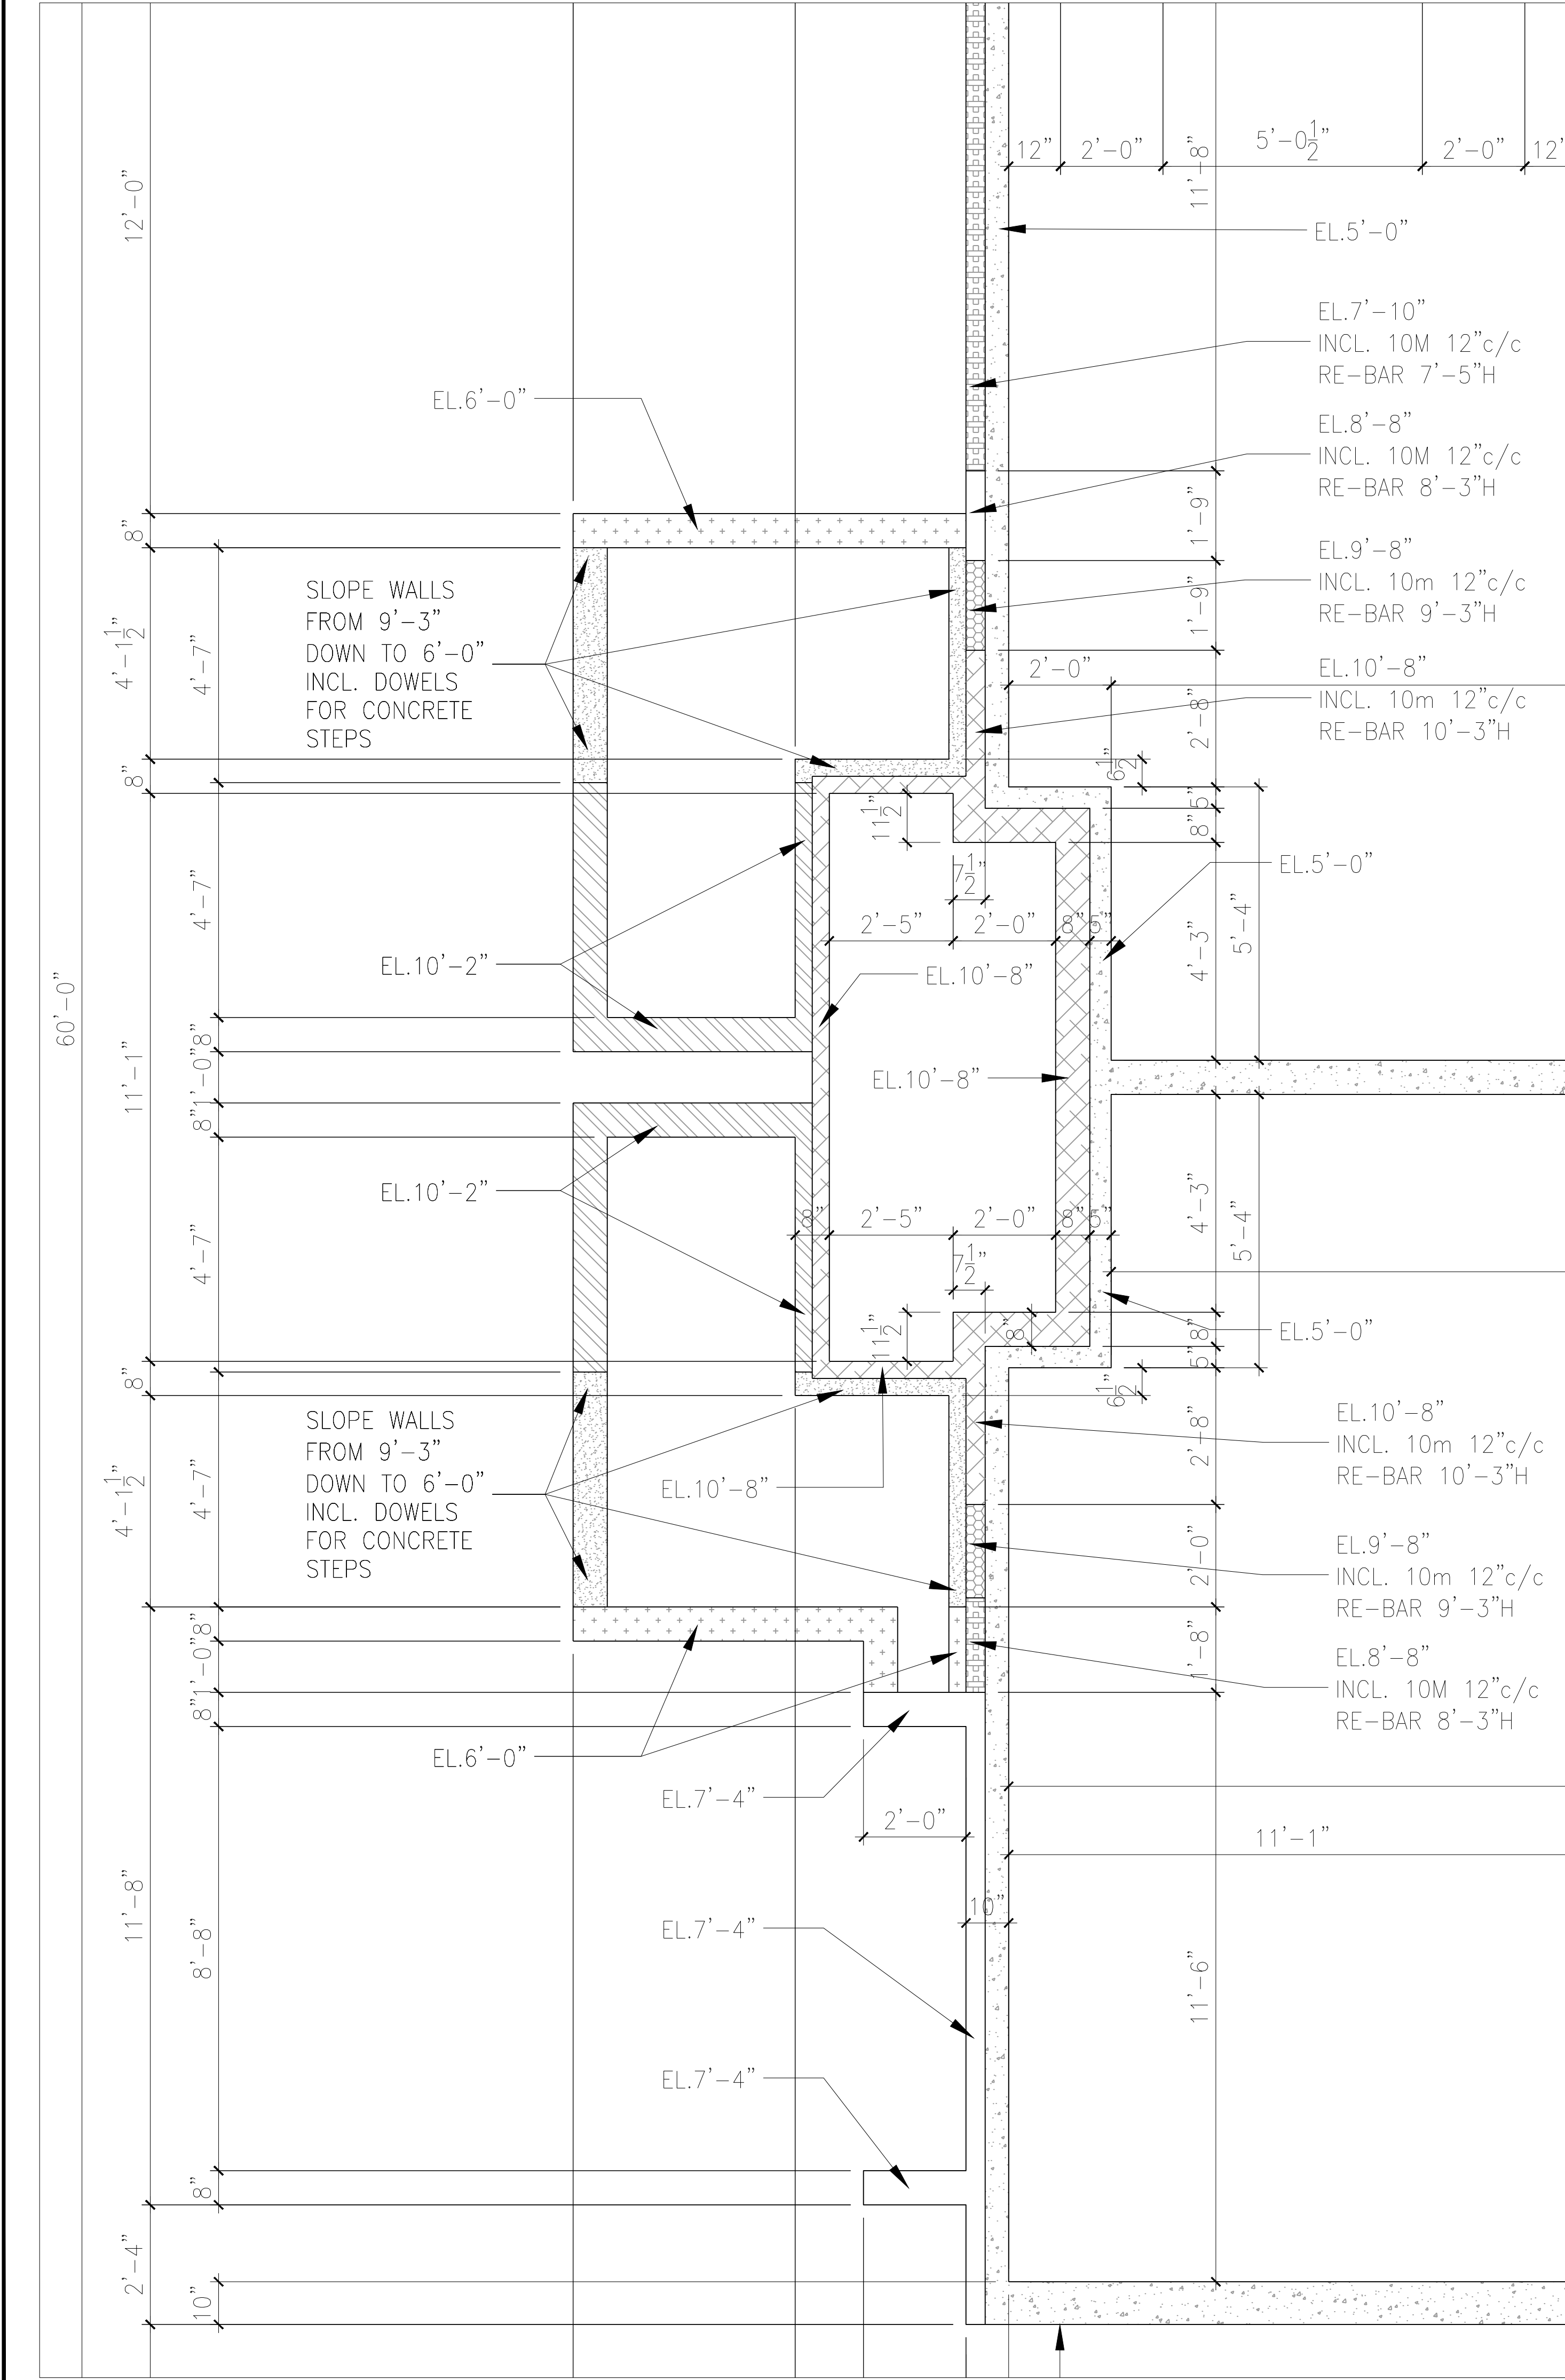

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH

Valecraft
ENGINEERS LTD.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-A AND ANY AMENDMENTS AND SHALL SHOW ONLY SOME OF THE DETAILS DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL DETAILS, REFER TO A SCHEDULE OR ANY OTHER ITEM AUTOMATICALLY. THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSIONS SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL UNITS:
S1 = 1 800x46
S2 = 1 800x48
S3 = 1 100x48
S4 = 1 120x48
S5 = 1 120x60
S6 = 1 200x104
S7 = 1 150x104 (2" BEARING)

UNITS TABLE:
L1 = 2'-2 1/2" + P2 ON BOTH SIDES
L2 = 3'-2 1/2" + P3 ON BOTH SIDES
L3 = 2'-1 7/8" + L1 (S2) + P3 ON BOTH SIDES
L4 = 3'-1 7/8" + L1 (S2) + P3 ON BOTH SIDES

IF UNITS IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER.

POST TABLE:
P1 = 3" ADJUSTABLE STEEL COLUMN
P1A = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
P2 = 2" ADJUSTABLE
P3 = 2'-2 1/2" OR 3'-2 1/2"
P4 = 2'-2 1/2" OR 3'-2 1/2"
P5 = 2'-2 1/2" OR 3'-2 1/2"
P6 = 2'-2 1/2" OR 3'-2 1/2"
P7 = 2'-2 1/2" OR 3'-2 1/2"
P8 = 2'-2 1/2" OR 3'-2 1/2"
P9 = 2'-2 1/2" OR 3'-2 1/2"
P10 = 2'-2 1/2" OR 3'-2 1/2"
P11 = 2'-2 1/2" OR 3'-2 1/2"
P12 = 2'-2 1/2" OR 3'-2 1/2"
P13 = 2'-2 1/2" OR 3'-2 1/2"
P14 = 2'-2 1/2" OR 3'-2 1/2"
P15 = 2'-2 1/2" OR 3'-2 1/2"
P16 = 2'-2 1/2" OR 3'-2 1/2"
P17 = 2'-2 1/2" OR 3'-2 1/2"
P18 = 2'-2 1/2" OR 3'-2 1/2"
P19 = 2'-2 1/2" OR 3'-2 1/2"
P20 = 2'-2 1/2" OR 3'-2 1/2"
P21 = 2'-2 1/2" OR 3'-2 1/2"
P22 = 2'-2 1/2" OR 3'-2 1/2"
P23 = 2'-2 1/2" OR 3'-2 1/2"
P24 = 2'-2 1/2" OR 3'-2 1/2"
P25 = 2'-2 1/2" OR 3'-2 1/2"
P26 = 2'-2 1/2" OR 3'-2 1/2"
P27 = 2'-2 1/2" OR 3'-2 1/2"
P28 = 2'-2 1/2" OR 3'-2 1/2"
P29 = 2'-2 1/2" OR 3'-2 1/2"
P30 = 2'-2 1/2" OR 3'-2 1/2"
P31 = 2'-2 1/2" OR 3'-2 1/2"
P32 = 2'-2 1/2" OR 3'-2 1/2"
P33 = 2'-2 1/2" OR 3'-2 1/2"
P34 = 2'-2 1/2" OR 3'-2 1/2"
P35 = 2'-2 1/2" OR 3'-2 1/2"
P36 = 2'-2 1/2" OR 3'-2 1/2"
P37 = 2'-2 1/2" OR 3'-2 1/2"
P38 = 2'-2 1/2" OR 3'-2 1/2"
P39 = 2'-2 1/2" OR 3'-2 1/2"
P40 = 2'-2 1/2" OR 3'-2 1/2"
P41 = 2'-2 1/2" OR 3'-2 1/2"
P42 = 2'-2 1/2" OR 3'-2 1/2"
P43 = 2'-2 1/2" OR 3'-2 1/2"
P44 = 2'-2 1/2" OR 3'-2 1/2"
P45 = 2'-2 1/2" OR 3'-2 1/2"
P46 = 2'-2 1/2" OR 3'-2 1/2"
P47 = 2'-2 1/2" OR 3'-2 1/2"
P48 = 2'-2 1/2" OR 3'-2 1/2"
P49 = 2'-2 1/2" OR 3'-2 1/2"
P50 = 2'-2 1/2" OR 3'-2 1/2"
P51 = 2'-2 1/2" OR 3'-2 1/2"
P52 = 2'-2 1/2" OR 3'-2 1/2"
P53 = 2'-2 1/2" OR 3'-2 1/2"
P54 = 2'-2 1/2" OR 3'-2 1/2"
P55 = 2'-2 1/2" OR 3'-2 1/2"
P56 = 2'-2 1/2" OR 3'-2 1/2"
P57 = 2'-2 1/2" OR 3'-2 1/2"
P58 = 2'-2 1/2" OR 3'-2 1/2"
P59 = 2'-2 1/2" OR 3'-2 1/2"
P60 = 2'-2 1/2" OR 3'-2 1/2"
P61 = 2'-2 1/2" OR 3'-2 1/2"
P62 = 2'-2 1/2" OR 3'-2 1/2"
P63 = 2'-2 1/2" OR 3'-2 1/2"
P64 = 2'-2 1/2" OR 3'-2 1/2"
P65 = 2'-2 1/2" OR 3'-2 1/2"
P66 = 2'-2 1/2" OR 3'-2 1/2"
P67 = 2'-2 1/2" OR 3'-2 1/2"
P68 = 2'-2 1/2" OR 3'-2 1/2"
P69 = 2'-2 1/2" OR 3'-2 1/2"
P70 = 2'-2 1/2" OR 3'-2 1/2"
P71 = 2'-2 1/2" OR 3'-2 1/2"
P72 = 2'-2 1/2" OR 3'-2 1/2"
P73 = 2'-2 1/2" OR 3'-2 1/2"
P74 = 2'-2 1/2" OR 3'-2 1/2"
P75 = 2'-2 1/2" OR 3'-2 1/2"
P76 = 2'-2 1/2" OR 3'-2 1/2"
P77 = 2'-2 1/2" OR 3'-2 1/2"
P78 = 2'-2 1/2" OR 3'-2 1/2"
P79 = 2'-2 1/2" OR 3'-2 1/2"
P80 = 2'-2 1/2" OR 3'-2 1/2"
P81 = 2'-2 1/2" OR 3'-2 1/2"
P82 = 2'-2 1/2" OR 3'-2 1/2"
P83 = 2'-2 1/2" OR 3'-2 1/2"
P84 = 2'-2 1/2" OR 3'-2 1/2"
P85 = 2'-2 1/2" OR 3'-2 1/2"
P86 = 2'-2 1/2" OR 3'-2 1/2"
P87 = 2'-2 1/2" OR 3'-2 1/2"
P88 = 2'-2 1/2" OR 3'-2 1/2"
P89 = 2'-2 1/2" OR 3'-2 1/2"
P90 = 2'-2 1/2" OR 3'-2 1/2"
P91 = 2'-2 1/2" OR 3'-2 1/2"
P92 = 2'-2 1/2" OR 3'-2 1/2"
P93 = 2'-2 1/2" OR 3'-2 1/2"
P94 = 2'-2 1/2" OR 3'-2 1/2"
P95 = 2'-2 1/2" OR 3'-2 1/2"
P96 = 2'-2 1/2" OR 3'-2 1/2"
P97 = 2'-2 1/2" OR 3'-2 1/2"
P98 = 2'-2 1/2" OR 3'-2 1/2"
P99 = 2'-2 1/2" OR 3'-2 1/2"
P100 = 2'-2 1/2" OR 3'-2 1/2"

POST ARE ALL JACK 1/4" STUD
EX. P2 = 1" JACK + 1" STUD
IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "10"

SMOKE ALARMS AS PER SECTION 9.10.18 OF THE
ONTARIO BUILDING CODE:
- SHALL HAVE A BATTERY BACKUP SUPPLY
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN
ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING
POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION,
FOULDED BY A MINUTE OF ALARM AND
- ULTIMATELY MONITORING ALARM ARE ALSO REQUIRED
ADJACENT TO EACH SLEEPING AREA.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV. #

REVISIONS TO SHEET

DATE

BY

REV. 1

ISSUED FOR TENDER

07/09/2018

MAO

REV. 2

NEW STANDARD DRAWING MODIFICATION

07/09/2018

MAO

REV. 3

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 4

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 5

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 6

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 7

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 8

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 9

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 10

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 11

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 12

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 13

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 14

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 15

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 16

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 17

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 18

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 19

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 20

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 21

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 22

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 23

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 24

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 25

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 26

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 27

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 28

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 29

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 30

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 31

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 32

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 33

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 34

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 35

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 36

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 37

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 38

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 39

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 40

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 41

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 42

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 43

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 44

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 45

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 46

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 47

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 48

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 49

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 50

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 51

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 52

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 53

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 54

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 55

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 56

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 57

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 58

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 59

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 60

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 61

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 62

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 63

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 64

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 65

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 66

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 67

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 68

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 69

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 70

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 71

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 72

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 73

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 74

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 75

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 76

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 77

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 78

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 79

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 80

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 81

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 82

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 83

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 84

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 85

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 86

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 87

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 88

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 89

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 90

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 91

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 92

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 93

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 94

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 95

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 96

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 97

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 98

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 99

NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

REV. 100


NEW STANDARD DRAWING MODIFICATION

08/25/2018

MAO

5000 SERIES -
DEERFIELD CONDOS


A101b

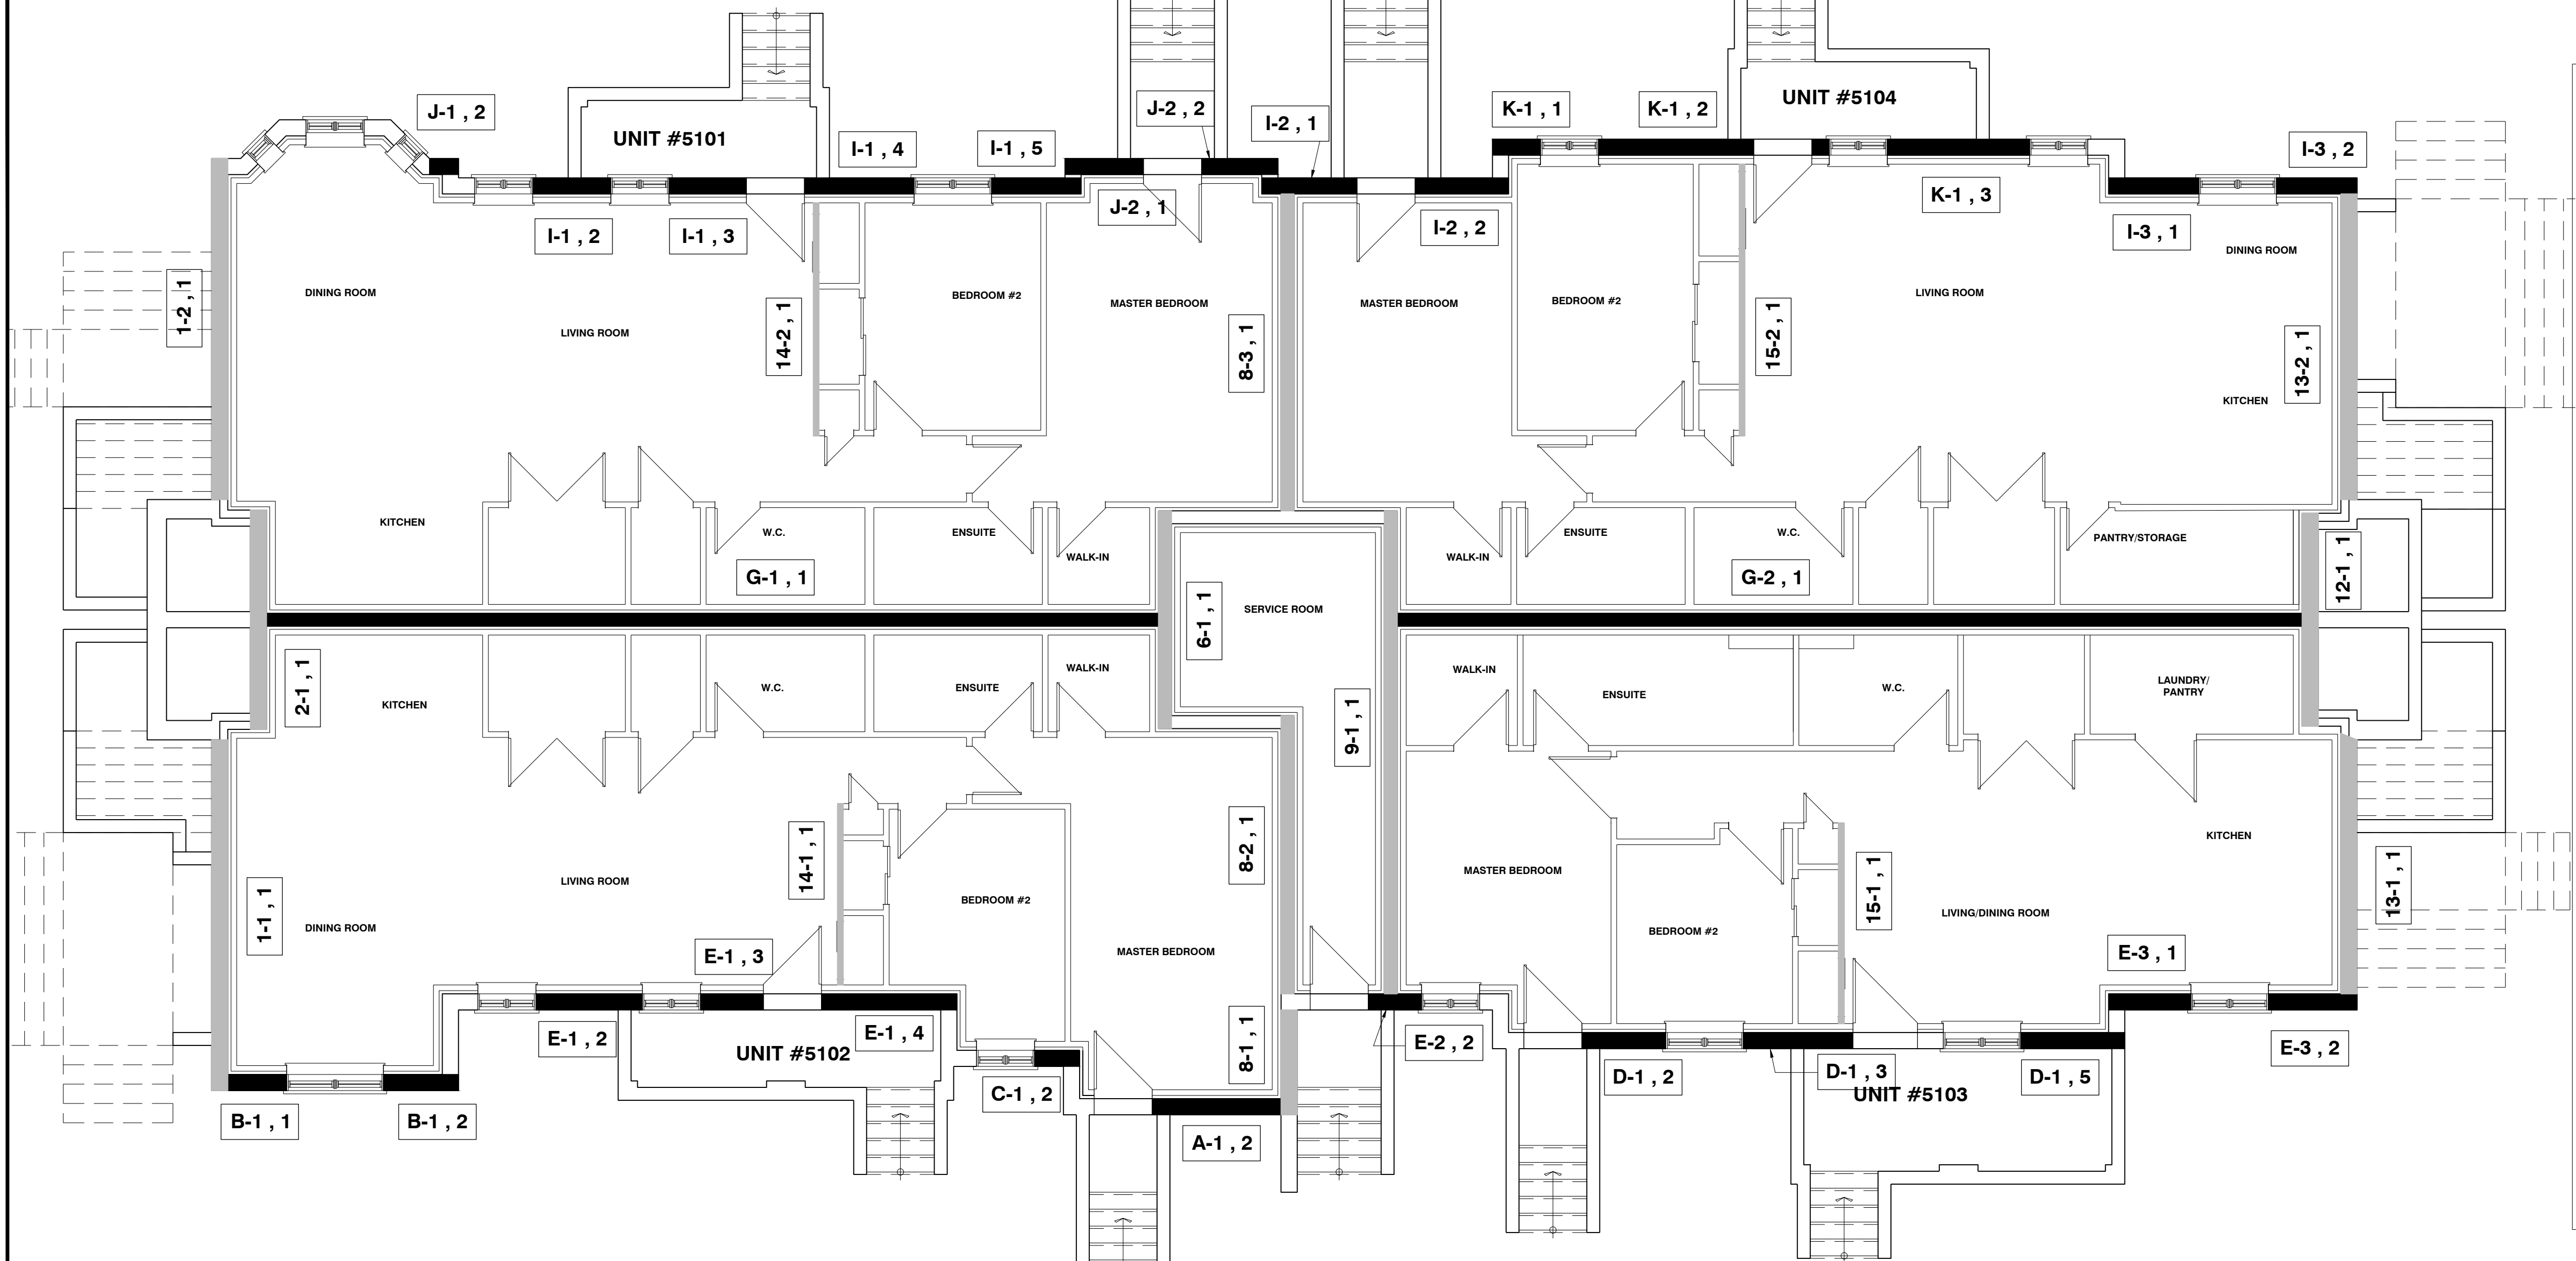


SHEAR WALL NOTES:

- 1- SHEAR WALLS ARE HIGHLIGHTED ON PLAN AND NAMES AS "A-1,2" WHERE:
"A" IS THE SHEAR LINE
"1" IS THE SHEAR WALL NUMBER
"2" IS THE SHEAR WALL SEGMENT
- 2- DO NOT USE P-NAILS OR SPIRAL NAILS IN SHEAR WALLS. NAILS SHALL BE COMMON NAILS OR POWER DRIVEN NAILS
- 3- NAILING SHOWN ON SCHEDULE APPLIES TO ALL FREE EDGES OF SHEATHING PANELS. PROVIDE NAILS AT 12" O/C ALONG INTERMEDIATE SUPPORTS.
- 4- BLOCK ALL UNSUPPORTED EDGES WITH 2X4 ON THE FLAT. SEE GENERAL NOTES, TYPICAL SHEAR WALL BLOCKING DETAIL
- 5- PROVIDE DOUBLE BOTTOM SILL PLATES FOR SHEAR WALLS SHEATHED BOTH SIDES
- 6- EXTRA STUDS AT HOLD DOWN LOCATIONS OF SHEAR WALLS SHALL BE NAILED TOGETHER WITH TWO ROWS OF 3/2" NAILS @ 6" O/C TYPICAL
- 7- DO NOT LOCATE VERTICAL BUTT JOINTS IN SHEAR WALL SHEATHING WITHIN 24" OF END POST
- 8- REQUIREMENTS OF WOOD FRAME LOAD BEARING WALLS APPLY TO ALL SHEAR WALLS
- 9- PROVIDE HOLD DOWN ANCHORS AS MANUFACTURED BY SIMPSON STRONG-TIE ONLY UNLESS ALTERNATES ARE PRE-APPROVED BY LAMPKIN STRUCTURAL SERVICES
- 10- IF THE HOLDOWN AT THE HIGHER LEVEL DOES NOT LINE UP WITH THE HOLDOWN AT THE LOWER LEVEL, A VERTICAL MEMBER WITH THE SAME TYPE OF HOLDOWN SHALL BE INSTALLED EVERY LOWER LEVEL. REFER TO STRUCTURAL DETAIL
- 11-
- 12- SEE WOOD FRAMING NOTES FOR ADDITIONAL INFORMATION
- 13- NO OPENINGS GREATER THAN 8" DIAMETER ALLOWED THROUGH SHEAR WALL SHEATHING UNLESS PRE-APPROVED BY LAMPKIN STRUCTURAL SERVICES
- 14- ALL EXTERIOR AND INTERIOR SHEAR WALLS TO BE NAILED AS PER SHEAR WALL SCHEDULE


Shown as	Shearwall	Segment	Min. Length	Exterior			Interior			Holdown	Min. Required End studs
				Sheathing	Edge fastener spacing	Interior fastener spacing	Sheathing	Edge fastener spacing	Interior fastener spacing		
	1-1	1	18'-6"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	ANCHOR TYPE 2	4
	1-2	1	18'-3"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	ANCHOR TYPE 2	4
	2-1	1	10'-4"	7/16 OSB	6"	12"	7/16 OSB	4"	12"	ANCHOR TYPE 4	2
	6-1	1	9'-11"	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	ANCHOR TYPE 4	2
	8-1	1	5'-6"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	ANCHOR TYPE 1	4
	8-2	1	14'-4"	1/2" Plywood	6"	12"	1/2" Plywood	4"	12"	ANCHOR TYPE 1	4
	8-3	1	17'-2"	1/2" Plywood	6"	12"	1/2" Plywood	4"	12"	ANCHOR TYPE 1	4
	9-1	1	25'-0"	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	ANCHOR TYPE 3	3
	12-1	1	10'-4"	7/16 OSB	6"	12"	7/16 OSB	4"	12"	ANCHOR TYPE 4	2
	13-1	1	14'-9"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	ANCHOR TYPE 2	4
	13-2	1	17'-0"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	ANCHOR TYPE 2	4
	14-1	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	14-2	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	15-1	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	15-2	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2

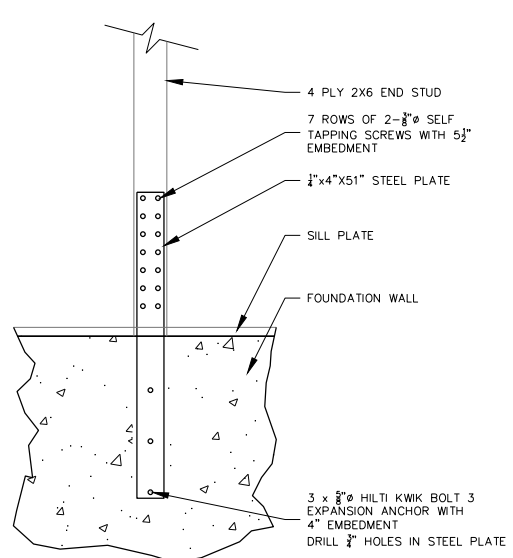


HOLD-DOWN ANCHOR TYPE 1

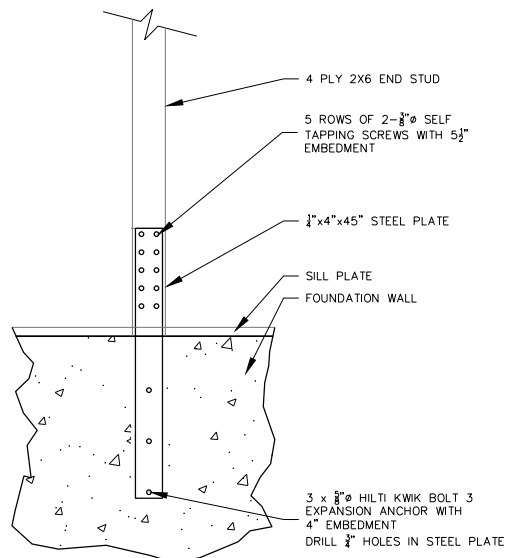


HOLD-DOWN ANCHOR TYPE 2

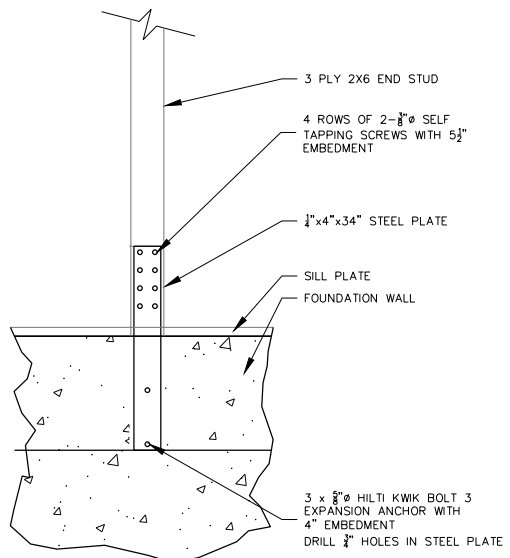

HOLD-DOWN ANCHOR TYPE 3

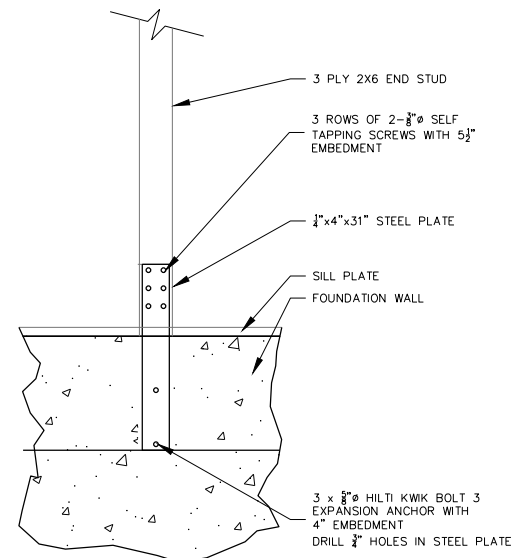

HOLD-DOWN ANCHOR TYPE 4

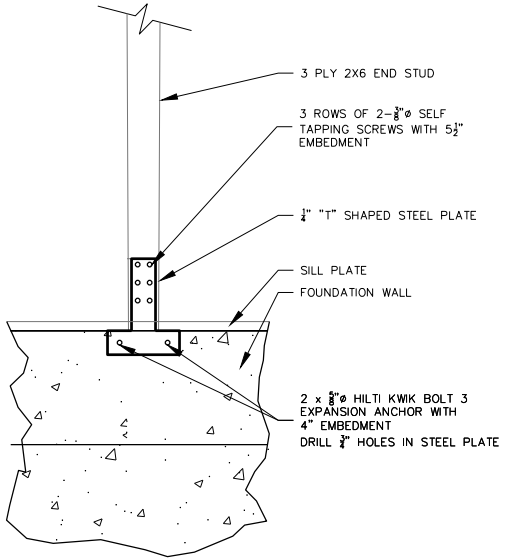

HOLD-DOWN ANCHOR TYPE 5

Shown as	Shearwall	Segment	Min. Length	Exterior			Interior			Holdown	Min. Required End studs
				Insulated Sheathing	Edge fastener spacing	Interior fastener spacing	Sheathing	Edge fastener spacing	Interior fastener spacing		
	A-1	2	6'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	B-1	1	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	B1	2	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	C-1	2	2'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	D-1	2	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	D-1	3	5'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	D-1	5	4'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	E-1	2	5'-5"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	E-1	3	3'-3"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	E-1	4	6'-7"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	E-2	2	2'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	E-3	1	4'-2"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	E-3	2	4'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	G-1	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	G-2	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	I-1	2	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-1	3	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-1	4	5'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-1	5	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-2	1	3'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-2	2	3'-5"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-3	1	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	I-3	2	3'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	J-1	2	1'-7"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 3	3
	J-2	1	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	J-2	2	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	K-1	1	2'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	K-1	2	8'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2
	K-1	4	7'-3"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	ANCHOR TYPE 4	2

- * END STUD IS NOT CONTINUOUS AND SHALL BE EXTENDED TO FOUNDATION WALL. SEE THE STRUCTURAL DETAIL FOR MORE INFORMATION.
- ** END STUD IS LANDING ON TOP OF AN OPENING. SEE THE STRUCTURAL DETAIL FOR MORE INFORMATION.

BLOCK: U
DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH
Valecraft
INCORPORATED

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY AMENDMENTS AND SHOW ONLY SOME OF THE CHANGES DETAILED ON THIS DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR ANY OTHER ITEMS, AUTOMATICALLY THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.
ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.
THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.
NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-A	REVISIONS TO SHEAR WALLS	10/04/2020	AB
REV-B	AS PER STRUCTURAL	10/12/2020	AB
REV-C	1/2" INCREASE ON NEW END PORCHES	11/18/2019	AB
REV-D	AS PER DRG & REMOVED MANGROVES	10/15/2019	AB
REV-E	AS PER STRUCTURAL	10/03/2019	AB
REV-F	ISSUED FOR TENDER	07/09/2018	MAO
REV-G	NEW STANDARD DRWG MODIFICATION	07/06/2018	MAO
REV-H	NEW STANDARD DRWG MODIFICATION	10/25/2018	MAO
REV-I	DESCRIPTION	DATE	BY

BASEMENT FLOOR SHEAR WALLS

ADDRESS:	SCALE:	DATE:	SHEET:
5000 SERIES - DEERFIELD CONDOS	1/4" = 1'-0"	10/04/2020	SW1
(STANDARD DRAWINGS)			

ROOF AND FLOOR LAYOUT NOTES:

– ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS. PROVIDE SUPPORT UNDER ORDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE:

COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER AND P.ENG. IN OTHER CASE.

NOTE:

COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH CLIENT AND MANUFACTURERS.

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS

ARCHITECT

1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH



Valecraft
Structural Ltd.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY DETAILS AND SHOWN ONLY SOME OF THE DETAILS DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL DETAILS CONTAINED ON A SCHEDULE OR WITH OTHER ITEMS, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER EXISTING OR NEW, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL LINTEL:

S1 = 1 80x6x6
S2 = 1 80x6x8
S3 = 1 100x6x8
S4 = 1 120x6x8
S5 = 1 120x8x10
S6 = 1 200x10x10
S7 = 1 150x10x10 (8" BEARING)

LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES
L2 = 3-2x10 + P3 ON BOTH SIDES
L3 = 2-1 7/8x5 LVL (1.9E) + P3 ON BOTH SIDES
L4 = 3-1 7/8x5 LVL (1.9E) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LAMBER.

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
P2 = 2-2x4 OR 3-2x4
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6

P11 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P14 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P16 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P17 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P18 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P19 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P20 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P21 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P22 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P23 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P24 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P25 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P26 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P27 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P28 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P29 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P30 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P31 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P32 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P33 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P34 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P35 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P36 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P37 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P38 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P39 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P40 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P41 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P42 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P43 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P44 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P45 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P46 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P47 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P48 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P49 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P50 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P51 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P52 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P53 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P54 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P55 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P56 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P57 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P58 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P59 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P60 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P61 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P62 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P63 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P64 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P65 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P66 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P67 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P68 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P69 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P70 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P71 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P72 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P73 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P74 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P75 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P76 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P77 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P78 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P79 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P80 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P81 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P82 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P83 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P84 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P85 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P86 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P87 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P88 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P89 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P90 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P91 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P92 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P93 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P94 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P95 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P96 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P97 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P98 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P99 = 105 86x86x13.9 + 100x10x12 18B PL (V)
P100 = 105 86x86x13.9 + 100x10x12 18B PL (V)

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LAMBER.

* POST ARE ALL JACK 1/4" STUD.

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2".

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2".

SMOKE ALARMS AS PER SECTION 9.10.18 OF THE ONTARIO BUILDING CODE.

SHALL HAVE A BATTERY BACKUP SYSTEM.

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY.

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT.

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION.

FOLLOWED BY A MINUTE OF SOUNDING.

UNITED MOUNTAIN ALARMS ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS

ARCHITECT

1 SHERBROOK STREET E

PERTH, ON, K7H 1A1

WITH

Valecraft

INCORPORATED

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY AMENDMENTS AND SHALL SHOW ONLY SOME OF THE COMMENTS DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR ANY OTHER ITEMS, THE DRAWING IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSIONS SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL LINTEL:

S1 = 1.80x6x6

S2 = 1.80x6x8

S3 = 1.10x4x8

S4 = 1.12x6x8

S5 = 1.12x6x10

S6 = 1.20x10x10

S7 = 1.10x10x10 (8" BEARING)

LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES

L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x8.5 LIA (1.92) + P3 ON BOTH SIDES

L4 = 3-1.75x8.5 LIA (1.92) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER.

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN

P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK

P2 = 2-2x4 OR 2-2x6

P3 = 2-2x4 OR 2-2x6

P4 = 2-2x4 OR 2-2x6

P5 = 2-2x4 OR 2-2x6

P6 = 2-2x4 OR 2-2x6

P7a = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7b = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7c = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7d = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7e = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7f = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7g = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7h = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7i = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7j = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7k = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7l = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7m = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7n = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7o = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7p = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7q = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7r = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7s = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7t = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7u = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7v = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7w = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7x = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7y = 105 88x88x13.18 + 100x100x12 18B PL (V)

P7z = 105 88x88x13.18 + 100x100x12 18B PL (V)

* POST ARE ALL JACK 1/4" STUD

EX. P2 = 1" JACK + 1" STUD

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.18 OF THE ONTARIO BUILDING CODE:

- SHALL HAVE A BATTERY BACKUP SUPPLY.
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY.
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT.
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY A MINIMUM OF 30 DAYS.
- LINTEL MOUNTED ALARMS ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

■ PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-8 REVISIONS TO SHEET WALLS 05/04/2020 AB

REV-7 AS PER STRUCTURAL 02/12/2020 AB

REV-6 1/2" INCREASE ON NEW EXIST PORCHES 17/03/2019 AB

REV-5 AS PER DEC & REMOVED MANGARDS 12/15/2019 AB

REV-4 AS PER STRUCTURAL 06/03/2019 AB

REV-3 ISSUED FOR TENDER 07/09/2018 MAD

REV-2 NEW STANDARD DRWG MODIFICATION 07/09/2018 MAD

REV-1 NEW STANDARD DRWG MODIFICATION 06/25/2018 MAD

NO. DESCRIPTION DATE BY

DRAWN

DATE

BY

ADDRESS: 100

SCALE: 1/2" = 1'-0"

DATE: 02/18/2021


5000 SERIES - DEERFIELD CONDOS

A104

STANDARD DRAWINGS

SHEET

The diagram is a detailed architectural ground floor plan for three residential units, labeled UNIT # 5205, UNIT # 5206, and UNIT # 5207. The plan is oriented with WEST to the left, EAST to the right, NORTH at the top, and SOUTH at the bottom. Each unit is shown with its own set of rooms and common areas, including a living/dining room, kitchen, bedrooms, bathrooms, and a porch. The plan includes extensive dimensioning for room sizes and overall unit dimensions. Structural details such as walls, doors, windows, and stairs are clearly indicated. The plan also shows common areas like hallways, stairs, and storage rooms. The drawing is a technical representation of the building's layout, providing a clear view of the spatial organization and structural elements of the units.

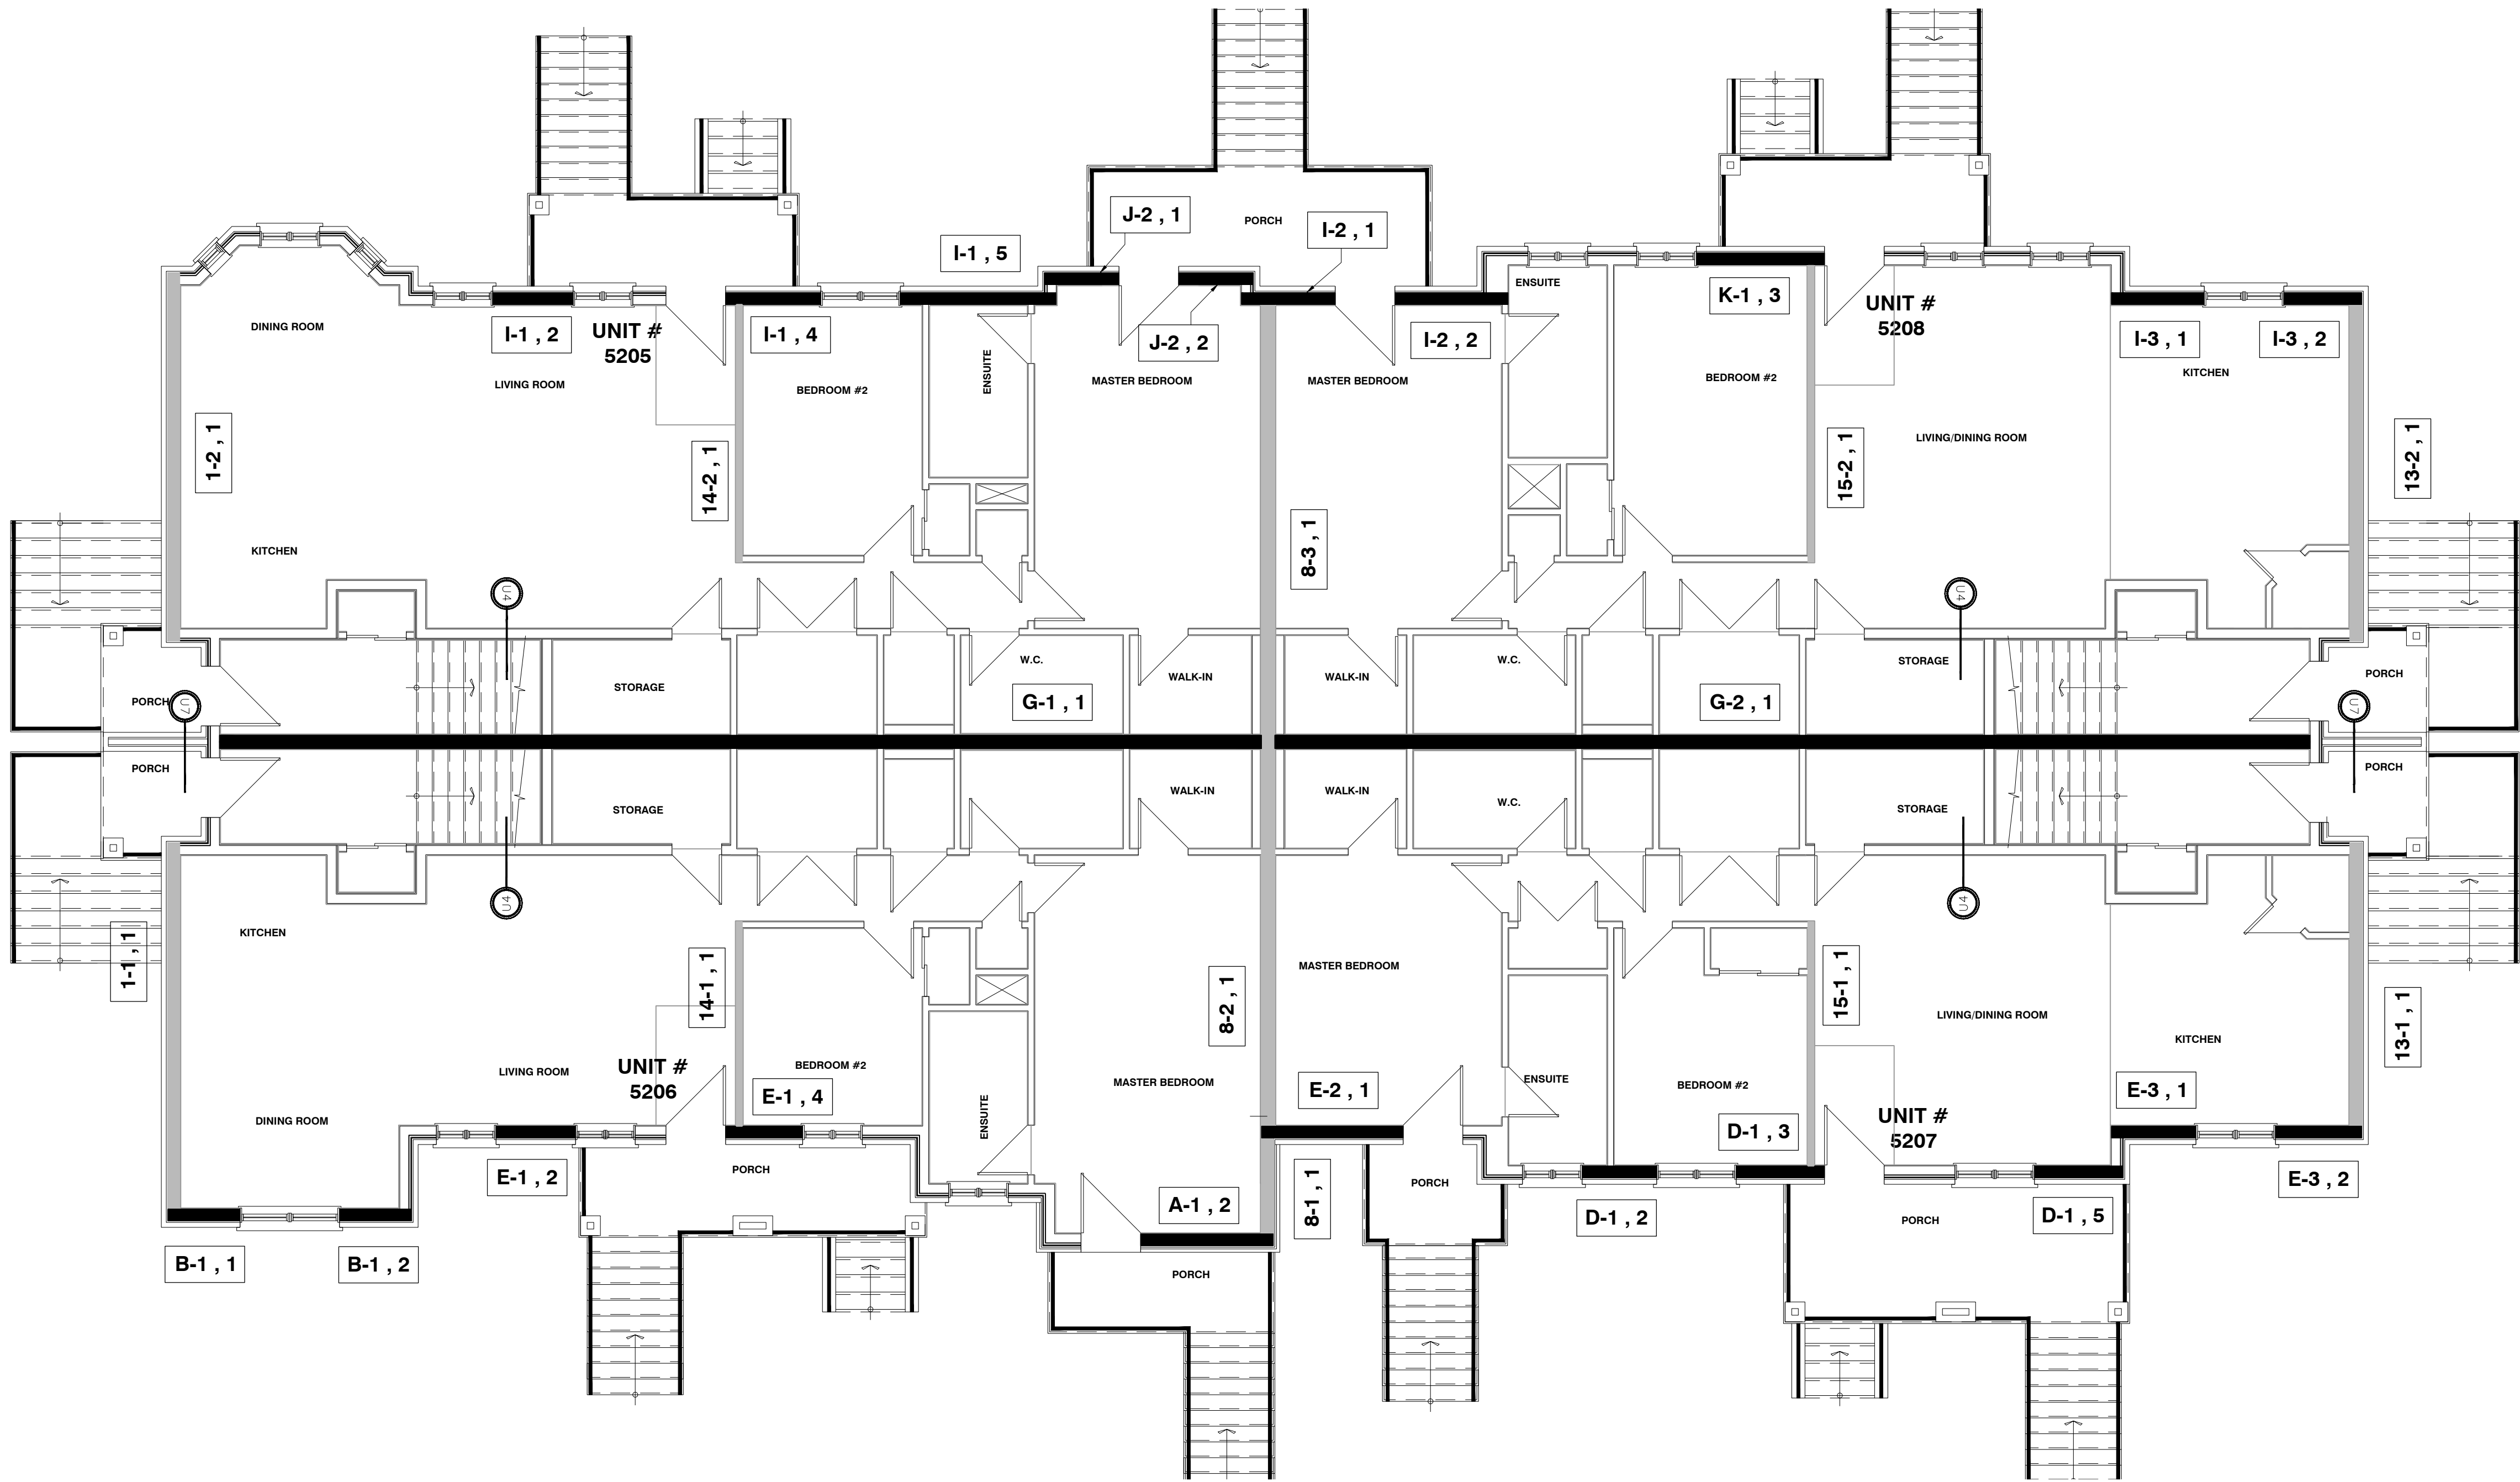

SHEAR WALL NOTES:

- 1- SHEAR WALLS ARE HIGHLIGHTED ON PLAN AND NAMES AS "A-1,2" WHERE:
"A" IS THE SHEAR LINE
"1" IS THE SHEAR WALL NUMBER
"2" IS THE SHEAR WALL SEGMENT
- 2- DO NOT USE P-NAILS OR SPIRAL NAILS IN SHEAR WALLS. NAILS SHALL BE COMMON NAILS OR POWER DRIVEN NAILS
- 3- NAILING SHOWN ON SCHEDULE APPLIES TO ALL FREE EDGES OF SHEATHING PANELS. PROVIDE NAILS AT 12" O/C ALONG INTERMEDIATE SUPPORTS.
- 4- BLOCK ALL UNSUPPORTED EDGES WITH 2X4 ON THE FLAT, SEE GENERAL NOTES; TYPICAL SHEAR WALL BLOCKING DETAIL
- 5- PROVIDE DOUBLE BOTTOM SILL PLATES FOR SHEAR WALLS SHEATHED BOTH SIDES
- 6- EXTRA STUDS AT HOLD DOWN LOCATIONS OF SHEAR WALLS SHALL BE NAILED TOGETHER WITH TWO ROWS OF 3½" NAILS @ 6" O/C TYPICAL
- 7- DO NOT LOCATE VERTICAL BUTT JOINTS IN SHEAR WALL SHEATHING WITHIN 24" OF END POST
- 8- REQUIREMENTS OF WOOD FRAME LOAD BEARING WALLS APPLY TO ALL SHEAR WALLS
- 9- PROVIDE HOLD DOWN ANCHORS AS MANUFACTURED BY SIMPSON STRONG-TIE ONLY UNLESS ALTERNATES ARE PRE-APPROVED BY LAMPKIN STRUCTURAL SERVICES
- 10- IF THE HOLDOWN AT THE HIGHER LEVEL DOES NOT LINE UP WITH THE HOLDOWN AT THE LOWER LEVEL, A VERTICAL MEMBER WITH THE SAME TYPE OF HOLDOWN SHALL BE INSTALLED EVERY LOWER LEVEL. REFER TO STRUCTURAL DETAIL
- 11-
- 12- SEE WOOD FRAMING NOTES FOR ADDITIONAL INFORMATION
- 13- NO OPENINGS GREATER THAN 8" DIAMETER ALLOWED THROUGH SHEAR WALL SHEATHING UNLESS PRE-APPROVED BY LAMPKIN STRUCTURAL SERVICES
- 14- ALL EXTERIOR AND INTERIOR SHEAR WALLS TO BE NAILED AS PER SHEAR WALL SCHEDULE

Shown as	Shearwall	Segment	Min. Length	Exterior			Interior			Holdown	Min. Required End studs
				Sheathing	Edge fastener spacing	Interior fastener spacing	Sheathing	Edge fastener spacing	Interior fastener spacing		
	1-1	1	18'-6"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	2x MSTA36	3
	1-2	1	18'-3"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	2x MSTA36	3
	8-1	1	5'-6"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	2XMST60	4
	8-2	1	14'-4"	1/2" Plywood	6"	12"	1/2" Plywood	6"	12"	2XMST60	4
	8-3	1	17'-2"	1/2" Plywood	6"	12"	1/2" Plywood	6"	12"	2XMST60	4
	13-1	1	14'-9"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	2x MSTA36	3
	13-2	1	17'-0"	7/16 OSB	6"	12"	2 x 7/16 OSB	3"	12"	2x MSTA36	3
	14-1	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	14-2	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	15-1	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2
	15-2	1	6'	5/8" GWB	6"	12"	1/2" Plywood	6"	12"	-	2

Shown as	Shearwall	Segment	Min. Length	Exterior			Interior			Holdown	Min. Required End studs
				Insulated Sheathing	Edge fastener spacing	Interior fastener spacing	Sheathing	Edge fastener spacing	Interior fastener spacing		
	A-1	2	6'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	B-1	1	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	B1	2	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	D-1	2	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	D-1*	3	4'-7"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	D-1	5	4'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-1	2	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	E-1	4	3'-11"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	E-2*	1	7'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	E-3	1	4'-2"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	E-3	2	4'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	3
	G-1	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	G-2	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	I-1	2	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-1*,**	4	5'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-1*	5	6'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-2	1	3'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-2	2	3'-5"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-3	1	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	I-3	2	3'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x MSTA36	2
	J-2	1	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	J-2	2	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	K-1*	3	7'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2

* END STUD IS NOT CONTINUOUS AND SHALL BE EXTENDED TO FOUNDATION WALL. SEE THE STRUCTURAL DETAIL FOR MORE INFORMATION.

** END STUD IS LANDING ON TOP OF AN OPENING. SEE THE STRUCTURAL DETAIL FOR MORE INFORMATION.

PROJECT

2012 O.B.C. DRAWINGS

REV-8

REVISIONS TO SHEAR WALLS

12/04/2020

AB

REV-7

AS PER STRUCTURAL

12/12/2020

AB

REV-6

1/2" INCREASE ON NEW END PORCHES

11/03/2019

AB

REV-5

AS PER DBC & REMOVED MANGROVES

12/15/2019

AB

REV-4

AS PER STRUCTURAL

10/03/2019

AB

REV-3

ISSUED FOR TENDER

07/09/2018

MAO

REV-2

NEW STANDARD DRAIN MODIFICATION

07/08/2018

MAO

REV-1

NEW STANDARD DRAIN MODIFICATION

10/25/2018

MAO

NO.

DESCRIPTION

DATE

BY

DATE

02/18/2021

DESIGNED BY

DATE

10/02/2020

SCALE

1/2" = 1'-0"

SHEET

SW2

5000 SERIES - DEERFIELD CONDOS

STANDARD DRAWINGS

DATE

02/18/2021

PROJECT

2012 O.B.C. DRAWINGS

REV-8

REVISIONS TO SHEAR WALLS

12/04/2020

AB

REV-7

AS PER STRUCTURAL

12/12/2020

AB

REV-6

1/2" INCREASE ON NEW END PORCHES

11/03/2019

AB

REV-5

AS PER DBC & REMOVED MANGROVES

12/15/2019

AB

REV-4

AS PER STRUCTURAL

10/03/2019

AB

REV-3

ISSUED FOR TENDER

07/09/2018

MAO

REV-2

NEW STANDARD DRAIN MODIFICATION

07/08/2018

MAO

REV-1

NEW STANDARD DRAIN MODIFICATION

10/25/2018

MAO

NO.

DESCRIPTION

DATE

BY

DATE

02/18/2021

DESIGNED BY

DATE

10/02/2020

SCALE

1/2" = 1'-0"

SHEET

SW2

5000 SERIES - DEERFIELD CONDOS

STANDARD DRAWINGS

DATE

02/18/2021

PROJECT

2012 O.B.C. DRAWINGS

REV-8

REVISIONS TO SHEAR WALLS

12/04/2020

AB

REV-7

AS PER STRUCTURAL

12/12/2020

AB

REV-6

1/2" INCREASE ON NEW END PORCHES

11/03/2019

AB

REV-5

AS PER DBC & REMOVED MANGROVES

12/15/2019

AB

REV-4

AS PER STRUCTURAL

10/03/2019

AB

REV-3

ISSUED FOR TENDER

07/09/2018

MAO

REV-2

NEW STANDARD DRAIN MODIFICATION

07/08/2018

MAO

REV-1

NEW STANDARD DRAIN MODIFICATION

10/25/2018

MAO

NO.

DESCRIPTION

DATE

BY

DATE

02/18/2021

DESIGNED BY

DATE

10/02/2020

SCALE

1/2" = 1'-0"

SHEET

SW2

5000 SERIES - DEERFIELD CONDOS

STANDARD DRAWINGS

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH
 Valecraft
Structural Ltd.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY AMENDMENTS AND SHOW ONLY SOME OF THE DETAILS DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL DETAILS CONTAINED ON A SCHEDULE OR ANY OTHER ITEM, REFERENCE TO THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSIONS SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL LINTEL:

S1 = 1 80x6x6
S2 = 1 80x6x8
S3 = 1 100x6x8
S4 = 1 120x6x8
S5 = 1 120x8x10
S6 = 1 200x10x12
S7 = 1 150x10x12 (AT BEARING)

LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES
L2 = 3-2x10 + P3 ON BOTH SIDES
L3 = 2-1 7/8x5 LVL (1.8E) + P3 ON BOTH SIDES
L4 = 3-1 7/8x5 LVL (1.8E) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER.

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
P2 = 2-2x4 OR 3-2x4
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6

P11 = HSS 86x86x3.18 x 100x10x12 18B PL (V)
P14 = HSS 86x86x3.18 x 100x10x12 18B PL (V)
P16 = HSS 76x76x3.18 x 100x10x12 18B PL (V)
P18 = HSS 76x76x3.18 x 100x10x12 18B PL (V)
P17 = HSS 76x76x3.18 x 100x10x12 18B PL (V)
P19 = 130x160x10 TOP PL (V)

(V) = 1/4" TH MILD STEEL W/ 6" X 6" PL NOT USED.

* POSTS ARE ALL JACK 1/4" STUD.
EX. P2 = 1 JACK + 1 STUD.
* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2".

SMOKE ALARMS AS PER SECTION 9.10.18 OF THE OREGON BUILDING CODE.

SHALL HAVE A VISIBLE SMOKE DETECTOR:

- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY.


- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT.


- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION.

FOULING BY A MEANS OF AIRING AND:

- CLOTHES DRYER ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

* PROVIDE MECHANICAL EXHAUST TO OUTSIDE.

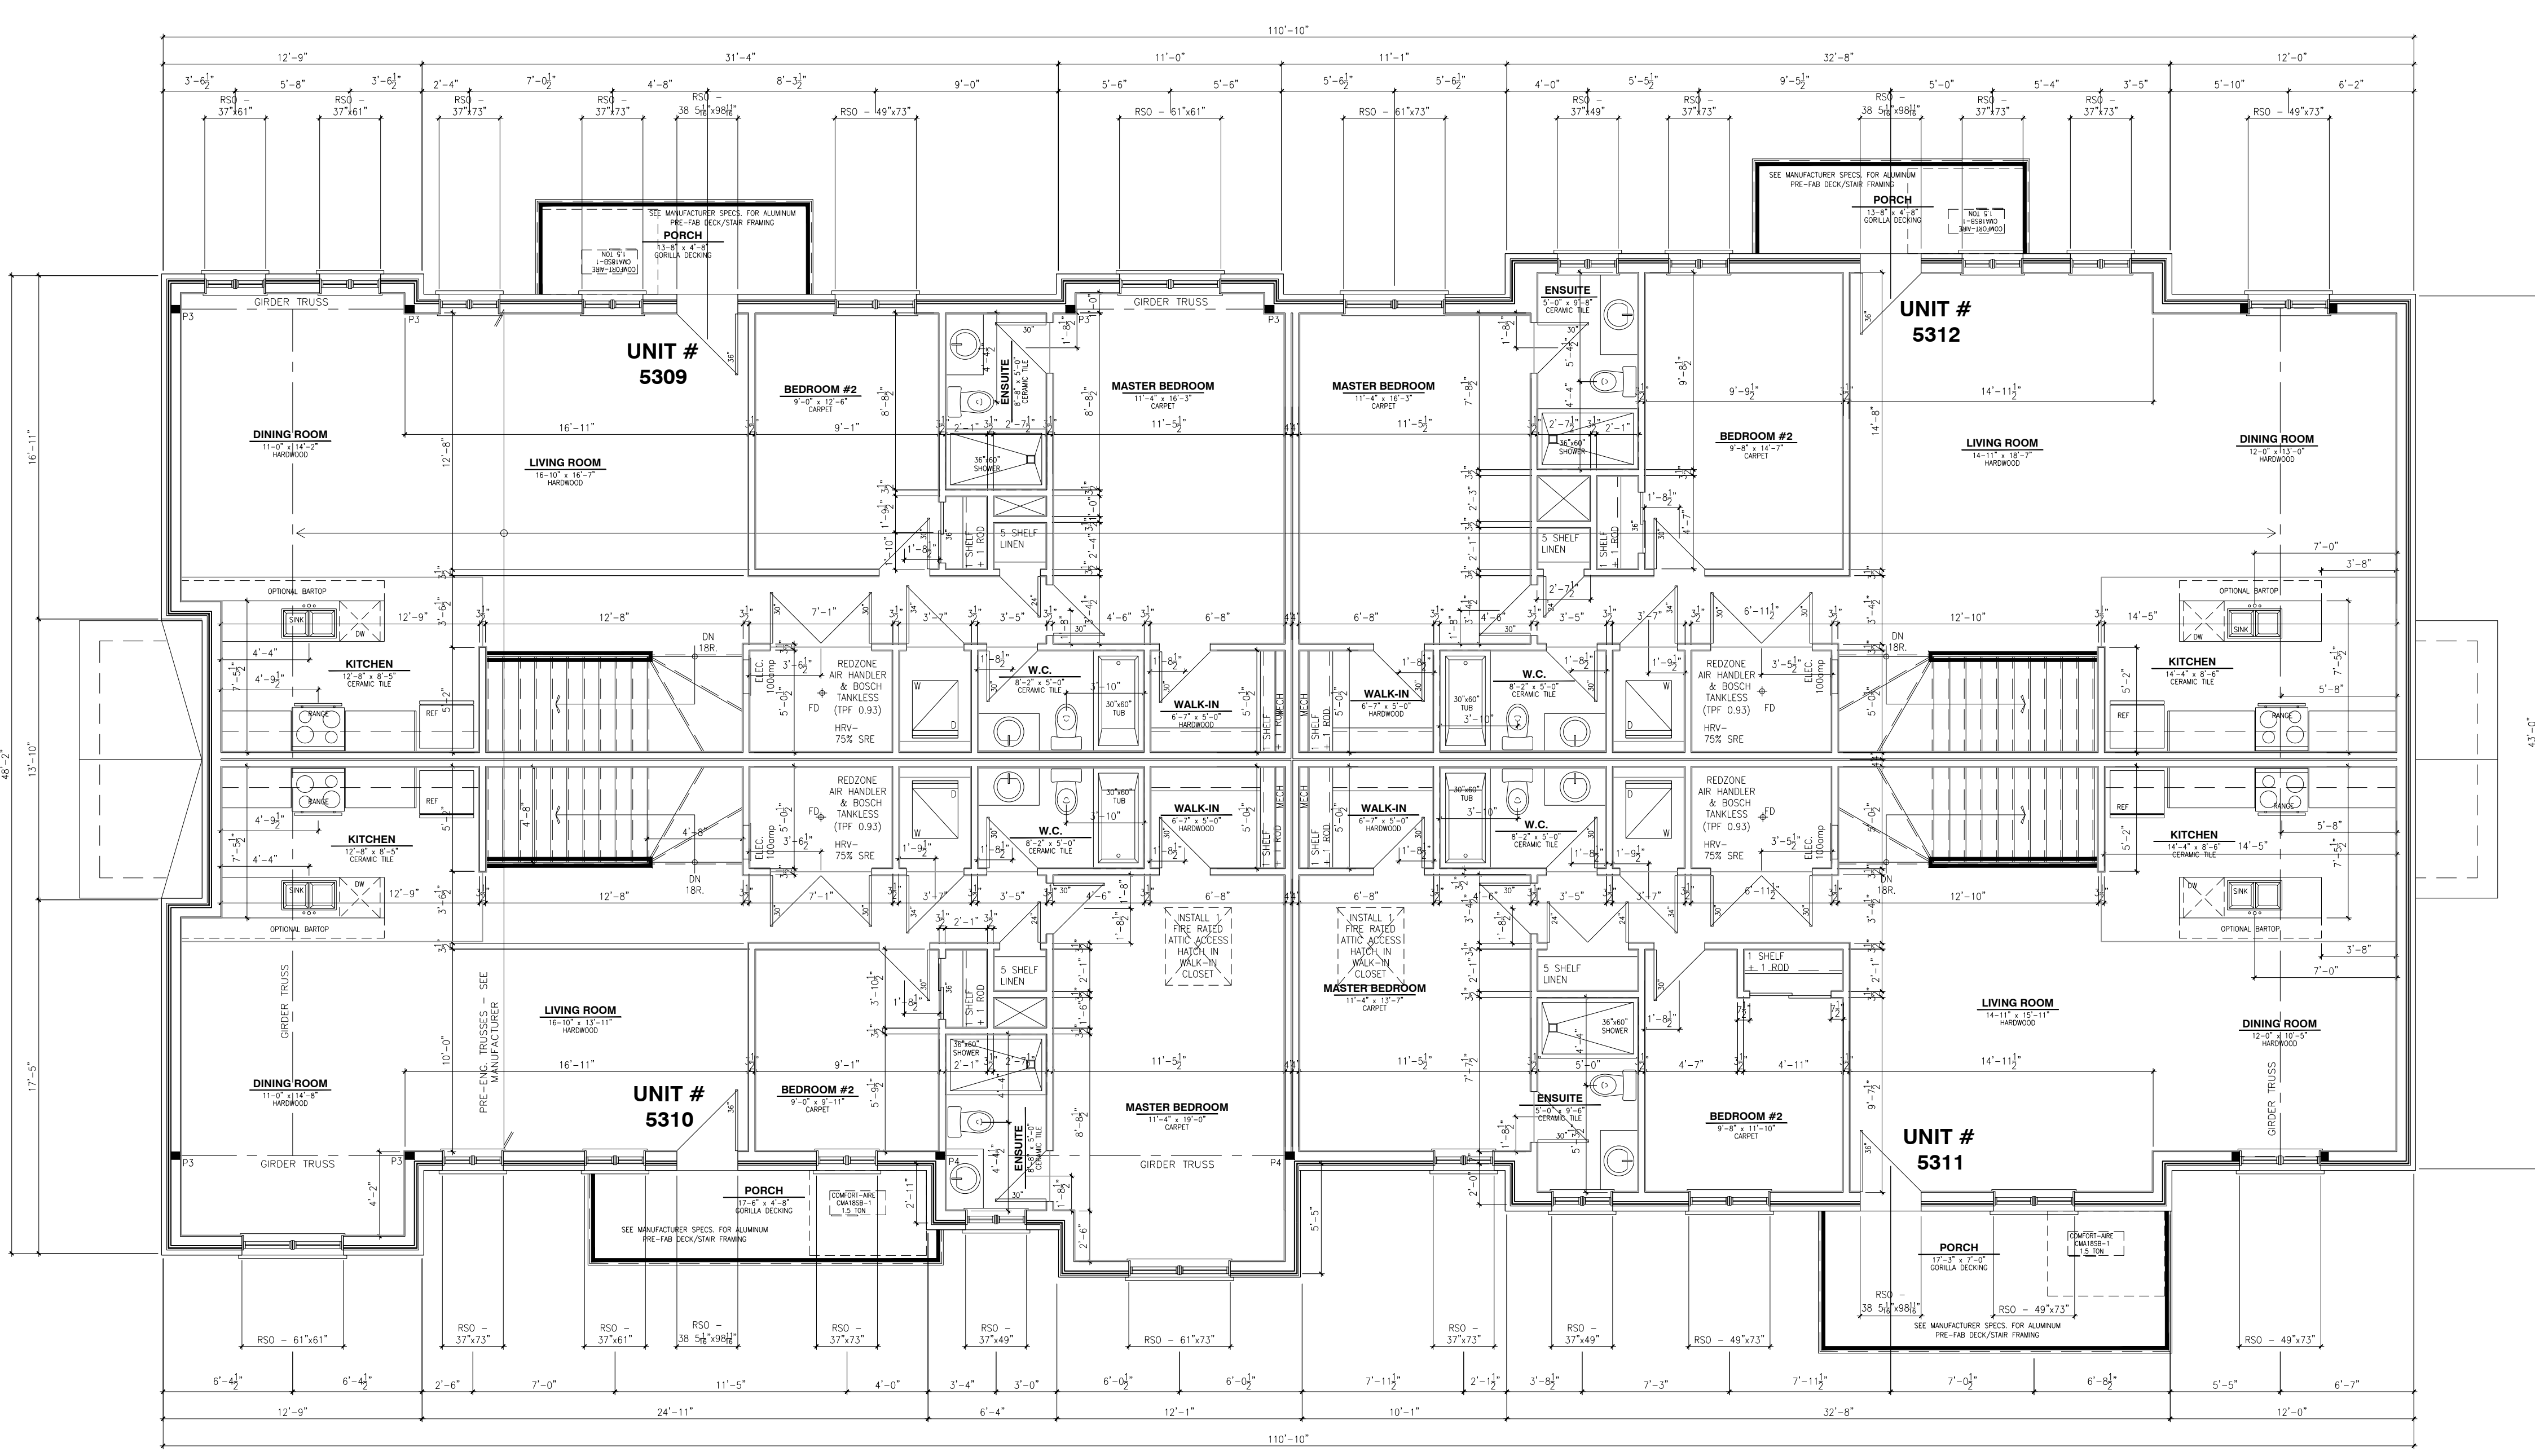

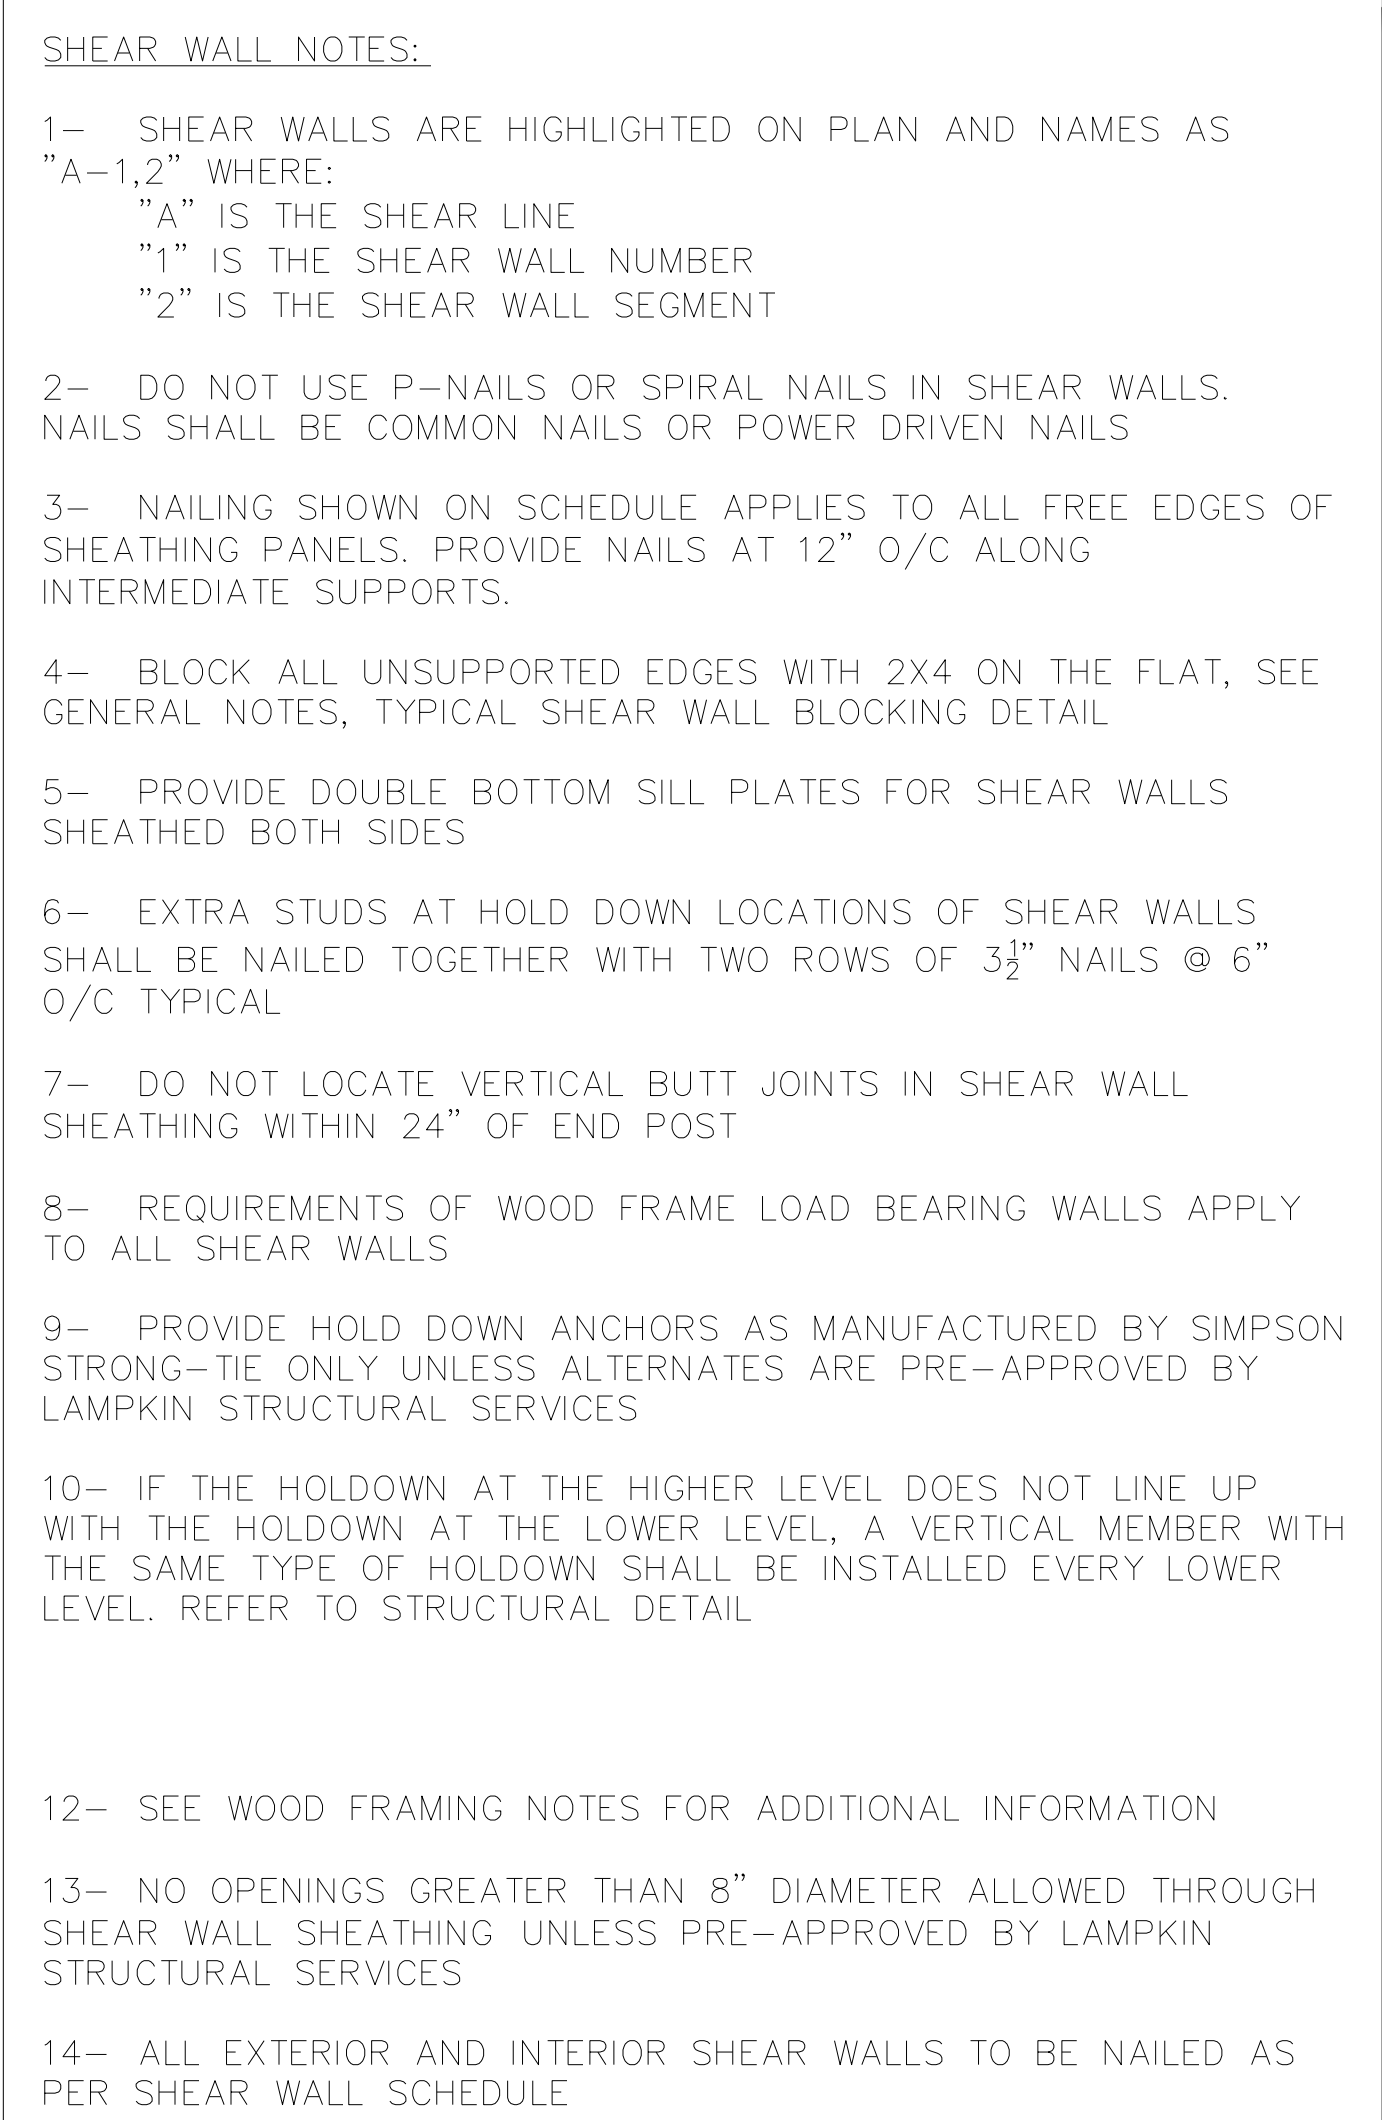

Shown as	Shearwall			Exterior			Interior			Holdown	Min. Required End studs
		Segment	Min. Length	Insulated Sheathing	Edge fastener spacing	Interior fastener spacing	Sheathing	Edge fastener spacing	Interior fastener spacing		
	A-1	2	3'-1"	7/16 OSB	6"	12"	7/16 OSB	4"	12"	2x LSTA36	2
	B-1	1	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	B1	2	3'-6"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	D-1	2	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12	2x LSTA36	2
	D-1	3	4'-7"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	D-1	5	4'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-1	2	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-1	4	3'-11"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-2	1	7'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-3	1	4'-2"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	E-3	2	4'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	G-1	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	G-2	1	46'	5/8" GWB	6"	12"	5/8" GWB	6"	12"	-	2
	I-1	2	4'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-1	4	5'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-1	5	6'-1"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-2	1	3'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-2	2	3'-5"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-3	1	4'-4"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
	I-3	2	3'-8"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2
J-2	1	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2	
J-2	2	3'-9"	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2	
K-1	3	7'	7/16 OSB	6"	12"	7/16 OSB	6"	12"	2x LSTA36	2	

BLOCK: U	
DATE: 02/18/2021	
GEOFF HODGINS ARCHITECT 1 SHERBROOK STREET E PERTH, ON, K7H 1A1	
WITH	
 Valecraft ENGINEERS LTD.	
THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE "B" AND ANY EFFECTS MAY OCCUR ONLY SOME OF THE CONDS ARE SHOWN ON THIS DOCUMENT. SHOULD THE DRAWING NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS, FURTHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER RECORDED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT. NO DIMENSION SHOULD BE SCALED ON DRAWINGS. THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.	

2012 O.B.C. DRAWINGS			
REV-0	REVISIONS TO SHEAR WALLS	15/04/2020	AB
REV-7	AS PER STRUCTURAL	02/12/2020	AB
REV-8	2" WORKED ON NEW EXIST FLOORING	11/15/2019	AB
REV-5	AS PER OBC & REMOVED MARGINS	10/15/2019	AB
REV-4	AS PER STRUCTURAL	06/03/2019	AB
REV-3	ISSUED FOR TENDER	07/09/2018	MDO
REV-2	NEW STANDARD DRWG MODIFICATION	07/08/2018	MDO
REV-1	NEW STANDARD DRWG MODIFICATION	05/25/2018	MDO
NO.	DESCRIPTION	DATE	BY

DRAWING: SECOND FLOOR SHEAR WALLS	
ADDRESS: JK	SCALE: 3/16" = 1'-0" SHEET: 15/09/2008
5000 SERIES - DEERFIELD CONDOS	
[STANDARD DRAWINGS]	[SW2]

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY AMENDMENTS AND SHOW ONLY SOME OF THE COMMENTS DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS COVERED ON A SCHEDULE OR ANY OTHER ITEMS, REFER TO THE SCHEDULE. IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:
STEEL LINTEL:
S1 = 1 80x8x6
S2 = 1 80x8x8
S3 = 1 100x10x8
S4 = 1 120x10x8
S5 = 1 120x12x10
S6 = 1 200x10x12
S7 = 1 150x10x12 (8" BEARING)

LINTEL TABLE:
L1 = 2-2x10 + P2 ON BOTH SIDES
L2 = 3-2x10 + P3 ON BOTH SIDES
L3 = 2-1 7/8x8.5 LVL (1.9E) + P3 ON BOTH SIDES
L4 = 3-1 7/8x8.5 LVL (1.9E) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER.

POST TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN
P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
P2 = 2-2x4 OR 3-2x4
P3 = 3-2x4 OR 3-2x6
P4 = 4-2x4 OR 4-2x6
P5 = 5-2x4 OR 5-2x6
P6 = 6-2x4 OR 6-2x6

P11 = 100 80x8x8x13.18 + 100x10x12 18B PL (V)
P11a = 100 80x8x8x13.18 + 100x10x12 18B PL (V)
P12 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P13 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P14 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P15 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P16 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P17 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P18 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P19 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P20 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P21 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P22 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P23 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P24 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P25 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P26 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P27 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P28 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P29 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P30 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P31 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P32 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P33 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P34 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P35 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P36 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P37 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P38 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P39 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P40 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P41 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P42 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P43 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P44 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P45 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P46 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P47 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P48 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P49 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P50 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P51 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P52 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P53 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P54 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P55 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P56 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P57 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P58 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P59 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P60 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P61 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P62 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P63 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P64 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P65 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P66 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P67 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P68 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P69 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P70 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P71 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P72 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P73 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P74 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P75 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P76 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P77 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P78 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P79 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P80 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P81 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P82 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P83 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P84 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P85 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P86 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P87 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P88 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P89 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P90 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P91 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P92 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P93 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P94 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P95 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P96 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P97 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P98 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P99 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)
P100 = 100 2x7x10x24x18 + 100x10x12 18B PL (V)

* POST ARE ALL JACK 1/4" STUD

EX: P2 = 1 JACK + 1 STUD

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "P2"

* PROVIDE MECHANICAL EXHAUST TO OUTSIDE

* SMOKE ALARMS AS PER SECTION 9.10.18 OF THE ONTARIO BUILDING CODE

* SHALL HAVE A BATTERY BACKUP SYSTEM


* ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY

* ARE REQUIRED ON EACH STORY, INCLUDING BASEMENT

* ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION

* FOLLOWED BY A MINIMUM OF 90 MIN. WDG.

* ULTIMATE MECHANICAL EXHAUST ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA

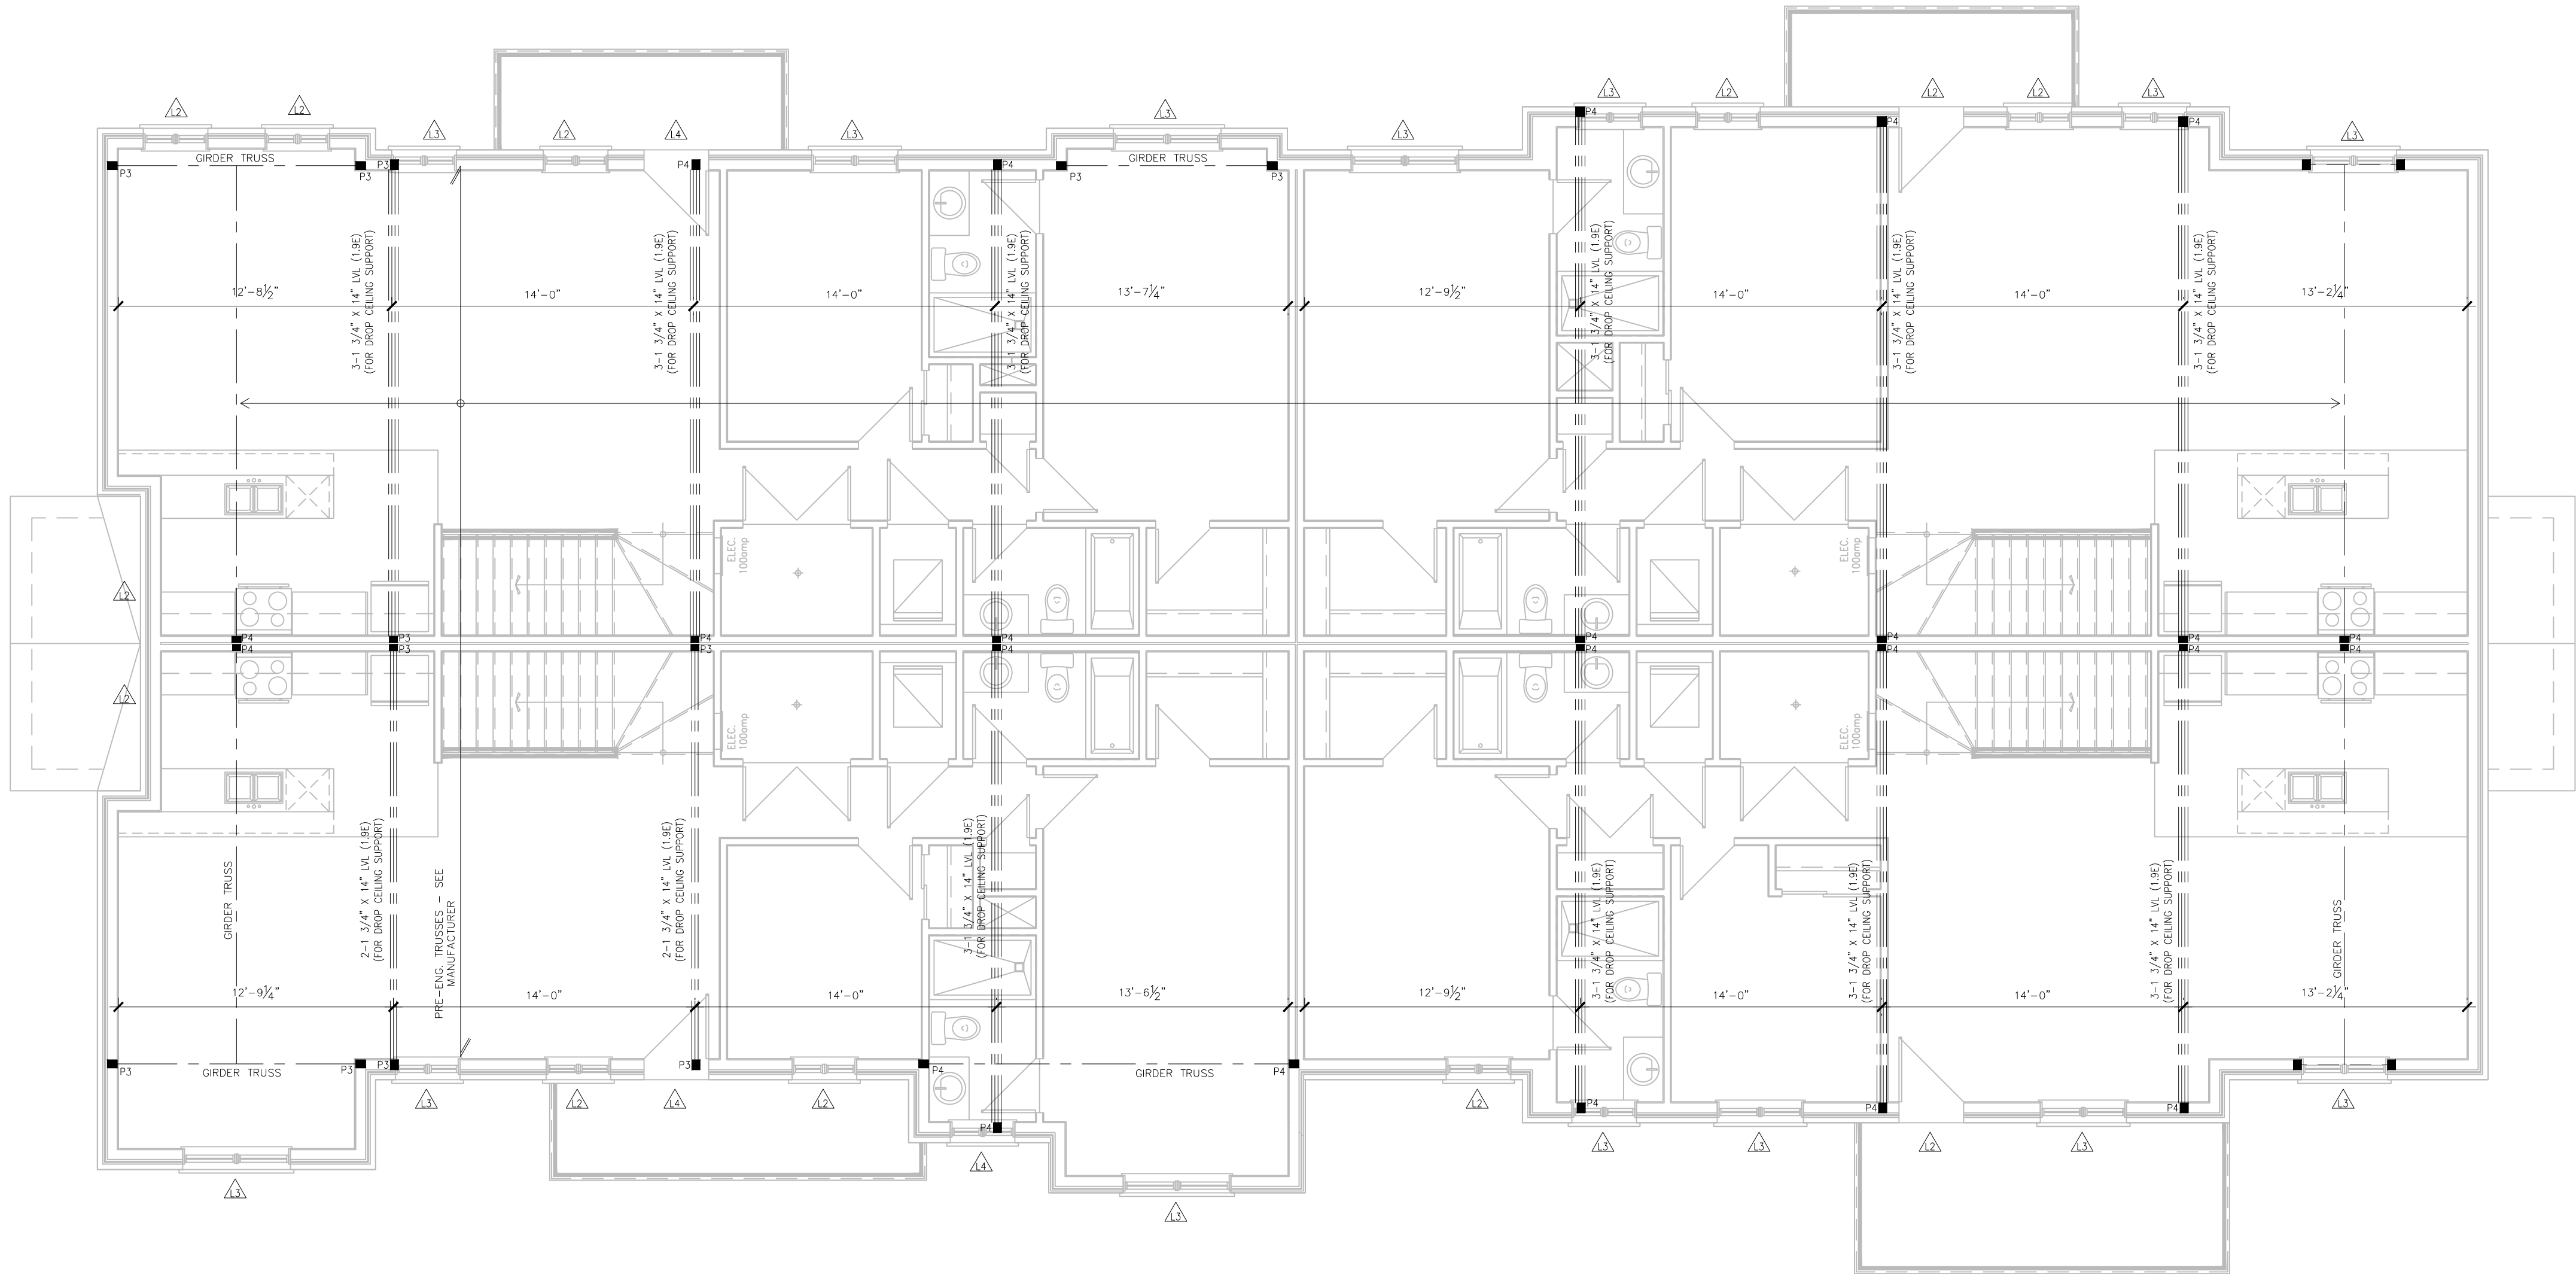

2012 O.B.C. DRAWINGS

REV-8	REVISIONS TO SHEET WALLS	05/04/2020	AB
REV-7	AS PER STRUCTURAL	02/12/2020	AB
REV-6	1"2" INCREASE ON NEW EXIST. FORMWORKS	17/05/2019	AB
REV-5	AS PER DEC. & REMOVED MANGERS	12/15/2019	AB
REV-4	AS PER STRUCTURAL	06/03/2019	AB
REV-3	ISSUED FOR TENDER	07/09/2018	MAO
REV-2	NEW STANDARD DRWG. MODIFICATION	07/08/2018	MAO
REV-1	NEW STANDARD DRWG. MODIFICATION	18/05/2018	MAO
NO.	DESCRIPTION	DATE	BY

SECOND / ROOF STRUCTURE

ADDRESS:	SCALE:	DATE:
10	1/2" = 1'-0"	10/02/2021

ROOF AND FLOOR LAYOUT NOTES:


– ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER, PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE:

COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER AND P.E.N.G. IN OTHER CASE.

NOTE:

COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH CLIENT AND MANUFACTURERS.

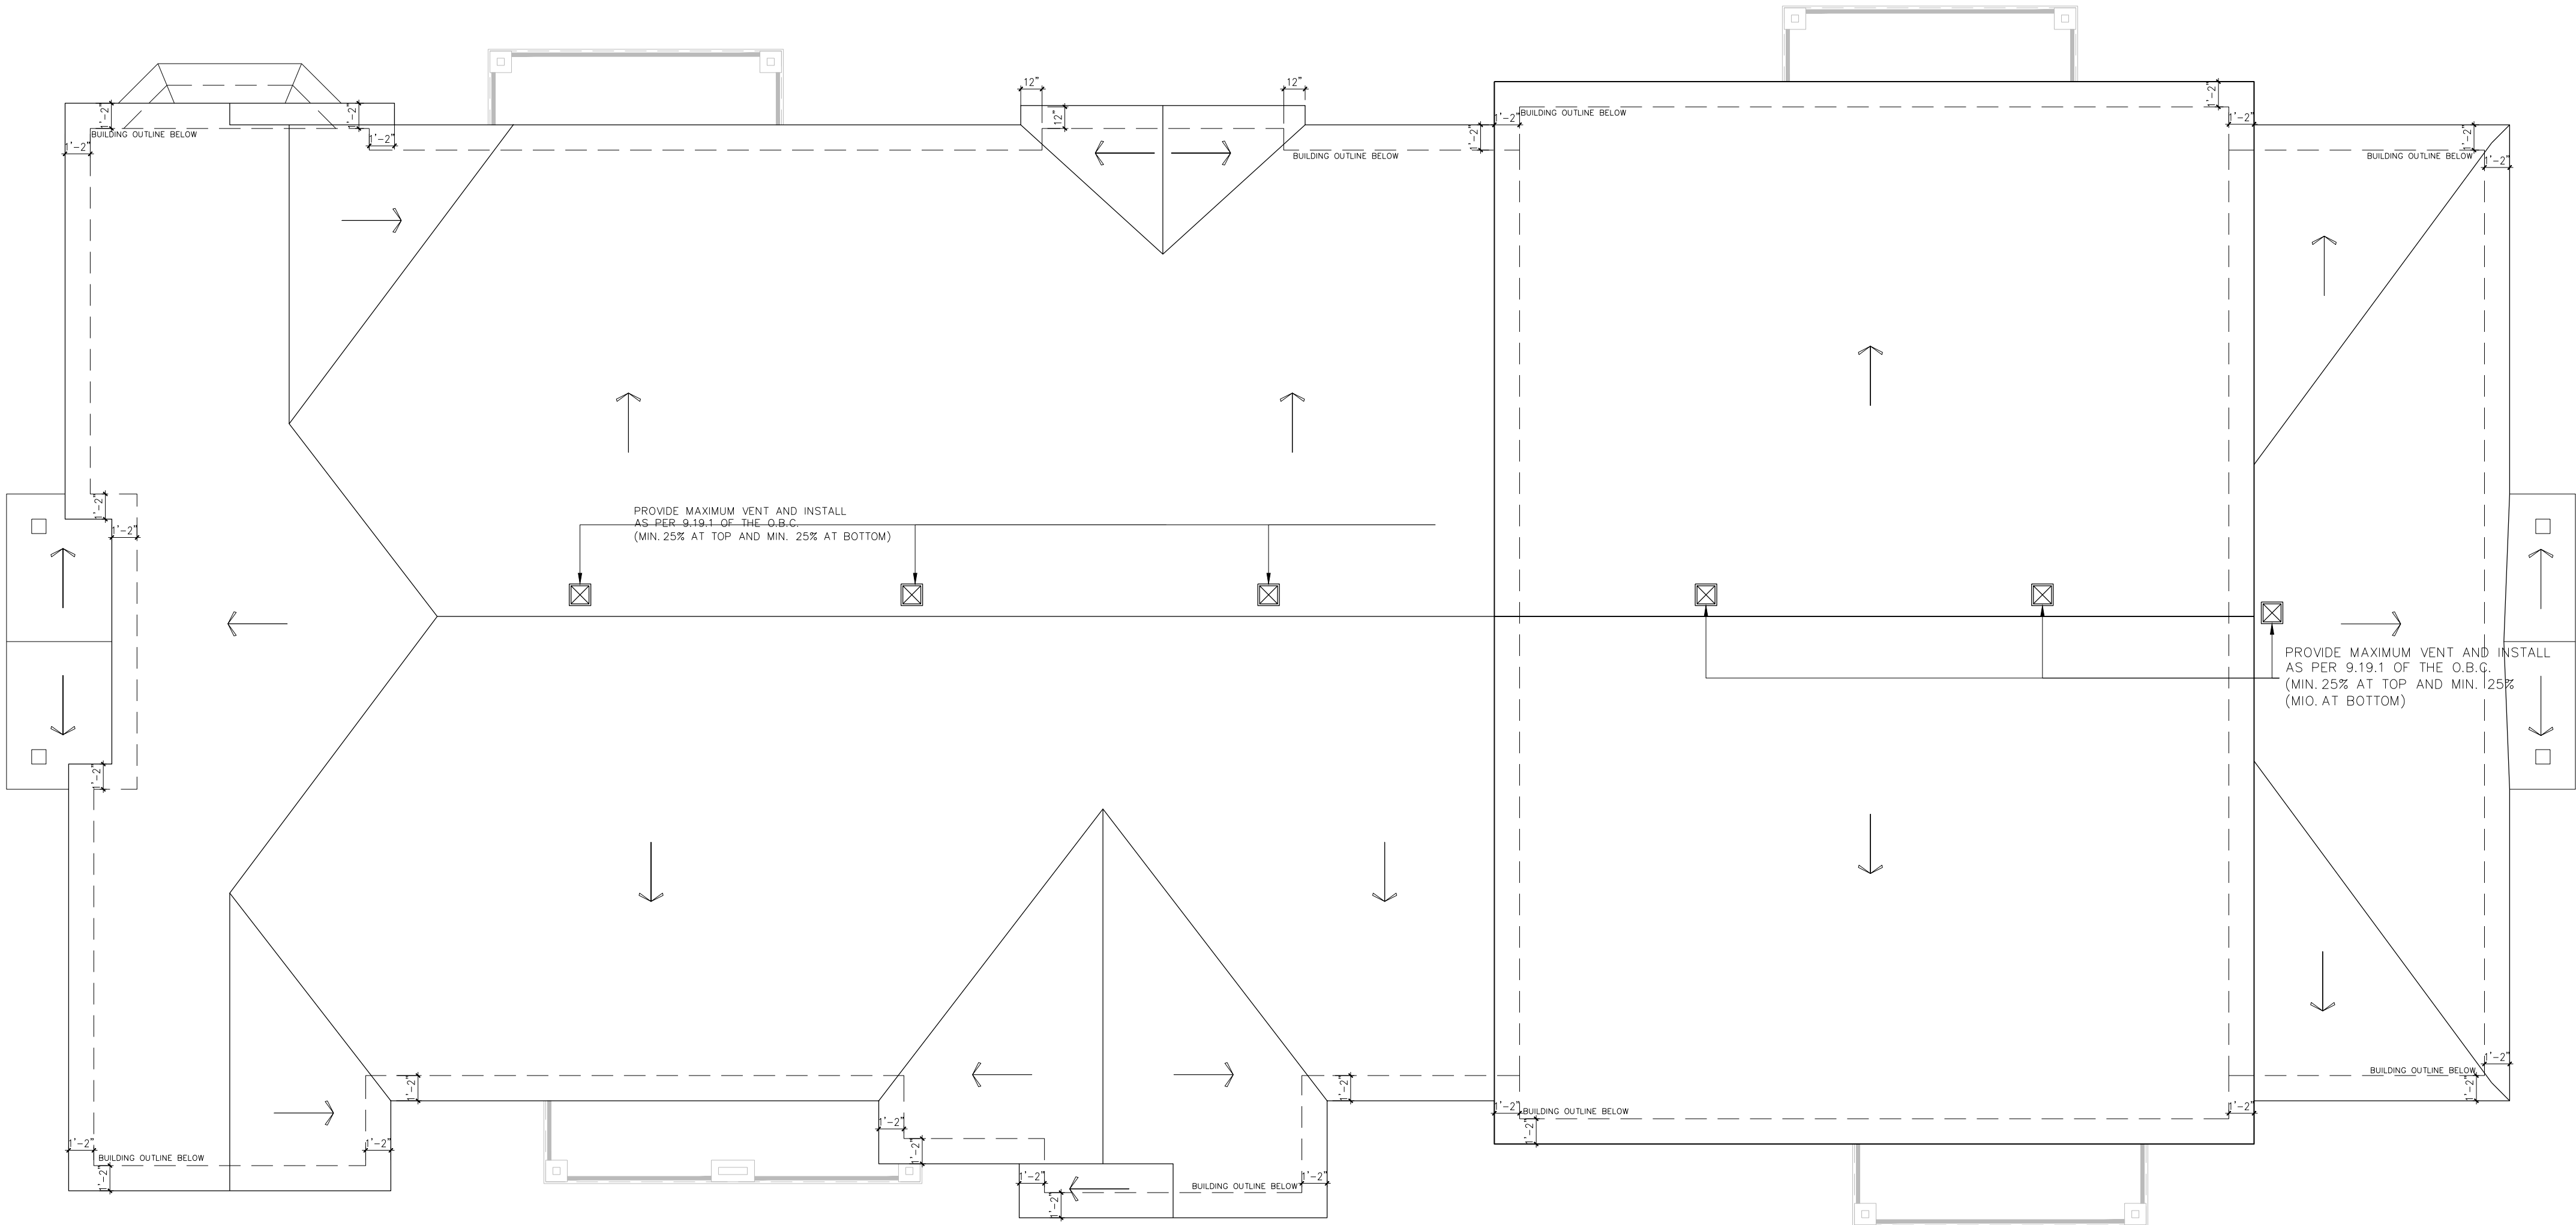

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS

ARCHITECT

1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH



THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-1A AND ANY AMENDMENTS AND SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS COORDINATED ON A SCHEDULE OR ANY OTHER ITEM, NOTWITHSTANDING THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER COORDINATED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO ALECOMPT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL LINTEL:

- S1 = L 80x8x6
- S2 = L 80x8x6
- S3 = L 100x8x8
- S4 = L 120x8x8
- S5 = L 120x8x8
- S6 = L 200x100x12
- S7 = L 150x100x12 (OF BEARING)

LINTEL TABLE:

- L1 = 2-2x10 + P3 ON BOTH SIDES
- L2 = 2-2x10 + P3 ON BOTH SIDES
- L3 = 2-1.75x8.5 Lx (1.92) + P3 ON BOTH SIDES
- L4 = 2-1.75x8.5 Lx (1.92) + P3 ON BOTH SIDES

* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER.

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
- P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK
- P2 = 3-2x4 OR 3-2x6
- P3 = 3-2x4 OR 3-2x6
- P4 = 3-2x4 OR 3-2x6
- P5 = 3-2x4 OR 3-2x6
- P6 = 3-2x4 OR 3-2x6
- P7 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P8 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P9 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P10 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P11 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P12 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P13 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P14 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P15 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P16 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P17 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P18 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P19 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P20 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P21 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P22 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P23 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P24 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P25 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P26 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P27 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P28 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P29 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P30 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P31 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P32 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P33 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P34 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P35 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P36 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P37 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P38 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P39 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P40 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P41 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P42 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P43 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P44 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P45 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P46 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P47 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P48 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P49 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P50 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P51 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P52 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P53 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P54 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P55 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P56 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P57 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P58 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P59 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P60 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P61 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P62 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P63 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P64 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P65 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P66 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P67 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P68 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P69 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P70 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P71 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P72 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P73 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P74 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P75 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P76 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P77 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P78 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P79 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P80 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P81 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P82 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P83 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P84 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P85 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P86 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P87 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P88 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P89 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P90 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P91 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P92 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P93 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P94 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P95 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P96 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P97 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P98 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P99 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)
- P100 = 100 88.8x88x1.18 + 100x200x12 TAB PL (V)

* POST ARE ALL JACK 1/4" STUD

* IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "9"

* JACK ALARMS AS PER SECTION 9-10.18 OF THE OUTSIDE BUILDING CODE

- SHALL HAVE A VISIBLE SIGNALING DEVICE
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY
- ARE REQUIRED ON EACH STORY INCLUDING BASEMENT
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY A MINIMUM OF 30 DAYS
- CANNOT BE LOCATED IN A SLEEPING AREA

* PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

REV-4	REVISION TO SHEET 1011	10/04/2020	AB
REV-3	AS PER STRUCTURAL	10/12/2020	AB
REV-2	1/2" INCREASE ON NEW EXIST FLOOR/CEILING	11/10/2019	AB
REV-1	AS PER OBC & REMOVED MANGROVES	12/15/2019	AB
REV-0	AS PER STRUCTURAL	10/02/2019	AB
REV-0	ISSUED FOR TENDER	07/09/2018	MAO
REV-0	NEW STANDARD DRAWING MODIFICATION	07/09/2018	MAO
REV-0	NEW STANDARD DRAWING MODIFICATION	10/02/2018	MAO
NO.	DESCRIPTION	DATE	BY

DRAWING: ROOF PLAN/LAYOUT

ADDRESS: 1011 1/2" INCREASE ON NEW EXIST FLOOR/CEILING

DATE: 10/04/2020

5000 SERIES - DEERFIELD CONDOS

STANDARD DRAWINGS


SHEET: A107

NOTE:
COORD. ALL MAN DOORS AND WINDOWS WITH CLIENT. REFER
TO CHOSEN OPTIONS FOR PROPER ROUGH OPENING WIDTHS

NOTE:
COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR
LIGHTING, ETC. WITH CLIENT AND MANUFACTURERS.



EAST

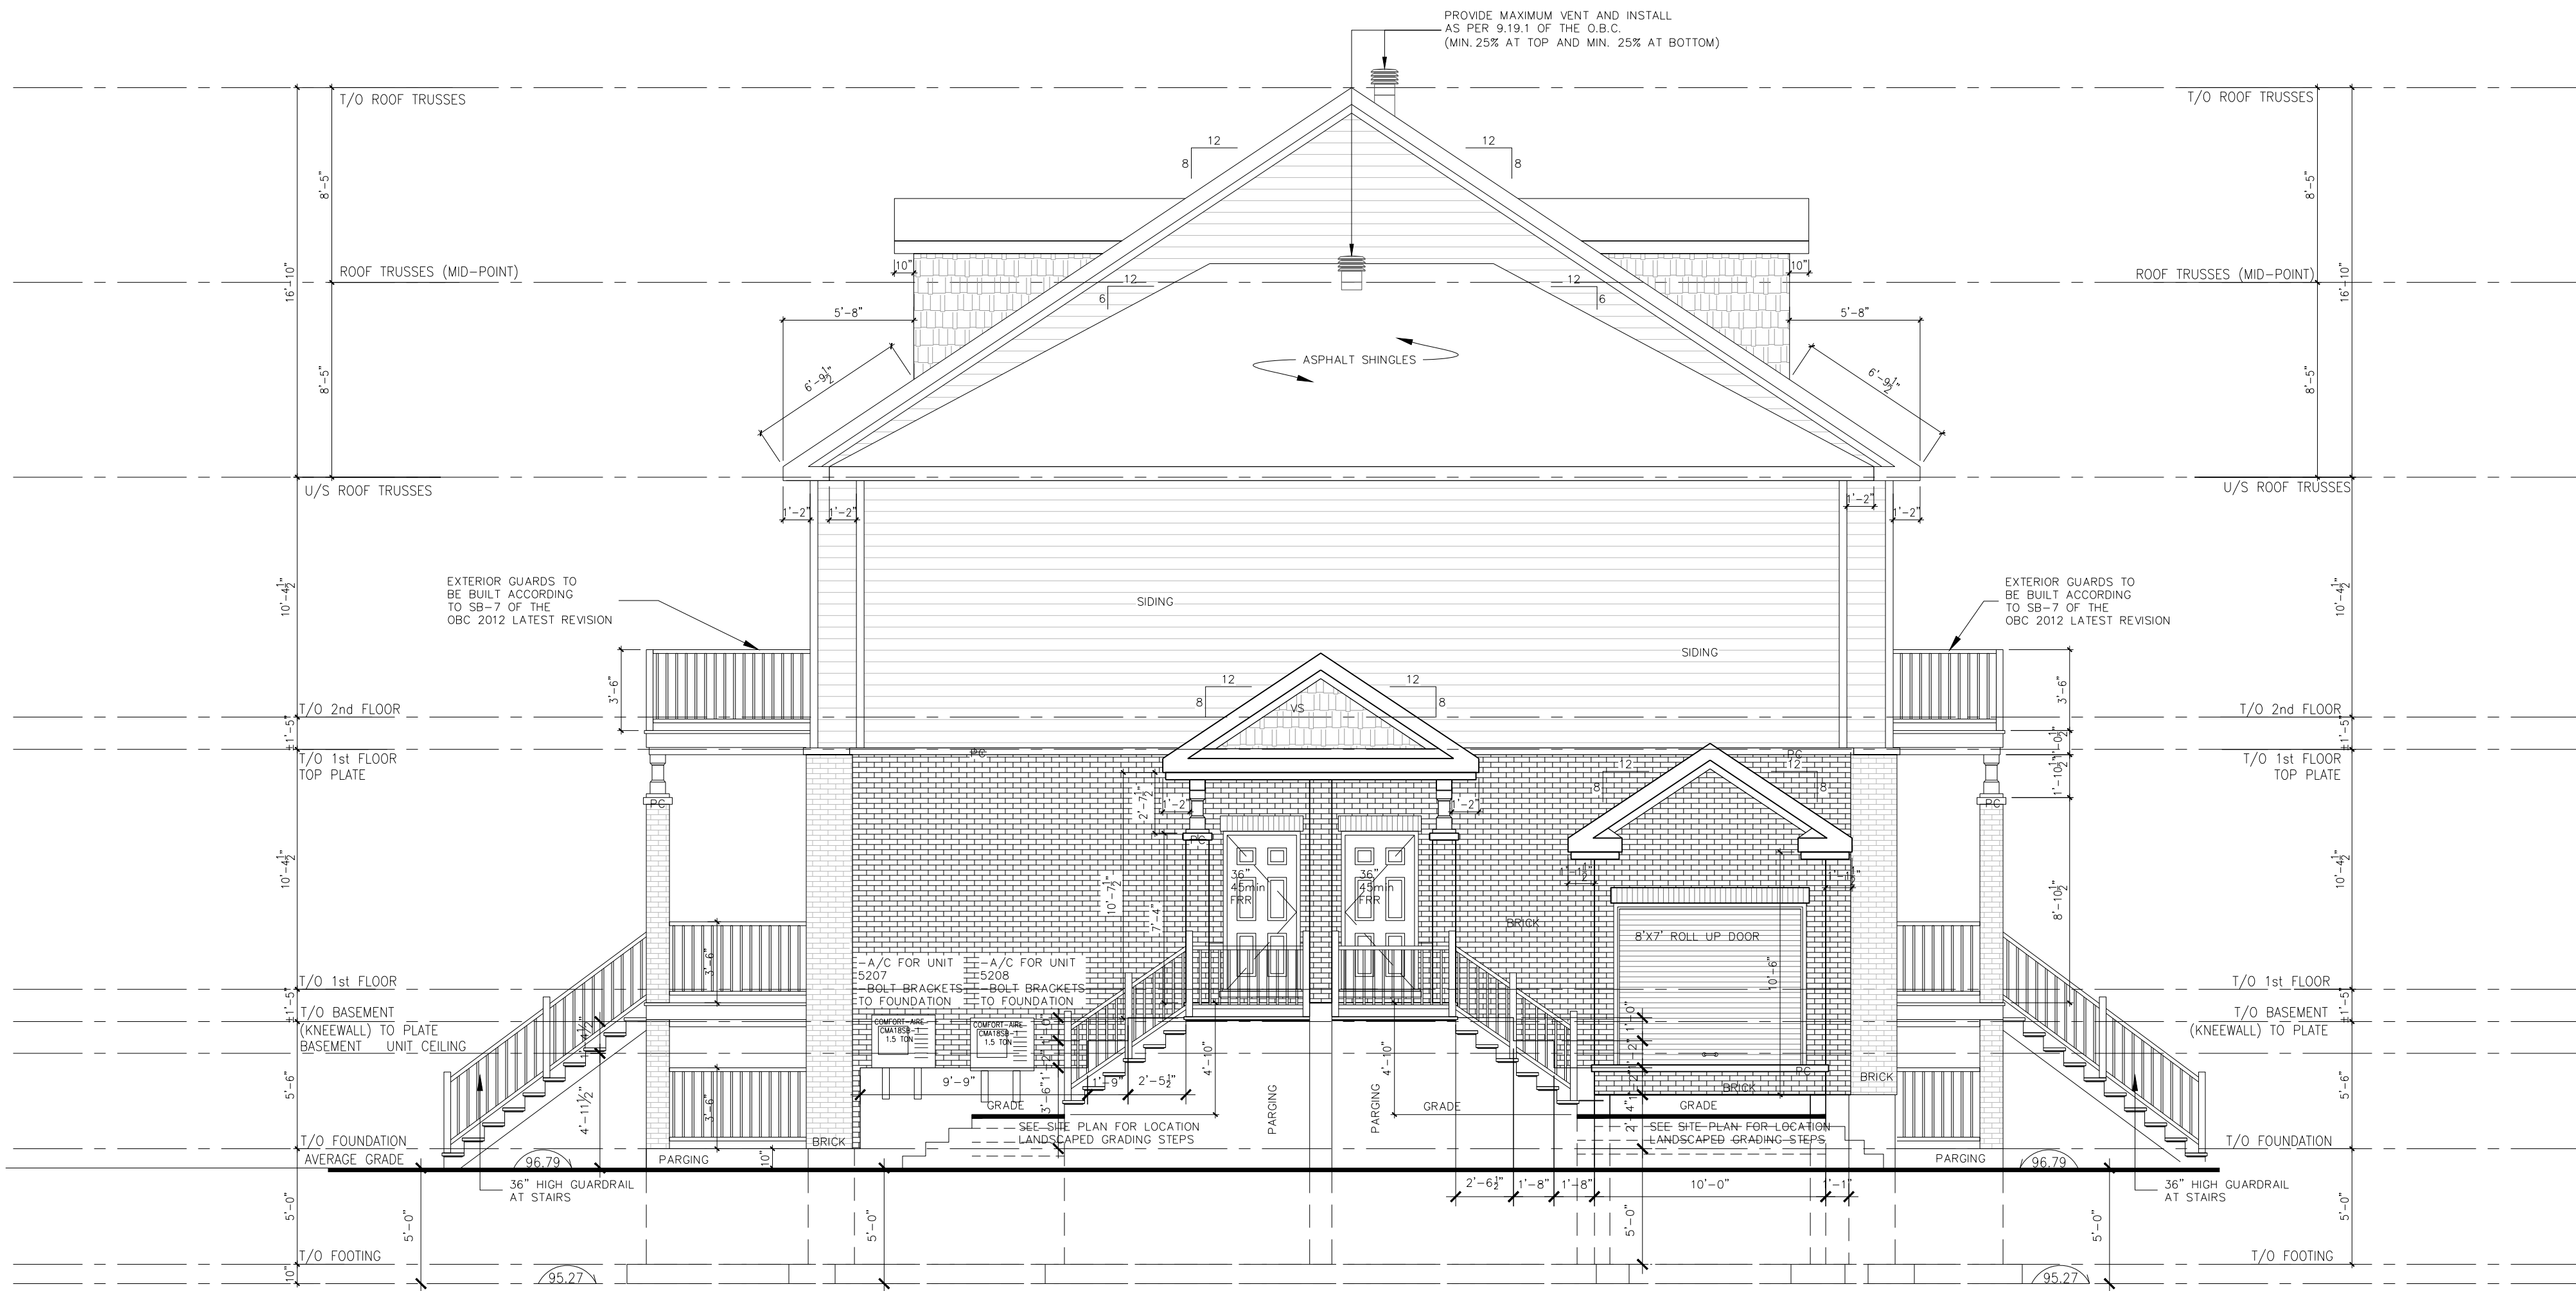

NORTH

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1


WITH
Valecraft
INCORPORATED

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE
10-11 AND ANY AMENDMENTS AND NOT SHOW ONLY SOME OF THE CHANGES
DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW
ALL ITEMS COVERED ON A SCHEDULE OR ANY OTHER ITEMS
NOTED THERE, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER
DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING
CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.
THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL
DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S
ARCHITECTURAL DEPARTMENT.
NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD
RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.



WEST

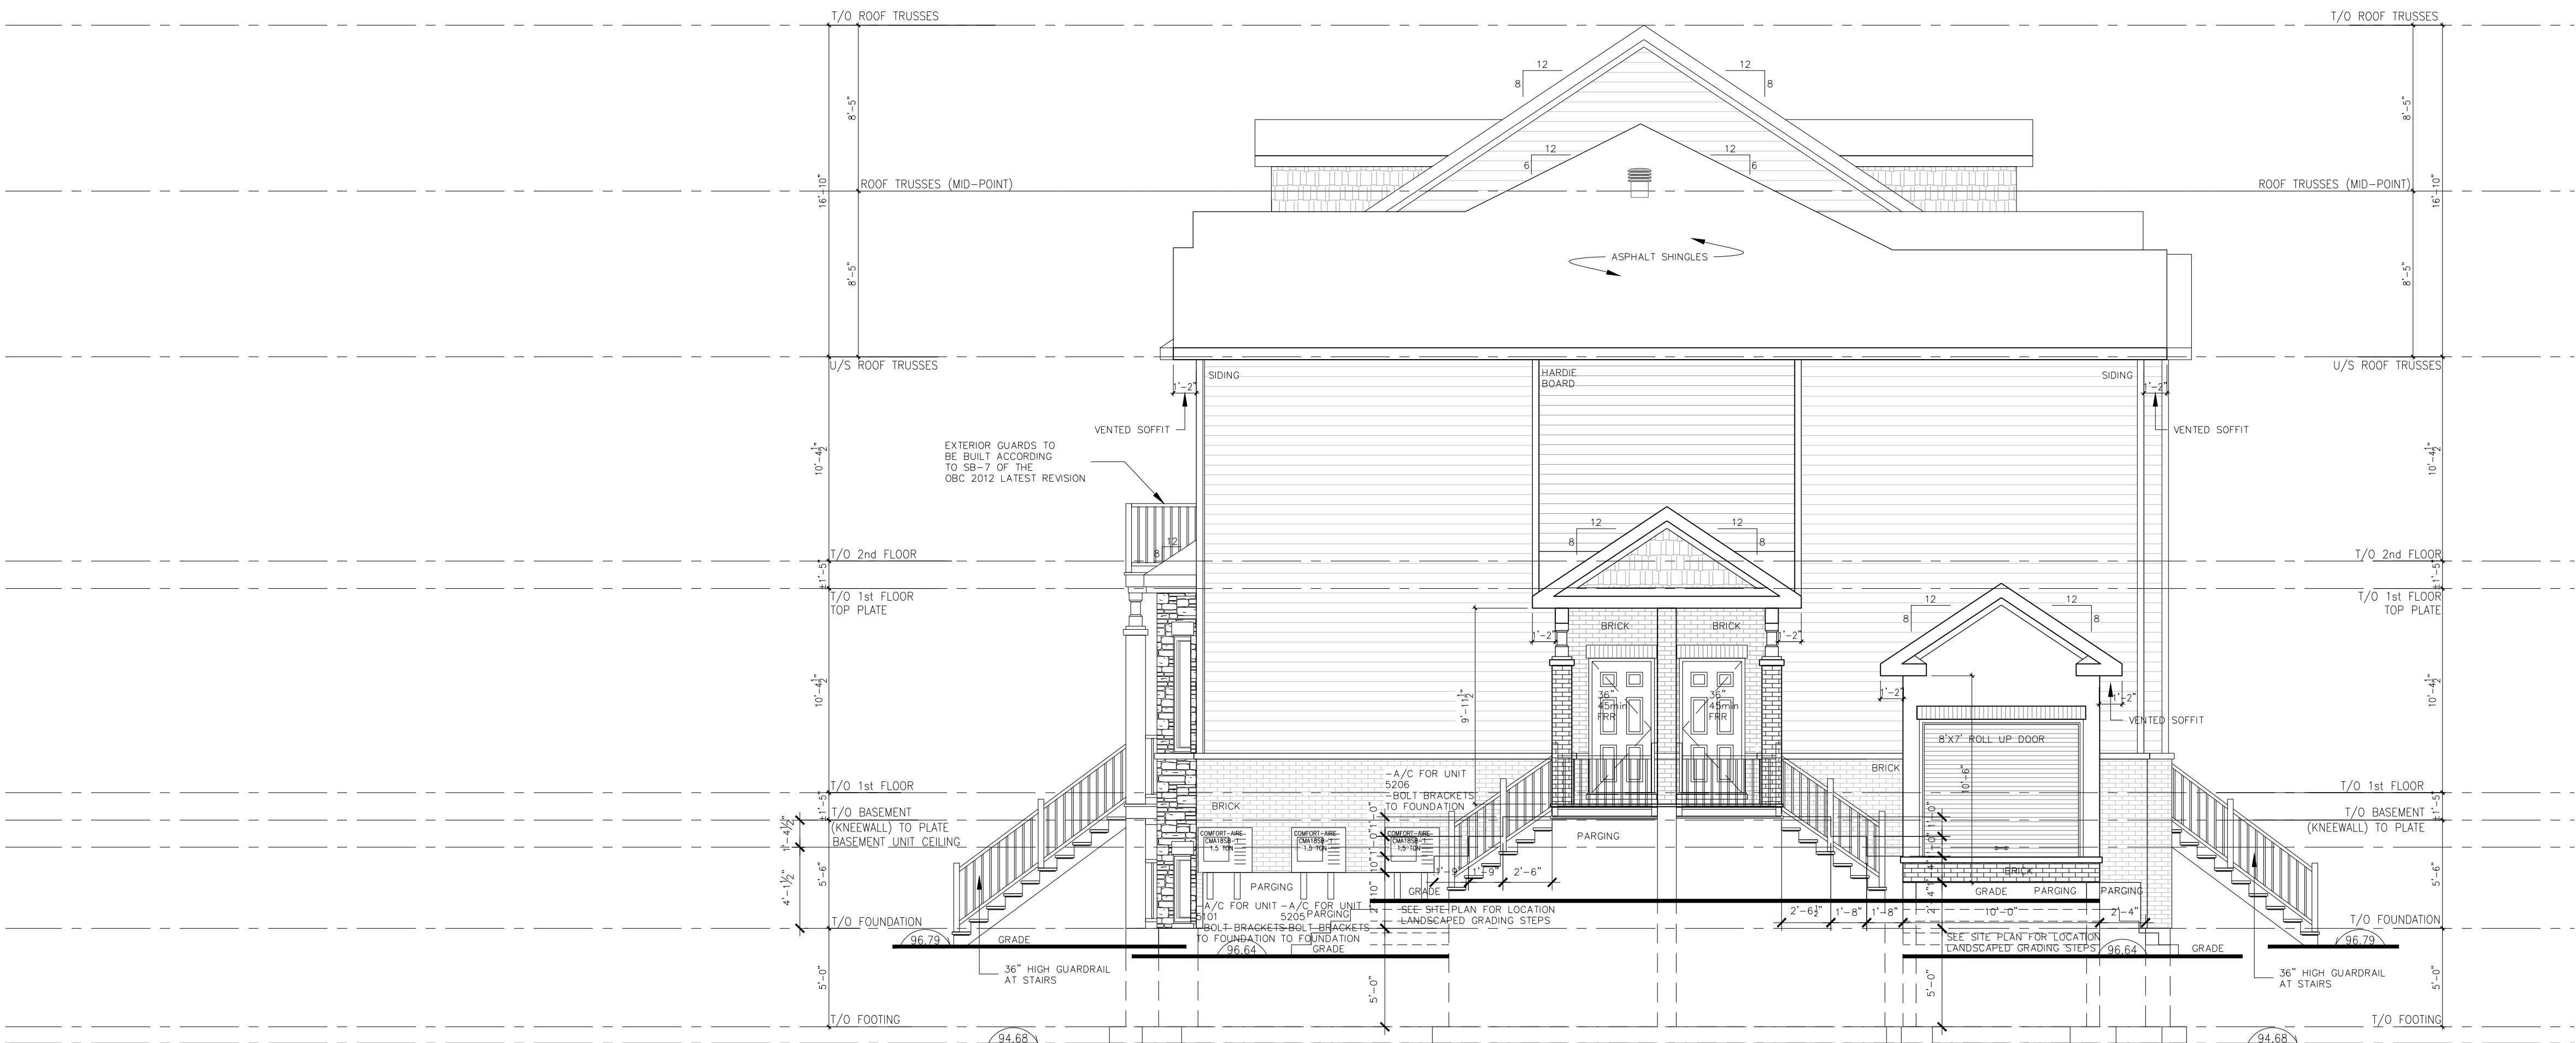

SOUTH

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH

Valecraft
INCORPORATED

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-11 AND ANY AMENDMENTS AND SHALL SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS COVERED ON A SCHEDULE OR ANY OTHER ITEMS, IT IS THE USER'S RESPONSIBILITY TO CONSULT THE SCHEDULE OR OTHER DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-4 REVISIONS TO SHEET WALLS

12/04/2020

AB

REV-3 AS PER STRUCTURAL

02/12/2020

AB

REV-2 1/2\"/>

DRAWING: ELEVATIONS

ADDRESS: 00

SCALE: 3/16\"/>

DATE: 10/02/2020

5000 SERIES -
DEERFIELD CONDOS

SHEET:
A109




ROOF AND FLOOR LAYOUT NOTES:

– ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER ORDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

NOTE: PROVIDE MINIMUM 2 ROWS OF "ICE AND WATER SHIELD MEMBRANE" AT ALL ROOF PERIMETER AND AT ALL ROOF VALLEY'S. ALL VALLEY'S TO BE COMPLETED WITH FLAT STOCK SHEET METAL.

NOTE: COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER AND PLING. IN OTHER CASE.

NOTE: COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH CLIENT AND MANUFACTURERS.

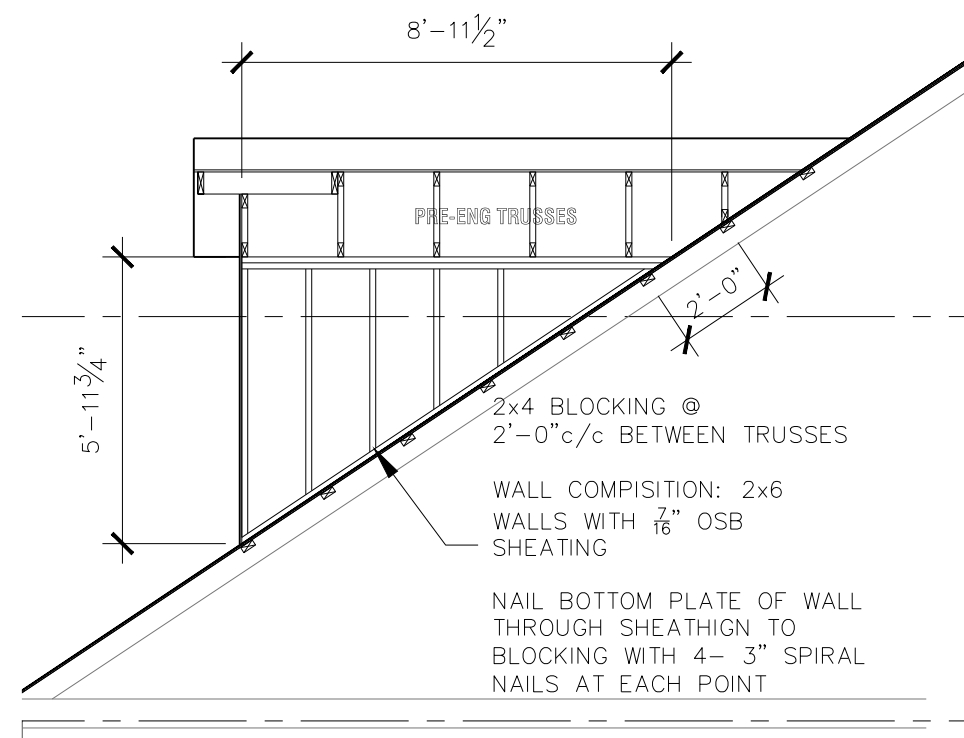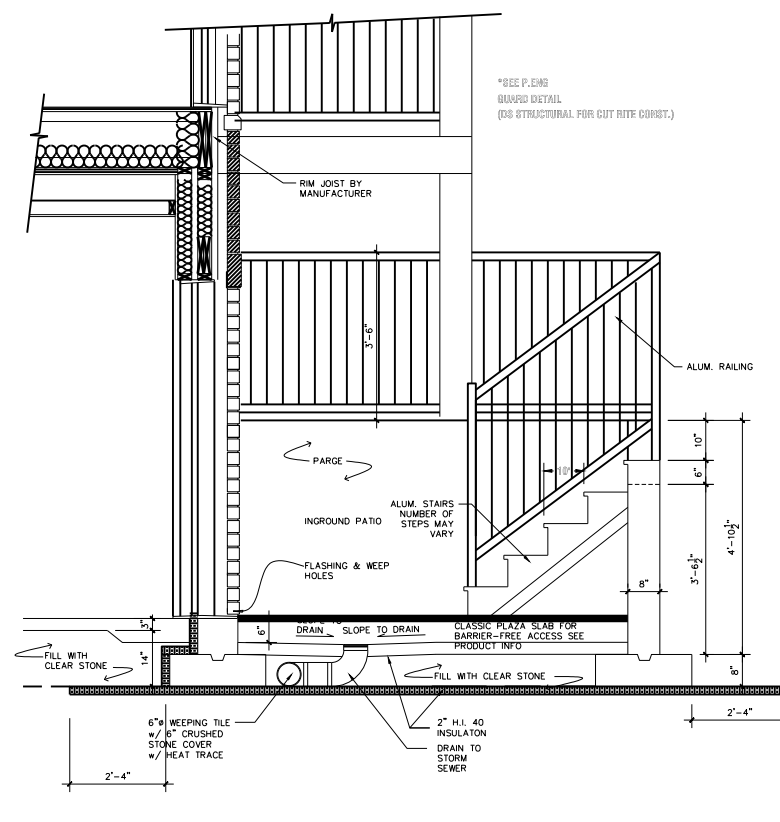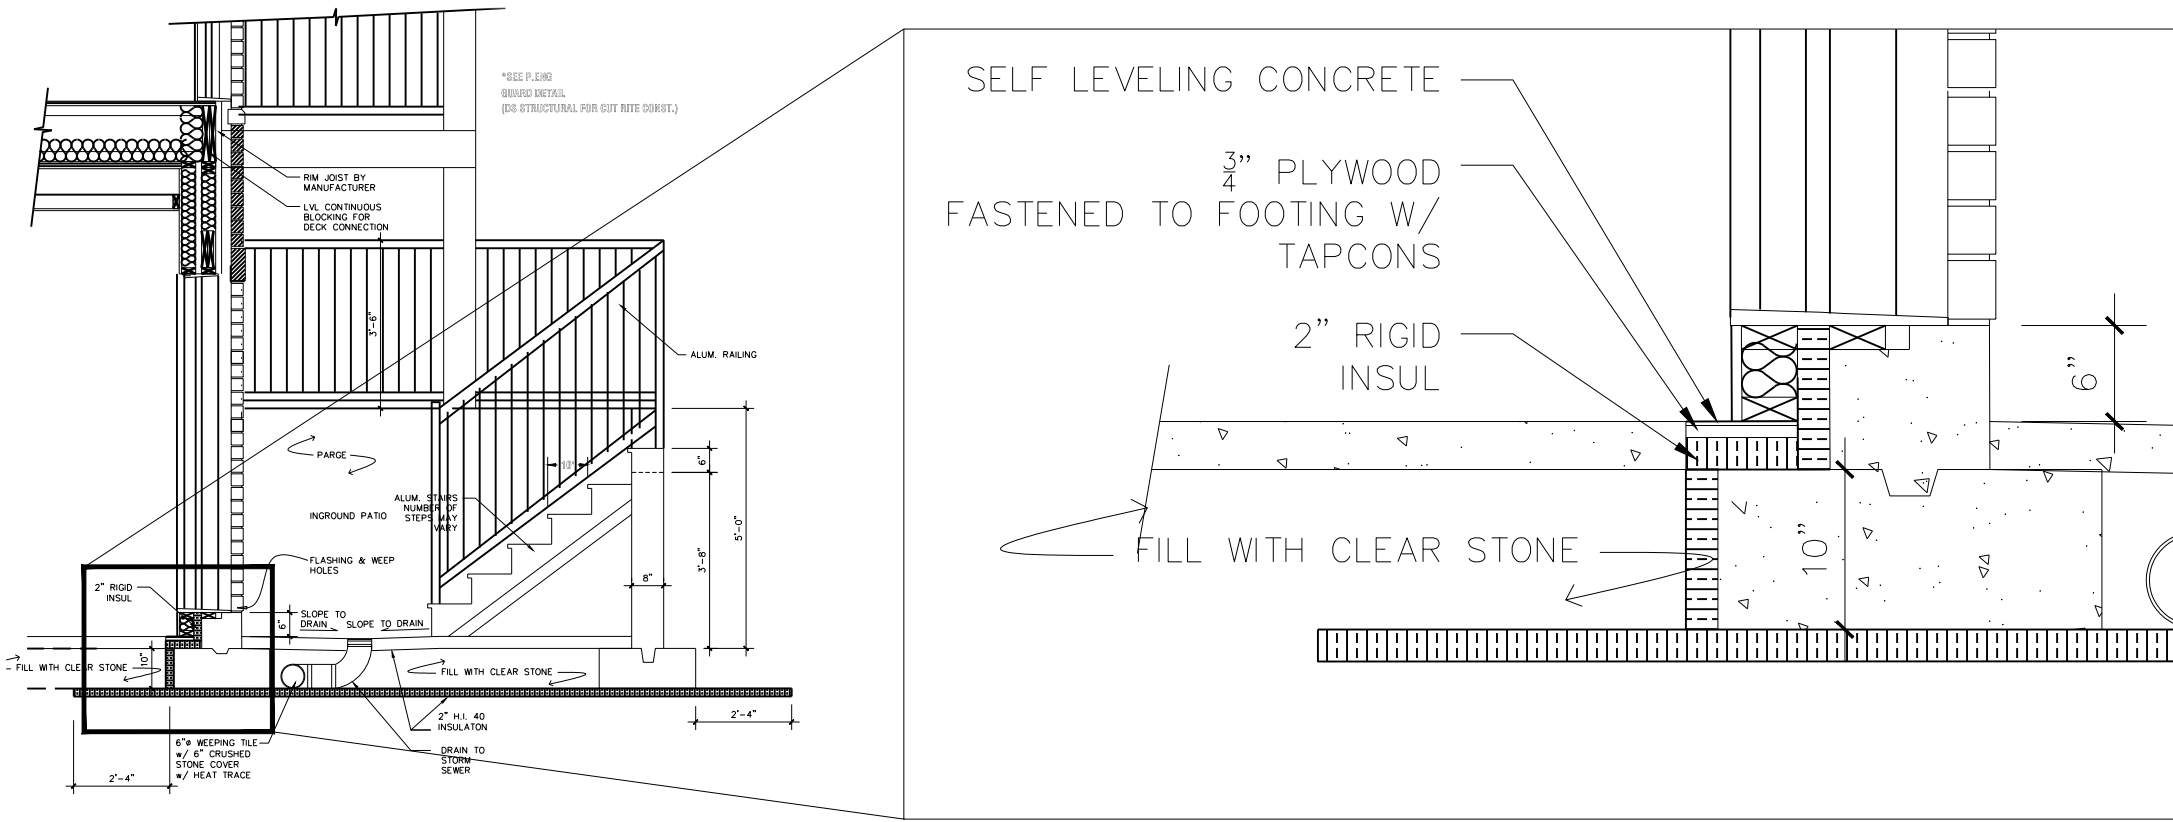

IP1 INGROUND PATIO @ UNITS 5101, 5102 & 5104


A110 SCALE: 1/4" = 1'-0"

IP2 INGROUND PATIO @ UNITS 5103 (BARRIER FREE)

A110 SCALE: 1/4" = 1'-0"


DR DORMER CONSTRUCTION

A110 SCALE: 1/4" = 1'-0"

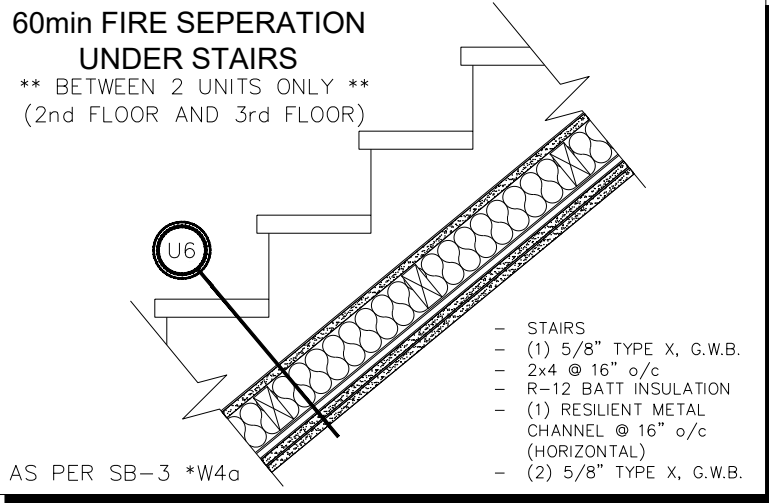

STAIR DETAIL - 60min FRR


SCALE: 3/4" = 1'-0"

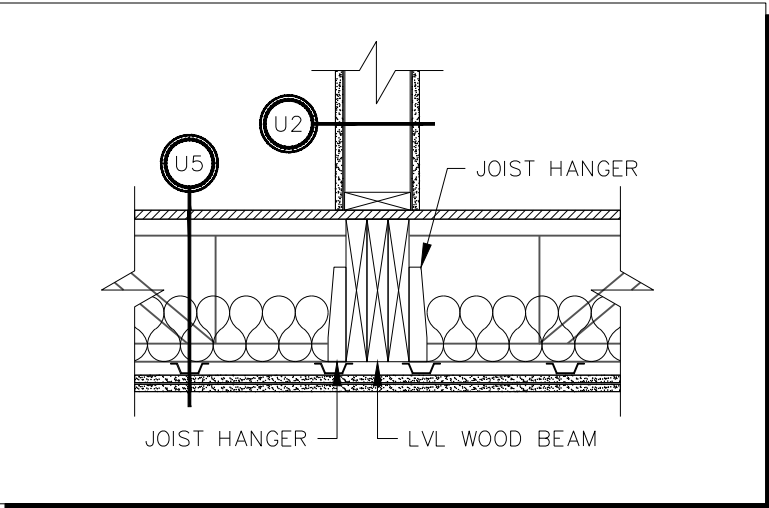

DETAIL - FLUSH BEAM


SCALE: 3/4" = 1'-0"

FIRE SEPARATION - INTERIOR WALL (60min FRR)

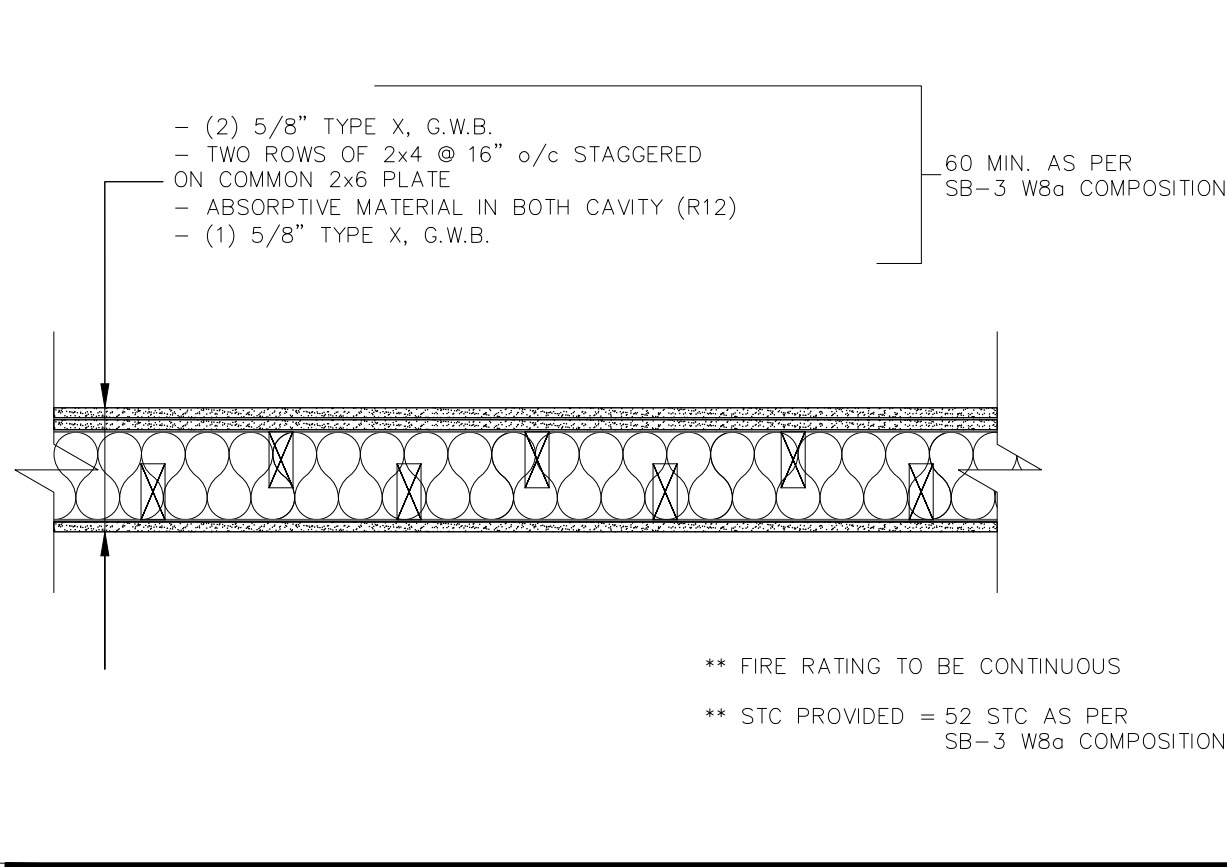

** FIRE RATING TO BE CONTINUOUS
** STC PROVIDED = 52 STC AS PER SB-3 W8a COMPOSITION

FIRE SEPARATION FLOOR (60min FRR)

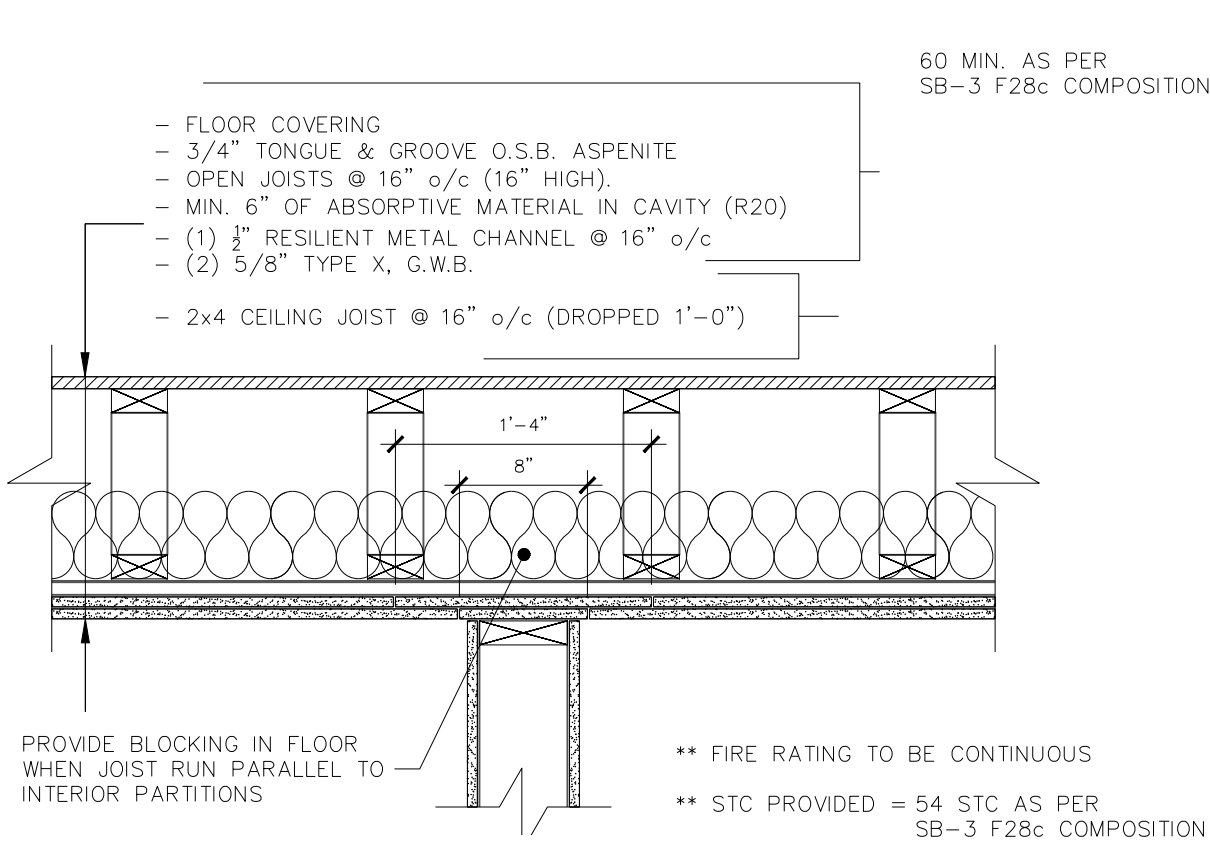


PROVIDE BLOCKING IN FLOOR WHEN JOIST RUN PARALLEL TO INTERIOR PARTITIONS
** FIRE RATING TO BE CONTINUOUS
** STC PROVIDED = 54 STC AS PER SB-3 F28c COMPOSITION

U4 - FIRE SEPARATION INTERIOR WALL BETWEEN UNITS

SCALE: 1" = 1'-0"

U5 - FLOOR SEPARATION - BETWEEN UNITS

SCALE: 1" = 1'-0"

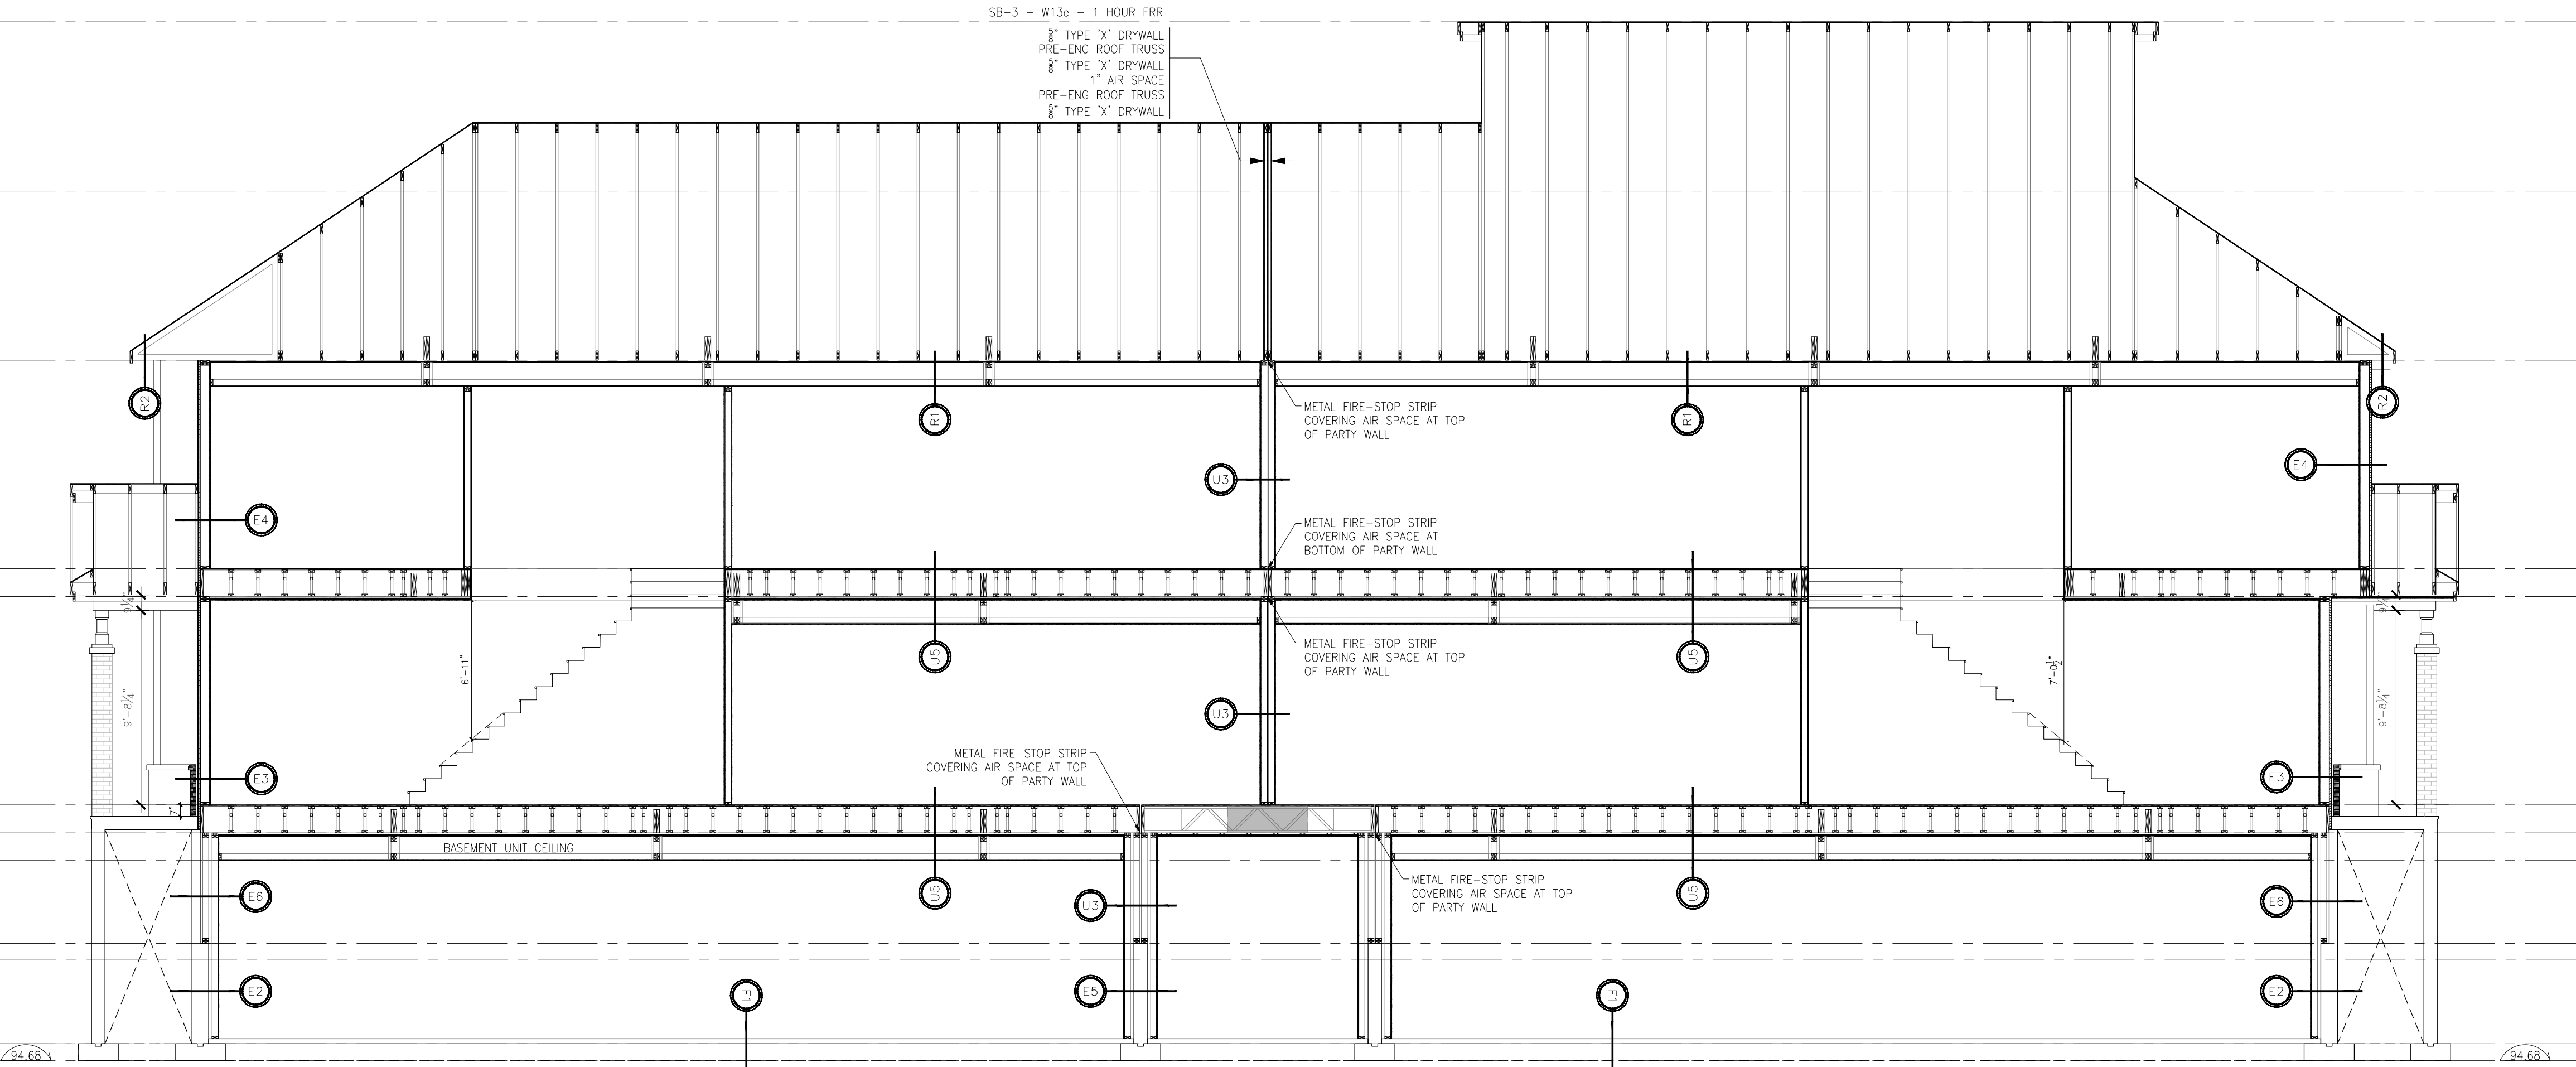

R1 ROOF - SB3 R1 45min FRR

- ASPHALT SINGLES (30 YEARS) c/w EAVE PROTECTION
- #15 ASPHALT SATURATED FELT
- 1/2" T&G ROOF SHEETING c/w "H" CLIPS
- PRE-FAB. ROOF TRUSSES, INSTALLED AT 24" o/c
- BLOWN INSULATION (R-60)
- 6 MIL VAPOUR BARRIER
- 1x4" WOOD FURRING @ 16" o/c
- 5/8" TYPE "X" DRYWALL
- 12" DROPPED CEILING – SEE DROPPED CEILING DETAIL
- 1/2" PAINTED REGULAR DRYWALL

R2 ROOF

- ASPHALT SINGLES (30 YEARS) c/w EAVE PROTECTION
- #15 ASPHALT SATURATED FELT
- 1/2" T&G ROOF SHEETING c/w "H" CLIPS
- PRE-FAB. ROOF TRUSSES, INSTALLED AT 24" o/c
- VENTED ALUMINIUM SOFFIT

I1 INTERIOR WALL - 2x4

- 1/2" PAINTED REGULAR DRYWALL
- 2x4 @ 16" o/c c/w SOUND INSULATION (COORD. THE NEED WITH CLIENT)
- 1/2" PAINTED REGULAR DRYWALL

• PROVIDE MOLD RESISTANT DRYWALL IN W.C.

I2 INTERIOR WALL - 2x6

- 1/2" PAINTED REGULAR DRYWALL
- 2x6 @ 16" o/c c/w SOUND INSULATION (COORD. THE NEED WITH CLIENT)
- 1/2" PAINTED REGULAR DRYWALL

• PROVIDE MOLD RESISTANT DRYWALL IN W.C.

F1 BASEMENT FLOOR SLAB

- 3" CONCRETE FLOOR SLAB AND 6 MIL V-B.
- 2" (R10) RIGID INSULATION (BASEMENT ENTRANCE)
- 10" OF 7/8" MINUS MATERIAL
- UNDISTURBED SOIL OR COMPACTED SOIL TO 95% PROCTOR

• SOIL TO BE 75kPa, PROVIDE SOIL TEST REPORT

F2 FLOOR - HOUSE/EXTERIOR

- 3/8" UNDERLAY FOR CERAMIC
- 3/4" FLOOR SHEETING (ASPENITE)
- 6 MIL VAPOUR BARRIER
- OPEN-WEB WOOD JOIST 16" HIGH @ 16" o/c
- NAILED AND GLUED c/w MID-SPAN BRIDGING
- LIVE LOAD 40 • DEAD LOAD 15
- BATT INSULATION (R40)
- 7/16" EXTERIOR SHEETING (ASPENITE)
- 5/8" EXTERIOR FIRE RATED G.W.B. (DENS GLASS)
- TYP. TYVEK OR EQUIVALENT, c/w SEALED JOINTS WITH PROPER TAPE
- UN-VENTED ALUMINIUM SOFFIT

S1 SILL PLATE

- 2x6 SILL PLATE c/w SILL GASKET
- 1/2" DIA. ANCHOR BOLTS @ 72" o/c MAX.

E6 EXTERIOR FOUNDATION WALL

- 2x4 @ 16" o/c KNEE WALL c/w R-12 BATT INSULATION
- 2x4 @ 16" o/c c/w R-12 BATT INSULATION & 2" CLOSED CELL SPRAY FOAM
- 5/8" PAINTED, TYPE X, DRYWALL – 1hr FRR

E5 FOUNDATION WALL - BETWEEN UNIT

- 5/8" PAINTED, TYPE X, DRYWALL
- 2x4 @ 16" o/c c/w BATT INSULATION (R-12)
- 8" POURED CONCRETE FOUNDATION WALL
- 2x4 @ 16" o/c c/w BATT INSULATION (R-12)
- 5/8" PAINTED, TYPE X, DRYWALL

E1 EXTERIOR FOUNDATION WALL

- PARING (SAND FINISH) ABOVE GRADE
- 8", 10" OR 12" POURED CONCRETE FOUND. WALL

E2 EXTERIOR FOUNDATION WALL

- PARING (SAND FINISH) ABOVE GRADE
- DRAINAGE LAYER, TYP. DELTA-MS OR EQUIVALENT
- 2 COATS OF DAMPROOFING BELOW GRADE
- 8", 10" OR 12" POURED CONCRETE FOUNDATION WALL
- 2x4 @ 16" o/c c/w R-12 BATT INSULATION & 2" CLOSED CELL SPRAY FOAM
- 5/8" PAINTED, TYPE X, DRYWALL – 1 hr FRR

E3 EXTERIOR FINISH - STONE/BRICK

- STONE/BRICK, COORD. COLOR WITH CLIENT
- 1" AIR SPACE c/w WEEP-HOLES @ 2'-7" o/c MAX.
- TYP. TYVEK OR EQUIVALENT, c/w SEALED JOINTS WITH PROPER TAPE
- R5.6 WALL SHEETING = 1-9/16" THICKNESS (R-5) (7/16" ASPENITE + 1-1/8" RIGID INSULATION)
- 2x6 @ 16" o/c c/w BATT INSULATION (R-20)
- 6 MIL VAPOUR BARRIER
- 5/8" PAINTED, TYPE X, DRYWALL – 1hr FRR

• PROVIDE MOLD RESISTANT DRYWALL IN W.C.

E4 EXTERIOR FINISH - SIDING/CANEXEL

- EXTERIOR HORIZONTAL SIDING c/w PROPER FURRING AS PER MANUFACTURER (SEE LOCATION ON ELEVATIONS)
- TYP. TYVEK OR EQUIVALENT, c/w SEALED JOINTS WITH PROPER TAPE
- R5.6 WALL SHEETING = 1-9/16" THICKNESS (R-5) (7/16" ASPENITE + 1-1/8" RIGID INSULATION)
- 2x6 @ 16" o/c c/w BATT INSULATION (R-20)
- 6 MIL VAPOUR BARRIER
- 5/8" PAINTED, TYPE X, DRYWALL

• PROVIDE MOLD RESISTANT DRYWALL IN W.C.

U1 INTERIOR WALL - 2x4

- 1" DRYWALL
- 2x4 @ 16" o/c
- 1" PAINTED DRYWALL
- PROVIDE MOLD RESISTANT DRYWALL IN W.C.

U2 INTERIOR WALL - 2x6

- 1" DRYWALL
- 2x6 @ 16" o/c
- 1" DRYWALL
- PROVIDE MOLD RESISTANT DRYWALL IN W.C.

U3 PARTY WALL - W13a - 60 MIN. F.R.R.

- 5/8" PAINTED, TYPE X, DRYWALL
- 2x4 @ 16" o/c ON SEPARATE PLATES (1" APART) c/w BATT INSULATION (R-12)
- 5/8" TYPE X DRYWALL
- 2x4 @ 16" o/c ON SEPARATE PLATES (1" APART) c/w BATT INSULATION (R-12)
- 5/8" PAINTED, TYPE X, DRYWALL
- WALL TO BE CONSTRUCTED FROM FOUNDATION WALL TO THE UNDERSIDE OF THE ROOF TRUSSES
- AT FLOOR RIMBOARDS, PROVIDE 2x 1/2" TYPE X DRYWALL IN 1" AIR SPACE (2'-0" WIDE MINIMUM)

U4 INTERIOR WALL - FIRE SEPARATION

SEE DETAIL ON DRAWING A-110

U5 INTERIOR FLOOR - GENERAL

SEE DETAIL ON DRAWING A-110

U6 INTERIOR - STAIRS

SEE DETAIL ON DRAWING A-110

U7 PORCH FIRE SEPARATION WALL

- MASONRY VENEER
- 1" AIR SPACE
- 8" TYPE "X" DRYWALL
- 2x4 STUD WALL
- 8" TYPE "X" DRYWALL
- 1" AIR SPACE
- MASONRY VENEER

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHESBROOK STREET E
PERTH, ON, K7H 1A1

WITH
Valecraft
DESIGN LTD.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE 10-16 AND ANY AMENDMENTS AND SHALL SHOW ONLY ONE OF THE CHANGES DETAILED ON THIS DOCUMENT. SCHEDULES 10-16 AND 10-17 SHALL NOT SHOW ALL CHANGES DETAILED ON A SCHEDULE OR AMENDMENT OTHER THAN THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER COVERED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO ALCOMIT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

NOTES:

STEEL LINTEL:

- S1 = L 80x6x6
- S2 = L 80x6x6
- S3 = L 100x6x8
- S4 = L 120x6x8
- S5 = L 120x6x8
- S6 = L 200x10x12
- S7 = L 200x10x12 (8" BEARING)

LINTEL TABLE:

- L1 = 2'-2 1/2" + P3 ON BOTH SIDES
- L2 = 2'-2 1/2" + P3 ON BOTH SIDES
- L3 = 2'-1 7/8" + L3 (1.92) + P3 ON BOTH SIDES
- L4 = 2'-1 7/8" + L3 (1.92) + P3 ON BOTH SIDES

• IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER

POST TABLE:

- P1 = 3" ADJUSTABLE STEEL COLUMN
- P1a = HEAVY DUTY, TYPE 2, ADJUSTABLE RED JACK POST 3' HGT.
- P2 = 3'-2 1/4" OR 3'-2 1/4"
- P3 = 3'-2 1/4" OR 3'-2 1/4"
- P4 = 3'-2 1/4" OR 3'-2 1/4"
- P5 = 3'-2 1/4" OR 3'-2 1/4"
- P6 = 3'-2 1/4" OR 3'-2 1/4"
- P7 = 3'-2 1/4" OR 3'-2 1/4"
- P8 = 3'-2 1/4" OR 3'-2 1/4"
- P9 = 3'-2 1/4" OR 3'-2 1/4"
- P10 = 3'-2 1/4" OR 3'-2 1/4"
- P11 = 3'-2 1/4" OR 3'-2 1/4"
- P12 = 3'-2 1/4" OR 3'-2 1/4"
- P13 = 3'-2 1/4" OR 3'-2 1/4"
- P14 = 3'-2 1/4" OR 3'-2 1/4"
- P15 = 3'-2 1/4" OR 3'-2 1/4"
- P16 = 3'-2 1/4" OR 3'-2 1/4"
- P17 = 3'-2 1/4" OR 3'-2 1/4"
- P18 = 3'-2 1/4" OR 3'-2 1/4"
- P19 = 3'-2 1/4" OR 3'-2 1/4"
- P20 = 3'-2 1/4" OR 3'-2 1/4"
- P21 = 3'-2 1/4" OR 3'-2 1/4"
- P22 = 3'-2 1/4" OR 3'-2 1/4"
- P23 = 3'-2 1/4" OR 3'-2 1/4"
- P24 = 3'-2 1/4" OR 3'-2 1/4"
- P25 = 3'-2 1/4" OR 3'-2 1/4"
- P26 = 3'-2 1/4" OR 3'-2 1/4"
- P27 = 3'-2 1/4" OR 3'-2 1/4"
- P28 = 3'-2 1/4" OR 3'-2 1/4"
- P29 = 3'-2 1/4" OR 3'-2 1/4"
- P30 = 3'-2 1/4" OR 3'-2 1/4"
- P31 = 3'-2 1/4" OR 3'-2 1/4"
- P32 = 3'-2 1/4" OR 3'-2 1/4"
- P33 = 3'-2 1/4" OR 3'-2 1/4"
- P34 = 3'-2 1/4" OR 3'-2 1/4"
- P35 = 3'-2 1/4" OR 3'-2 1/4"
- P36 = 3'-2 1/4" OR 3'-2 1/4"
- P37 = 3'-2 1/4" OR 3'-2 1/4"
- P38 = 3'-2 1/4" OR 3'-2 1/4"
- P39 = 3'-2 1/4" OR 3'-2 1/4"
- P40 = 3'-2 1/4" OR 3'-2 1/4"
- P41 = 3'-2 1/4" OR 3'-2 1/4"
- P42 = 3'-2 1/4" OR 3'-2 1/4"
- P43 = 3'-2 1/4" OR 3'-2 1/4"
- P44 = 3'-2 1/4" OR 3'-2 1/4"
- P45 = 3'-2 1/4" OR 3'-2 1/4"
- P46 = 3'-2 1/4" OR 3'-2 1/4"
- P47 = 3'-2 1/4" OR 3'-2 1/4"
- P48 = 3'-2 1/4" OR 3'-2 1/4"
- P49 = 3'-2 1/4" OR 3'-2 1/4"
- P50 = 3'-2 1/4" OR 3'-2 1/4"
- P51 = 3'-2 1/4" OR 3'-2 1/4"
- P52 = 3'-2 1/4" OR 3'-2 1/4"
- P53 = 3'-2 1/4" OR 3'-2 1/4"
- P54 = 3'-2 1/4" OR 3'-2 1/4"
- P55 = 3'-2 1/4" OR 3'-2 1/4"
- P56 = 3'-2 1/4" OR 3'-2 1/4"
- P57 = 3'-2 1/4" OR 3'-2 1/4"
- P58 = 3'-2 1/4" OR 3'-2 1/4"
- P59 = 3'-2 1/4" OR 3'-2 1/4"
- P60 = 3'-2 1/4" OR 3'-2 1/4"
- P61 = 3'-2 1/4" OR 3'-2 1/4"
- P62 = 3'-2 1/4" OR 3'-2 1/4"
- P63 = 3'-2 1/4" OR 3'-2 1/4"
- P64 = 3'-2 1/4" OR 3'-2 1/4"
- P65 = 3'-2 1/4" OR 3'-2 1/4"
- P66 = 3'-2 1/4" OR 3'-2 1/4"
- P67 = 3'-2 1/4" OR 3'-2 1/4"
- P68 = 3'-2 1/4" OR 3'-2 1/4"
- P69 = 3'-2 1/4" OR 3'-2 1/4"
- P70 = 3'-2 1/4" OR 3'-2 1/4"
- P71 = 3'-2 1/4" OR 3'-2 1/4"
- P72 = 3'-2 1/4" OR 3'-2 1/4"
- P73 = 3'-2 1/4" OR 3'-2 1/4"
- P74 = 3'-2 1/4" OR 3'-2 1/4"
- P75 = 3'-2 1/4" OR 3'-2 1/4"
- P76 = 3'-2 1/4" OR 3'-2 1/4"
- P77 = 3'-2 1/4" OR 3'-2 1/4"
- P78 = 3'-2 1/4" OR 3'-2 1/4"
- P79 = 3'-2 1/4" OR 3'-2 1/4"
- P80 = 3'-2 1/4" OR 3'-2 1/4"
- P81 = 3'-2 1/4" OR 3'-2 1/4"
- P82 = 3'-2 1/4" OR 3'-2 1/4"
- P83 = 3'-2 1/4" OR 3'-2 1/4"
- P84 = 3'-2 1/4" OR 3'-2 1/4"
- P85 = 3'-2 1/4" OR 3'-2 1/4"
- P86 = 3'-2 1/4" OR 3'-2 1/4"
- P87 = 3'-2 1/4" OR 3'-2 1/4"
- P88 = 3'-2 1/4" OR 3'-2 1/4"
- P89 = 3'-2 1/4" OR 3'-2 1/4"
- P90 = 3'-2 1/4" OR 3'-2 1/4"
- P91 = 3'-2 1/4" OR 3'-2 1/4"
- P92 = 3'-2 1/4" OR 3'-2 1/4"
- P93 = 3'-2 1/4" OR 3'-2 1/4"
- P94 = 3'-2 1/4" OR 3'-2 1/4"
- P95 = 3'-2 1/4" OR 3'-2 1/4"
- P96 = 3'-2 1/4" OR 3'-2 1/4"
- P97 = 3'-2 1/4" OR 3'-2 1/4"
- P98 = 3'-2 1/4" OR 3'-2 1/4"
- P99 = 3'-2 1/4" OR 3'-2 1/4"
- P100 = 3'-2 1/4" OR 3'-2 1/4"

POST ARE ALL JACK c/w STUD

(E6, P2 = 1" JACK + 1" STUD)

• IF NO POST ARE MENTIONED ON PLANS, PROVIDE MIN. A "90"

- SMOKE ALARMS AS PER SECTION 9.10.16 OF THE ONTARIO BUILDING CODE:
 - SHALL HAVE A BATTERY BACKUP SUPPLY
 - ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY
 - ARE REQUIRED ON EACH FLOOR, INCLUDING BASEMENT
 - ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWING BY A MINUTE OF ALARM AND
 - CANNOT BE LOCATED IN A SLEEPING AREA
- PROVIDE MECHANICAL EXHAUST TO OUTSIDE

NOTE:

STRUCTURAL SHEAR WALL COMPONENTS TO BE ADDED TO SPECIFIED WALLS AS SHOWN ON SHEETS SW1, SW2 AND SW3

2012 O.B.C. DRAWINGS


REV.	DESCRIPTION	DATE
REV-4	REVISIONS TO SHEAR WALLS	10/04/2020 JAB
REV-3	AS PER STRUCTURAL	02/12/2020 JAB
REV-4	1/2" INCREASE IN NEW EAVE PROFILES	17/02/2019 JAB
REV-5	AS PER OBC & REMOVED WARDROBE	12/15/2019 JAB
REV-6	AS PER STRUCTURAL	06/02/2019 JAB
REV-7	ISSUED FOR TENDER	07/09/2018 JAB
REV-2	NEW STANDARD DOWEL MODIFICATION	07/06/2018 JAB
REV-1	NEW STANDARD DOWEL MODIFICATION	10/25/2018 JAB
NO.	DESCRIPTION	DATE


INFORMATION - PROJECT

ADDRESS:	SCALE:	DATE:
88	3/16" = 1'-0"	02/18/2021

5000 SERIES - DEERFIELD CONDOS

110

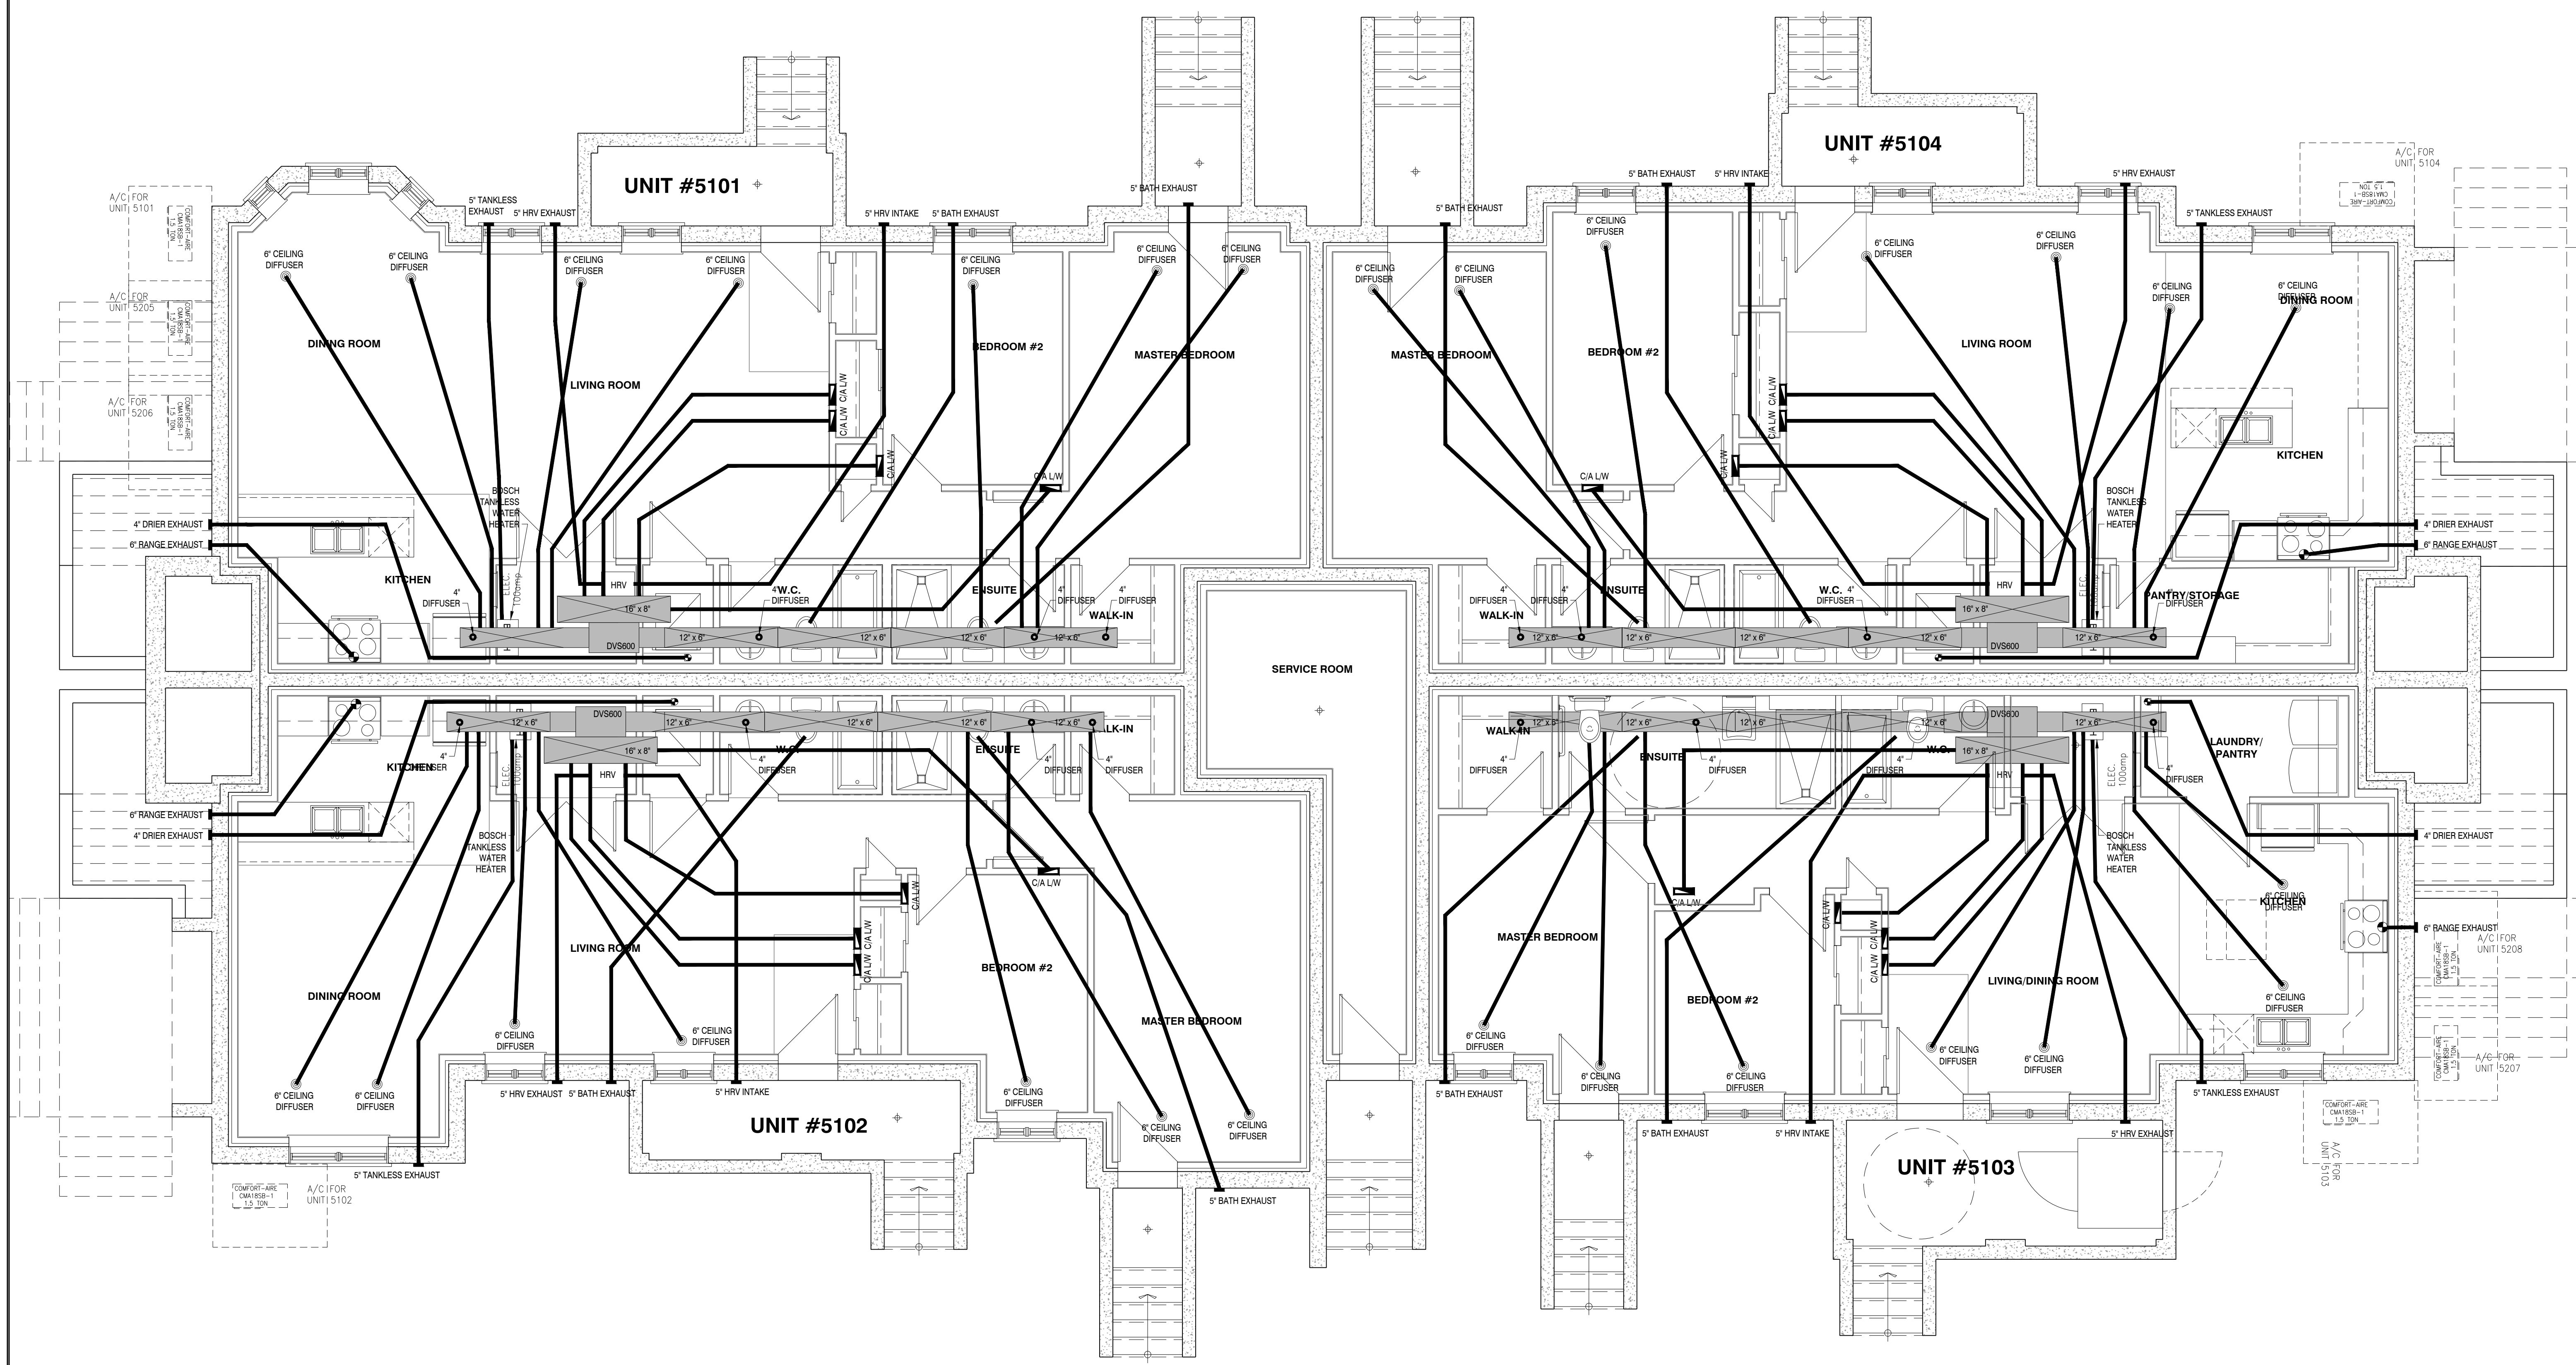

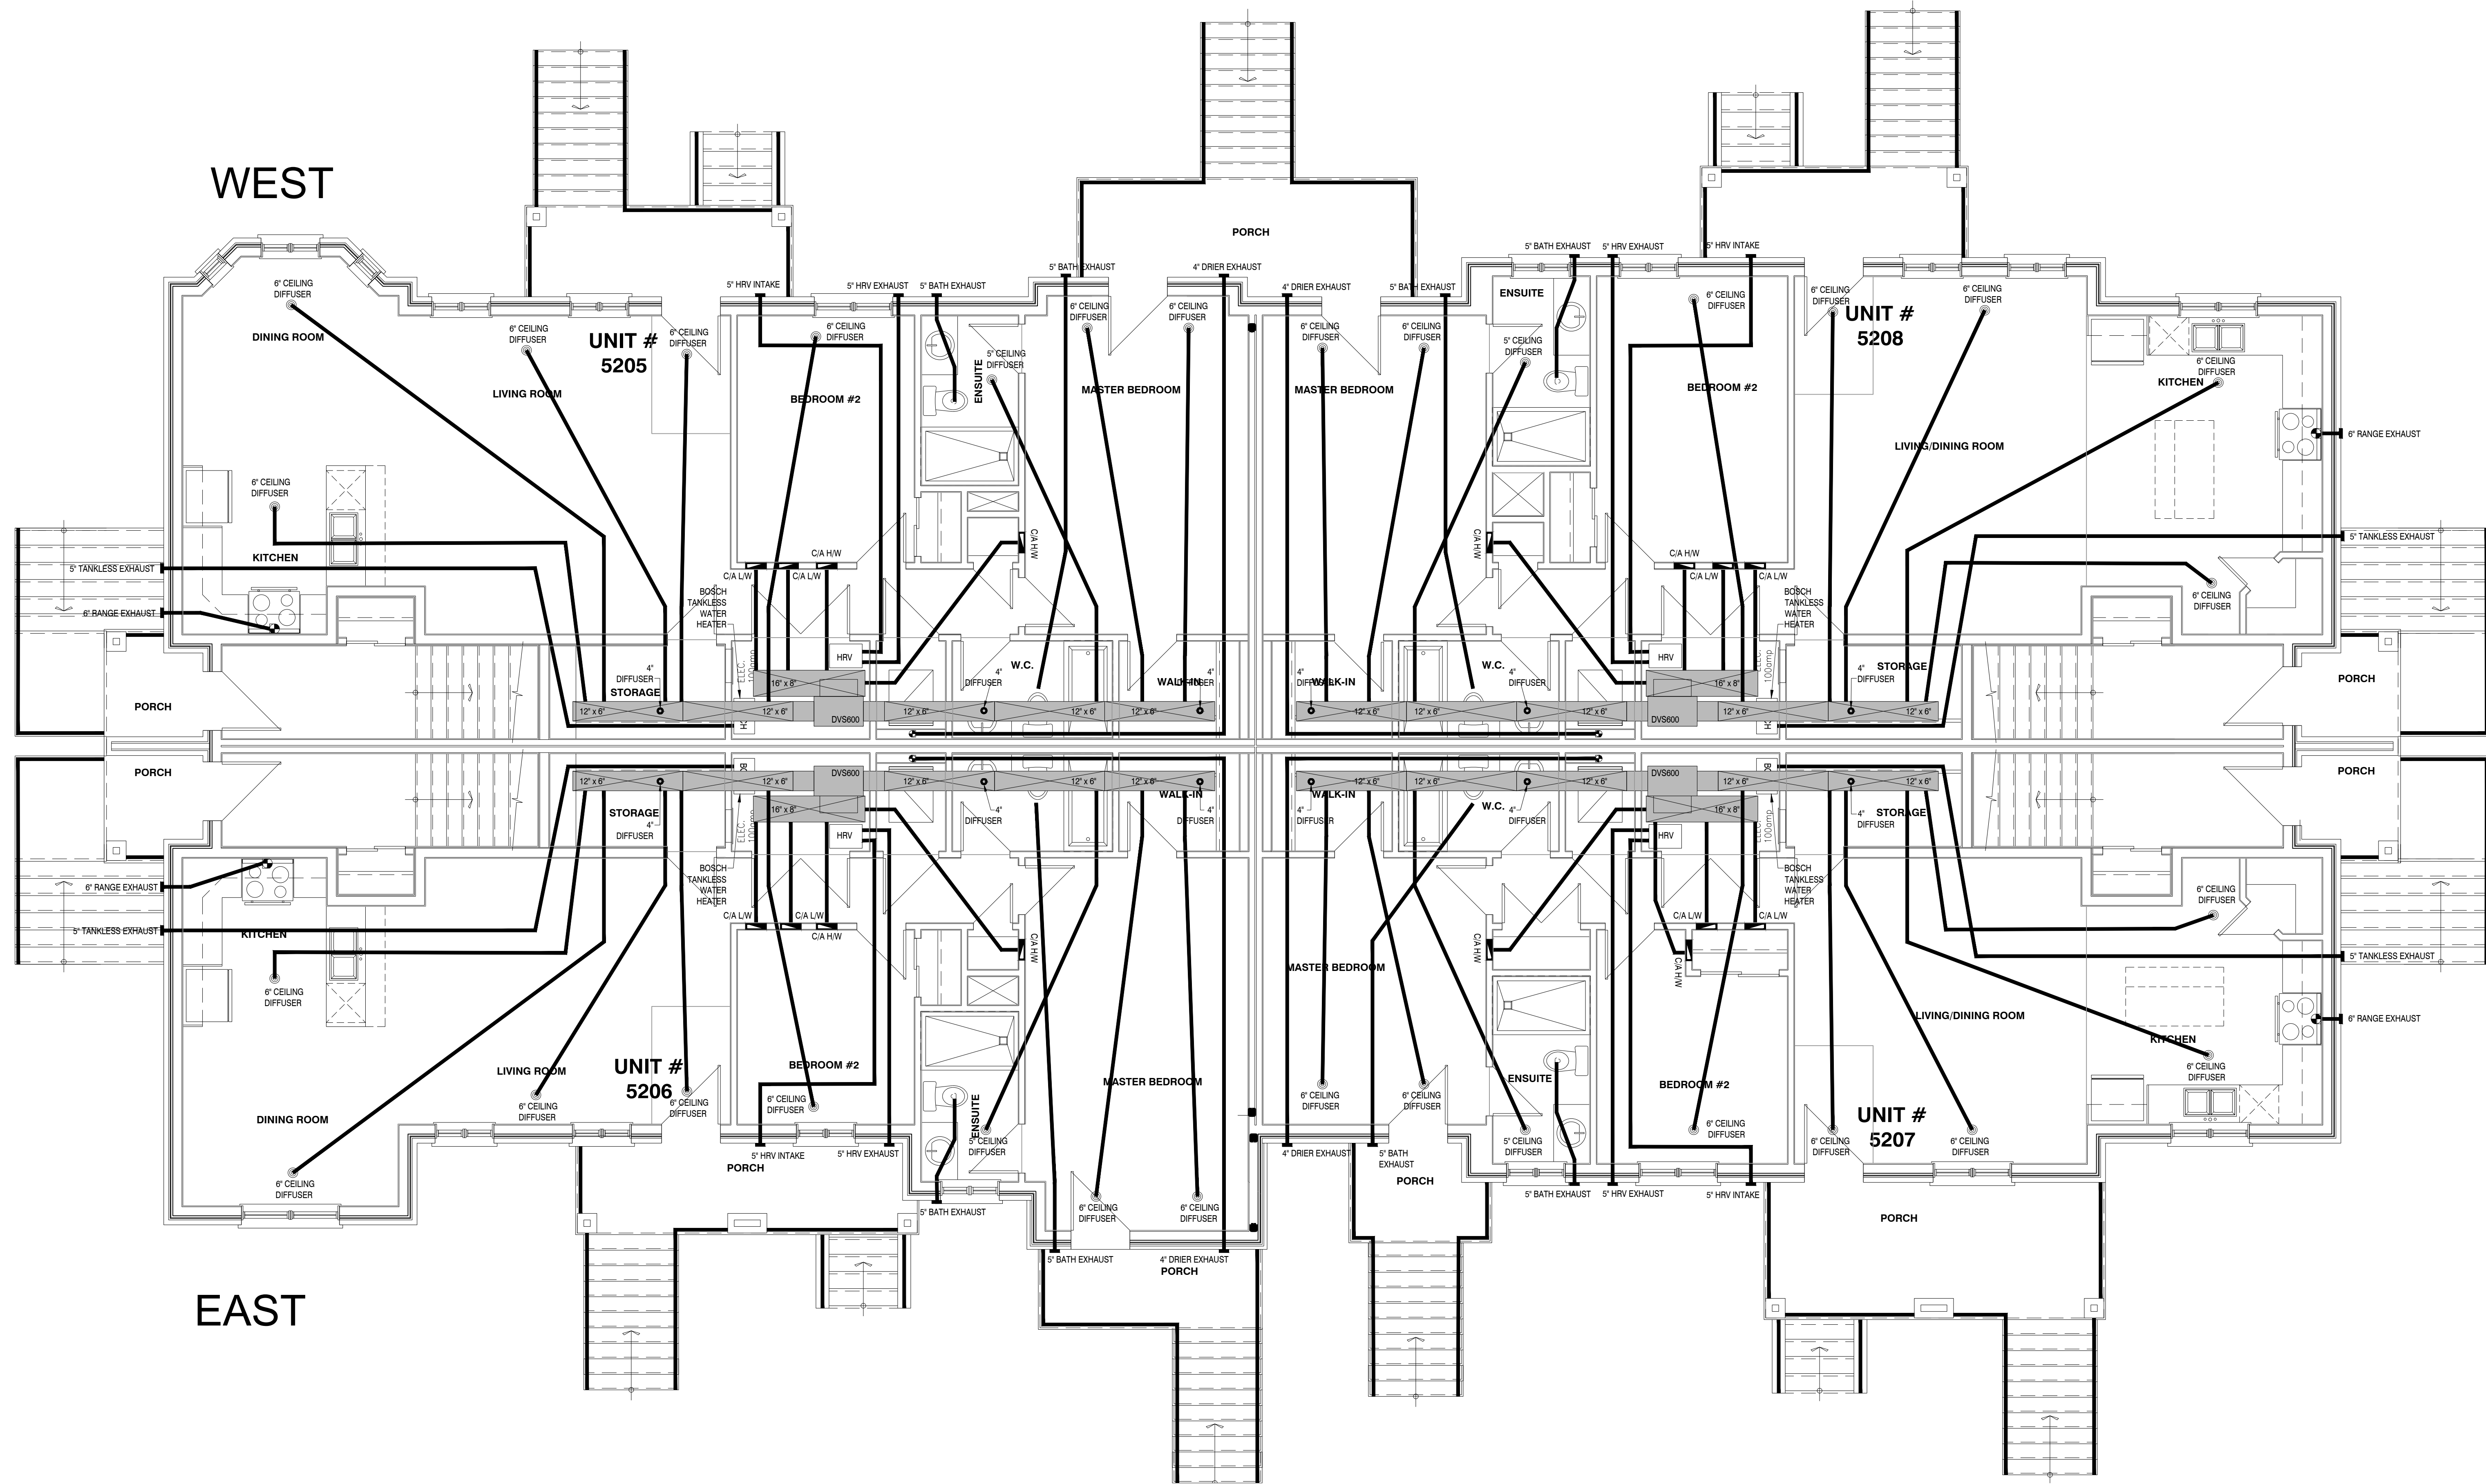

BLOCK: U

DATE: 02/18/2021

GEOFF HODGINS
ARCHITECT
1 SHERBROOK STREET E
PERTH, ON, K7H 1A1

WITH

Valecraft
ENGINEERS LTD.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-1A AND ANY AMENDMENTS AND SHALL SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR ANY OTHER ITEMS AUTOMATICALLY, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT.

ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE.

2012 O.B.C. DRAWINGS

REV-8

REVISIONS TO SHEET WALLS

12/04/2020

AB

REV-7

AS PER STRUCTURAL

12/12/2020

AB

REV-6

1/2" INCREASE ON NEW EXIST PORCHES

17/03/2019

AB

REV-5

AS PER DRC & REMOVED MANGARDS

12/15/2019

AB

REV-4

AS PER STRUCTURAL

06/03/2019

AB

REV-3

ISSUED FOR TENDER

07/09/2018

MAO

REV-2

NEW STANDARD DRWG MODIFICATION

07/08/2018

MAO

REV-1

NEW STANDARD DRWG MODIFICATION

18/03/2018

MAO

NO.

DESCRIPTION

DATE

BY

GROUND FLOOR ELECTRICAL

ADDRESS:

NO.

SCALE:

1/4" = 1'-0"

DATE:

10/02/2020


5000 SERIES -
DEERFIELD CONDOS

10/02/2020

SHEET:

E2



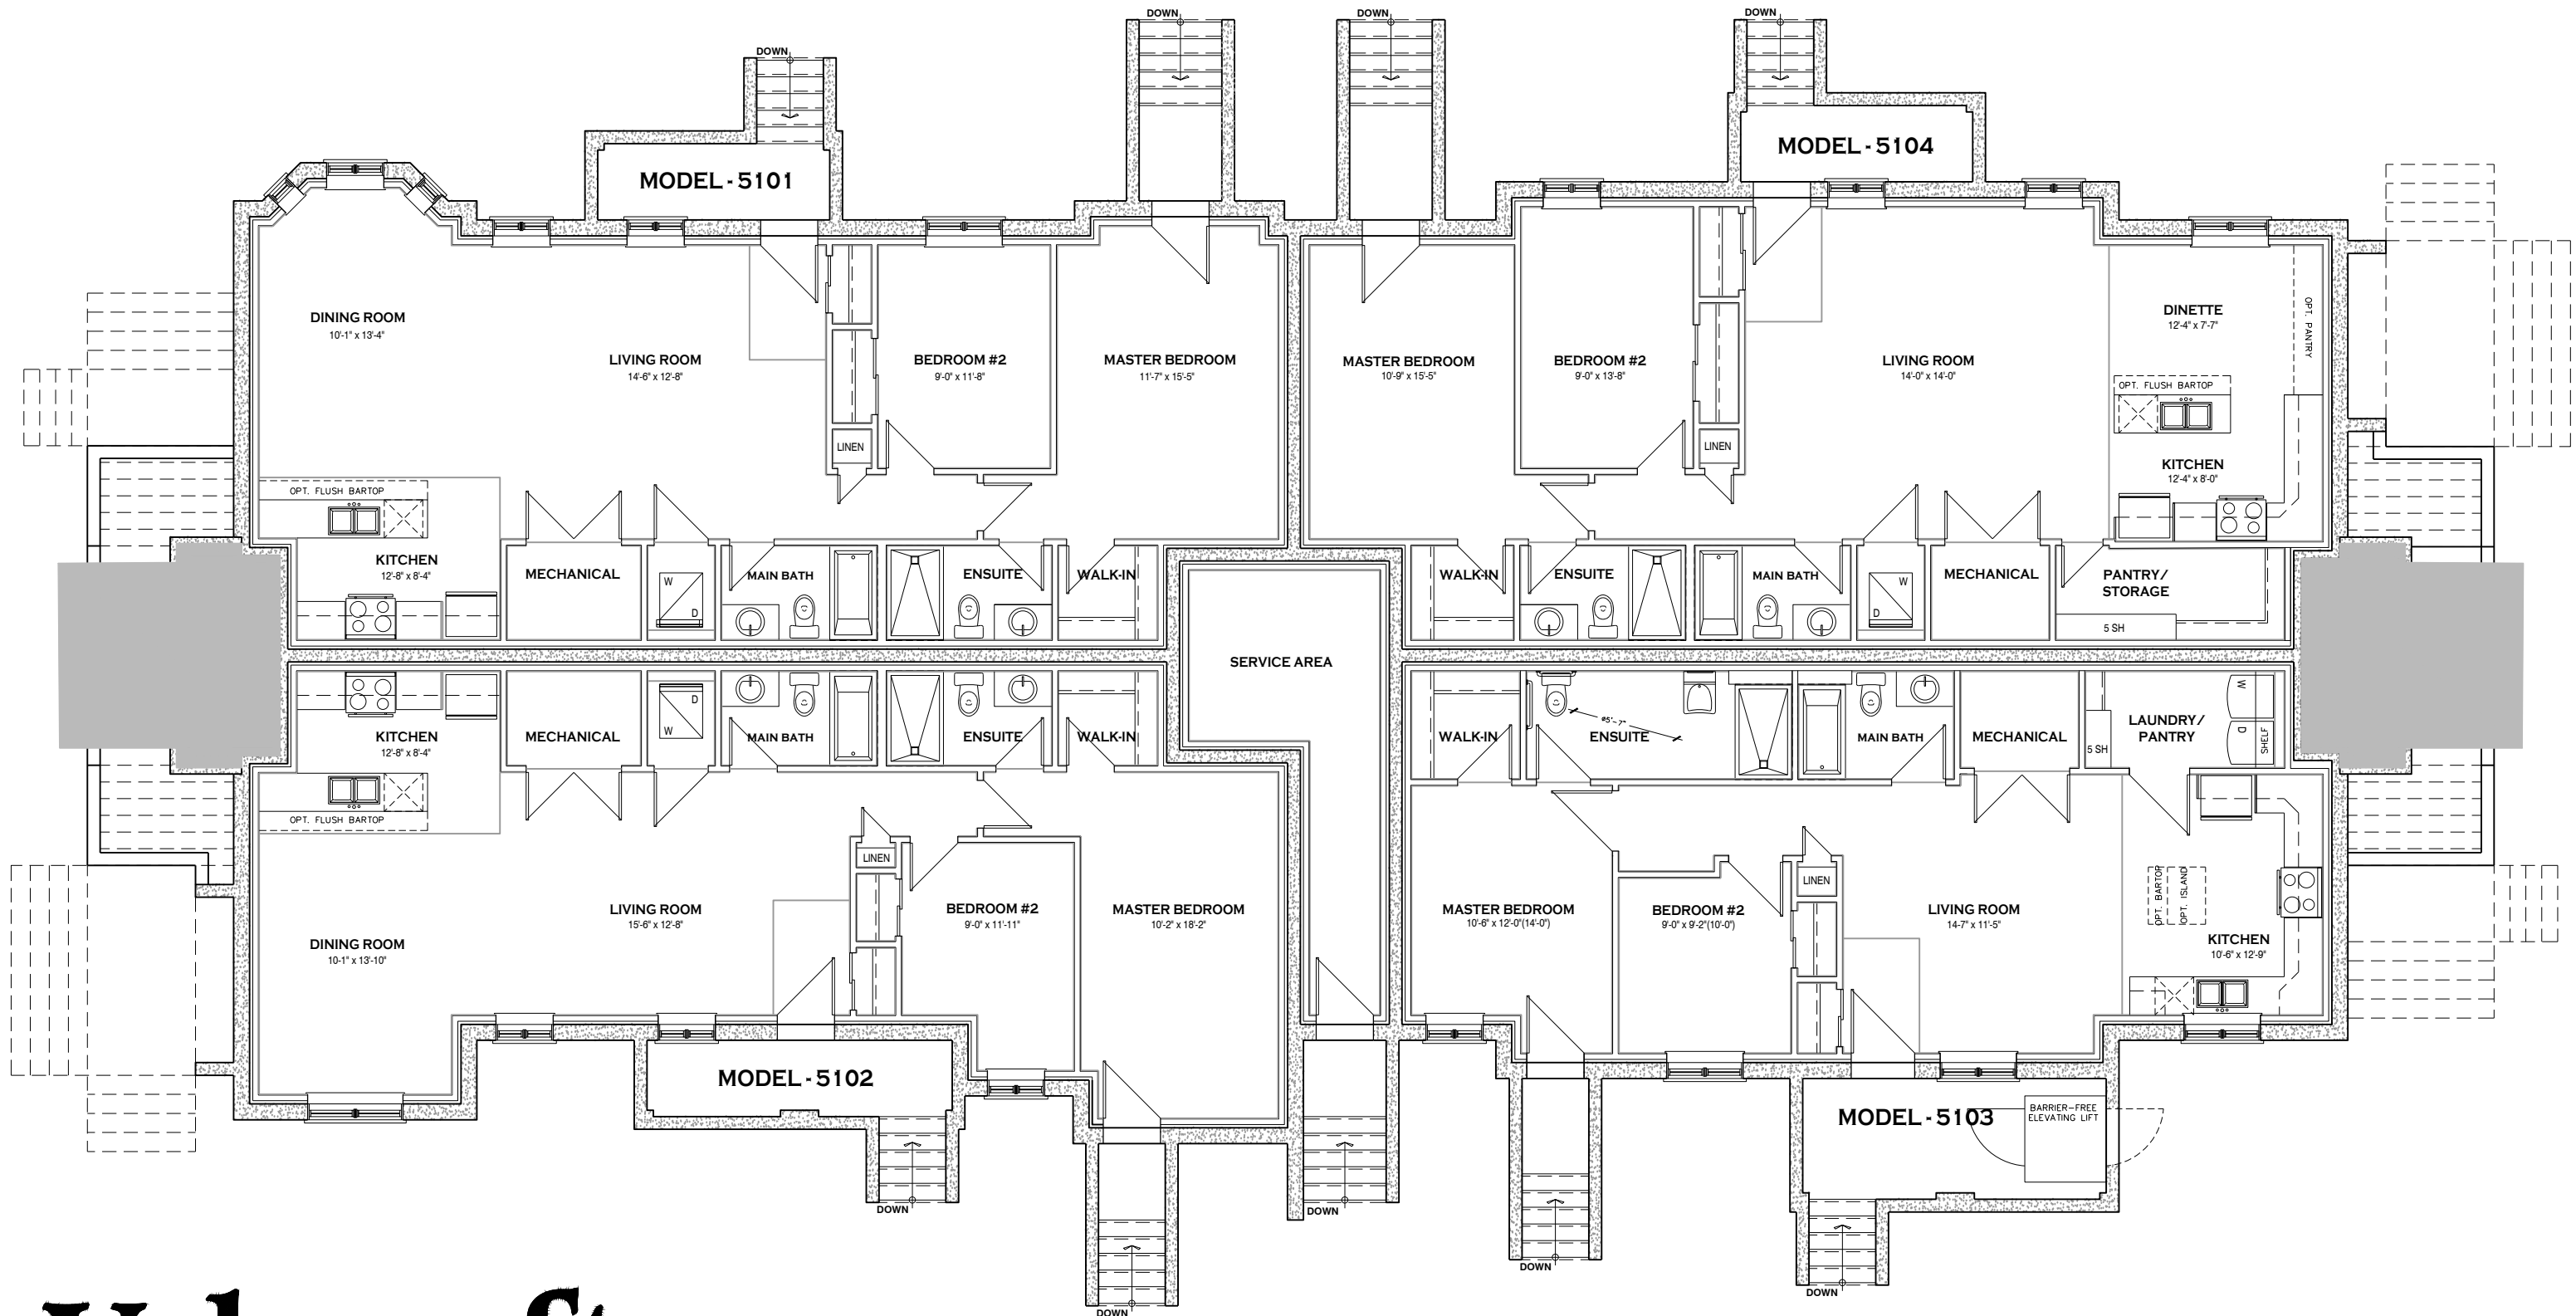

Valecraft




Homes Ltd.

LEVEL 1	
5000 SERIES - UNITS	
5101	1262 sq.ft.
5102	1209 sq.ft.
5103	1032 sq.ft.
5104	1258 sq.ft.

All dimensions are approximate
 Exterior illustrations are artist concepts only and may not be as shown.
 E & OE, plans, materials and specifications are subject to change without notice.
 Actual useable floor space may vary from the stated floor area.
 NOTE * : Number of steps varies due to site grading.

E. & O.E. 03/04/20

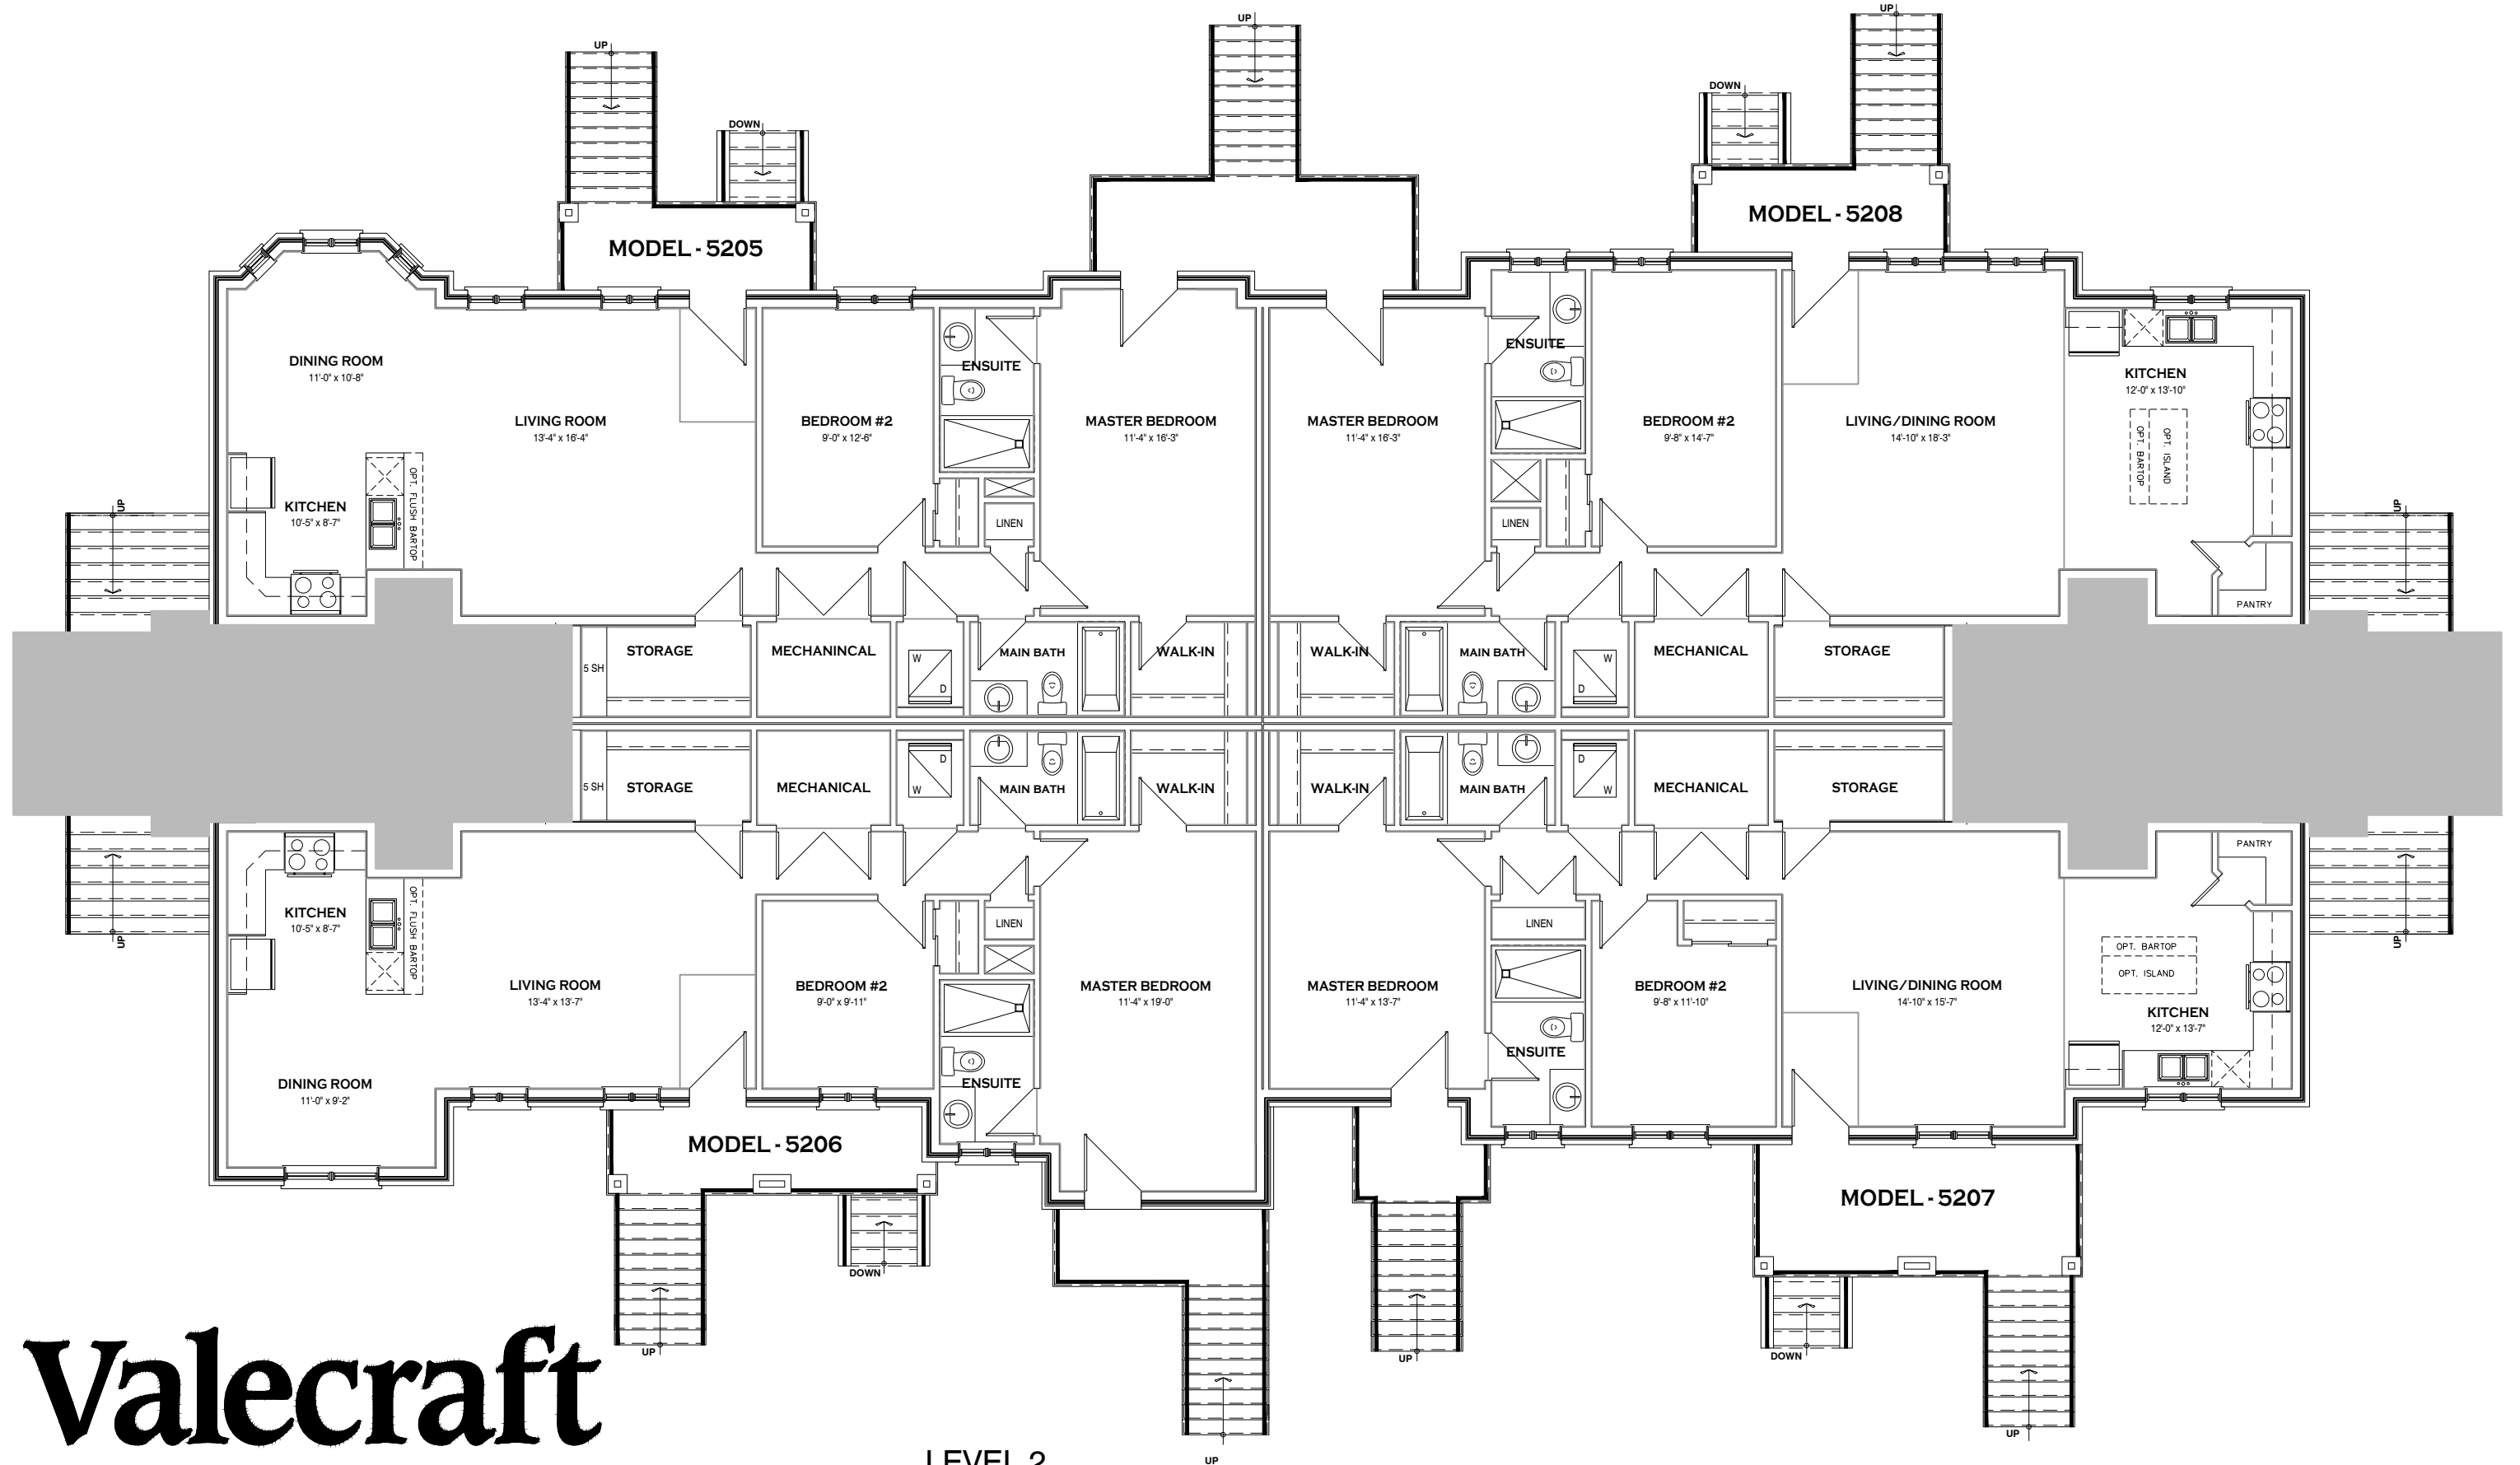

Valecraft





Homes Ltd.

LEVEL 2	
5000 SERIES - UNITS	
5205	1195 sq.ft.
5206	1145 sq.ft.
5207	1071 sq.ft.
5208	1218 sq.ft.

All dimensions are approximate
Exterior illustrations are artist concepts only and may not be as shown.
E & OE, plans, materials and specifications are subject to change without notice.
Actual useable floor space may vary from the stated floor area.
NOTE * : Number of steps varies due to site grading.

E. & O.E. 02/06/20

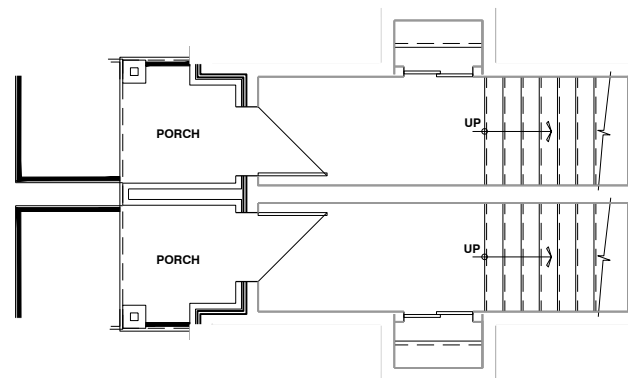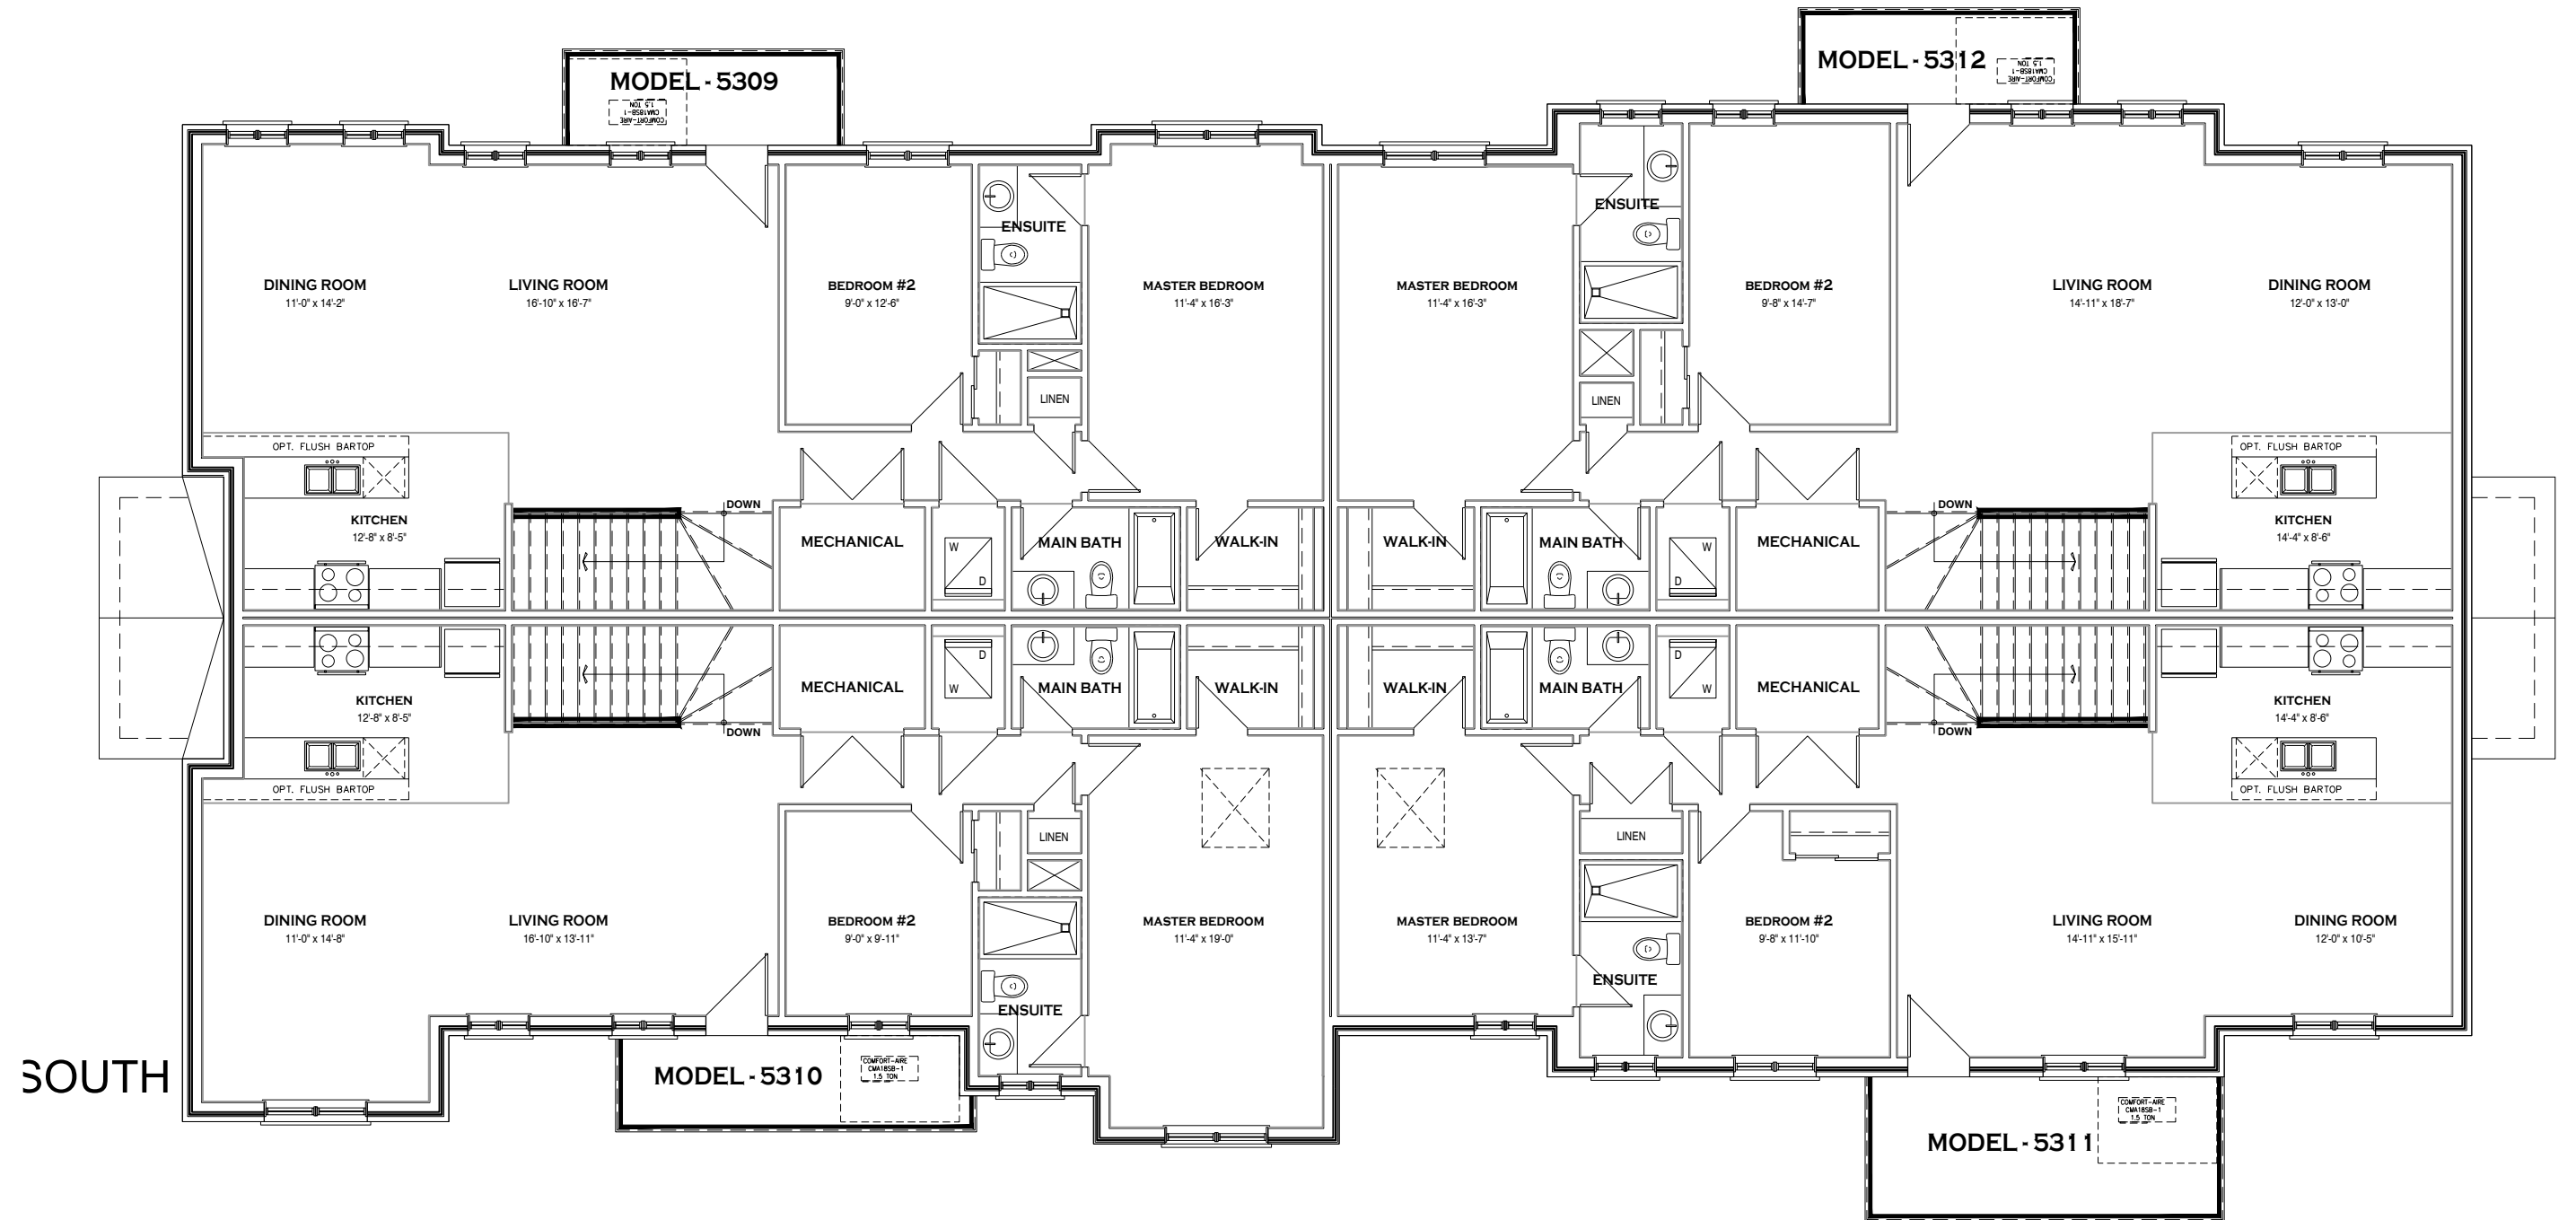

ENTRANCE TO UNIT


Valecraft



Homes Ltd.

All dimensions are approximate
Exterior illustrations are artist concepts only and may not be as shown.
E & OE, plans, materials and specifications are subject to change without notice.
Actual useable floor space may vary from the stated floor area.
NOTE * : Number of steps varies due to site grading.

5000 SERIES - UNITS 5309 1383 sq.ft.
LEVEL 3 5310 1348 sq.ft.
5311 1253 sq.ft.
5312 1400 sq.ft.

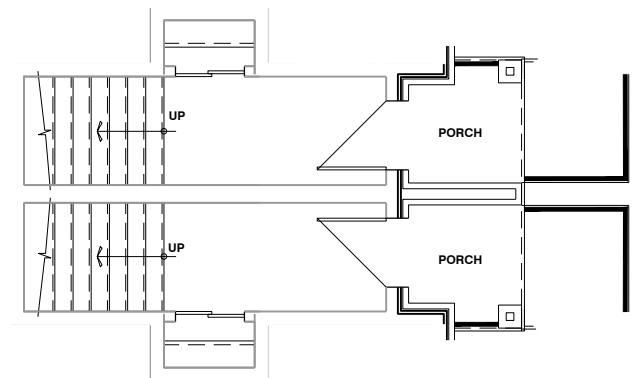

ENTRANCE TO UNIT