



SCALE: 3/16" = 1'-0"



A — ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B — THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C — NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D — THE GENERAL CONTRACTOR OR SUPE—CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION STIE.

SITE.

E - THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

EXTERIOR FINISH LEGEND:

- BRICK (MAIN) - BRICK SOLDIER COURSE (ACCENT)

VEC - SIDING (VERTICAL CORNER)

- SIDING (HORIZONTAL)

- STONE VENEER
- TRIM 200mm COVE SIDING

- ALUMINUM FASCIA

- ALUMINUM CLADDING

- AS" ALUMINUM BAND

5 - ASPHALT SHINGLES
- FLASHING
- ROOF VENT (MAXIMUM)
- PARCING

PARGINGPARGING

PCH10 - PRECAST HEADER 10"


PCH8 - PRECAST HEADER 8" PCS - PRECAST SILL PCB - PRECAST BAND VS - VINYL SHAKES

2012 O.B.C. DRAWINGS FRONT ELEVATION | SCALE: | DATE: | 11/25/2019

1030 - THE NASH 2019 FOOTPRINT

(STANDARD DRAWINGS)

A1a

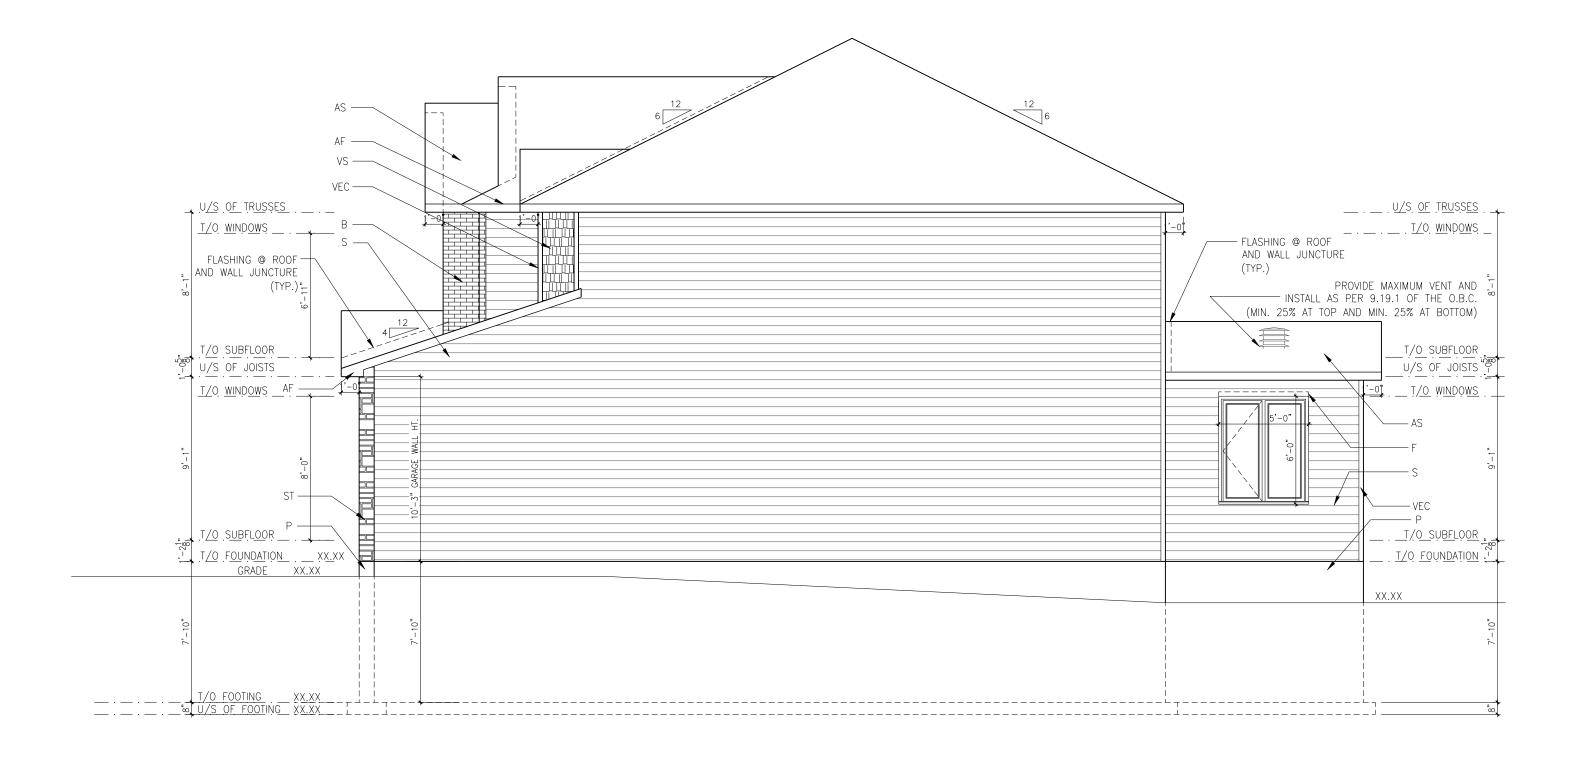



SCALE: 3/16" = 1'-0"

LOT:



3

A — ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B — THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C — NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D — THE GENERAL CONTRACTOR OR SUPE—CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION STIE.

SITE.

E - THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

EXTERIOR FINISH LEGEND:

B - BRICK (MAIN)
B1 - BRICK SOLDIER COURSE (ACCENT)
B2 - BRICK SOLDIER COURSE (ACCENT)
B3 - BRICK SOLDIER COURSE
B4 - STACK BOND (ACCENT)
B5 - BRICK SILL (ACCENT)
B6 - BRICK ROW LOCK (ACCENT)
B7 - BRICK CORBELLING
B8 - BRICK CORBELLING
B9 - BRICK CONDIE 20mm PROUD
+20 - BRICK 20mm PROUD
-20 - BRICK 20mm RECESSED

- SIDING (HORIZONTAL)

- STONE VENEER
- TRIM 200mm COVE SIDING

- ALUMINUM FASCIA

- ALUMINUM CLADDING

- AS" ALUMINUM BAND


5 - ASPHALT SHINGLES
- FLASHING
- ROOF VENT (MAXIMUM)
- PARCING P - PARGING PC - PARGING

PCH10 - PRECAST HEADER 10"

PCH8 - PRECAST HEADER 8" PCS - PRECAST SILL PCB - PRECAST BAND VS - VINYL SHAKES VEC - SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS **RIGHT ELEVATION** | SCALE: | DATE: | 11/25/2019 **1030 - THE NASH** A2a

2019 FOOTPRINT (STANDARD DRAWINGS)

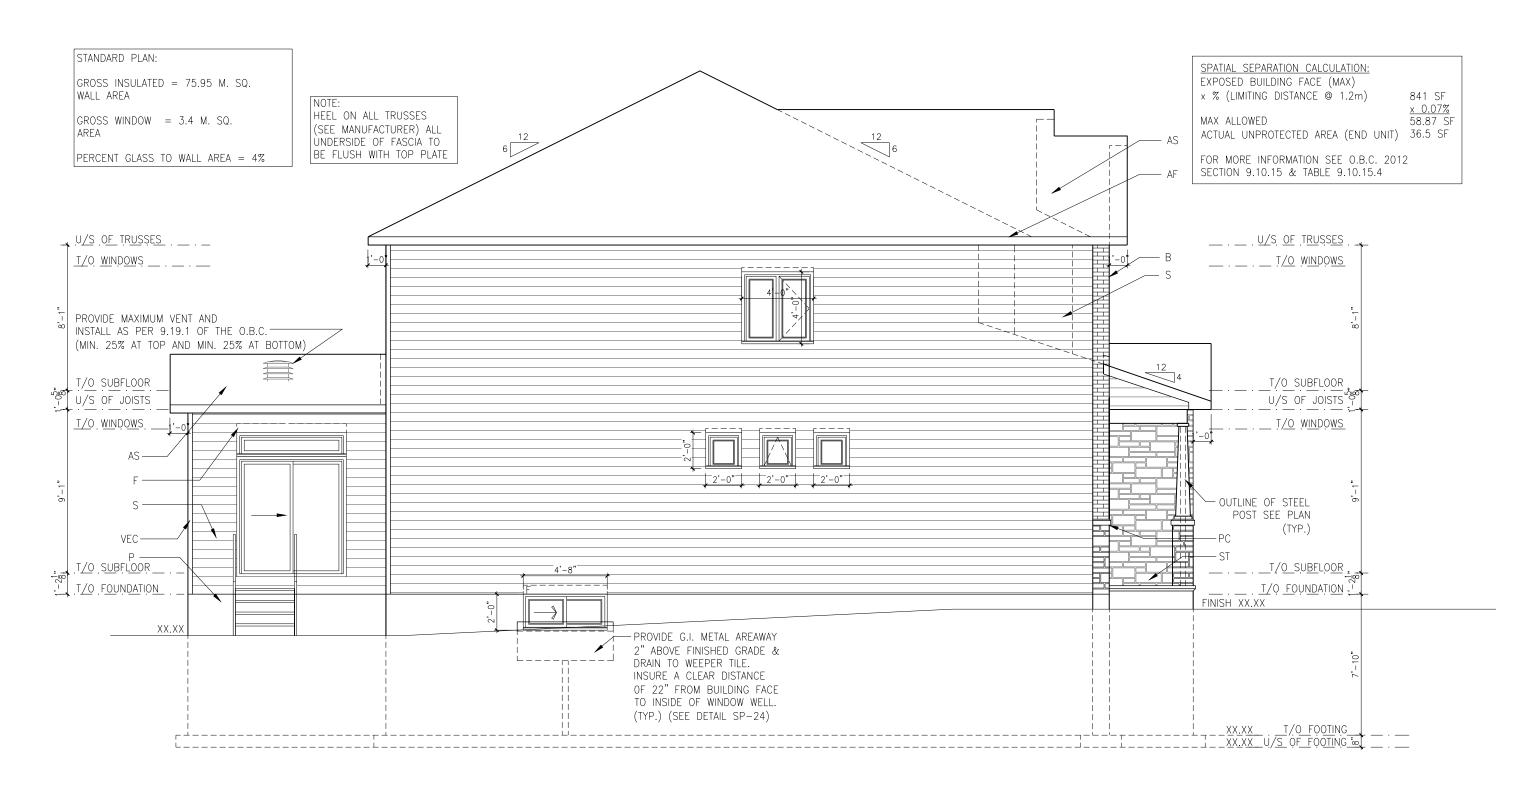



SCALE: 3/16" = 1'-0"

LOT:

DATE:



3

12/18/2020

A — ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B — THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C — NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D — THE GENERAL CONTRACTOR OR SUPE—CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION SITE

SITE.

E - THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWING
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
TEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT

I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

EXTERIOR FINISH LEGEND:

- BRICK (MAIN) - BRICK SOLDIER COURSE (ACCENT)

B2 - BRICK SOLDIER COURSE (ACCENT) + 20mm PROUD B3 - BRICK SLEEPER COURSE B4 - STACK BOND (ACCENT)

- Siding (Horizontal)
- Stone Veneer
- Trim 200mm Cove Siding
- Aluminum Fascia
- Aluminum Cladding

PCH10 - PRECAST HEADER 10"

- 48" ALUMINUM BAND - ASPHALT SHINGLES - FLASHING - ROOF VENT (MAXIMUM)

- PARGING


PCH8 - PRECAST HEADER 8" PCS - PRECAST SILL PCB - PRECAST BAND VS - VINYL SHAKES VEC - SIDING (VERTICAL CORNER)

2012 O.B.C. DRAWINGS **LEFT ELEVATION**

SCALE: DATE: 11/25/2019

1030 - THE NASH 2019 FOOTPRINT

A3a (STANDARD DRAWINGS)

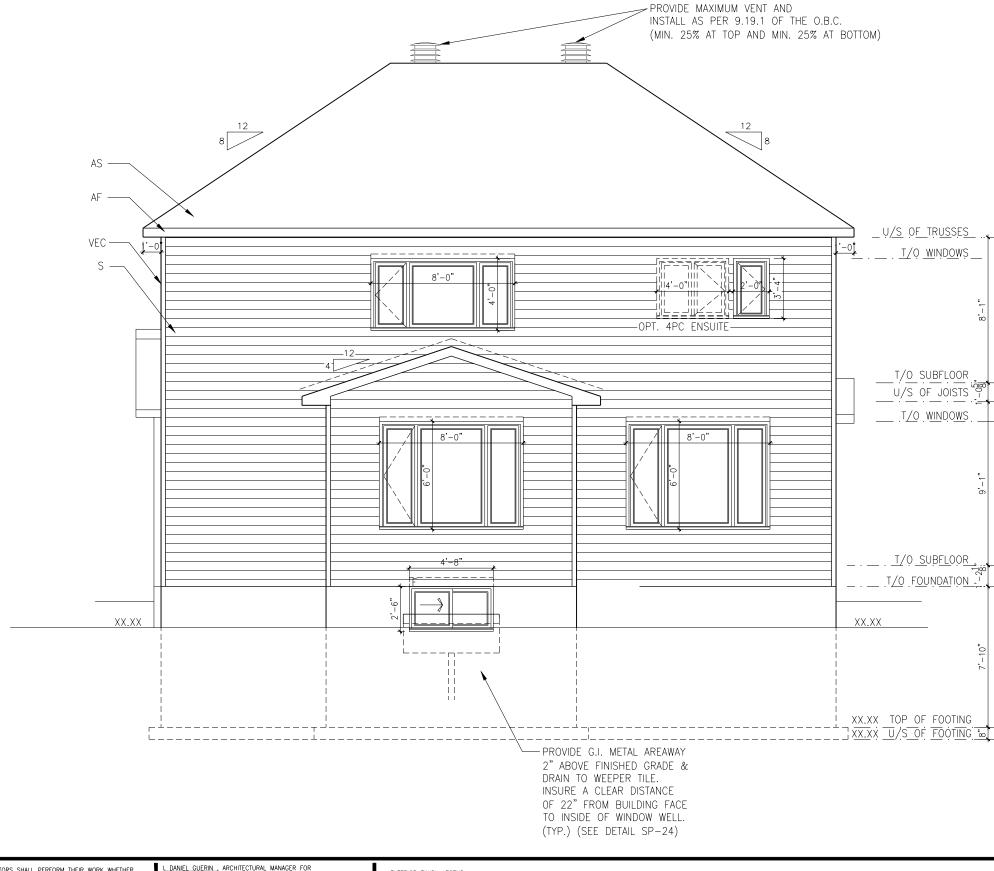

REAR ELEVATION

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020



A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT.

C – NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D – THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION STIE.

SITE.

E - THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING
DOCUMENT.

I<u>, DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611 ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

EXTERIOR FINISH LEGEND:

B - BRICK (MAIN)
B1 - BRICK SOLDIER COURSE (ACCENT)
B2 - BRICK SOLDIER COURSE (ACCENT)
B3 - BRICK SOLDIER COURSE
B4 - STACK BOND (ACCENT)
B5 - BRICK SILL (ACCENT)
B6 - BRICK ROW LOCK (ACCENT)
B7 - BRICK CORBELLING
B8 - BRICK CORBELLING
B9 - BRICK CONDIE 20mm PROUD
+20 - BRICK 20mm PROUD
-20 - BRICK 20mm RECESSED

PCH10 - PRECAST HEADER 10"

S - SIDING (HORIZONTAL)
ST - STONE VENEER
T - TRIM 200mm COVE SIDING
AF - ALLUMNUM FASCIA
AC - ALUMNUM CLADDING
AB - 48" ALUMNUM BAND
AS - ASPHALT SHINGLES
F - FLASHING
V - ROOF VENT (MAXIMUM)
P - PAGRING P - PARGING PC - PARGING


PCH8 - PRECAST HEADER 8" PCS - PRECAST SILL PCB - PRECAST BAND VS - VINYL SHAKES VEC - SIDING (VERTICAL CORNER) 2012 O.B.C. DRAWINGS **REAR ELEVATION** | SCALE: | DATE: | 3/16" = 1'-0" | 11/25/2019


1030 - THE NASH 2019 FOOTPRINT


(STANDARD DRAWINGS)

A4a

		FOOTING S	SCHEDULE		
ALLOWABL	E SOIL BEARING CAPACI	TY / BEARING RESISTA	NCE AT SLS FOR «SITE	CLASS:D»	
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	40KPa
WF1	30"x8" DP. 2-15M(B) LONG.	36"x8" DP. 15M(B)x32"Lg @ 20" o/c 3-15M(B) LONG.	40"x8" DP. 15M(B)x36"Lg @ 20" o/c 3-15M(B) LONG.	48"x8" DP. 15M(B)x42"Lg @ 16" o/c 3-15M(B) LONG.	72"x10" DP. 15M(B)x66"Lg
WF2	28"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	38"x8" DP. 15M(B)x34"Lg @ 20" o/c 3-15M(B) LONG.	46"x8" DP. 15M(B)x42"Lg @ 16" o/c 3-15M(B) LONG.	70"x10" DP. 15M(B)x64"Lg @ 16" o/c 5-15M(B) LONG.
WF3	26"x8" DP. 2-15M(B) LONG.	30"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	42"x8" DP. 15M(B)x38"Lg @ 20" o/c 3-15M(B) LONG.	64"x10" DP. 15M(B)x58"Lg @ 16" o/c 5-15M(B) LONG.
WF4	24"x8" DP. 2-15M(B) LONG.	28"x8" DP. 2-15M(B) LONG.	32"x8" DP. 2-15M(B) LONG.	38"x8" DP. 15M(B)x34"Lg @ 20" o/c 3-15M(B) LONG.	58"x10" DP. 15M(B)x52"Lg @ 16" o/c 4-15M(B) LONG.
WF5	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	26"x8" DP. 2-15M(B) LONG.	34"x8" DP. 2-15M(B) LONG.	52"x10" DP. 15M(B)x48"Lg @ 16" o/c 4-15M(B) LONG.
WF6	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	24"x8" DP. 2-15M(B) LONG.	30"x8" DP. 2-15M(B) LONG.	46"x10" DP. 15M(B)x42"Lg @ 16" o/c 3-15M(B) LONG.
WF7	20"x8" DP. 2-15M(B) LONG.	20"x8" DP. 2-15M(B) LONG.			36"x10" DP. 15M(B)x32"Lg @ 16" o/c 3-15M(B) LONG.
	PAD F	OOTING SCHE	DULE		
ALLOWABL	E SOIL BEARING CAPACI	TY / BEARING RESISTA	NCE AT SLS FOR «SITE	CLASS:D»	
WALL FOOTINGS	100KPa	85KPa	75KPa	60KPa	40KPa
F1	40"x40"x10" DP.3-15M (B)x34" LG.EW.	44"x44"x10" DP. 3-15M (B)x38" LG.EW	48"x48"x10" DP. 4-15M (B)x42" LG.EW	52"x52"x10" DP. 4-15M (B)x46" LG.EW	64"x64"x12" DP. 5-15M (B)x58" LG.EW
F2	24"x24"x10" DP.	24"x24"x10" DP.	24"x24"x10" DP.	28"x28"x12" DP.	34"x34"x12" w/ 3-15M 28" LG. e/w
F3	36"x60"x10" DP.3-15M (B) LONG. AND 5-15M (B) TRANS.	40"x60"x10" DP.3-15M (B) LONG. AND 5-15M (B) TRANS.	44"x66"x10" DP.4-15M (B) LONG. AND 5-15M (B) TRANS.	48"x72"x10" DP.4-15M (B) LONG. AND 6-15M (B) TRANS.	60"x84"x12" DP. 5-15M(B) LONG and 7-15M(B) TRANS.

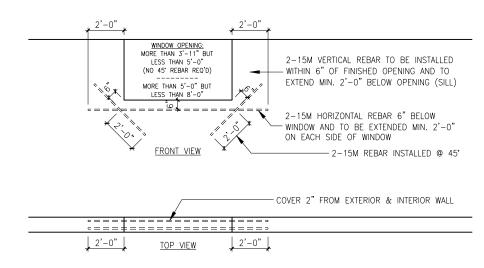

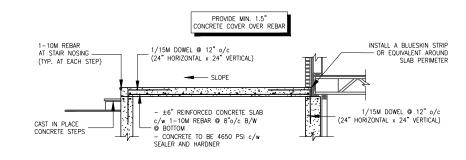



- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTI OF 3000 P.S.I. (21MPa) AT 28 DAYS;
- ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);
- CONCRETE FOOTINGS MUST BE PLACED ON UNDISTURBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST
- FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGTH AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD SUB FLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND FULLY NAILED AND ANCHORED;
- FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEO-TECHNICAL ENGINEER.

- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

BASEMENT NOTE:

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH 9.7.1.3.:
- 1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:
- A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND
- B) PROVIDES AN INDIVIDUAL, UNOBSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3,8 SF.)
 WITH NO DIMENSIONS LESS THAN 380mm (15IN)

2012 O.B.C. DRAWINGS

FOOTING TABLE

SCALE: 3/16" = 1'-0" 11/25/2019

1030 - THE NASH 2018 FOOTPRINT

A5 (STANDARD DRAWINGS)



3

12/18/2020

FOOTING TABLE

SCALE: 3/16" = 1'-0"

LOT:

DATE:

- A ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.

 B THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S AND CONTRACTURE OF THE PROPERTY OF T
- ARCHITECTURAL DEPARTMENT ARCHIECTURAL DEPARTMENT.
 C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
 D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE
 JELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION
- SITE.

 E THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

 SCHEDULE B-1A AND ANY 680'S AND MAY SHOW ONLY SOME OF
 THE CHANCES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS
 NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER
 ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING

 DOCUMENT.
- I<u>, DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896
- TARION REGISTRATION NUMBER #611
- ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM
- REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH DESCRIPTION
- = L 90x90x6 = L 90x90x8 = L 100x90x8 = L 125x90x8 S5 = L 125x90x10S6 = L 200x100x12
 - S7 = L 150x100x10 (8" BEARING)
 LINTEL TABLE:
 L1 = 2-2x10 + P2 ON BOTH SIDES
 L2 = 3-2x10 + P3 ON BOTH SIDES
 - L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES * UNLESS OTHERWISE NOTED
- * UNLESS OTHERWISE NOTED + 130x160x10 TOP PL. (*)

 * IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE


 (*) = 2-12ø ANCH. (WHERE ANCH. PL. NOT USED)
- P1 = 3" ADJUSTABLE STEEL COLUMN P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 * POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

POST TABLE:

- PLANS, I P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
- P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*) P17 = HSS 73 .0.D.x4.8 + 100x180x12 BOTTOM PL.

SMOKE ALARMS AS PER SECTION 9.10.19, OF THE ONTARIO BUILDING CODE:
SHALL HAVE A VISUAL SIGNALING DEVICE;
ARE REQUIRED IN EACH SICEPING ROOM AND HALLWAY;
ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND CARPON MONOVIPE ALARM; AND CARPON MONOVIPE ALARM; AND CARPON MONOVIPE ALARM; AND CARPON MONOVIPE ALARM AND ALARM AND ALARM; AND CARPON MONOVIPE ALARM AND ALARM A

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

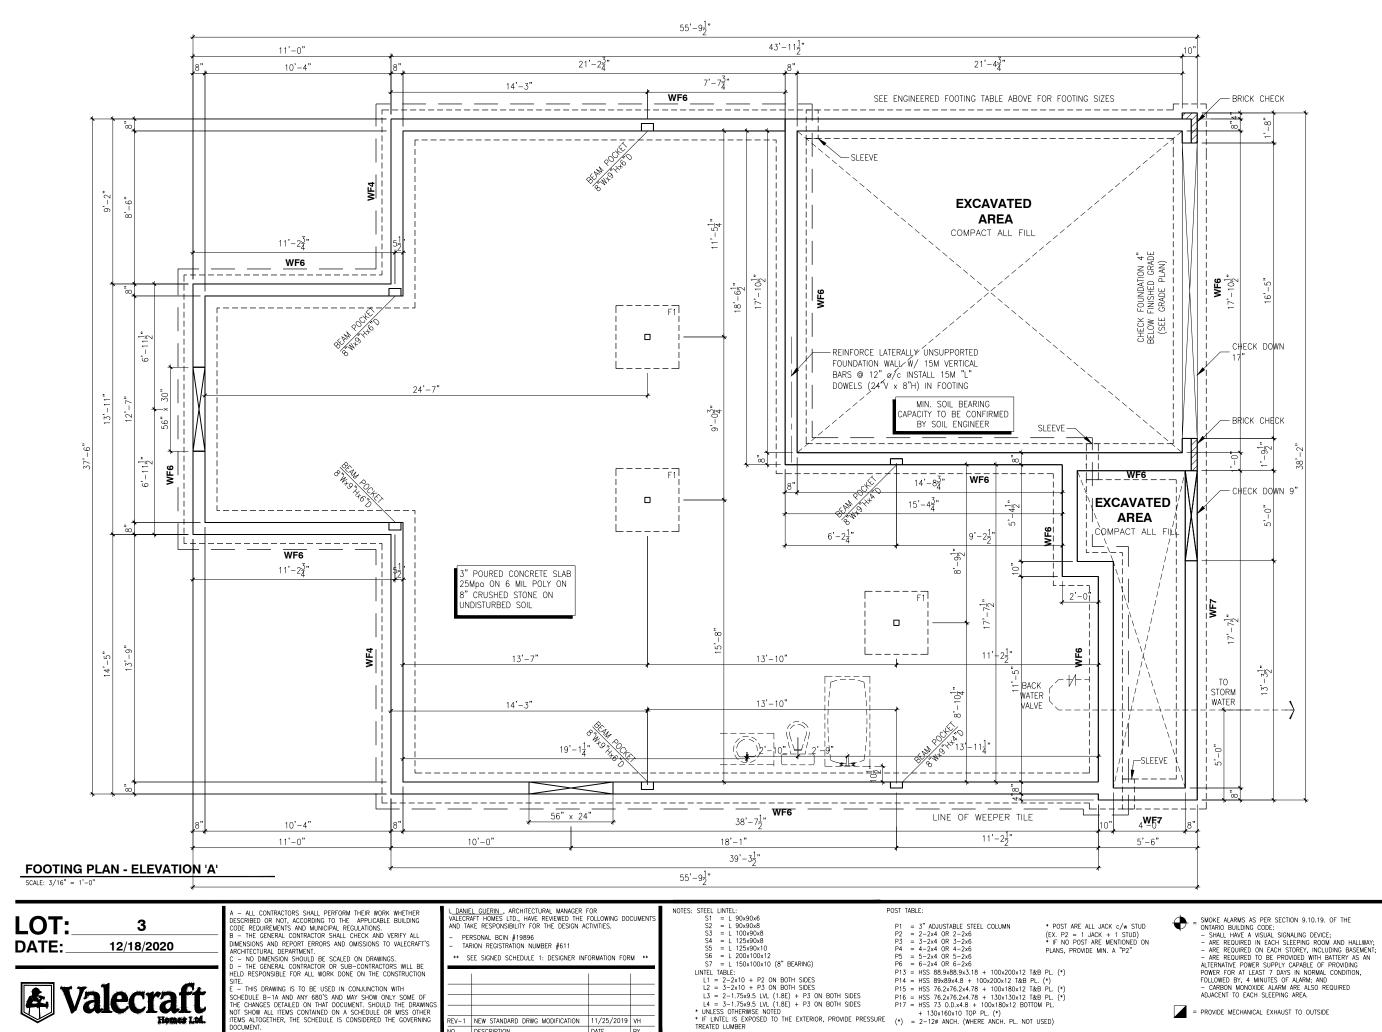

2012 O.B.C. DRAWINGS

- ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTH

ALL GARAGE FLOOR SLAB TO BE 4" THICK AND 4650 P.S.I. c/w 5 TO 8% AIR ENTRAINED & TO BE SLOPED TOWARDS THE EXTERIOR (MIN 2% SLOPE);

CONCRETE FOOTINGS MUST BE PLACED ON UNDISTURBED OR COMPACTED SOIL TO AN ELEVATION BELOW FROST PENETRATION;

FOUNDATION WALL SHALL NOT BE BACKFILLED UNTIL CONCRETE HAS REACHED ITS SPECIFIED 28 DAYS STRENGTH AND STRUCTURAL FLOOR FRAMING (INCLUDING PLYWOOD

SUB FLOOR) REQUIRED TO STABILIZE THE WALLS ARE COMPLETED AND FULLY NAILED AND ANCHORED;

FOOTINGS DIMENSIONS ARE BASED ON THE SOIL BEARING CAPACITY PROVIDED BY THE GEO-TECHNICAL ENGINEER.

- IF A BEDROOM IS ADDED IN THE BASEMENT, THE ROOM MUST CONFORM WITH 9.7.1.3.:

1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IN A SUITE SHALL BE PROVIDED WITH AT LEAST 1 OUTISE WINDOW THAT:

A) IS OPENABLE FROM THE INSIDE WITHOUT THE USE OF TOOLS; AND B) PROVIDES AN INDIVIDUAL, UNOBSTRUCTED OPEN PORTION HAVING A MINIMUM AREA OF 0,38m2 (3.8 SF.) WITH NO DIMENSIONS LESS THAN 380mm (15IN)

OF 3000 P.S.I. (21MPa) AT 28 DAYS;


BASEMENT NOTE:


FOOTING PLAN

SCALE: DATE: 11/25/2019 1030 - THE NASH

2018 FOOTPRINT (STANDARD DRAWINGS)

A5a

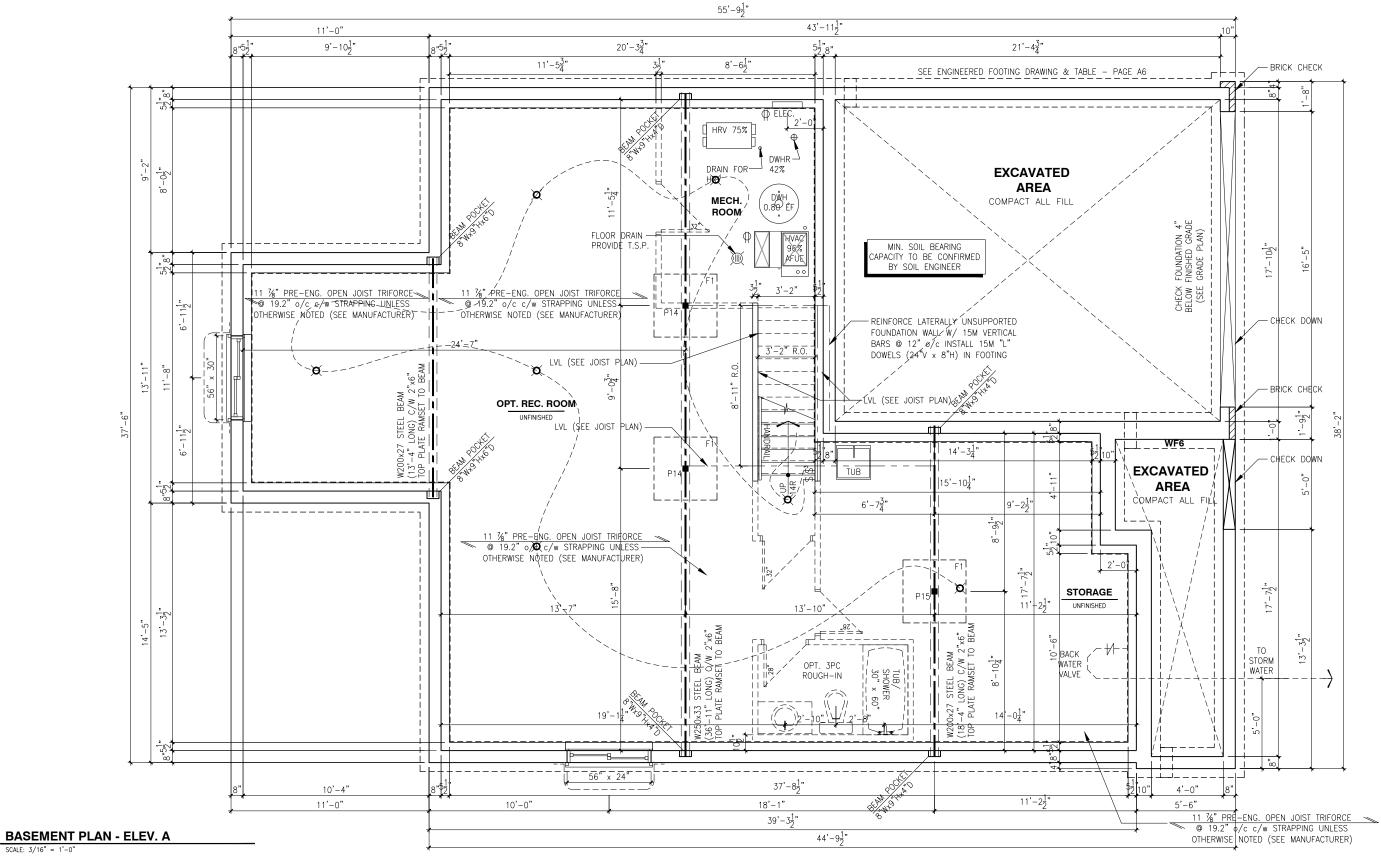

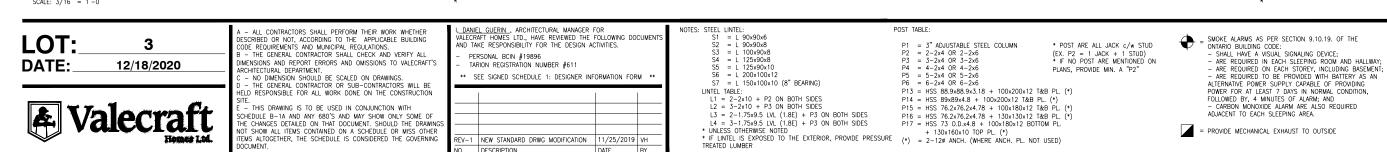

2012 O.B.C. DRAWINGS


BASEMENT PLAN

DRESS: | SCALE: | DATE: | 11/25/2019


1030 - THE NASH 2018 FOOTPRINT

(STANDARD DRAWINGS)

A6a

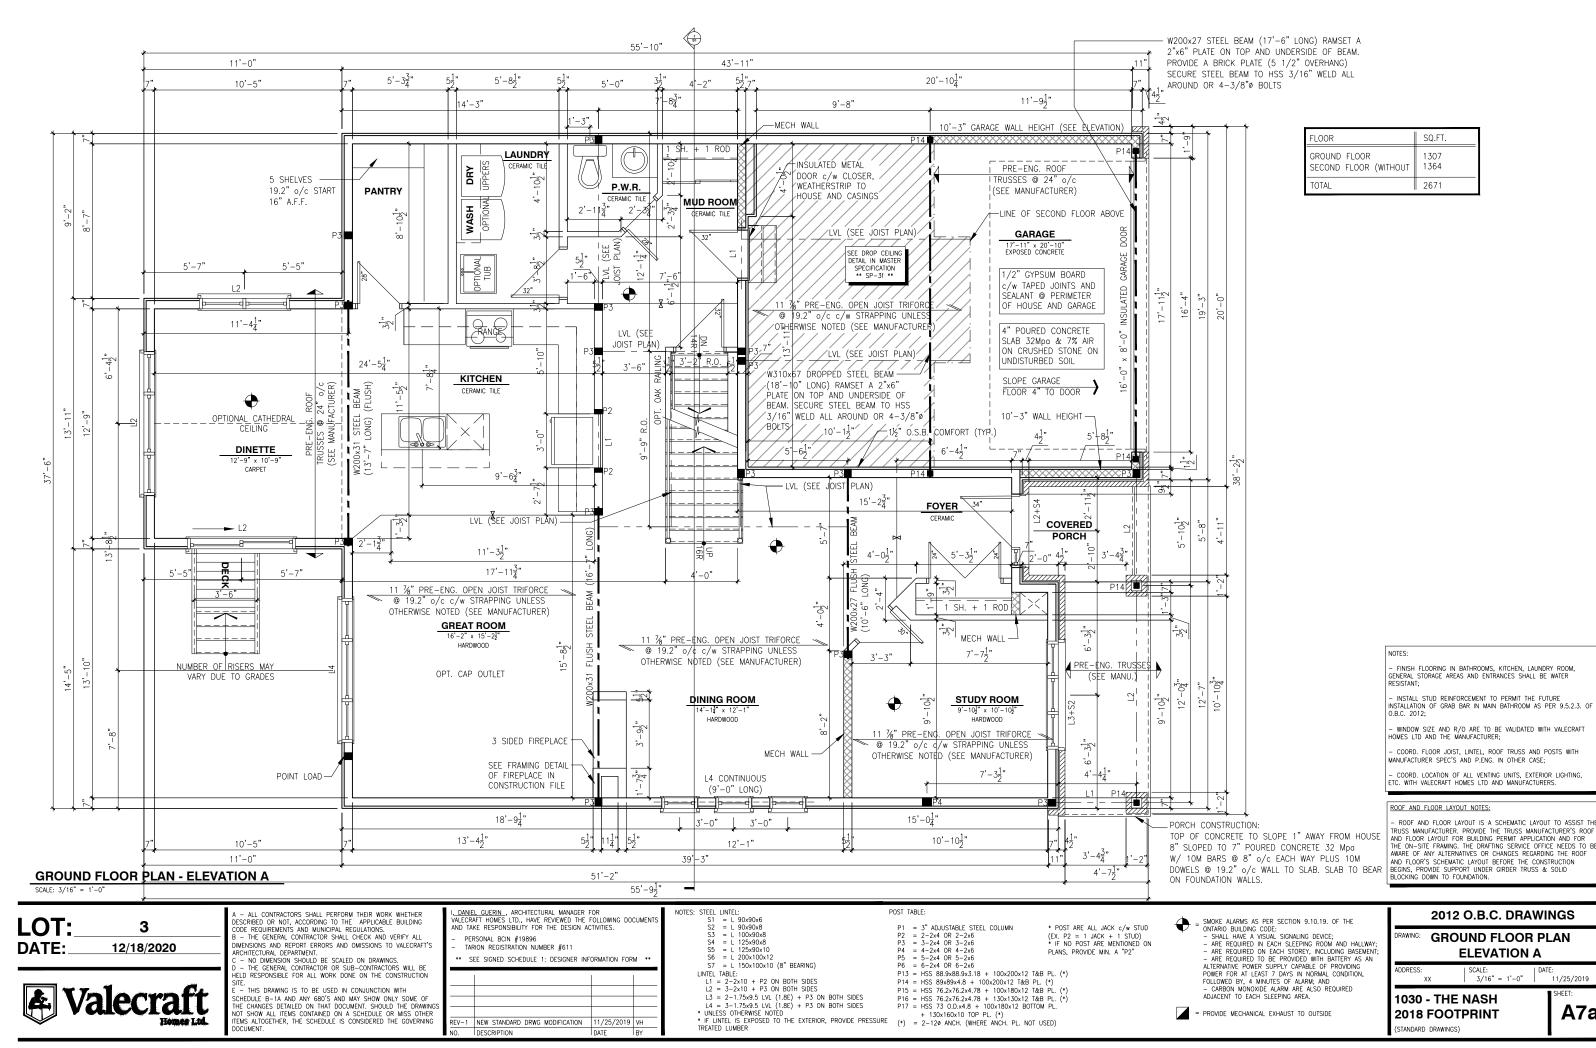

A7a

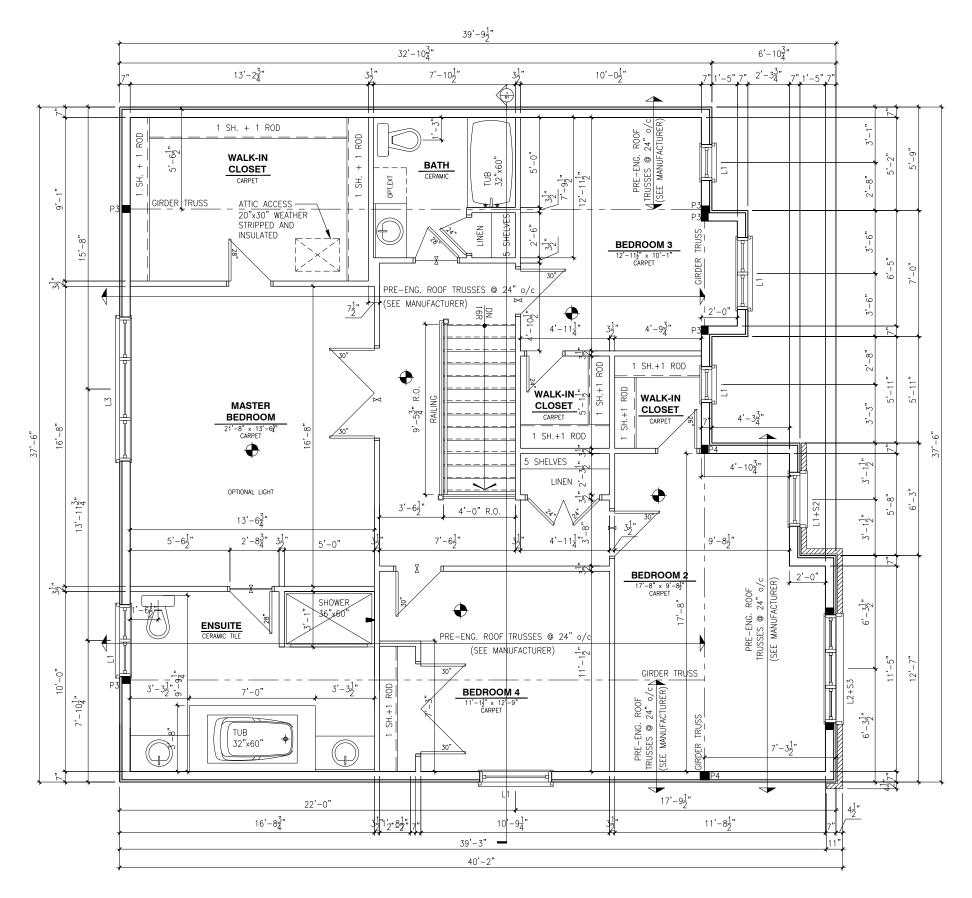

SECOND FLOOR PLAN - ENSUITE UPG. SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020

Valecraft

A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S

ARCHITECTURAL DEPARTMENT ARCHITECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE JELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

90x90x8 100x90x8 125x90x8

= L 125X9UX1U = L 200x100x12 = L 150x100x10 (8" BEARING) LINTEL TABLE:

P1 = 3" ADJUSTABLE STEEL COLUMN

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 PLANS, PROVIDE MIN. A "P2"

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)

P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*) P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.0x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*) L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES | P16 = HSS 73 O.D.x4.8.7 A + 130x130x12 L8CB PL.

**UNLESS OTHERWISE NOTED + 130x160x10 TOP PL. (*) + 130x160x10 TOP PL. (*) |

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE (*) = 2-12\(\text{P} \) ANCH. (WHERE ANCH. PL. NOT USED)

- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF

AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

SECOND FLOOR PLAN

— FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

0.B.C. 2012;

ROOF AND FLOOR LAYOUT NOTES:

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;


- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.


1030 - THE NASH

2018 FOOTPRINT STANDARD DRAWINGS)

A8a

11/25/2019

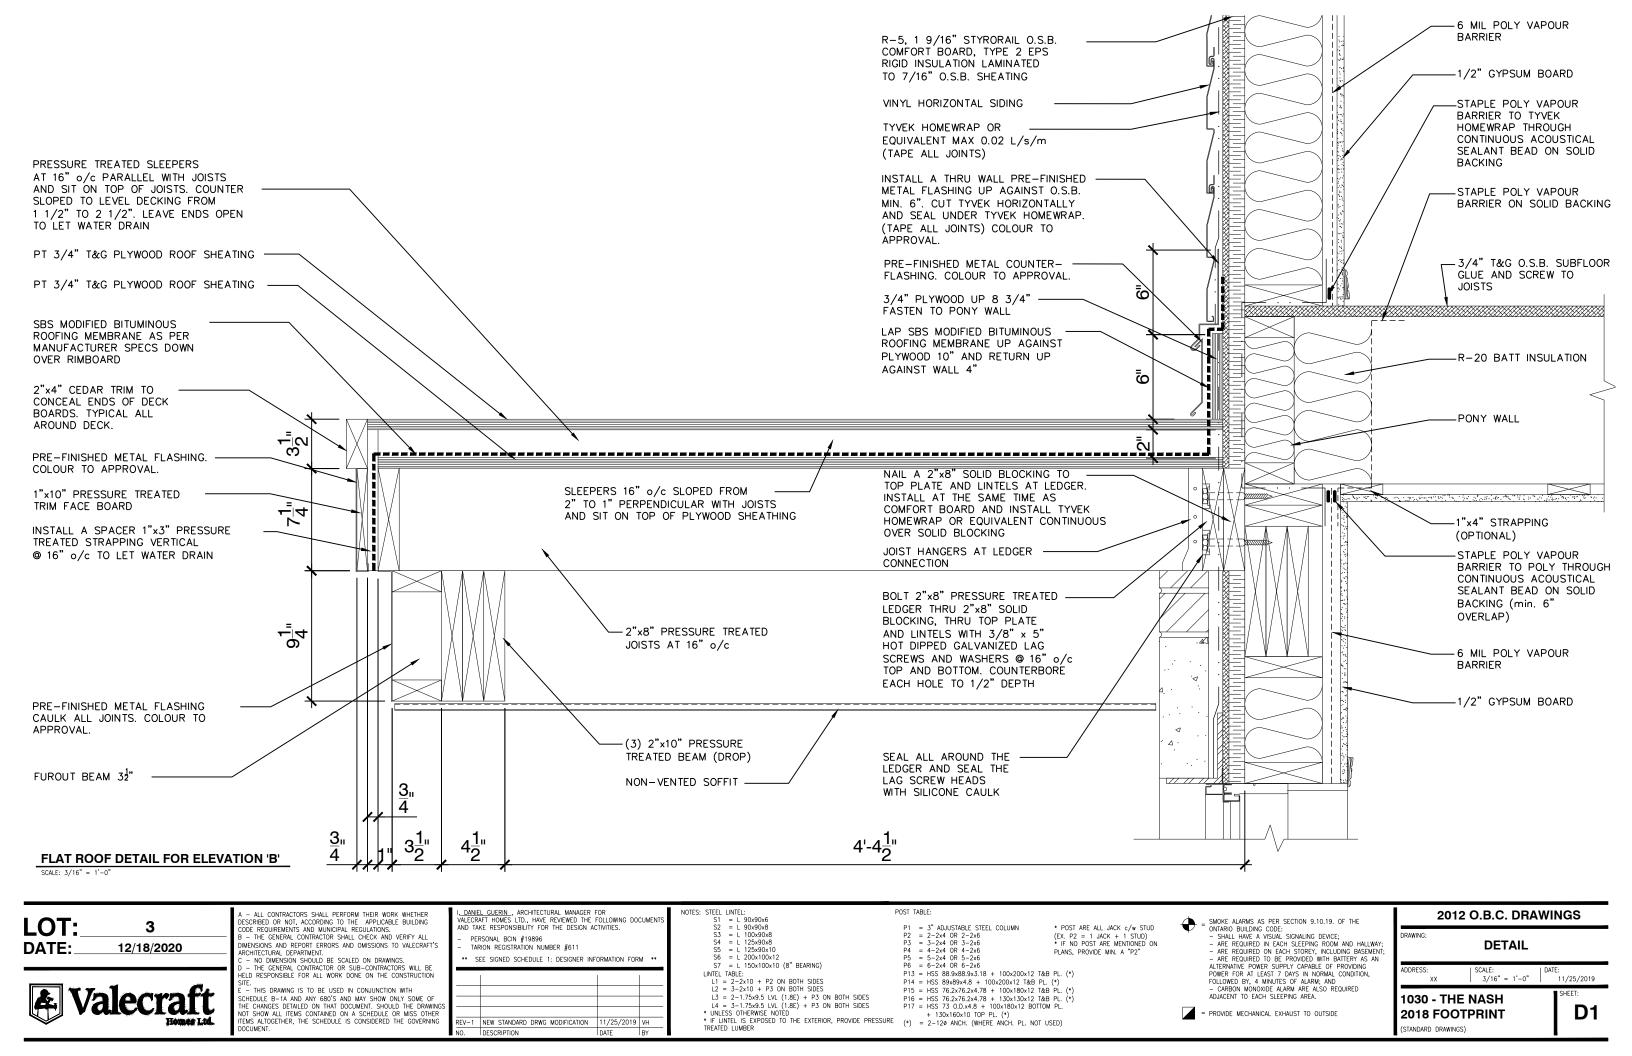

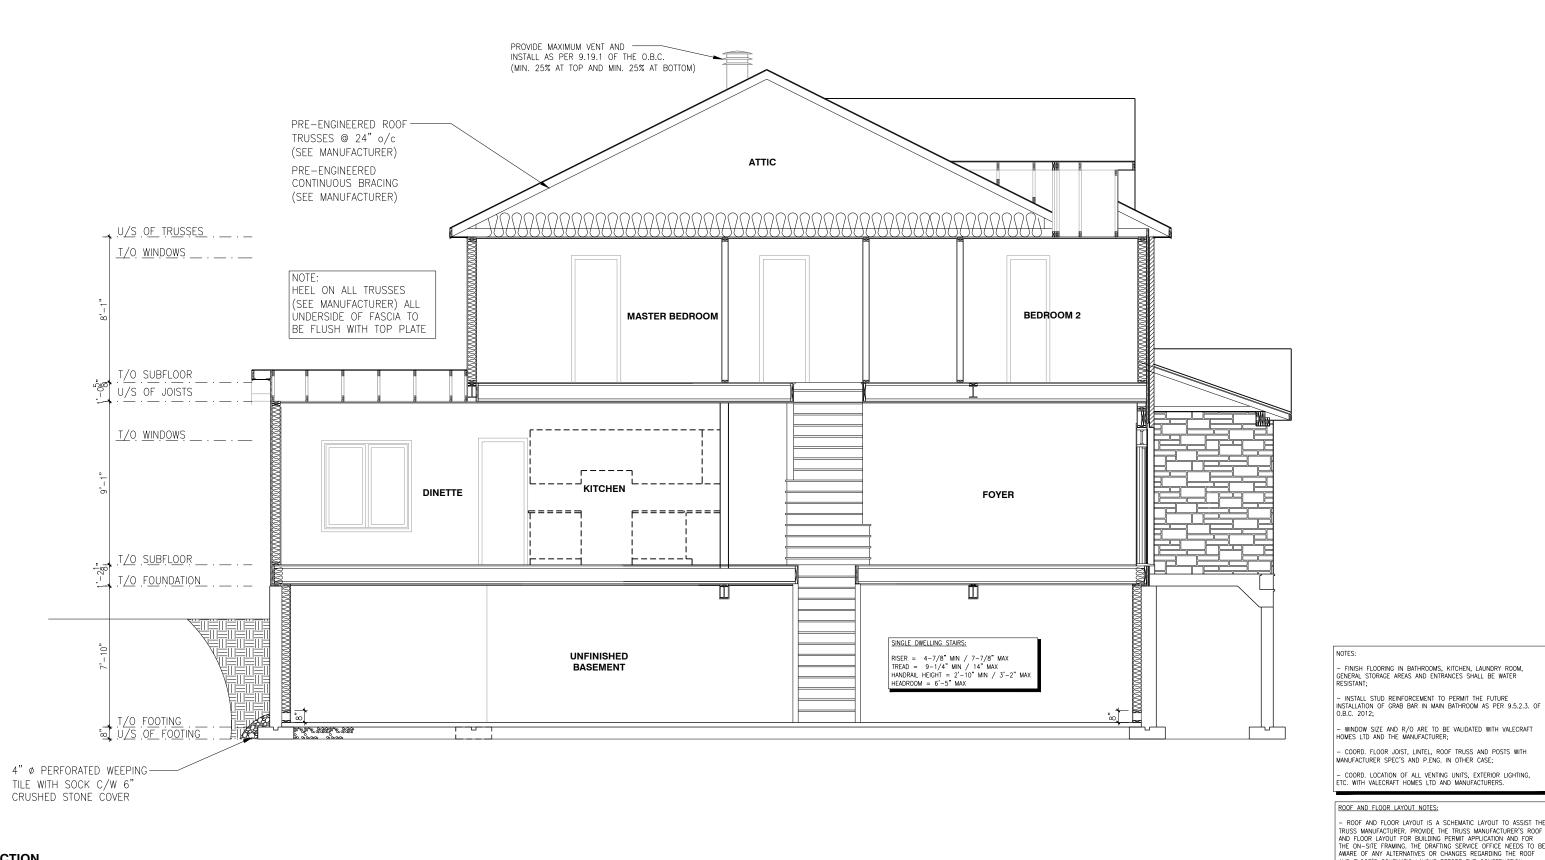

SECTION

SCALE: 3/16" = 1'-0"

LOT:

DATE:

3

12/18/2020

Valecraft

A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

B - THE GENERAL CONTRACTOR SHALL CHECK AND VENITY ALL
DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S
ARCHITECTURAL DEPARTMENT.
C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE
HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION
SITE.

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL CUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611 ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

L 90x90x8 100x90x8

125x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3" ADJUSTABLE STEEL COLUMN

P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6

S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
LITEL TABLE: P13 = HSS 88.9x89.x3.18 + 100x200x12 T&B P.L. t
L1 = 2-2x10 + P2 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B P.L. t
L2 = 3-2x10 + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B P.L. t
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B P.L. t
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL. t
VINLESS OTHERWISE NOTED P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL. t
+ 130x160x10 TOP PL. (*)
TREATED LUMBER P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.0x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

PLANS, PROVIDE MIN. A "P2"

- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.


SECTION

11/25/2019

1030 - THE NASH **2018 FOOTPRINT**

STANDARD DRAWINGS)

S1

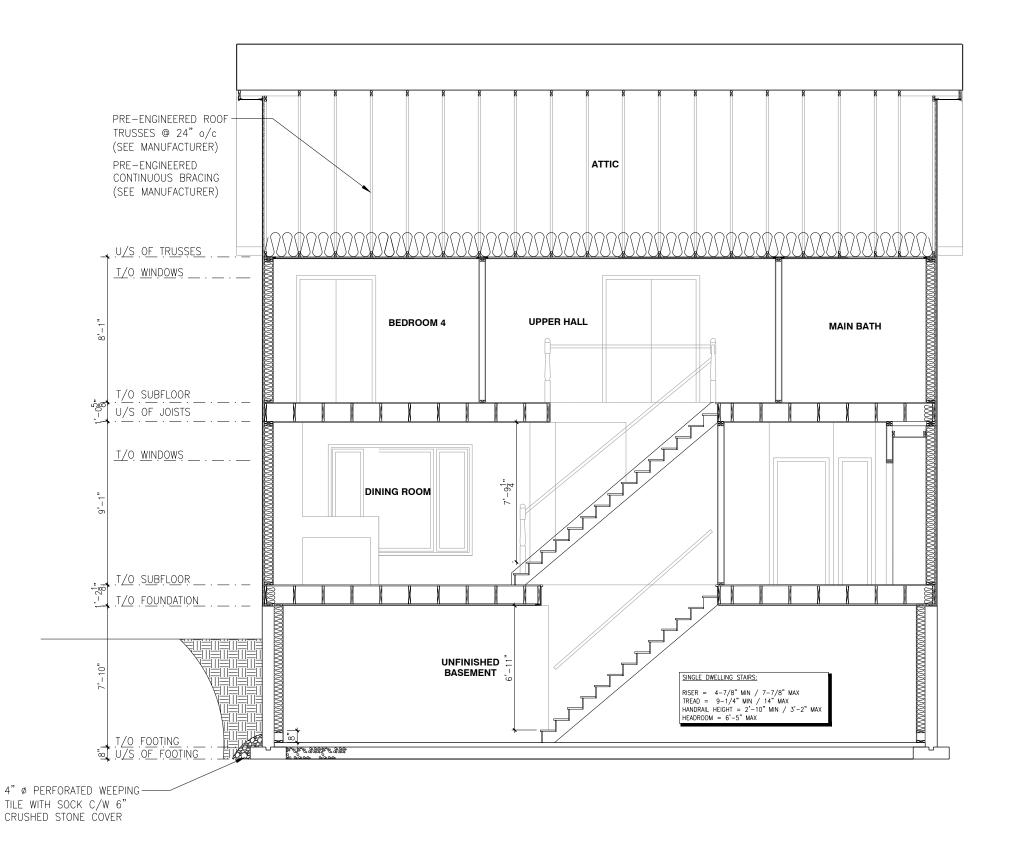

SECTION

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020



A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S

DIMENSIONS AND EPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

L 90x90x8 . 100x90x8

= L 125x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES

L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES

L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES | P16 = HSS 73 O.D.x4.8.7 A + 130x130x12 L8CB PL.

**UNLESS OTHERWISE NOTED + 130x160x10 TOP PL. (*) + 130x160x10 TOP PL. (*) |

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE (*) = 2-12\(\text{P} \) ANCH. (WHERE ANCH. PL. NOT USED)

P1 = 3" ADJUSTABLE STEEL COLUMN

P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6

P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)

P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.0x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)

PLANS, PROVIDE MIN. A "P2"

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

- SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:
- SHALL HAVE A VISUAL SIGNALING DEVICE;
- ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;
- ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;
- ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND
- CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF

AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

— FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;

- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH

COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

0.B.C. 2012;

ROOF AND FLOOR LAYOUT NOTES:


SECTION

ADDRESS: 11/25/2019

1030 - THE NASH **2018 FOOTPRINT**

STANDARD DRAWINGS)

S1

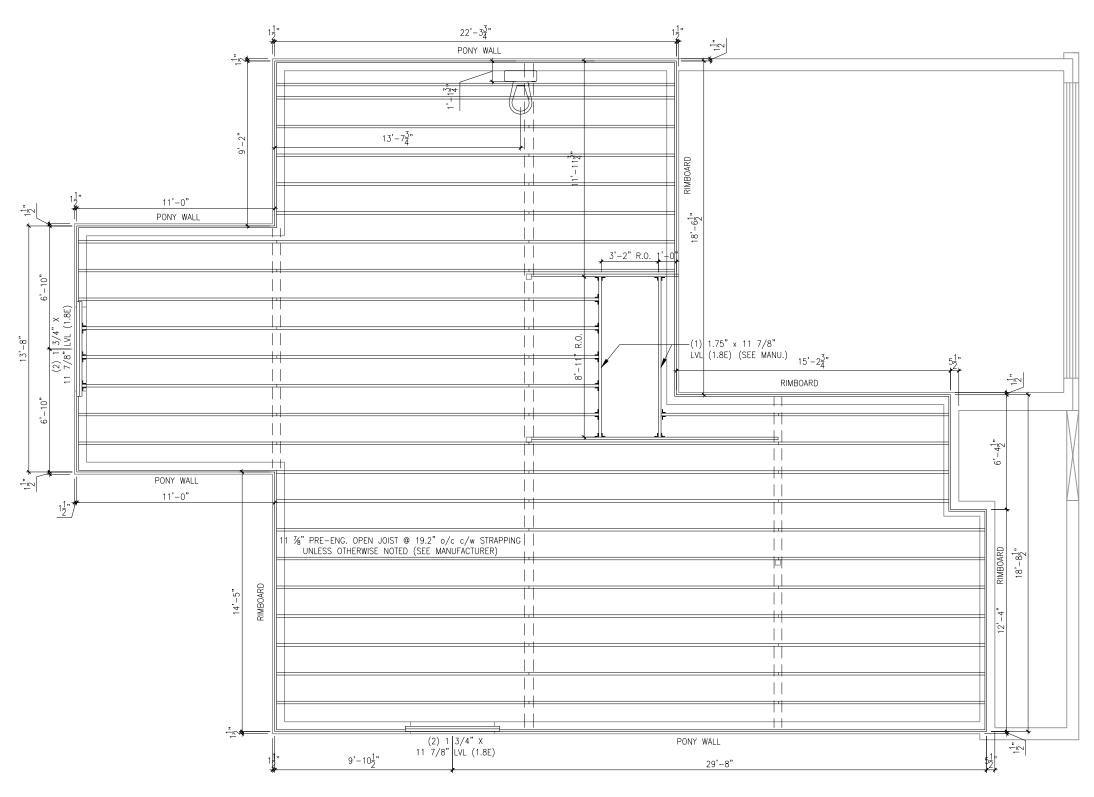

GROUND FLOOR JOIST LAYOUT

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020



A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT

ARCHIECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611 ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

 REV-1
 NEW STANDARD DRWG MODIFICATION
 11/25/2019
 VH

 NO.
 DESCRIPTION
 DATE
 RY

L 90x90x8 100x90x8

125x90x8 = L 120x90x0 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3" ADJUSTABLE STEEL COLUMN P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6

LINTEL TABLE:

L1 = 2-2x10 + P2 ON BOTH SIDES

L2 = 3-2x10 + P3 ON BOTH SIDES

L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES

L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES

L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES

UNLESS OTHERWISE NOTED

UNLESS OTHERWISE NOTED

UNLESS OTHERWISE NOTED

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER*

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER*

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER*

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER*

**IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE TREATED LUMBER*

**IF LINTEL IS BOX 98.98.98.18 + 100x200x12 T&B PL. (*)

174 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

185 = 185 = 185 = 180.89x88.93.18 + 100x200x12 T&B PL. (*)

186 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)

191 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

191 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

191 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

192 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

193 = HSS 88.9x88.93.18 + 100x200x12 T&B PL. (*)

194 = HSS 89.x88.93.18 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 130x180x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

194 = HSS 89.x88.93.18 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x20x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

195 = HSS 76.2x6.2x4.78 + 100x200x12 T&B PL. (*)

196 = HSS 7 P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x476.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF

AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

RAWING: GROUND FLOOR JOIST

— FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

O.B.C. 2012;

ROOF AND FLOOR LAYOUT NOTES:

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER; - COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE; COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.


LAYOUT "A,B,C"

1030 - THE NASH **2018 FOOTPRINT**

(STANDARD DRAWINGS)

A9

11/25/2019

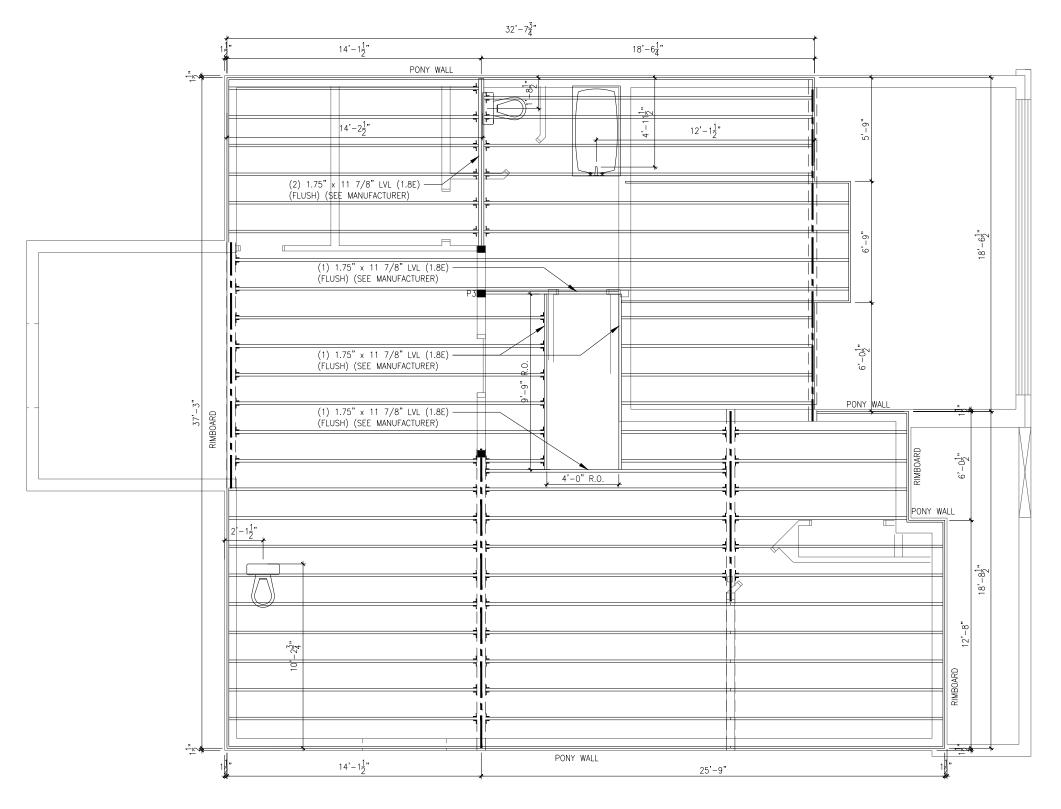

SECOND FLOOR JOIST LAYOUT

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020

Valecraft

A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT

- THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONDUNCTION WITH SCHEDULE B-TIA AND ANY G-80°S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

L 90x90x8 . 100x90x8 = L 105x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3" ADJUSTABLE STEEL COLUMN

P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6

S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
LITEL TABLE: P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
L1 = 2-2x10 + P2 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
L2 = 3-2x10 + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x476.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.D.x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)



* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

2012 O.B.C. DRAWINGS

AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF

- FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

0.B.C. 2012;

ROOF AND FLOOR LAYOUT NOTES:

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER; - COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE; COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

RAWING: SECOND FLOOR JOIST LAYOUT "A,B,C"

DATE: 11/25/2019

1030 - THE NASH

2018 FOOTPRINT (STANDARD DRAWINGS)


A10

ARCHIECTURAL DEPARTMENT.

C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.

D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

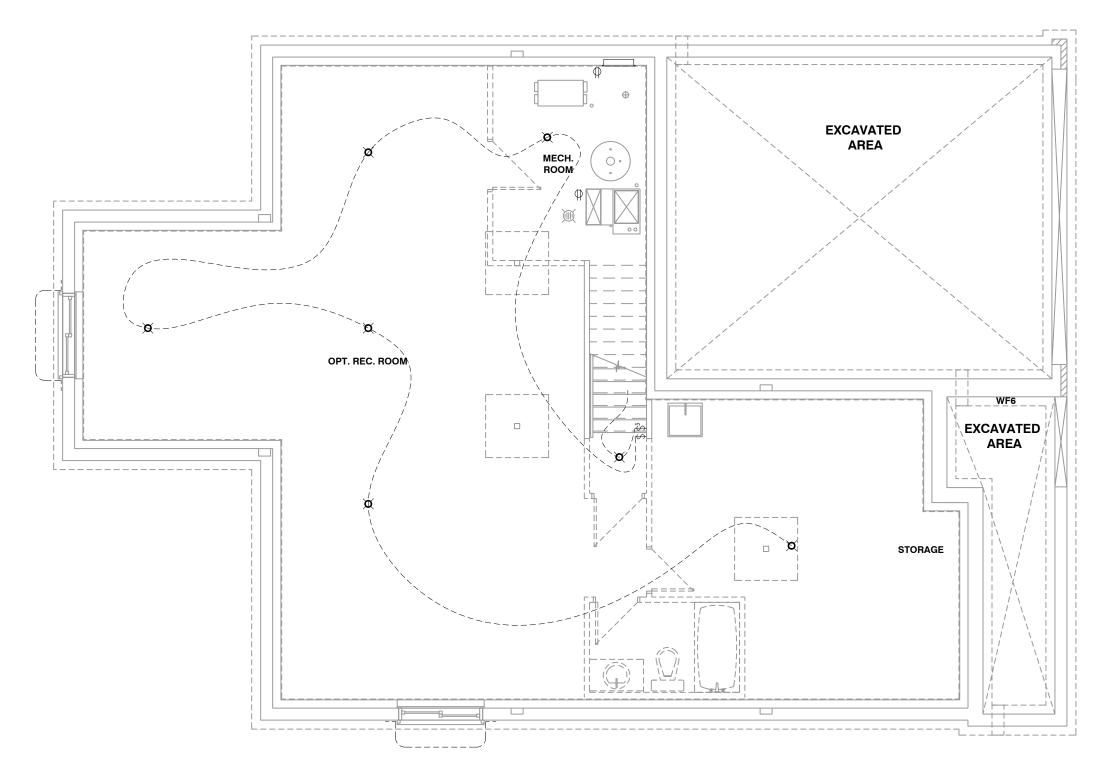

BASEMENT ELECTRICAL

LOT: 3 DATE: 12/18/2020



A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

B - THE GENERAL CONTRACTOR STALL CHECK AND VERIFY ALL
DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S
ARCHITECTURAL DEPARTMENT.
C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE
HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION
SITE.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611 ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

 REV-1
 NEW STANDARD DRWG MODIFICATION
 11/25/2019
 VH

 NO.
 DESCRIPTION
 DATE
 BY

L 90x90x8 100x90x8

= L 125x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
LITEL TABLE: P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
L1 = 2-2x10 + P2 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
L2 = 3-2x10 + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER P13 = HSS 88.9x89.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89.x89.x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.D.x4.8 + 100x180x12 B0TTOM PL.
+ 130x160x10 TOP PL. (*)

P1 = 3" ADJUSTABLE STEEL COLUMN

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, A MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

— FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

O.B.C. 2012;

ROOF AND FLOOR LAYOUT NOTES:

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER; - COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE; COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

BASEMENT FLOOR ELECTRICAL

DATE: 11/25/2019


1030 - THE NASH **2018 FOOTPRINT**

STANDARD DRAWINGS)

E00

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

PLANS, PROVIDE MIN. A "P2"

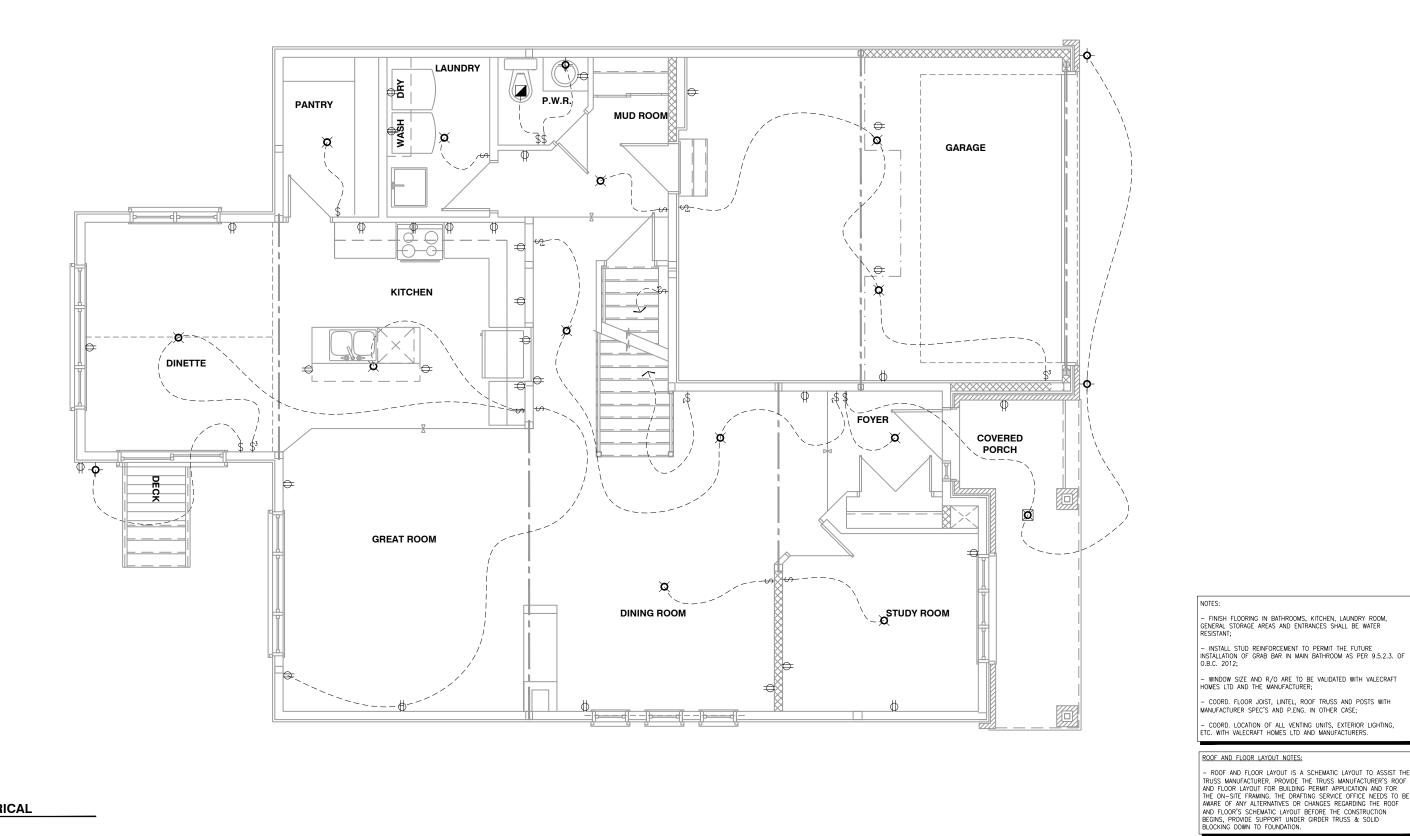

GROUND FLOOR ELECTRICAL

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020



A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

B - THE GENERAL CONTRACTOR SHALL CHECK AND VENITY ALL
DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S
ARCHITECTURAL DEPARTMENT.
C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE
HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION
SITE.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES.

PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611 ** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

L 90x90x8 100x90x8 = L 105x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3" ADJUSTABLE STEEL COLUMN

* POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 PLANS, PROVIDE MIN. A "P2"

S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
LITEL TABLE: P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
L1 = 2-2x10 + P2 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
L2 = 3-2x10 + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*) P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.0x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, A MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE

2012 O.B.C. DRAWINGS

- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE;

FIRST FLOOR

ELECTRICAL ADDRESS:

1030 - THE NASH **2018 FOOTPRINT**

(STANDARD DRAWINGS)

E01

11/25/2019

SECOND FLOOR ELECTRICAL

SCALE: 3/16" = 1'-0"

LOT: 3 DATE: 12/18/2020

Valecraft

A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS.
B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

B - THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S ARCHITECTURAL DEPARTMENT. C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS. D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION STEE

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH E - I HIS DRAWING IS TO BE USED IN COUNCITION WITH SOME OF SCHEDULE B - 1A AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOCETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

SI	EE SIGNED	SCHED	ULE 1	: DESIGNER	INF	NOITAMAC	FOR	M **	ı
									ı
									1
									ı
									ı
- 1	NEW STAN	IDARD [ORWG	MODIFICATIO	N	11/25/2	019	VH	ı
	DESCRIPTI	ON				DATE		BY	

= L 90x90x8 L 100x90x8 = L 105x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
L1 = 2-2x10 + P2 ON BOTH SIDES P13 = HSS 88.9x89.x3.18 + 100x200x12 T&B PL. (*)
L2 = 3-2x10 + P3 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
* UNLESS OTHERWISE NOTED
* UNLESS OTHERWISE NOTED
* UNLESS OTHERWISE NOTED
* IF LINTEL IS EXPOSED TO THE EXTERIOR, PROVIDE PRESSURE
TREATED LUMBER

P1 = 3" ADJUSTABLE STEEL COLUMN P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6 * POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON

PLANS, PROVIDE MIN. A "P2"

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, 4 MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA. = PROVIDE MECHANICAL EXHAUST TO OUTSIDE

- FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF

WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;

- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE;

- COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

ROOF AND FLOOR LAYOUT NOTES:

ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

2012 O.B.C. DRAWINGS


SECOND FLOOR ELECTRICAL

ADDRESS: 11/25/2019

1030 - THE NASH **2018 FOOTPRINT**

(STANDARD DRAWINGS)

E02

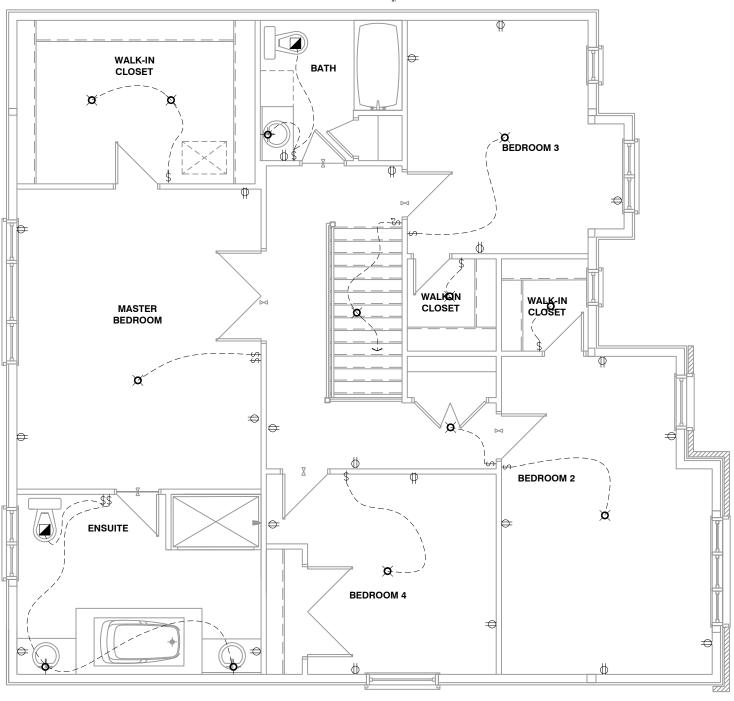

- FINISH FLOORING IN BATHROOMS, KITCHEN, LAUNDRY ROOM, GENERAL STORAGE AREAS AND ENTRANCES SHALL BE WATER RESISTANT;

- INSTALL STUD REINFORCEMENT TO PERMIT THE FUTURE INSTALLATION OF GRAB BAR IN MAIN BATHROOM AS PER 9.5.2.3. OF 0.B.C. 2012;
- WINDOW SIZE AND R/O ARE TO BE VALIDATED WITH VALECRAFT HOMES LTD AND THE MANUFACTURER;
- COORD. FLOOR JOIST, LINTEL, ROOF TRUSS AND POSTS WITH MANUFACTURER SPEC'S AND P.ENG. IN OTHER CASE;
- COORD. LOCATION OF ALL VENTING UNITS, EXTERIOR LIGHTING, ETC. WITH VALECRAFT HOMES LTD AND MANUFACTURERS.

ROOF AND FLOOR LAYOUT NOTES:

- ROOF AND FLOOR LAYOUT IS A SCHEMATIC LAYOUT TO ASSIST THE TRUSS MANUFACTURER. PROVIDE THE TRUSS MANUFACTURER'S ROOF AND FLOOR LAYOUT FOR BUILDING PERMIT APPLICATION AND FOR THE ON-SITE FRAMING. THE DRAFTING SERVICE OFFICE NEEDS TO BE AWARE OF ANY ALTERNATIVES OR CHANGES REGARDING THE ROOF AND FLOOR'S SCHEMATIC LAYOUT BEFORE THE CONSTRUCTION BEGINS, PROVIDE SUPPORT UNDER GIRDER TRUSS & SOLID BLOCKING DOWN TO FOUNDATION.

SMOKE ALARMS AS PER SECTION 9.10.19. OF THE ONTARIO BUILDING CODE:

SHALL HAVE A VISUAL SIGNALING DEVICE;

ARE REQUIRED IN EACH SLEEPING ROOM AND HALLWAY;

ARE REQUIRED ON EACH STOREY, INCLUDING BASEMENT;

ARE REQUIRED TO BE PROVIDED WITH BATTERY AS AN ALTERNATIVE POWER SUPPLY CAPABLE OF PROVIDING POWER FOR AT LEAST 7 DAYS IN NORMAL CONDITION, FOLLOWED BY, A MINUTES OF ALARM; AND

CARBON MONOXIDE ALARM ARE ALSO REQUIRED ADJACENT TO EACH SLEEPING AREA.

Valecraft

SECOND FLOOR ELECTRICAL

3

12/18/2020

SCALE: 3/16" = 1'-0"

LOT:

DATE:

A – ALL CONTRACTORS SHALL PERFORM THEIR WORK WHETHER DESCRIBED OR NOT, ACCORDING TO THE APPLICABLE BUILDING CODE REQUIREMENTS AND MUNICIPAL REGULATIONS. B – THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL

B - THE GENERAL CONTRACTOR STALL CHECK AND VERIFY ALL
DIMENSIONS AND REPORT ERRORS AND OMISSIONS TO VALECRAFT'S
ARCHITECTURAL DEPARTMENT.
C - NO DIMENSION SHOULD BE SCALED ON DRAWINGS.
D - THE GENERAL CONTRACTOR OR SUB-CONTRACTORS WILL BE
HELD RESPONSIBLE FOR ALL WORK DONE ON THE CONSTRUCTION
SITE.

THIS DRAWING IS TO BE USED IN CONJUNCTION WITH

I<u>DANIEL GUERIN</u>, ARCHITECTURAL MANAGER FOR VALECRAFT HOMES LTD., HAVE REVIEWED THE FOLLOWING DOCUMENTS AND TAKE RESPONSIBILITY FOR THE DESIGN ACTIVITIES. PERSONAL BCIN #19896 TARION REGISTRATION NUMBER #611

** SEE SIGNED SCHEDULE 1: DESIGNER INFORMATION FORM

REV-1 NEW STANDARD DRWG MODIFICATION 11/25/2019 VH

L 90x90x8 . 100x90x8 = L 125x90x8 = L 125x90x10 = L 200x100x12 = L 150x100x10 (8" BEARING)

P1 = 3" ADJUSTABLE STEEL COLUMN * POST ARE ALL JACK c/w STUD (EX. P2 = 1 JACK + 1 STUD) * IF NO POST ARE MENTIONED ON P1 = 3 ADJUSTABLE STE P2 = 2-2x4 OR 2-2x6 P3 = 3-2x4 OR 3-2x6 P4 = 4-2x4 OR 4-2x6 P5 = 5-2x4 OR 5-2x6 P6 = 6-2x4 OR 6-2x6

PLANS, PROVIDE MIN. A "P2" P13 = HSS 88.9x8.9x3.18 + 100x200x12 T&B PL. (*)
P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)

2012 O.B.C. DRAWINGS

SECOND FLOOR ELECTRICAL

ADDRESS: 11/25/2019

1030 - THE NASH **2018 FOOTPRINT**

(STANDARD DRAWINGS)

E02

S7 = L 150x100x10 (8" BEARING) P6 = 6-2x4 OR 6-2x6
LITEL TABLE: P13 = HSS 88.9x88.9x3.18 + 100x200x12 T&B PL. (*)
L1 = 2-2x10 + P2 ON BOTH SIDES P14 = HSS 89x89x4.8 + 100x200x12 T&B PL. (*)
L2 = 3-2x10 + P3 ON BOTH SIDES P15 = HSS 76.2x76.2x4.78 + 100x180x12 T&B PL. (*)
L3 = 2-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
L4 = 3-1.75x9.5 LVL (1.8E) + P3 ON BOTH SIDES P17 = HSS 73 O.D.x4.8 + 100x180x12 BOTTOM PL.

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER

* UNLESS OTHERWISE NOTED PRESSURE
TREATED LUMBER E - HIS DRAWING IS TO BE USED IN CONJUNCTION WITH SCHEDULE B-IA AND ANY 680'S AND MAY SHOW ONLY SOME OF THE CHANGES DETAILED ON THAT DOCUMENT. SHOULD THE DRAWINGS NOT SHOW ALL ITEMS CONTAINED ON A SCHEDULE OR MISS OTHER ITEMS ALTOGETHER, THE SCHEDULE IS CONSIDERED THE GOVERNING DOCUMENT. P16 = HSS 76.2x76.2x4.78 + 130x130x12 T&B PL. (*)
P17 = HSS 73 0.0x4.8 + 100x180x12 BOTTOM PL.
+ 130x160x10 TOP PL. (*)

= PROVIDE MECHANICAL EXHAUST TO OUTSIDE